



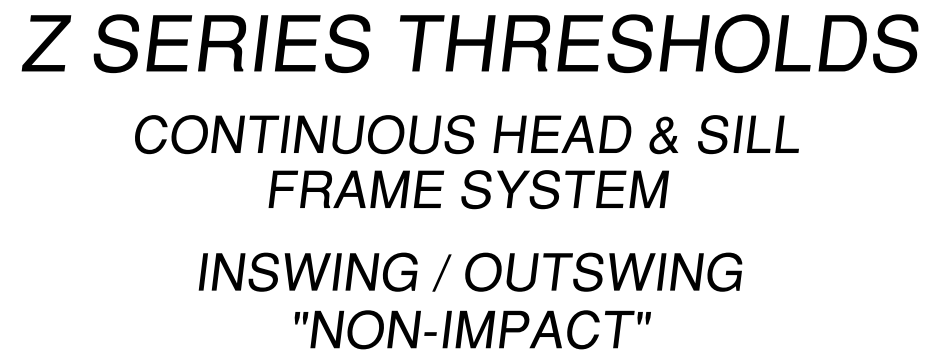


1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. This product has been tested and is approved for use in the door panels as specified in this approval. Substitution into a similar product that possess a comparable current Florida Statewide product approval may be approved for use by the local Authority Having Jurisdiction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

| TABLE OF CONTENTS |                                               |
|-------------------|-----------------------------------------------|
| SHEET#            | DESCRIPTION                                   |
| 1                 | Typical Elevation & General Notes             |
| 2                 | Z Series Threshold Details & Design Pressures |
| 3                 | Door Panel Details                            |
| 4                 | Sidelite Panel Details                        |
| 5                 | Elevations                                    |
| 6                 | Vertical Cross Sections                       |
| 7                 | Horizontal Cross Sections                     |
| 8                 | Buck Anchoring                                |
| 9                 | Frame Anchoring & Hardware Details            |
| 10                | Bill of Materials & Components                |

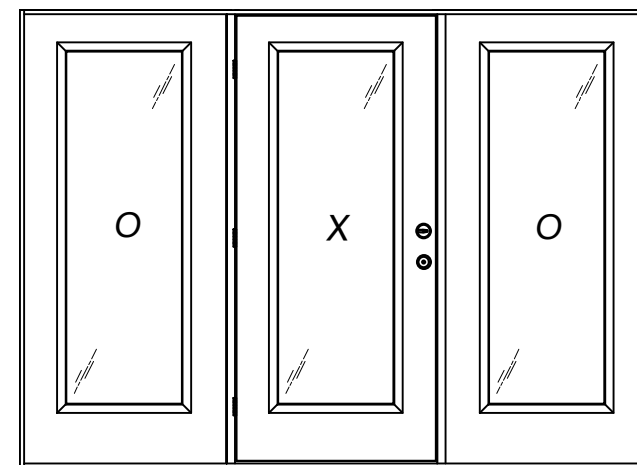

JELD-WEN GLAZED STEEL  
SINGLE DOOR w/ SIDELITE(S)

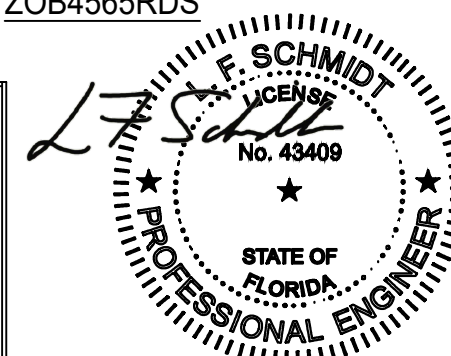

Digitally signed by Lyndon F  
Schmidt  
Date: 2026.07.17 12:03:57 -04'00'

This item has been digitally signed and sealed by  
**L. F. Schmidt, P.E.** on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.


THIS PRODUCT APPROVAL IS VALID  
ONLY FOR THE STATE OF FLORIDA

***RW***  
BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813


**ASSEMBLY:**

[illegible]


Z:\2023 FBC Drawings\Endura Products\FL-20698 R5\FL-20698.7-8.dwg

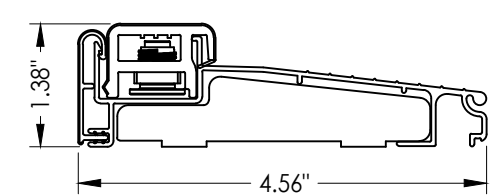


**T1 INSWING ADJUSTABLE THRESHOLD**  
ZAIL4565

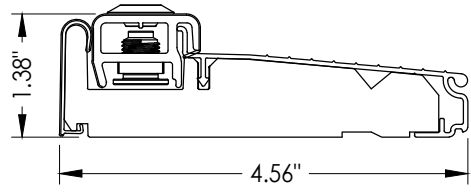


**T2 INSWING ADJUSTABLE THRESHOLD**  
ZAI4565FN

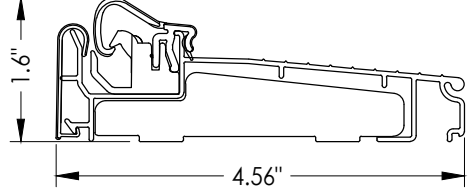


**T6 INSWING ARTICULATING THRESHOLD**  
ZACL4565

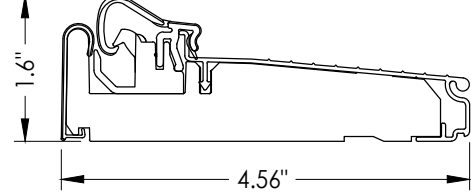


**T7 INSWING ARTICULATING THRESHOLD**  
ZAC4565FN

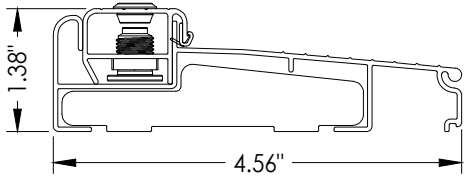


**T3 INSWING ADJUSTABLE THRESHOLD**  
ZAILAA4565

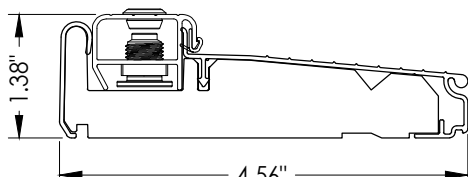


**T4 INSWING ADJUSTABLE THRESHOLD**  
ZAILAA4565FN

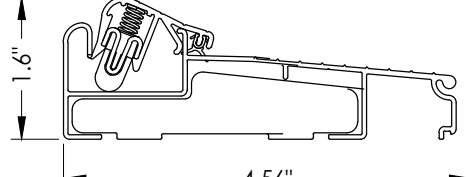


**T8 INSWING ARTICULATING THRESHOLD**  
ZACLAA4565

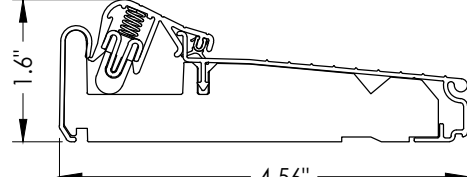

**T9 INSWING ARTICULATING THRESHOLD**  
ZACAA4565FN

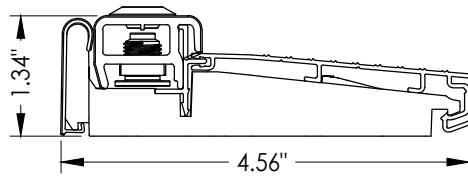


**T5 INSWING ADJUSTABLE THRESHOLD**  
ZAI4565RDS

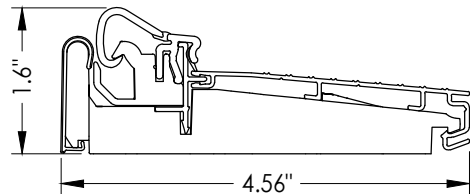


**T10 INSWING ARTICULATING THRESHOLD**  
ZAC4565RDS

| INSWING ADJUSTABLE THRESHOLD |               |                    |                              |          |
|------------------------------|---------------|--------------------|------------------------------|----------|
| DOOR PANEL                   | CONFIGURATION | MAXIMUM FRAME SIZE | DESIGN PRESSURE RATING (PSF) |          |
|                              |               |                    | POSITIVE                     | NEGATIVE |
| JELD-WEN GLAZED STEEL        | OX / XO       | 74.75" X 81.94"    | +50.0                        | -50.0    |
|                              | OXO           | 112.2" X 81.94"    |                              |          |


| INSWING ARTICULATING THRESHOLD |               |                    |                              |          |
|--------------------------------|---------------|--------------------|------------------------------|----------|
| DOOR PANEL                     | CONFIGURATION | MAXIMUM FRAME SIZE | DESIGN PRESSURE RATING (PSF) |          |
|                                |               |                    | POSITIVE                     | NEGATIVE |
| JELD-WEN GLAZED STEEL          | OX / XO       | 74.75" X 81.94"    | +50.0                        | -50.0    |
|                                | OXO           | 112.2" X 81.94"    |                              |          |

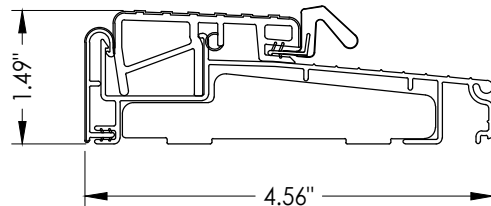

**T11 OUTSWING THRESHOLD**  
ZOBL4565

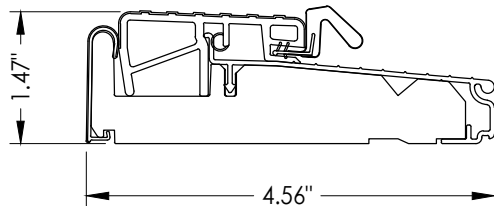

**T12 OUTSWING THRESHOLD**  
ZOB4565FN

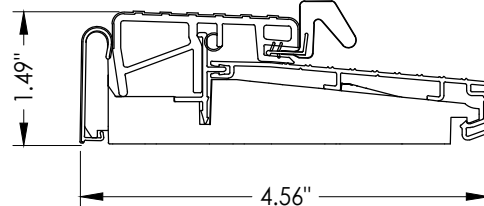

**T13 OUTSWING THRESHOLD**  
ZOB4565RDS

| OUTSWING FIXED BUMPER THRESHOLD |               |                    |                              |          |
|---------------------------------|---------------|--------------------|------------------------------|----------|
| DOOR PANEL                      | CONFIGURATION | MAXIMUM FRAME SIZE | DESIGN PRESSURE RATING (PSF) |          |
|                                 |               |                    | POSITIVE                     | NEGATIVE |
| JELD-WEN GLAZED STEEL           | OX / XO       | 74.75" X 81.13"    | +45.0                        | -45.0    |
|                                 | OXO           | 112.2" X 81.13"    |                              |          |

**NOTE:**

All thresholds are to be installed continuous throughout. The thresholds with the FN designation are manufactured in maximum 72" lengths and therefore may be used only in the OX or XO configurations or in the OXO configuration with smaller (14") sidelites.

Documents Prepared By:

Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

PRODUCT:

ENDURA

PART OR ASSEMBLY:

Z SERIES THRESHOLD DETAILS  
& DESIGN PRESSURES

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS



DRAWING NO.:

FL-20698.8

SHEET 2 OF 10

© 2016 R.W. BUILDING CONSULTANTS INC.


Z:\2023 FBC Drawings\Endura Products\FL-20698 R5\FL-20698.7-8.dwg

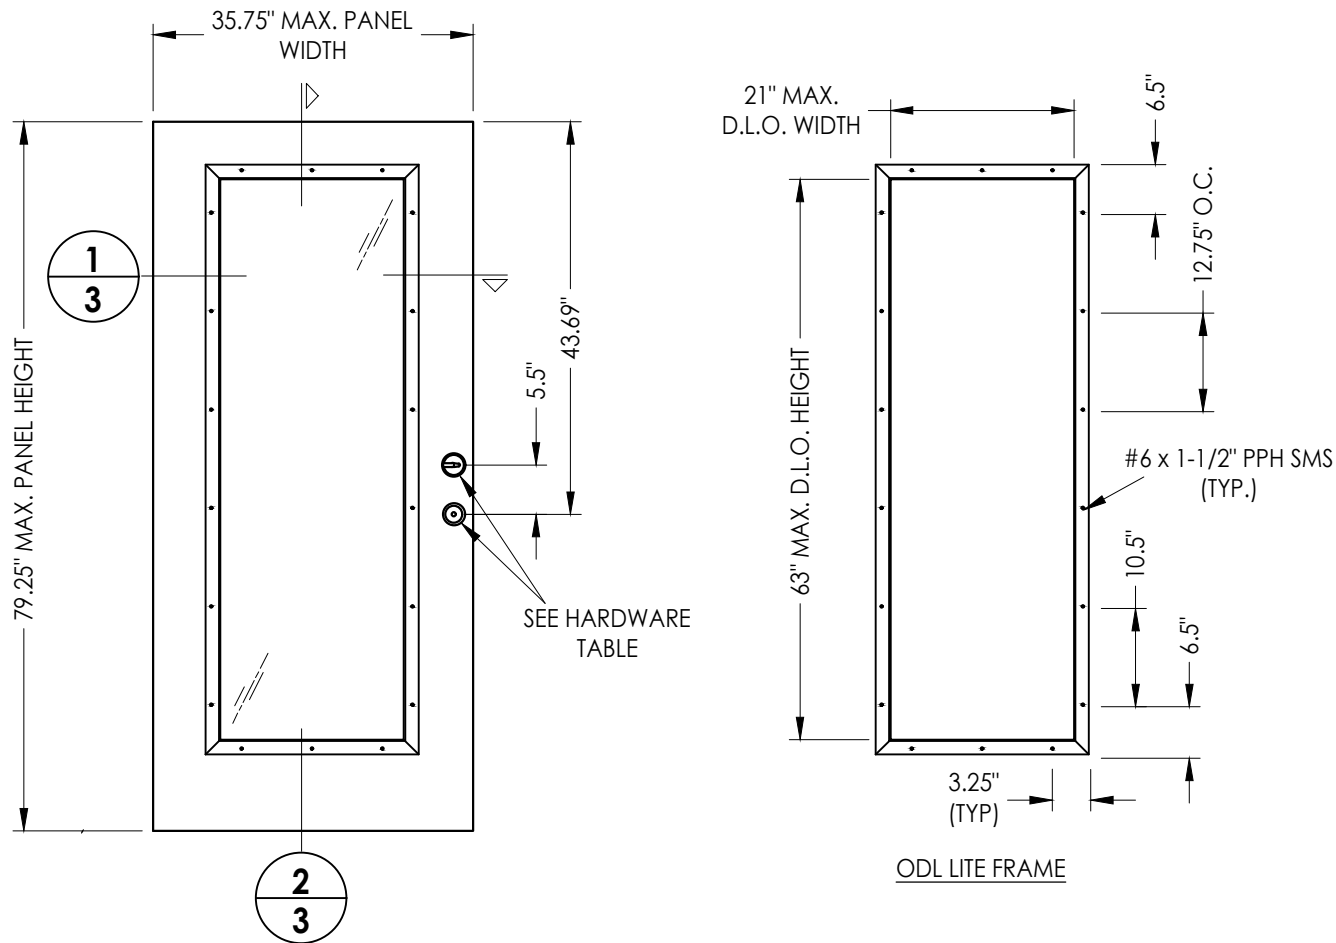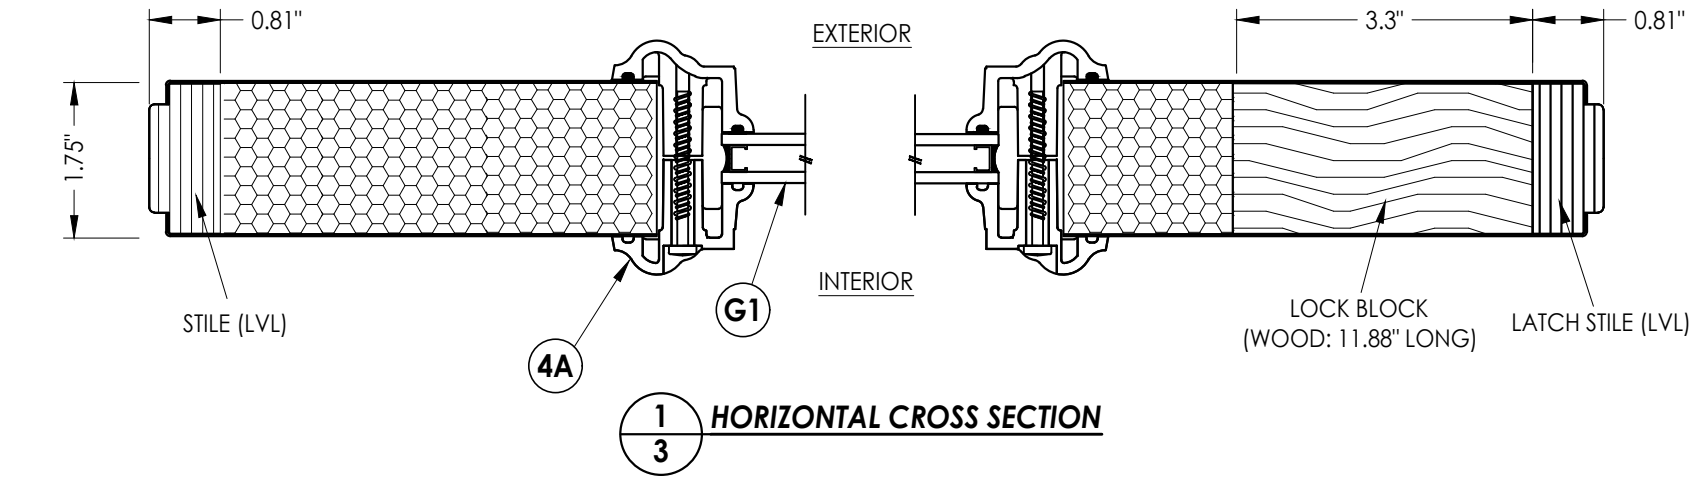

40 **DOOR PANEL**  
JELD-WEN  
Steel (Wood Edge)

| DOOR LOCK HARDWARE TABLE |           |                        |
|--------------------------|-----------|------------------------|
| MANUFACTURER             | MODEL     |                        |
| KWIKSET                  | Knob:     | SIGNATURE SERIES       |
|                          | DEADBOLT: | SIGNATURE SERIES (980) |

DOOR SKIN: 24 GA. STEEL (0.022" MIN. THICKNESS)  
CORE MATERIAL: POLYSTYRENE FOAM

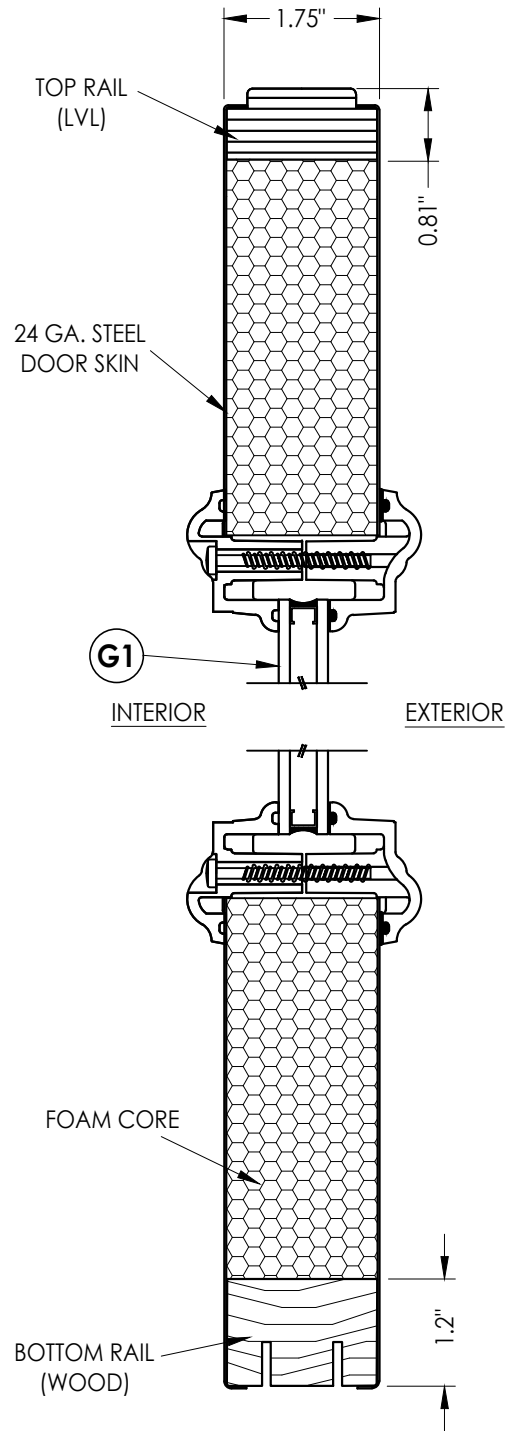

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20698.8

SHEET 3 OF 10

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409


**R<sup>2</sup>W** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: ENDURA


PART OR ASSEMBLY:  
DOOR PANEL DETAILS

| REVISIONS |         |                          |         |
|-----------|---------|--------------------------|---------|
| NO.       | DATE    | BY                       |         |
| 3         | 7/02/26 | UPDATE TO 9TH ED. (2026) | FBC LFS |
| 2         | 7/06/23 | UPDATE TO 8TH ED. (2023) | FBC LFS |
| 1         | 8/06/20 | UPDATE TO 7th ED. (2020) | FBC DAC |

Z:\2023 FBC Drawings\Endura Products\FL-20698 R5\FL-20698.7-8.dwg


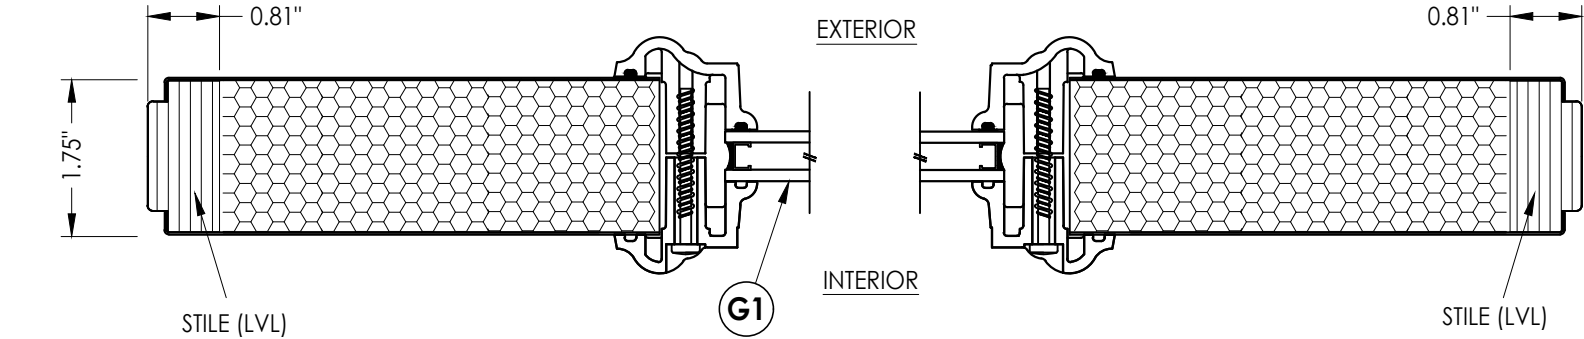


1  
4 HORIZONTAL CROSS SECTION

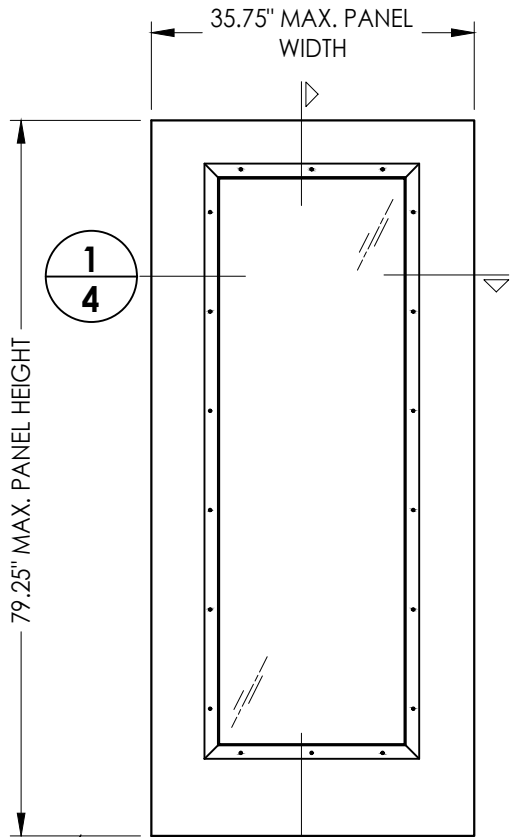


2  
4



50 SIDELITE PANEL  
JELD-WEN  
Steel (Wood Edge)

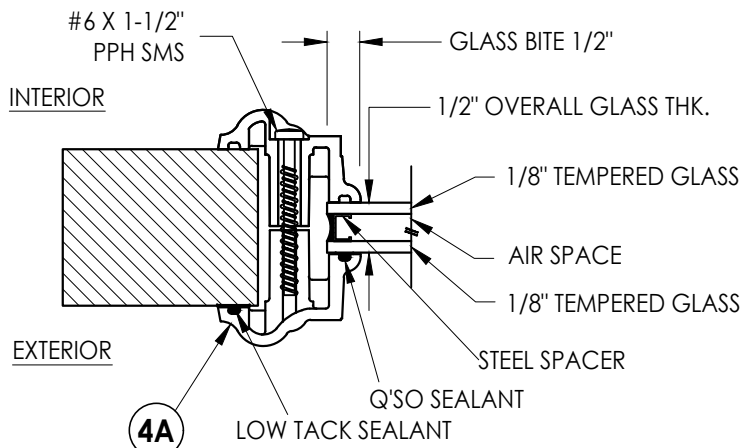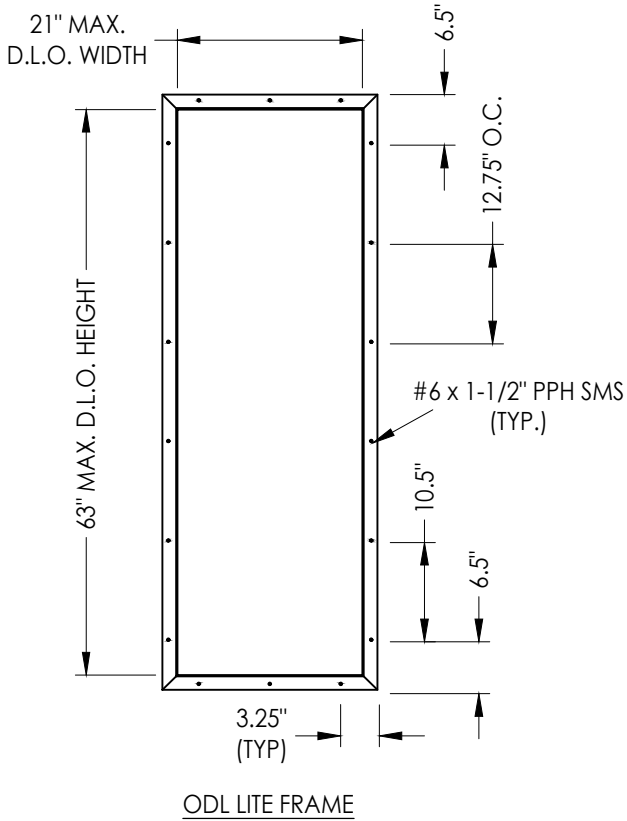

G1 GLAZING DETAIL

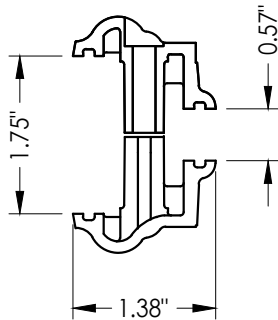

4A ODL LITE FRAME  
HP Polypropylene

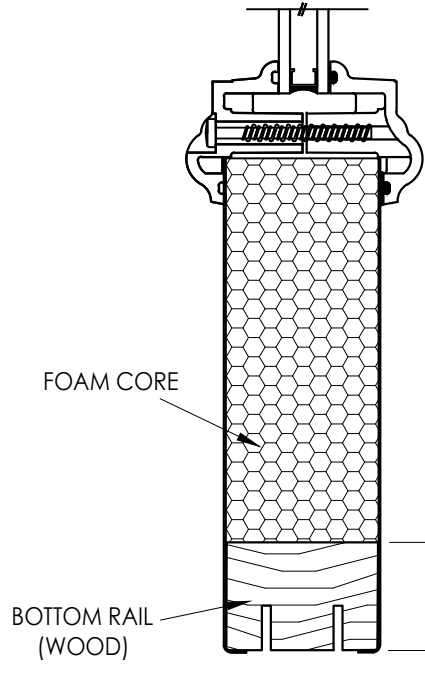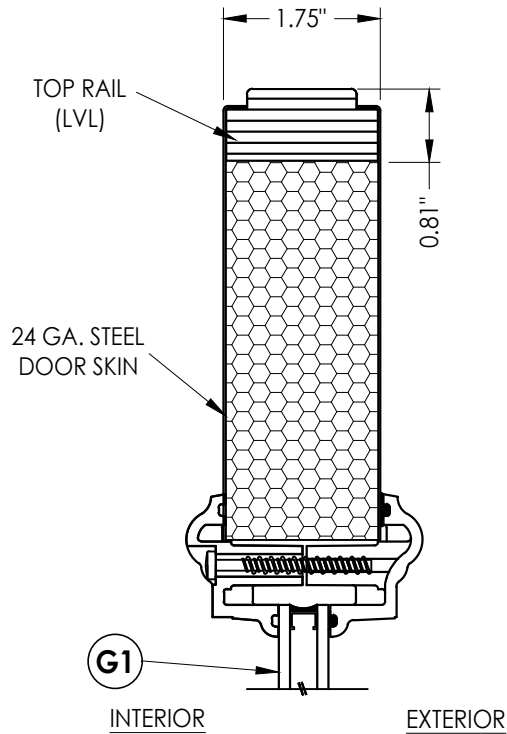

2  
4 VERTICAL CROSS SECTION

SIDELITE SKIN: 24 GA. STEEL (0.022" MIN. THICKNESS)  
CORE MATERIAL: POLYSTYRENE FOAM

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

*RW* BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

|                   |                        |
|-------------------|------------------------|
| PRODUCT:          | ENDURA                 |
| PART OR ASSEMBLY: | SIDELITE PANEL DETAILS |

| REVISIONS |         |                          |         |
|-----------|---------|--------------------------|---------|
| NO.       | DATE    | BY                       |         |
| 3         | 7/02/26 | UPDATE TO 9TH ED. (2026) | FBC LFS |
| 2         | 7/06/23 | UPDATE TO 8TH ED. (2023) | FBC LFS |
| 1         | 8/06/20 | UPDATE TO 7th ED. (2020) | FBC DAC |

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20698.8

SHEET 4 OF 10

Technical drawing of a three-door cabinet. The overall width is 112.2" MAX. The drawing shows three doors, each with a handle and a lock. The doors are labeled with callouts 1 through 8. The callouts are as follows:

- 1: Top left corner of the first door.
- 2: Top right corner of the first door.
- 3: Top left corner of the second door.
- 4: Top right corner of the second door.
- 5: Top left corner of the third door.
- 6: Top right corner of the third door.
- 7: Top left corner of the fourth door.
- 8: Top right corner of the fourth door.

The doors are labeled with 'O' and 'X' marks. The first door has an 'O' mark, the second door has an 'X' mark, and the third door has an 'O' mark. The fourth door has an 'O' mark. The callouts 1 through 8 are located at the corners of the doors. The callouts 1, 2, 3, and 4 are at the top corners, and the callouts 5, 6, 7, and 8 are at the bottom corners. The callouts 1, 2, 3, and 4 are located at the top corners of the first, second, and third doors. The callouts 5, 6, 7, and 8 are located at the bottom corners of the first, second, and third doors. The callouts 1, 2, 3, and 4 are located at the top corners of the first, second, and third doors. The callouts 5, 6, 7, and 8 are located at the bottom corners of the first, second, and third doors.


|           |         |                   |        |     |     |
|-----------|---------|-------------------|--------|-----|-----|
|           |         |                   |        |     |     |
|           |         |                   |        |     |     |
|           |         |                   |        |     |     |
|           |         |                   |        |     |     |
| 3         | 7/02/26 | UPDATE TO 9TH ED. | (2026) | FBC | LFS |
| 2         | 7/06/23 | UPDATE TO 8TH ED. | (2023) | FBC | LFS |
| 1         | 8/06/20 | UPDATE TO 7th ED. | (2020) | FBC | DAC |
| NO.       | DATE    |                   |        |     | BY  |
| REVISIONS |         |                   |        |     |     |

SHEET 5 OF 10


**SEMBLY:**  
**ELEVATIONS**

***RW***  
BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Endura Products\FL-20698 R5\FL-20698.7-8.dwg

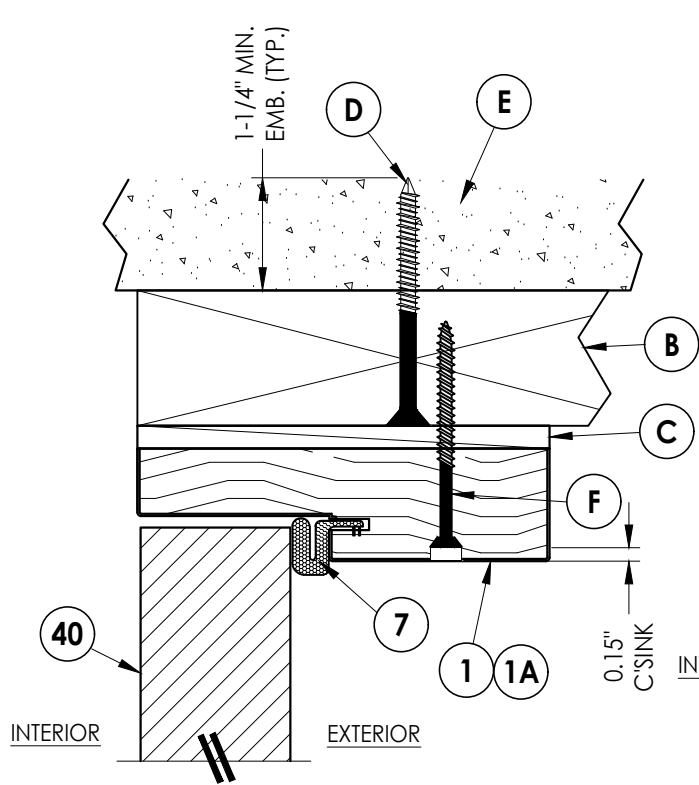

**1**  
**6** **VERTICAL CROSS SECTION**  
Inswing shown (Outswing similar)  
2X Buck Construction

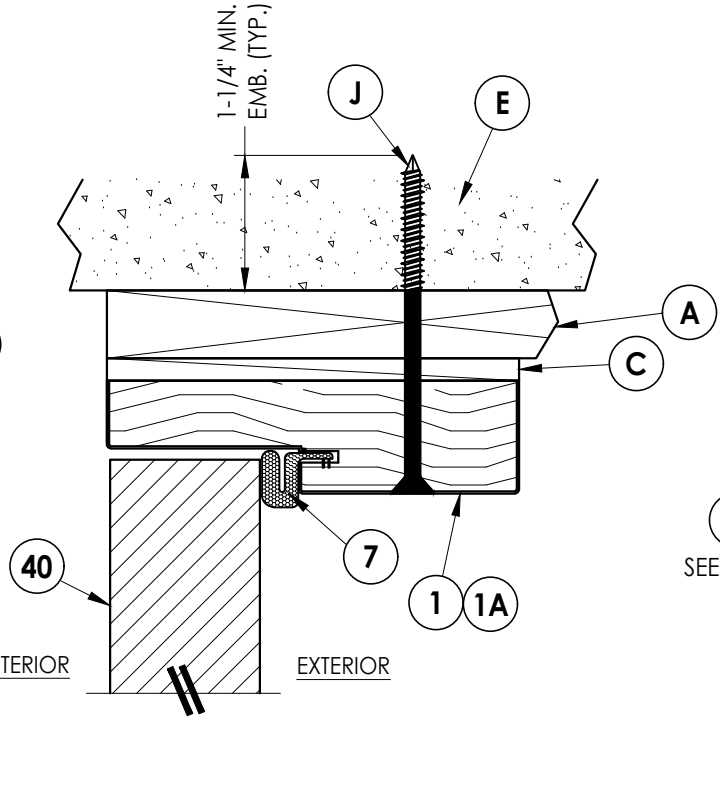


**2**  
**6** **VERTICAL CROSS SECTION**  
Inswing shown (Outswing similar)  
1X Buck Construction

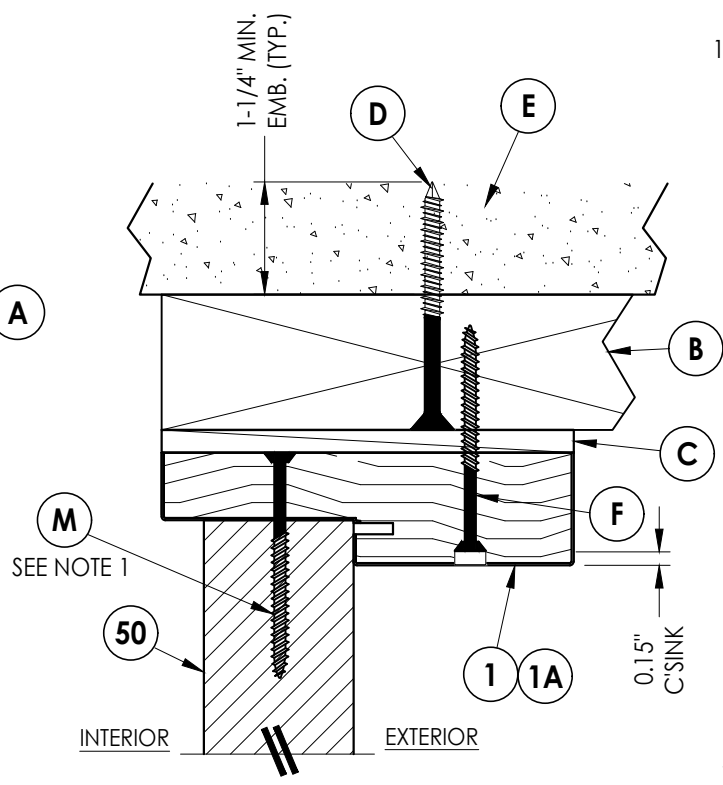


**3**  
**6** **VERTICAL CROSS SECTION**  
Inswing shown (Outswing similar)  
2X Buck Construction


NOTE:  
1. Spacing for sidelite screws (item M):  
6" from each end (2 total).

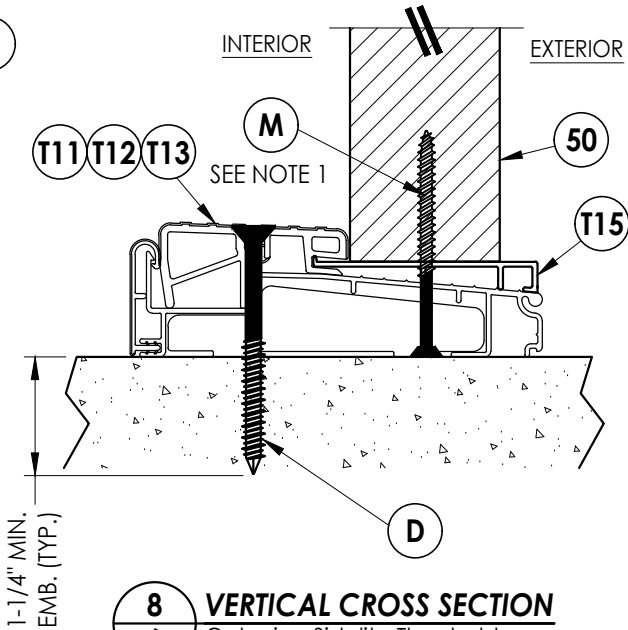


**8**  
**6** **VERTICAL CROSS SECTION**  
Outswing Sidelite Threshold

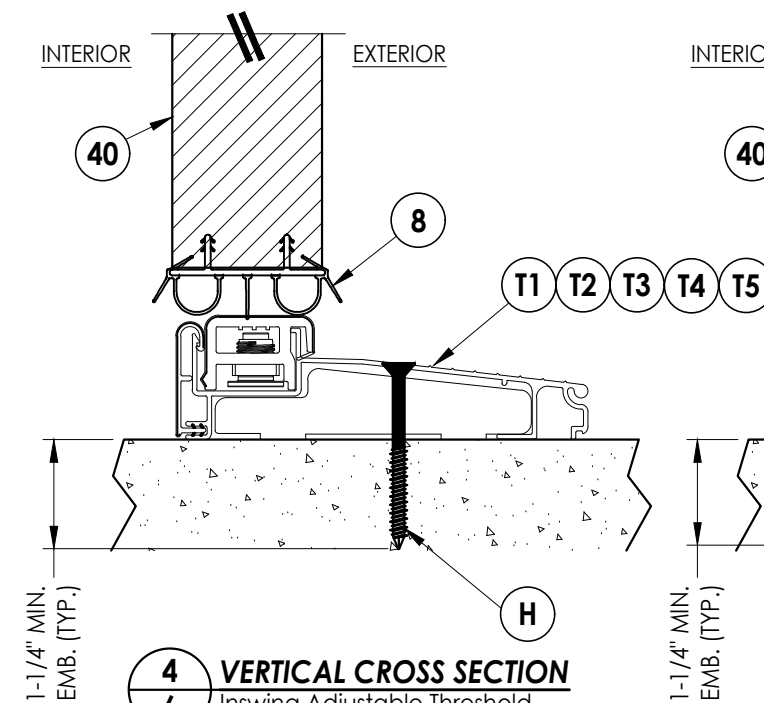


**4**  
**6** **VERTICAL CROSS SECTION**  
Inswing Adjustable Threshold

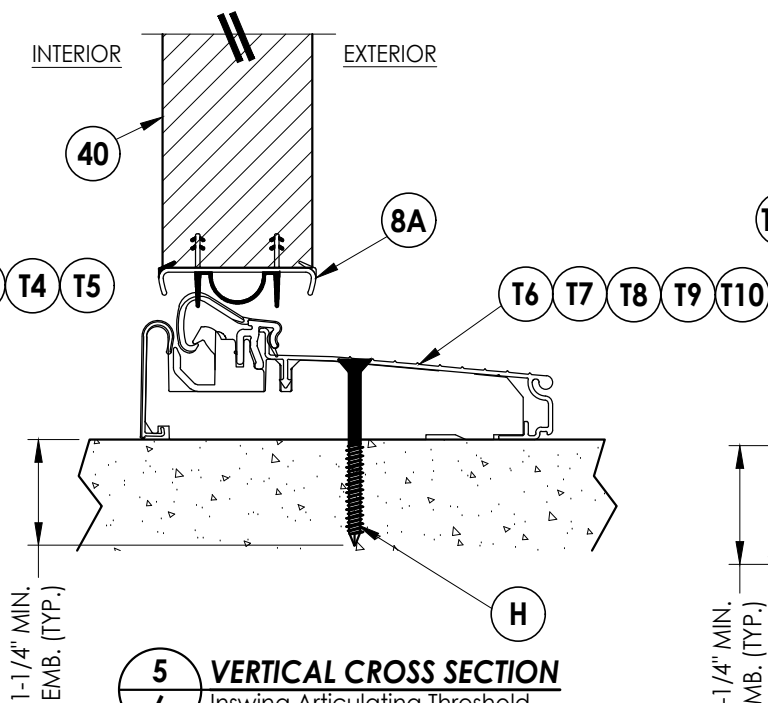

**5**  
**6** **VERTICAL CROSS SECTION**  
Inswing Articulating Threshold

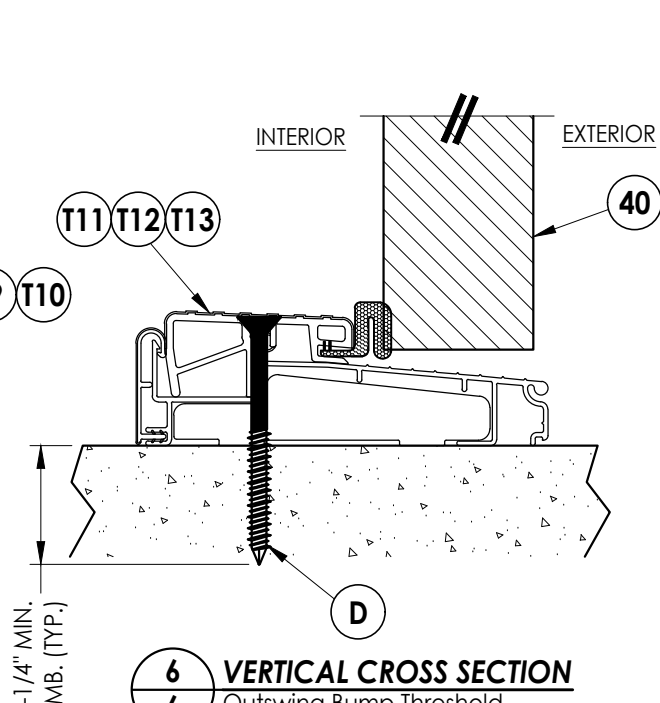

**6**  
**6** **VERTICAL CROSS SECTION**  
Outswing Bump Threshold

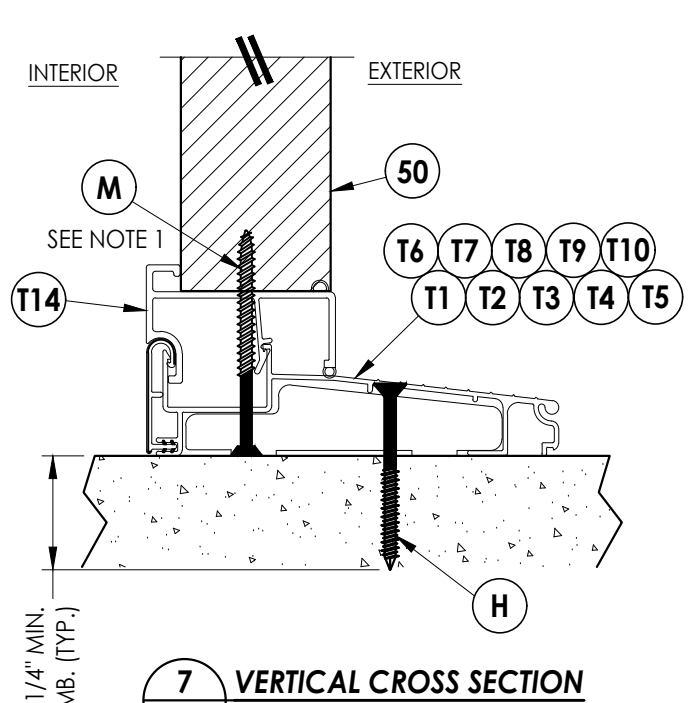

**7**  
**6** **VERTICAL CROSS SECTION**  
Inswing Sidelite Threshold

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Vairco, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813


PRODUCT: ENDURA

PART OR ASSEMBLY:  
VERTICAL CROSS  
SECTIONS


| NO. | DATE    | REVISIONS                    |
|-----|---------|------------------------------|
| 3   | 7/02/26 | UPDATE TO 9TH ED. (2026) FBC |
| 2   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC |
| 1   | 8/06/20 | UPDATE TO 7th ED. (2020) FBC |

DATE: 5/26/16  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-20698.8  
SHEET 6 OF 10

Z:\2023 FBC Drawings\Endura Products\FL-20698 R5\FL-20698.7-8.dwg

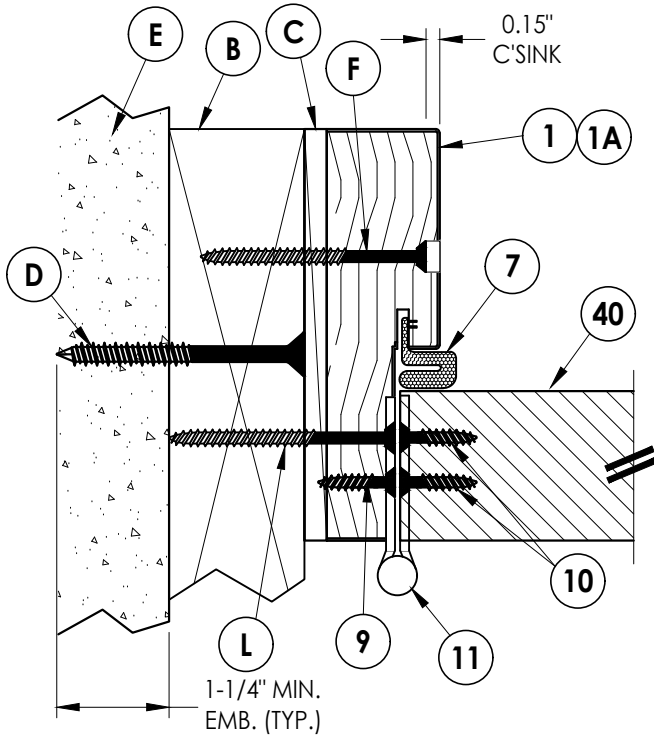


**1**  
**7** **HORIZONTAL CROSS SECTION**  
Inswing shown (Outswing similar)  
2X Buck Construction

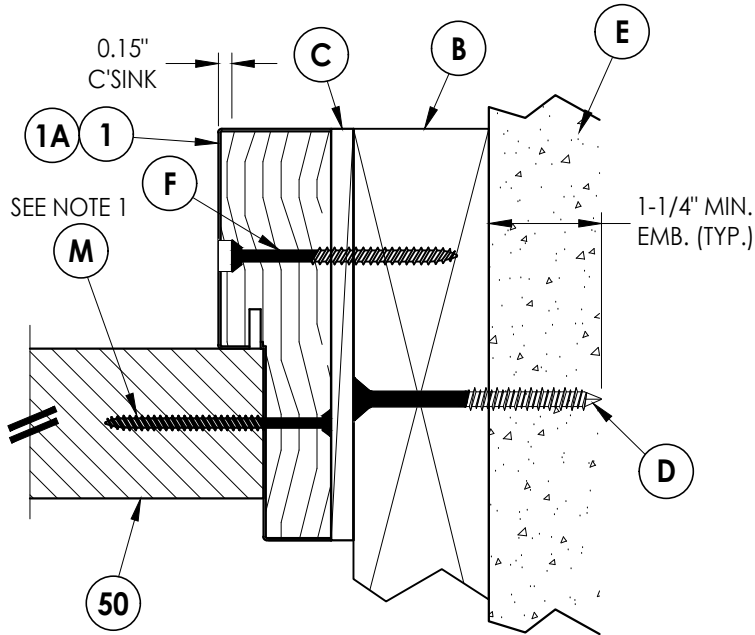


**2**  
**7** **HORIZONTAL CROSS SECTION**  
Inswing shown (Outswing similar)  
2X Buck Construction


NOTE:  
1. Spacing for sidelite screws (item M): 6.5", 38.5"  
and 69" from head to sill (3 total).

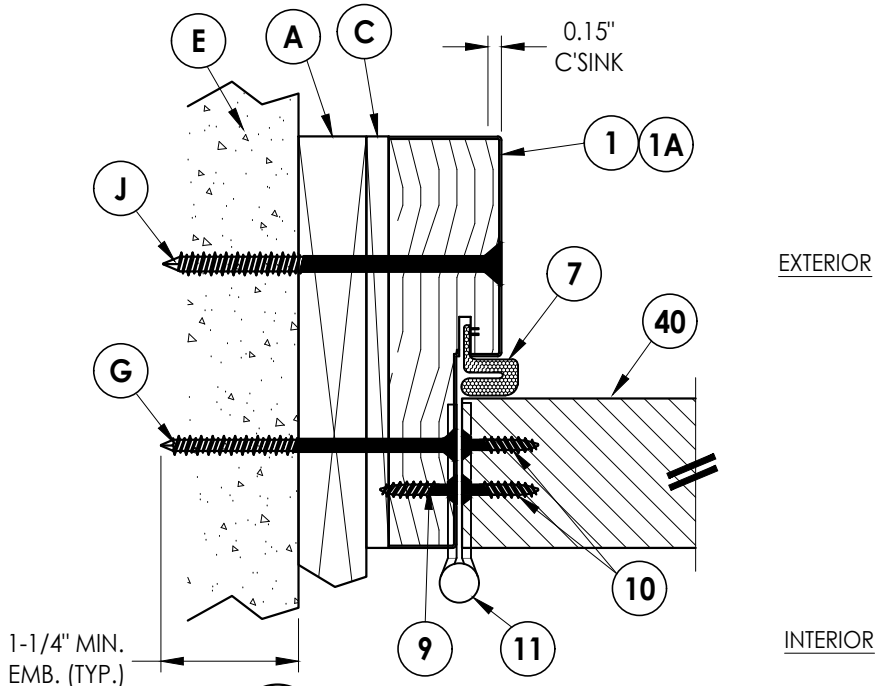

**3**  
**7** **HORIZONTAL CROSS SECTION**  
Inswing shown (Outswing similar)  
1X Buck Construction

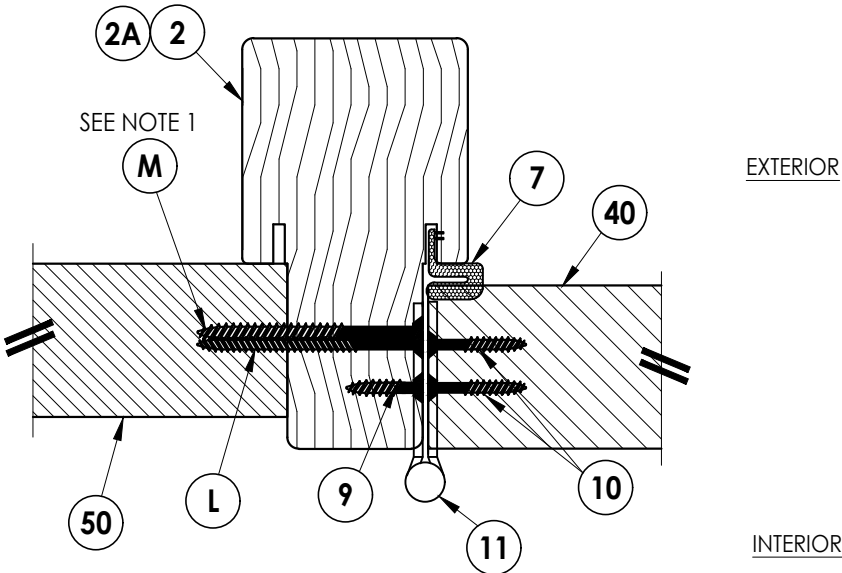

**4**  
**7** **HORIZONTAL CROSS SECTION**  
Inswing shown (Outswing similar)

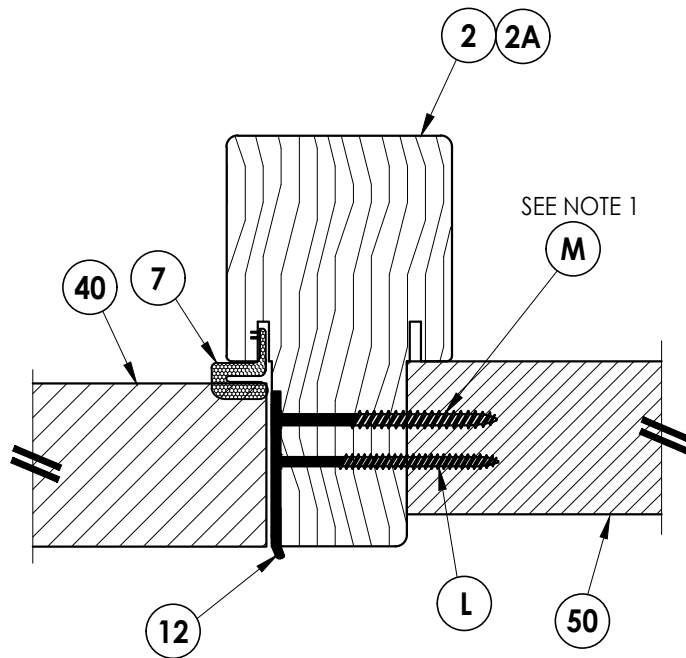

**5**  
**7** **HORIZONTAL CROSS SECTION**  
Inswing shown (Outswing similar)

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: ENDURA

PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS

| NO. | DATE    | REVISIONS                        |
|-----|---------|----------------------------------|
| 3   | 7/02/26 | UPDATE TO 9TH ED. (2026) FBC LFS |
| 2   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC LFS |
| 1   | 8/06/20 | UPDATE TO 7th ED. (2020) FBC DAC |

DATE: 5/26/16

SCALE: N.T.S.



DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20698.8

SHEET 7 OF 10

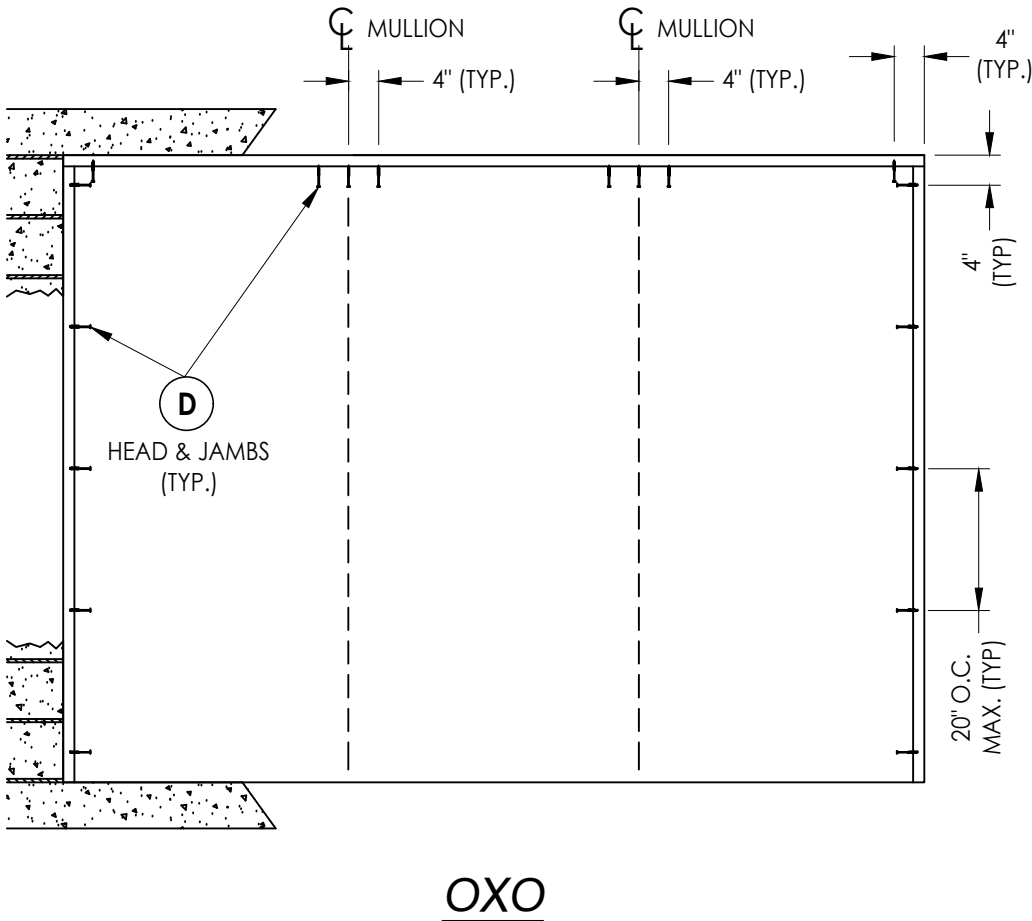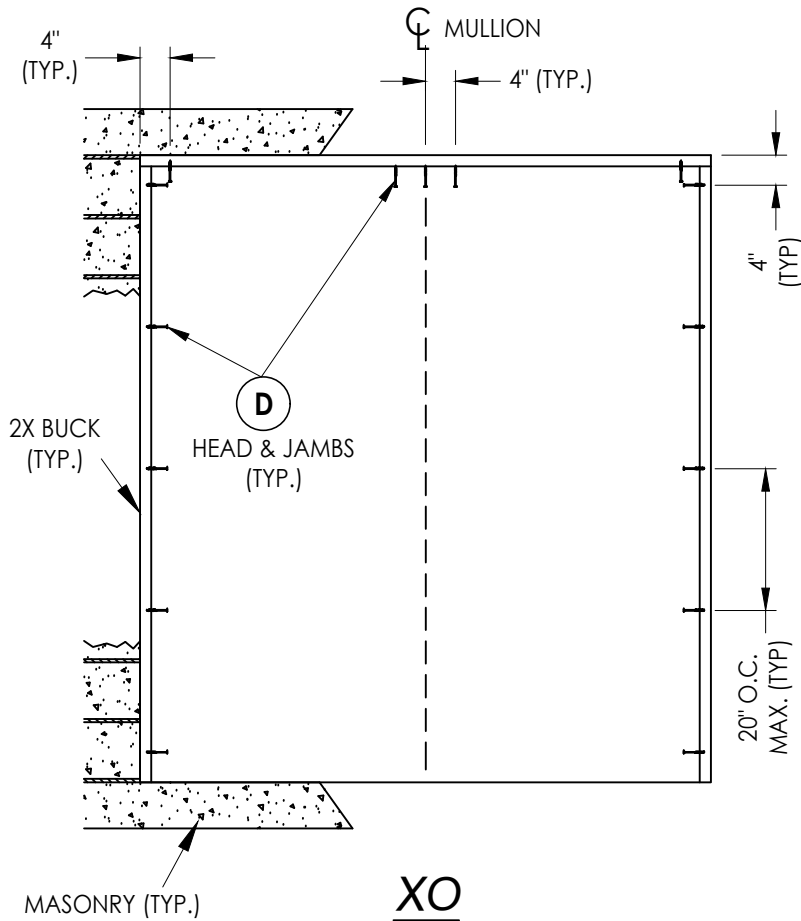

2X BUCK ANCHORING





|     |         |                          |     |     |    |
|-----|---------|--------------------------|-----|-----|----|
|     |         |                          |     |     |    |
|     |         |                          |     |     |    |
| 3   | 7/02/26 | UPDATE TO 9TH ED. (2026) | FBC | LFS |    |
| 2   | 7/06/23 | UPDATE TO 8TH ED. (2023) | FBC | LFS |    |
| 1   | 8/06/20 | UPDATE TO 7th ED. (2020) | FBC | DAC |    |
| NO. | DATE    |                          |     |     | BY |

|              |            |
|--------------|------------|
| DATE:        | 5/26/16    |
| SCALE:       | N.T.S.     |
| DWG. BY:     | JK         |
| CHK. BY:     | LFS        |
| DRAWING NO.: | FL-20698.8 |
| SHEET        | 8 OF 10    |

|                   |                |
|-------------------|----------------|
| PRODUCT:          | ENDURA         |
| PART OR ASSEMBLY: | BUCK ANCHORING |


Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

*RW* BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

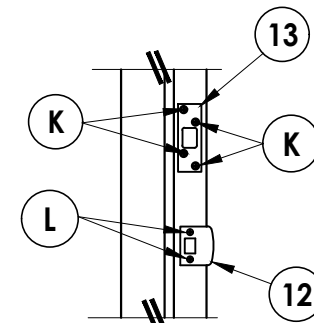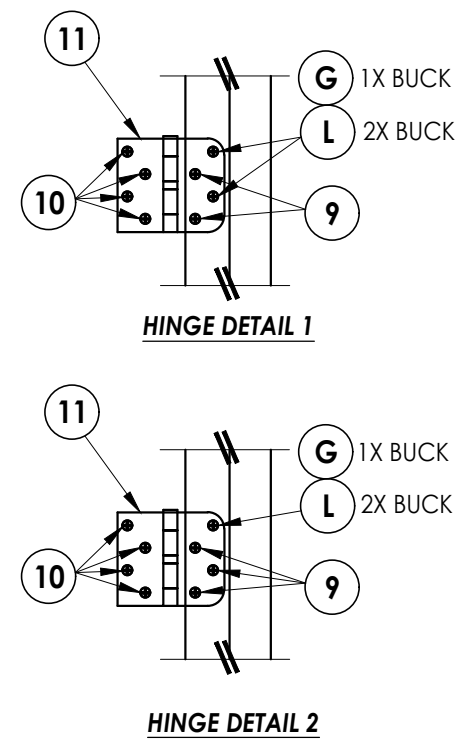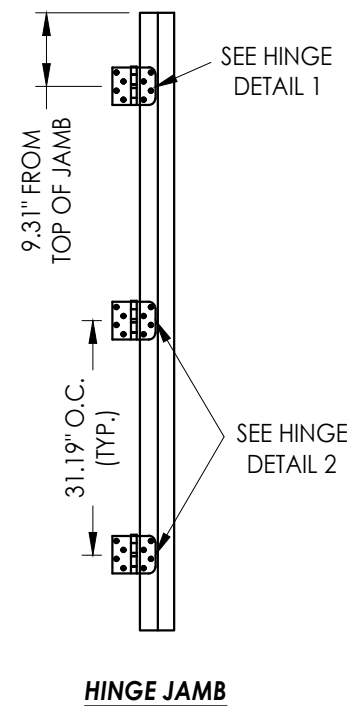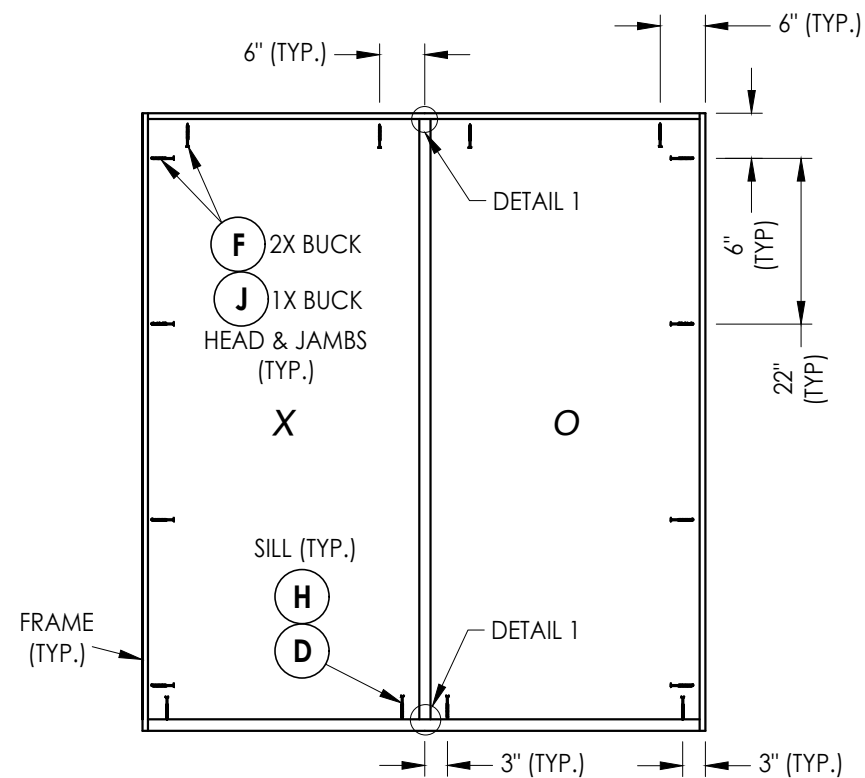


### LATCH & DEADBOLT STRIKE PLATE DETAILS

The head is attached to the jamb w/  
(3) 7/16" x 2" steel crown staples (TYP.)

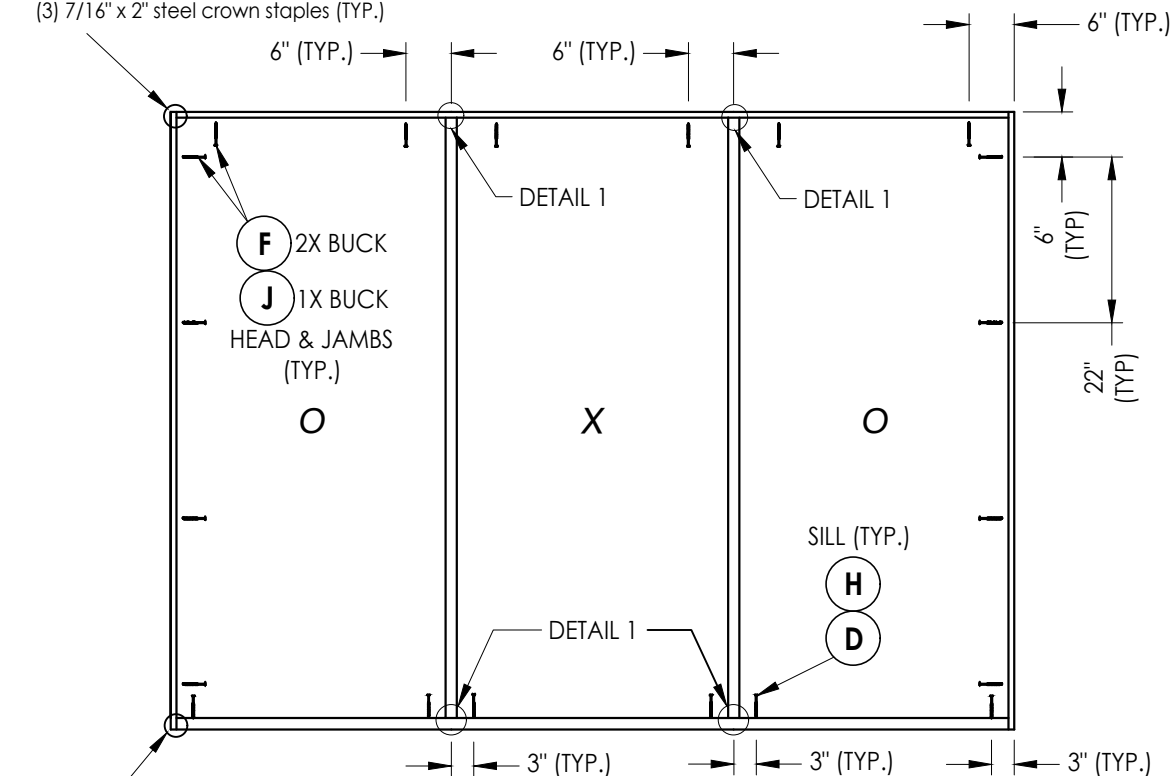

The threshold is attached to the jamb w/ (3) 7/16" x 2" steel crown staples & (1) #8 x 1-5/8" wood screw (TYP.)

## FRAME ANCHORING

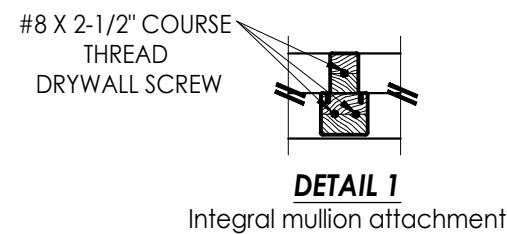

### CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

| ANCHOR TYPE            | ANCHOR SIZE | MIN. EMBEDMENT | MIN. CLEARANCE TO MASONRY EDGE | MIN. CLEARANCE TO ADJACENT ANCHOR |
|------------------------|-------------|----------------|--------------------------------|-----------------------------------|
| ITW BUILDEX<br>TAPCON® | 3/16"       | 1-1/4"         | 3"                             | 1-1/2"                            |
|                        | 1/4"        | 1-1/4"         | 2"                             | 4"                                |
| DeWALT<br>ULTRA-CON®   | 1/4"        | 1-1/4"         | 1"                             | 4"                                |

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20698.8

SHEET 9 OF 10

**PRODUCT:**

ENDURA


**FOR ASSEMBLY:**  
**FRAME ANCHORING  
& HARDWARE DETAILS**

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409


**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Endura Products\FL-20698 R5\FL-20698.7-8.dwg


| BILL OF MATERIALS |                                                                                                |           |
|-------------------|------------------------------------------------------------------------------------------------|-----------|
| ITEM #            | DESCRIPTION                                                                                    | MATERIAL  |
| A                 | 1X BUCK (G >= 0.42)                                                                            | WOOD      |
| B                 | 2X BUCK (G >= 0.42)                                                                            | WOOD      |
| C                 | 1/4" MAX. SHIM SPACE                                                                           | -         |
| D                 | 1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW                                                 | STEEL     |
| E                 | MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90 | CONCRETE  |
| F                 | #10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)                                             | STEEL     |
| G                 | 3/16" X 3-1/4" PFH ITW CONCRETE SCREW                                                          | STEEL     |
| H                 | 1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW                                                 | STEEL     |
| J                 | 1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW                                                 | STEEL     |
| K                 | #10 X 3" PFH WOOD SCREW                                                                        | STEEL     |
| L                 | #8 X 2-1/2" PFH WOOD SCREW                                                                     | STEEL     |
| M                 | #8 X 2-1/2" PFH COURSE THREAD DRYWALL SCREW                                                    | STEEL     |
| P                 | #10 X 1-3/4" PFH WOOD SCREW                                                                    | STEEL     |
| T1                | INSWING ADJUSTABLE THRESHOLD                                                                   | ALUM/COMP |
| T2                | INSWING ADJUSTABLE THRESHOLD                                                                   | ALUM/COMP |
| T3                | INSWING ADJUSTABLE THRESHOLD                                                                   | ALUM/COMP |
| T4                | INSWING ADJUSTABLE THRESHOLD                                                                   | ALUM/COMP |
| T5                | INSWING ADJUSTABLE THRESHOLD                                                                   | ALUM/COMP |
| T6                | INSWING ARTICULATING THRESHOLD                                                                 | ALUM/COMP |
| T7                | INSWING ARTICULATING THRESHOLD                                                                 | ALUM/COMP |
| T8                | INSWING ARTICULATING THRESHOLD                                                                 | ALUM/COMP |
| T9                | INSWING ARTICULATING THRESHOLD                                                                 | ALUM/COMP |
| T10               | INSWING ARTICULATING THRESHOLD                                                                 | ALUM/COMP |
| T11               | OUTSWING THRESHOLD                                                                             | ALUM/COMP |
| T12               | OUTSWING THRESHOLD                                                                             | ALUM/COMP |
| T13               | OUTSWING THRESHOLD                                                                             | ALUM/COMP |
| T14               | INSWING THRESHOLD w/ SIDELITE ADAPTER                                                          | ALUM/COMP |
| T15               | OUTSWING THRESHOLD w/ SIDELITE ADAPTER                                                         | ALUM/COMP |
| 1                 | FINGER JOINT PINE JAMB (G >= 0.42)                                                             | WOOD      |
| 1A                | FINGER JOINTED PINE JAMB (SG >= 0.42) (FrameSaver)                                             | WOOD/COMP |
| 2                 | INTEGRAL MULLION (ENDURA FATBOY - PINE, G >= 0.42)                                             | WOOD      |
| 2A                | INTEGRAL MULLION (SG >= 0.42) (FrameSaver)                                                     | WOOD/COMP |
| 7                 | WEATHERSTRIP (ENDURA)                                                                          | FOAM      |
| 8                 | DOOR BOTTOM SWEEP                                                                              | VINYL     |
| 8A                | ARTICULATING SWEEP                                                                             | VINYL     |
| 9                 | #8 X 3/4" PFH WOOD SCREW                                                                       | STEEL     |
| 10                | #8 X 1" PFH WOOD SCREW                                                                         | STEEL     |
| 11                | 4" X 4" BUTT HINGE                                                                             | STEEL     |
| 12                | LATCH STRIKE PLATE                                                                             | STEEL     |
| 13                | DEADBOLT STRIKE PLATE (SECURITY)                                                               | STEEL     |
| 40                | DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR DETAILS                                           | -         |
| 50                | SIDELITE PANEL - SEE SIDELITE PANEL DETAIL SHEET FOR DETAILS                                   | -         |




8 SWEEP




8A ARTICULATING SWEEP

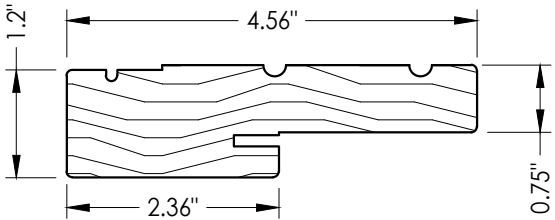


1 WOOD JAMB

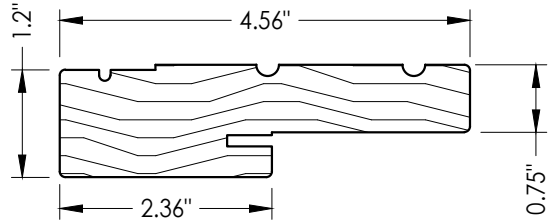


1A WOOD JAMB  
FrameSaver (Endura)

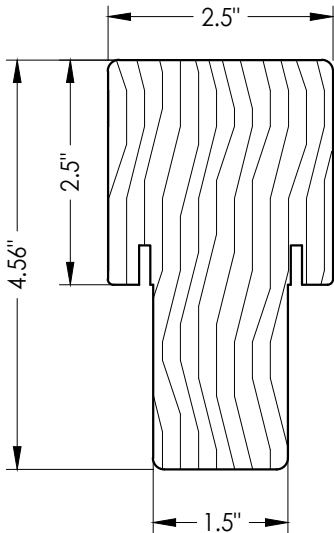


2 INTEGRAL MULLION

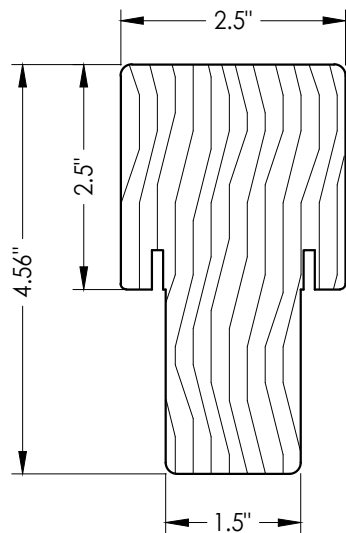

2A INTEGRAL MULLION  
FrameSaver (Endura)

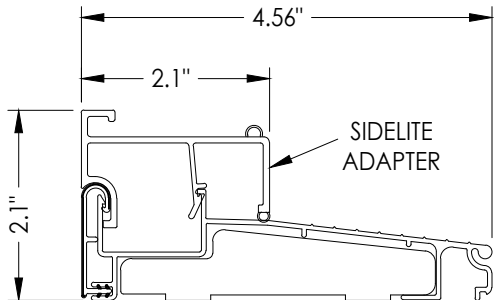

T14 INSWING THRESHOLD w/ SIDELITE ADAPTER  
Endura (Z-Series)

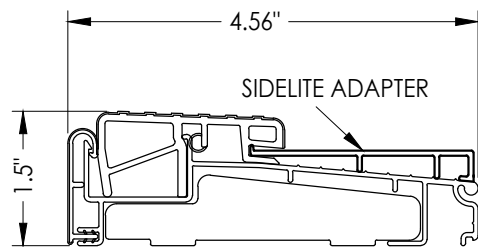

T15 OUTSWING THRESHOLD w/ SIDELITE ADAPTER  
Endura (Z-Series)

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: ENDURA

PART OR ASSEMBLY:  
BILL OF MATERIALS  
& COMPONENTS

| NO. | DATE    | REVISIONS                        |
|-----|---------|----------------------------------|
| 3   | 7/02/26 | UPDATE TO 9TH ED. (2026) FBC LFS |
| 2   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC LFS |
| 1   | 8/06/20 | UPDATE TO 7th ED. (2020) FBC DAC |

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20698.8

SHEET 10 OF 10