

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: MAHOGANY
11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 11 FOR GLASS DETAILS.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

13. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4” ELCO CRETE–FLEX TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - 17.1. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42C
 - 17.2. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - 17.3. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - 17.4. METAL STRUCTURE: STEEL 18GA (.048”) FY=33KSI/FU=52KSI OR ALUMINUM 6063–T5 FU=30KSI .125” THICK MINIMUM.
18. APPROVED CONFIGURATIONS: XX, X.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 – 3	ELEVATIONS
4	DESIGN PRESSURE CHARTS
5 – 10	INSTALLATION DETAILS
11	GLAZING DETAIL AND COMPONENTS

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH IN–SWING DOOR
IMPACT HVHZ
NOTES

DRAWN:
N.G.

DWG NO.
08–02837

REV
D


SCALE NTS

DATE 12/08/15

SHEET 1 OF 11


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 11/27/2023

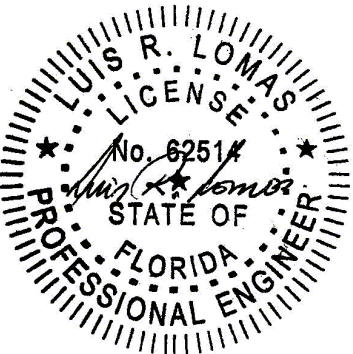


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

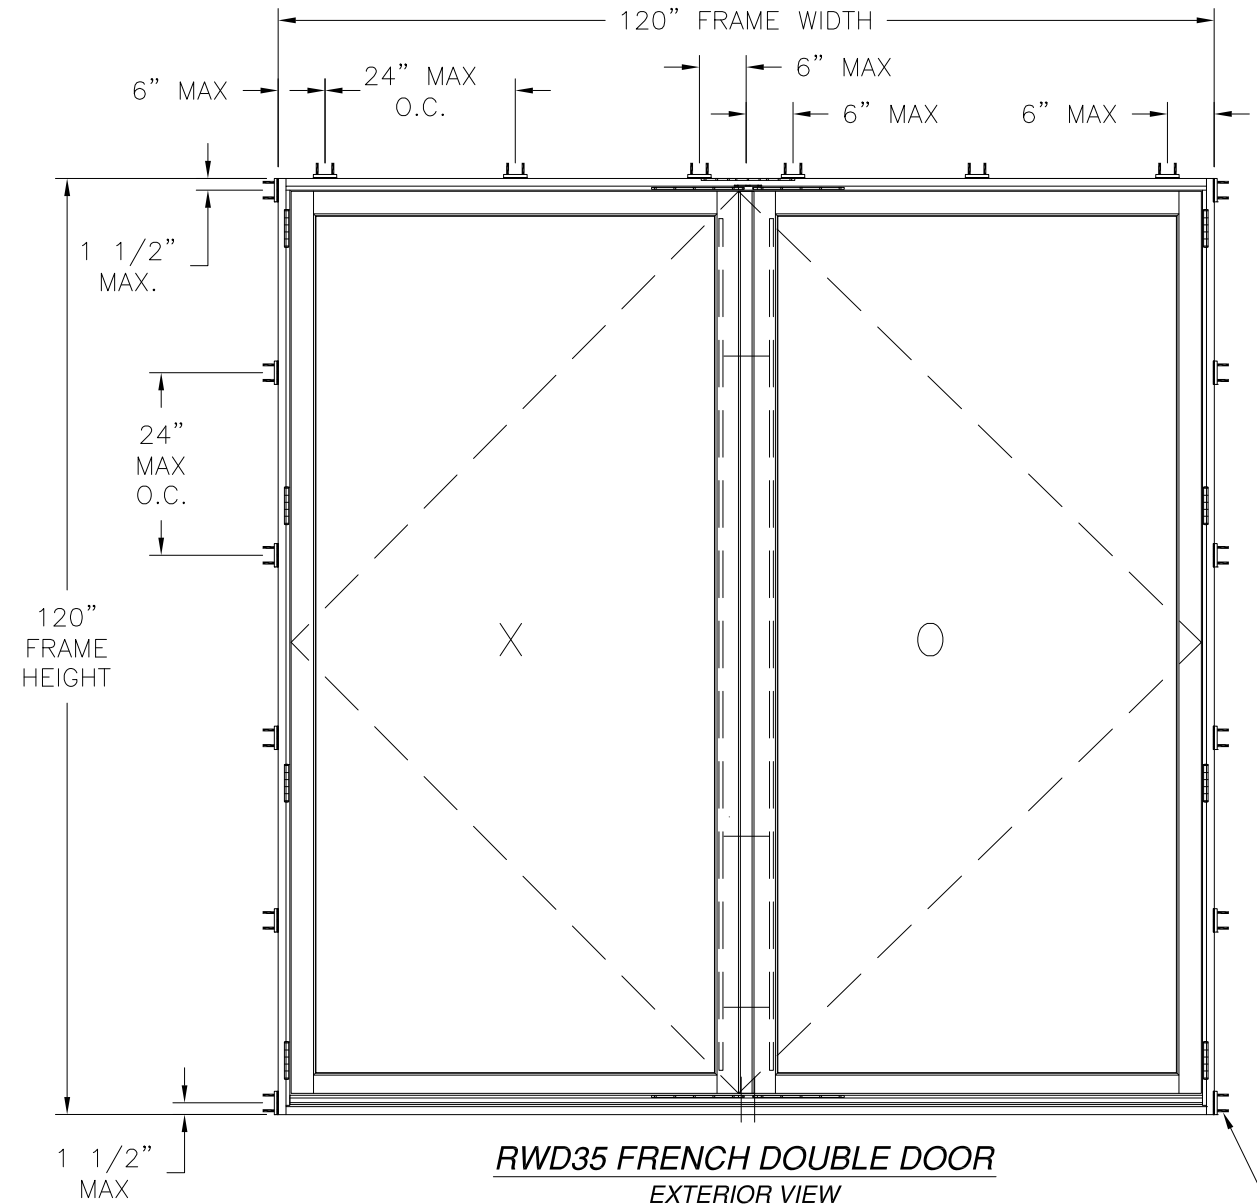

RWD35 FRENCH DOUBLE DOOR
EXTERIOR VIEW
BRACKET INSTALLATION

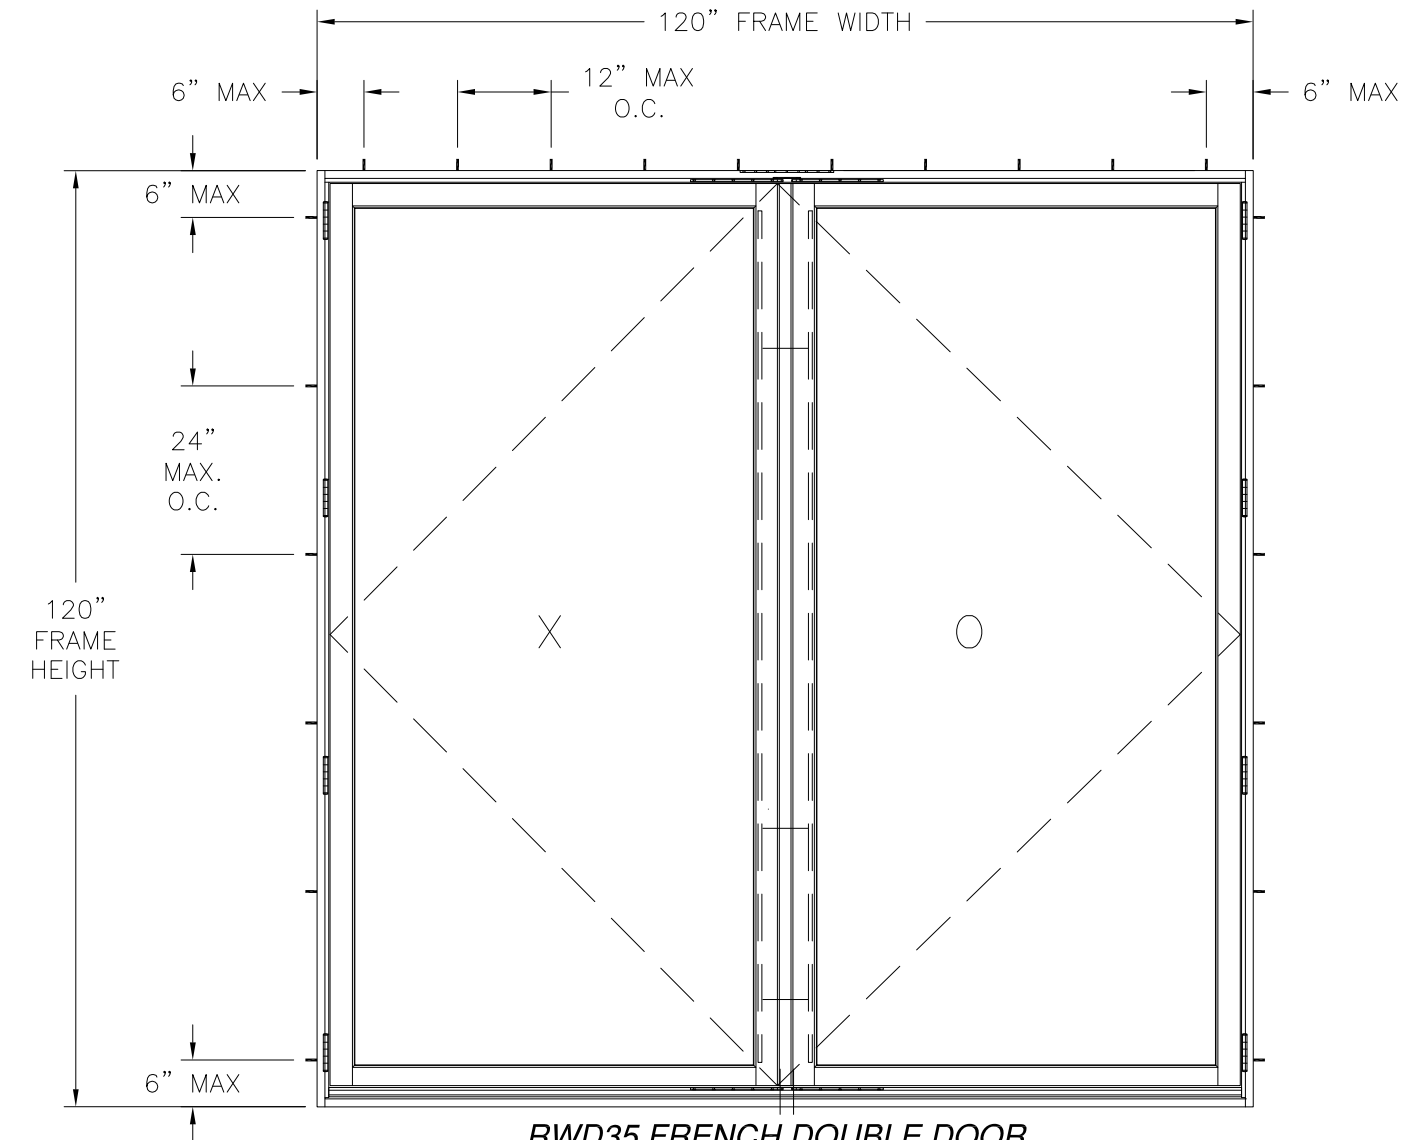

RWD35 FRENCH DOUBLE DOOR
EXTERIOR VIEW
FRAME INSTALLATION

(2) ANCHORS PER
INSTALLATION BRACKET

- NOTES:
- 1. PANEL SIZE: 58 3/4" x 117 5/32"
 - 2. D.L.O.: 52 3/32" x 110 29/32"

DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	LARGE AND SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4 AND HVHZ
58 3/4" X 117 5/32" PANEL SHOWN, OTHER SIZES ARE APPROVED
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 47.8 FT²
SEE CHART #1 AND #2 SHEET 4, FOR OTHER SIZES RATINGS

HARDWARE SCHEDULE	
A.	(8) 4.5" X 4.5" MERIT BUTTON TOP HINGES 35 1/2" O.C.
B.	(1) HOPPE INACTIVE GEAR (2074564) W/BOTTOM SHOOT BOLT AT LOCK STILE
C.	SHOOT BOLT WITH 1740MM EXTENSION AT TOP LOCK STILE
D.	SHOOT BOLT WITH 475MM EXTENSION AT TOP LOCK STILE
E.	(1) HOPPE ACTIVE GEAR (8778847) W/BOTTOM SHOOT BOLT AT LOCK STILE
F.	1/2" X 2" STEEL REINFORCEMENT AT EACH MEETING STILE
G.	STEEL REINFORCEMENT (RWD NOVA) AT SASH RAILS

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
DOUBLE ELEVATION

DRAWN:
N.G.

DWG NO.
08-02837

REV
D


SCALE
NTS

DATE
12/08/15

SHEET
2 OF 11


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 11/27/2023

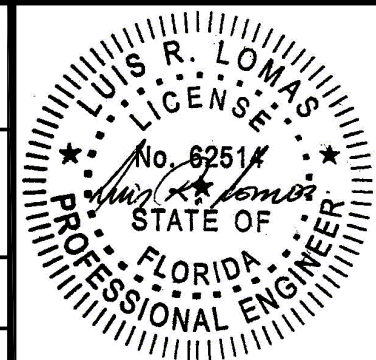


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

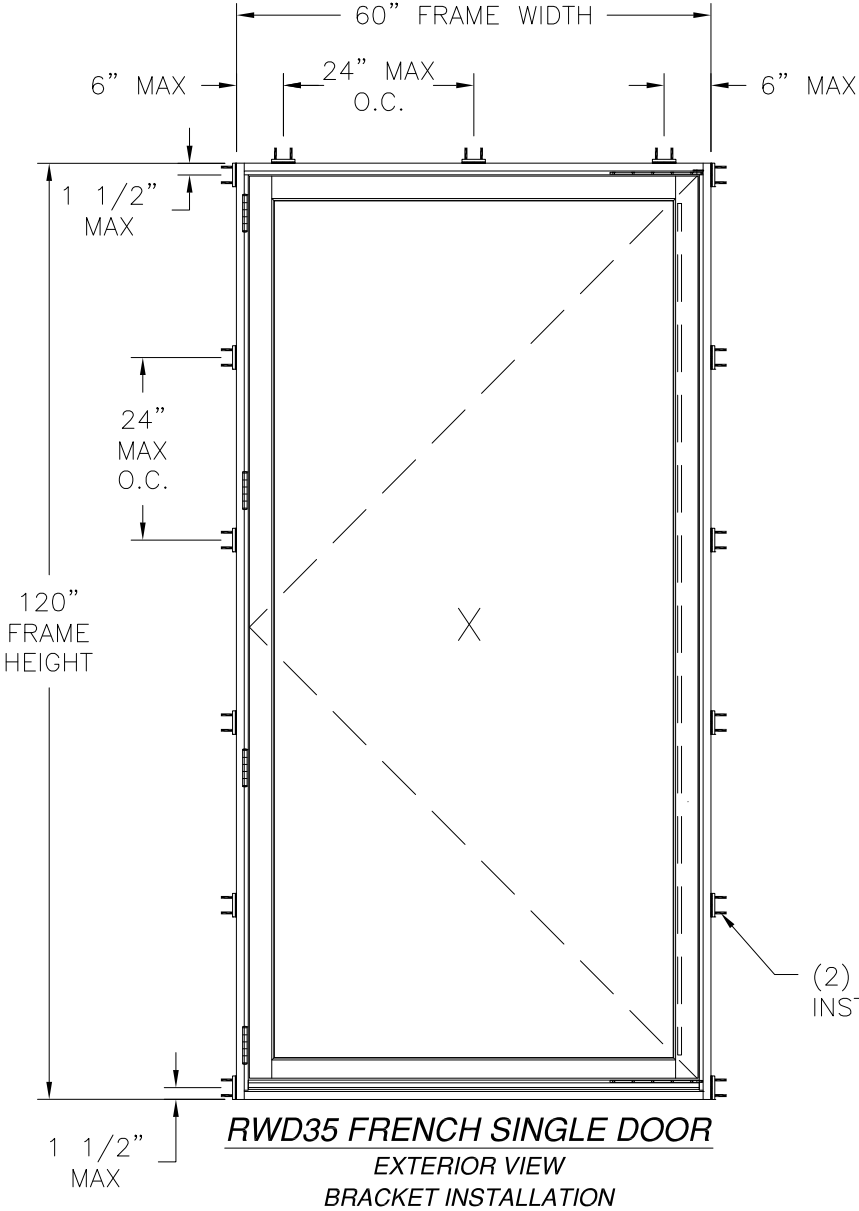

RWD35 FRENCH SINGLE DOOR
EXTERIOR VIEW
BRACKET INSTALLATION

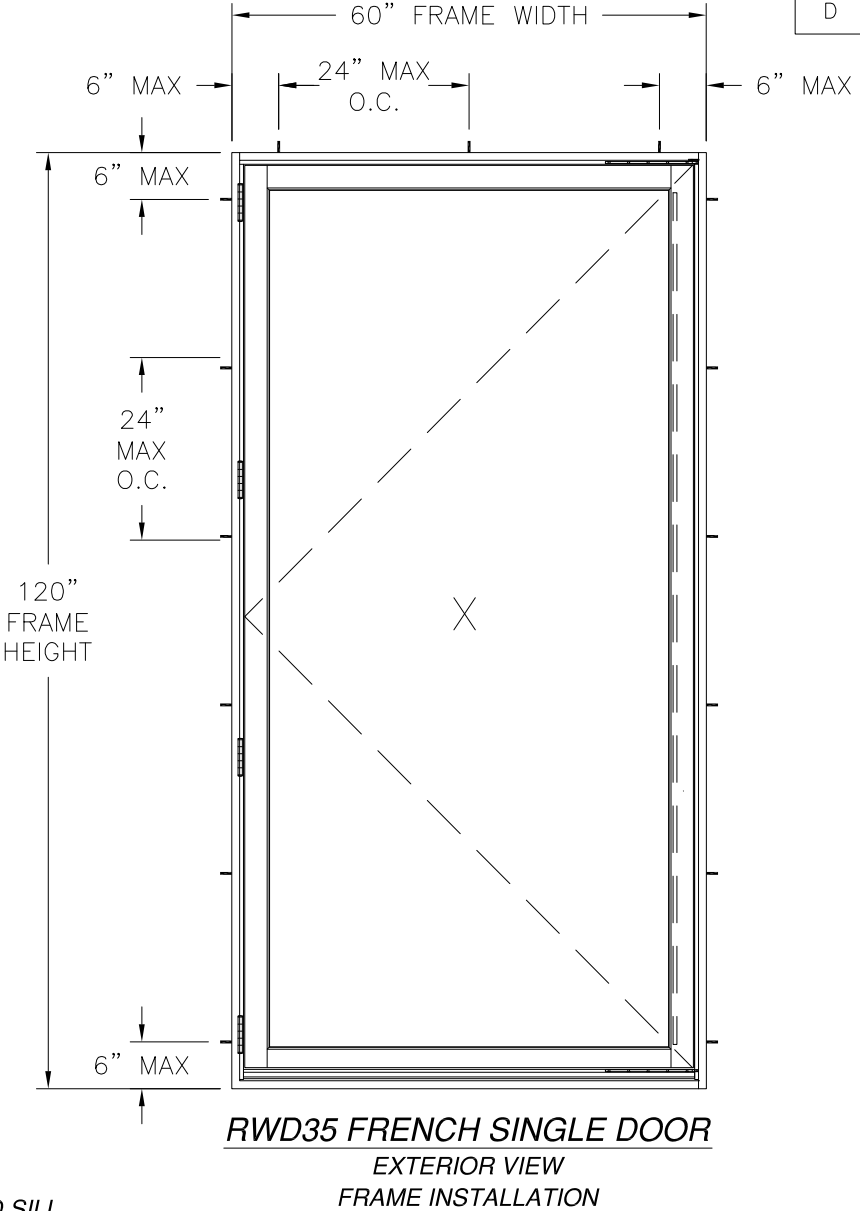

RWD35 FRENCH SINGLE DOOR
EXTERIOR VIEW
FRAME INSTALLATION

(2) ANCHORS PER
INSTALLATION BRACKET

WITH BRONZE OR WOOD SILL

DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	LARGE AND SMALL MISSILE IMPACT


MISSILE LEVEL D, WIND ZONE 4 AND HVHZ
58 3/4" X 117 5/32" PANEL SHOWN, OTHER SIZES ARE APPROVED
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 47.8 FT²
SEE CHART #3 SHEET 4, FOR OTHER SIZES RATINGS

- NOTES:
- PANEL SIZE: 58 3/4" x 117 5/32"
 - D.L.O.: 52 3/32" x 110 29/32"

HARDWARE SCHEDULE	
A.	(8) 4.5" X 4.5" MERIT BUTTON TOP HINGES 35 1/2" O.C.
B.	(1) HOPPE INACTIVE GEAR (2074564) W/BOTTOM SHOOT BOLT AT LOCK STILE
C.	SHOOT BOLT WITH 1740MM EXTENSION AT TOP LOCK STILE
D.	SHOOT BOLT WITH 475MM EXTENSION AT TOP LOCK STILE
E.	(1) HOPPE ACTIVE GEAR (8778847) W/BOTTOM SHOOT BOLT AT LOCK STILE
F.	1/2" X 2" STEEL REINFORCEMENT AT EACH MEETING STILE
G.	STEEL REINFORCEMENT (RWD NOVA) AT SASH RAILS

SIGNED: 11/27/2023

REILLY WINDOWS & DOORS 901 BURMAN BLVD. CALVERTON, NY 11933		
RWD35 FRENCH IN-SWING DOOR IMPACT HVHZ SINGLE ELEVATION		
DRAWN: N.G.	DWG NO. 08-02837	REV D
SCALE NTS	DATE 12/08/15	SHEET 3 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

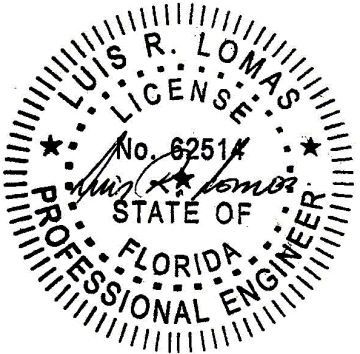

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

CHART #1
FOR DOUBLE DOORS INSTALLED WITH BRONZE SILL

Design pressure capacity chart (psf)														
Panel Height (in)	Panel Width (in)													
	24.00		30.00		36.00		42.00		48.00		54.00		58.75	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
80.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
84.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
90.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
96.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
102.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
108.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
114.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
117.28	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0

CHART #2
FOR DOUBLE DOORS INSTALLED WITH WOOD SILL

Design pressure capacity chart (psf)														
Frame Height (in)	Panel width (in)													
	24.0		30.0		36.0		42.0		48.0		54.0		58.75	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
80.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	49.2	49.2	40.5	40.5	35.5	35.5
84.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	48.5	48.5	39.7	39.7	34.7	34.7
90.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	48.0	48.0	38.8	38.8	33.7	33.7
96.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	47.8	47.8	38.2	38.2	33.0	33.0
102.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	47.8	47.8	37.9	37.9	32.5	32.5
108.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	47.8	47.8	37.8	37.8	32.1	32.1
114.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	47.8	47.8	37.8	37.8	31.9	31.9
117.28	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	47.8	47.8	37.8	37.8	31.9	31.9

CHART #3
FOR SINGLE DOORS INSTALLED WITH BRONZE OR WOOD SILL

Design pressure capacity chart (psf)														
Frame Height (in)	Panel width (in)													
	24.0		30.0		36.0		42.0		48.0		54.0		58.75	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
80.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
84.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
90.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
96.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
102.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
108.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
114.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
117.28	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0

SIGNED: 11/27/2023

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
DESIGN PRESSURE CHARTS

DRAWN:
N.G.

DWG NO.
08-02837


REV
D

SCALE
NTS


DATE
12/08/15



SHEET
4 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

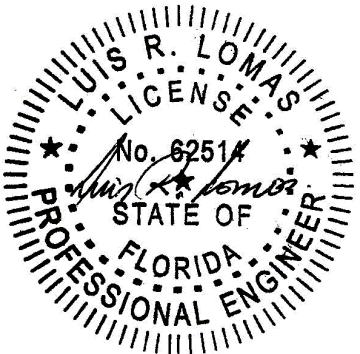


Luis R. Lomas P.E.
FL No.: 62514

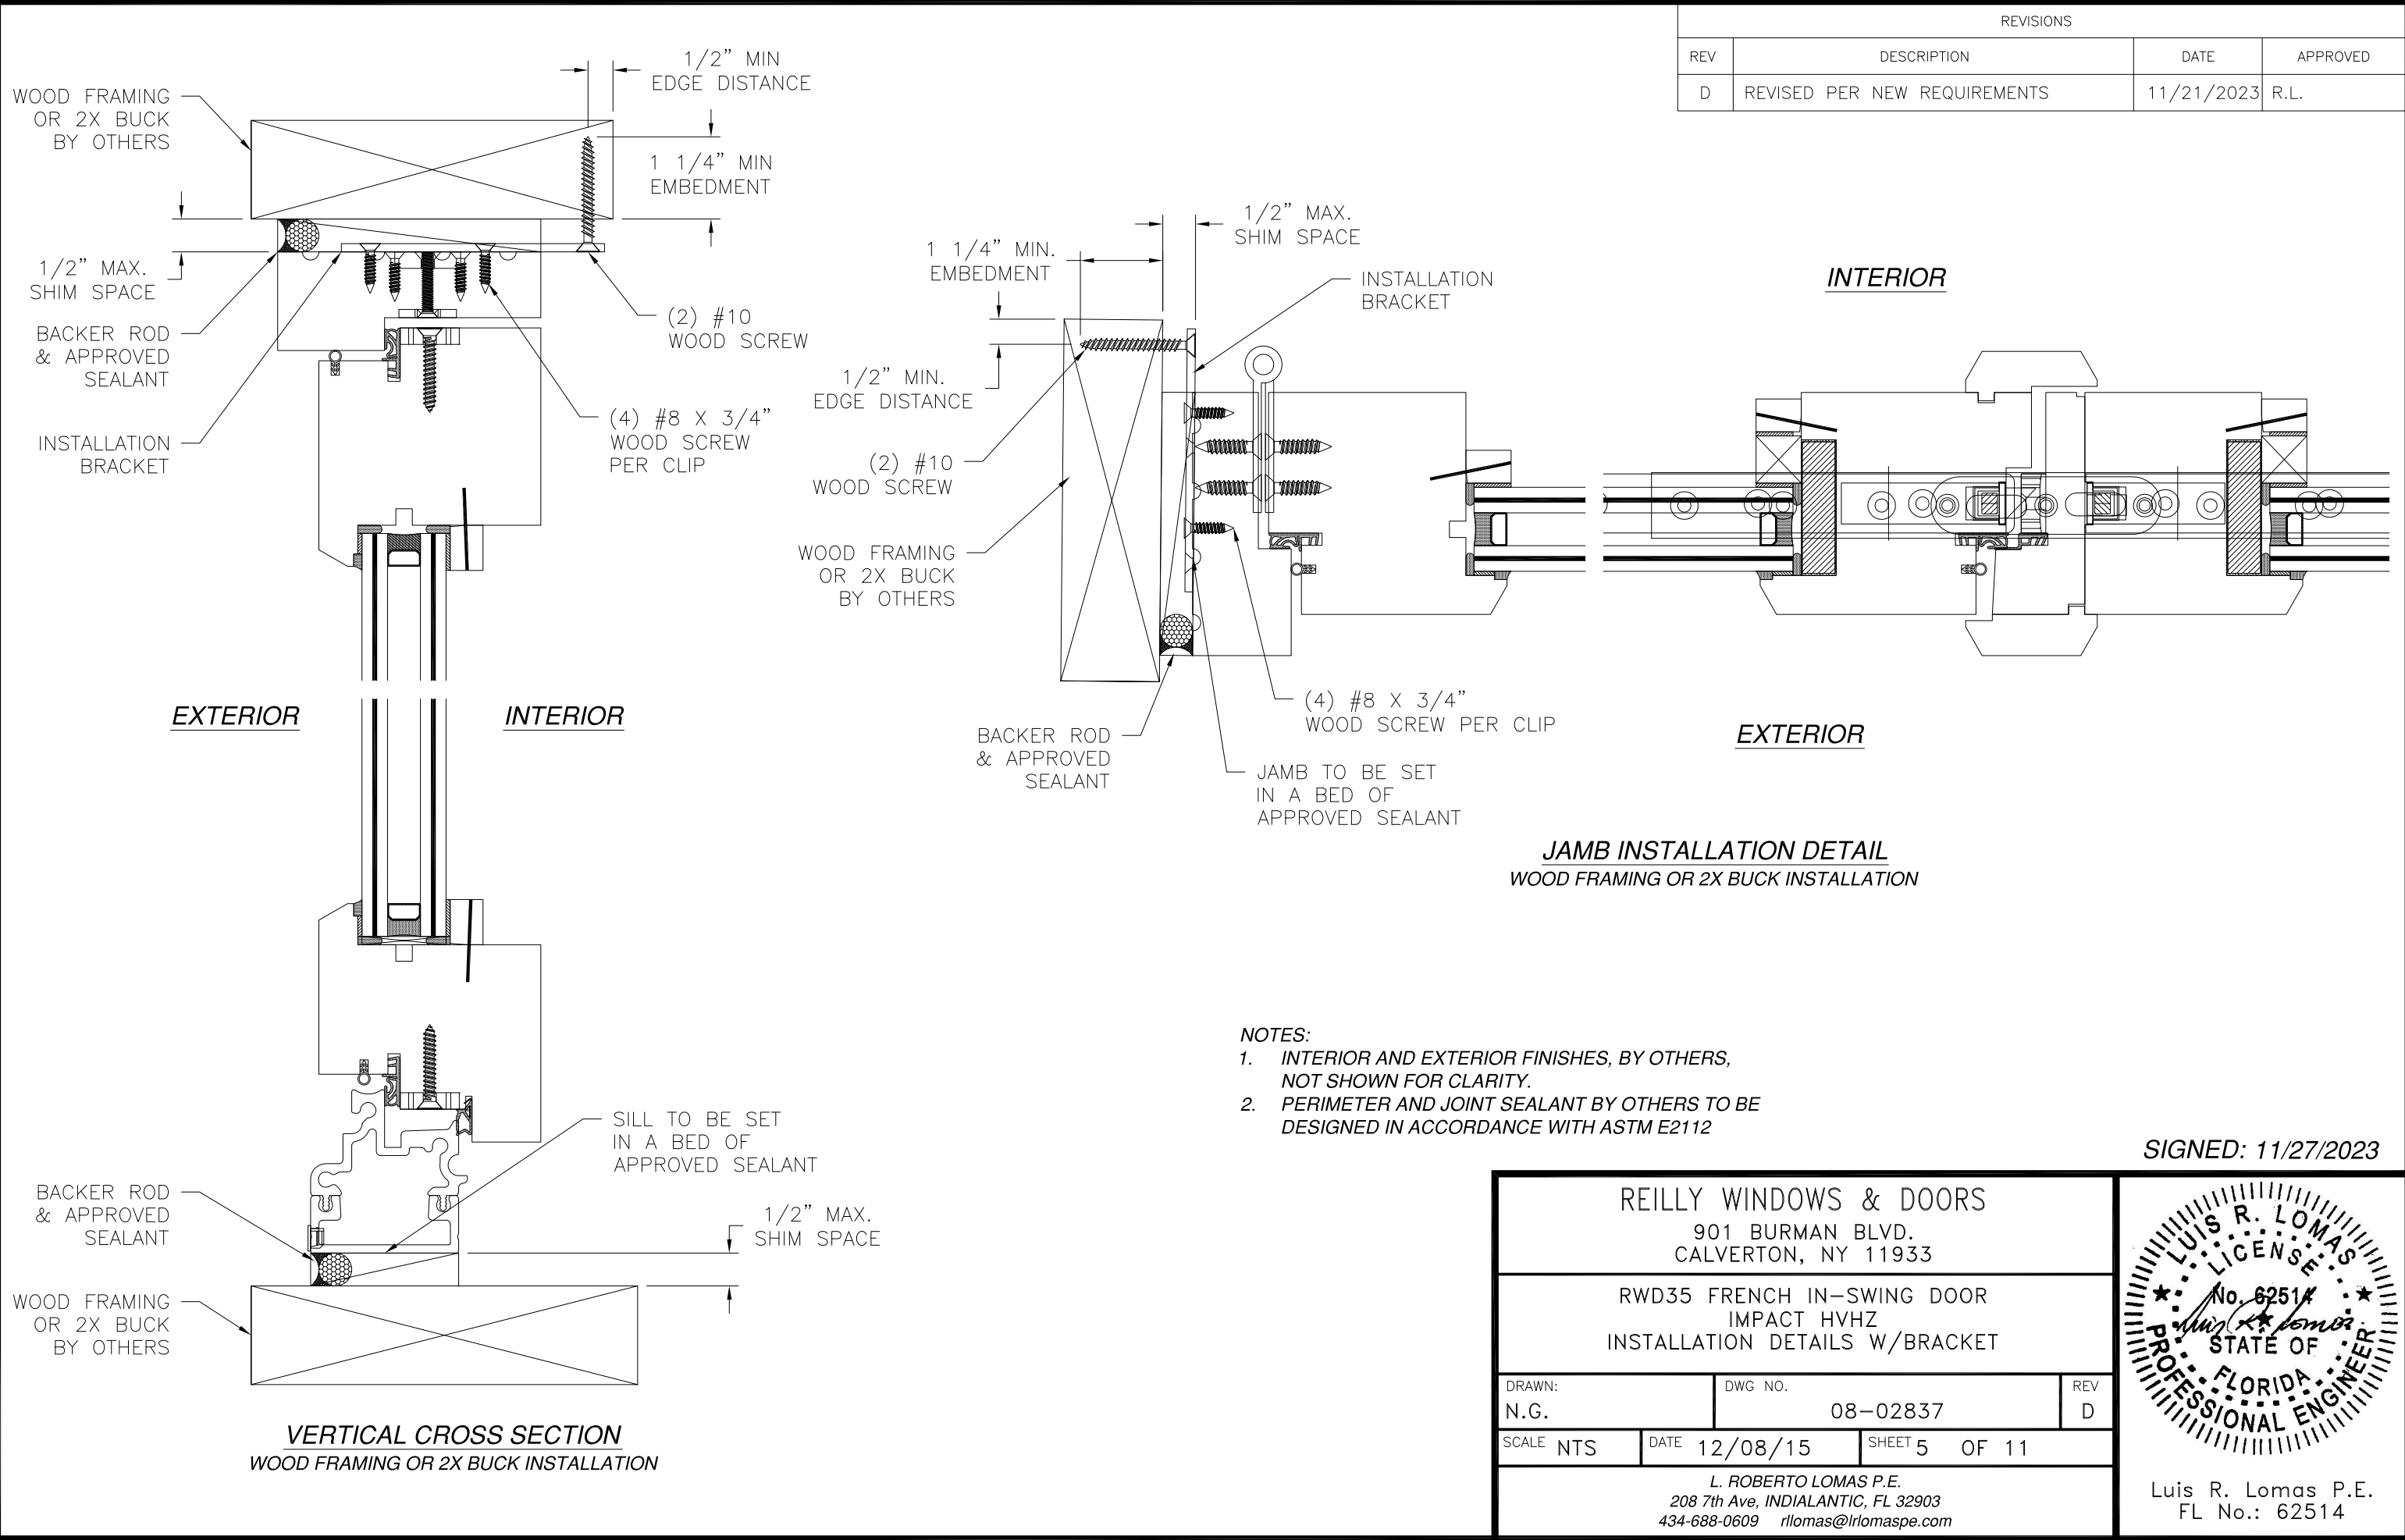

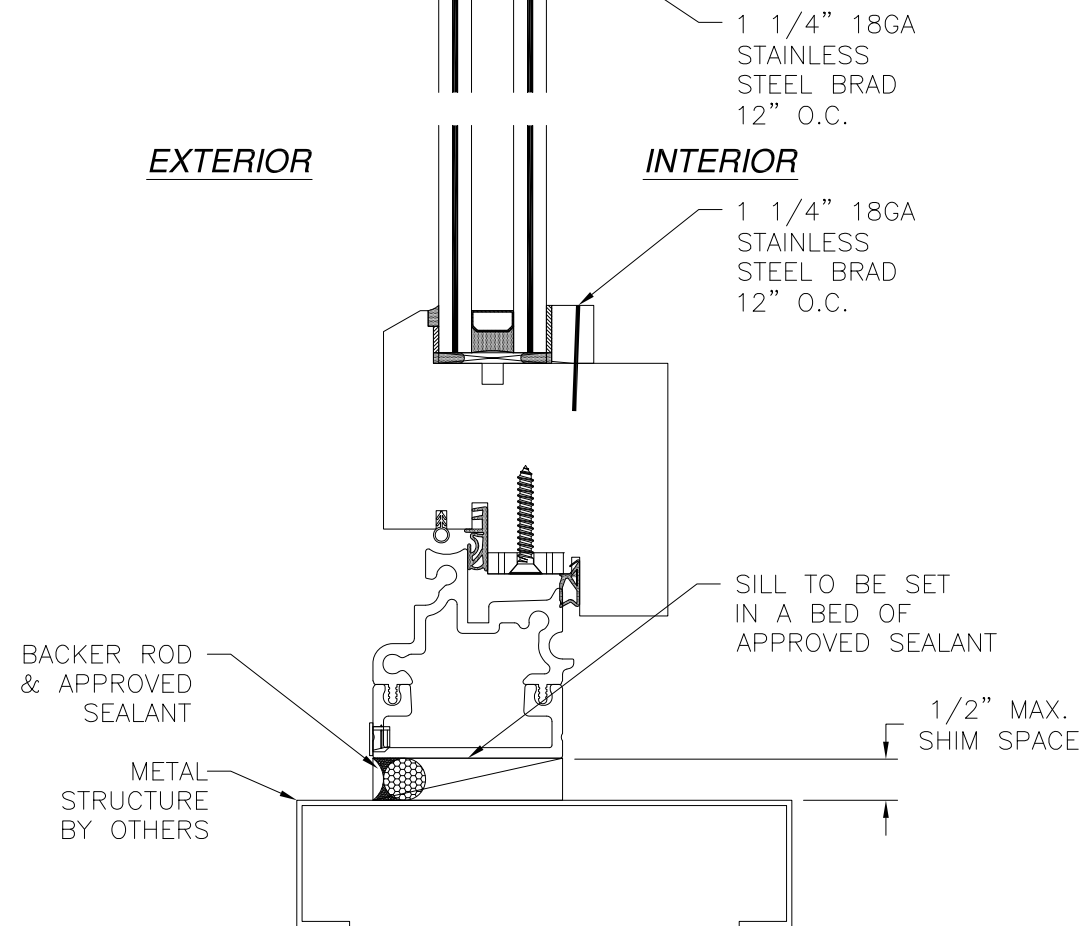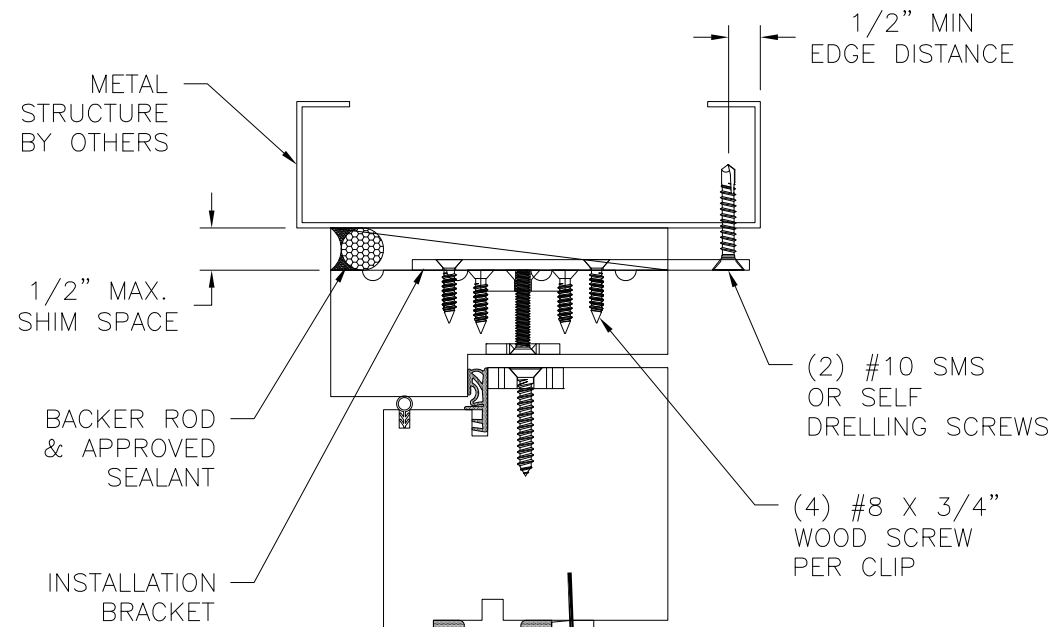


VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

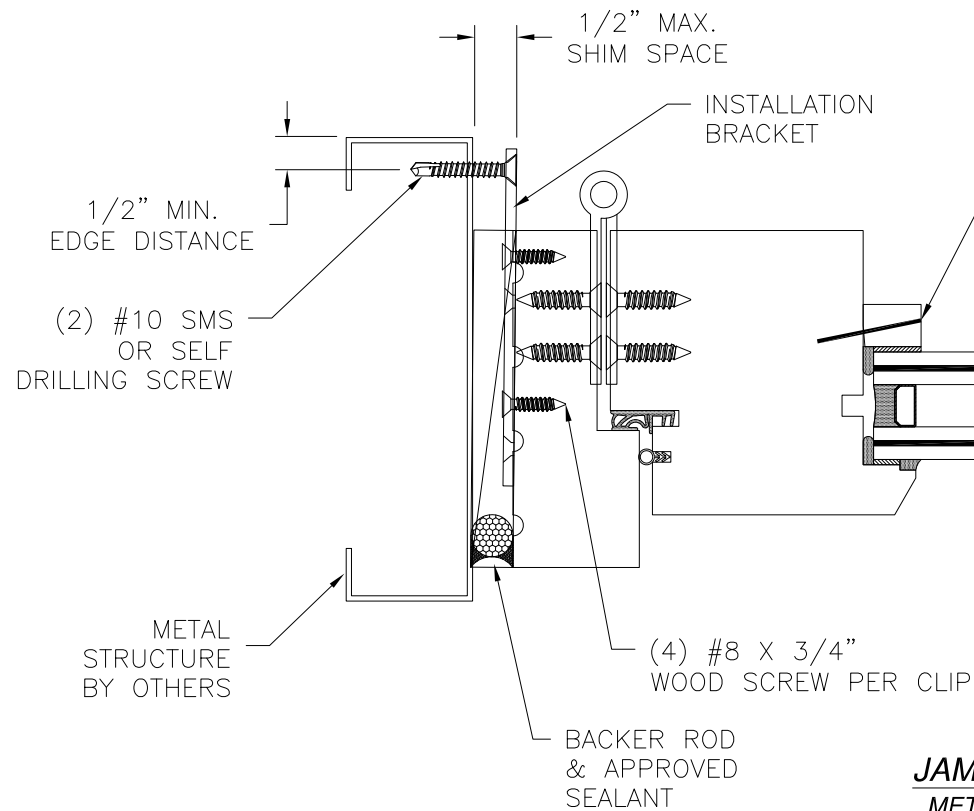

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

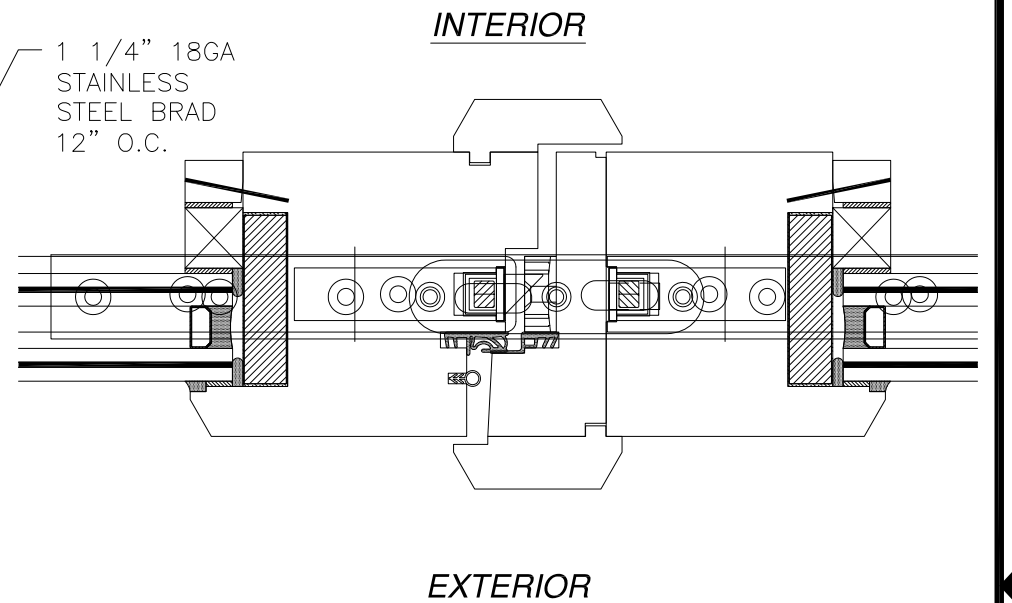

- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 11/27/2023

REILLY WINDOWS & DOORS 901 BURMAN BLVD. CALVERTON, NY 11933		
RWD35 FRENCH IN-SWING DOOR IMPACT HVHZ INSTALLATION DETAILS W/BRACKET		
DRAWN: N.G.	DWG NO. 08-02837	REV D
SCALE NTS	DATE 12/08/15	SHEET 6 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@rlomaspe.com		

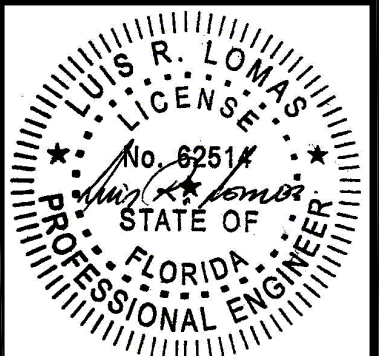

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

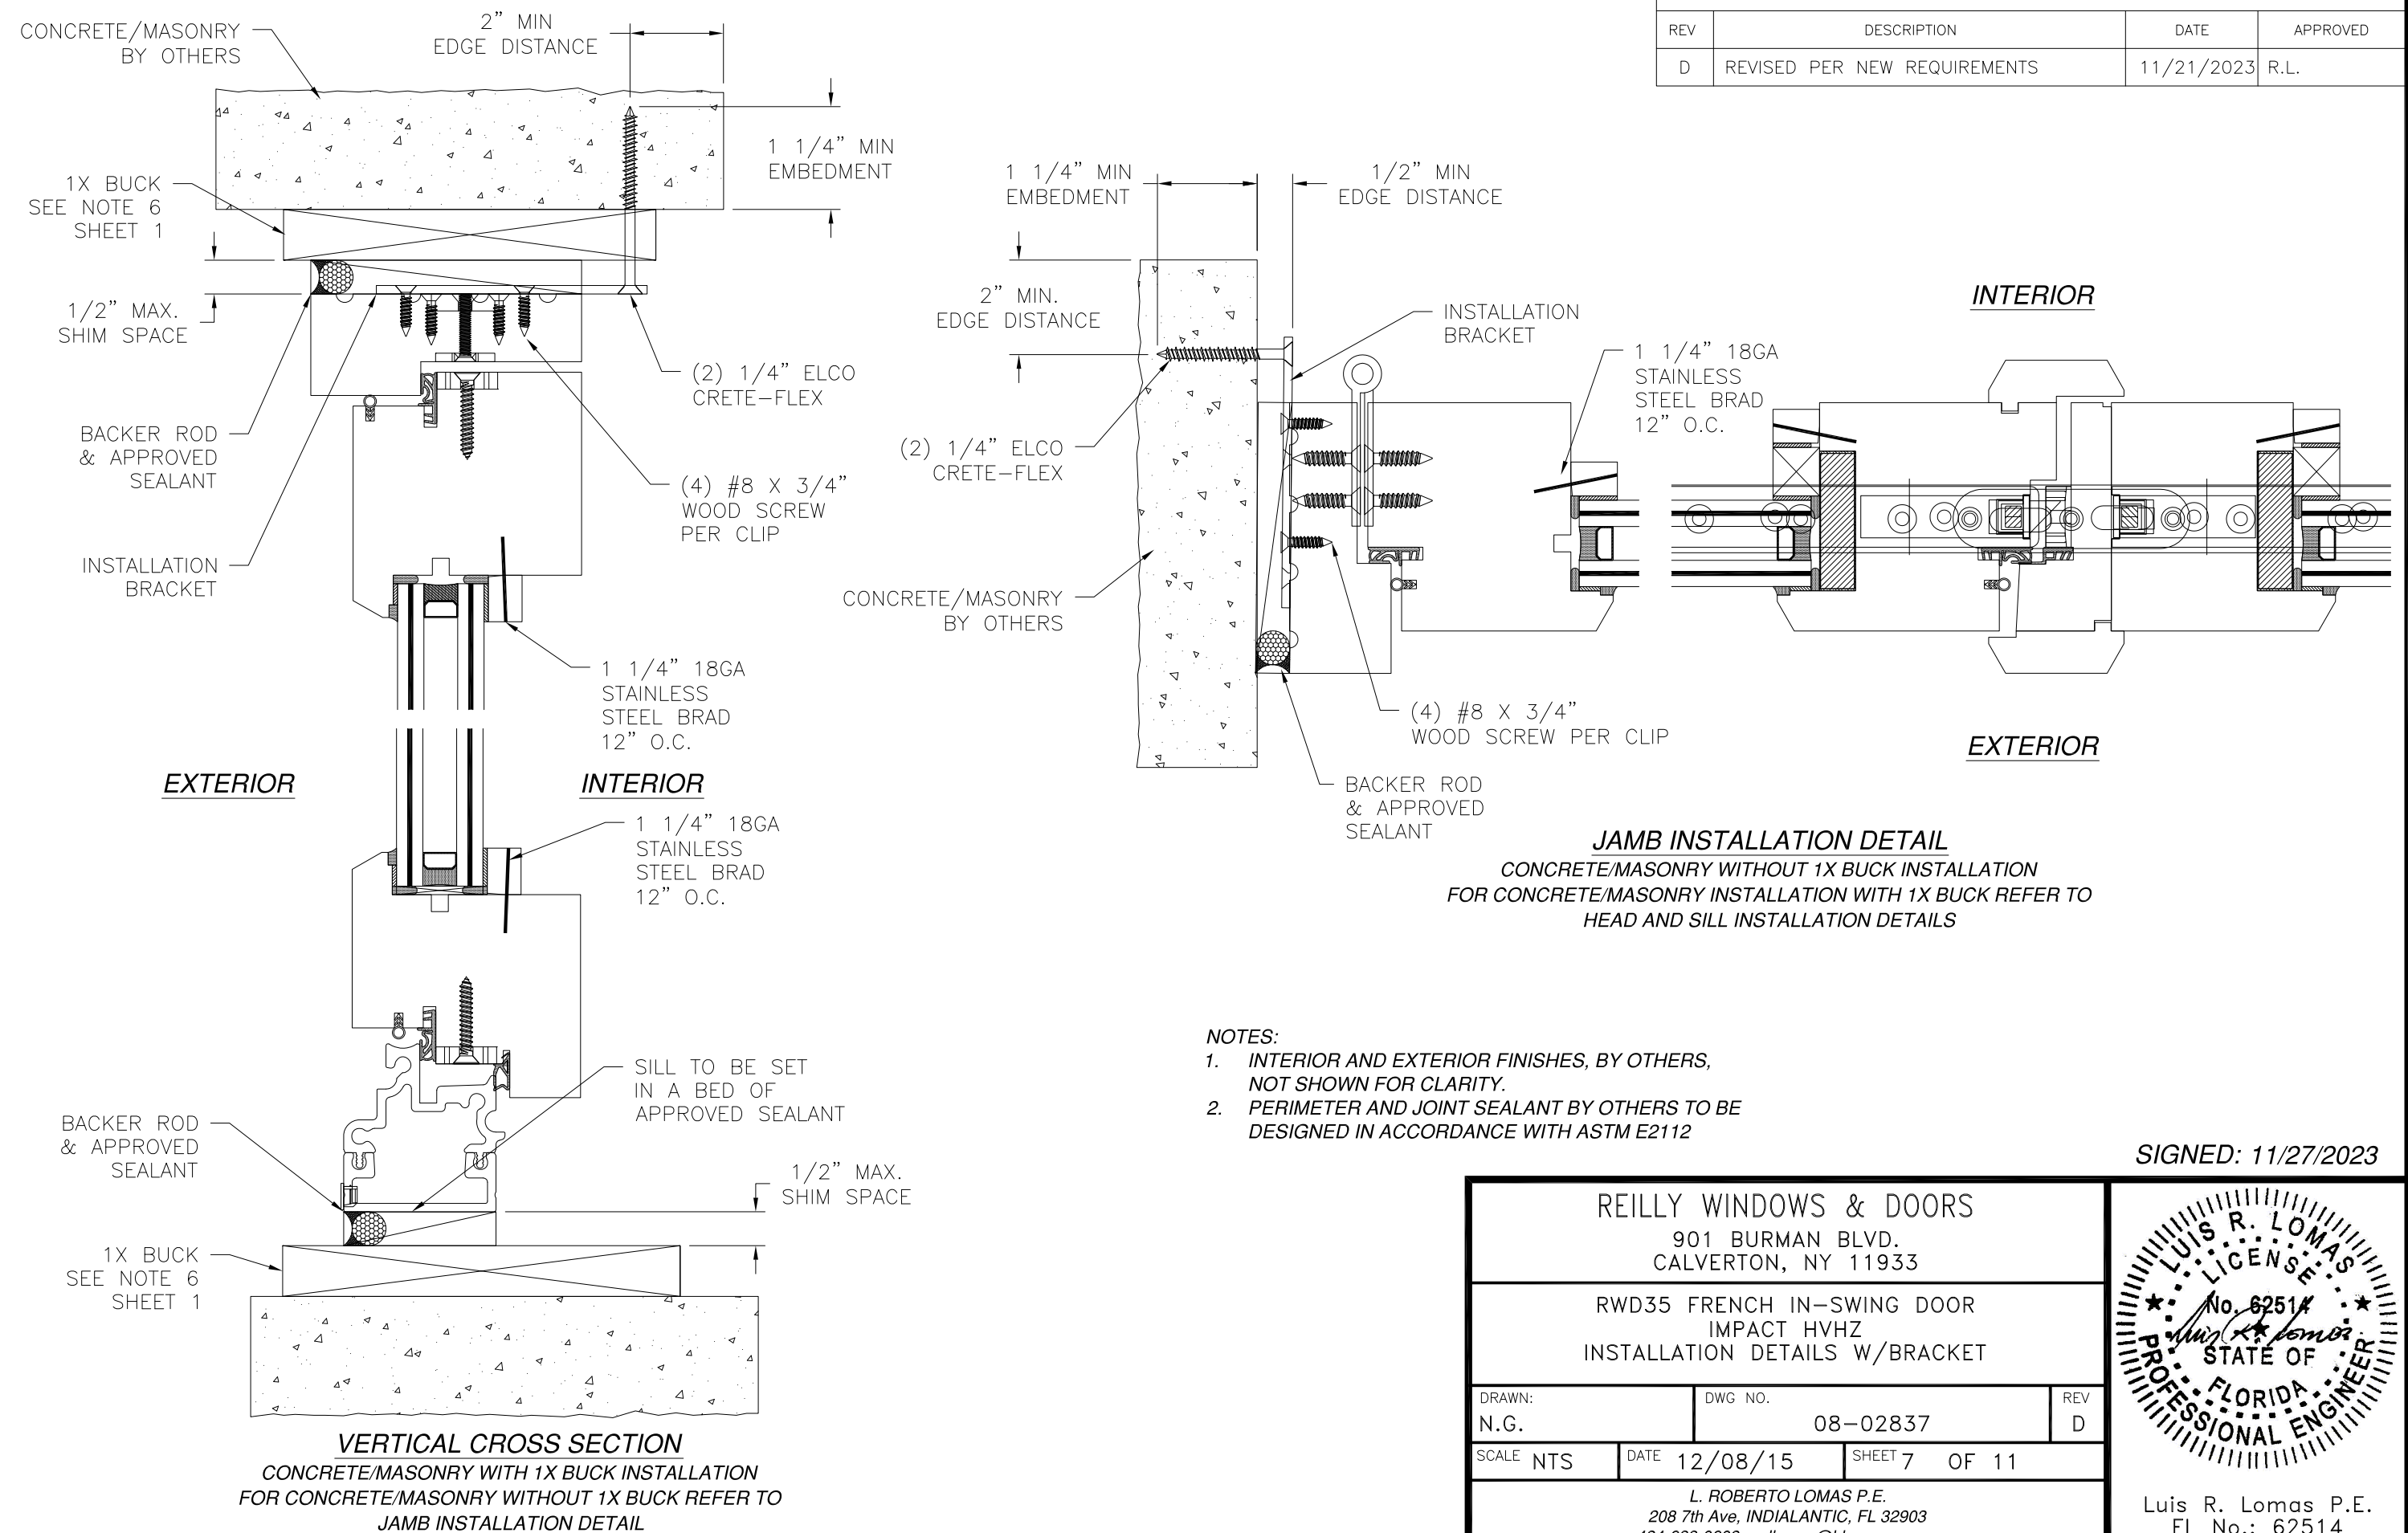

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 11/27/2023

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
INSTALLATION DETAILS W/BRACKET

DRAWN:
N.G.

DWG NO.
08-02837


REV
D

SCALE
NTS


DATE
12/08/15

SHEET
7 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

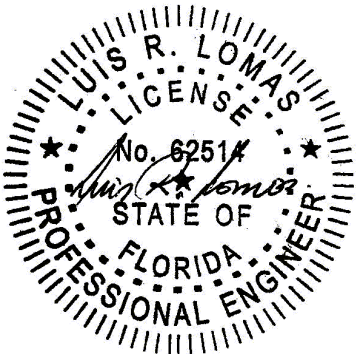


Luis R. Lomas P.E.
FL No.: 62514

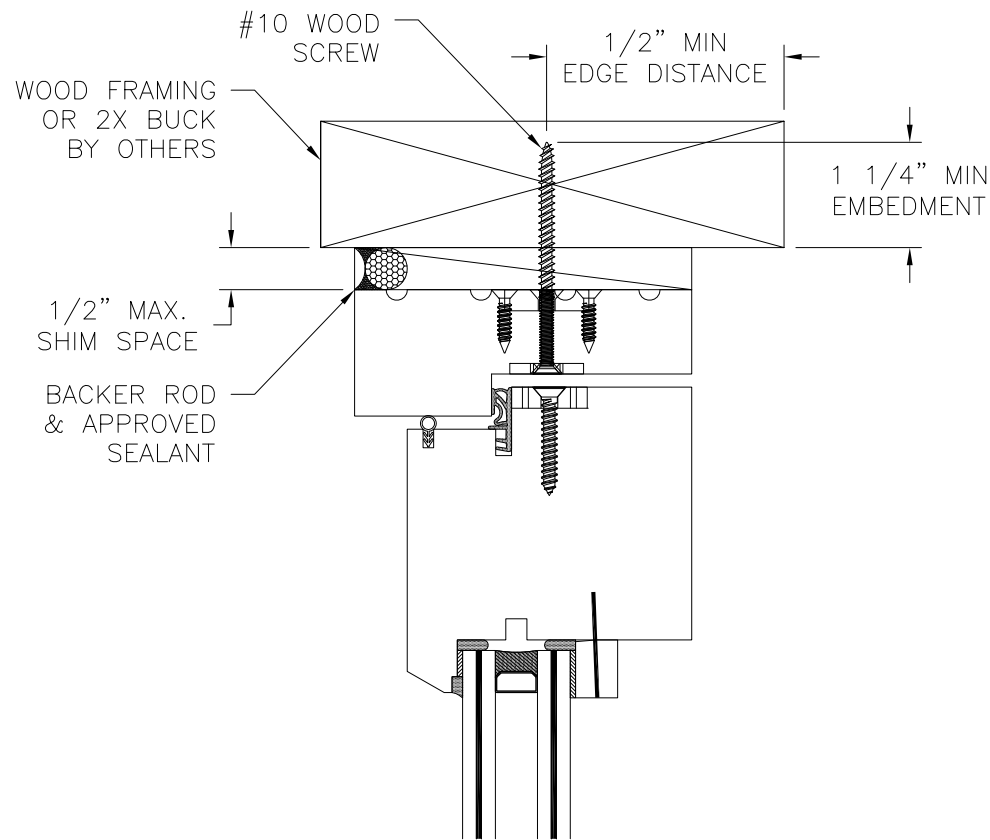

EXTERIOR


INTERIOR

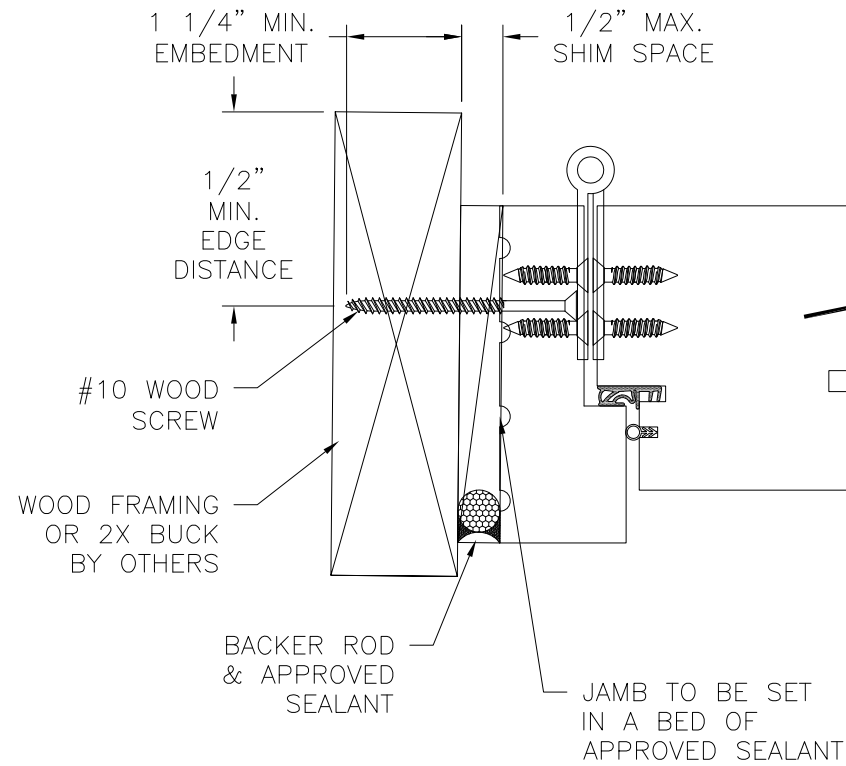


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

INTERIOR

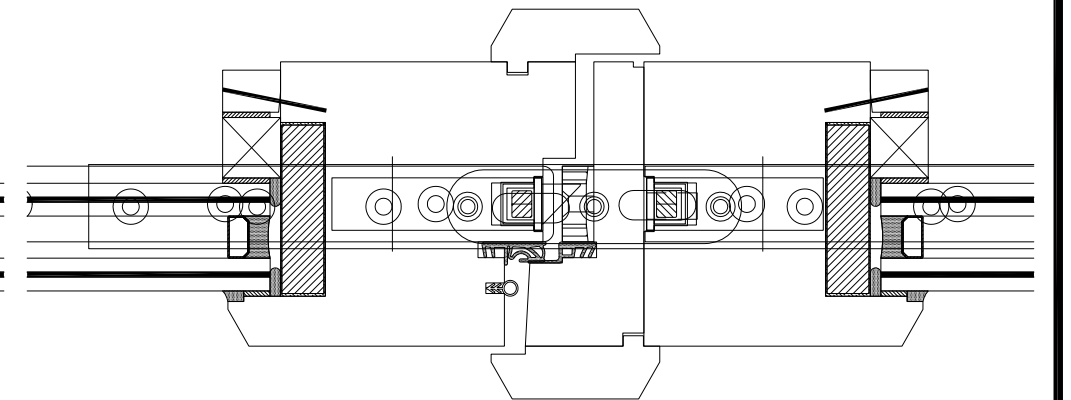

EXTERIOR

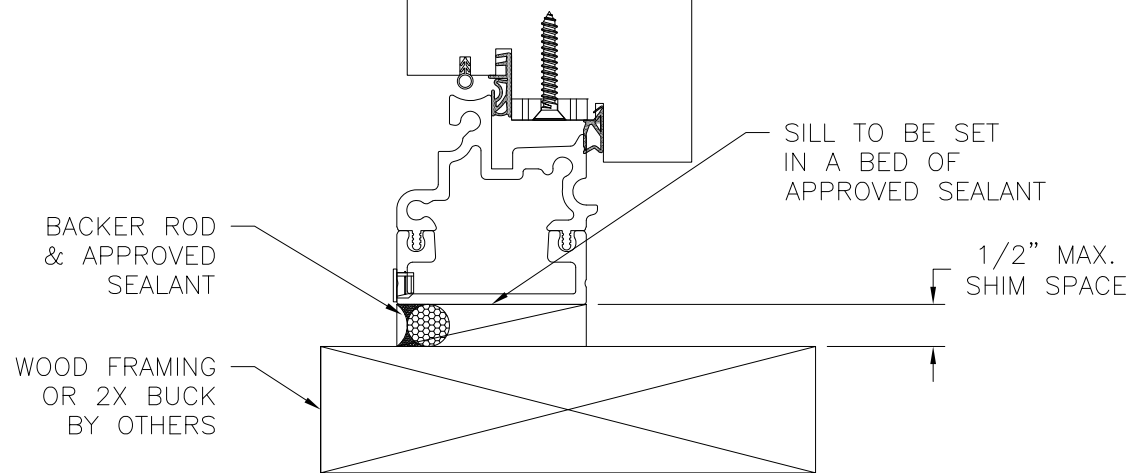

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 11/27/2023


REILLY WINDOWS & DOORS

901 BURMAN BLVD.
CALVERTON, NY 11933


RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
FRAME INSTALLATION DETAILS

DRAWN: N.G.	DWG NO. 08-02837	REV D
SCALE NTS	DATE 12/08/15	SHEET 8 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

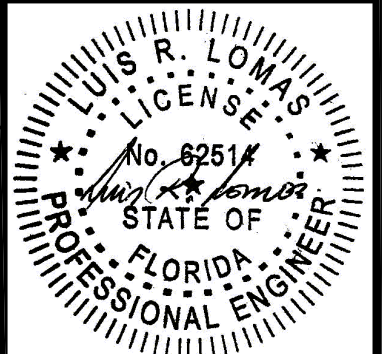

Luis R. Lomas P.E.
FL No.: 62514

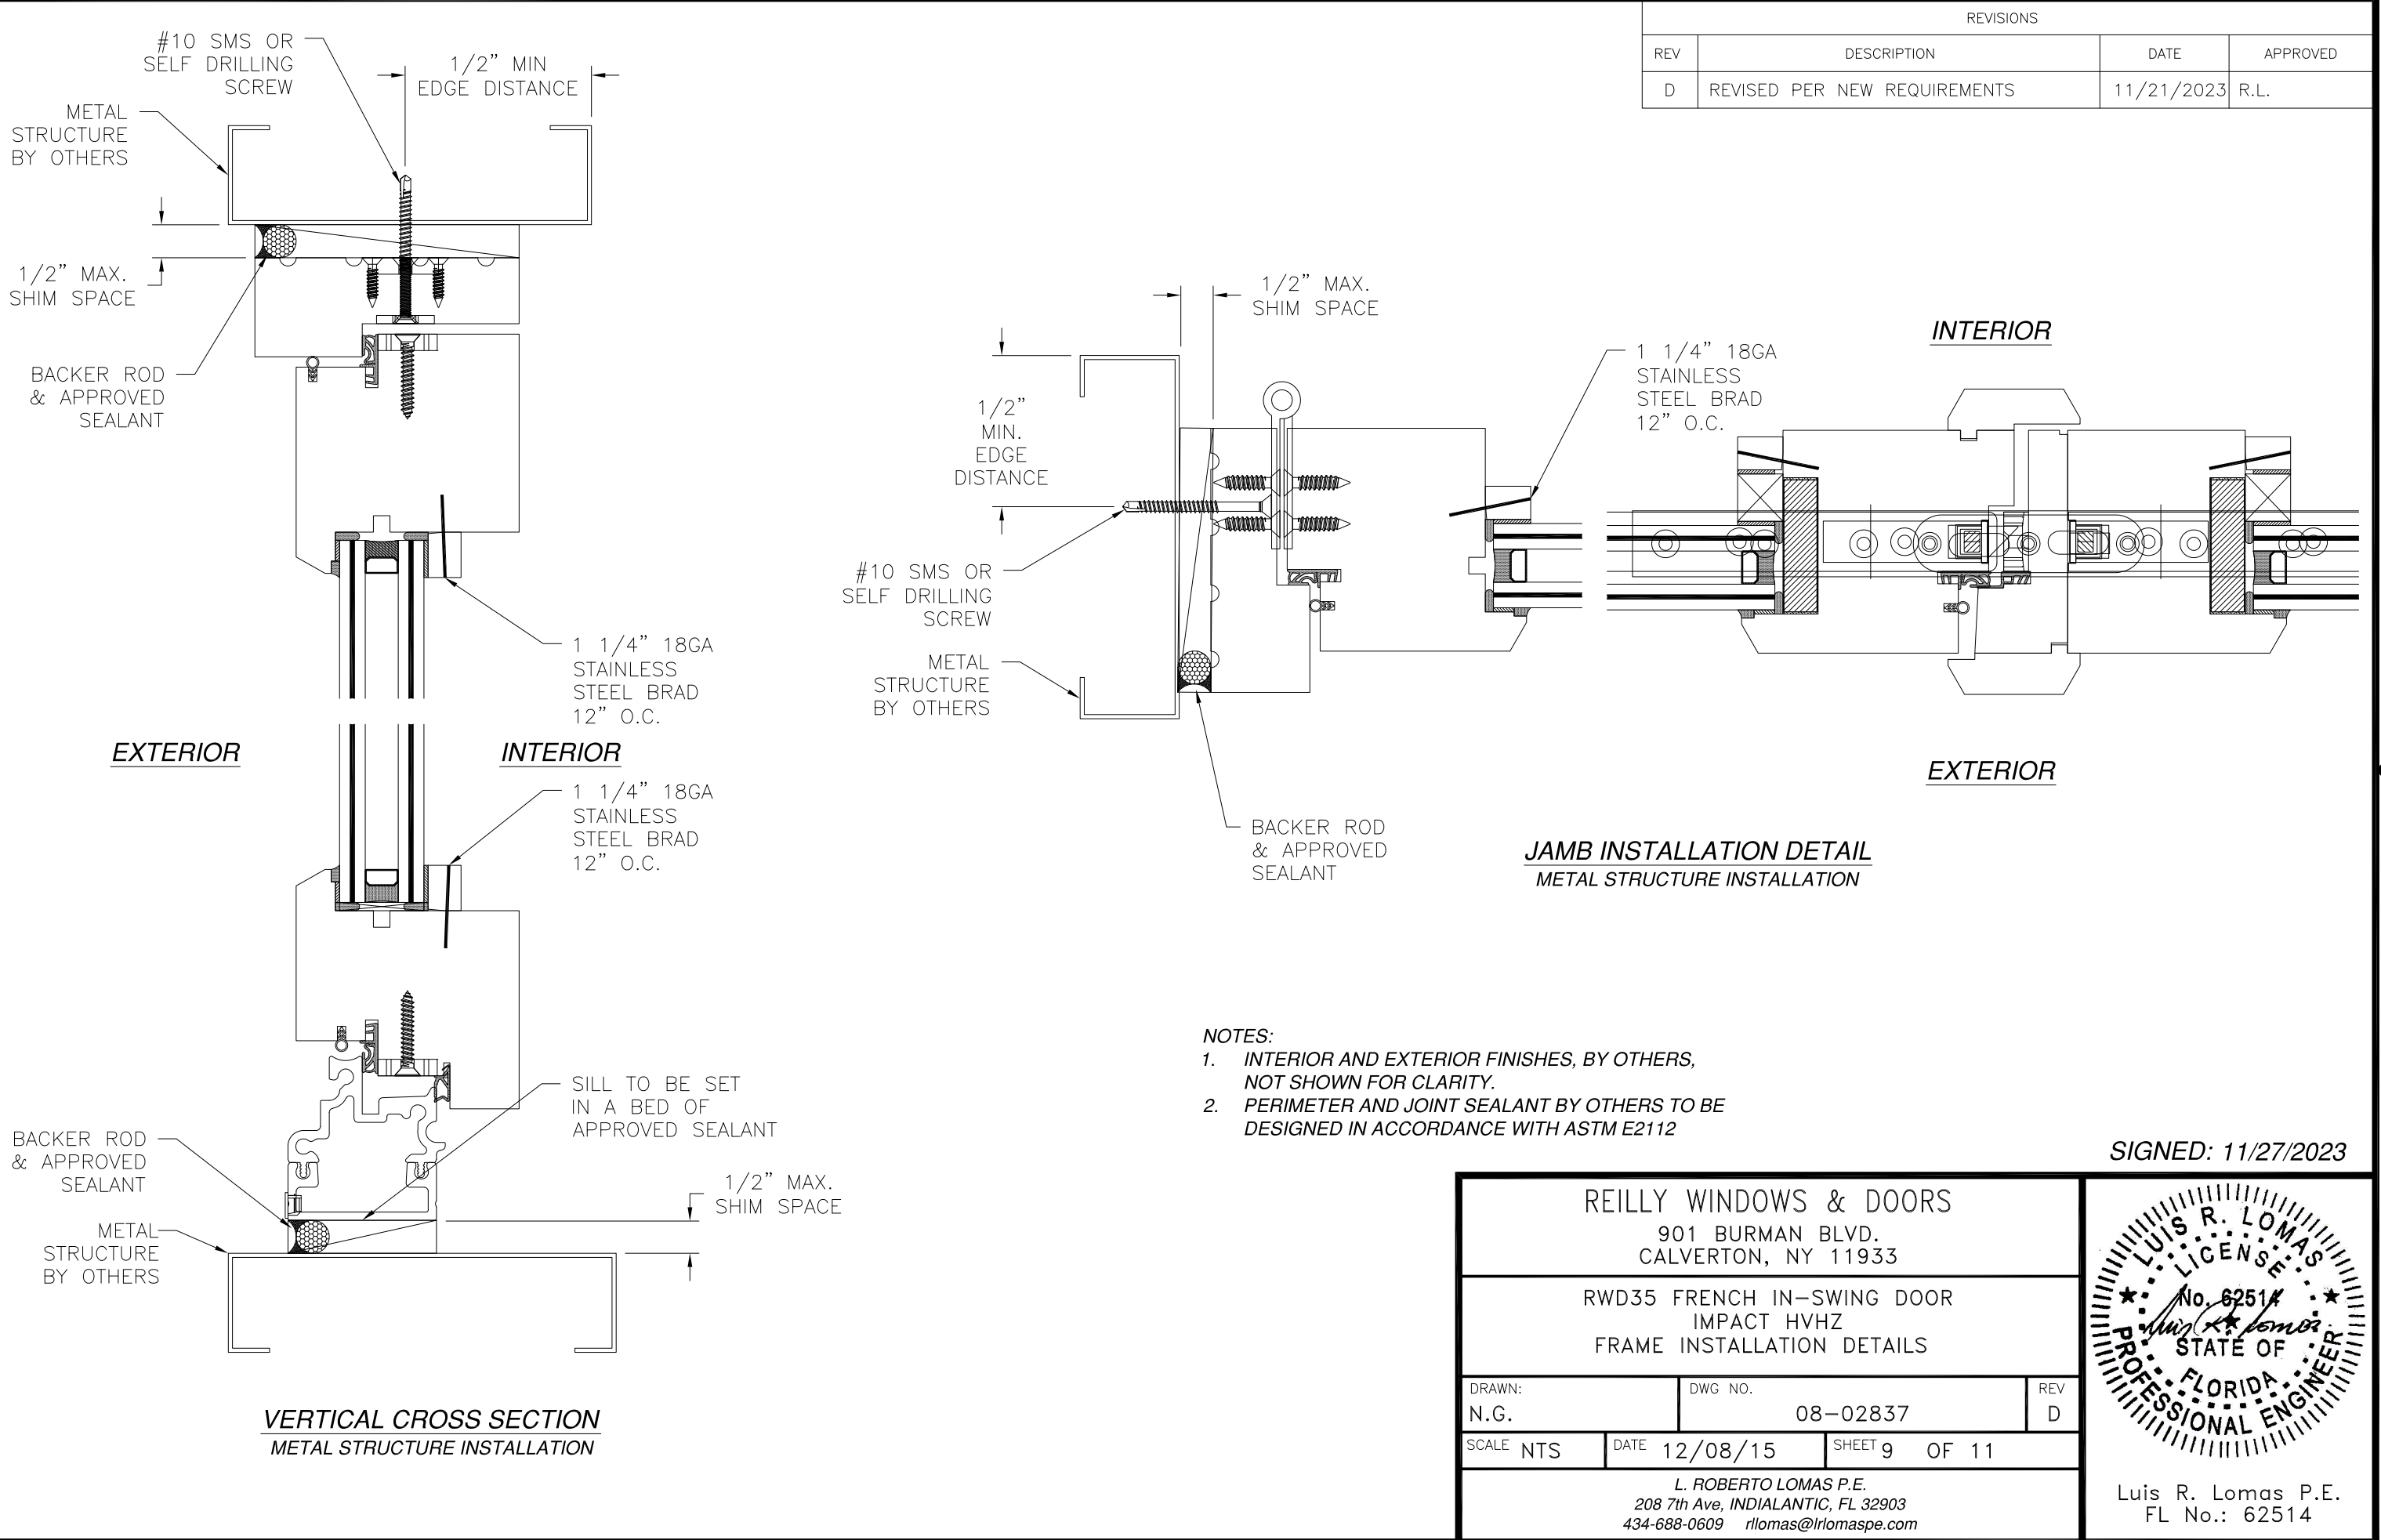

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 11/27/2023

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933


RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
FRAME INSTALLATION DETAILS

DRAWN: N.G.	DWG NO. 08-02837	REV D
SCALE NTS	DATE 12/08/15	SHEET 9 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

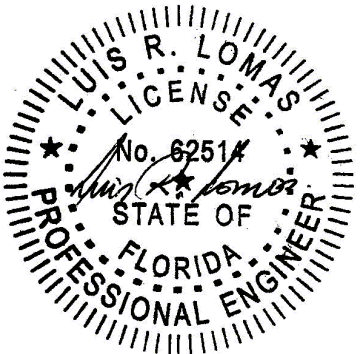


Luis R. Lomas P.E.
FL No.: 62514

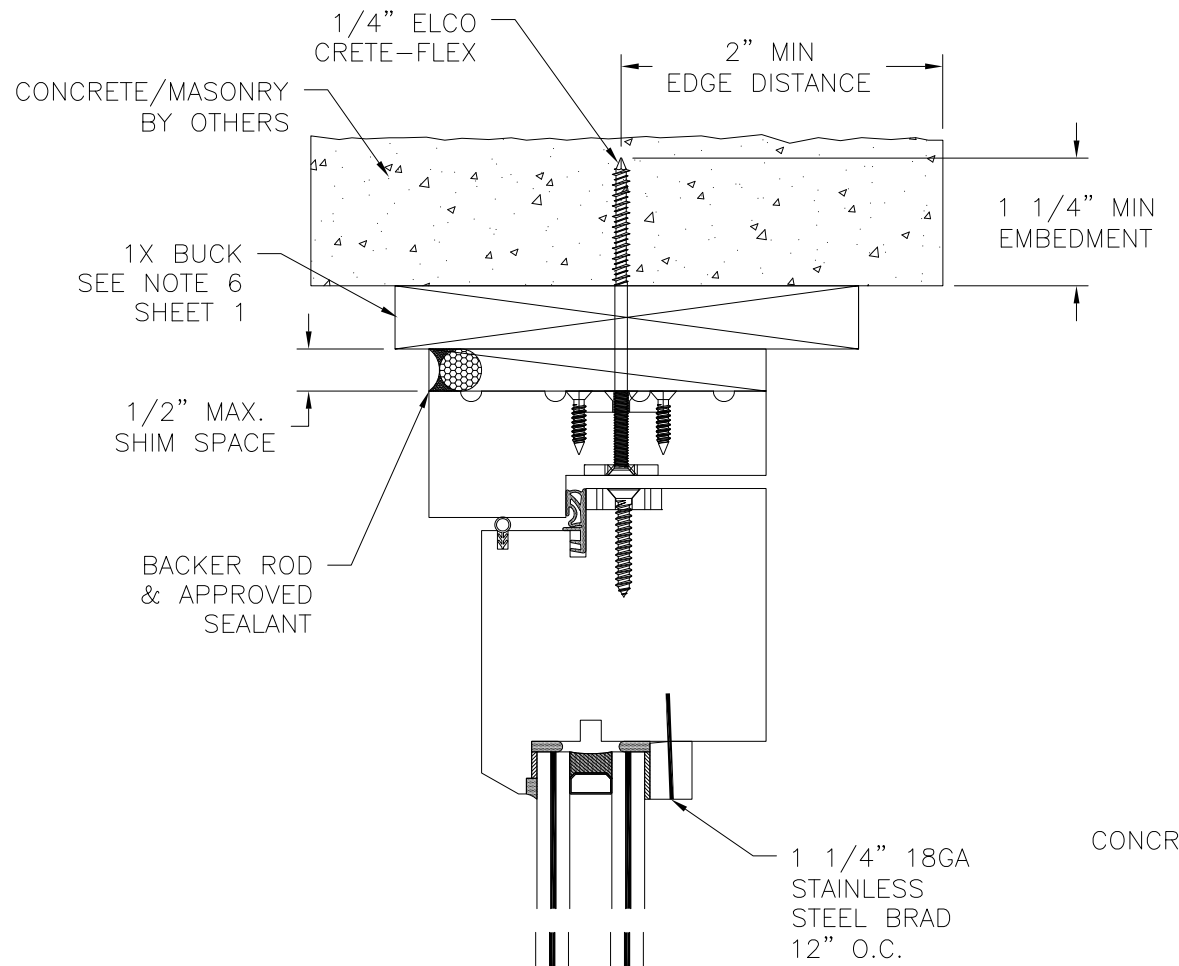


EXTERIOR

INTERIOR

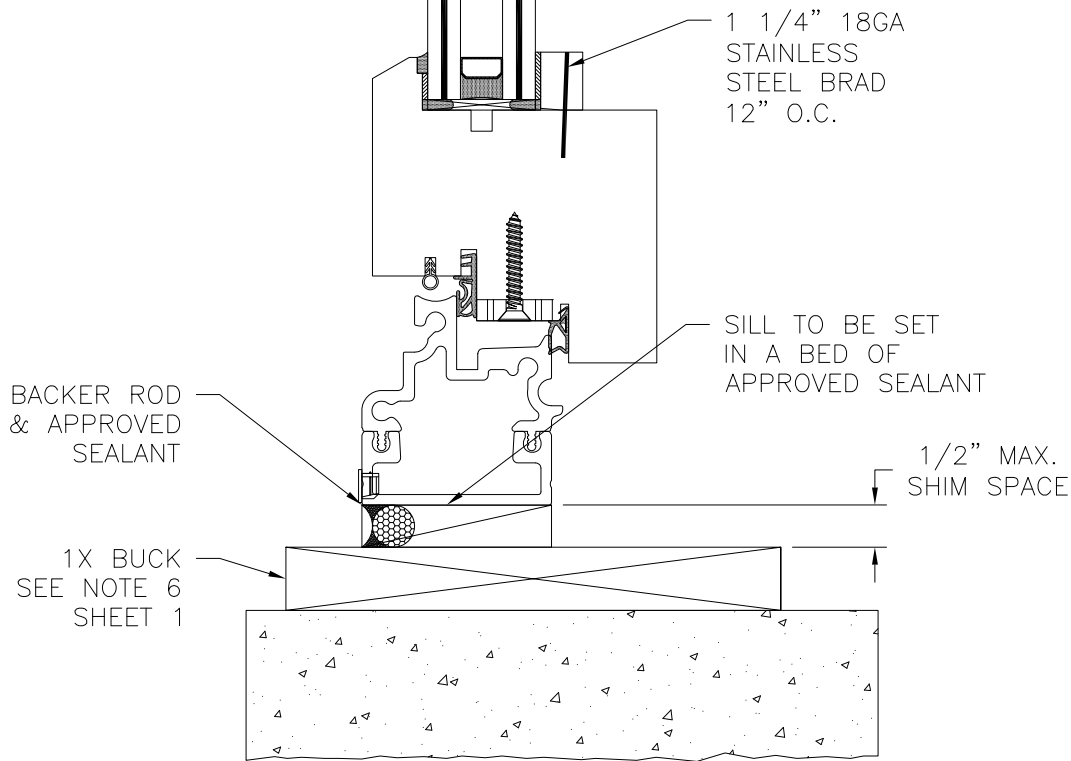

VERTICAL CROSS SECTION
CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
JAMB INSTALLATION DETAIL

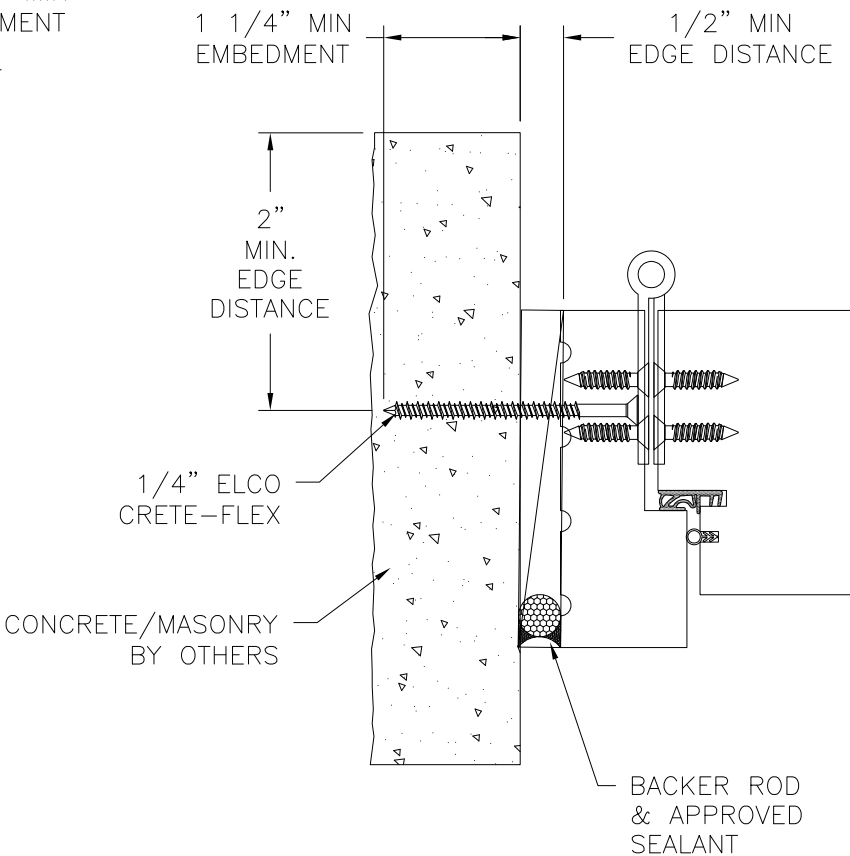

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
FOR CONCRETE/MASONRY WITH 1X BUCK REFER TO
HEAD AND SILL INSTALLATION DETAILS

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933


RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
FRAME INSTALLATION DETAILS

DRAWN: N.G.	DWG NO. 08-02837	REV D
SCALE NTS	DATE 12/08/15	SHEET 10 OF 11


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 11/27/2023


Luis R. Lomas P.E.
FL No.: 62514

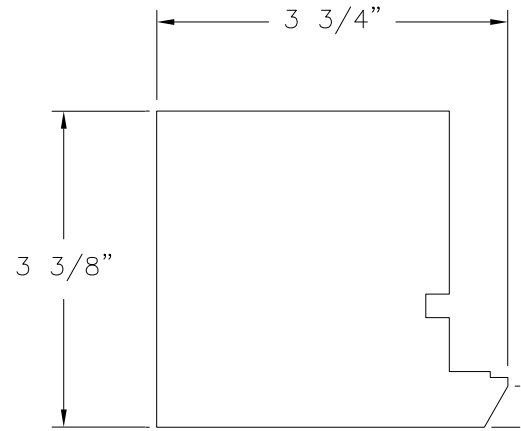


STILE & RAIL (B3.12)
MAHOGANY

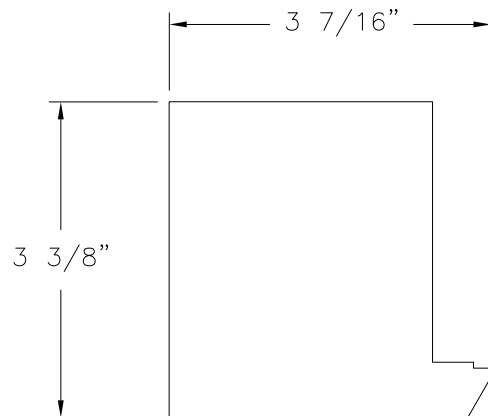


MEETING RAIL - RIGHT (B2.81)
MAHOGANY

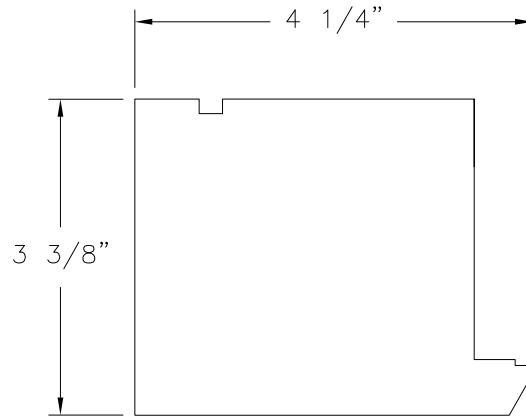


MEETING RAIL - LEFT (B3.62)
MAHOGANY

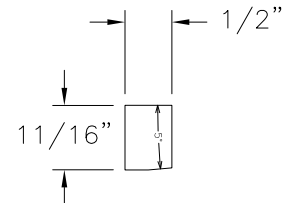


GLASS STOP (GSA)
MAHOGANY

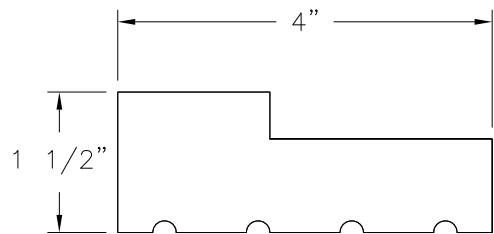


VERTICAL/HORIZONTAL JAMB(J4)
MAHOGANY




EXTERIOR ASTRAGAL (AS2)
MAHOGANY




INTERIOR ASTRAGAL (AS2A)
MAHOGANY

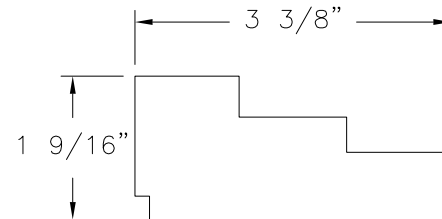



INACTIVE ASTRAGAL (AS3.3)
MAHOGANY

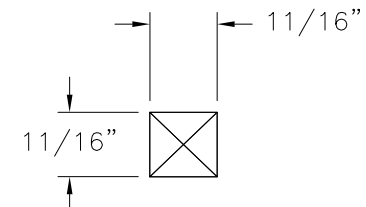

GLASS STOP BLOCK (BL1)
MAHOGANY

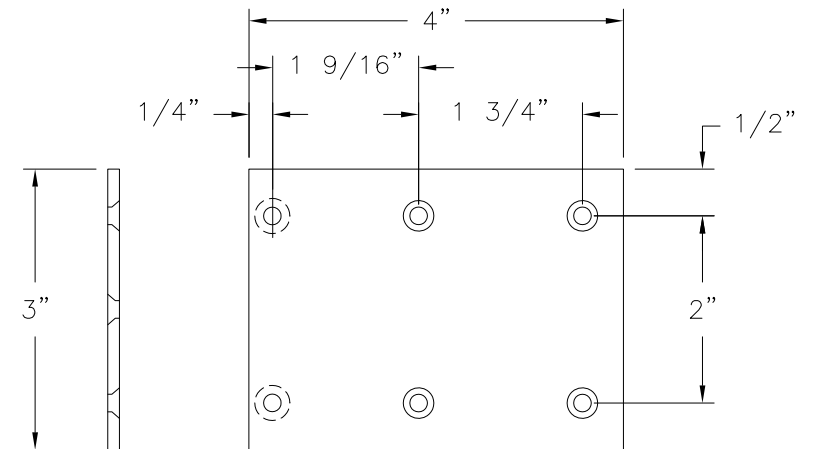

INSTALLATION BRACKET
ALUMINUM 6063-T5 .125 " THICK

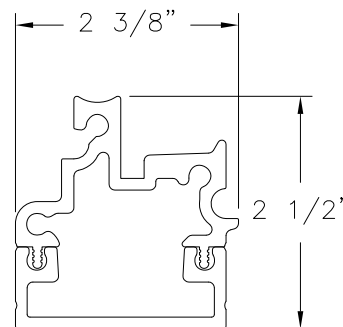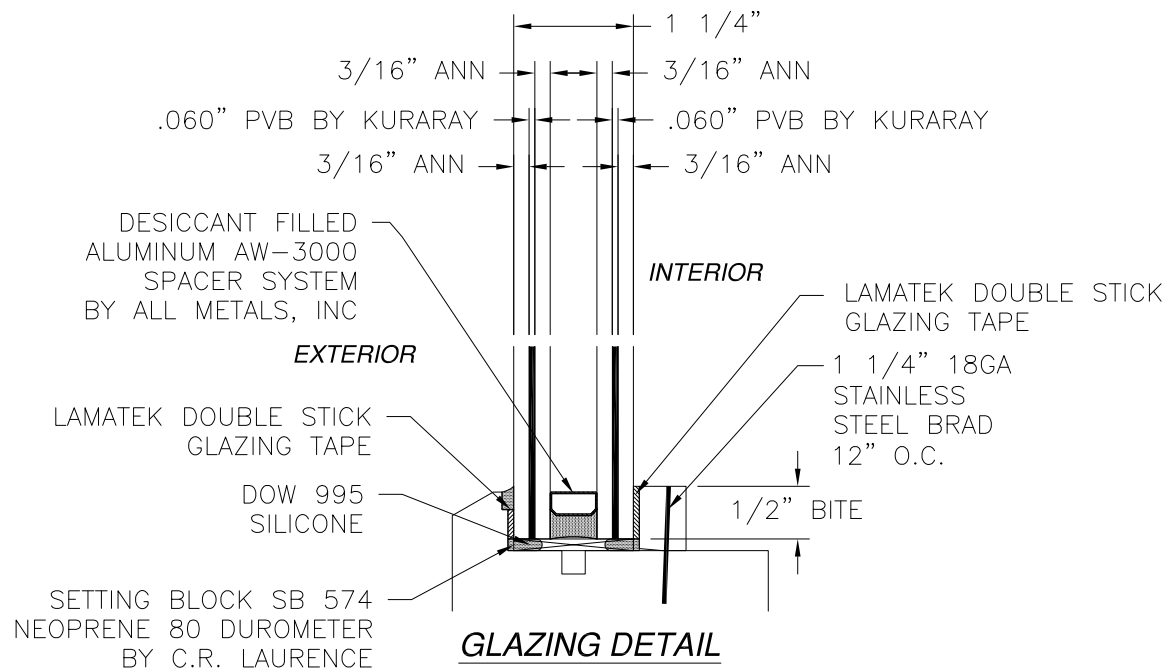

SILL
BRONZE .125 " THICK

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	11/21/2023	R.L.

SIGNED: 11/27/2023


REILLY WINDOWS & DOORS

901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH IN-SWING DOOR
IMPACT HVHZ
GLAZING DETAIL AND COMPONENTS

DRAWN: N.G.	DWG NO. 08-02837	REV D
SCALE NTS	DATE 12/08/15	SHEET 11 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

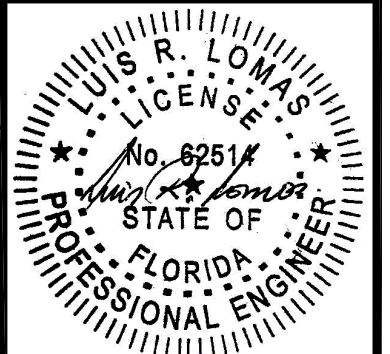

Luis R. Lomas P.E.
FL No.: 62514