

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: MAHOGANY
11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 11 FOR GLASS DETAILS.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

13. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4” ELCO CRETE–FLEX TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.

D. METAL STRUCTURE: STEEL 18GA (.048”) FY=33KSI/FU=52KSI OR ALUMINUM 6063–T5 FU=30KSI .125” THICK MINIMUM.
19. APPROVED CONFIGURATIONS: XX, X.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 – 4	ELEVATIONS AND CHARTS
5 – 10	INSTALLATION DETAILS
11	GLAZING DETAIL AND COMPONENTS

REILLY WINDOWS & DOORS

901 BURMAN BLVD.

CALVERTON, NY 11933

RWD35 FRENCH OUT–SWING DOOR

IMPACT

NOTES

DRAWN:

DWG NO.

REV

R.L.

08–03985

–

SCALE

DATE

SHEET

NTS

11/14/23

1

OF

11

L. ROBERTO LOMAS P.E.

1432 WOODFORD RD LEWISVILLE, NC 27023

434-688-0609 rllomas@rlomaspe.com

SIGNED: 11/14/2023

LUIS R. LOMAS

LICENS. E. S.

No. 62514

STATE OF



FLORIDA

PROFESSIONAL ENGINEER

Luis R. Lomas P.E.

FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

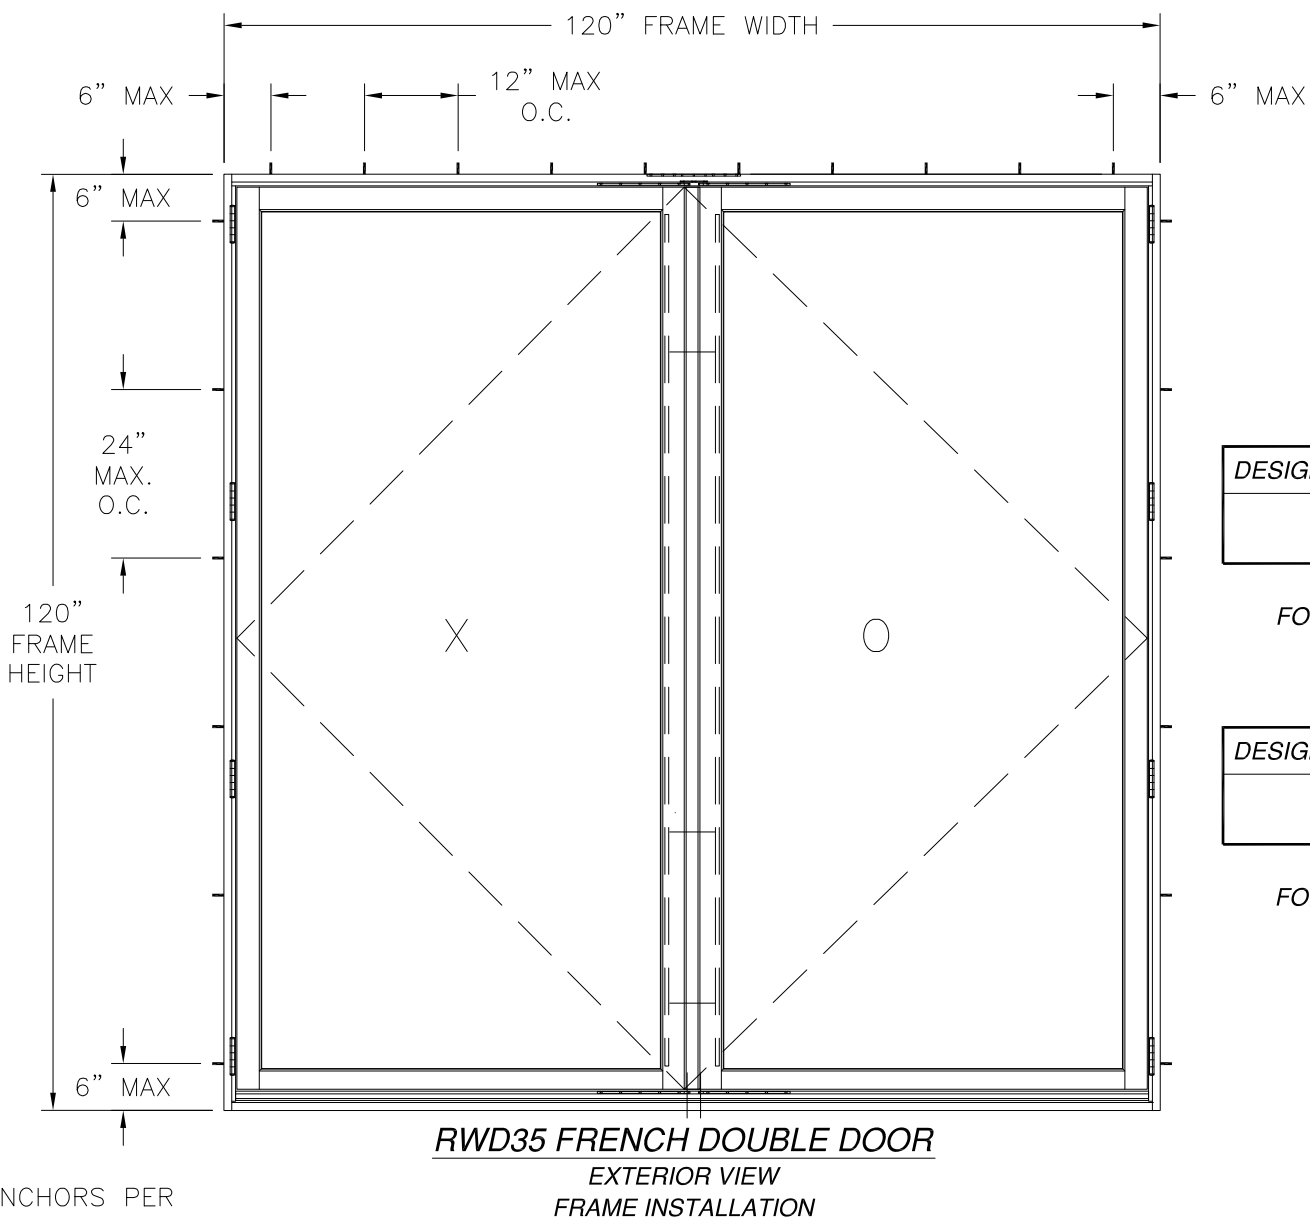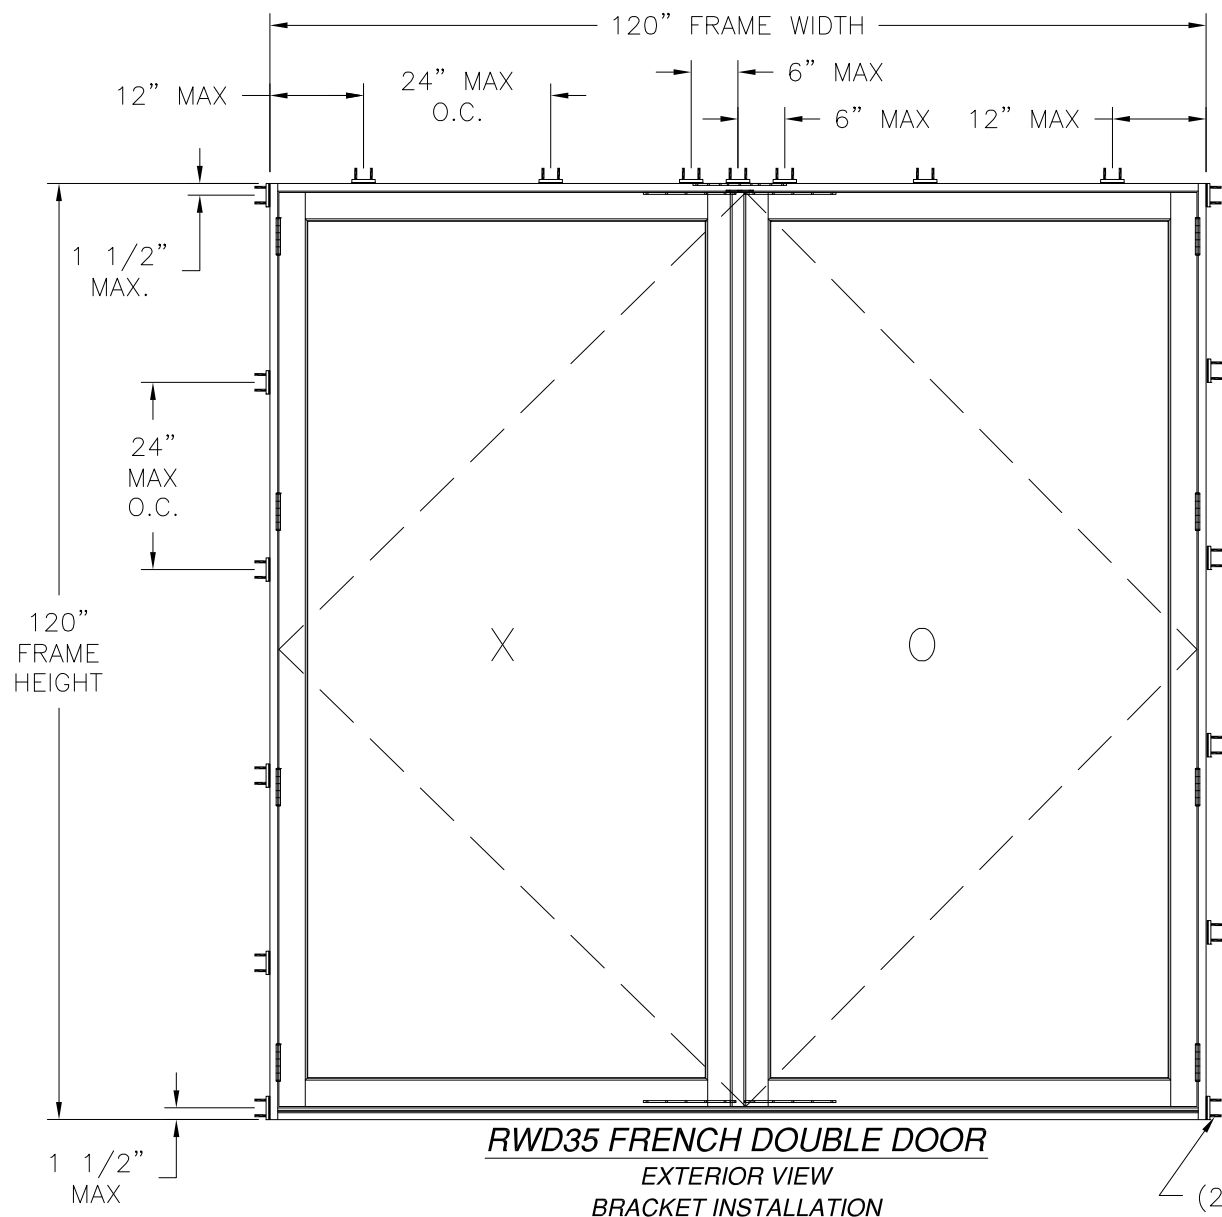

WITH GLASS A	
DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4
FOR ADDITIONAL SIZES SEE CHART #1

WITH GLASS B	
DESIGN PRESSURE RATING	IMPACT RATING
±33.8PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4
FOR ADDITIONAL SIZES SEE CHART #2

58 3/4" X 117 5/32" PANEL SHOWN, OTHER SIZES ARE APPROVED
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 47.8 FT²

HARDWARE SCHEDULE	
A.	(8) 4.5" X 4.5" MERIT BUTTON TOP HINGES 35 1/2" O.C.
B.	(1) HOPPE INACTIVE GEAR (2074564) W/BOTTOM SHOOT BOLT AT LOCK STILE
C.	SHOOT BOLT WITH 1740MM EXTENSION AT TOP LOCK STILE
D.	SHOOT BOLT WITH 475MM EXTENSION AT TOP LOCK STILE
E.	(1) HOPPE ACTIVE GEAR (8778847) W/BOTTOM SHOOT BOLT AT LOCK STILE
F.	1/2" X 2" STEEL REINFORCEMENT AT EACH MEETING STILE
G.	STEEL REINFORCEMENT (RWD NOVA) AT SASH RAILS

- NOTES:
- PANEL SIZE: 58 3/4" x 117 5/32"
 - D.L.O.: 52 3/32" x 110 29/32"


REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
ELEVATION


DRAWN: R.L.	DWG NO. 08-03985	REV -
SCALE NTS	DATE 11/14/23	SHEET 2 OF 11

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

SIGNED: 11/14/2023

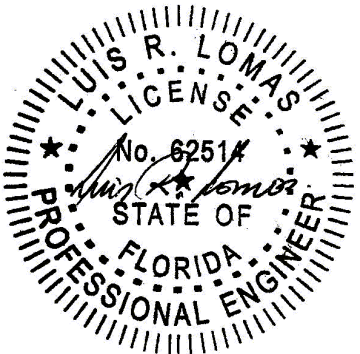

Luis R. Lomas P.E.
FL No.: 62514

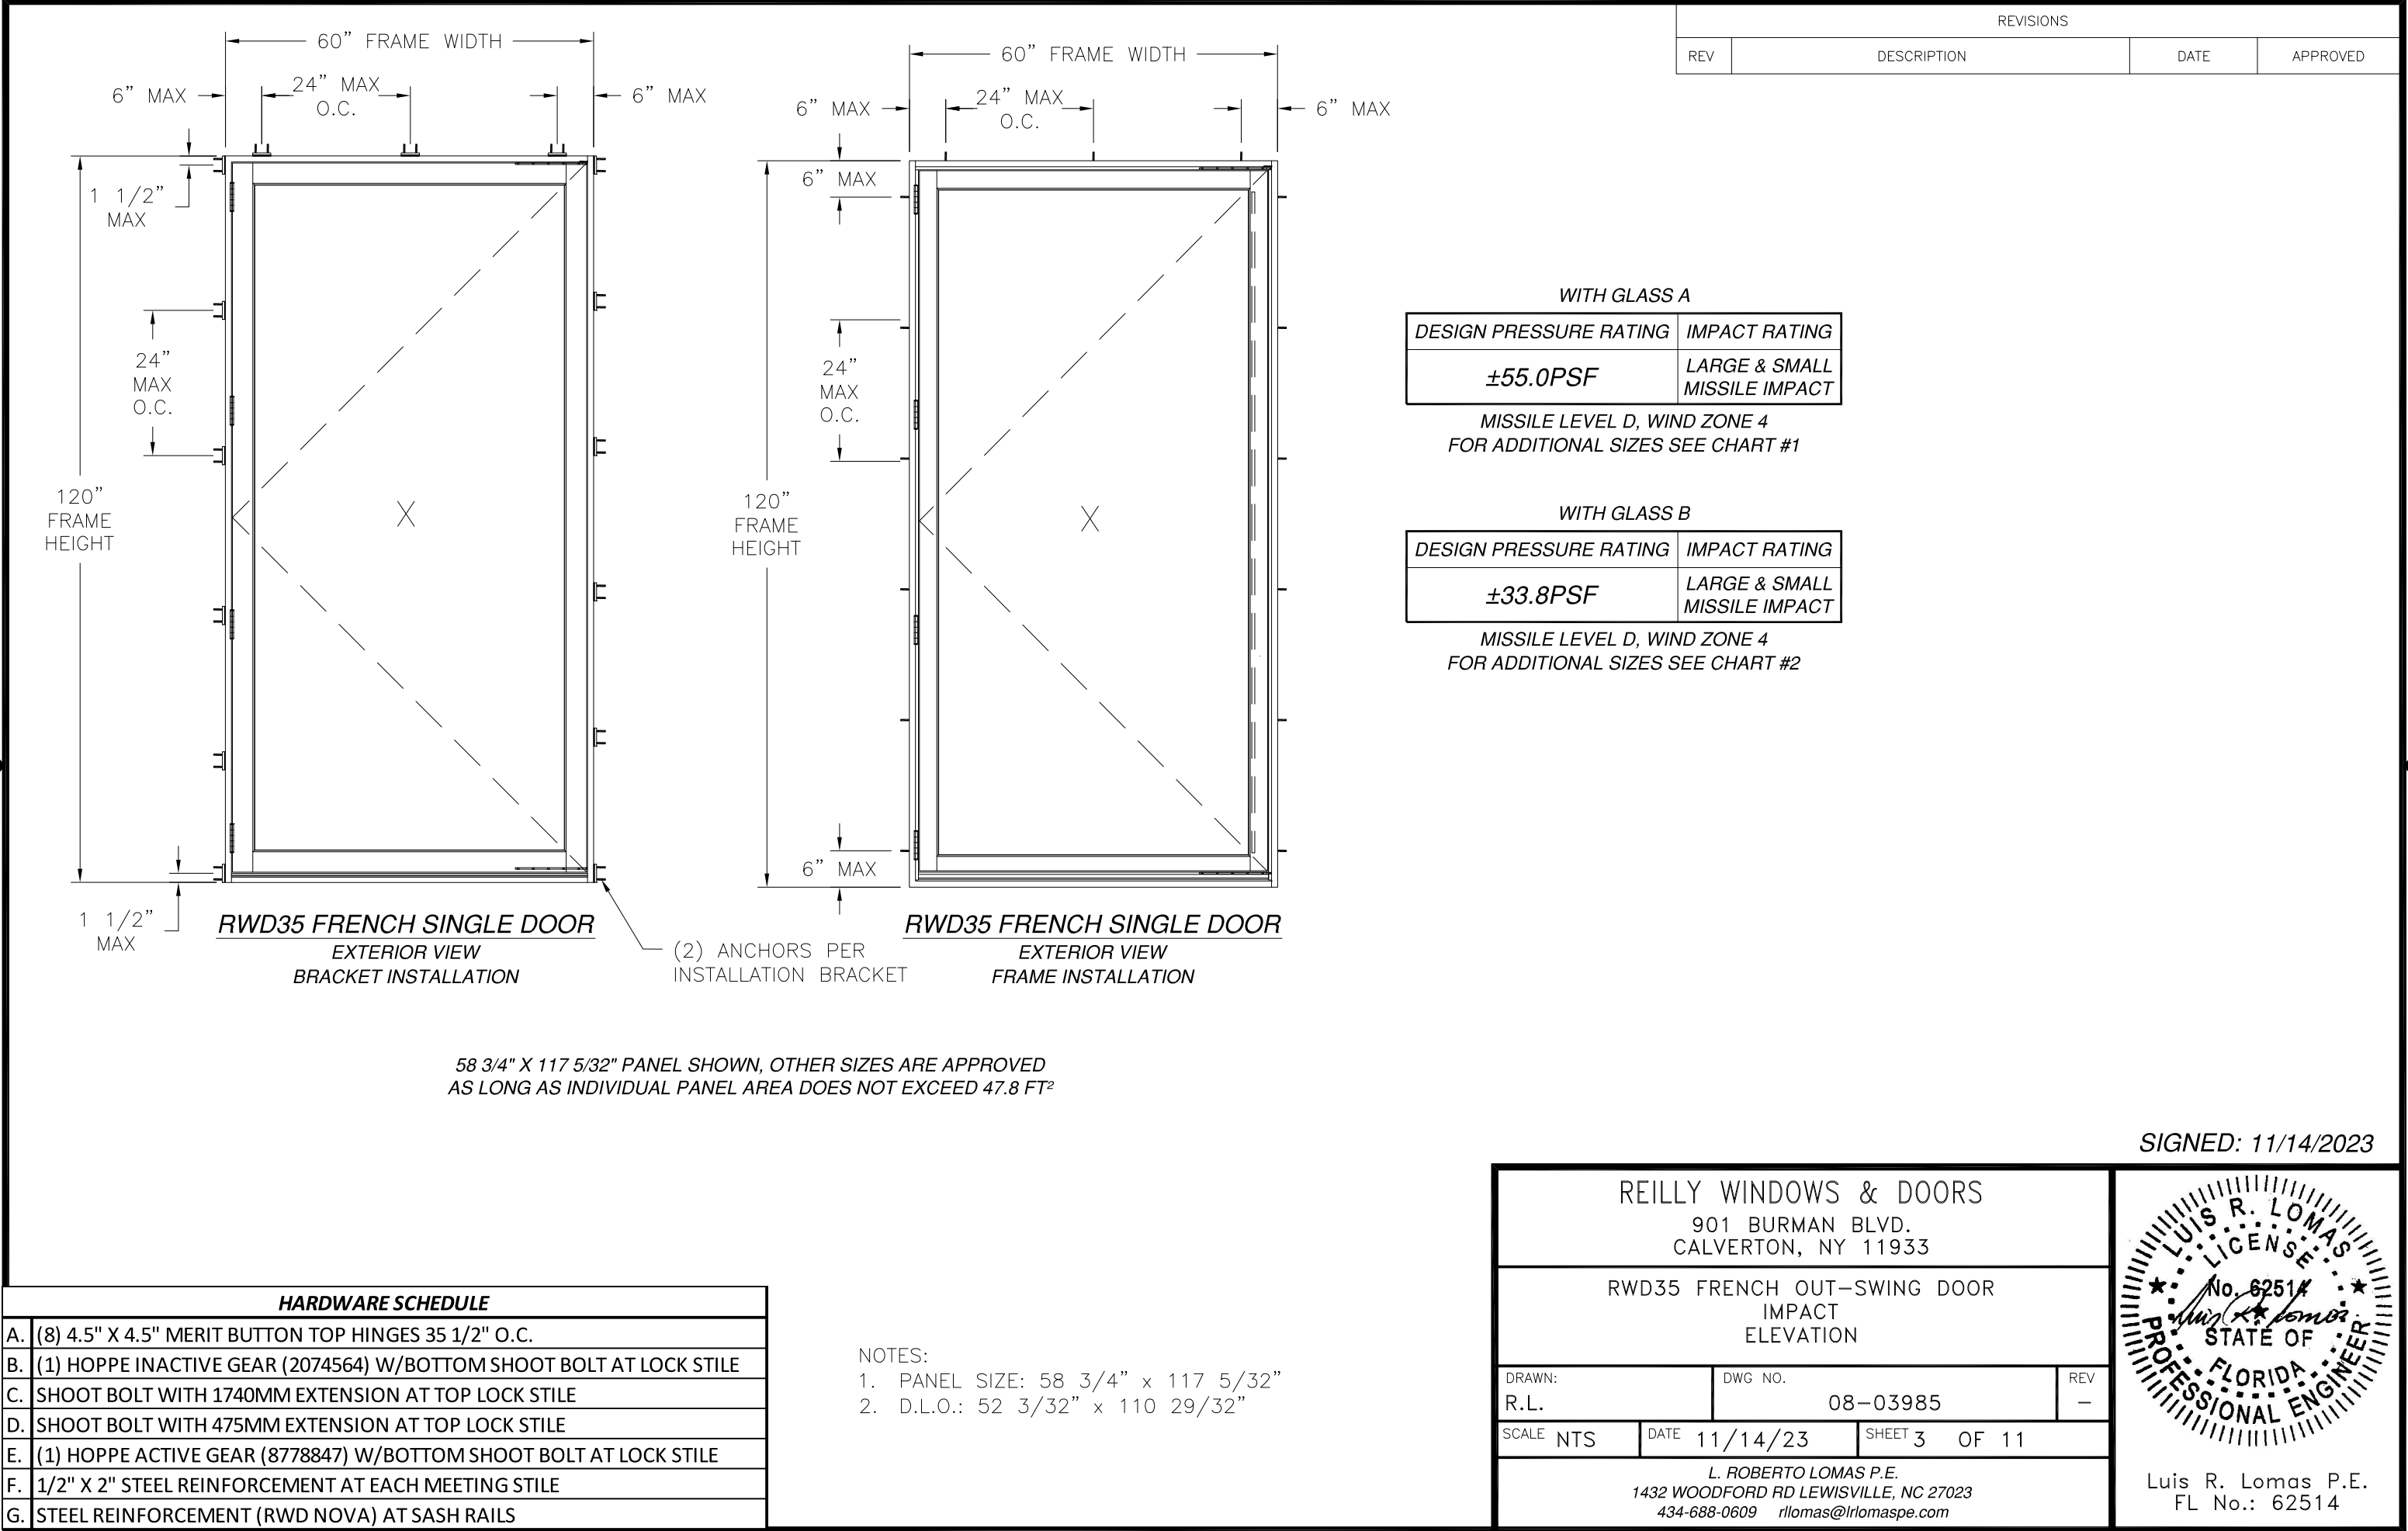

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

Chart #1

Ratings for doors with glass A (psf)														
Panel Height (in)	Panel Width (in)													
	24.00		30.00		36.00		42.00		48.00		54.00		58.75	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
80.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
84.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
90.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
96.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
102.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
108.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
114.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
117.28	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0

Chart #2

Ratings for doors with glass B (psf)														
Panel Height (in)	Panel Width (in)													
	24.00		30.00		36.00		42.00		48.00		54.00		58.75	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
80.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	53.9	53.9	49.5	49.5
84.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	51.3	51.3	47.2	47.2
90.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	53.9	53.9	47.9	47.9	44.0	44.0
96.00	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.5	50.5	44.9	44.9	41.3	41.3
102.00	55.0	55.0	55.0	55.0	55.0	55.0	54.3	54.3	47.5	47.5	42.3	42.3	38.8	38.8
108.00	55.0	55.0	55.0	55.0	55.0	55.0	51.3	51.3	44.9	44.9	39.9	39.9	36.7	36.7
114.00	55.0	55.0	55.0	55.0	55.0	55.0	48.6	48.6	42.5	42.5	37.8	37.8	34.8	34.8
117.28	55.0	55.0	55.0	55.0	55.0	55.0	47.3	47.3	41.3	41.3	36.8	36.8	33.8	33.8

SIGNED: 11/14/2023

REILLY WINDOWS & DOORS

901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR

IMPACT

RATINGS CHARTS

DRAWN:
R.L.

DWG NO.
08-03985

REV
-

SCALE NTS


DATE 11/14/23

SHEET 4 OF 11

L. ROBERTO LOMAS P.E.


1432 WOODFORD RD LEWISVILLE, NC 27023

434-688-0609 rllomas@lrlomaspe.com

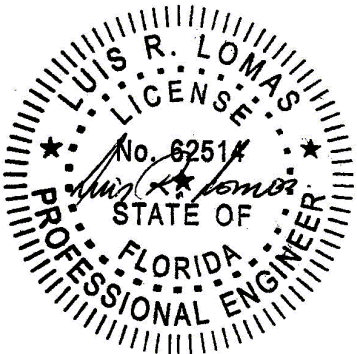

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

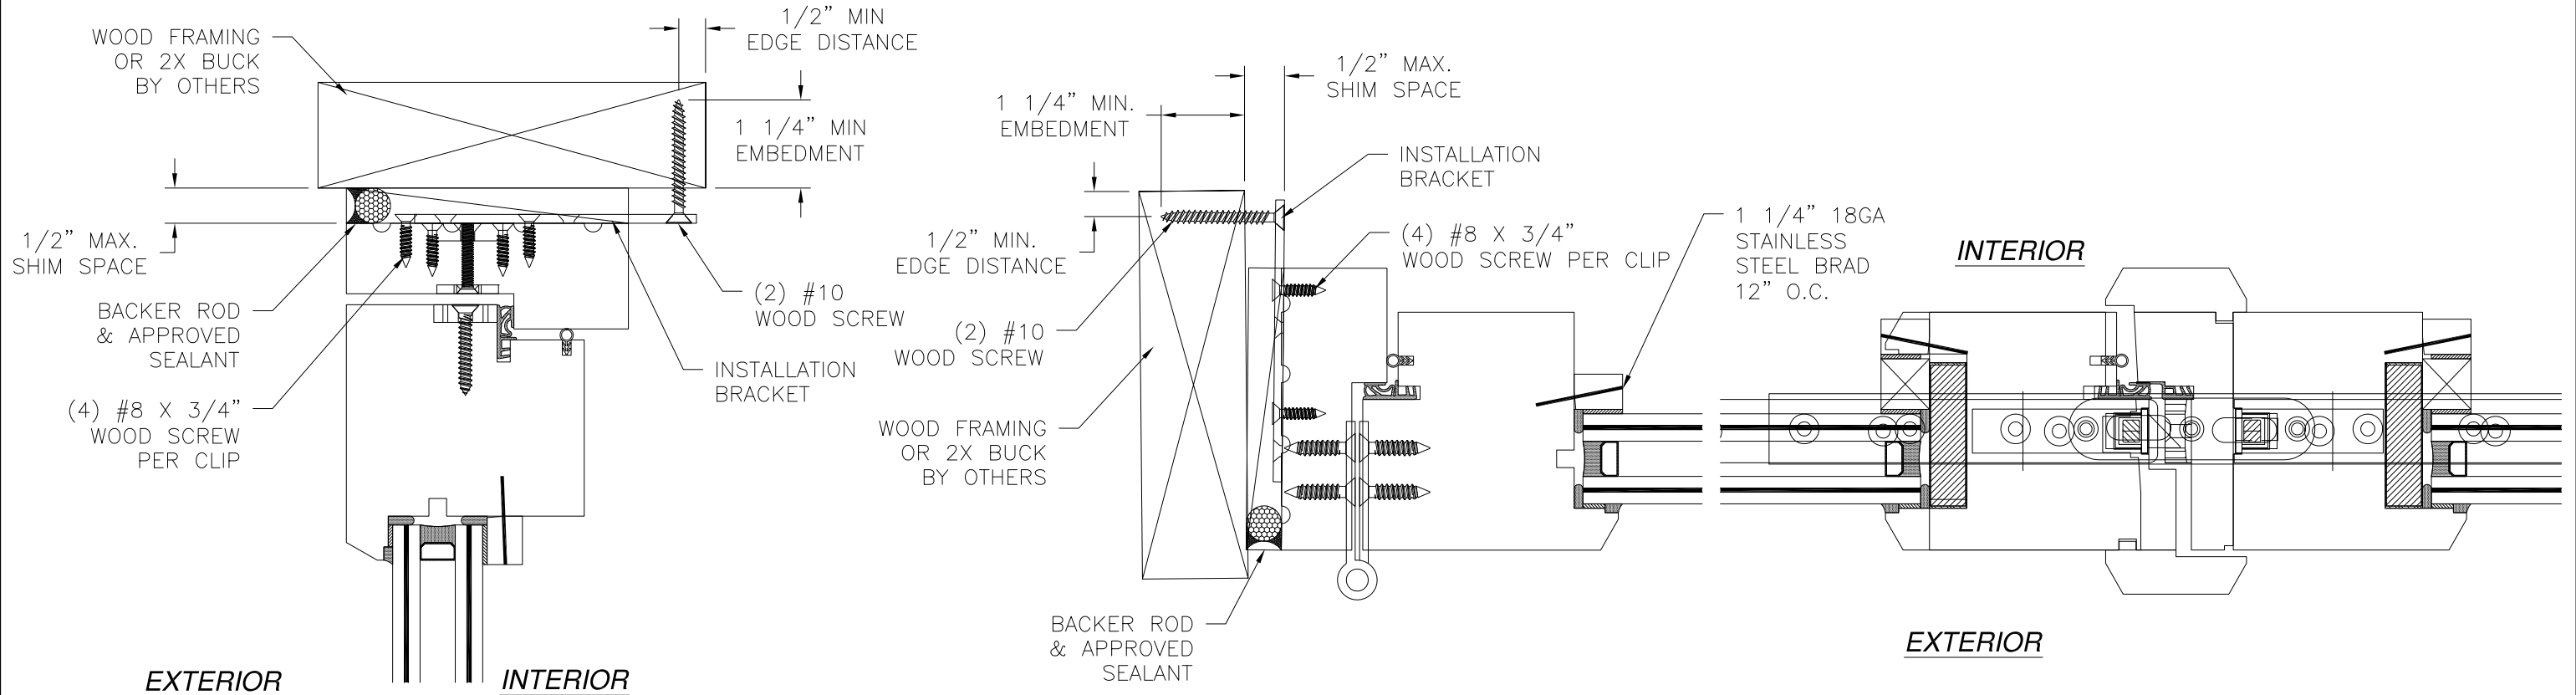

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 11/14/2023

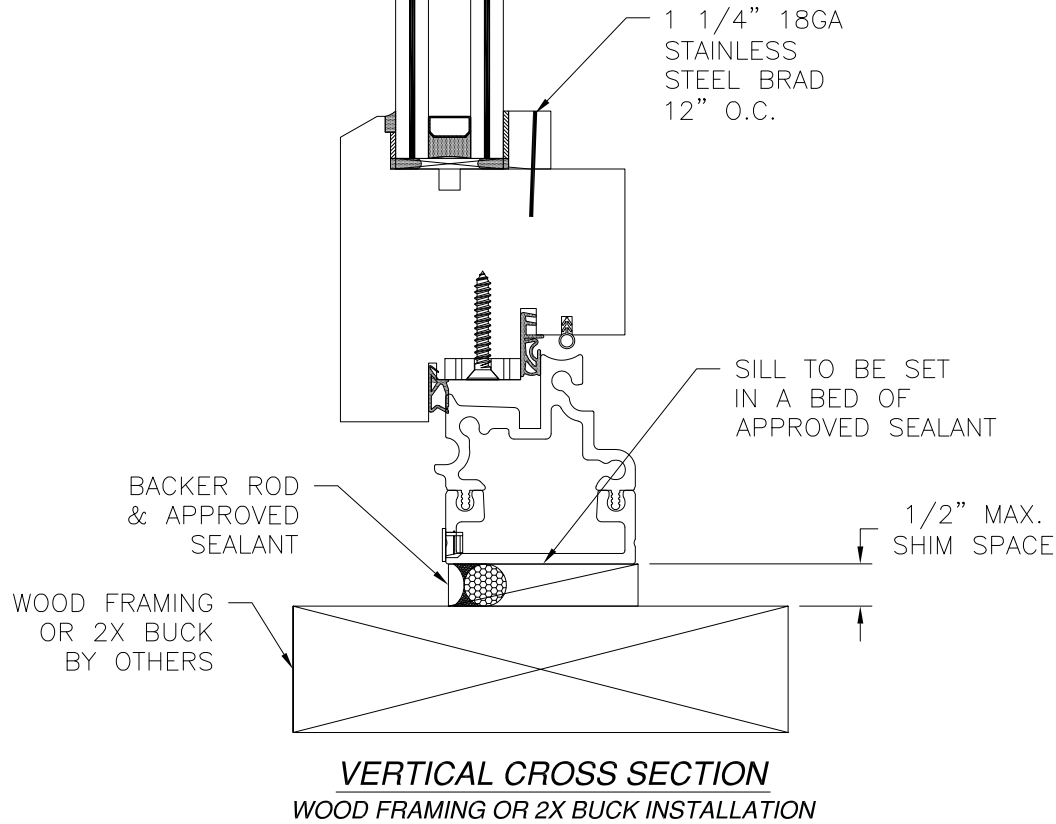

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
INSTALLATION DETAILS W/BRACKET

DRAWN:
R.L.

DWG NO.
08-03985


REV
-

SCALE
NTS

DATE
11/14/23


SHEET
5 OF 11

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

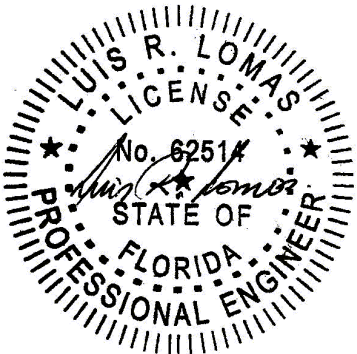

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

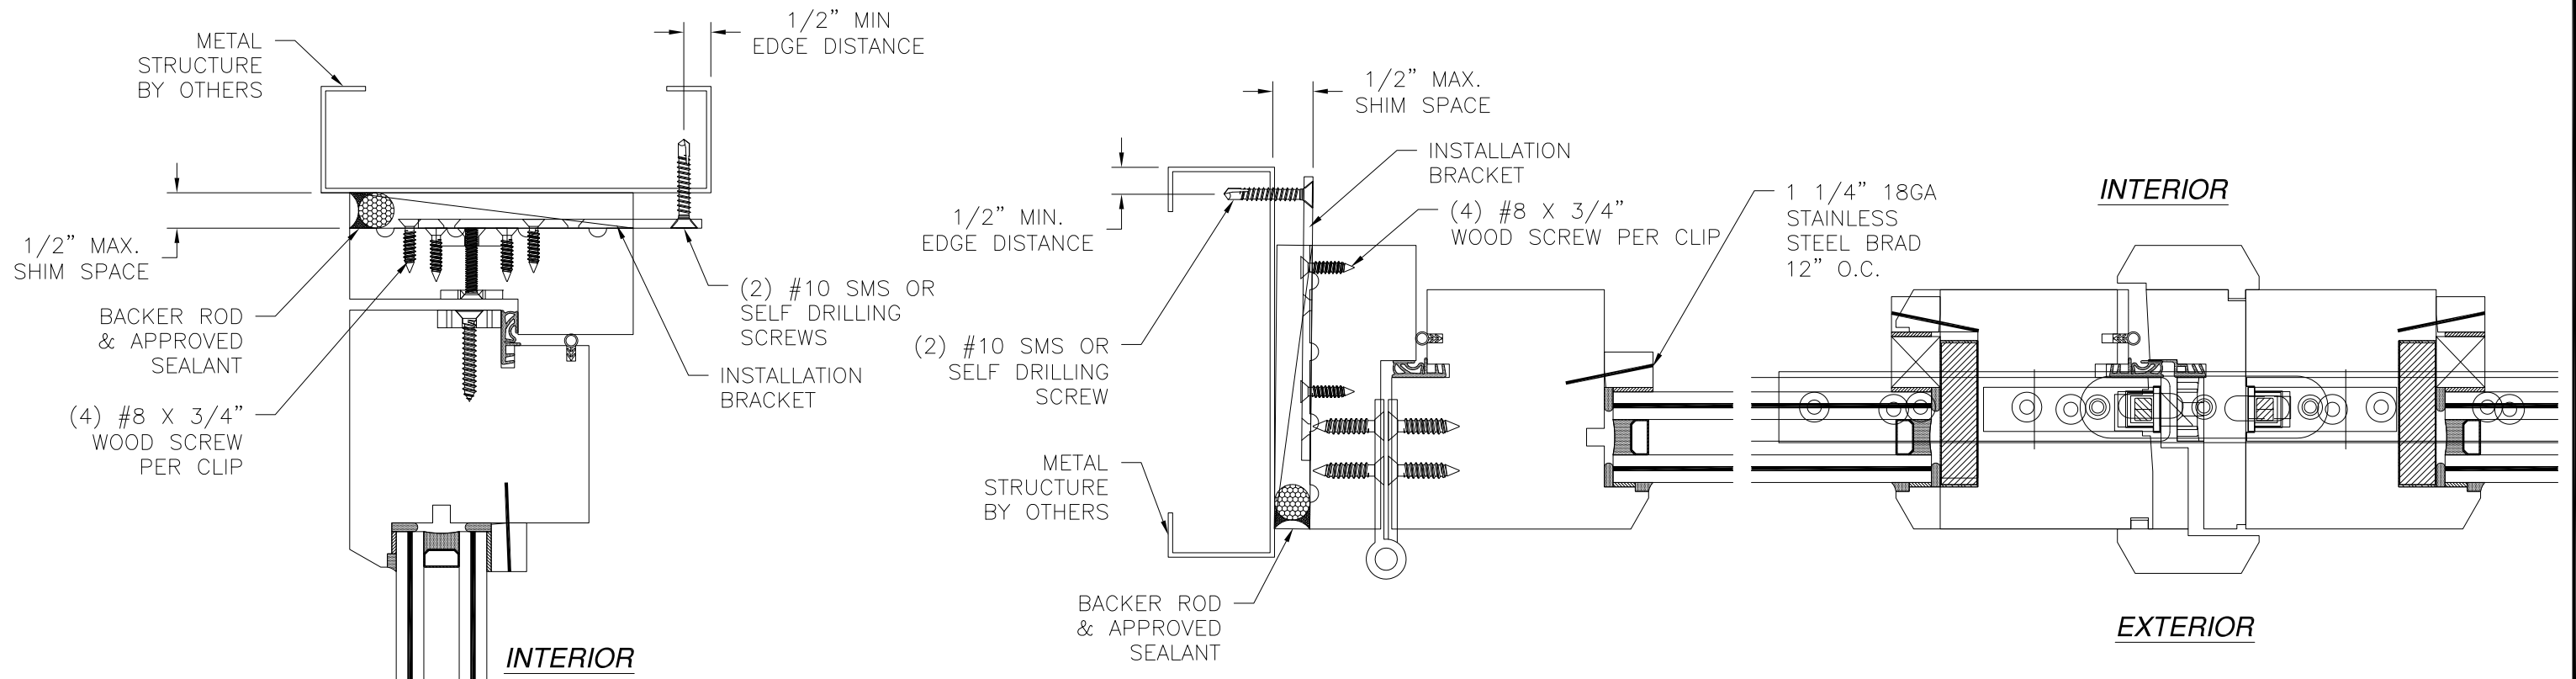

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 11/14/2023

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
INSTALLATION DETAILS W/BRACKET

DRAWN:
R.L.

DWG NO.
08-03985


REV
-

SCALE
NTS


DATE
11/14/23

SHEET
6 OF 11


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

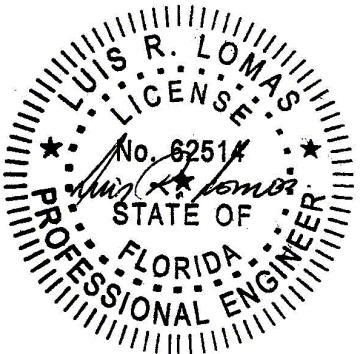

Luis R. Lomas P.E.
FL No.: 62514

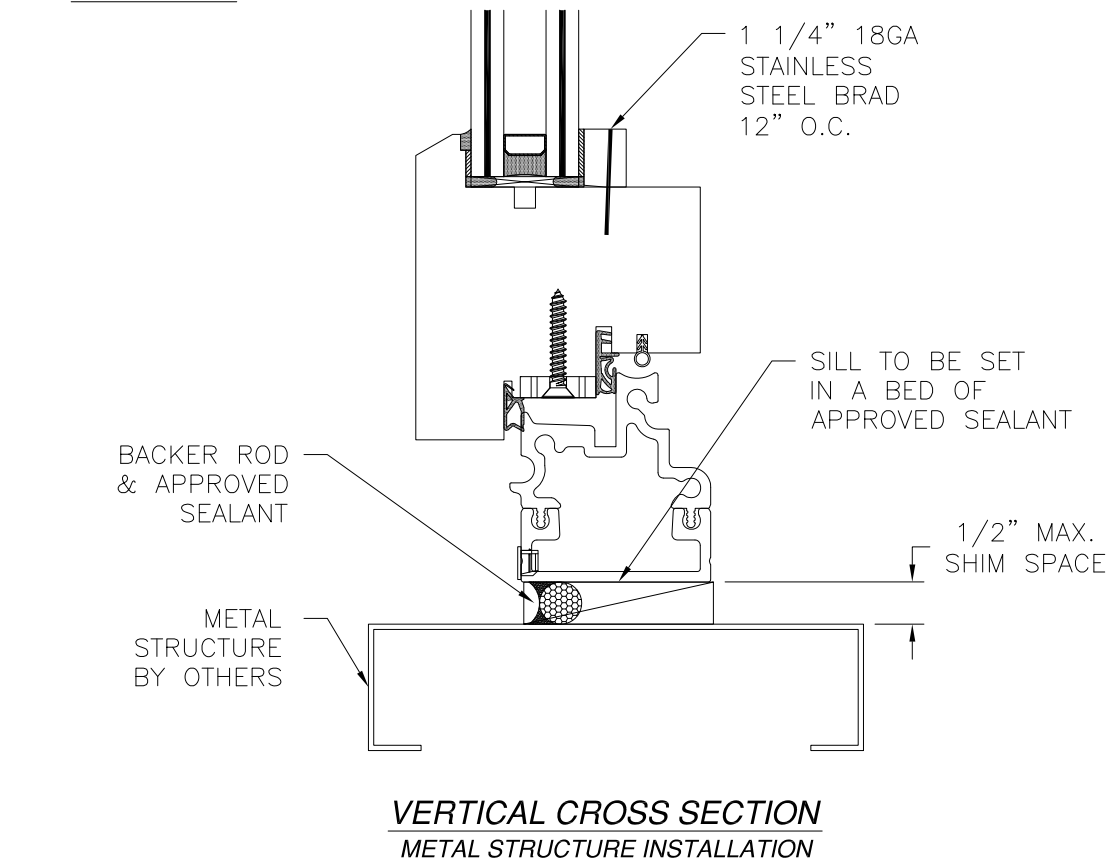

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

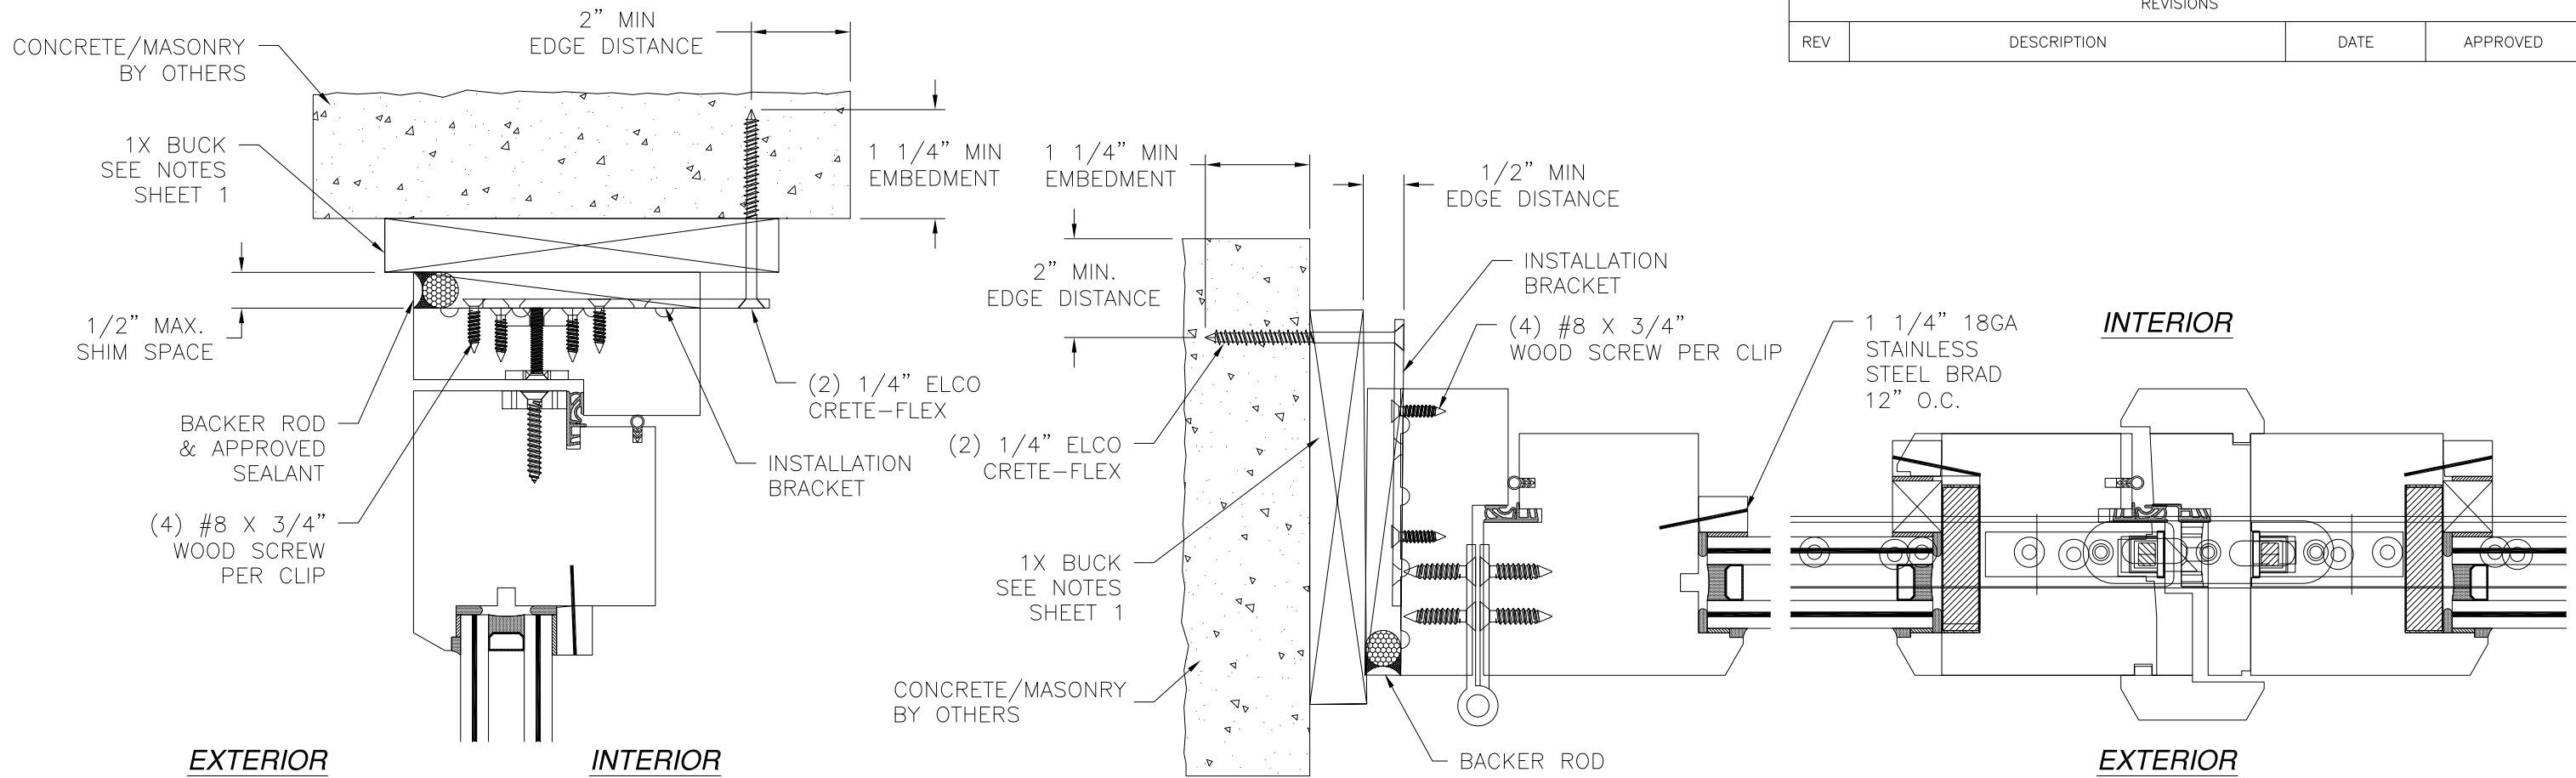

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED


EXTERIOR

INTERIOR

INTERIOR

EXTERIOR

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

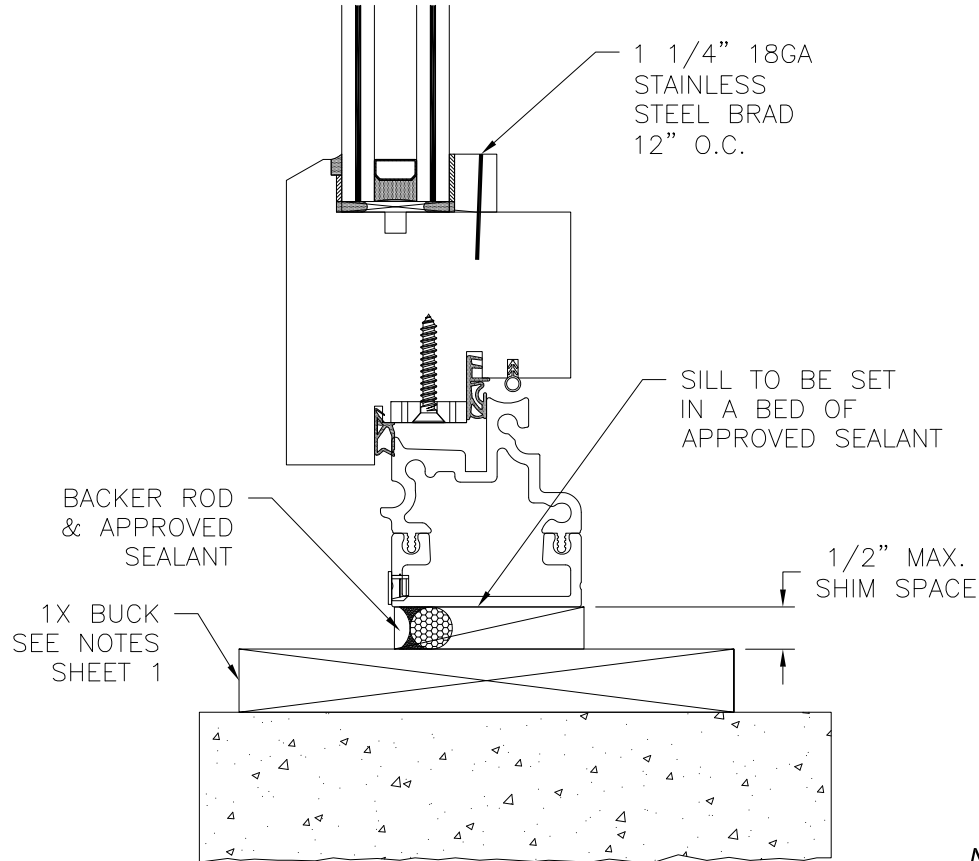

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REILLY WINDOWS & DOORS


901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
INSTALLATION DETAILS W/BRACKET

DRAWN: R.L.	DWG NO. 08-03985	REV -
SCALE NTS	DATE 11/14/23	SHEET 7 OF 11


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

SIGNED: 11/14/2023

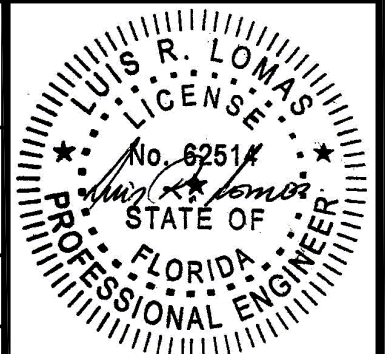

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

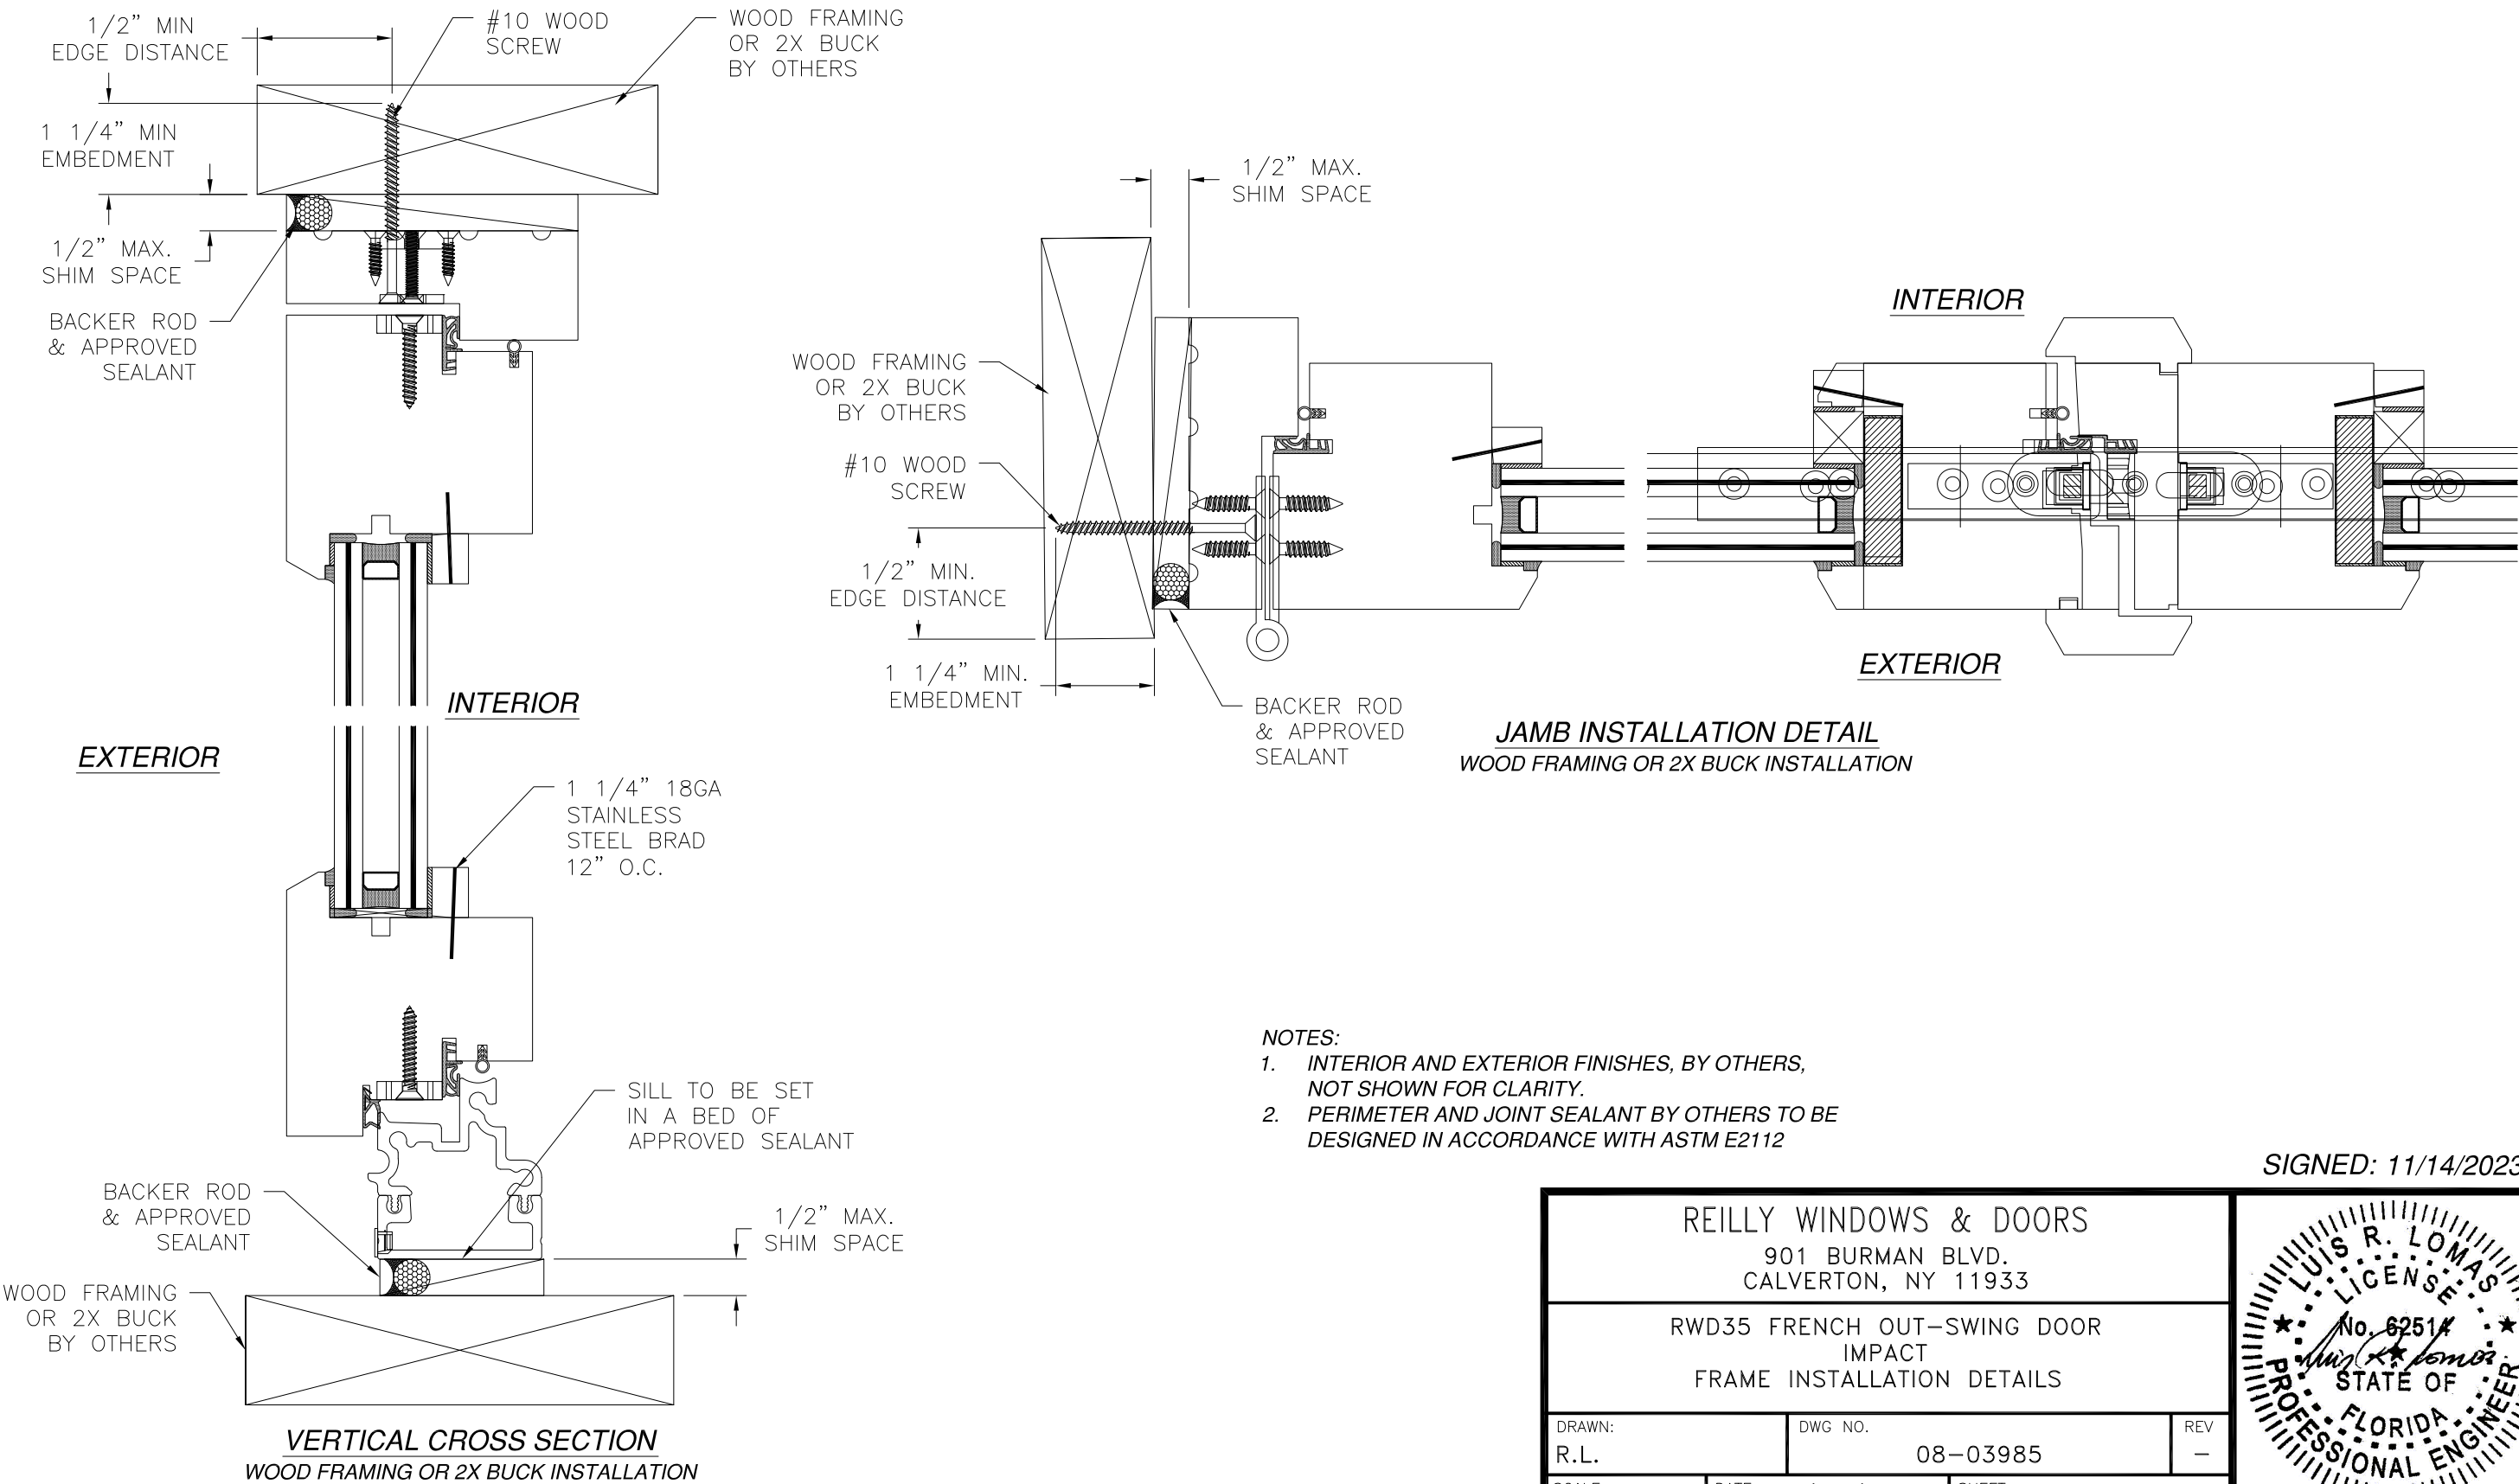

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 11/14/2023

REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
FRAME INSTALLATION DETAILS

DRAWN:
R.L.

DWG NO.
08-03985


REV
-

SCALE
NTS

DATE
11/14/23


SHEET
8 OF 11

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

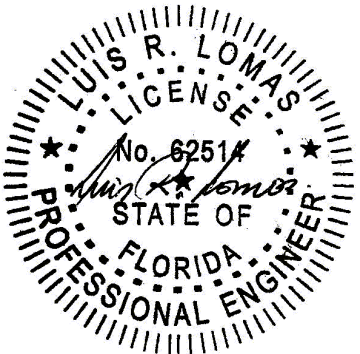

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

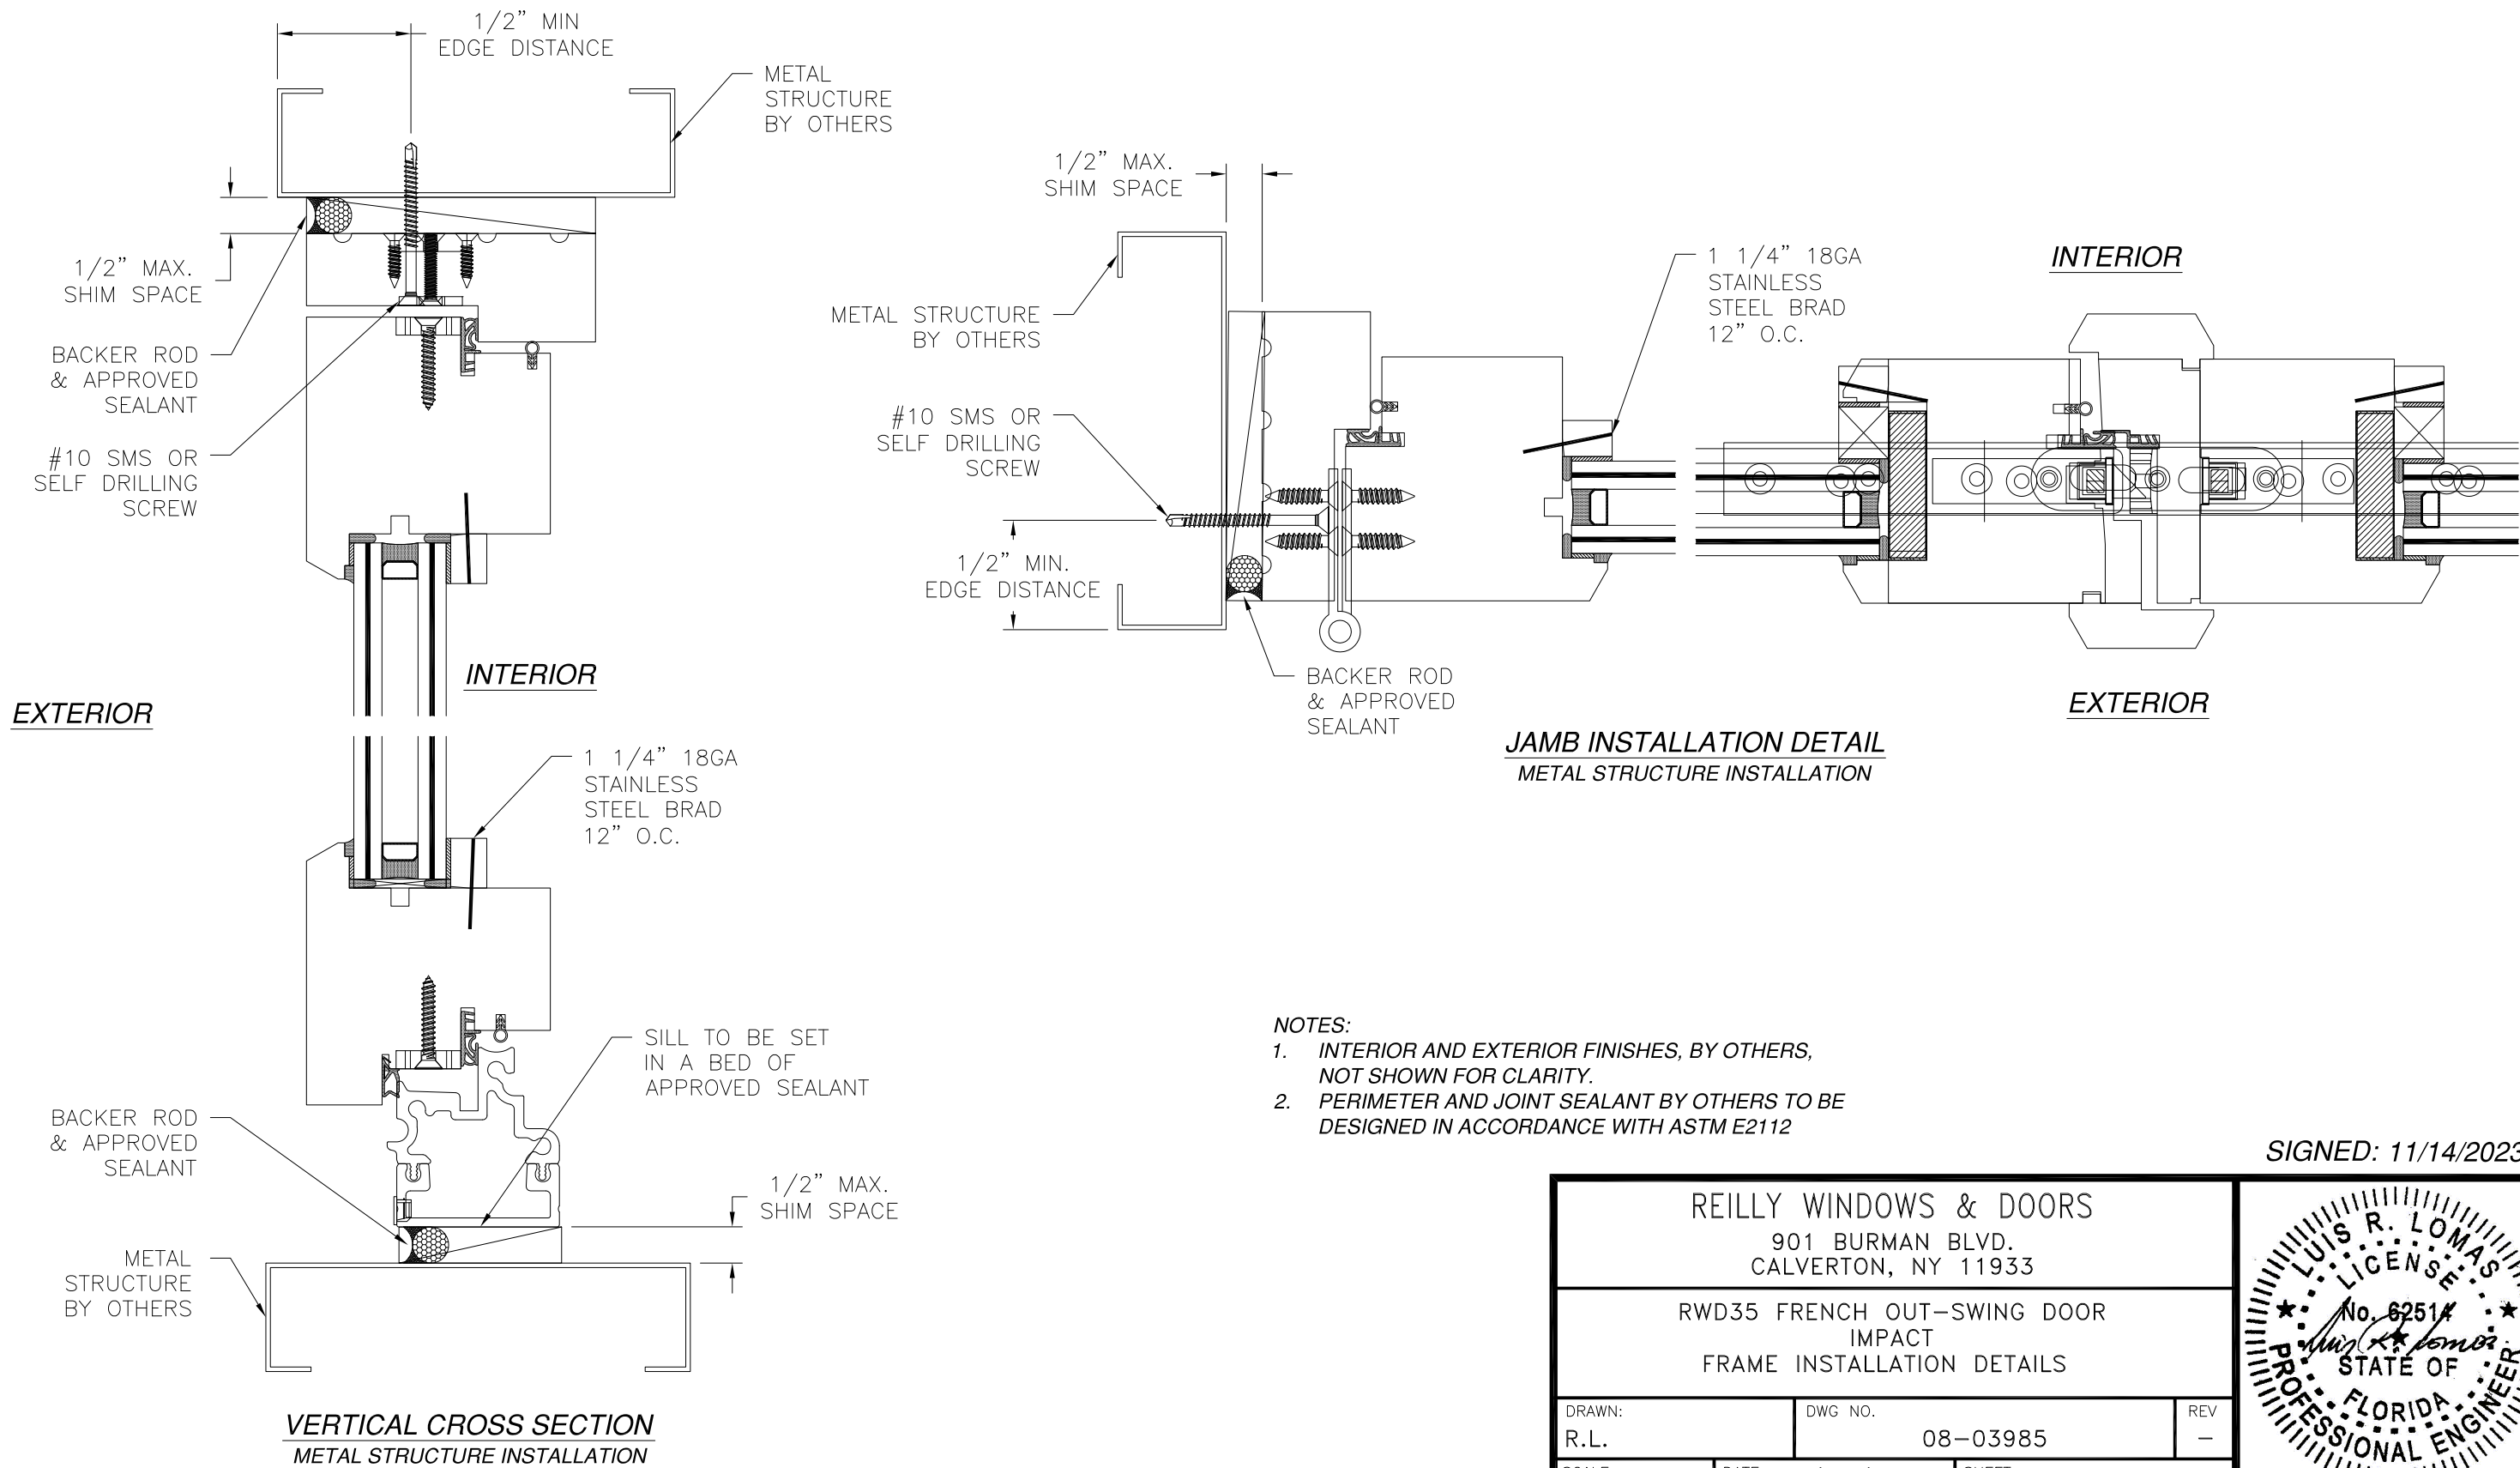

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 11/14/2023

REILLY WINDOWS & DOORS 901 BURMAN BLVD. CALVERTON, NY 11933		
RWD35 FRENCH OUT-SWING DOOR IMPACT FRAME INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-03985	REV -
SCALE NTS	DATE 11/14/23	SHEET 9 OF 11
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

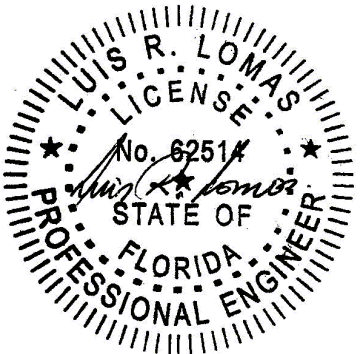

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

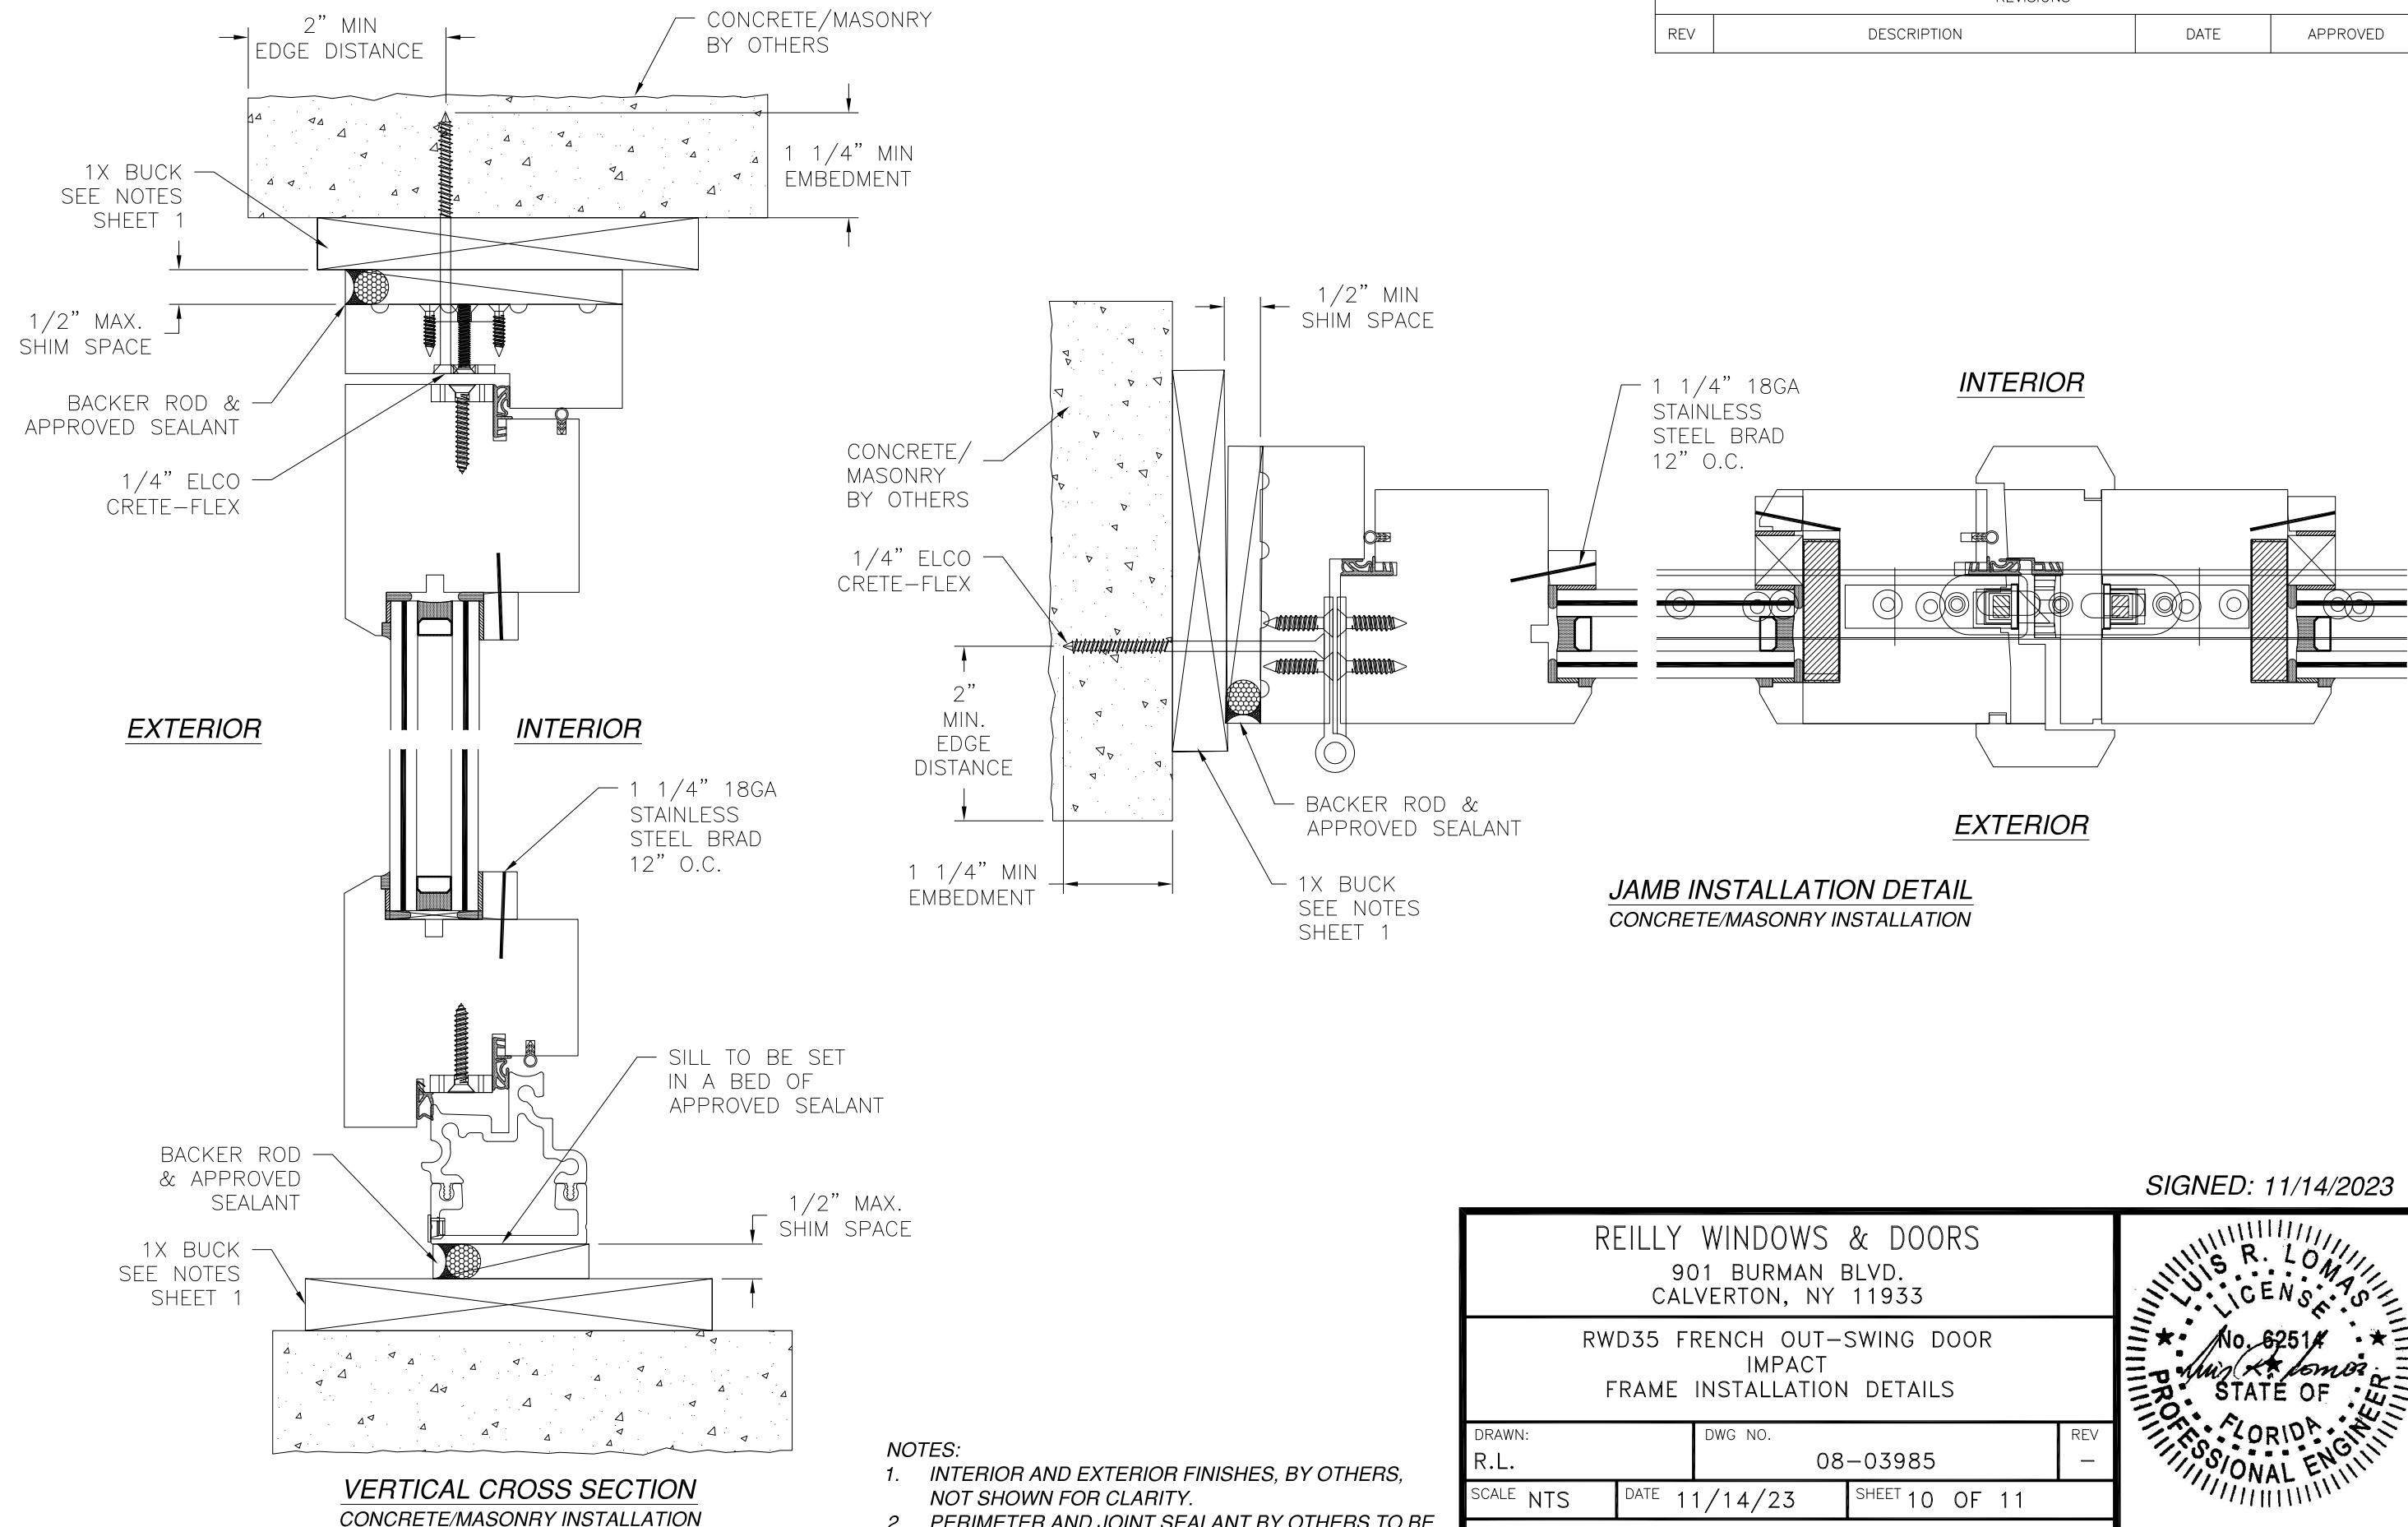


SIGNED: 11/14/2023


REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
FRAME INSTALLATION DETAILS


DRAWN: R.L.	DWG NO. 08-03985	REV -
SCALE NTS	DATE 11/14/23	SHEET 10 OF 11
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

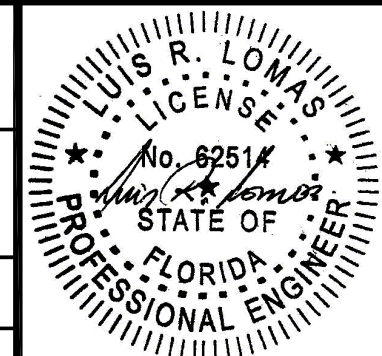


Luis R. Lomas P.E.
FL No.: 62514

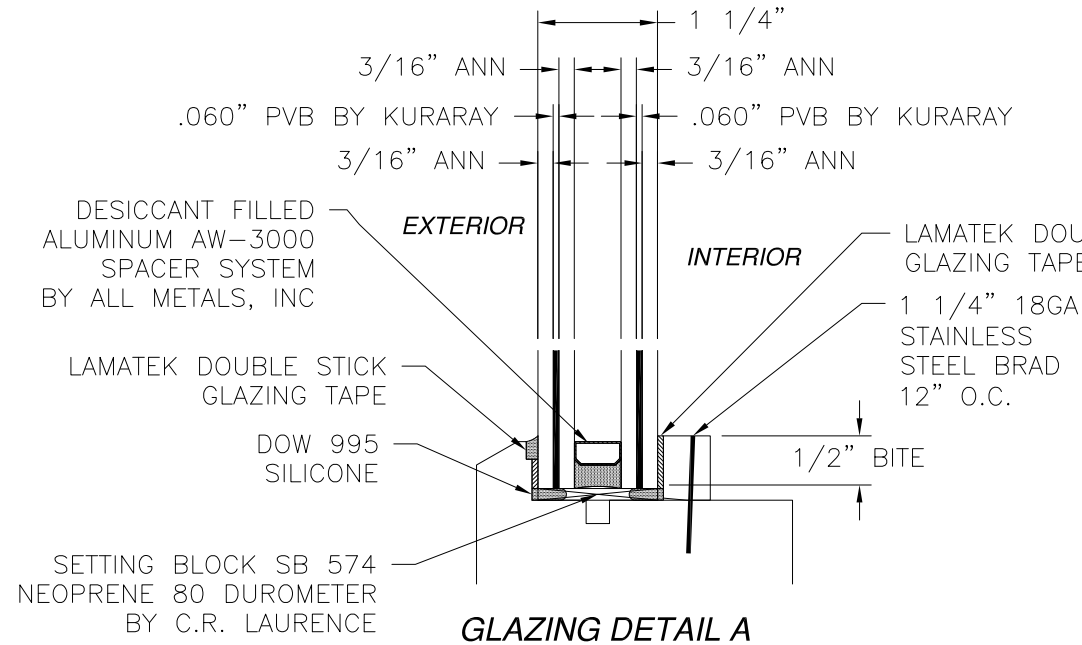


GLAZING DETAIL A

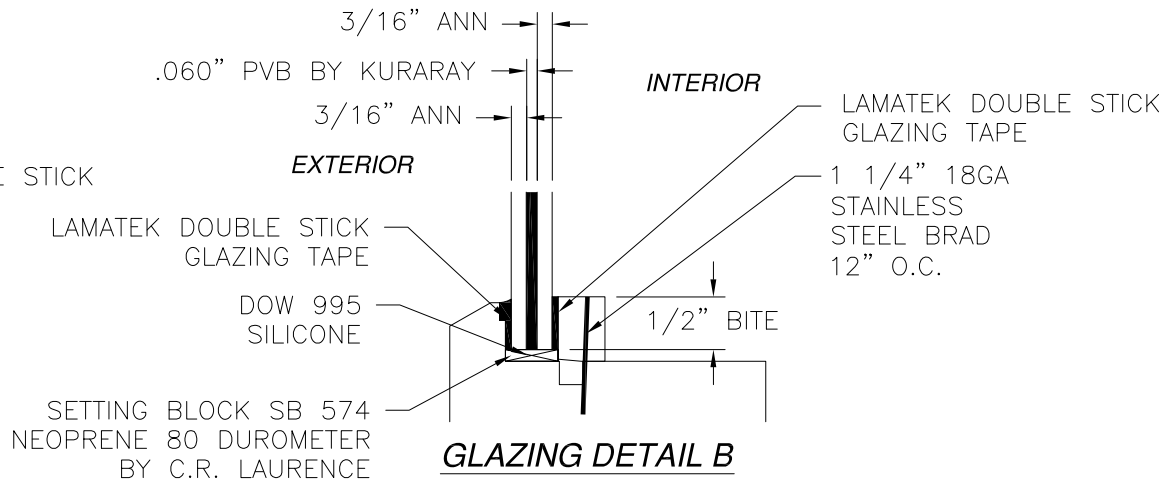


GLAZING DETAIL B

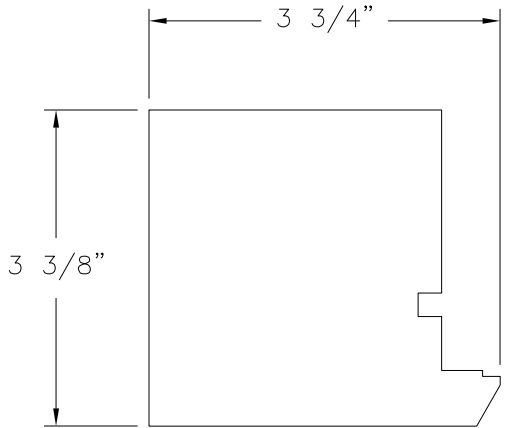


STILE & RAIL (B3.12)
MAHOGANY

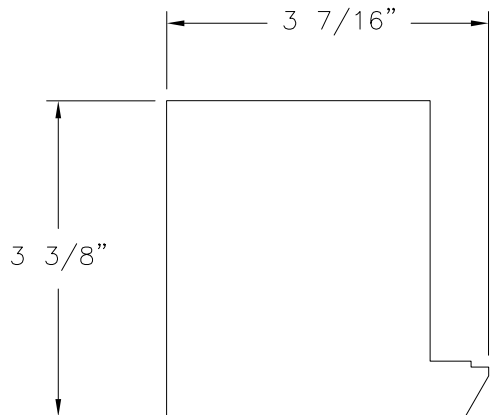


MEETING RAIL - RIGHT (B2.81)
MAHOGANY

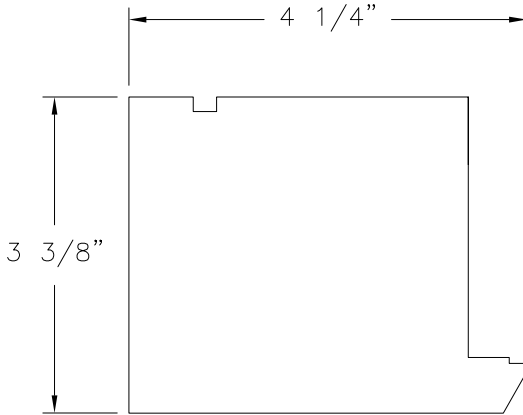


MEETING RAIL - LEFT (B3.62)
MAHOGANY

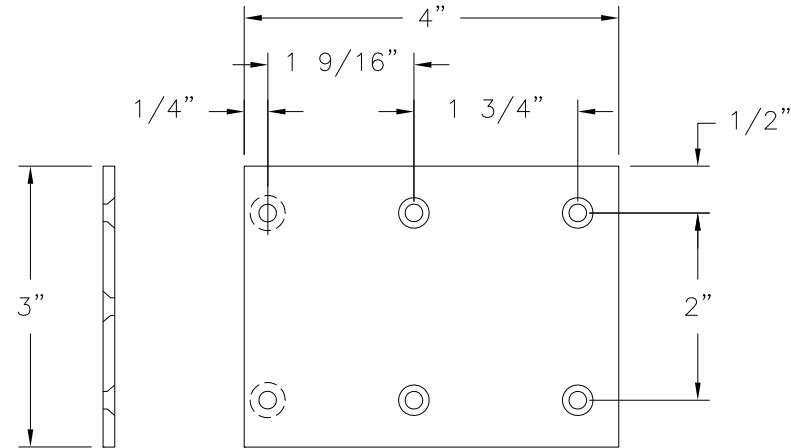


INSTALLATION BRACKET
ALUMINUM 6063-T5 .125 " THICK

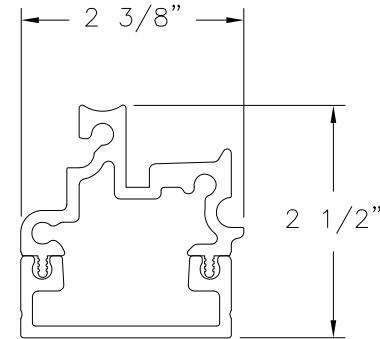


SILL
ALUMINUM 6063-T5 .125 " THICK

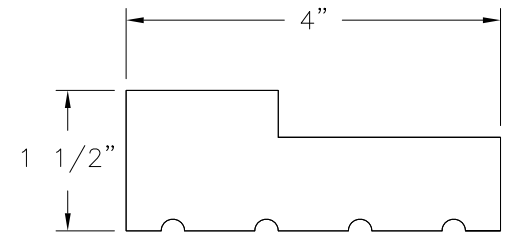


VERTICAL/HORIZONTAL JAMB (J4)
MAHOGANY

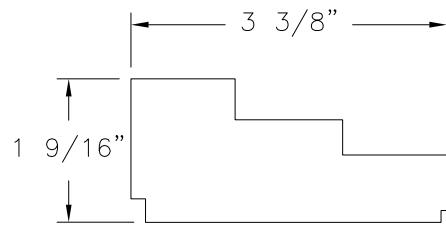


INACTIVE ASTRAGAL (AS3.3)
MAHOGANY




EXTERIOR ASTRAGAL (AS2)
MAHOGANY



INTERIOR ASTRAGAL (AS2A)
MAHOGANY



GLASS STOP (GSA)
MAHOGANY

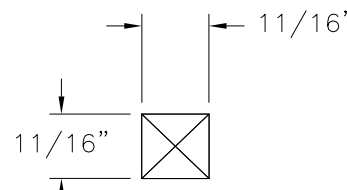

GLASS STOP BLOCK (BL1)
MAHOGANY

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED


REILLY WINDOWS & DOORS
901 BURMAN BLVD.
CALVERTON, NY 11933

RWD35 FRENCH OUT-SWING DOOR
IMPACT
GLAZING DETAIL AND COMPONENTS

DRAWN: R.L.	DWG NO. 08-03985	REV -
SCALE NTS	DATE 11/14/23	SHEET 11 OF 11

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

SIGNED: 11/14/2023

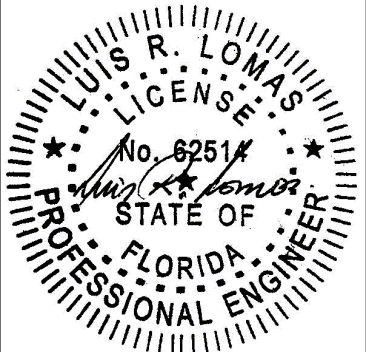

Luis R. Lomas P.E.
FL No.: 62514