

NOTES:

1. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.

2. SLIDE LOCK OR OPERATOR REQUIRED. LOW HEADROOM REQUIRES A LOCK ON THE LEFT AND RIGHT SIDE OF THE DOOR.

3. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

4. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:
EXTERIOR - 27 GA
INTERIOR - 30 GA

5. DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER AND BE SPRUCE-PINE-FIR. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

6. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A LHR TOP BRACKET IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. SEE LHR, DETAIL A, SHEET 2.

7. GLAZING OPTIONS - .125" MINIMUM DSB GLAZING INSTALLED IN TOP SECTION (WITH OR WITHOUT DECORATIVE LITE FRAME DIVIDERS) MEETS UNIFORM STATIC WIND PRESSURES SHOWN ON THIS DRAWING. GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS. MAX CLEAR OPENING TO BE 43-1/4" x 19-1/4".

8. 11 GA ROLLER SLIDES WITH WELDED ENDS AND 11 GA REINFORCING BRACKETS REQUIRED FOR DOORS >8' TALL.

13 GA HORIZ ANGLE

13 GA FLAG ANGLE

5/16x1-5/8"
LAG SCREW
EACH HOLE(4) 1/4-20x9/16"
TRACK BOLTS & NUTS15 GA MIN VERT
TRACK5/16x1-5/8" LAG
SCREW AT EACH
JAMB BRACKET1/4-20x9/16" TRACK
BOLT AND NUT AT EACH
JAMB BRACKETSECURE LOCK STRIKER PLATE
(ONLY REQUIRED WITH SLIDE
LOCK) ATTACHED TO TRACK
WITH (2) 1/4-20x9/16" TRACK
BOLTS AND NUTSSLIDE LOCK BOTH ENDS
(NOT REQUIRED WITH
OPERATOR - SEE NOTE 2)15 GA JB-1 JAMB
BRACKETS. SEE
SCHEDULE FOR
QUANTITY AND
LOCATION.

NOTE: (3) SECTION DOOR SHOWN.
SEE SHEET 2 FOR U-BAR LOCATIONS
ON DOORS WITH OTHER SECTION
QUANTITIES.

JAMB BRACKET SCHEDULE

DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
7'-0"	3	6	2", 10", 26", 42", 53", 63"
8'-0"	4	8	2", 10", 26", 39", 48", 57", 66", 75"
> 8'-0"			SEE NOTE BELOW

NOTE:

ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.


**SUPERIMPOSED DESIGN PRESSURE
LOADS ON SUPPORTING STRUCTURE**

DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
9'-0"	ALL	+140.4/-161.1
8'-0"	ALL	+124.8/-143.2

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

The Genuine. The Original.


Lewisville, TX

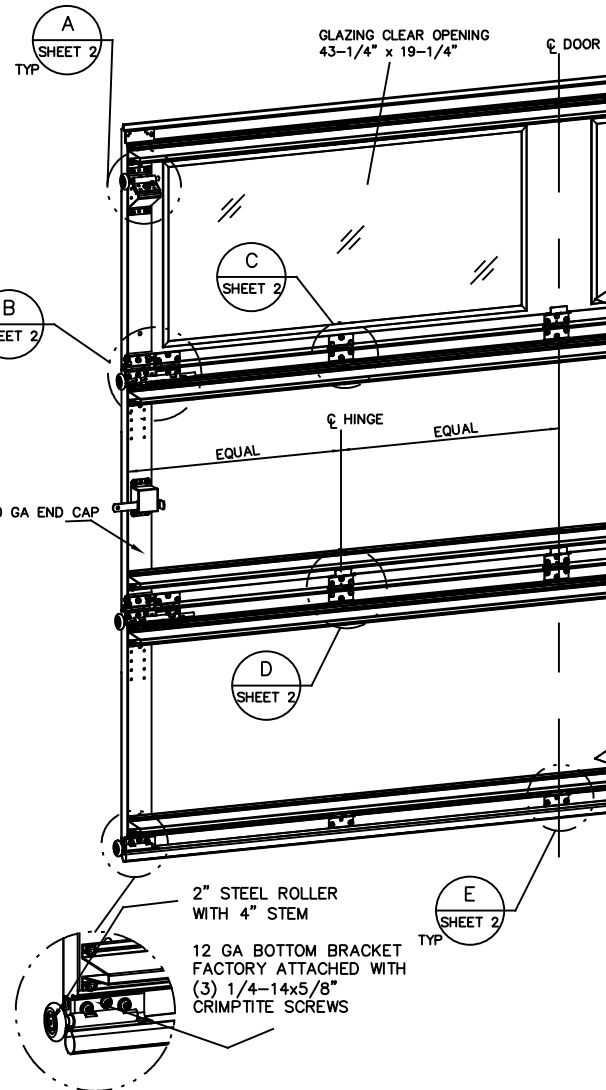**SERIES 300, 5800, 7540**

REVISIONS
POO CREATED NEW
DRAWING FOR
WINDLOAD OPTIONS
8-23-16 GAC

REV A PCR 32177
ADDED ORACLE
MODEL NUMBERS
10-29-19 TLC

REV B PCR 32442
ADDED NYLON BALL
BEARING ROLLER
OPTION
9-24-2020 JQ

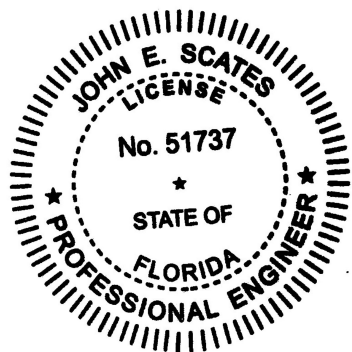

Digitally signed by John E. Scates, P.E.
Date: 2020.09.25 16:11:18 -05'00'

JOHN E. SCATES, PE
2560 King Arthur #124-54
Lewisville, TX 75056
FL PE 51737 TX PE 56308/F-2203

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+31.20/-35.80	MAX WIDTH:	9'-0"	DATE		NAME	
IMPACT/CYCLIC RATED (YES/NO): NO		MAX HEIGHT:	14'-0"	DRAWN	8-23-16	GAC	
		MAX SECTION HEIGHT: 28"	CHECKED	8-23-16	DK		
MODELS 300-309/5800					SHEET 1 OF 2		
WINDLOAD SPECIFICATION					DRAWING PART NO.	REV.	
					411422	B	


LOW HEADROOM TRACK

STANDARD LIFT TRACK

U-BAR LOCATIONS

REVISIONS

2" STEEL ROLLER WITH 4" STEM. OPTIONAL NYLON BALL BEARING ROLLER AVAILABLE.
14GA LHR TOP BRACKET ATTACHED TO DOOR WITH (3) 1/4-20 X 11/16" SELF DRILLING AND (2) #12 X 1/2" PHILLIPS SCREWS



(2) 15 GA HINGE LEAFS ATTACHED WITH (3) 1/4-14x5/8" CRIMPITE SCREWS EACH

14 GA HINGE BASE FACTORY ATTACHED TO DOOR WITH (5) 1/4-14x5/8" CRIMPITE SCREWS

13 GA REINFORCING BRACKET ATTACHED BENEATH HINGE BASE. (EXCEPTION: NOTE #8)

2" STEEL ROLLER WITH 9" STEM. OPTIONAL NYLON BALL BEARING ROLLER AVAILABLE.

13 GA ROLLER CARRIERS FACTORY ATTACHED TO HINGE BASE AND REINFORCING BRACKET. (EXCEPTION: NOTE #8)

BEFORE U-BAR INSTALLATION

DETAIL A

DETAIL B


15 GA HINGE ATTACHED WITH (6) 1/4-14x5/8" CRIMPITE SCREWS

BEFORE U-BAR INSTALLATION

AFTER U-BAR INSTALLATION

DETAIL C

15 GA HINGE ATTACHED WITH (6) 1/4-14x5/8" CRIMPITE SCREWS



BEFORE U-BAR INSTALLATION

POSITION U-BAR ADJACENT TO HINGE LEAF AND ATTACH WITH (2) 1/4-14x5/8" CRIMPITE SCREWS AS SHOWN



AFTER U-BAR INSTALLATION

DETAIL D

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.


2" STEEL ROLLER WITH 4" STEM. OPTIONAL NYLON BALL BEARING ROLLER AVAILABLE.
13 GA COMMERCIAL 'A' FRAME TOP BRACKET ATTACHED WITH (4) 1/4-20x7/8" SELF DRILLING SCREWS



13 GA ROLLER SLIDE ATTACHED TO BRACKET WITH 5/16-18 BOLT & NUT IN CENTER SLOT AND 1/4-20x9/16" TRACK BOLT & NUT THROUGH ANY TWO ALIGNING HOLES

POSITION U-BAR AND ATTACH WITH (3) 1/4-20x7/8" SELF DRILLING SCREWS AS SHOWN

15 GA HINGE BRACKET ATTACHED WITH (2) 1/4-20x7/8" SELF DRILLING SCREWS



BEFORE U-BAR INSTALLATION





AFTER U-BAR INSTALLATION

DETAIL E

UNLESS NOTED OTHERWISE, ALL U-BARS SHALL BE ATTACHED WITH A MINIMUM OF (2) FASTENERS AT EACH END AND AT ALL INTERMEDIATE HINGE LOCATIONS (OR IN LINE WITH INTERMEDIATE HINGE LOCATIONS IF U-BAR IS NOT LOCATED AT A HINGE). ALL FASTENERS USED TO ATTACH U-BARS SHALL BE 1/4-14x5/8" CRIMPITE SCREWS EXCEPT 1/4-20x7/8" SELF DRILLING SCREWS SHALL BE USED AT END CAPS AND WHERE FASTENING THROUGH HINGE LEAFS OR BRACKETS.

POSITION U-BAR OVER HINGE LEAF AND ATTACH WITH (1) 1/4-14x5/8" CRIMPITE SCREW AND (1) 1/4-20x7/8" SELF DRILLING SCREW AS SHOWN (SELF DRILLING SCREW ATTACHES THROUGH HINGE LEAF)

NOTE: U-BARS SHOULD BE INSTALLED LEVEL ACROSS DOOR AND MAINTAIN A MINIMUM CENTERLINE SPACING OF 6-5/8" BETWEEN U-BARS ON ADJACENT SECTIONS



(6) SECTION DOORS WITH (11) 3" 20 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(5) SECTION DOORS WITH (9) 3" 20 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(4) SECTION DOORS WITH (7) 3" 20 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)


(3) SECTION DOORS WITH (5) 3" 20 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

(7) SECTION DOORS WITH (13) 3" 20 GA 80 KSI U-BARS LOCATED AS SHOWN (TOP BRACKET REMOVED FOR CLARITY)

P00 CREATED NEW DRAWING FOR WINDLOAD OPTIONS 8-23-16 GAC

REV A PCR 32177 ADDED ORACLE MODEL NUMBERS 10-29-19 TLC

REV B PCR 32442 ADDED NYLON BALL BEARING ROLLER OPTION 9-24-2020 JQ

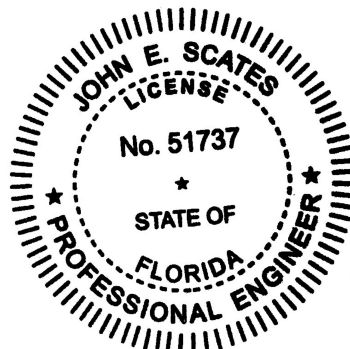

JOHN E. SCATES, PE
2560 King Arthur #124-54
Lewisville, TX 75056
FL PE 51737 TX PE 56308/F-2203

The Genuine. The Original.



Lewisville, TX

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF):	+31.20/-35.80	MAX WIDTH:	9'-0"	DATE	NAME		
IMPACT/CYCLIC RATED (YES/NO):	NO	MAX HEIGHT:	14'-0"	8-23-16	GAC		
		MAX SECTION HEIGHT: 28'	CHECKED	8-23-16	DK		
MODELS 300-309/5800					SHEET 2 OF 2		
WINDLOAD SPECIFICATION					DRAWING PART NO.	REV.	
					411422	B	