


WOOD EDGE
OPAQUE STEEL DOUBLE DOOR
w/ or w/out SIDELITES
INSWING/OUTSWING
"NON-IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details "Profiles"
3	Door Panel Details "Traditions"
4	Sidelite Panel and Glazing Details
5	Elevations
6	Horizontal & Vertical Cross Sections (2X Buck)
7	Horizontal & Vertical Cross Sections (1X Buck)
8	Horizontal & Vertical Cross Sections (Direct to Masonry)
9	Vertical Cross Sections (Thresholds)
10	Buck Anchoring
11	Frame Anchoring
12	Hardware Details
13	Components
14	Bill of Materials

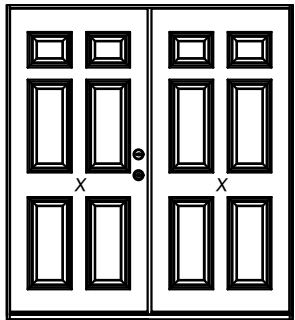


XX

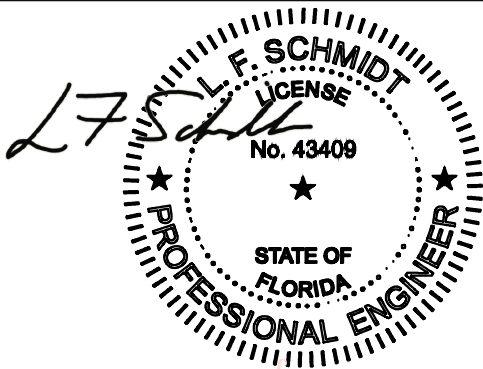

Digitally signed by Lyndon F Schmidt
Date: 2026.08.06 08:32:18 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

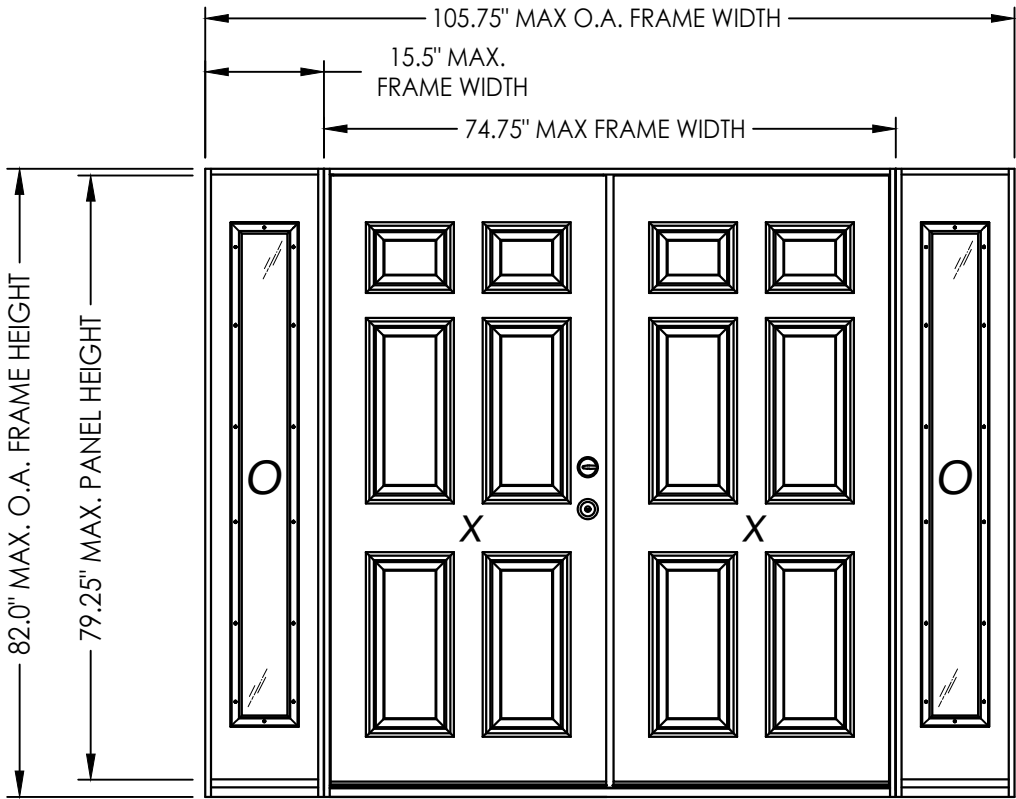

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX, OXXO	+50.0	-55.0	+50.0	-50.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

37/03/26UPDATE TO 9TH ED. (2026) FBC LFS

28/07/23UPDATE TO 8TH ED. (2023) FBC LFS

17/14/20UPDATE TO 7TH ED (2020) FBC LFS

NO. DATE REVISIONS BY

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS



DRAWING NO.:
FL-21131.3

SHEET 1 OF 14

R.W. BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

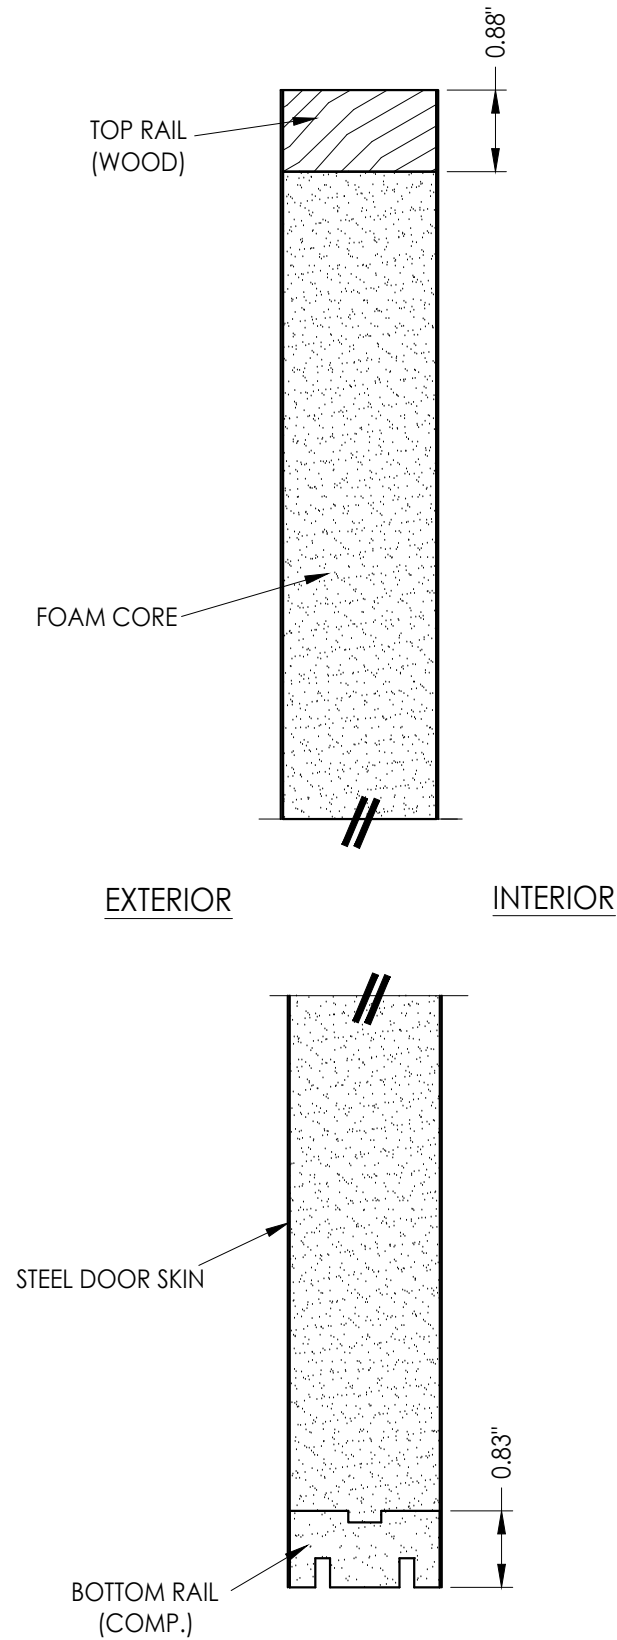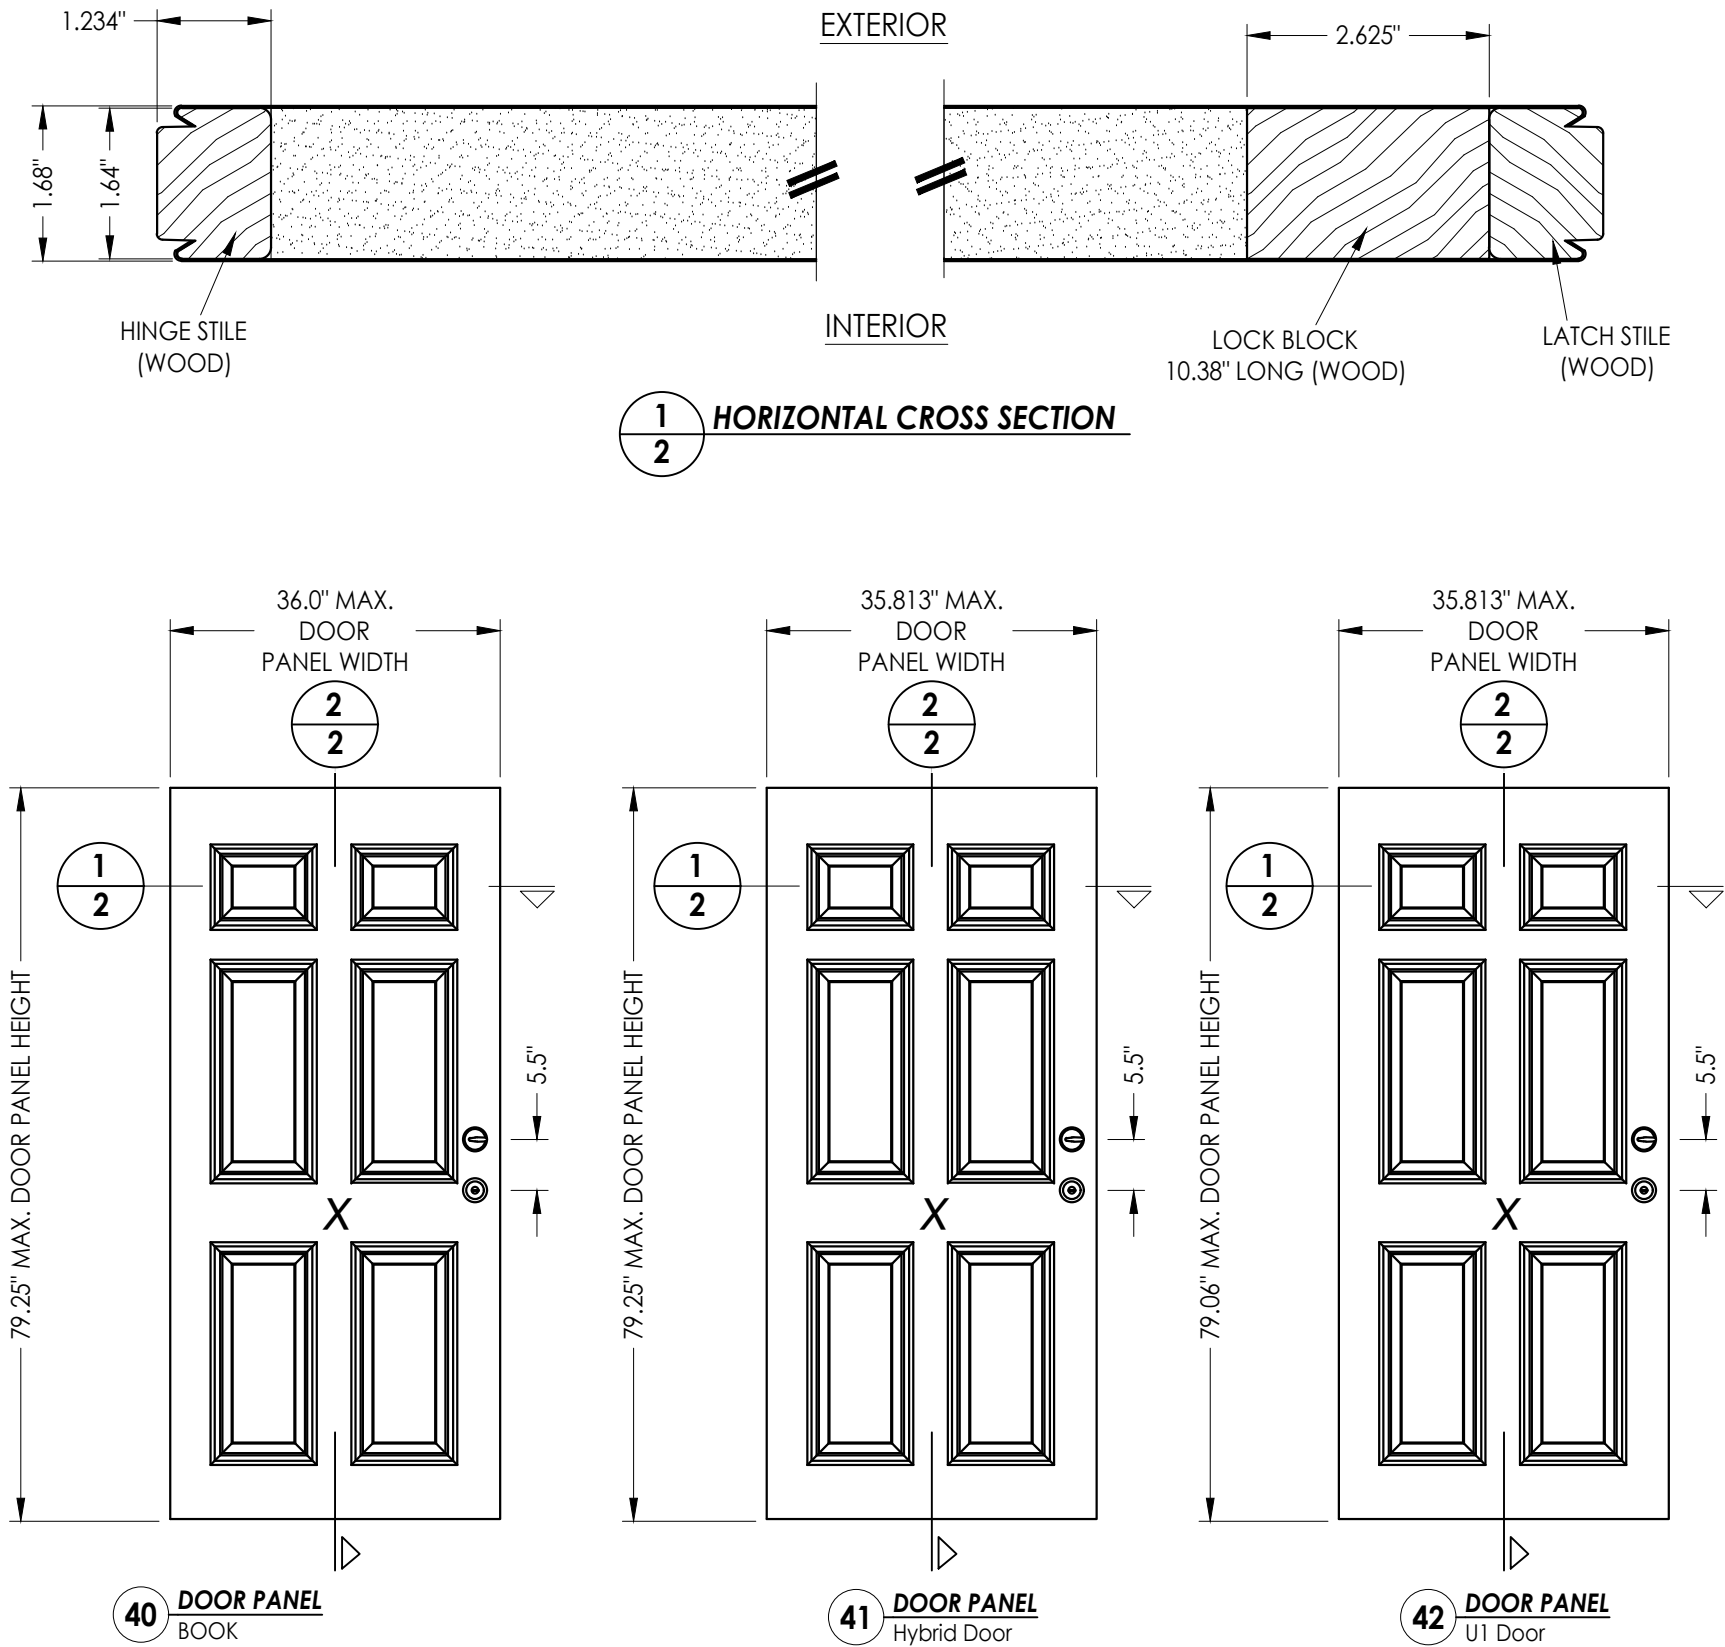

"PROFILES" SERIES DOOR PANEL


STEEL DOOR SKIN: 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409
RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: THERMA-TRU
STEEL DOOR
PART OR ASSEMBLY: "PROFILES"
DOOR PANEL DETAILS

NO.	DATE	REVISIONS		
		DATE	BY	
3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/14/20	UPDATE TO 7TH ED (2020)	FBC	LFS

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21131.3
SHEET 2 OF 14

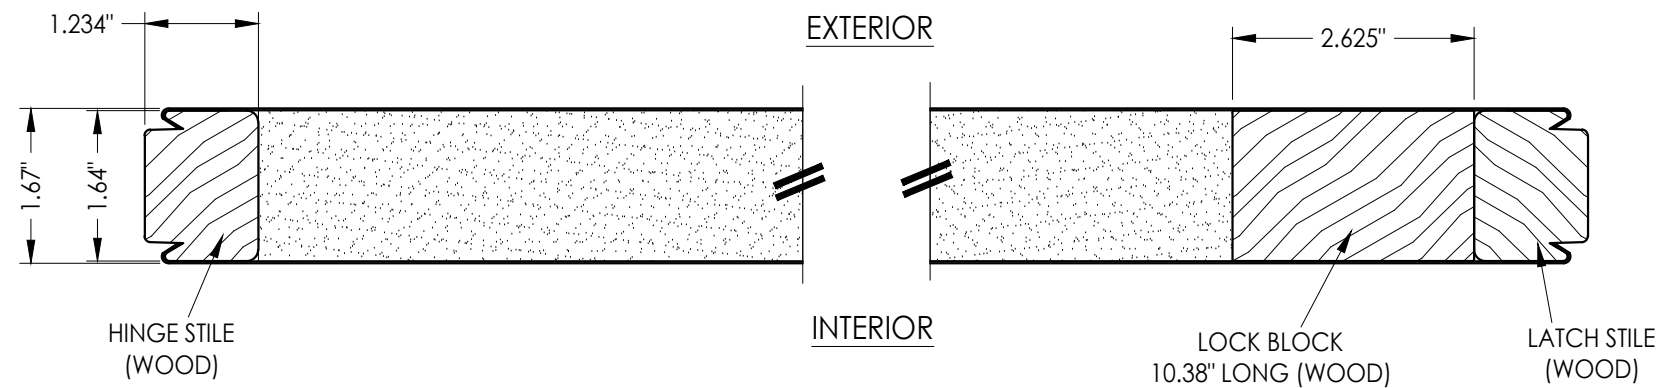


1 **HORIZONTAL CROSS SECTION**
3

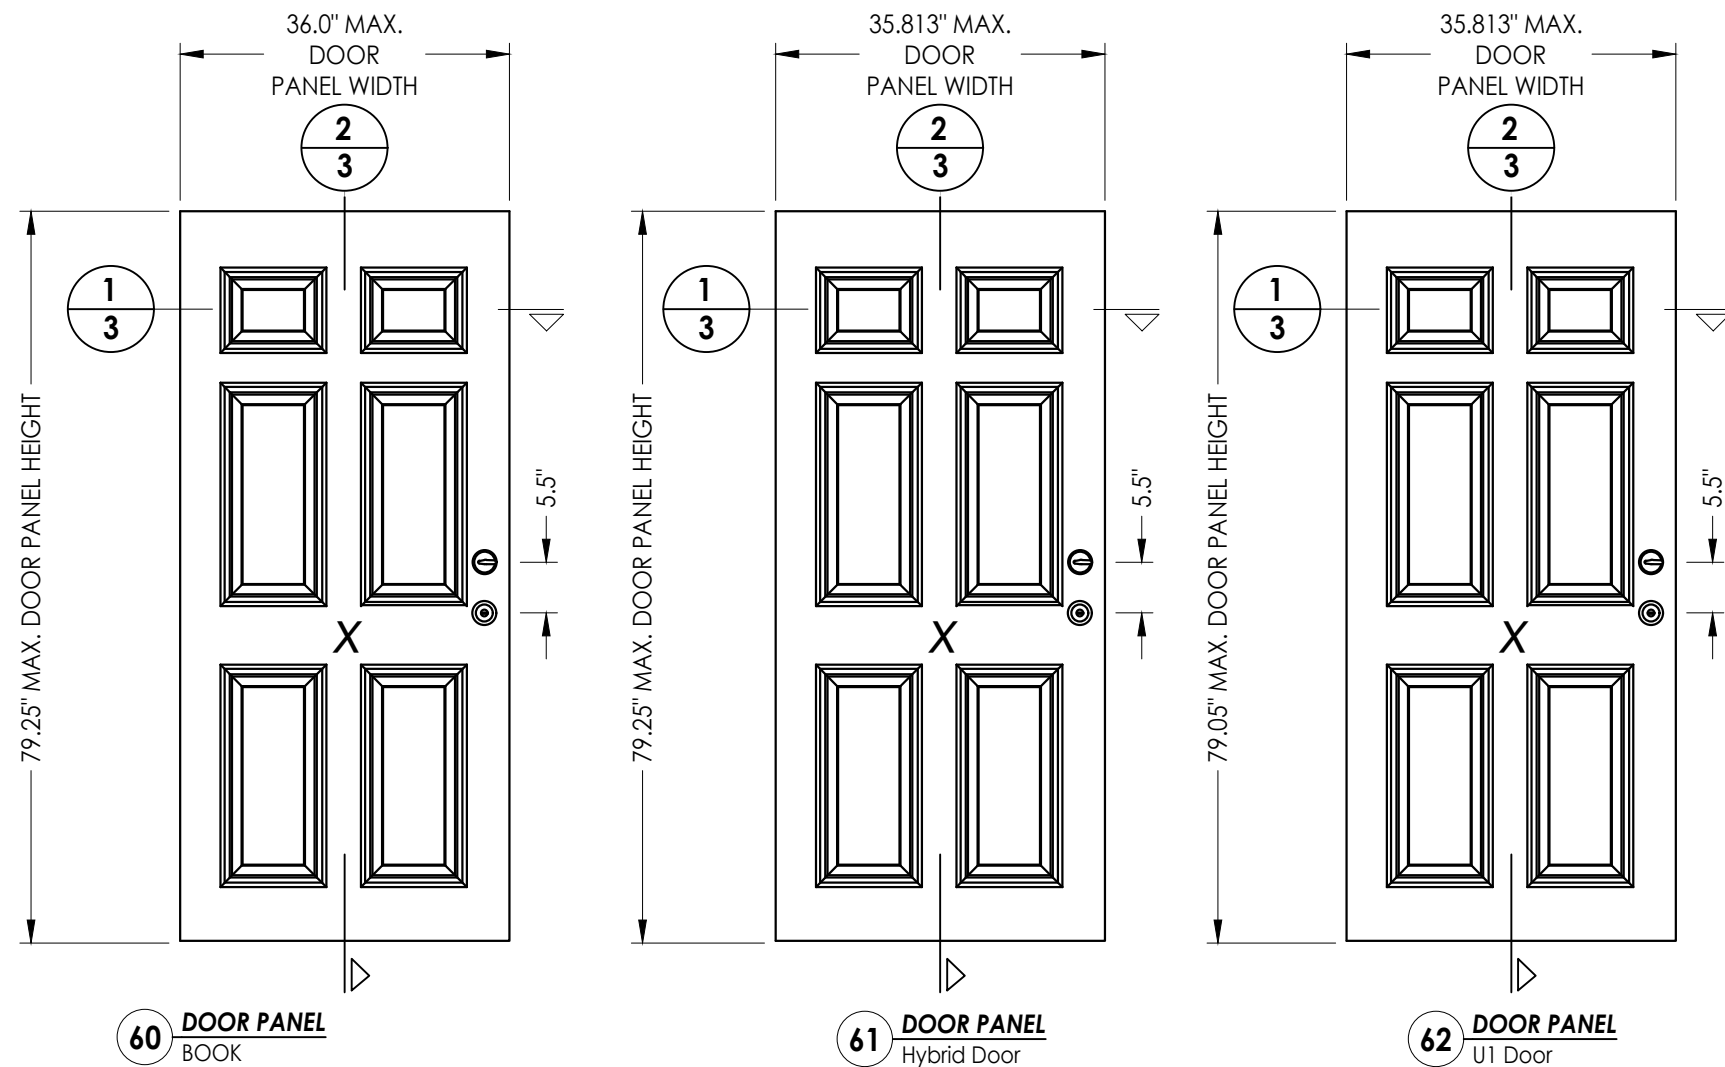

"TRADITIONS" SERIES DOOR PANEL

STEEL DOOR SKIN: 25 GA. (0.018" MIN. THICKNESS, $F_y = 27,830$ PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

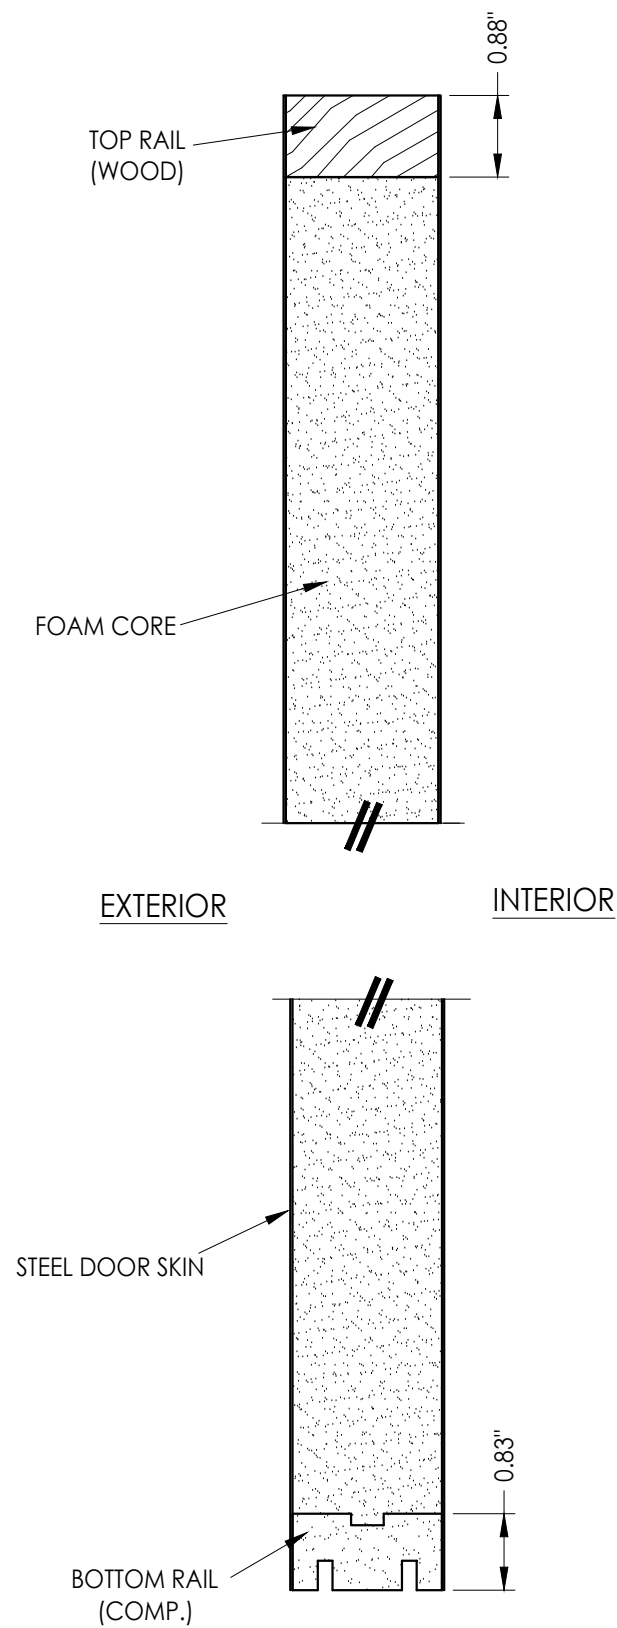

2 VERTICAL CROSS SECTION

3	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
2	8/07/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
1	7/14/20	UPDATE TO 7TH ED	(2020)	FBC	LFS
NO.	DATE				BY
					REVISIONS

DATE: 10/12/17

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21131.3

SHEET 3 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^qW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT:

THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

**"TRADITIONS"
DOOR PANEL DETAILS**

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

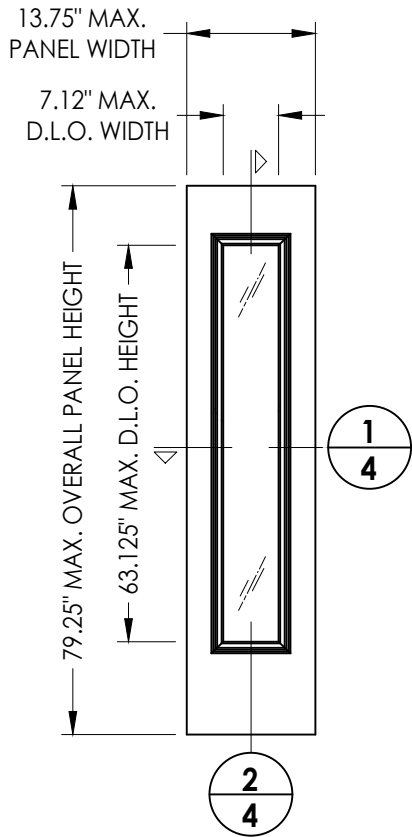

NOTE:

1. Spacing for item #11 & #12 (lite frame screws) is as follows: From the top down on sides; 3", 14.75", 26.5", 38.25", 50.5" & 62.25". There are (2) screws both top and bottom at 4.25" in from each corner.


SIDELITE PANEL

STEEL SKIN "PROFILES": 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)




STEEL SKIN "TRADITIONS": 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)

FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

SIDELITE WOOD COMPONENTS: PINE (SG >= 0.42)

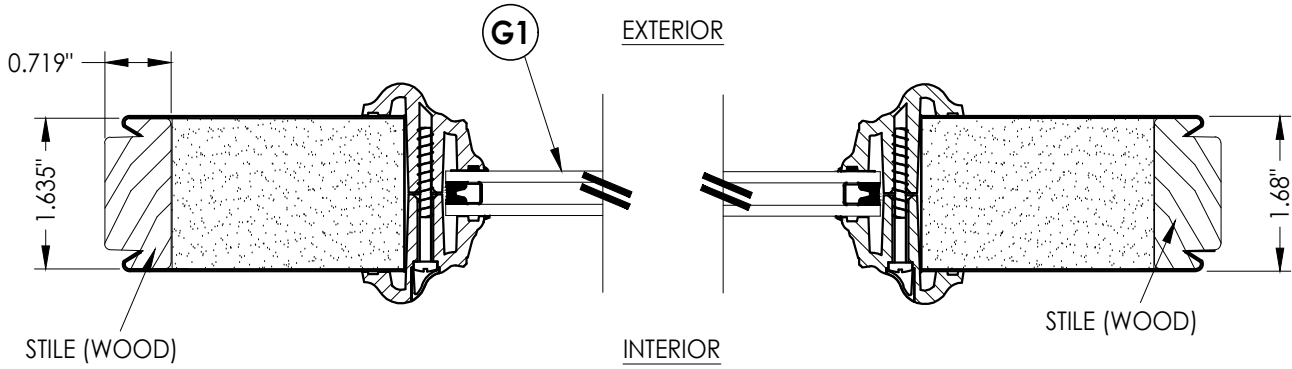

**1
4** HORIZONTAL CROSS SECTION

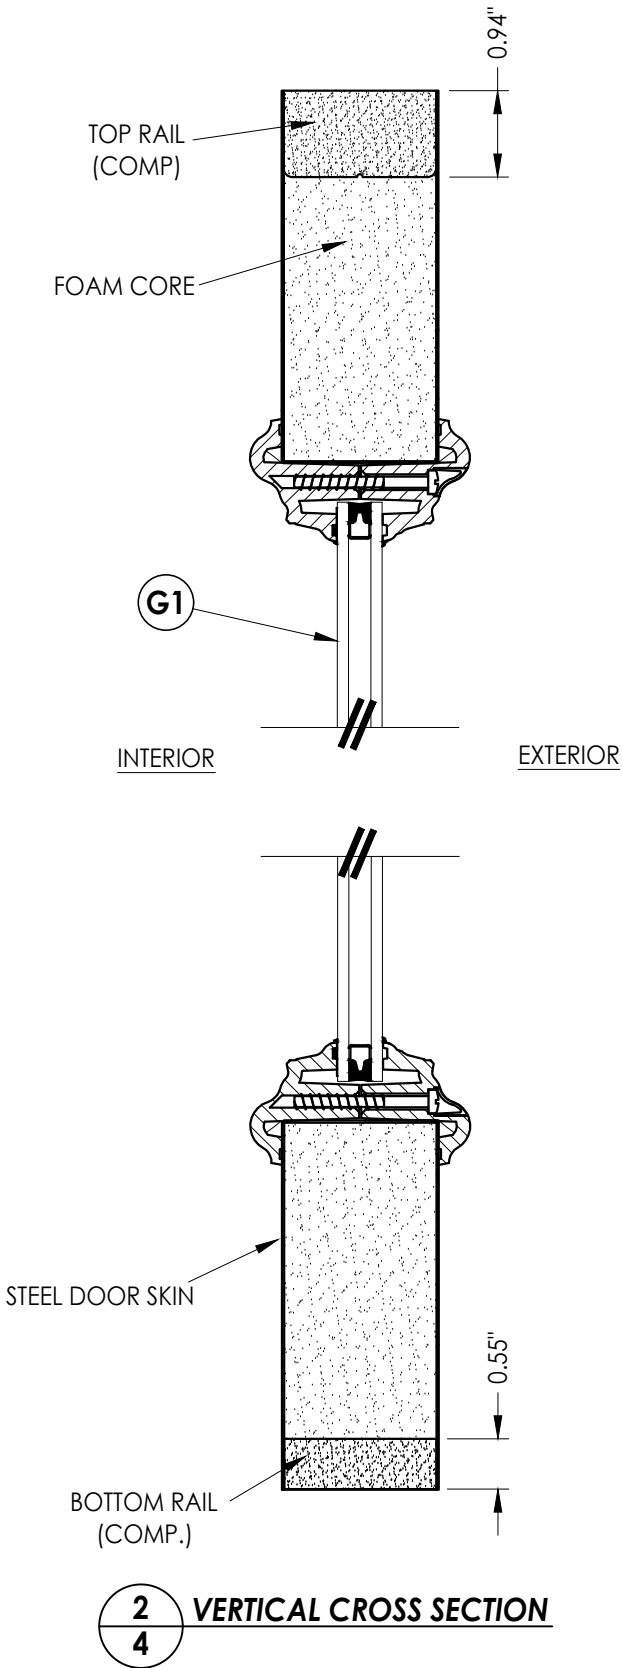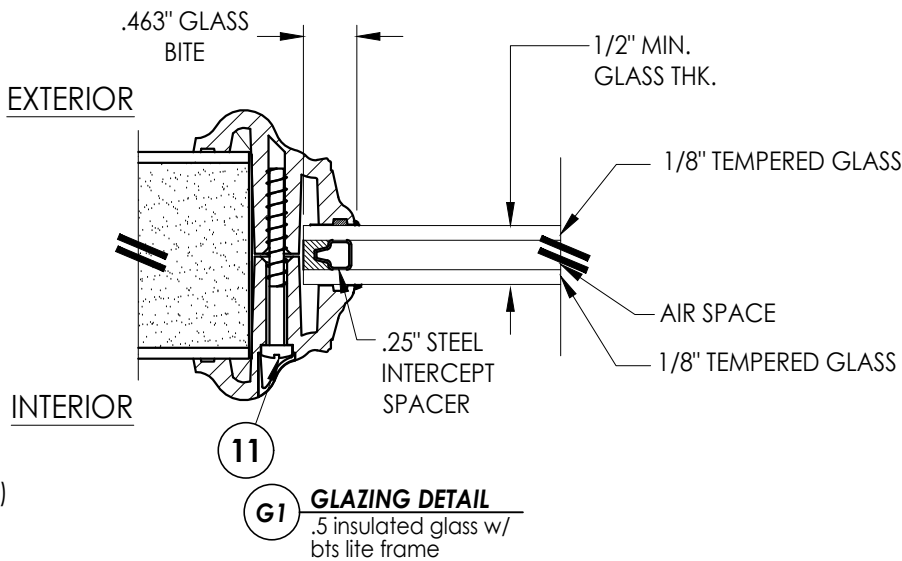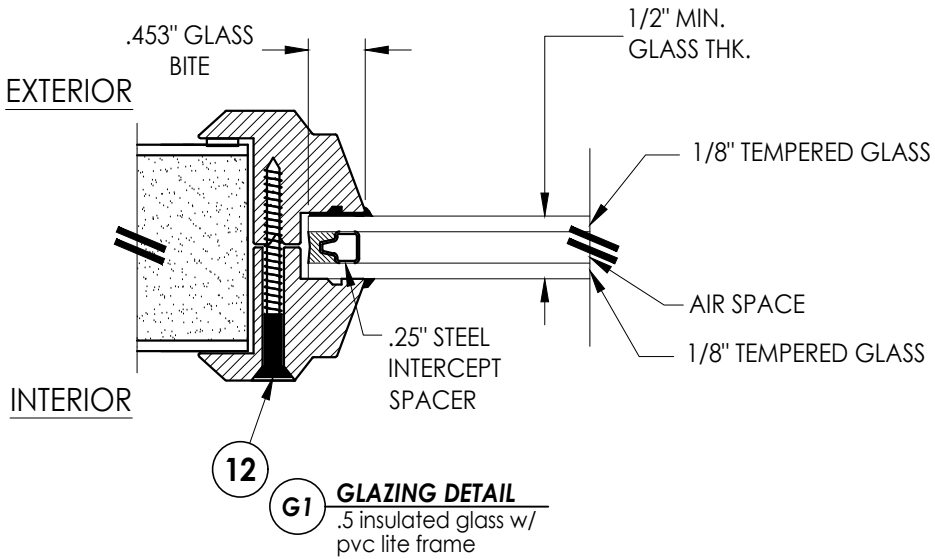

**2
4** VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
SIDELITE PANEL / GLAZING
DETAILS

REVISIONS			
NO.	DATE	BY	
3	7/03/26	LFS	UPDATE TO 9TH ED. (2026) FBC
2	8/07/23	LFS	UPDATE TO 8TH ED. (2023) FBC
1	7/14/20	LFS	UPDATE TO 7TH ED (2020) FBC

DATE: 10/12/17


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-21131.3

SHEET 4 OF 14

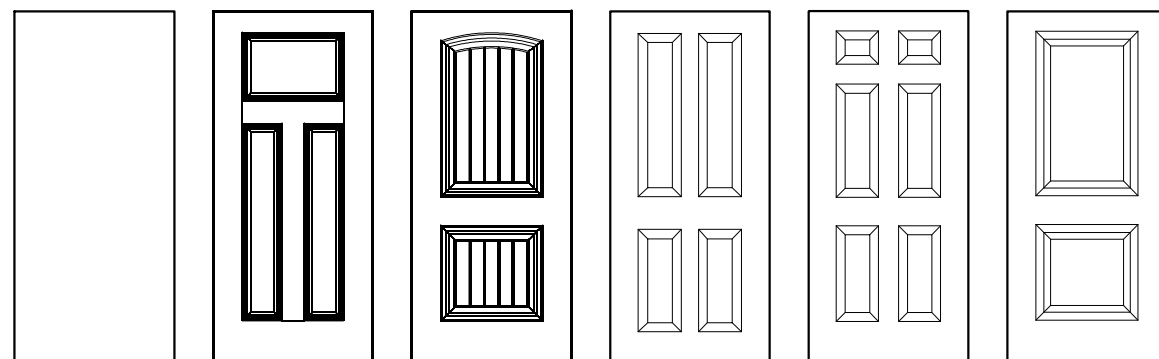

Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

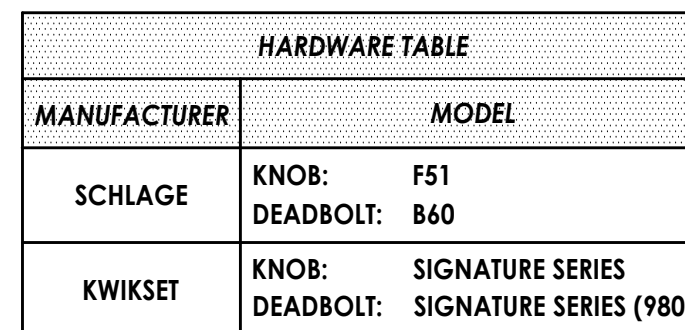[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

**THERMA-TRU
STEEL DOOR**

PART OR ASSEMBLY:

ELEVATIONS

Design-Build Consultants, Inc.


P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197


FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

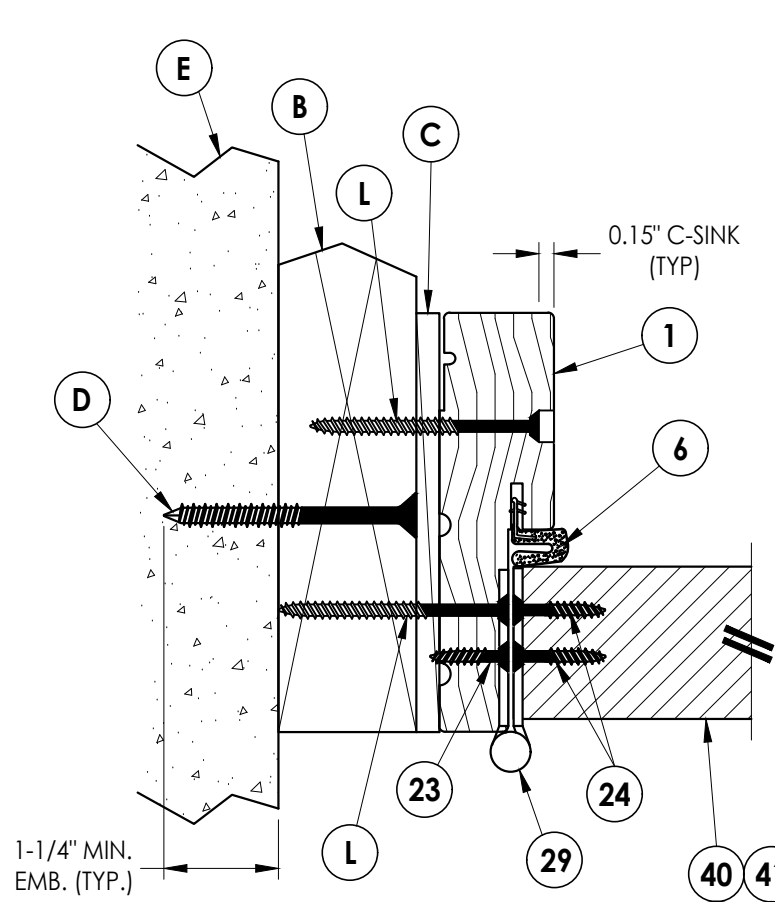


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

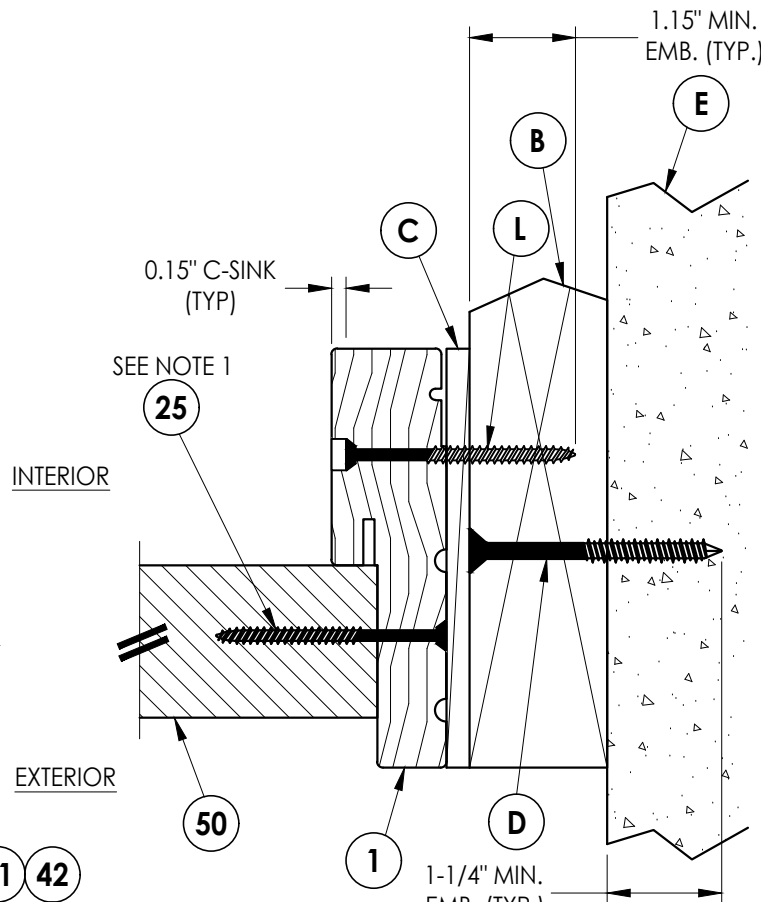

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

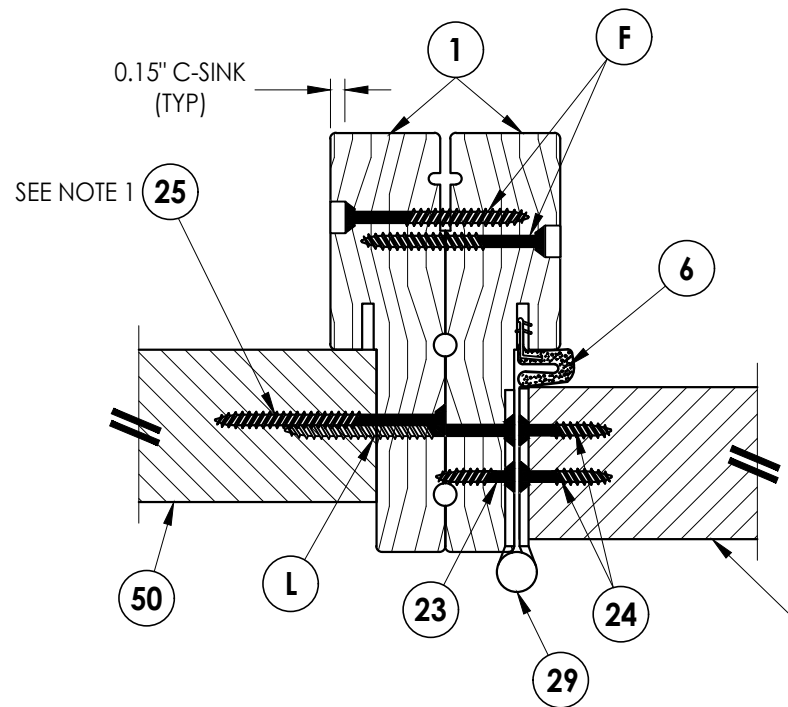


5
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

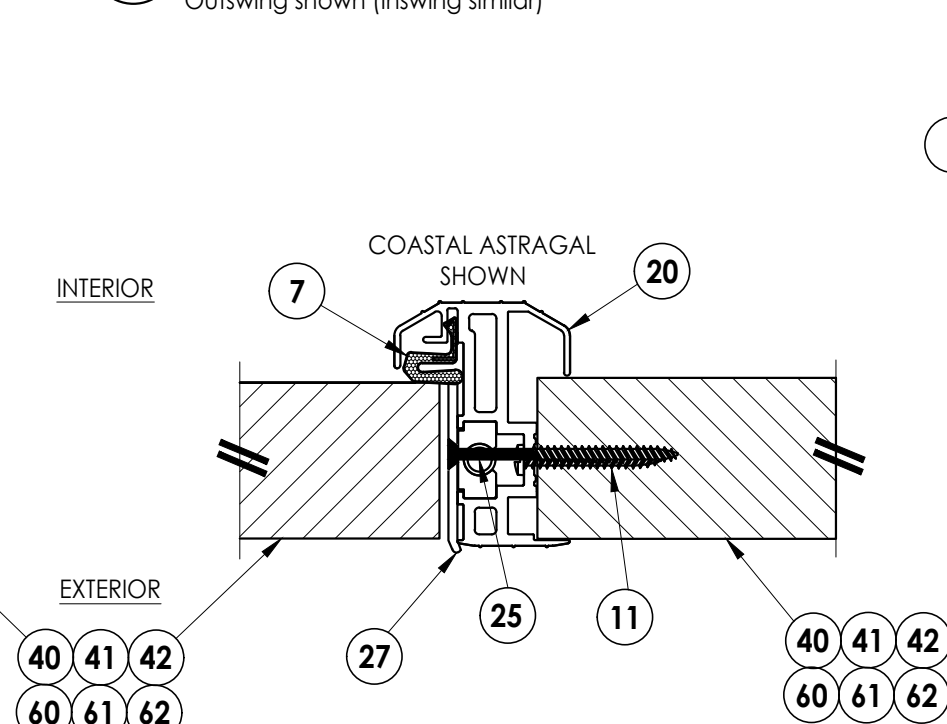


6
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

- Notes:
1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

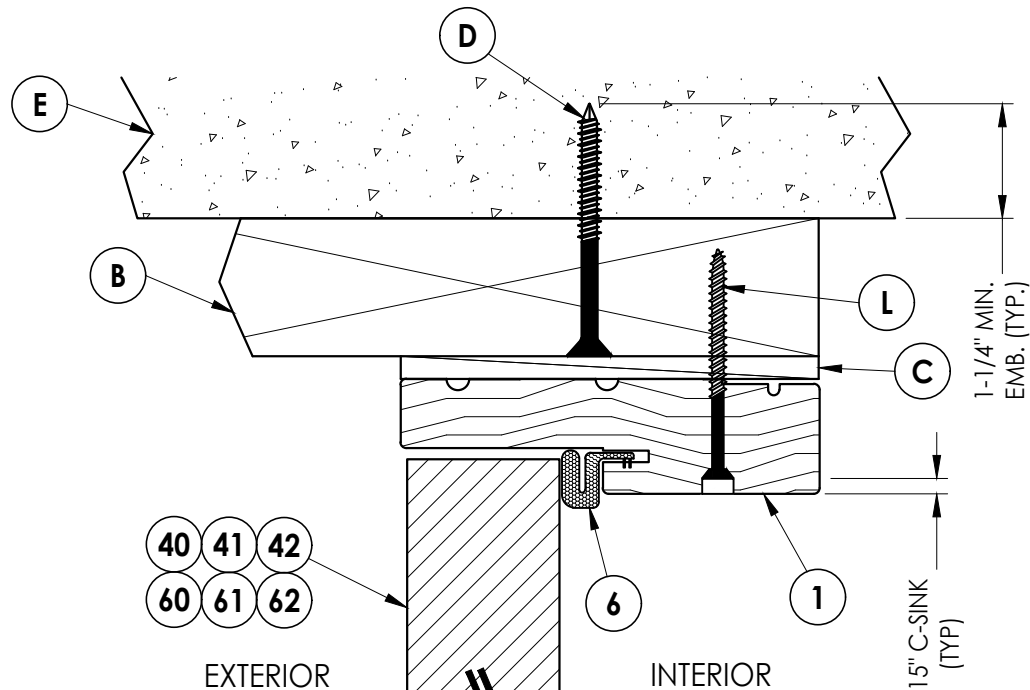

3
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

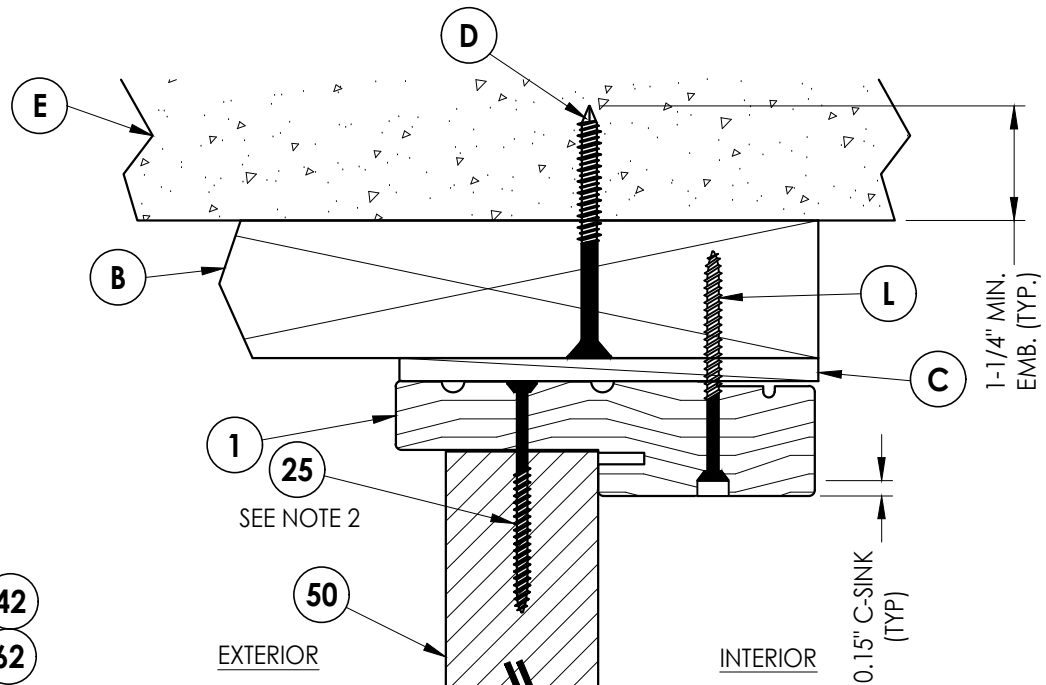

4
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR


PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

REVISIONS			
NO.	DATE	BY	
3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/14/20	UPDATE TO 7TH ED. (2020)	FBC LFS


DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21131.3
SHEET 6 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg


- Notes:
1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

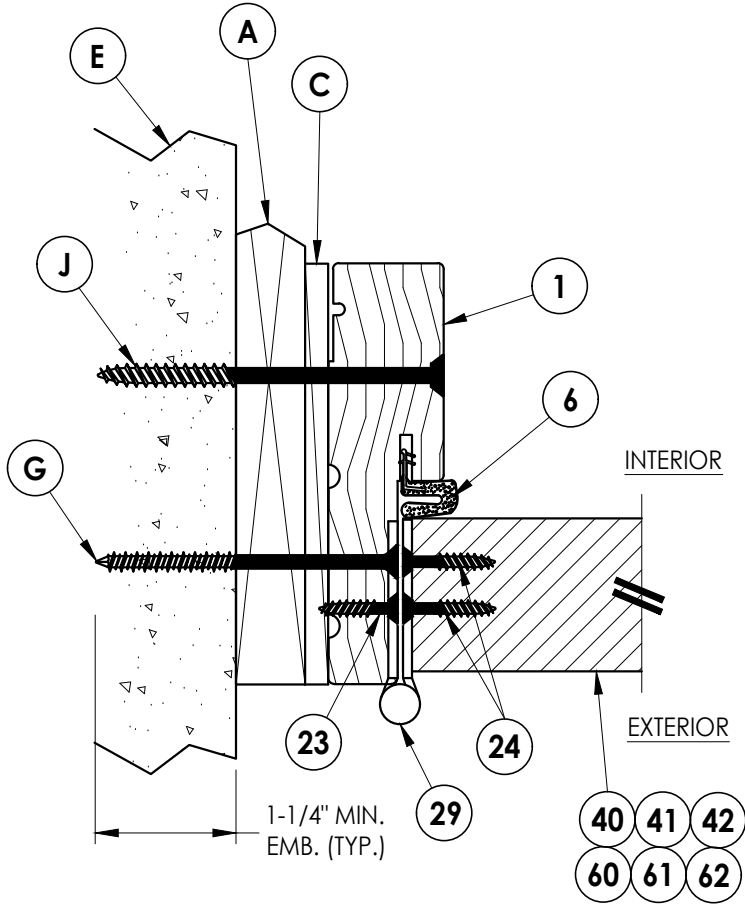


1
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

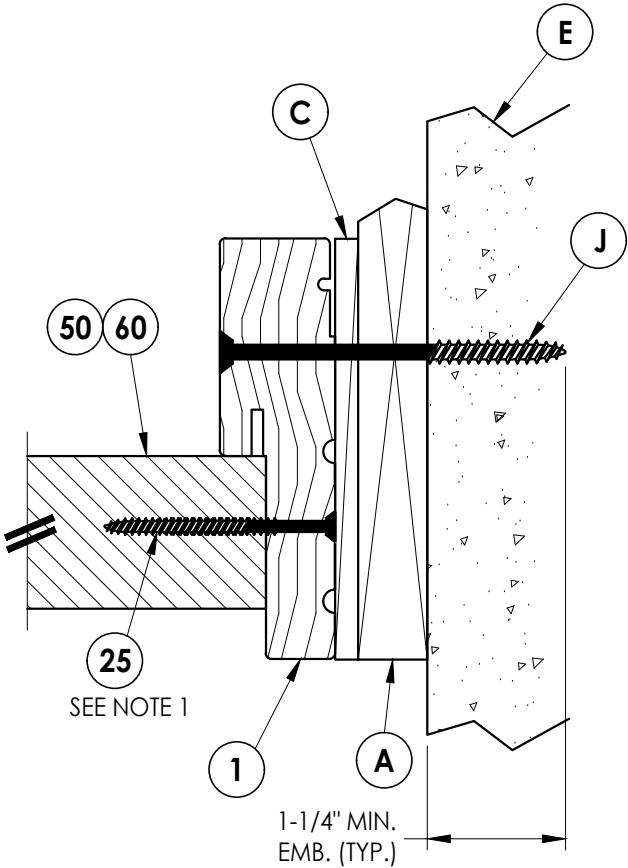

2
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

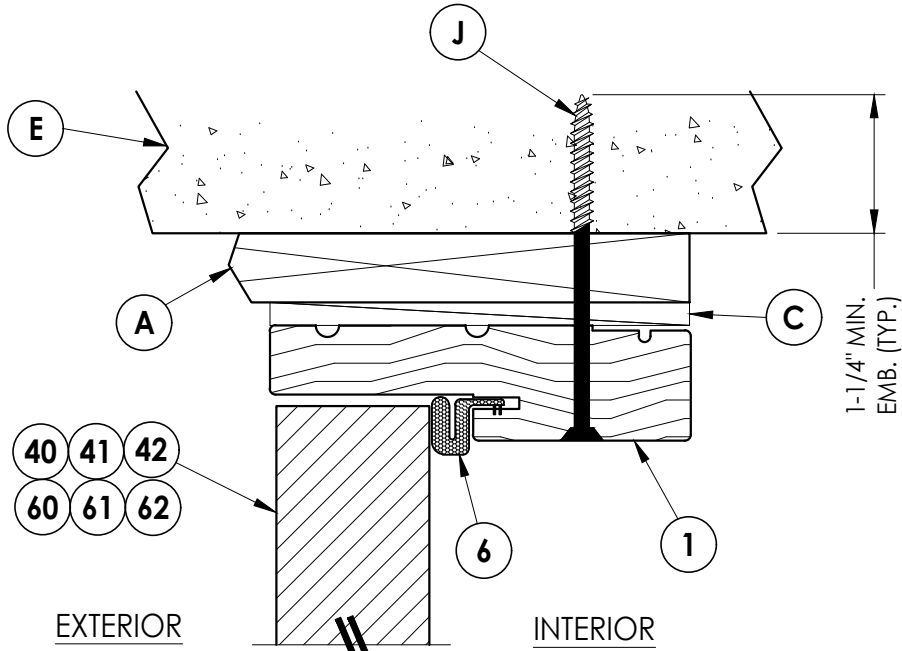

3
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

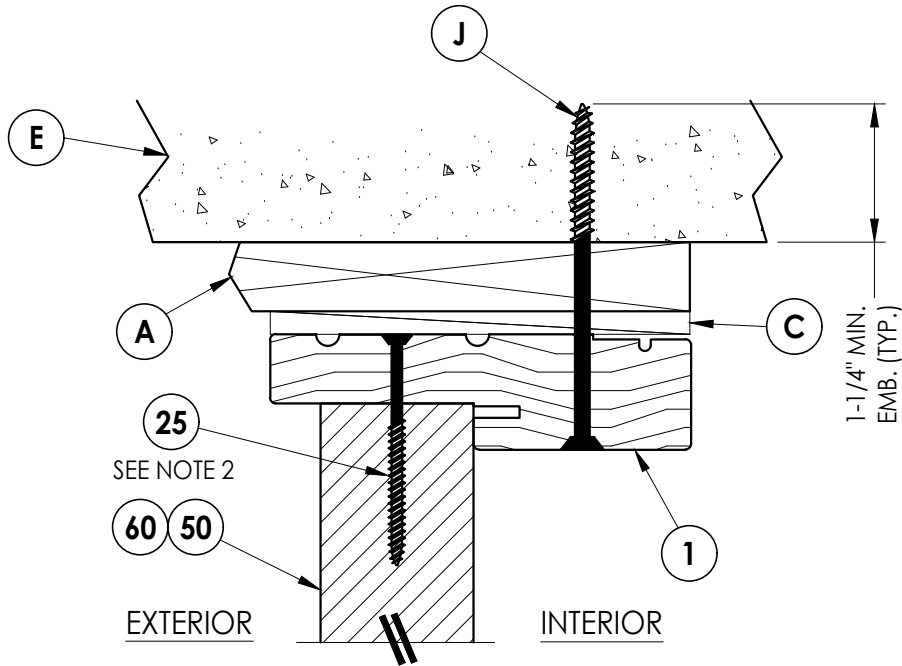

4
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

REVISIONS			
NO.	DATE	BY	
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/14/20	UPDATE TO 7TH ED (2020) FBC	LFS

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-21131.3

SHEET 7 OF 14


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

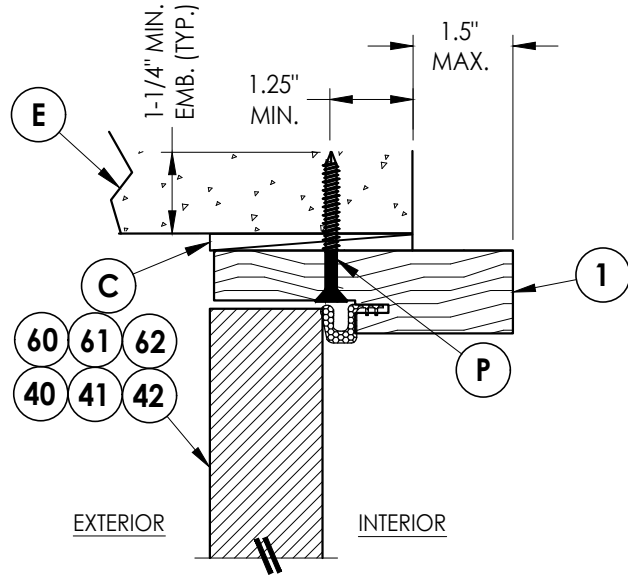

3
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

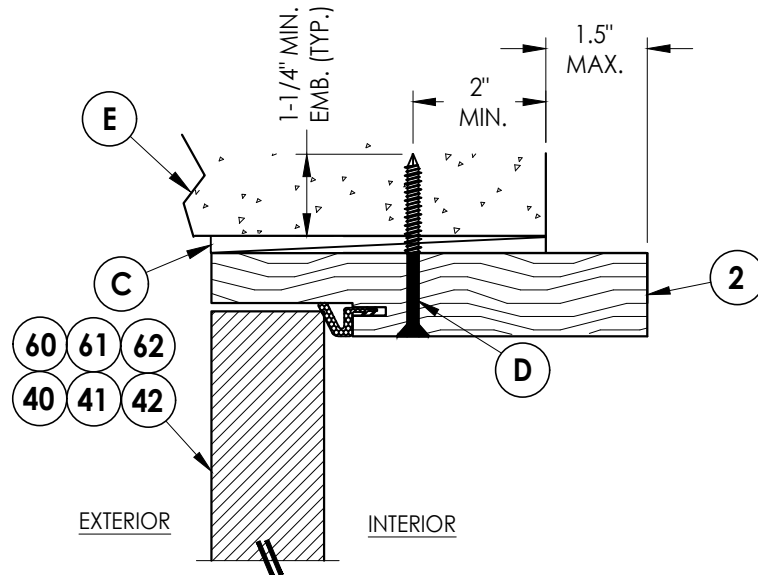


5
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

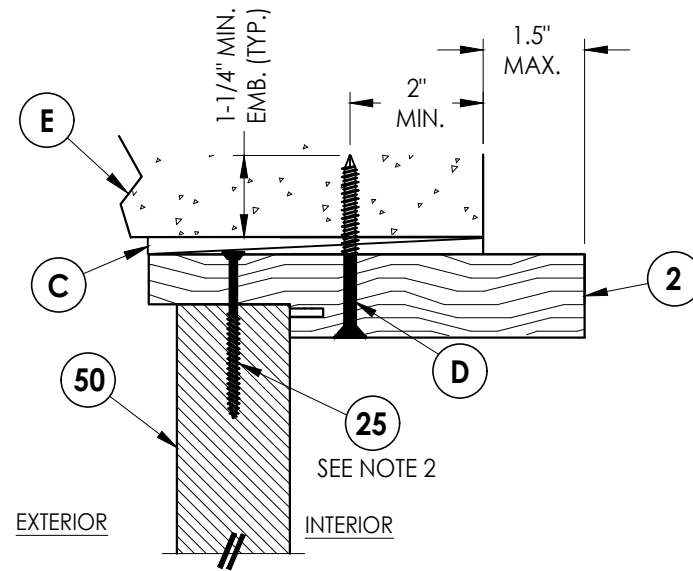


6
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Notes:


1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

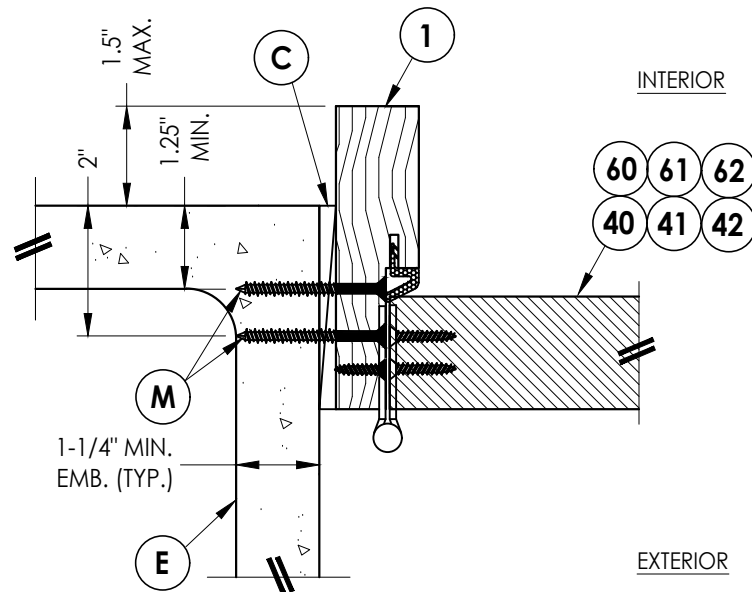

1
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

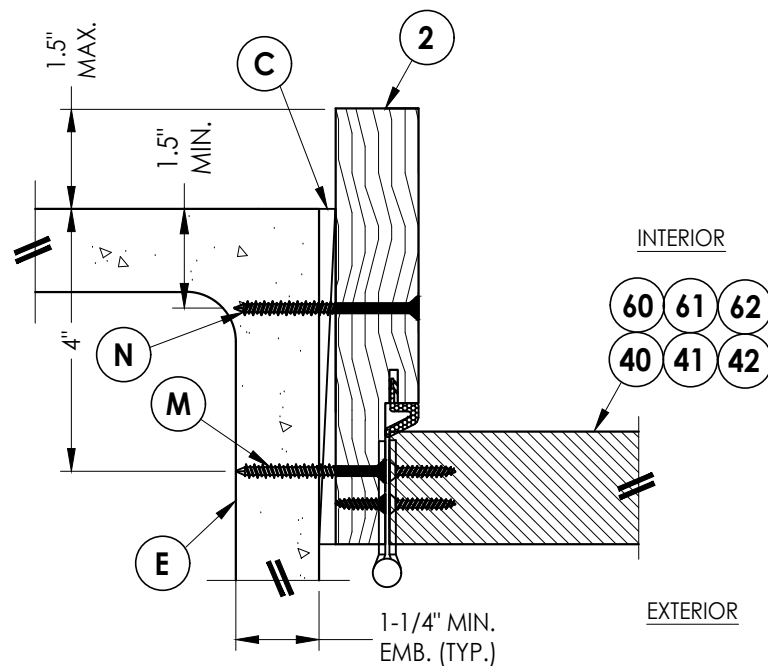

4
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

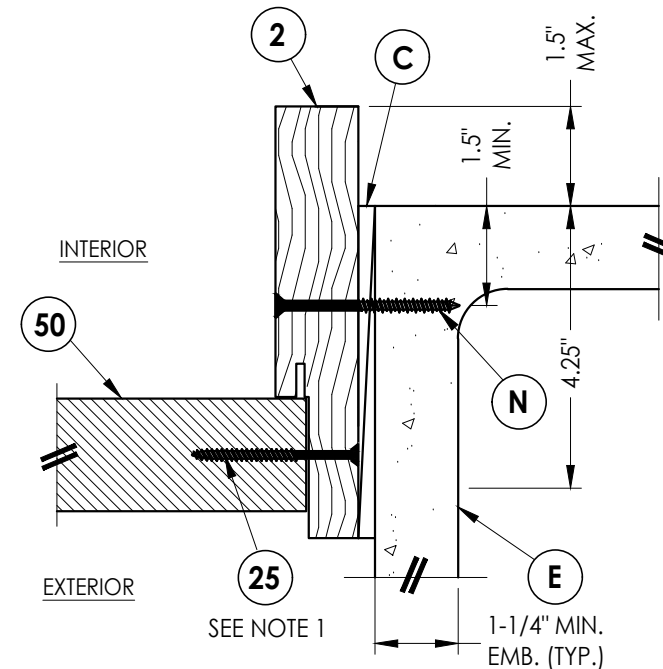

2
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813






PRODUCT: THERMA-TRU
STEEL DOOR
PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC
1	7/14/20	UPDATE TO 7TH ED (2020) FBC

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21131.3
SHEET 8 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

- Notes:
- 1. Sill Item #'s 16, 32, 33, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pph screws at each end.
Sill Item #'s 17 & 18 are attached to jambs w/ (2) #8 X 2-1/2" pph screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - 2. Sidelite assembly screws located 4" from each end (2 screws along sill).

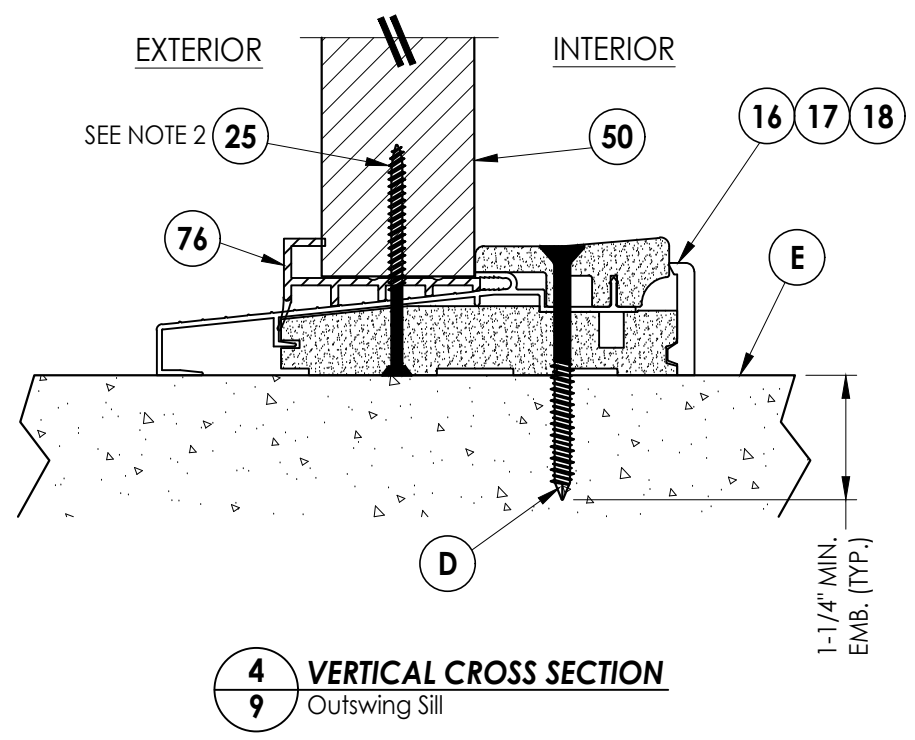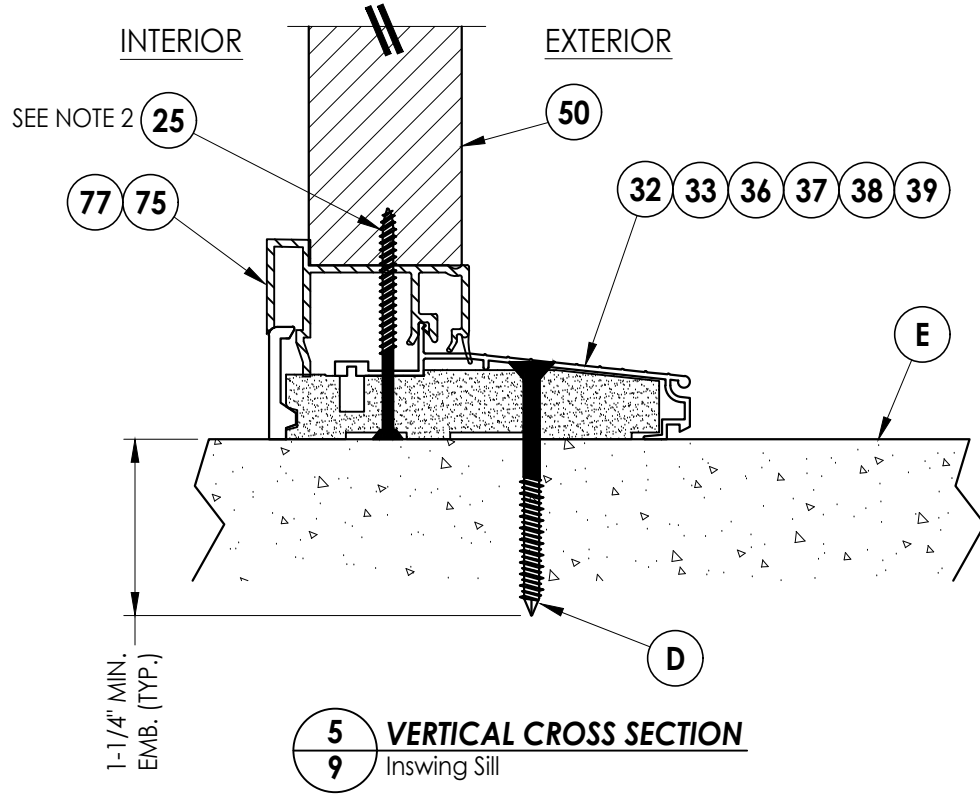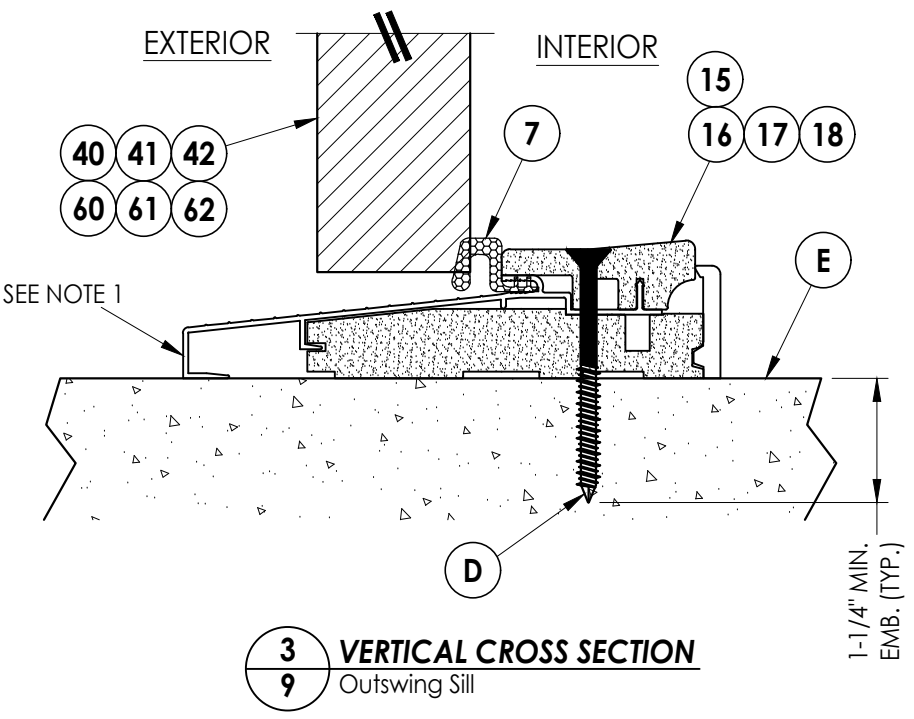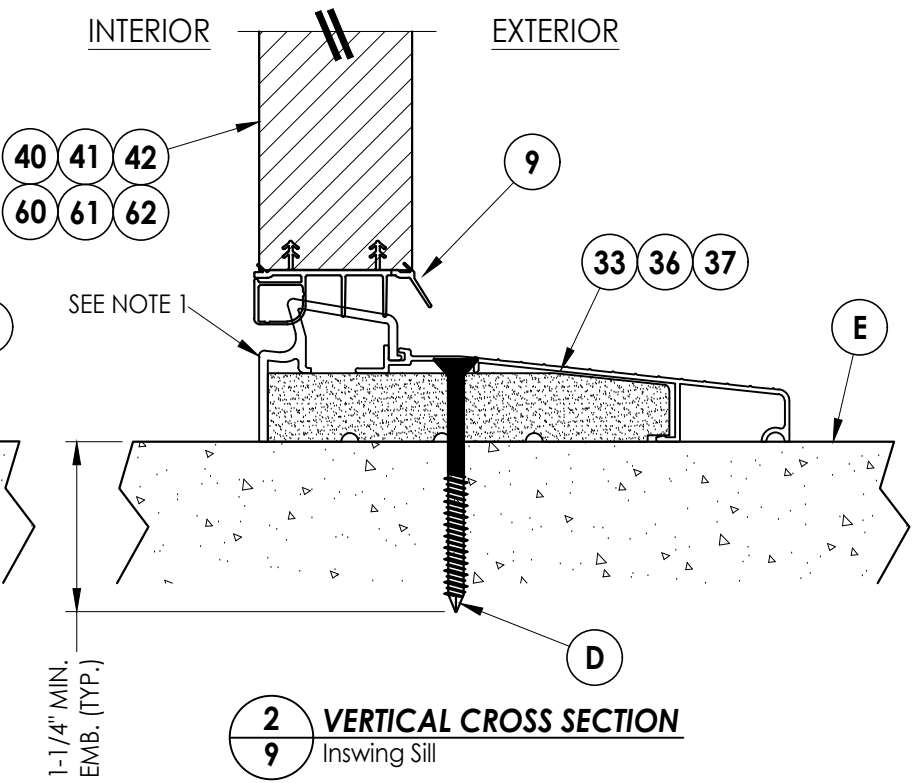
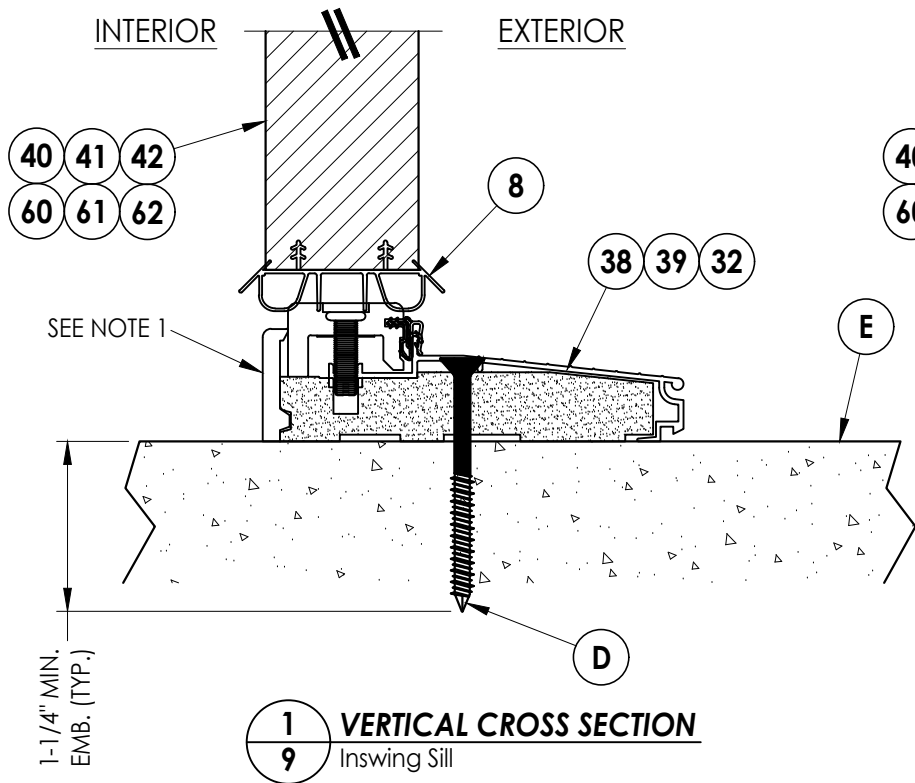


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:		THERMA-TRU STEEL DOOR	
PART OR ASSEMBLY:		VERTICAL CROSS SECTIONS (THRESHOLDS)	
NO.	DATE	REVISIONS	
		LFS	BY
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/14/20	UPDATE TO 7TH ED (2020) FBC	LFS
DATE: 10/12/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21131.3			
SHEET 9 OF 14			

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

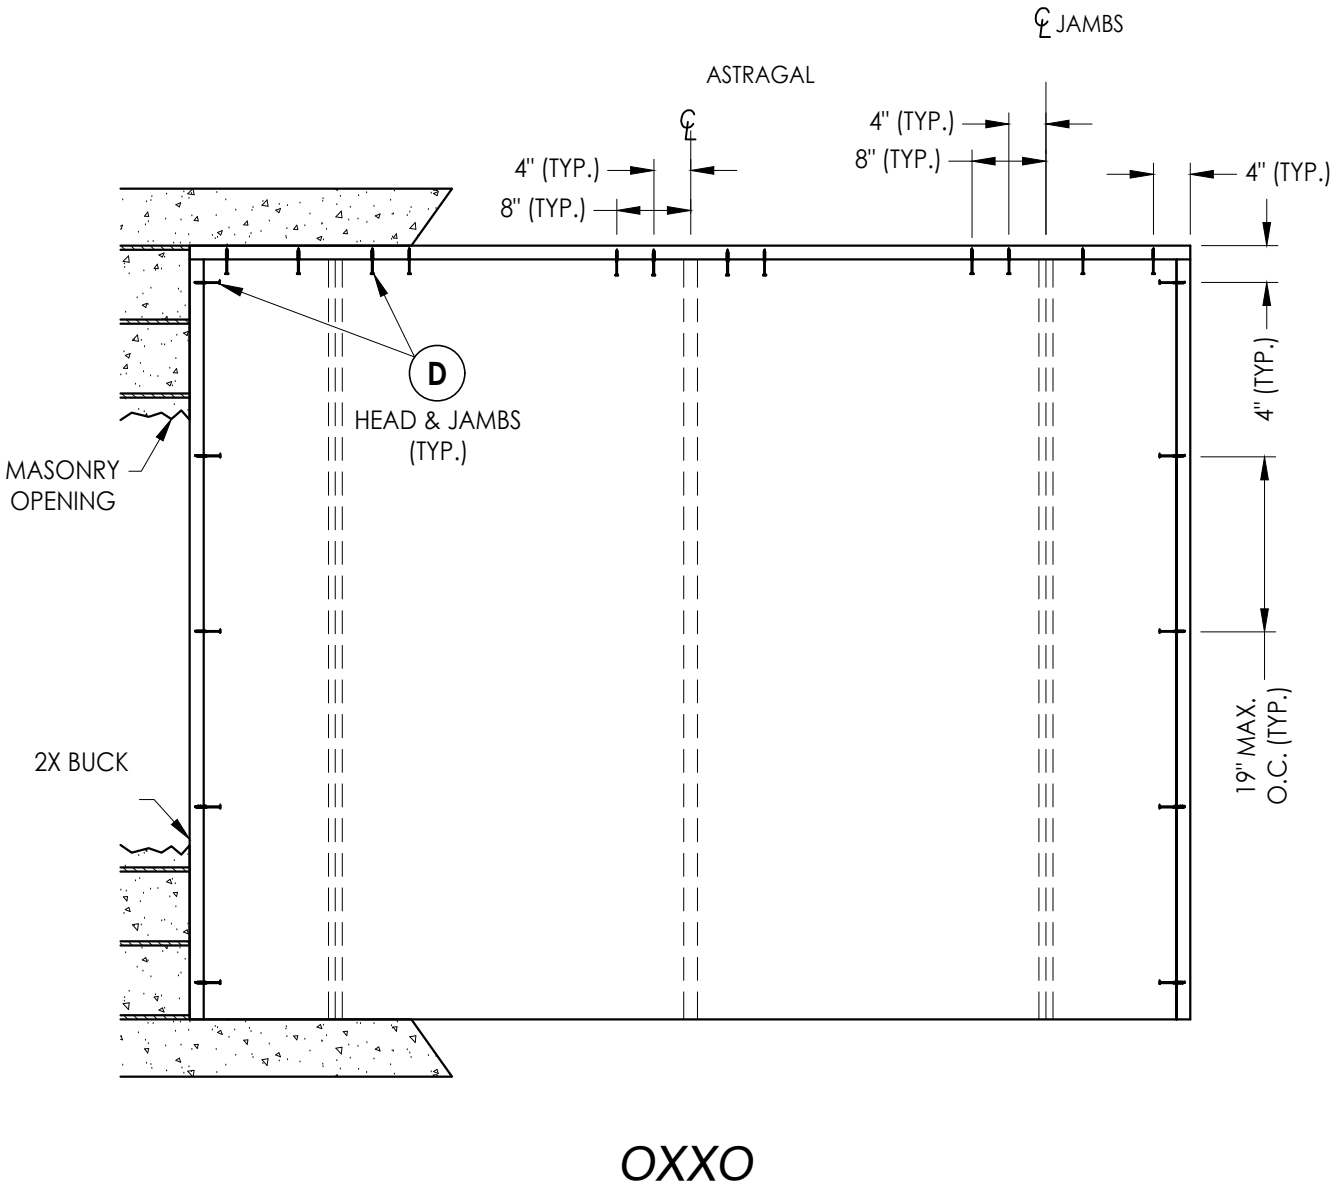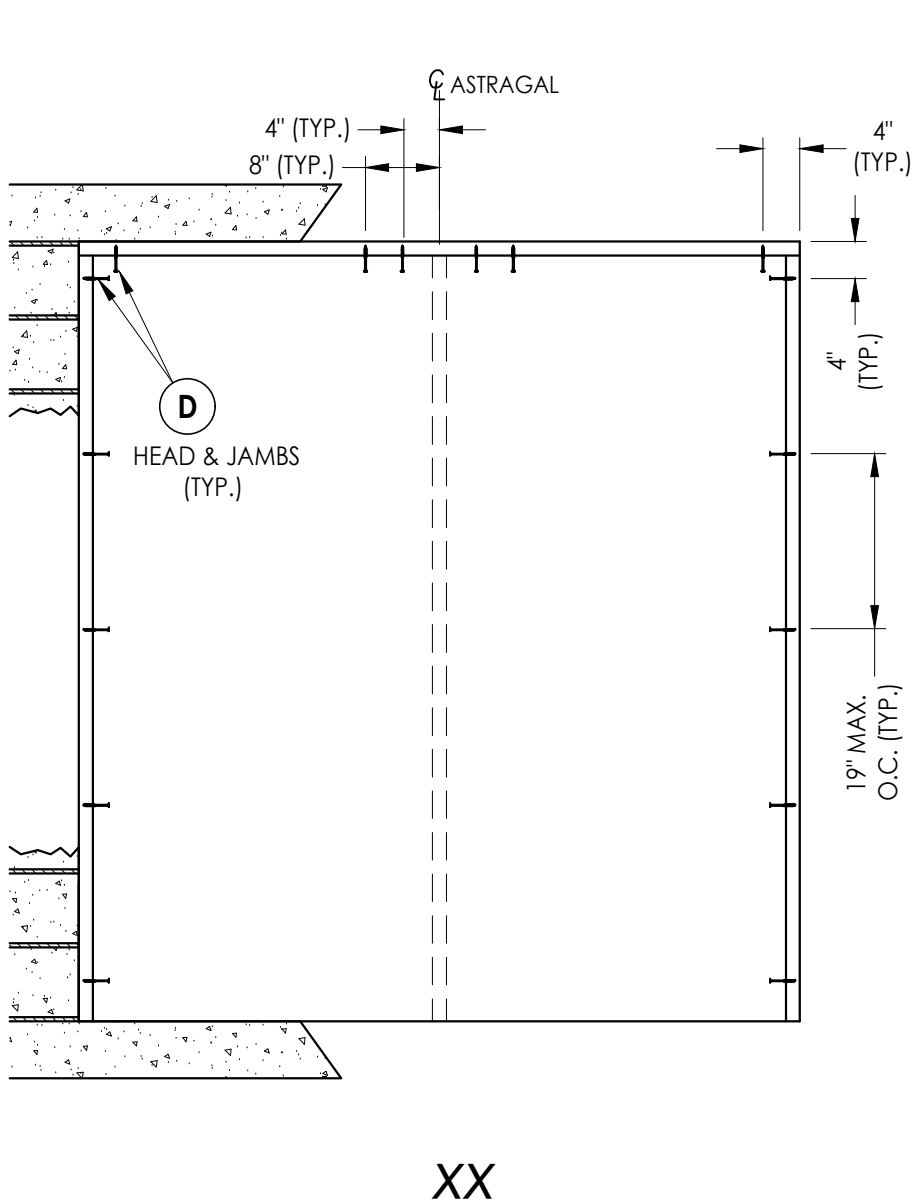



2X BUCK ANCHORING

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/14/20	UPDATE TO 7TH ED (2020) FBC LFS


DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21131.3
SHEET	10 OF 14

PRODUCT:	THERMA-TRU STEEL DOOR
PART OR ASSEMBLY:	BUCK ANCHORING

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813
---	--

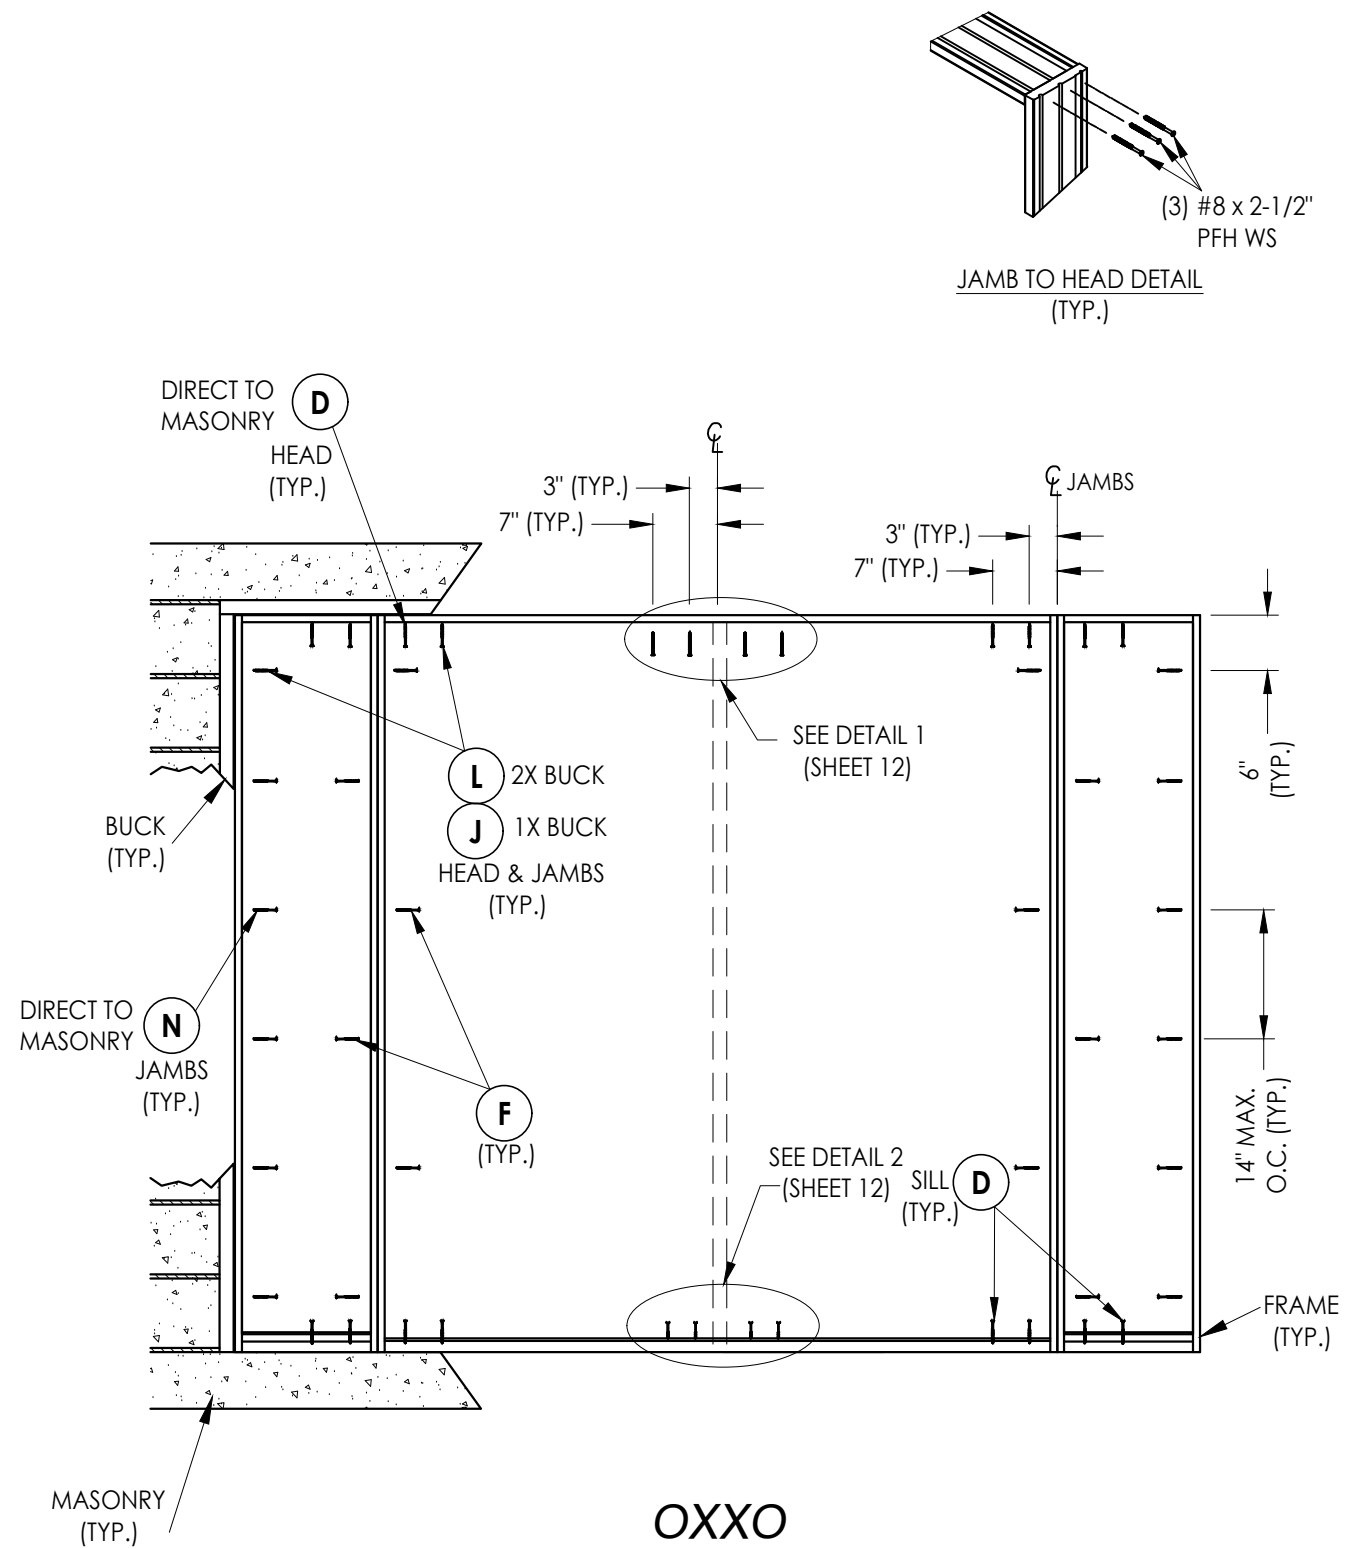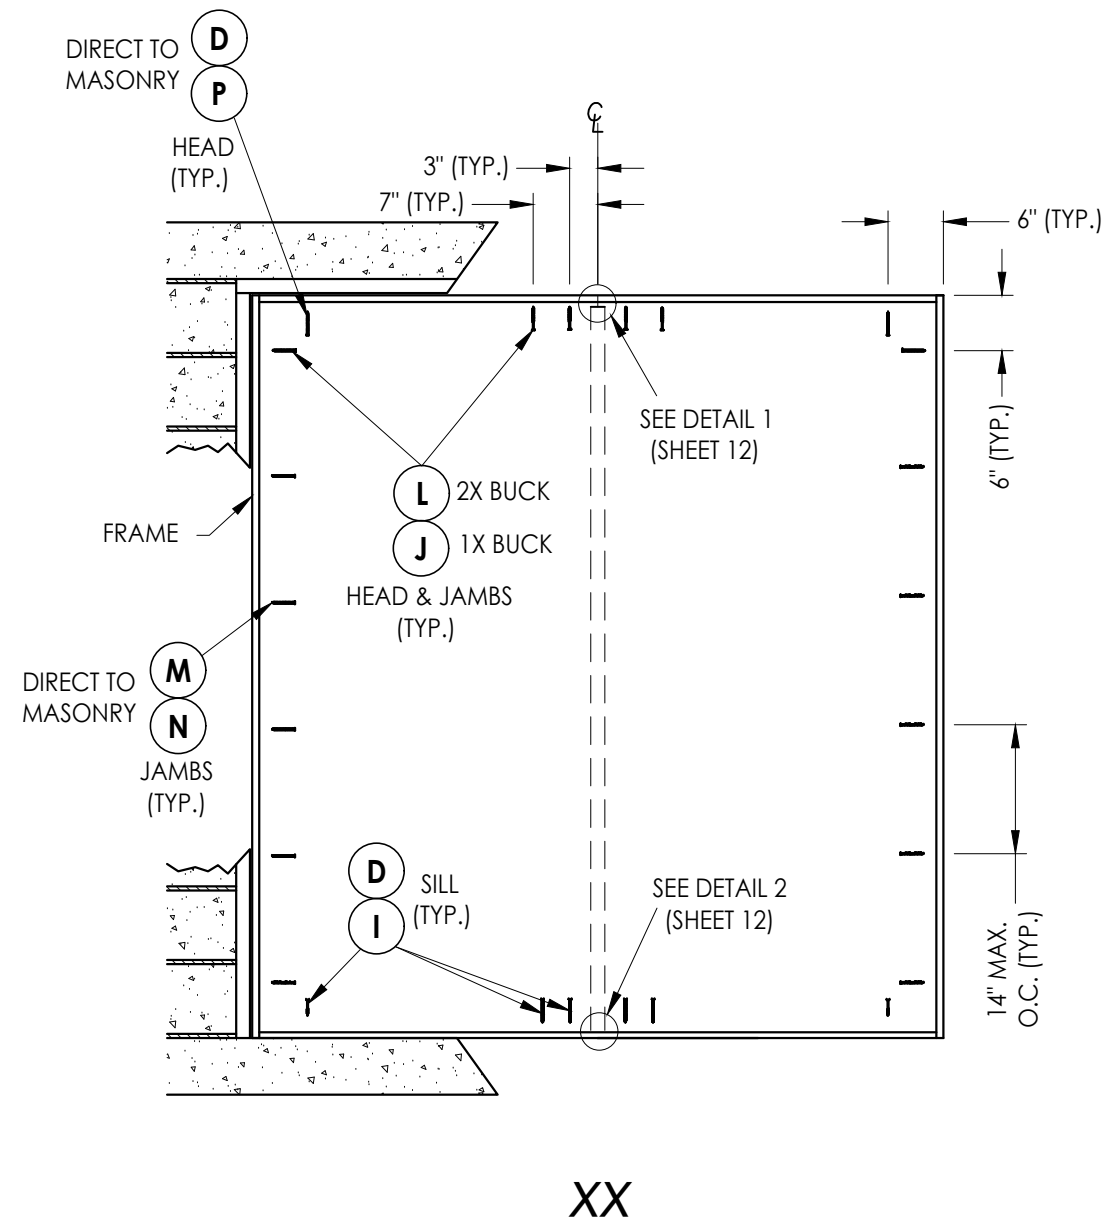

FRAME ANCHORING

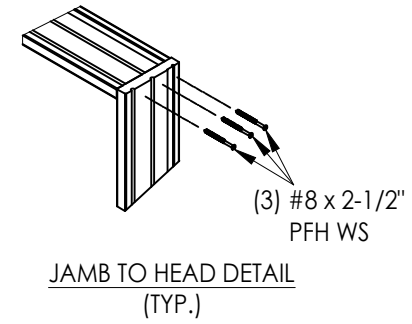

3	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS				
2	8/07/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS				
1	7/14/20	UPDATE TO 7TH ED	(2020)	FBC	LFS				
NO.	DATE				BY				
						REVISIONS			
DATE: 10/12/17									
SCALE: N.T.S.									
DWG. BY: JK									
CHK. BY: LFS									
DRAWING NO.: FL-21131.3									
SHEET 11 OF 14									

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
 STEEL DOOR

R ASSEMBLY:
FRAME ANCHORING

REVISIONS

DATE: 10/12/17

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: *LFS*


DRAWING NO.:

FL-21131.3


SHEET 11 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

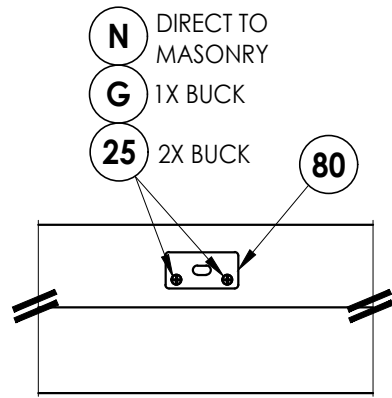


DETAIL 1
Coastal Astragal Strike Plate @ Head

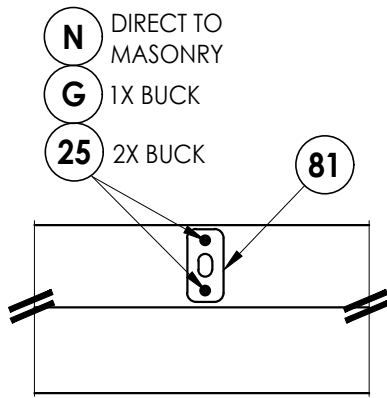


DETAIL 1
Standard Astragal Strike Plate @ Head

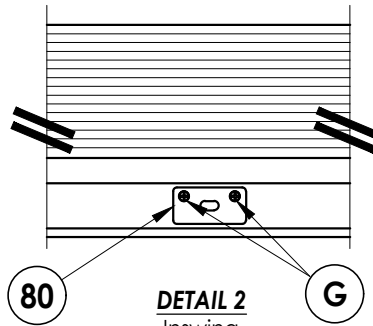


DETAIL 2
Inswing
Coastal Astragal Strike Plate @ Sill

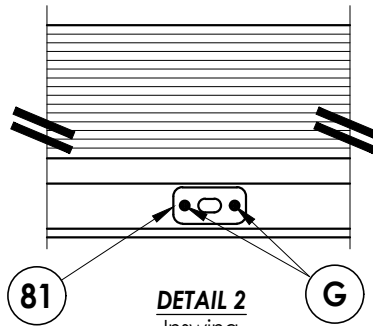


DETAIL 2
Inswing
Standard Astragal Strike Plate @ Sill

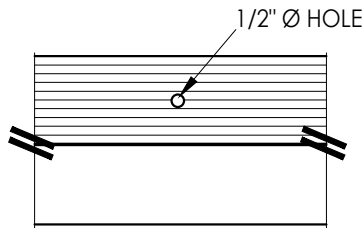


DETAIL 2
Outswing
Astragal Bolt Hole @ Sill

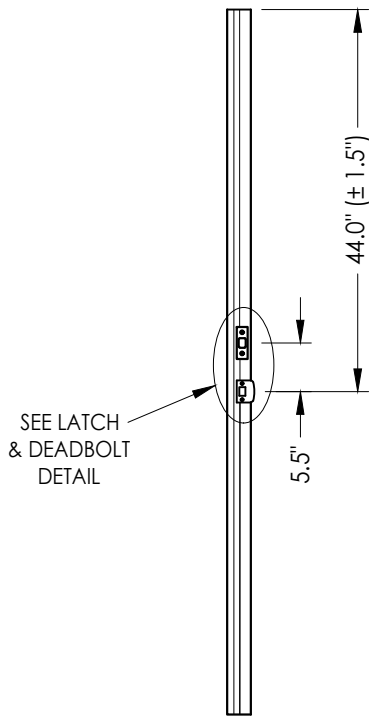


ASTRAGAL
Latch and Deadbolt

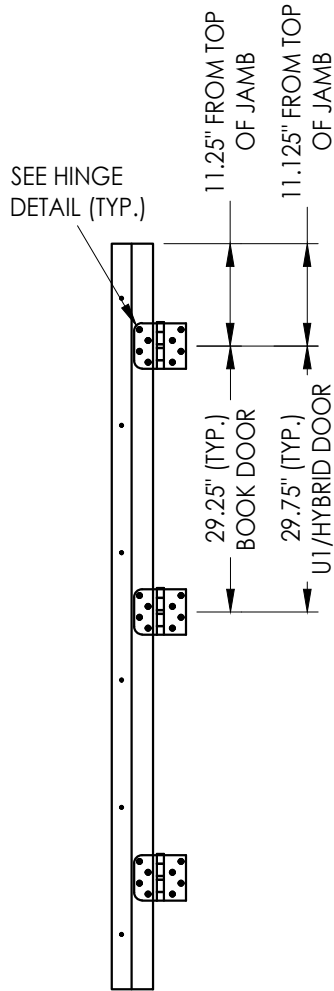

HINGE JAMB

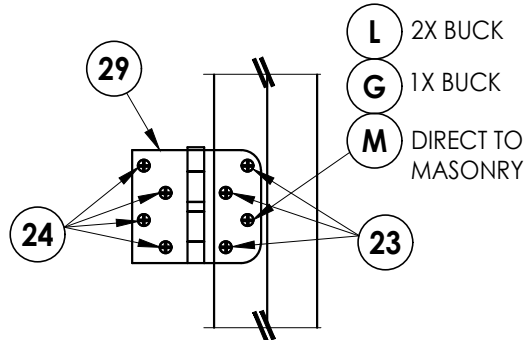

HINGE DETAIL

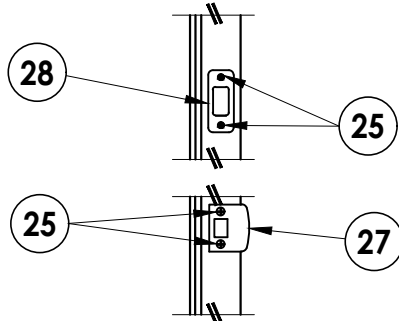

LATCH & DEADBOLT DETAIL
Schlage / Kwikset

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


R.W. BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	
THERMA-TRU STEEL DOOR	
PART OR ASSEMBLY:	
HARDWARE DETAILS	


REVISIONS	
NO.	DATE
3	7/03/26
2	8/07/23
1	7/14/20

DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21131.3
SHEET	12 OF 14


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.1-3.dwg

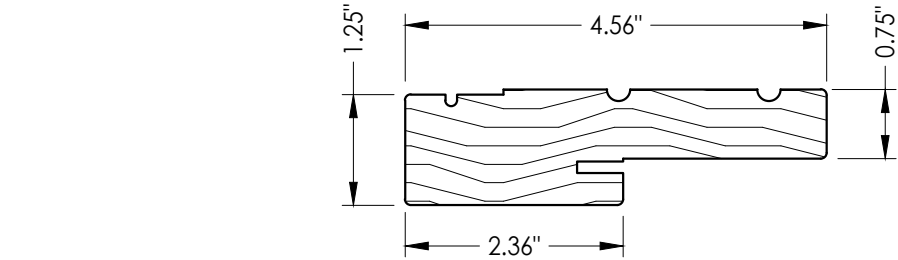


1 WOOD JAMB

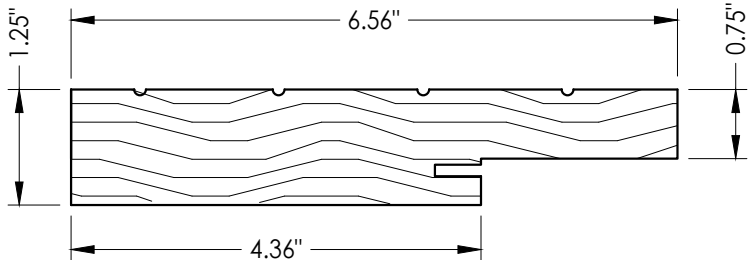


2 WOOD JAMB

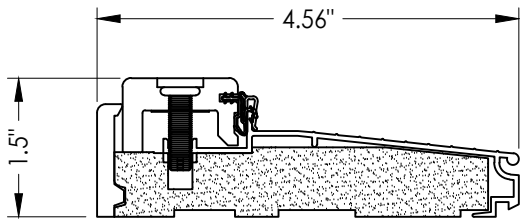


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

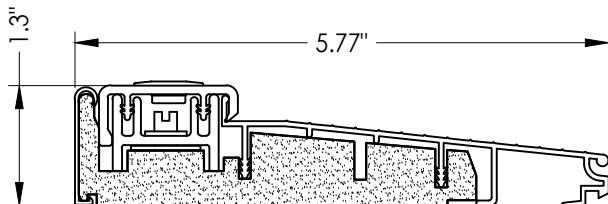


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

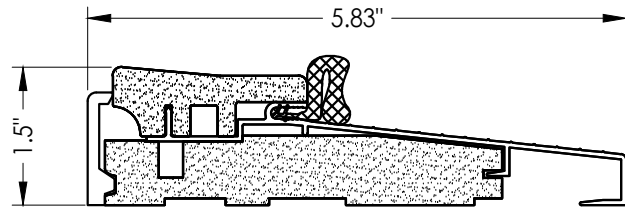


16 OUTSWING THRESHOLD
Composite Sill

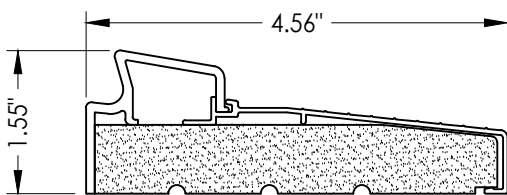


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

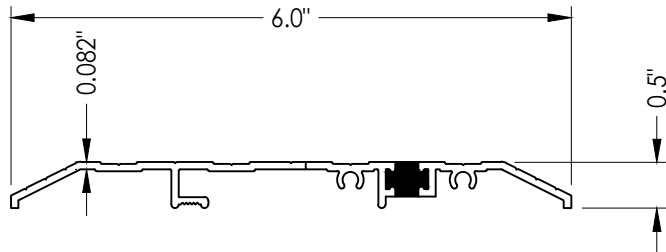


15 PUBLIC ACCESS THRESHOLD

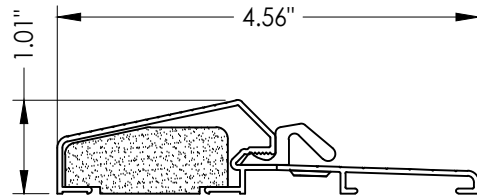


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

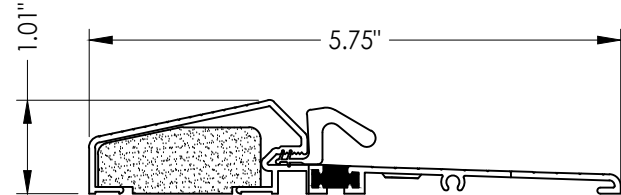


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

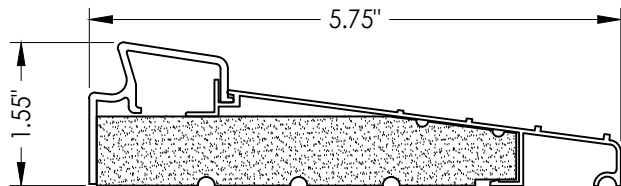


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

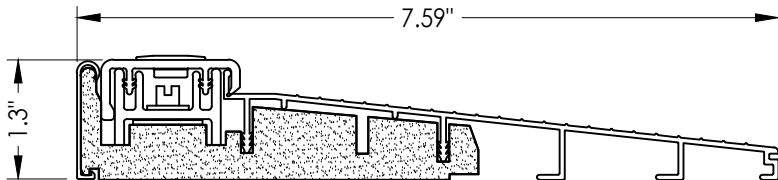


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

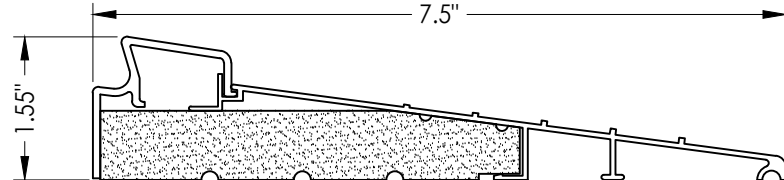


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

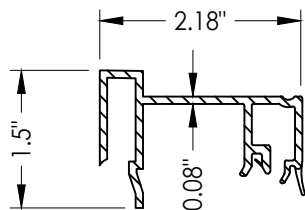


75 SIDELITE SPACER
Inswing




76 SIDELITE SPACER
Outswing

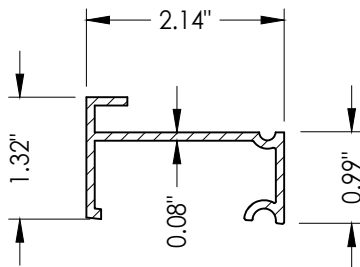


77 SIDELITE SPACER
Inswing



8 SWEEP



9 SWEEP



10 SWEEP

PRODUCT:		THERMA-TRU STEEL DOOR		PART OR ASSEMBLY:		COMPONENTS	
				LFS	FBC		
				LFS	FBC		
				LFS	FBC		
				BY			

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21131.3

SHEET 13 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			29	4" X 4" HINGE	STEEL
F	#10 X 2" PFH WOOD SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	38	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	39	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	40	DOOR PANEL (BOOK) - "PROFILES" SERIES	-
2	JAMB (FINGER JOINT PINE)	WOOD	41	DOOR PANEL (HYBRID) - "PROFILES" SERIES	-
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	42	DOOR PANEL (U1) - "PROFILES" SERIES	-
7	WEATHERSTRIP (LONG REACH)	FOAM	50	SIDELITE (FULL LITE)	-
8	SWEEP	VINYL	60	DOOR PANEL (BOOK) - "TRADITIONS" SERIES	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	61	DOOR PANEL (HYBRID) - "TRADITIONS" SERIES	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	62	DOOR PANEL (U1) - "TRADITIONS" SERIES	-
11	#8-10 X 1-1/2" PLASCREW	STEEL	75	SIDELITE SPACER (INSWING)	PVC
12	#6-18 X 1-3/4" PFH SCREW	STEEL	76	SIDELITE SPACER (OUTSWING)	PVC
15	PUBLIC ACCESS THRESHOLD	ALUM	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
16	OUTSWING THRESHOLD	ALUM/COMP	CORROSION RESISTANCE - SALTWATER ENVIRONMENTS Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R3 CONCRETE ANCHOR NOTES:		
17	OUTSWING THRESHOLD	ALUM/COMP			
18	OUTSWING THRESHOLD	ALUM/COMP			
22	#8 x 3/4" PFH WOOD SCREW	STEEL			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]