


WOOD EDGE
GLAZED STEEL DOUBLE DOOR
w/ or w/out SIDELITES
INSWING/OUTSWING
"NON-IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details "Profiles"
3	Door Panel Details "Traditions"
4	Sidelite Panel and Glazing Details
5	Elevations
6	Horizontal & Vertical Cross Sections (2X Buck)
7	Horizontal & Vertical Cross Sections (1X Buck)
8	Horizontal & Vertical Cross Sections (Direct to Masonry)
9	Vertical Cross Sections (Thresholds)
10	Buck Anchoring
11	Frame Anchoring
12	Hardware Details
13	Components
14	Bill of Materials

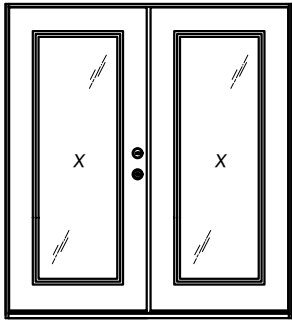

XX

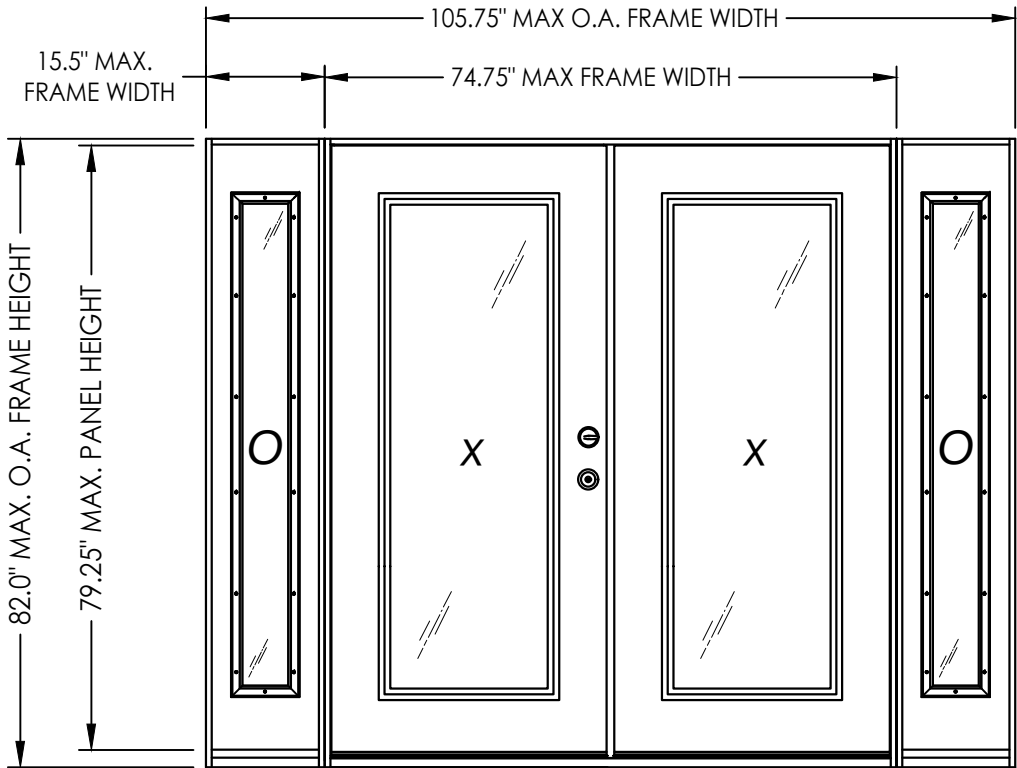

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX, OXXO	+45.0	-50.0	+45.0	-45.0

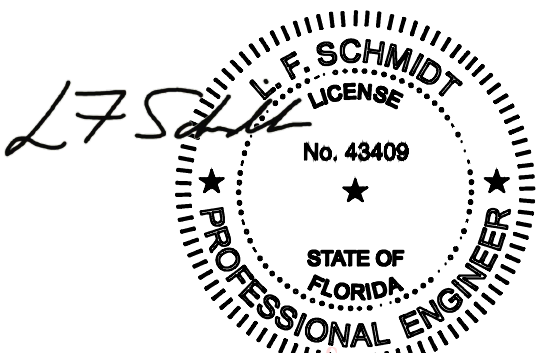

Digitally signed by Lyndon F Schmidt
Date: 2026.08.06 08:37:26 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
STEEL DOOR
PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES


NO.	DATE	REVISIONS			
		BY	DATE	DESCRIPTION	REVISIONS
3	7/03/26	LFS		UPDATE TO 9TH ED. (2026) FBC	
2	8/07/23	LFS		UPDATE TO 8TH ED. (2023) FBC	
1	7/14/20	LFS		UPDATE TO 7TH ED. (2020) FBC	

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21131.9
SHEET 1 OF 14


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

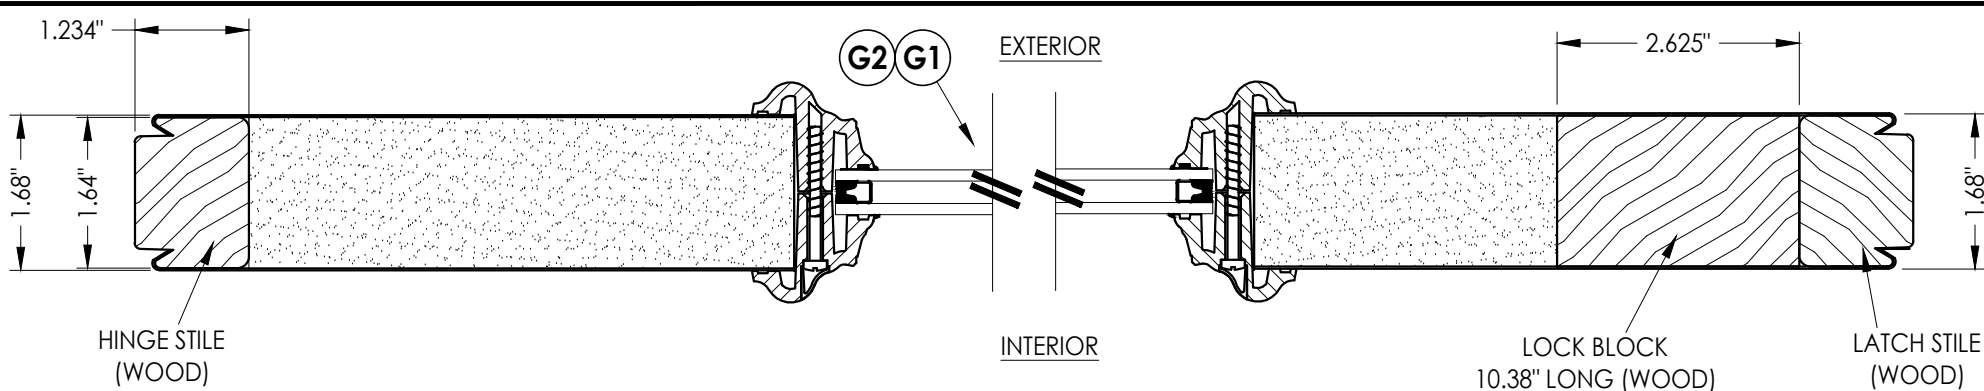


1
2 HORIZONTAL CROSS SECTION

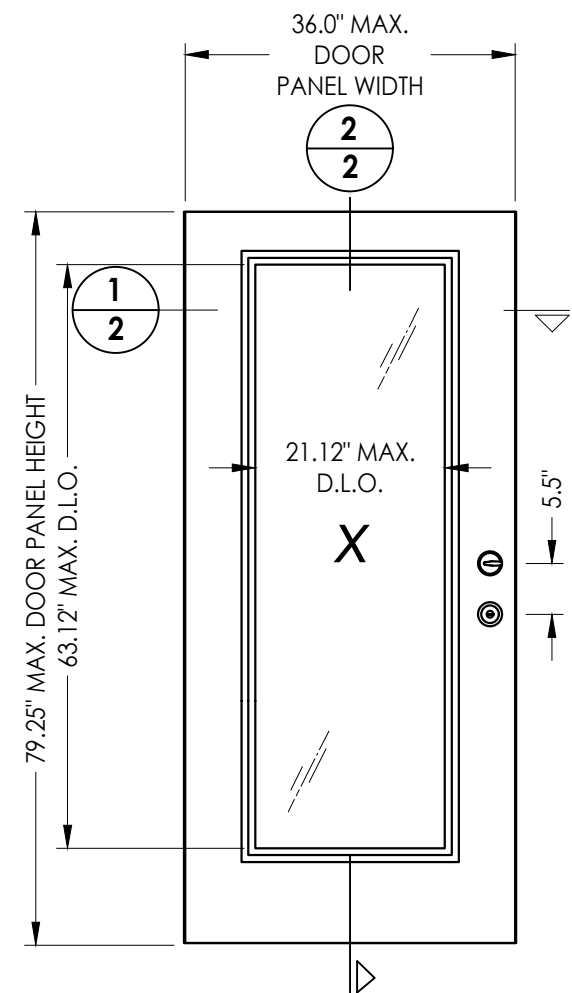


40 DOOR PANEL
BOOK

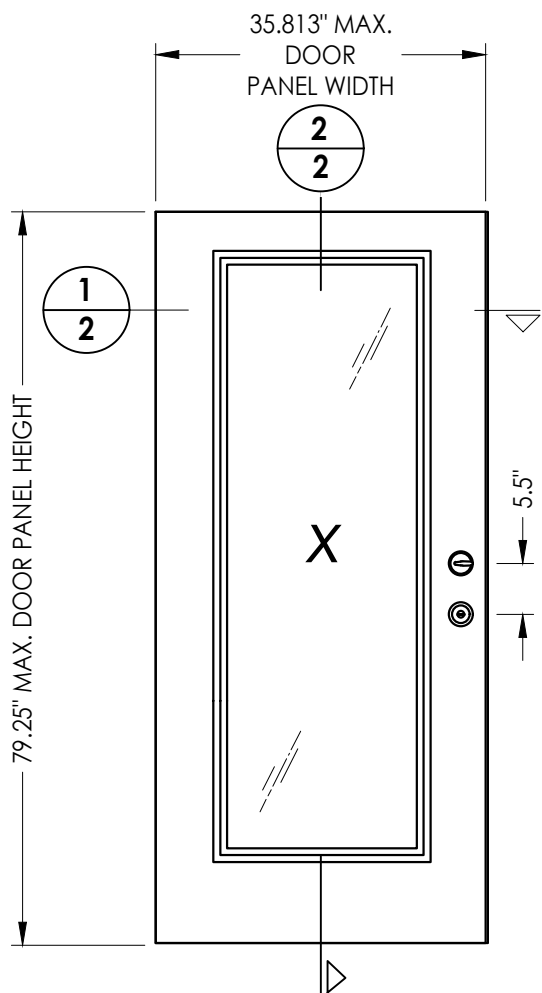

41 DOOR PANEL
Hybrid Door

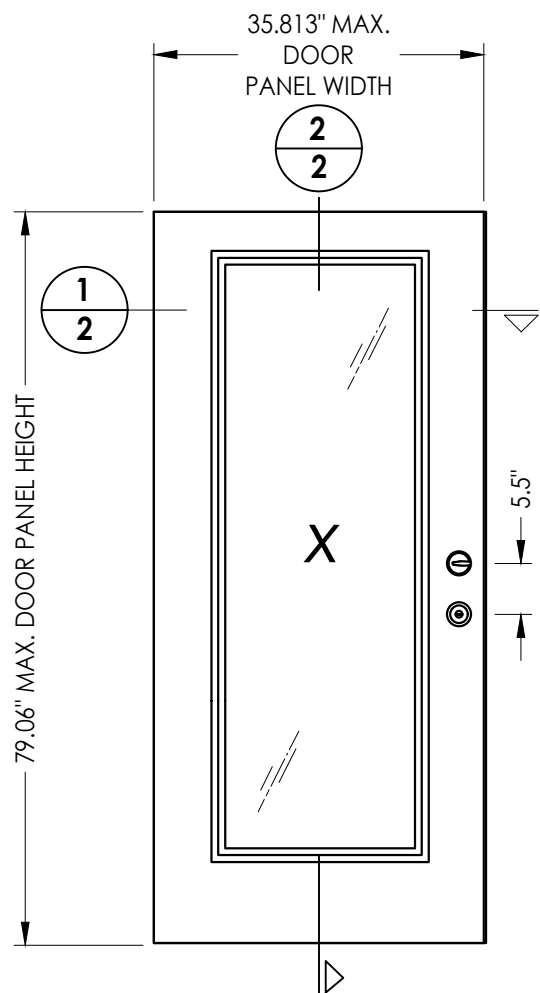

42 DOOR PANEL
U1 Door

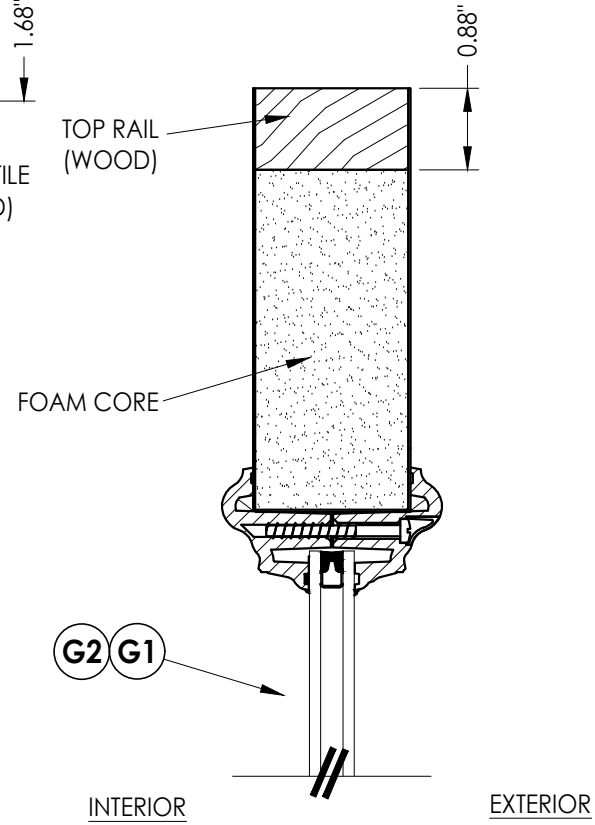

2
2 VERTICAL CROSS SECTION

"PROFILES" SERIES DOOR PANEL

STEEL DOOR SKIN: 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)

FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	THERMA-TRU STEEL DOOR	
	PART OR ASSEMBLY:	"PROFILES" DOOR PANEL DETAILS

NO.	DATE	REVISIONS		
		BY	DATE	DESCRIPTION
3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/14/20	UPDATE TO 7TH ED (2020)	FBC	LFS

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21131.9

SHEET 2 OF 14

36.0" MAX.
DOOR
PANEL WIDTH

79.25" MAX. DOOR PANEL HEIGHT
63.12" MAX. D.L.O.

21.12" MAX.
D.L.O.

5.5"

1
3

2
3

60 DOOR PANEL
BOOK

35.813" MAX.
DOOR
PANEL WIDTH

79.25" MAX. DOOR PANEL HEIGHT

5.5"

1
3

2
3

61 DOOR PANEL
Hybrid Door

35.813" MAX.
DOOR
PANEL WIDTH

79.05" MAX. DOOR PANEL HEIGHT

5.5"

1
3

2
3

62 DOOR PANEL
U1 Door

Technical cross-section diagram of a door assembly, showing the interior and exterior views.

Interior View (Top):

- TOP RAIL (WOOD):** The upper rail, shown with a wood grain pattern. Its thickness is dimensioned as 0.88".
- FOAM CORE:** The insulating core material, shown with a stippled pattern.
- Hinge:** A hinge is shown connecting the top rail to the door frame.
- Callouts:** G1 and G2 are circled and point to the hinge area.
- Labels:** "INTERIOR" is written below the door, and "EXTERIOR" is written to the right.

Exterior View (Bottom):

- STEEL DOOR SKIN:** The outer skin of the door, shown with a cross-hatched pattern.
- FOAM CORE:** The insulating core material, shown with a stippled pattern.
- BOTTOM RAIL (COMP.):** The bottom rail, shown with a cross-hatched pattern. Its thickness is dimensioned as 0.83".
- Hinge:** A hinge is shown connecting the bottom rail to the door frame.
- Labels:** "EXTERIOR" is written to the right of the door.

2 3 VERTICAL CROSS SECTION


3	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
2	8/07/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
1	7/14/20	UPDATE TO 7TH ED	(2020)	FBC	LFS
NO.	DATE				
					REVISIONS

DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21131.9
SHEET	3 OF 14

"TRADITIONS"
DOOR PANEL DETAILS

R^qW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

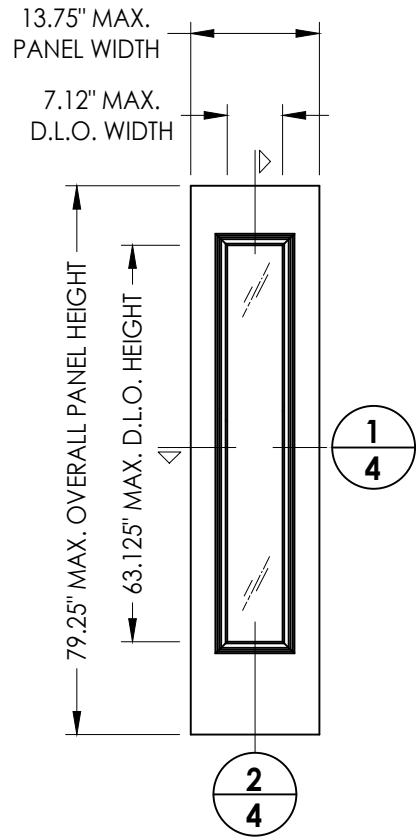


50 SIDELITE PANEL

NOTE:


1. Spacing for item #11 & #12 (lite frame screws) is as follows: From the top down on sides; 3", 14.75", 26.5", 38.25", 50.5" & 62.25". There are (2) screws both top and bottom at 4.25" in from each corner.

SIDELITE PANEL


STEEL SKIN "PROFILES": 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)
STEEL SKIN "TRADITIONS": 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)
SIDELITE WOOD COMPONENTS: PINE (SG >= 0.42)

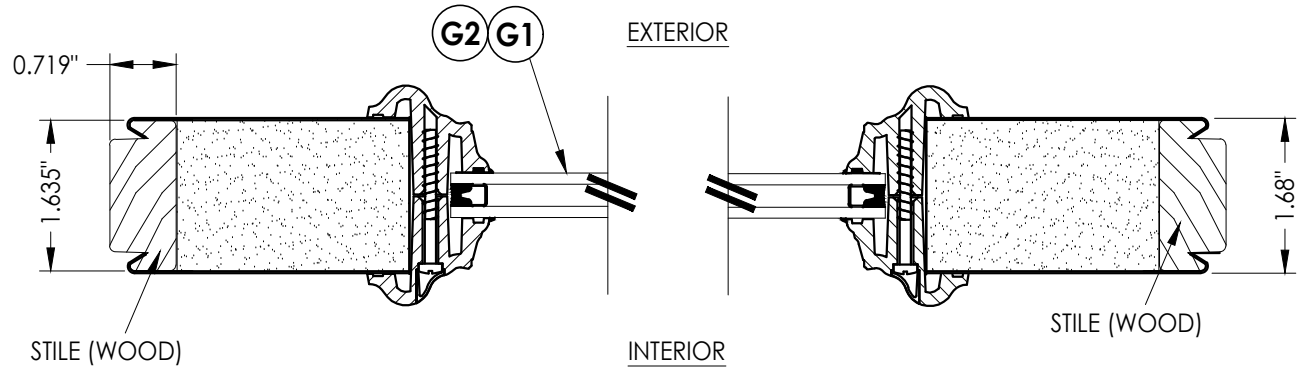


1 4 HORIZONTAL CROSS SECTION

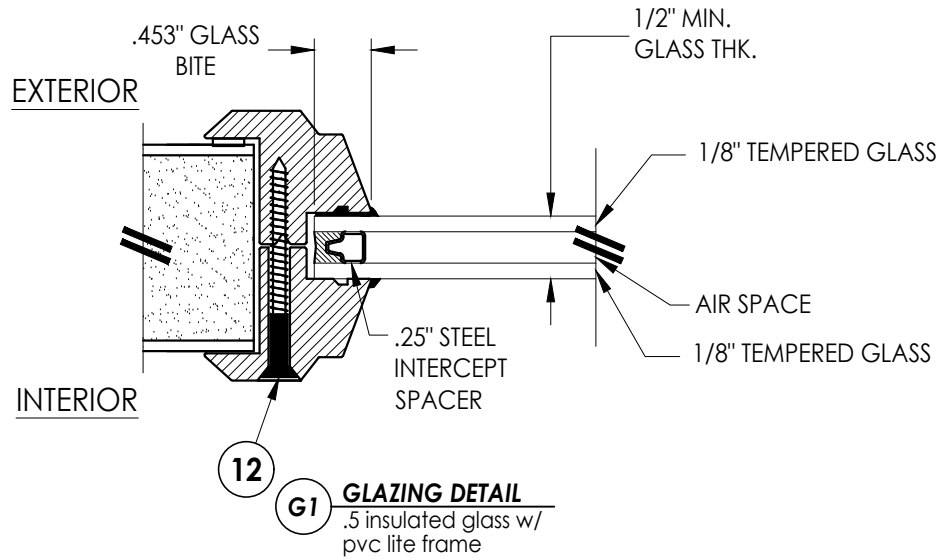

12 G1 GLAZING DETAIL
.5 insulated glass w/
pvc lite frame

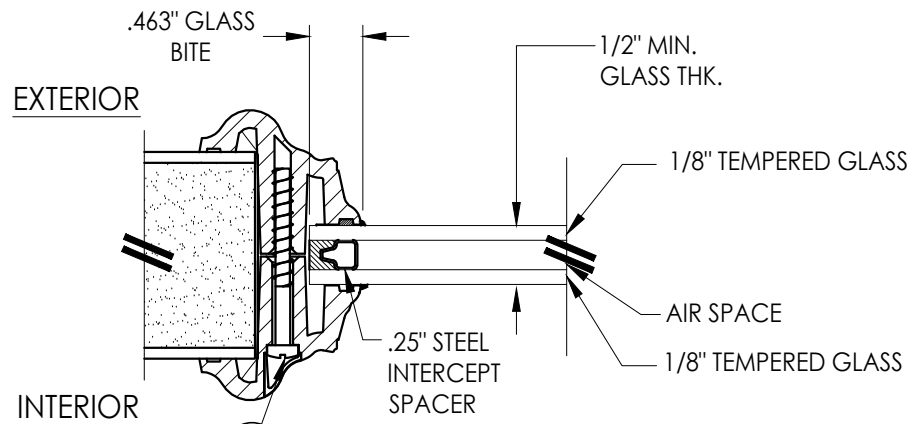

11 G1 GLAZING DETAIL
.5 insulated glass w/
bts lite frame

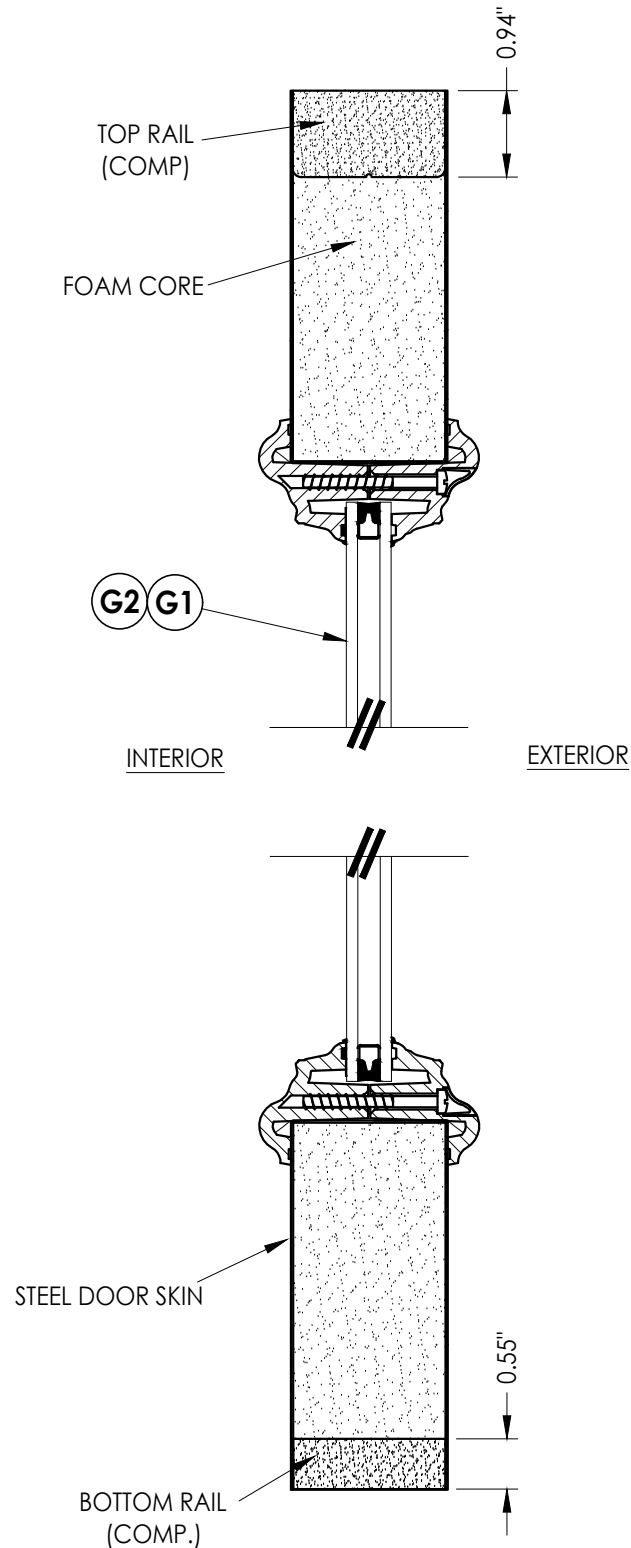

2 4 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
SIDELITE PANEL / GLAZING
DETAILS

REVISIONS			
NO.	DATE	BY	
3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/14/20	UPDATE TO 7TH ED (2020)	FBC LFS

DATE: 10/12/17


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-21131.9

SHEET 4 OF 14

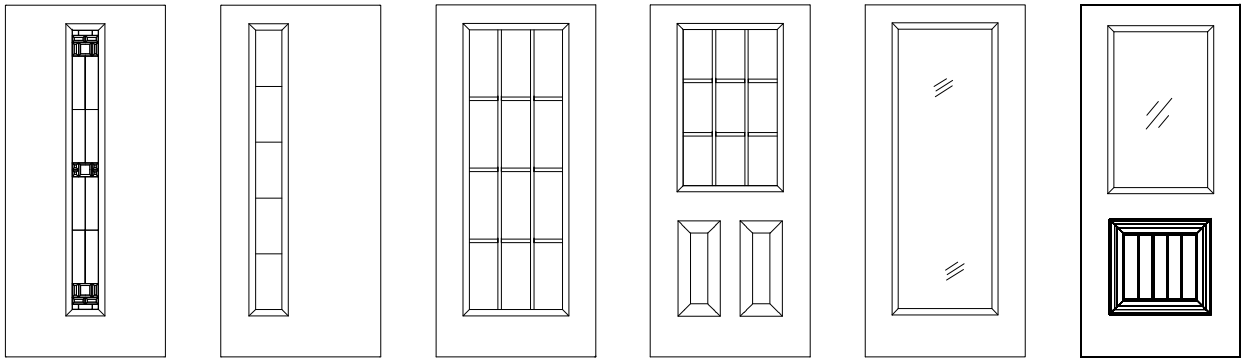

Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

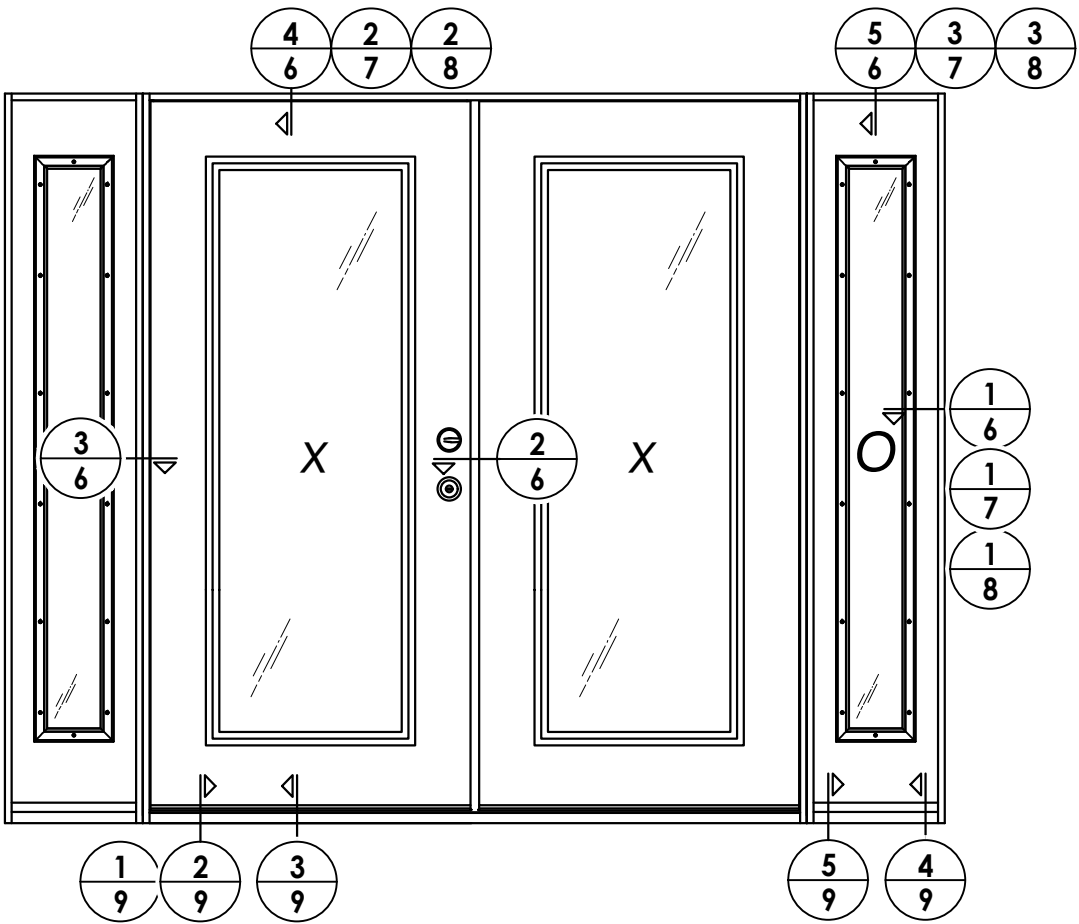

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB: F51 DEADBOLT: B60	
KWIKSET	KNOB: SIGNATURE SERIES DEADBOLT: SIGNATURE SERIES (980)	


[illegible]

PRODUCT:	PART OR ASSEMBLY:
THERMA-TRU STEEL DOOR	ELEVATIONS


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

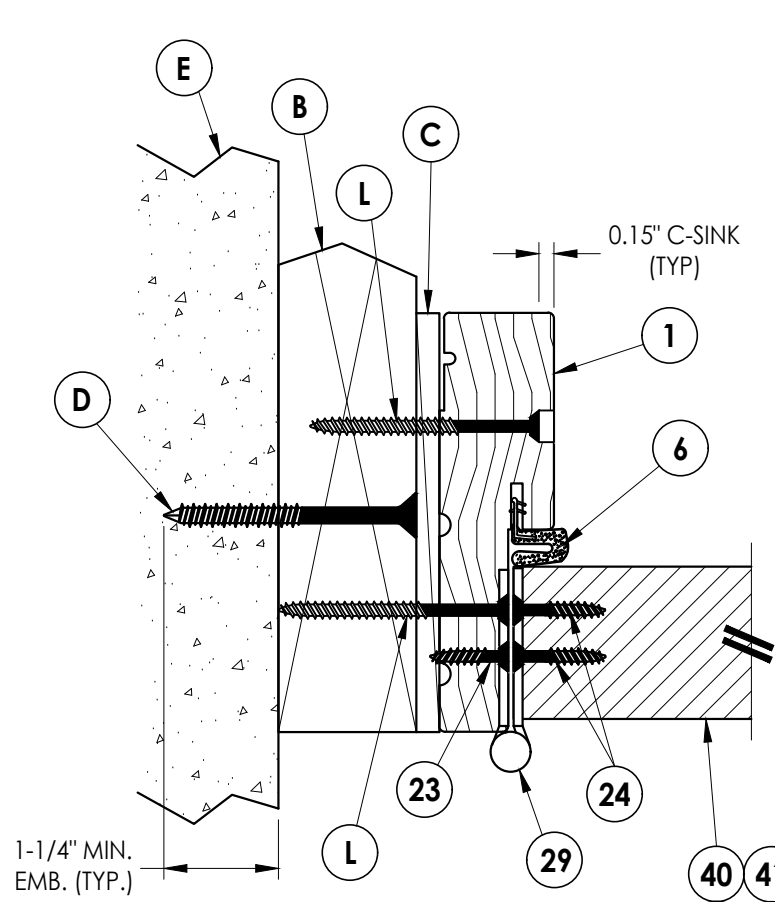


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

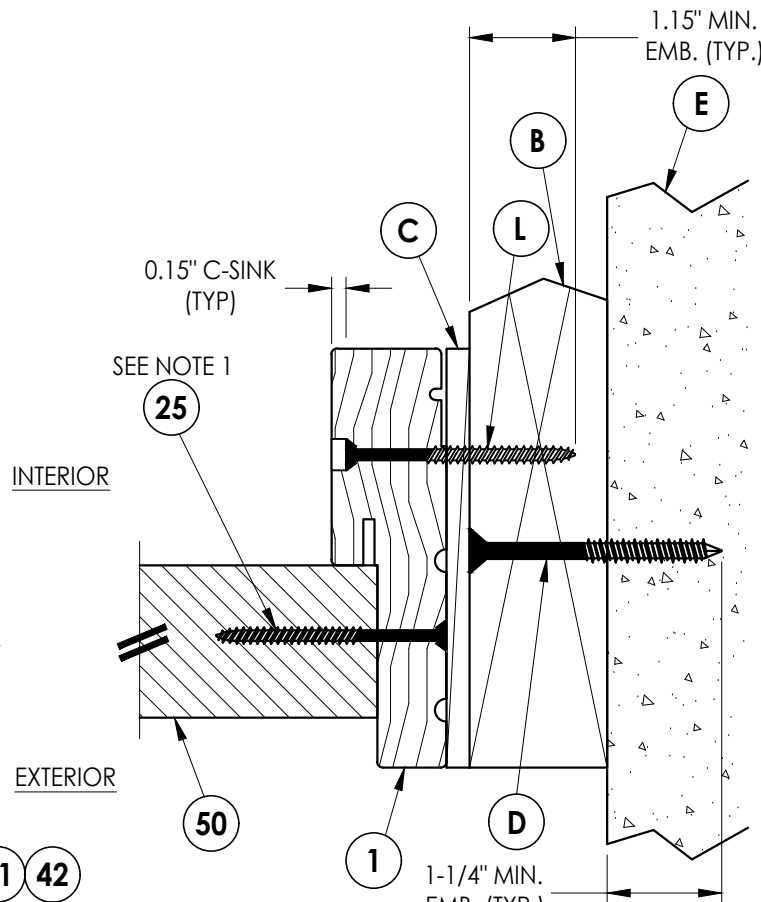

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

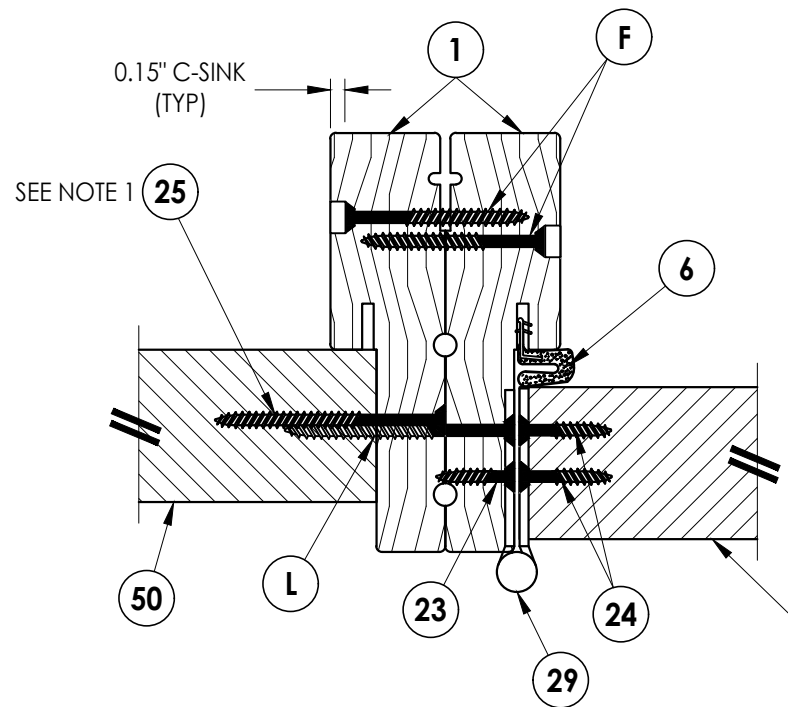


5
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

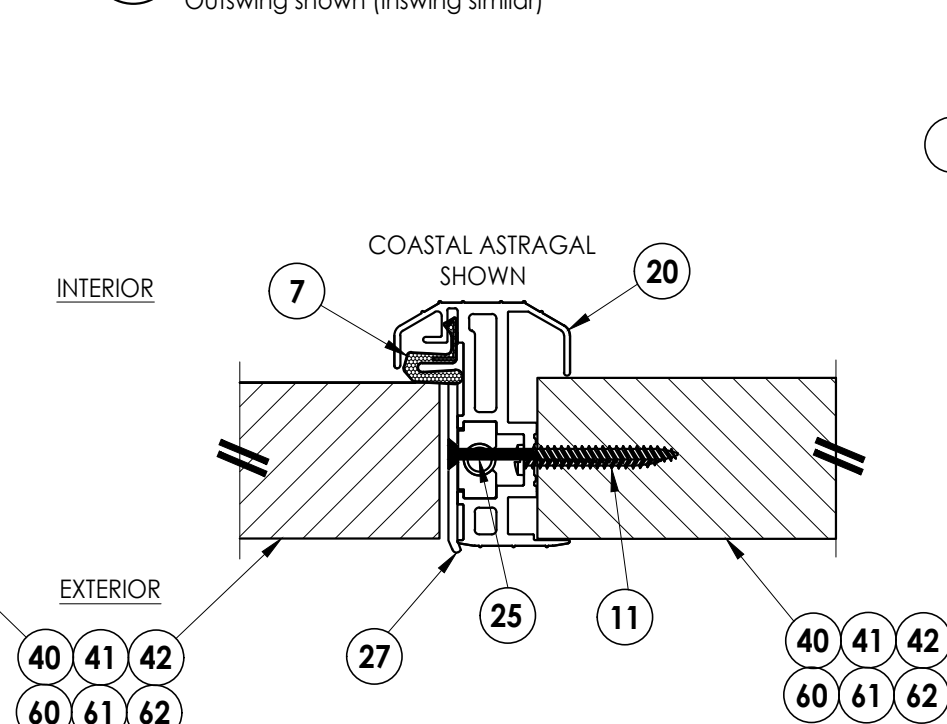


6
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

- Notes:
1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

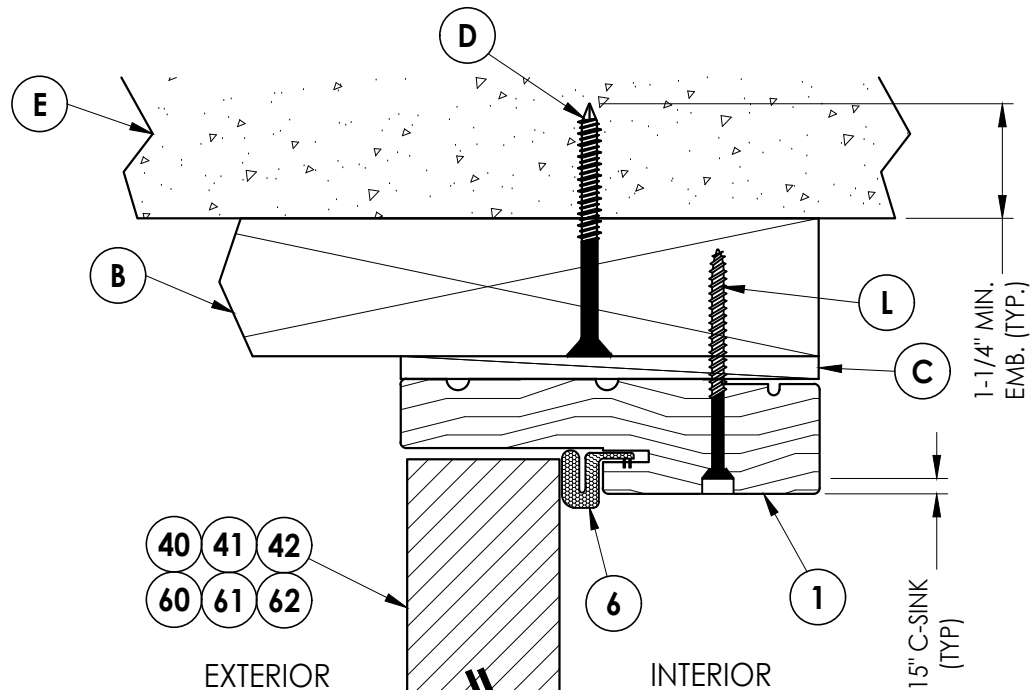

3
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

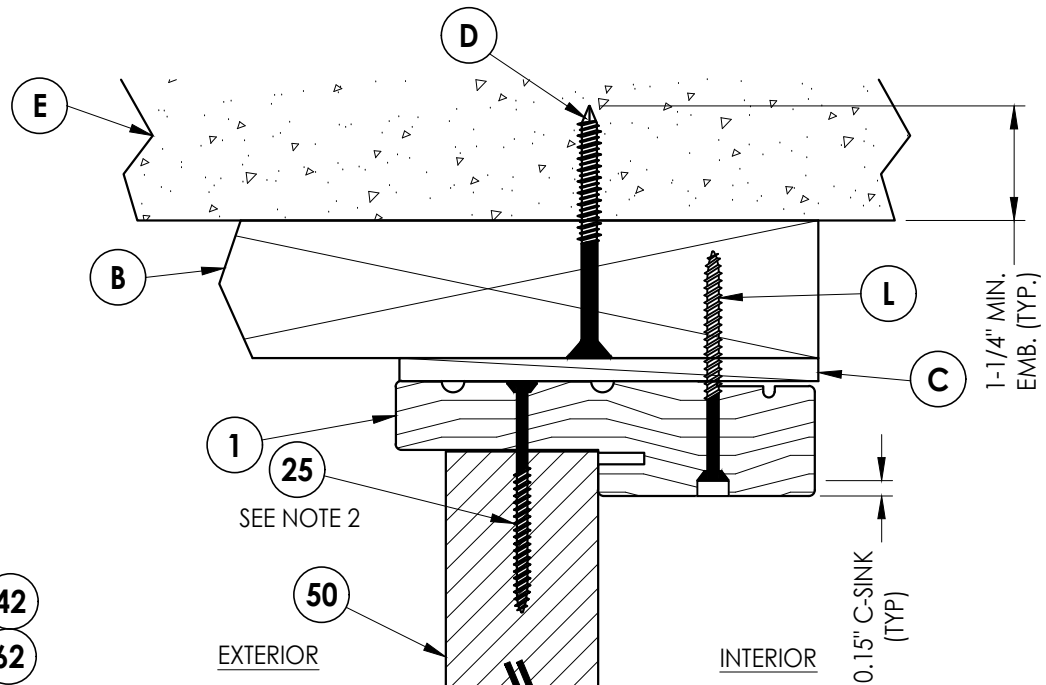

4
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)


		REVISIONS	
NO.	DATE	BY	
3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/14/20	UPDATE TO 7TH ED. (2020)	FBC LFS

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21131.9
SHEET 6 OF 14


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

Notes:


1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

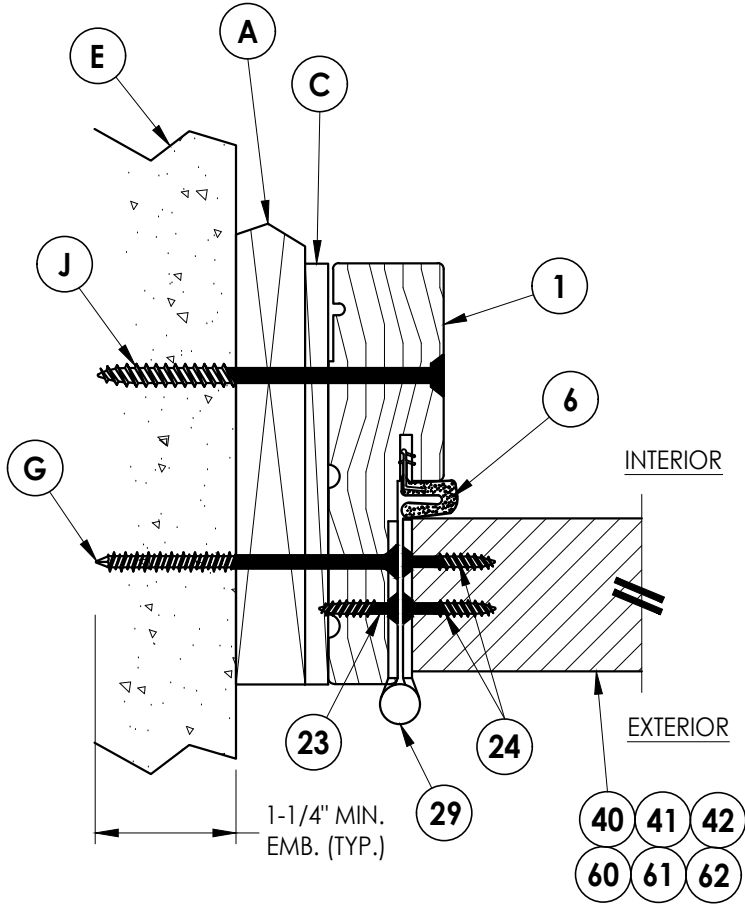


1
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

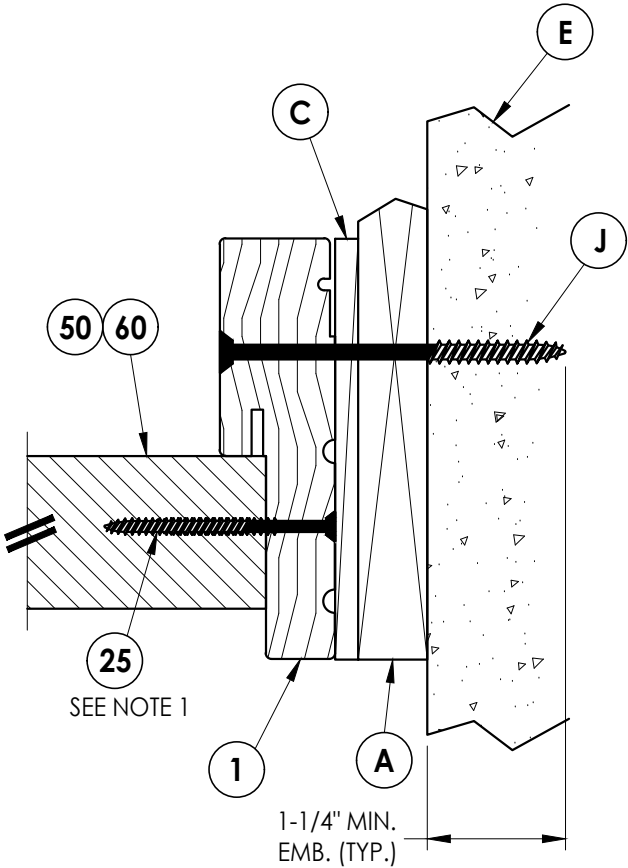

2
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

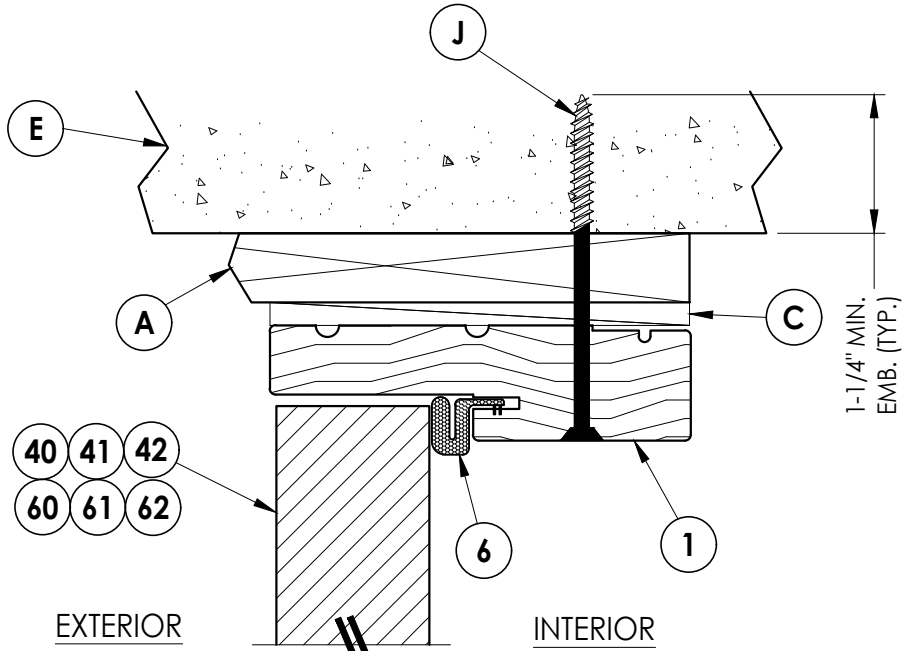

3
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

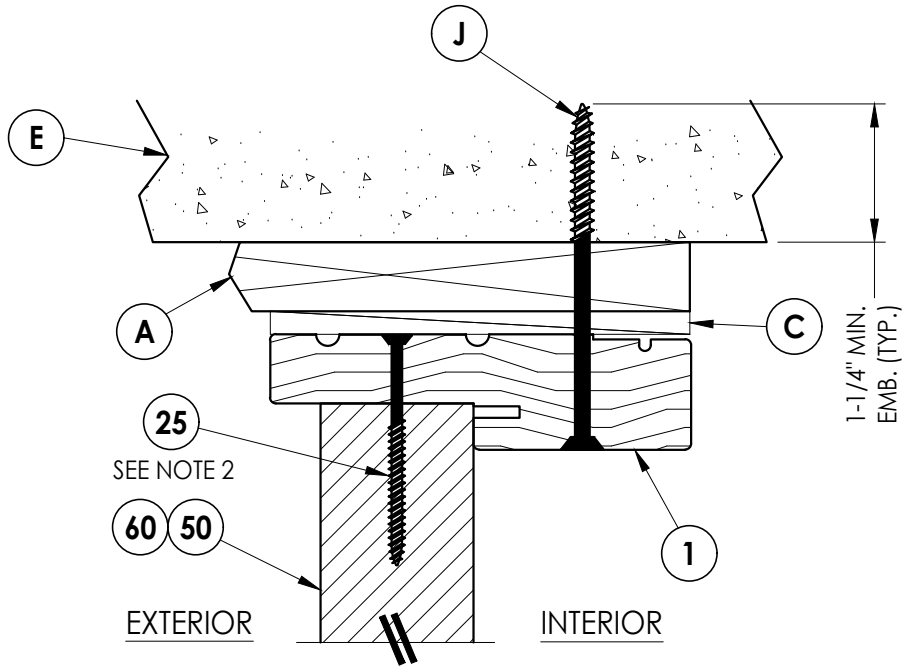

4
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

REVISIONS			
NO.	DATE	BY	
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/14/20	UPDATE TO 7TH ED (2020) FBC	LFS

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-21131.9

SHEET 7 OF 14


Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

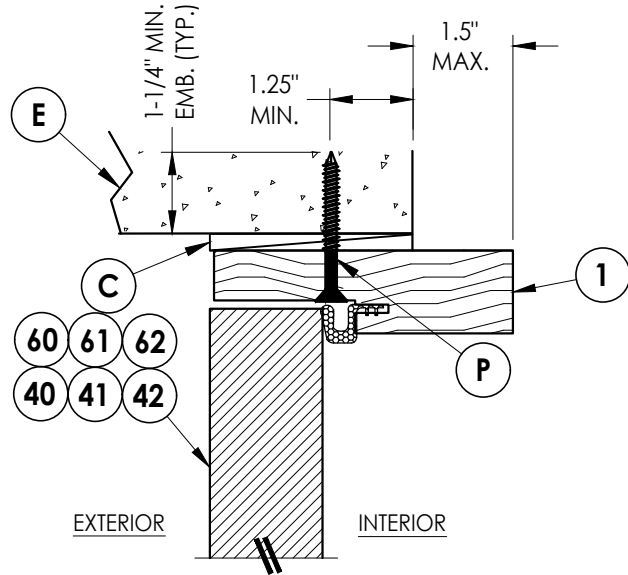

3
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

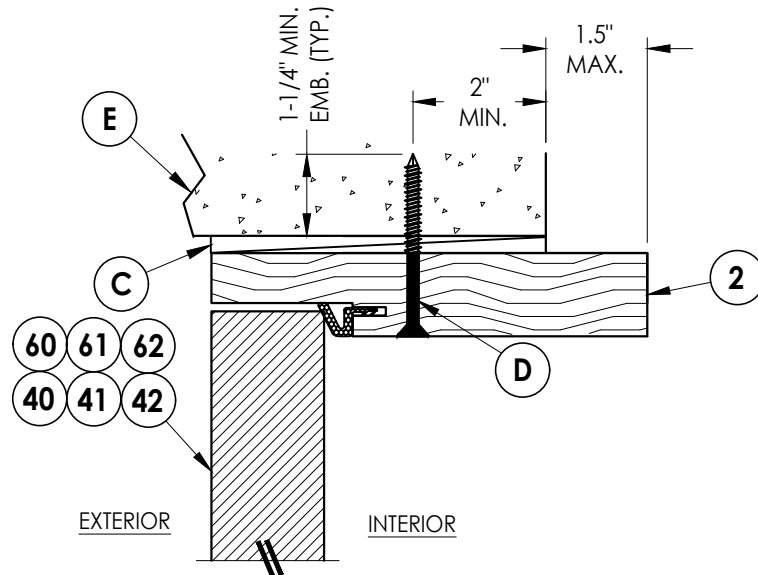


5
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

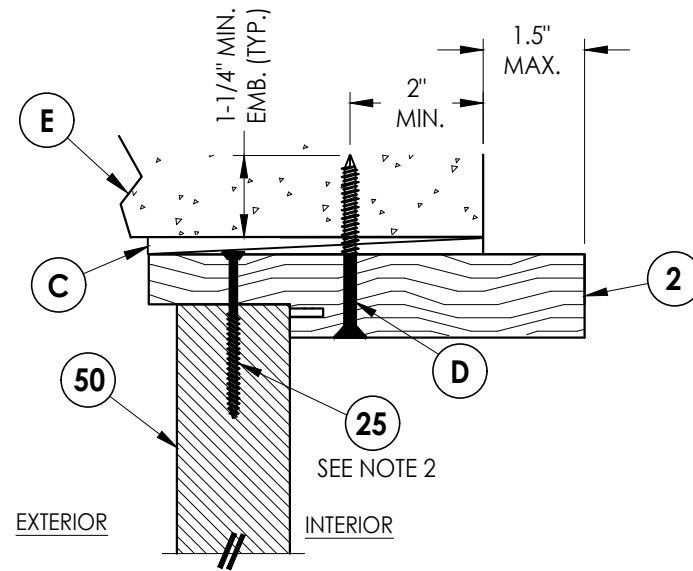


6
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Notes:


1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

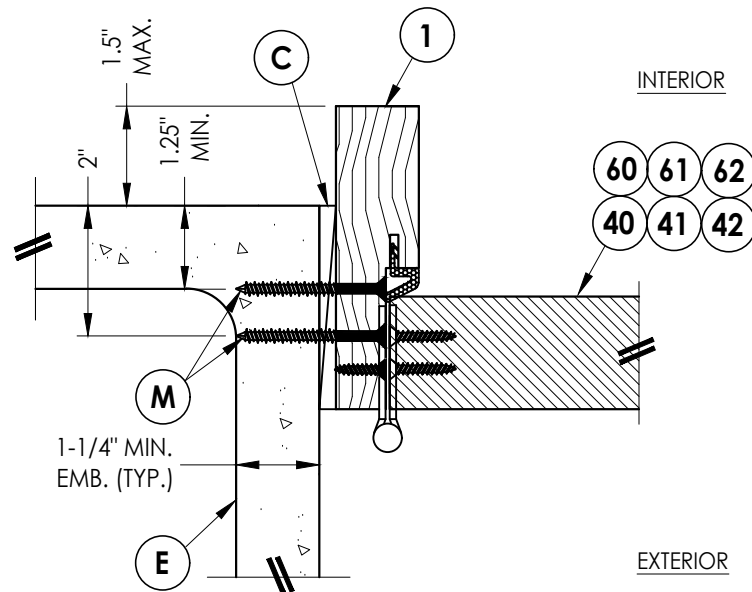

1
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

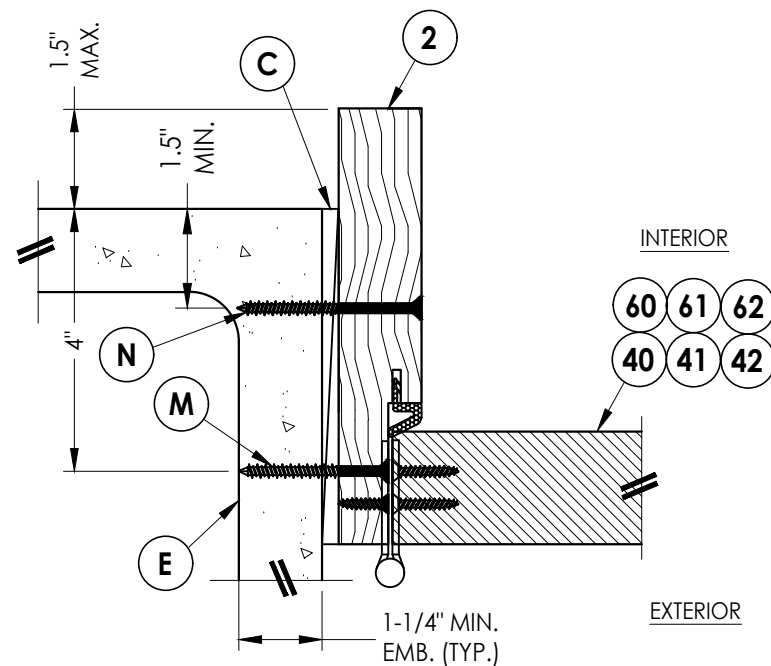

4
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

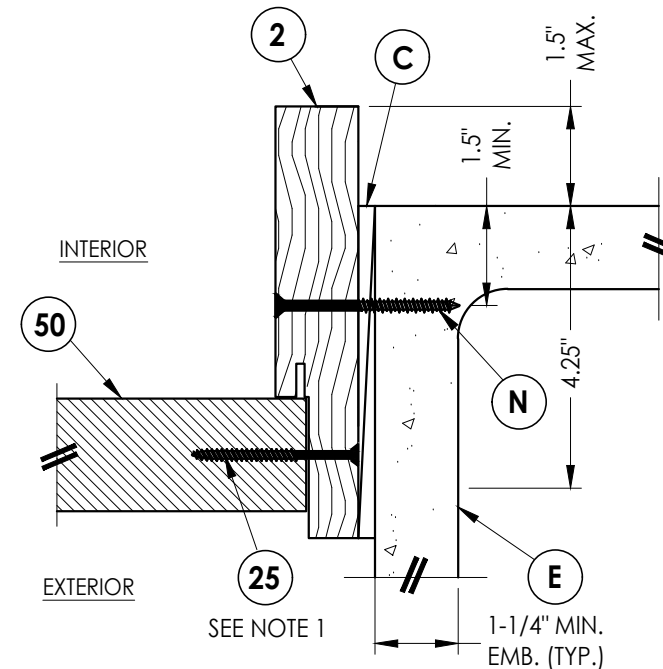

2
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
STEEL DOOR
PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC
1	7/14/20	UPDATE TO 7TH ED (2020) FBC

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK






CHK. BY: LFS

DRAWING NO.: FL-21131.9

SHEET 8 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

- Notes:
- 1. Sill Item #'s 16, 32, 33, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pph screws at each end.
Sill Item #'s 17 & 18 are attached to jambs w/ (2) #8 X 2-1/2" pph screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - 2. Sidelite assembly screws located 4" from each end (2 screws along sill).

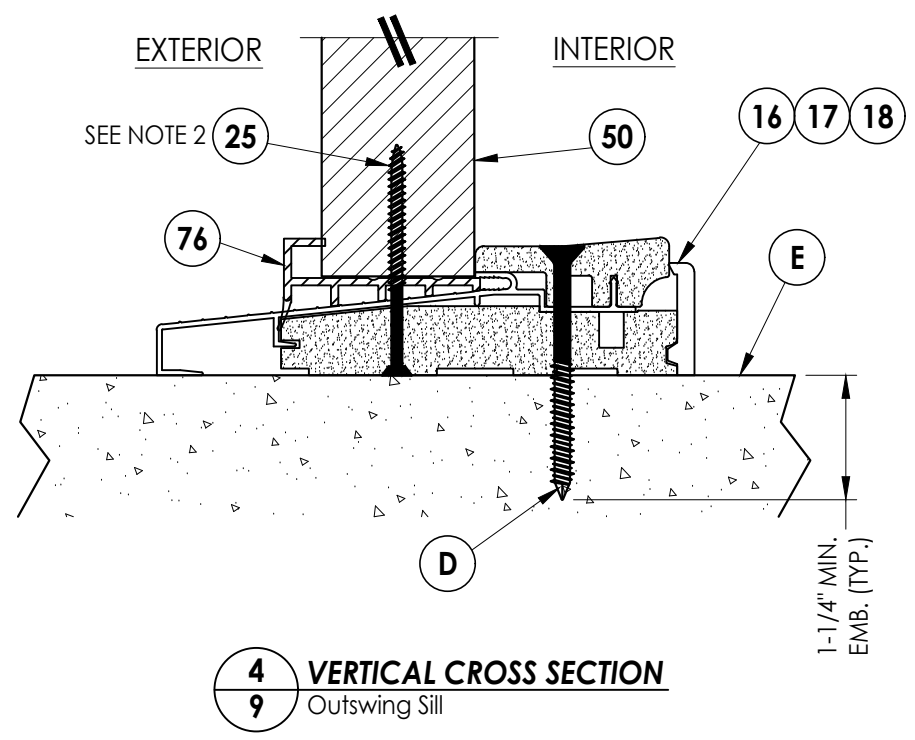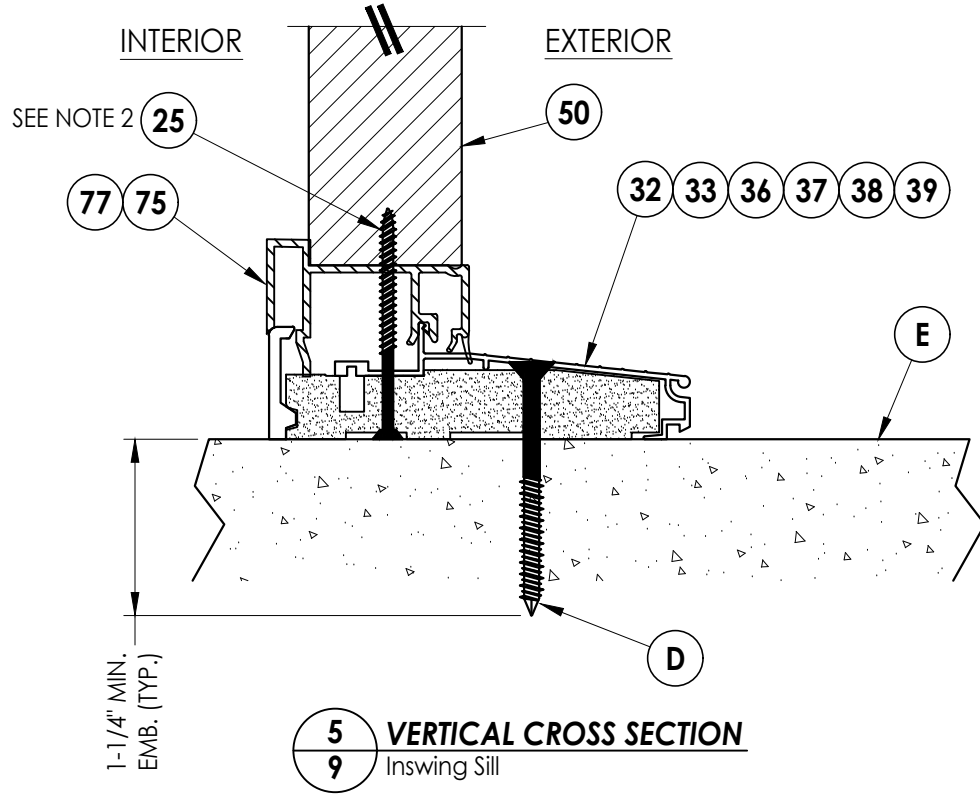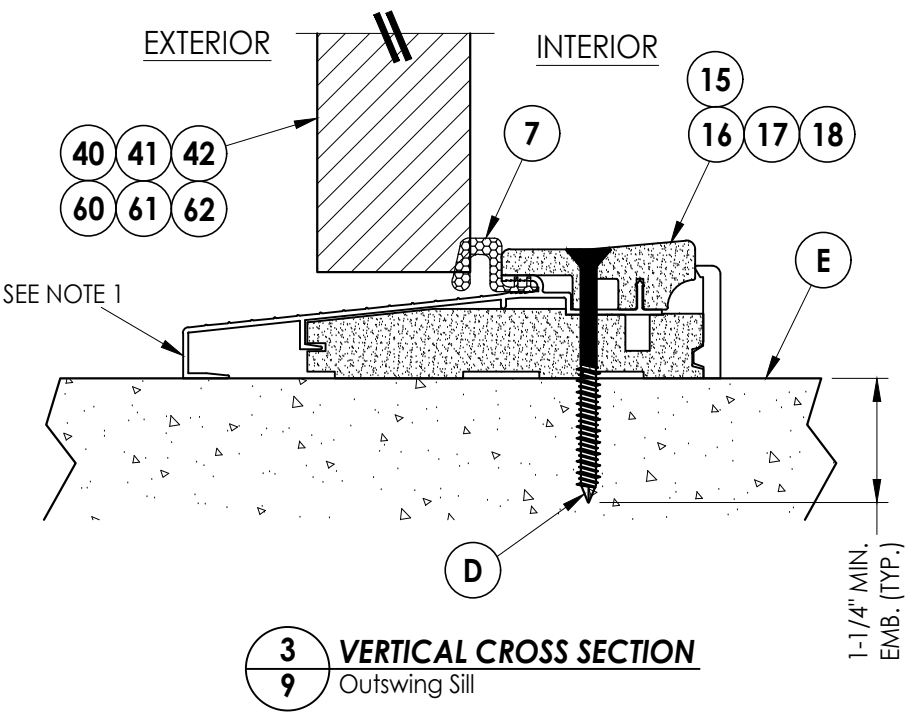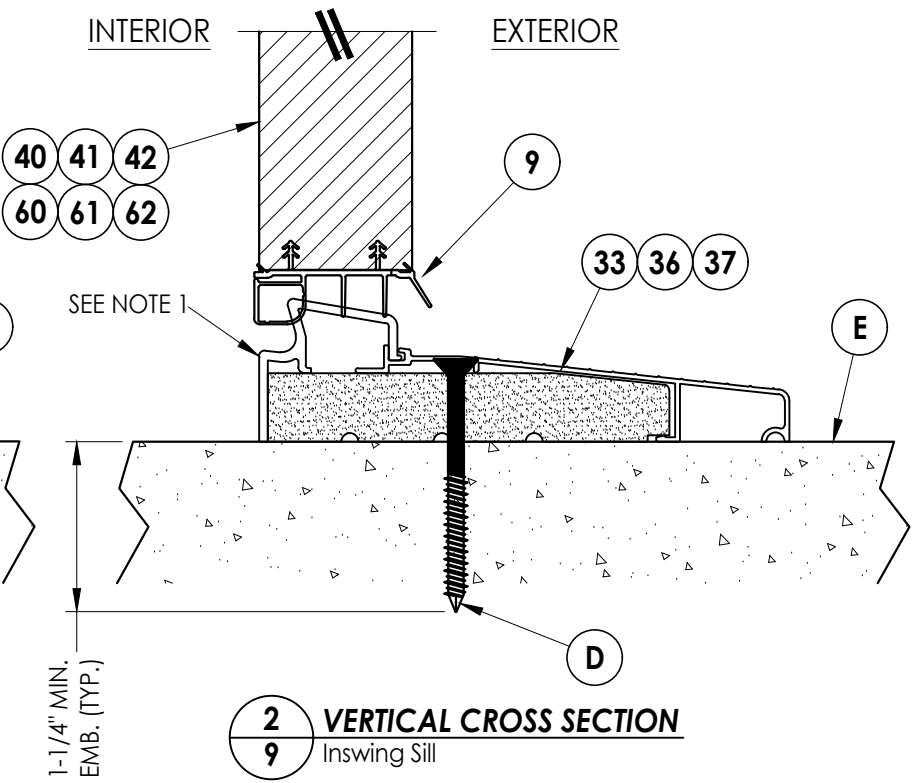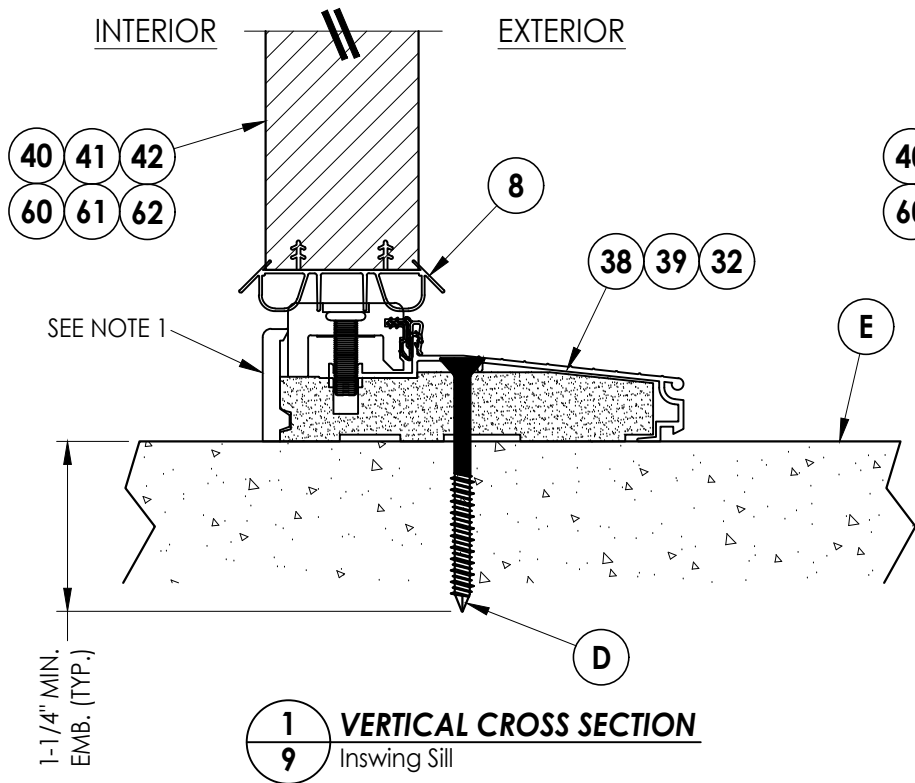



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU STEEL DOOR
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)

REVISIONS			
NO.	DATE	BY	
3	7/03/26	LFS	UPDATE TO 9TH ED. (2026) FBC
2	8/07/23	LFS	UPDATE TO 8TH ED. (2023) FBC
1	7/14/20	LFS	UPDATE TO 7TH ED (2020) FBC

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21131.9
SHEET 9 OF 14

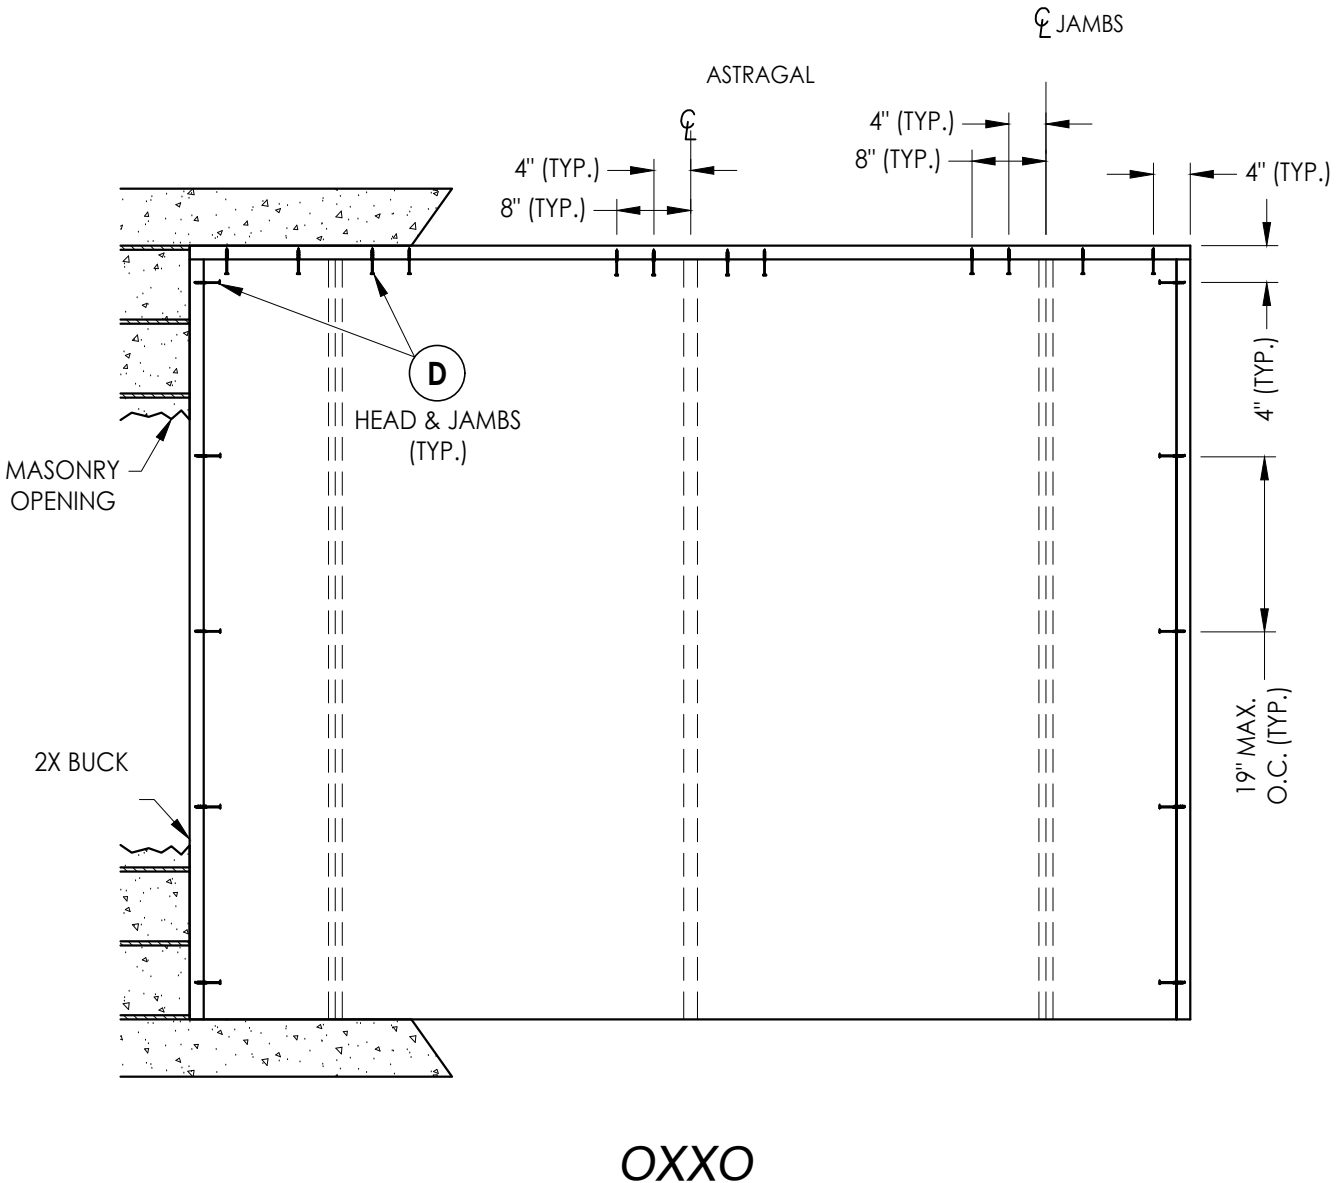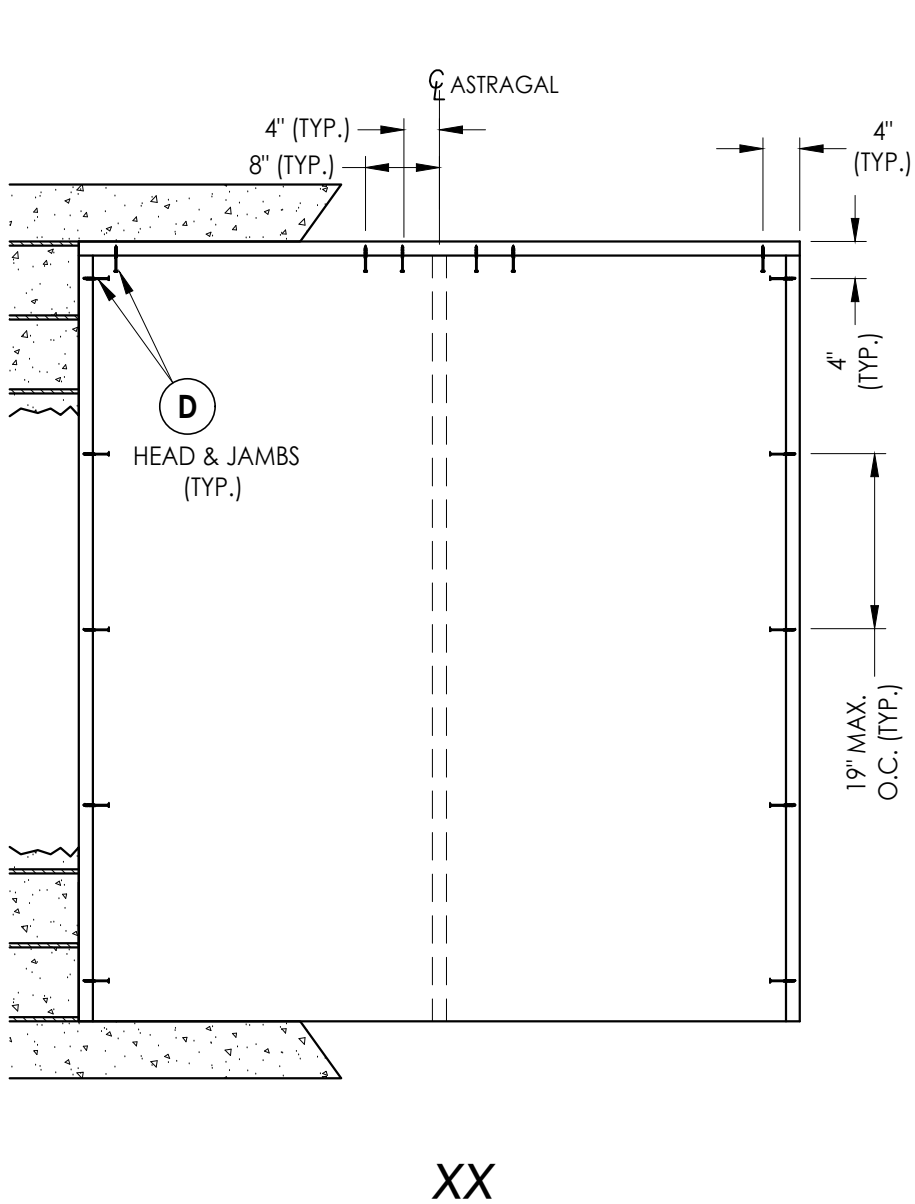

2X BUCK ANCHORING



DATE: 10/12/17	
SCALE: N.T.S.	
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.: FL-21131.9	
SHEET 10 OF 14	
NO.	DATE
	REVISIONS
	3 7/03/26 UPDATE TO 9TH ED. (2026) FBC LFS
	2 8/07/23 UPDATE TO 8TH ED. (2023) FBC LFS
	1 7/14/20 UPDATE TO 7TH ED (2020) FBC LFS

PRODUCT:	THERMA-TRU STEEL DOOR
	PART OR ASSEMBLY: BUCK ANCHORING


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

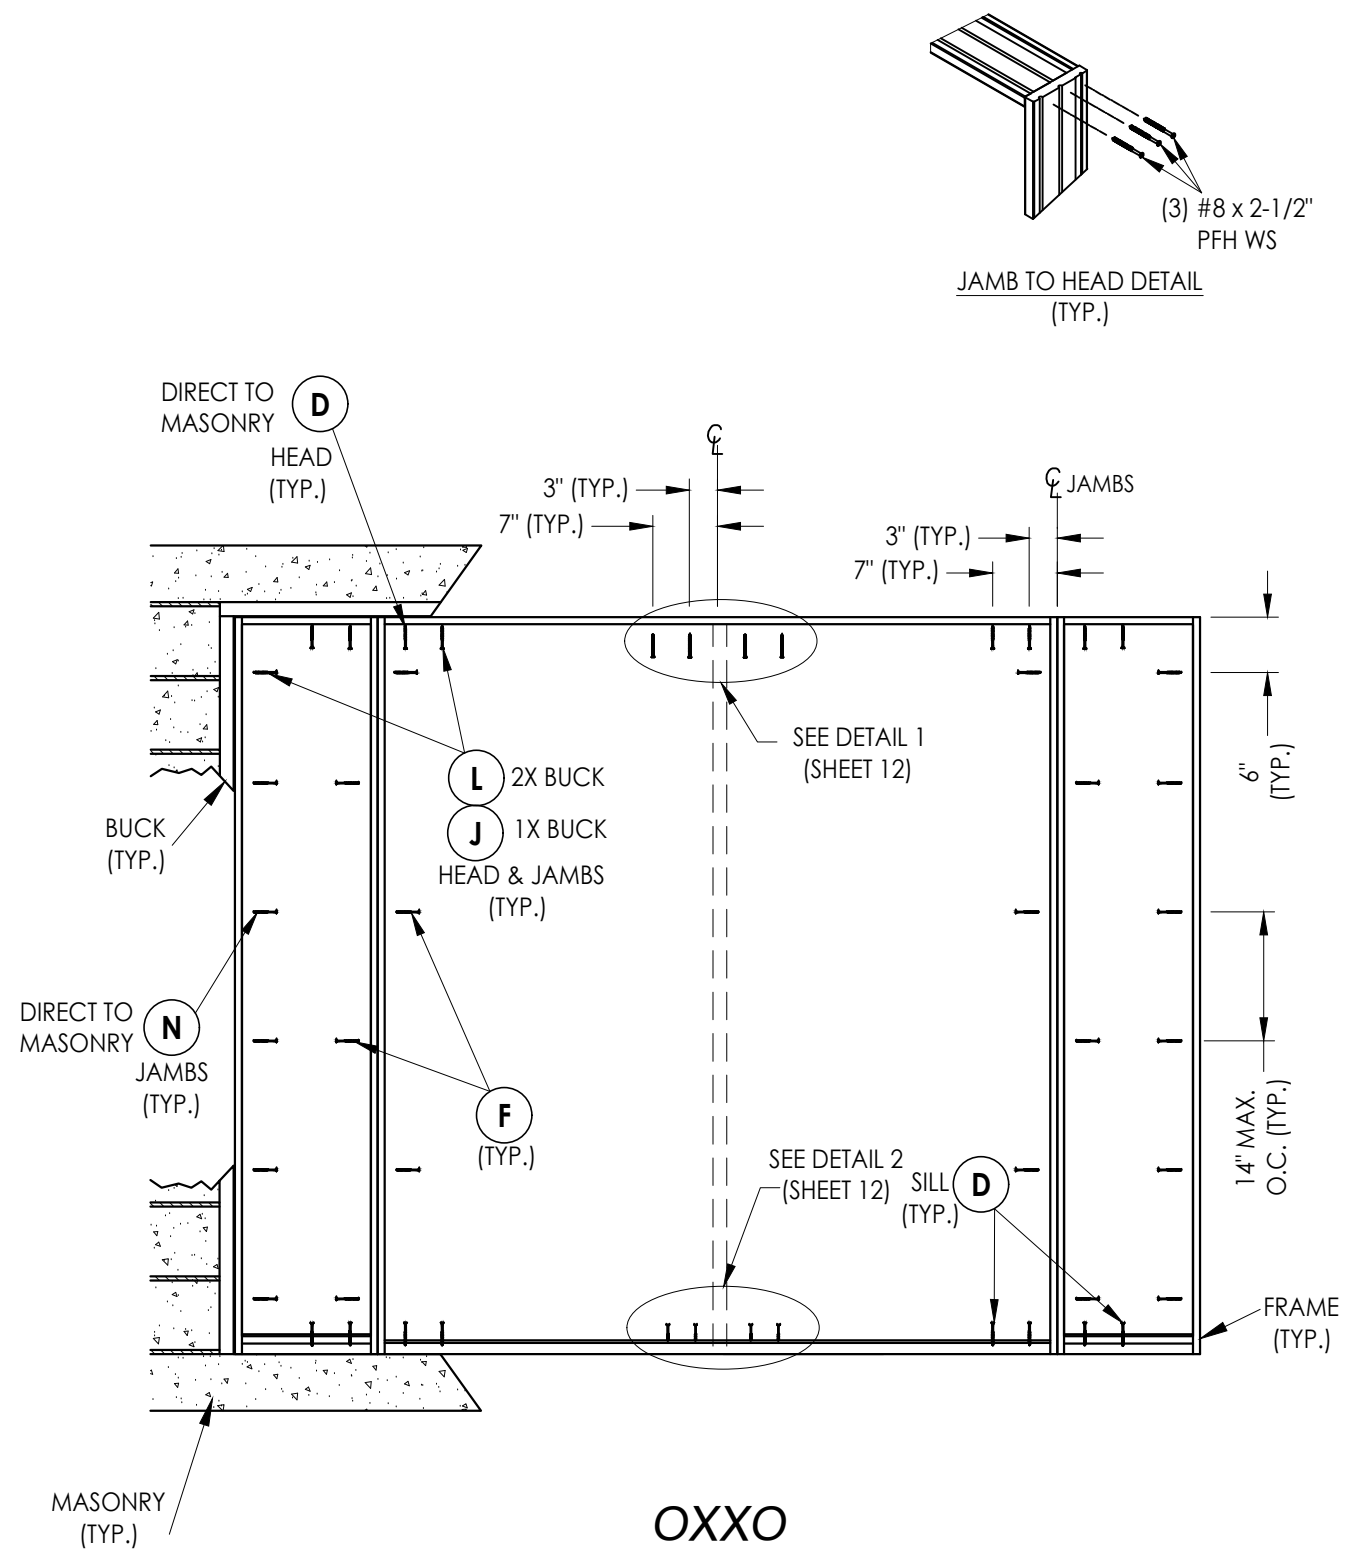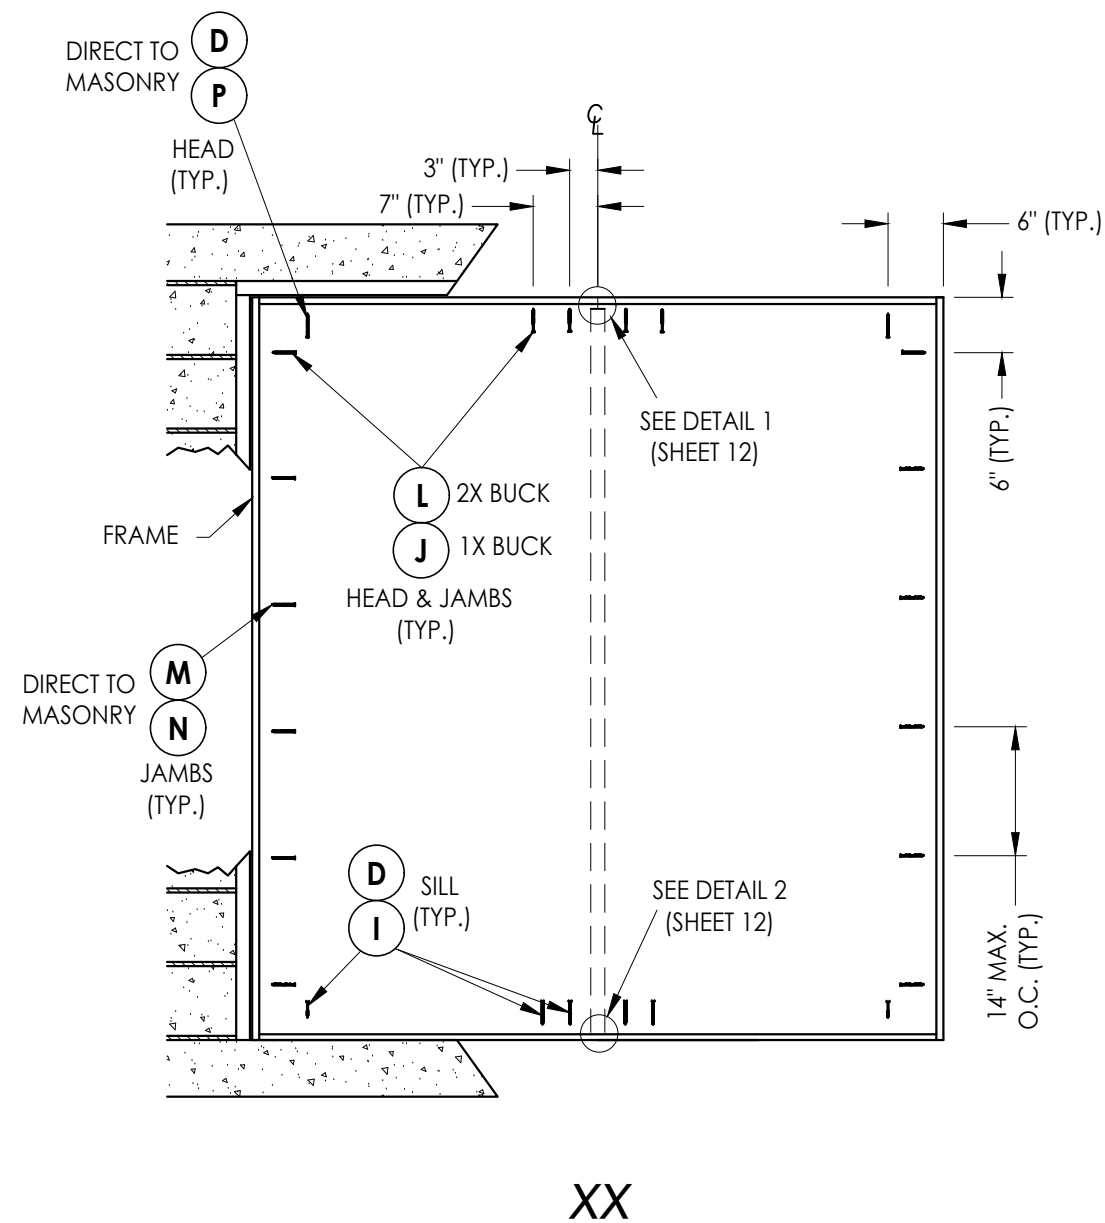

FRAME ANCHORING

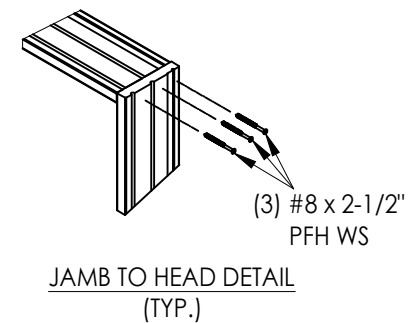


3	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC LFS
2	8/07/23	UPDATE TO 8TH ED.	(2023)	FBC LFS
1	7/14/20	UPDATE TO 7TH ED	(2020)	FBC LFS
NO.	DATE	BY REVISIONS		


DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21131.9
SHEET	11 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

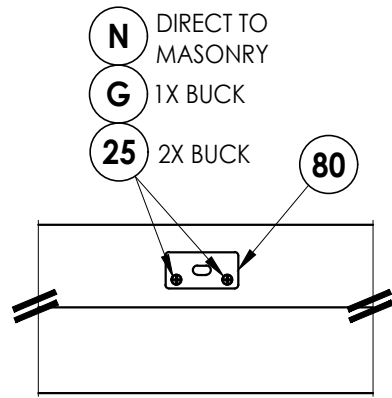


DETAIL 1
Coastal Astragal Strike Plate @ Head

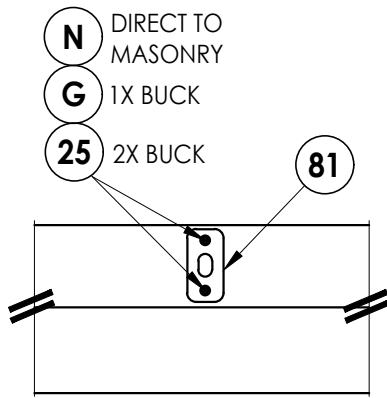


DETAIL 1
Standard Astragal Strike Plate @ Head

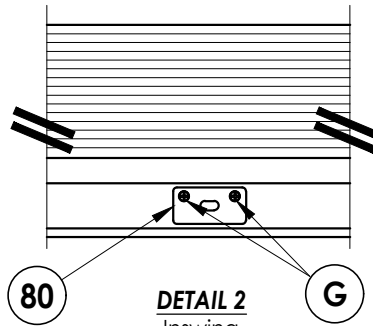


DETAIL 2
Inswing
Coastal Astragal Strike Plate @ Sill

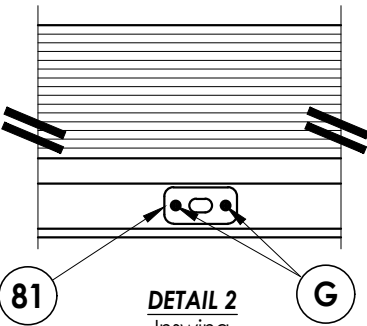


DETAIL 2
Inswing
Standard Astragal Strike Plate @ Sill

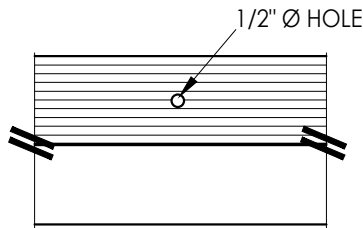


DETAIL 2
Outswing
Astragal Bolt Hole @ Sill

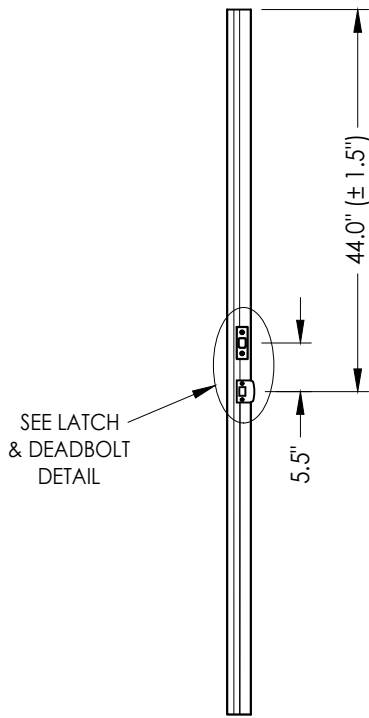


ASTRAGAL
Latch and Deadbolt

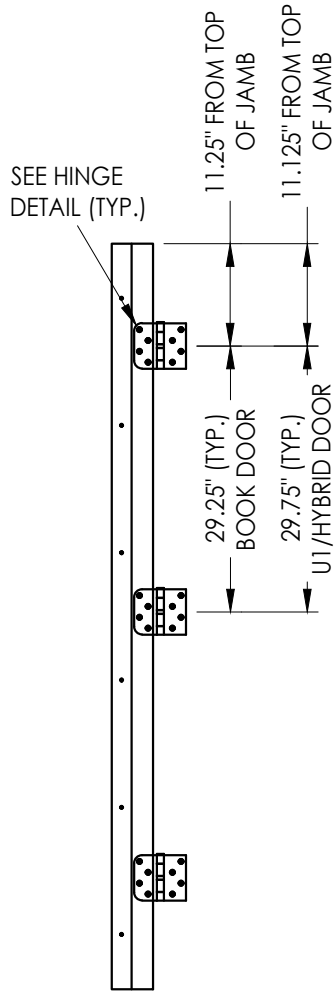

HINGE JAMB

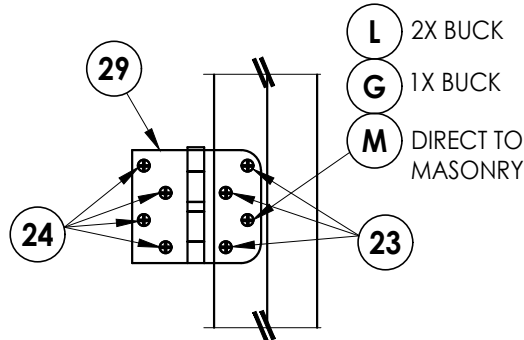

HINGE DETAIL

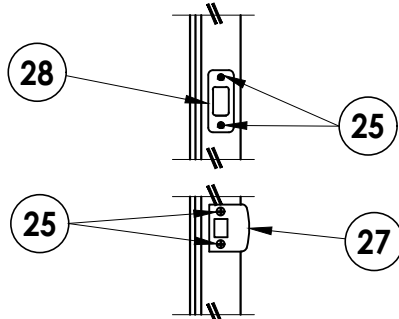

LATCH & DEADBOLT DETAIL
Schlage / Kwikset

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R.W. BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU STEEL DOOR	
PART OR ASSEMBLY: HARDWARE DETAILS	

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/14/20	UPDATE TO 7TH ED. (2020) FBC LFS

DATE: 10/12/17

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21131.9

SHEET 12 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

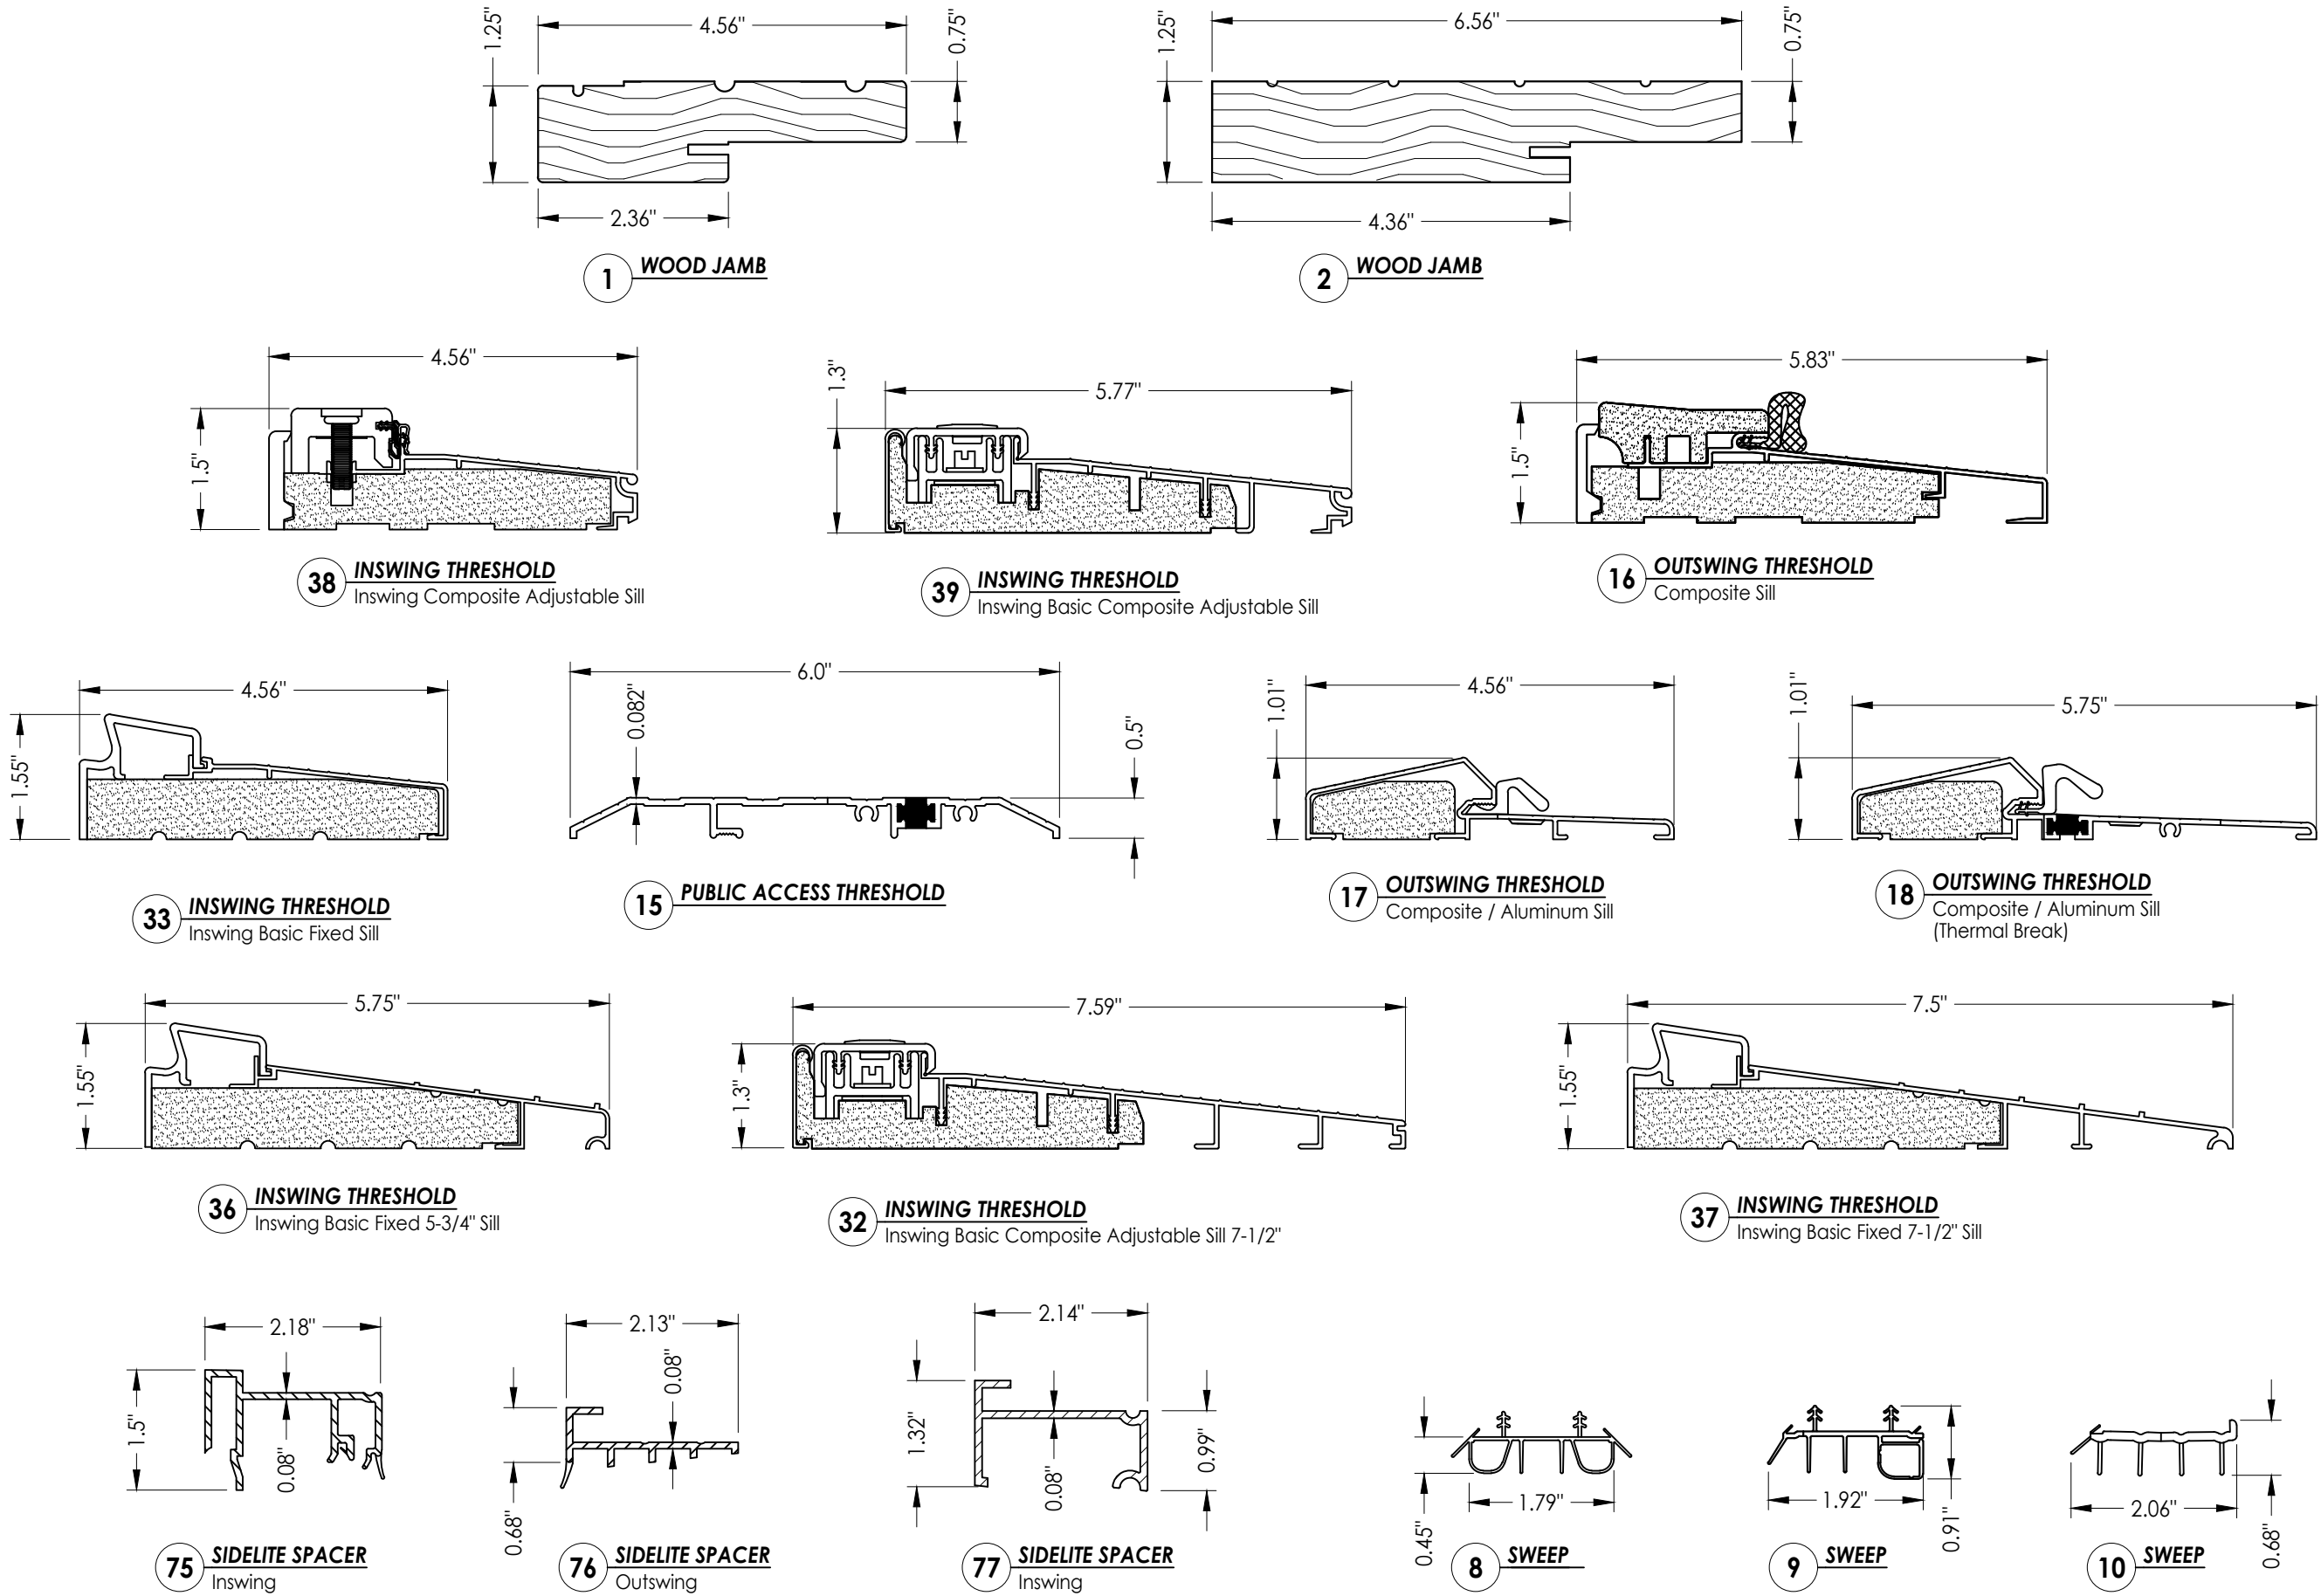

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		R.W. BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU STEEL DOOR		PART OR ASSEMBLY: COMPONENTS	
		LFS	BY
		UPDATE TO 9TH ED. (2026) FBC	
		UPDATE TO 8TH ED. (2023) FBC	
		UPDATE TO 7TH ED (2020) FBC	
		NO.	DATE
REVISIONS			
DATE: 10/12/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21131.9			
SHEET 13 OF 14			

Z:\2023 FBC Drawings\Therma-Tru\FL-21131 R3\FL-21131.7-9.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 X 2" PFH WOOD SCREW	STEEL
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
1	JAMB (FINGER JOINT PINE)	WOOD
2	JAMB (FINGER JOINT PINE)	WOOD
6	WEATHERSTRIP (MEDIUM REACH)	FOAM
7	WEATHERSTRIP (LONG REACH)	FOAM
8	SWEEP	VINYL
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL
11	#8-10 X 1-1/2" PLASCREW	STEEL
12	#6-18 X 1-3/4" PFH SCREW	STEEL
15	PUBLIC ACCESS THRESHOLD	ALUM
16	OUTSWING THRESHOLD	ALUM/COMP
17	OUTSWING THRESHOLD	ALUM/COMP
18	OUTSWING THRESHOLD	ALUM/COMP
22	#8 x 3/4" PFH WOOD SCREW	STEEL
23	#10 x 3/4" PFH WOOD SCREW	STEEL
24	#10 x 1" PFH WOOD SCREW	STEEL

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
26	#8 x 5/8" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE	STEEL
28A	DEADBOLT SUB STRIKE PLATE	STEEL
29	4" X 4" HINGE	STEEL
32	INSWING THRESHOLD	ALUM/COMP
33	INSWING THRESHOLD	ALUM/COMP
36	INSWING THRESHOLD	ALUM/COMP
37	INSWING THRESHOLD	ALUM/COMP
38	INSWING THRESHOLD	ALUM/COMP
39	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL (BOOK) - "PROFILES" SERIES	-
41	DOOR PANEL (HYBRID) - "PROFILES" SERIES	-
42	DOOR PANEL (U1) - "PROFILES" SERIES	-
50	SIDELITE (FULL LITE)	-
60	DOOR PANEL (BOOK) - "TRADITIONS" SERIES	-
61	DOOR PANEL (HYBRID) - "TRADITIONS" SERIES	-
62	DOOR PANEL (U1) - "TRADITIONS" SERIES	-
75	SIDELITE SPACER (INSWING)	PVC
76	SIDELITE SPACER (OUTSWING)	PVC
77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

- CONCRETE ANCHOR NOTES:**
- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
 - Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
 - Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

- WOOD SCREW INSTALLATION NOTES:**
- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:

THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

BILL OF MATERIALS

REVISIONS

NO.	DATE	BY
3	7/03/26	LFS
2	8/07/23	LFS
1	7/14/20	LFS

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21131.9

SHEET 14 OF 14

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.