

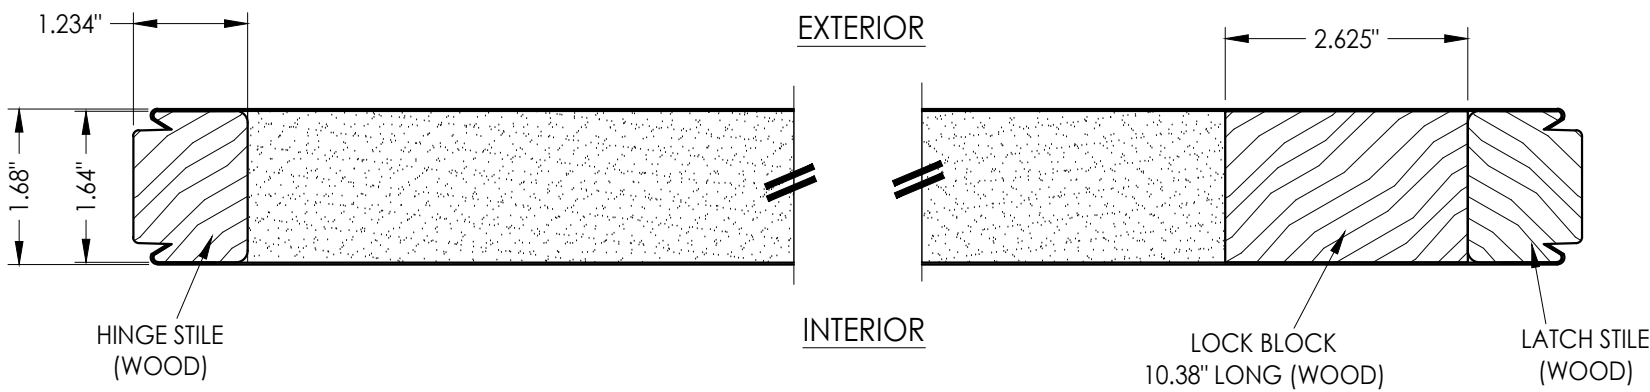


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

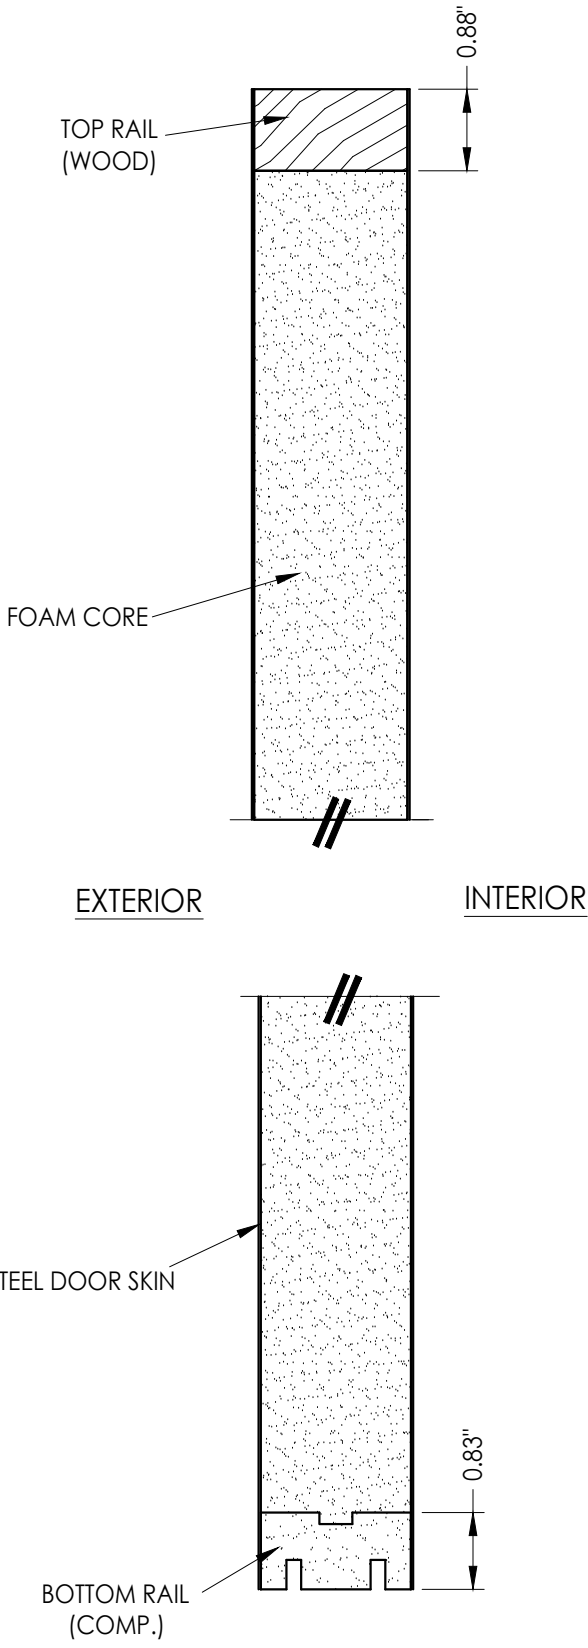

1
2 **HORIZONTAL CROSS SECTION**

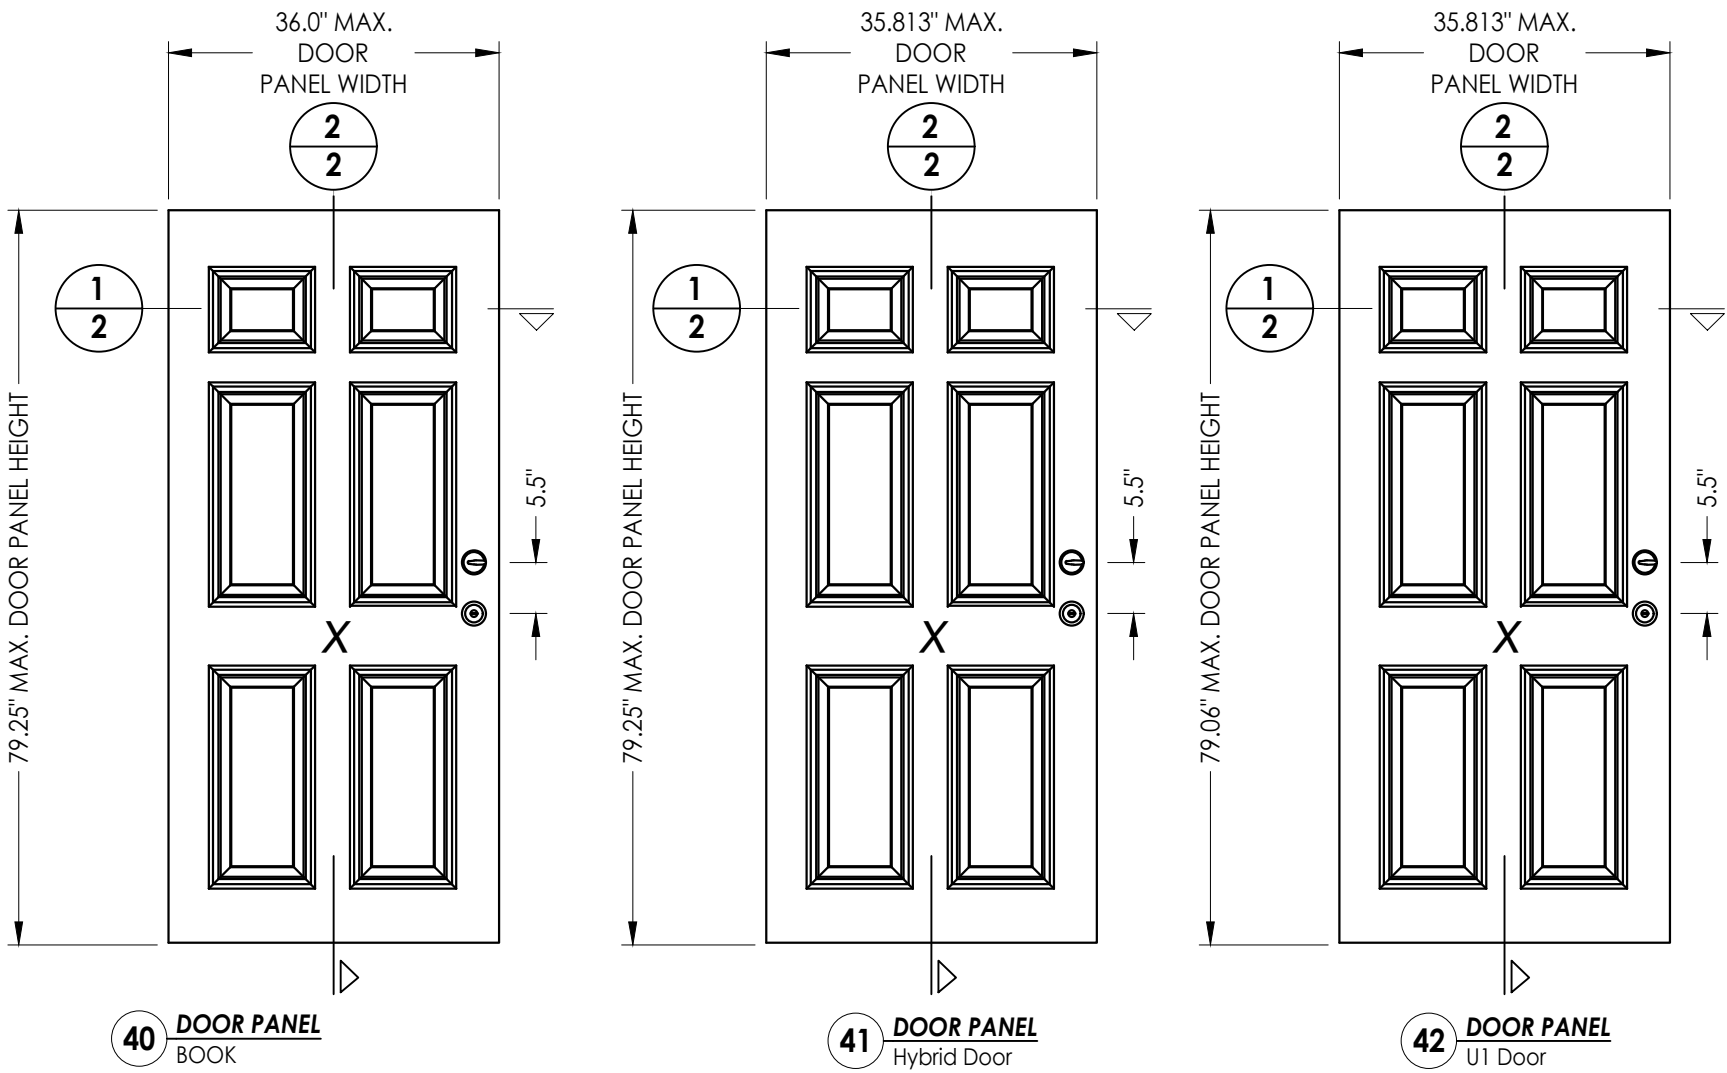


2
2 **VERTICAL CROSS SECTION**



"PROFILES" SERIES DOOR PANEL
STEEL DOOR SKIN: 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU STEEL DOOR		PART OR ASSEMBLY: "PROFILES" DOOR PANEL DETAILS	
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC	LFS
NO.	DATE		BY
			REVISIONS
DATE: 10/11/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21132.3			
SHEET 2 OF 14			

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

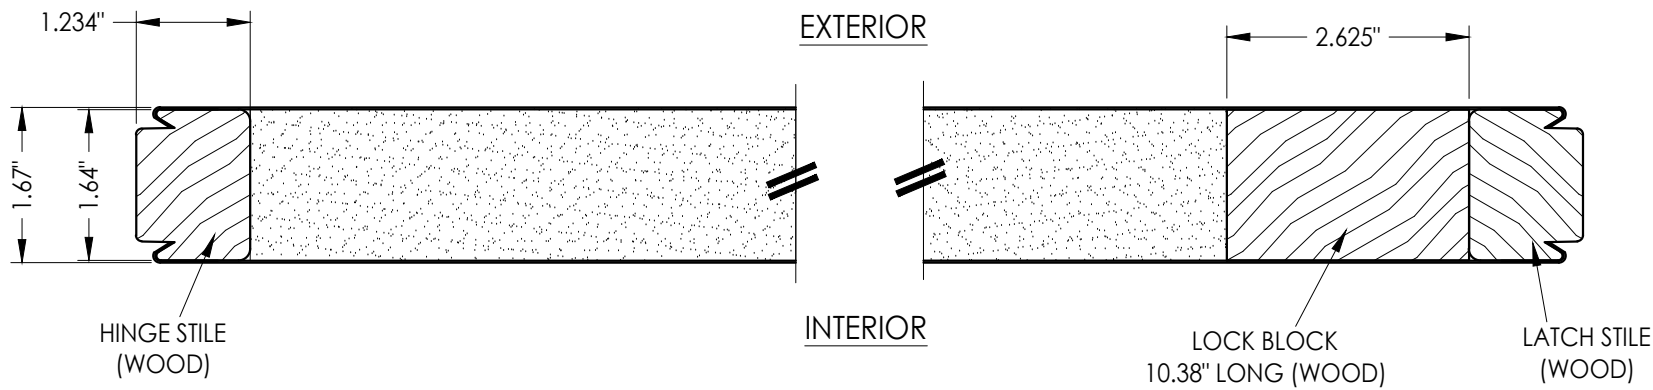

1
3 HORIZONTAL CROSS SECTION

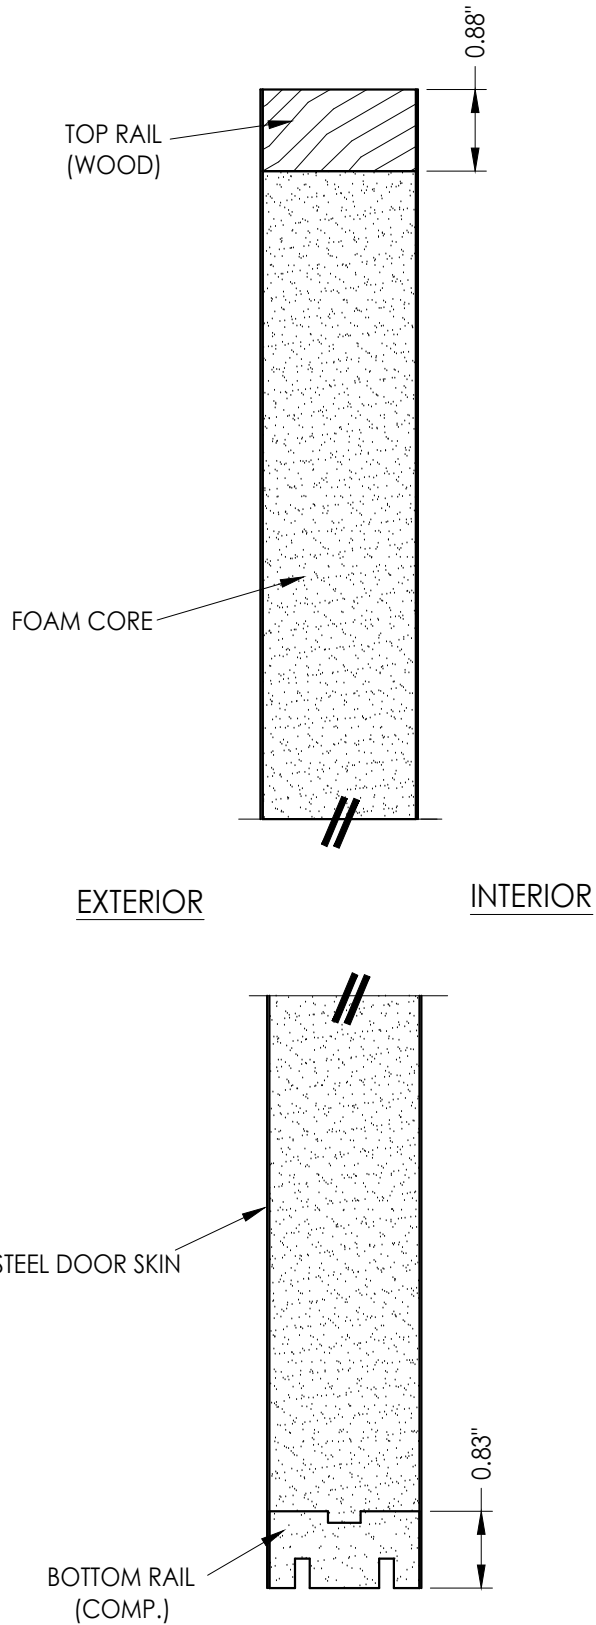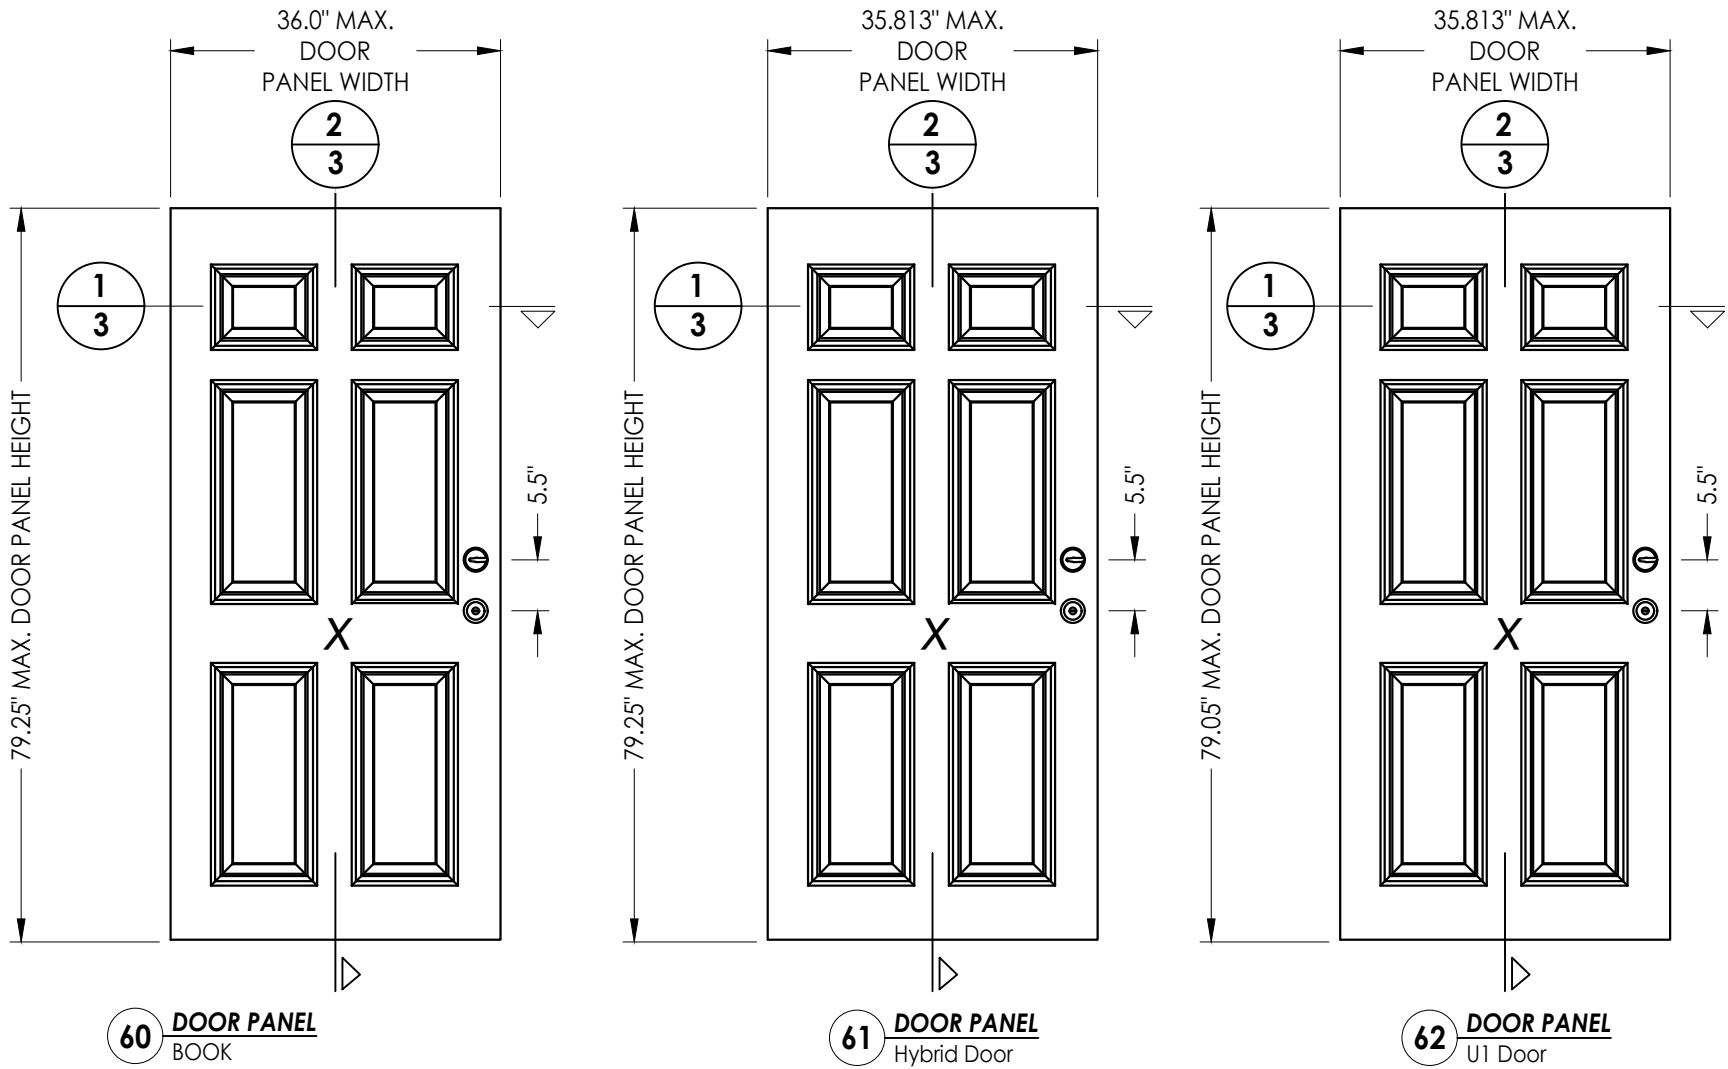

2
3 VERTICAL CROSS SECTION

"TRADITIONS" SERIES DOOR PANEL

STEEL DOOR SKIN: 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	THERMA-TRU STEEL DOOR
PART OR ASSEMBLY:	"TRADITIONS" DOOR PANEL DETAILS

NO.	DATE	REVISIONS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC
1	7/20/20	UPDATE TO 7th ED (2020) FBC
		BY

DATE:	10/11/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21132.3
SHEET	3 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

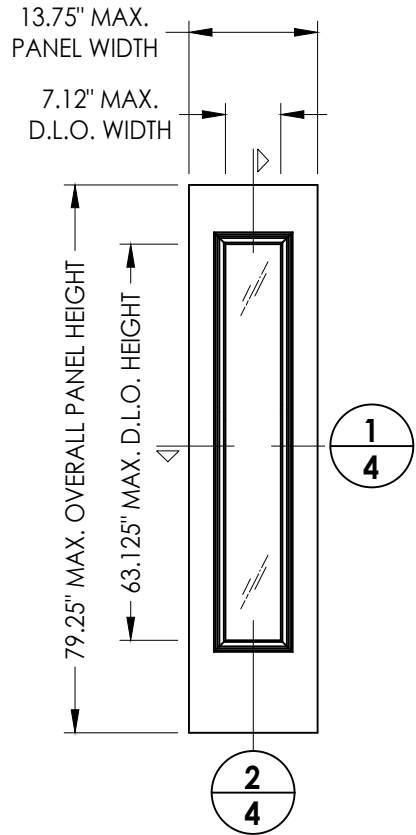


50 SIDELITE PANEL


NOTE:
1. Spacing for item #11 & #12 (lite frame screws) is as follows: From the top down on sides; 3", 14.75", 26.5", 38.25", 50.5" & 62.25". There are (2) screws both top and bottom at 4.25" in from each corner.

SIDELITE PANEL


STEEL SKIN "PROFILES": 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)
STEEL SKIN "TRADITIONS": 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)
SIDELITE WOOD COMPONENTS: PINE (SG >= 0.42)

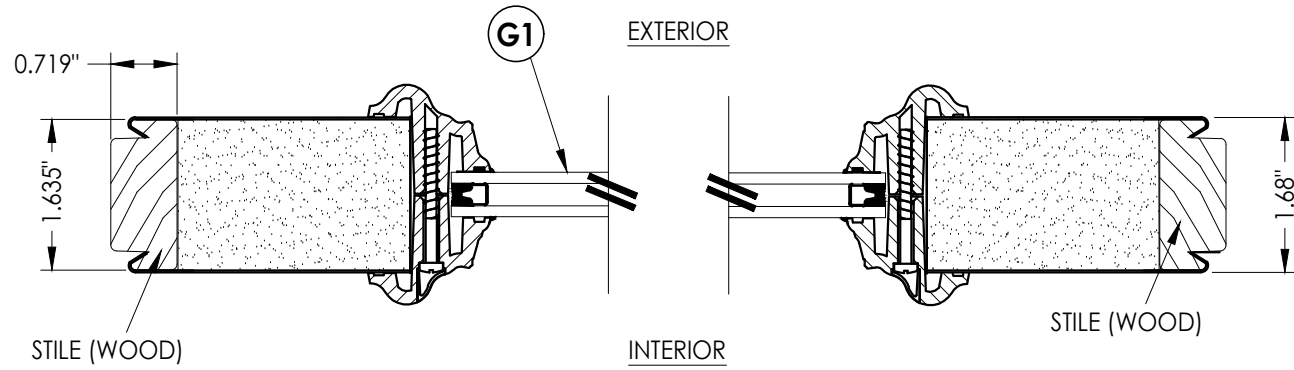


1 4 HORIZONTAL CROSS SECTION

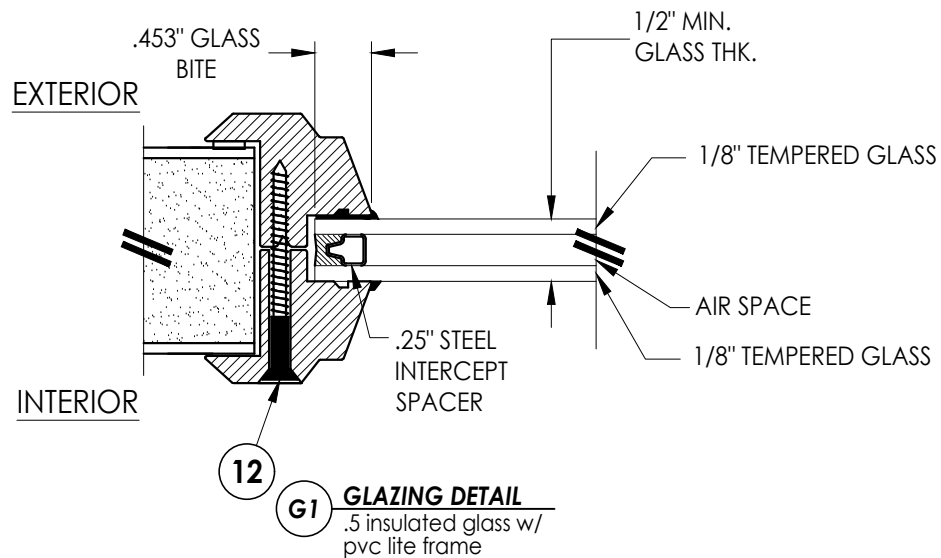

12 GLAZING DETAIL
.5 insulated glass w/
pvc lite frame

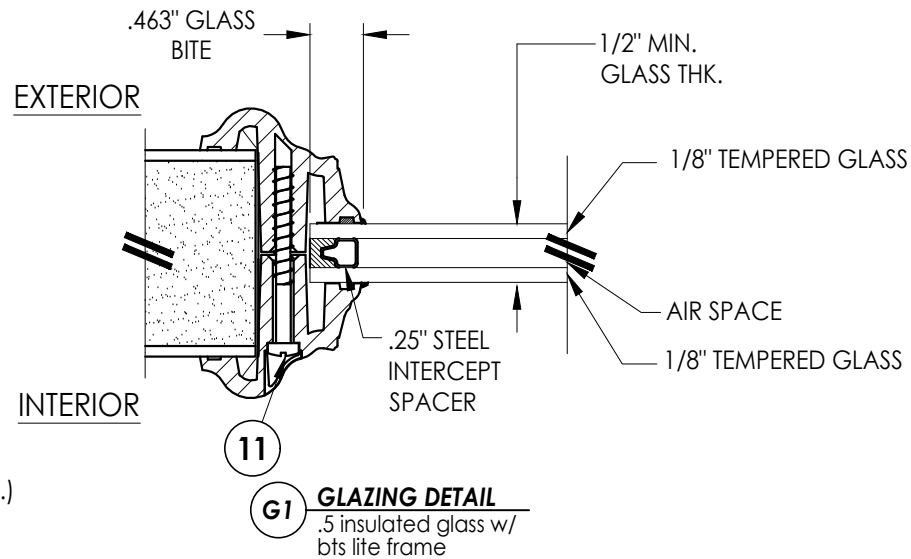


11 GLAZING DETAIL
.5 insulated glass w/
bts lite frame

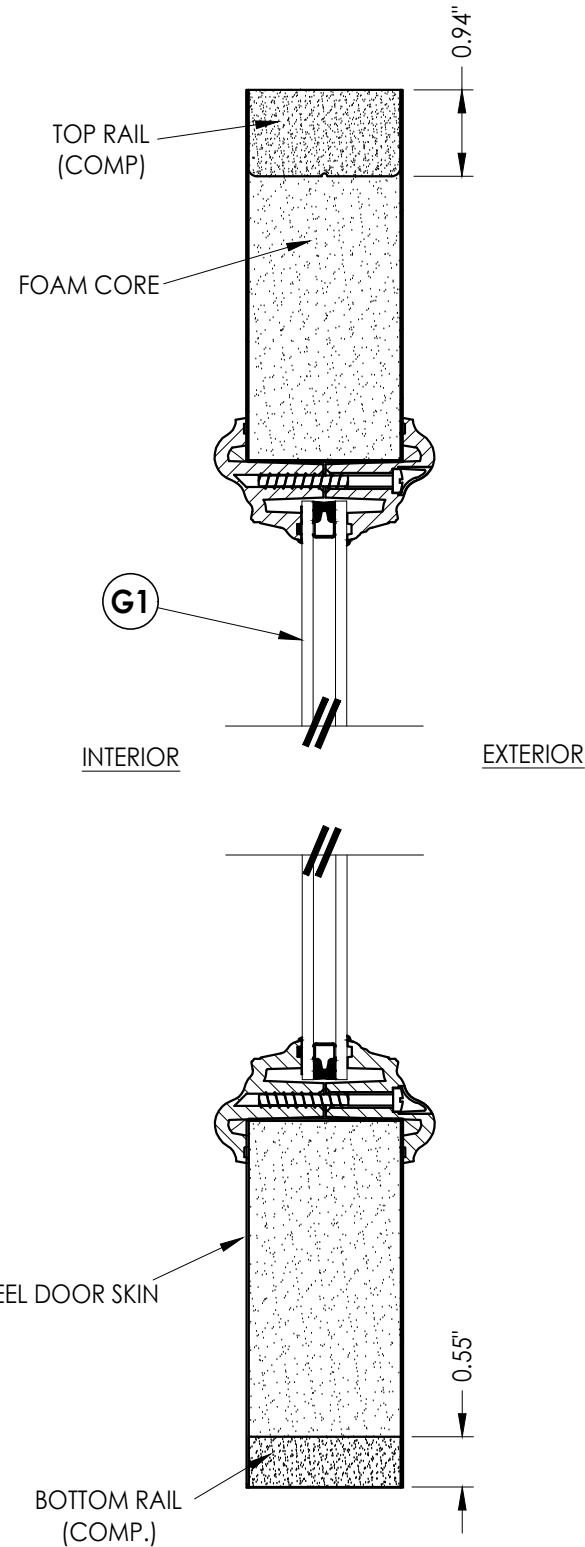


2 4 VERTICAL CROSS SECTION

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU STEEL DOOR		PART OR ASSEMBLY: SIDELITE PANEL / GLAZING DETAILS	
		LFS	BY
		FBC	
2	8/07/23	UPDATE TO 8TH ED. (2023)	
1	7/20/20	UPDATE TO 7th ED (2020)	
NO.	DATE		
REVISIONS			
DATE: 10/11/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21132.3			
SHEET 4 OF 14			


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

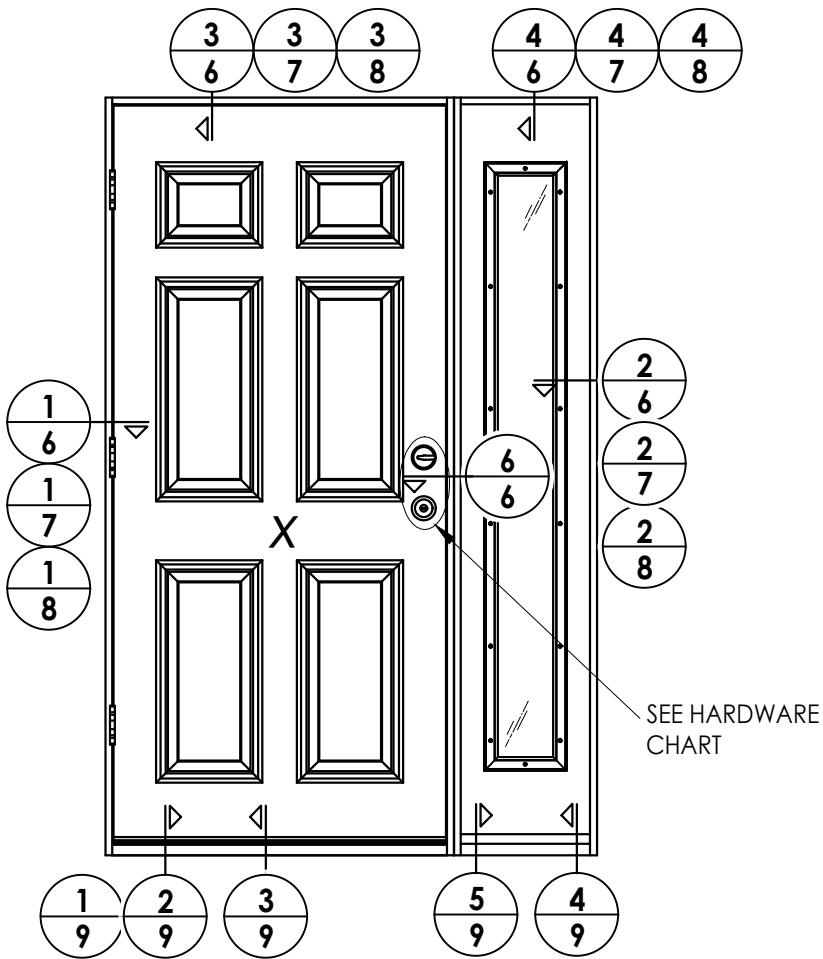

ELEVATION
XO

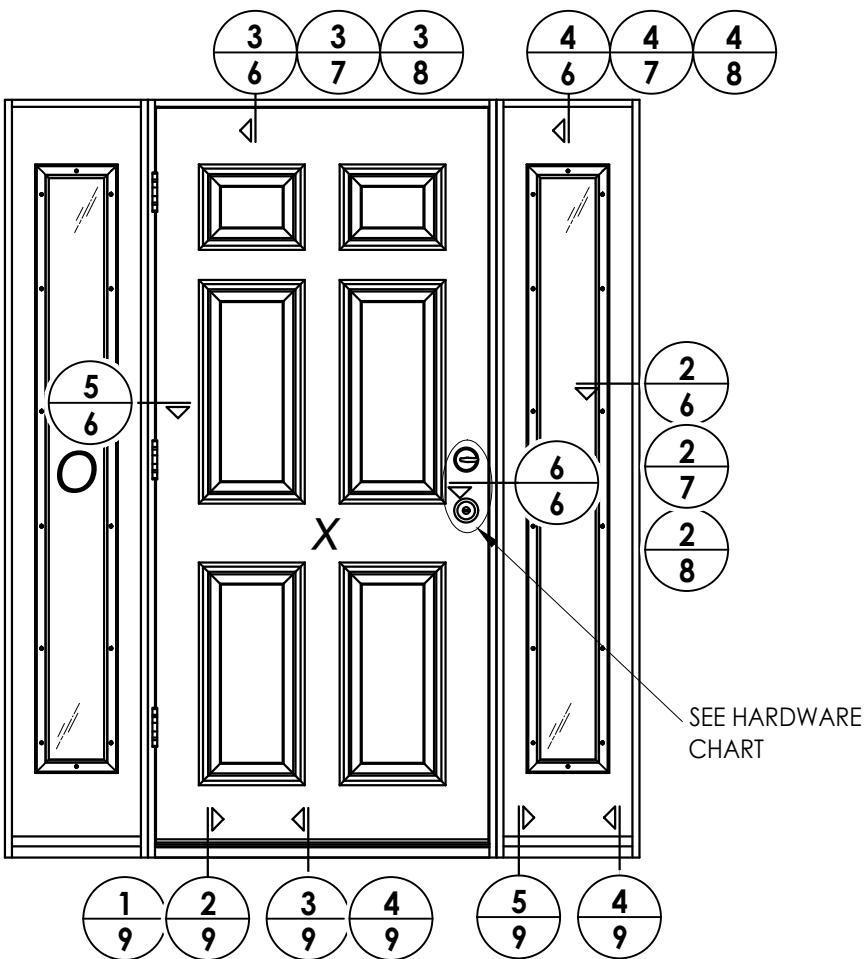

ELEVATION
OXO

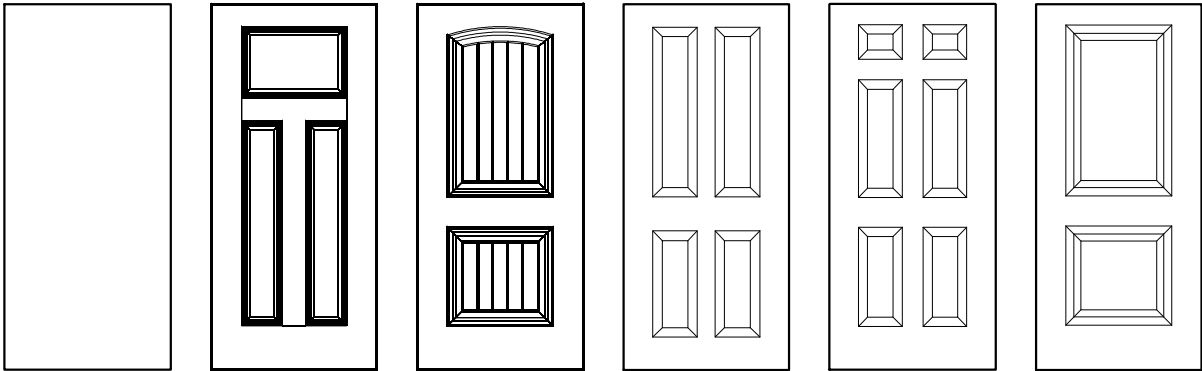


PROFILES/TRADITIONS Steel Door Panel Options

Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)


HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	Knob:	F51
	Deadbolt:	B60
KWIKSET	Knob:	SIGNATURE SERIES
	Deadbolt:	SIGNATURE SERIES (980)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409			BUILDING CONSULTANTS, INC. P.O. Box 230, Vairico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813		
PRODUCT: THERMA-TRU STEEL DOOR			PART OR ASSEMBLY: ELEVATIONS		
			LFS	FBC	REVISIONS
			LFS	FBC	
			NO.	DATE	
			2	8/07/23	UPDATE TO 8TH ED. (2023)
			1	7/20/20	UPDATE TO 7th ED (2020)
DATE: 10/11/17					
SCALE: N.T.S.					
DWG. BY: JK					
CHK. BY: LFS					
DRAWING NO.: FL-21132.3					
SHEET 5 OF 14					


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

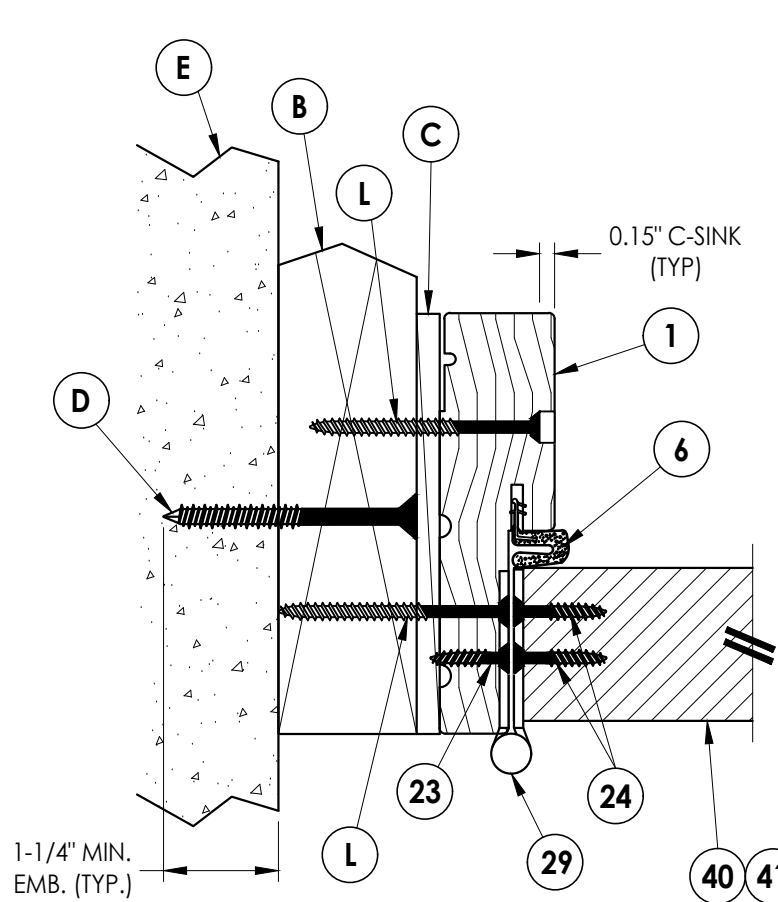


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

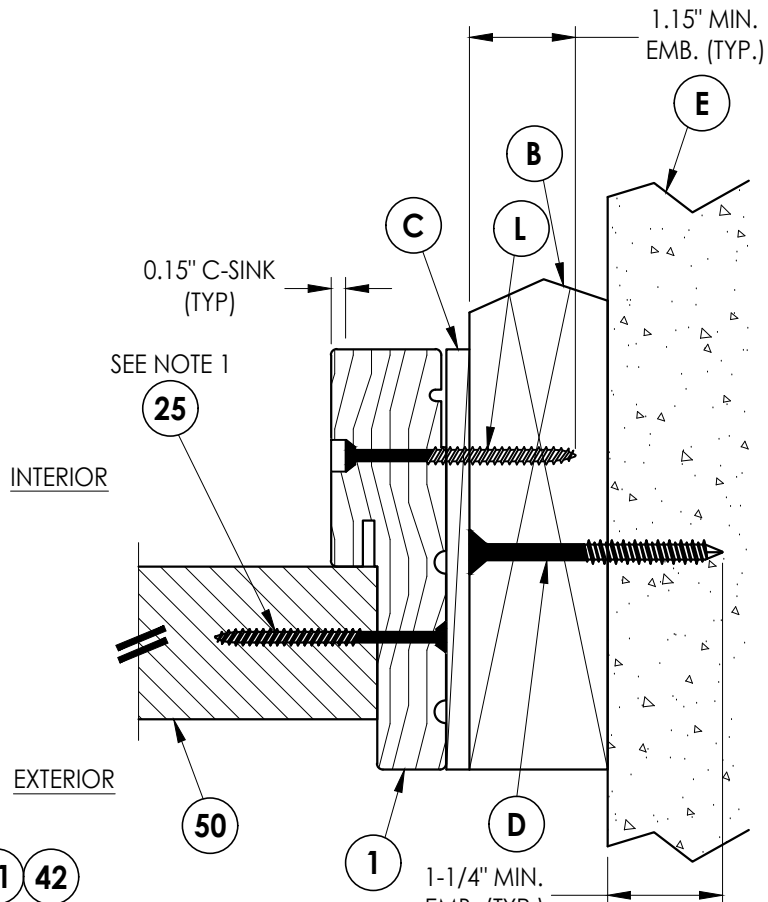

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

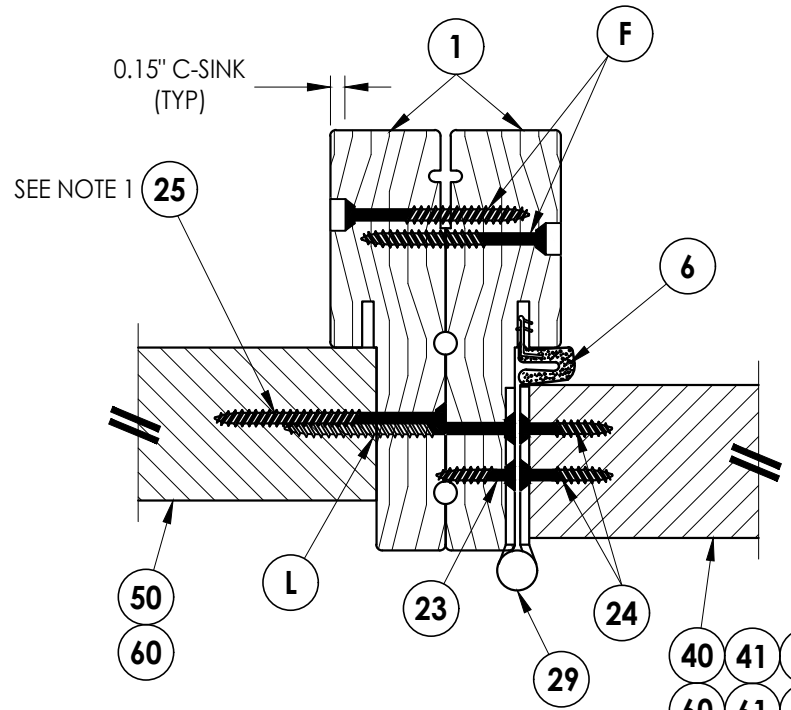


5
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

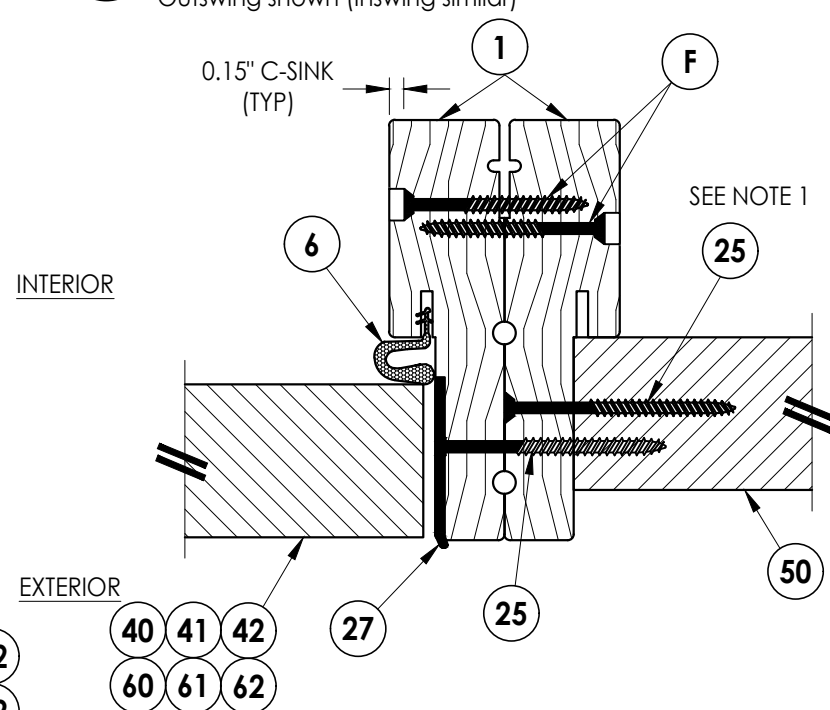


6
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

Notes:

1. Sidelite assembly screws located 8" from top and 8" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

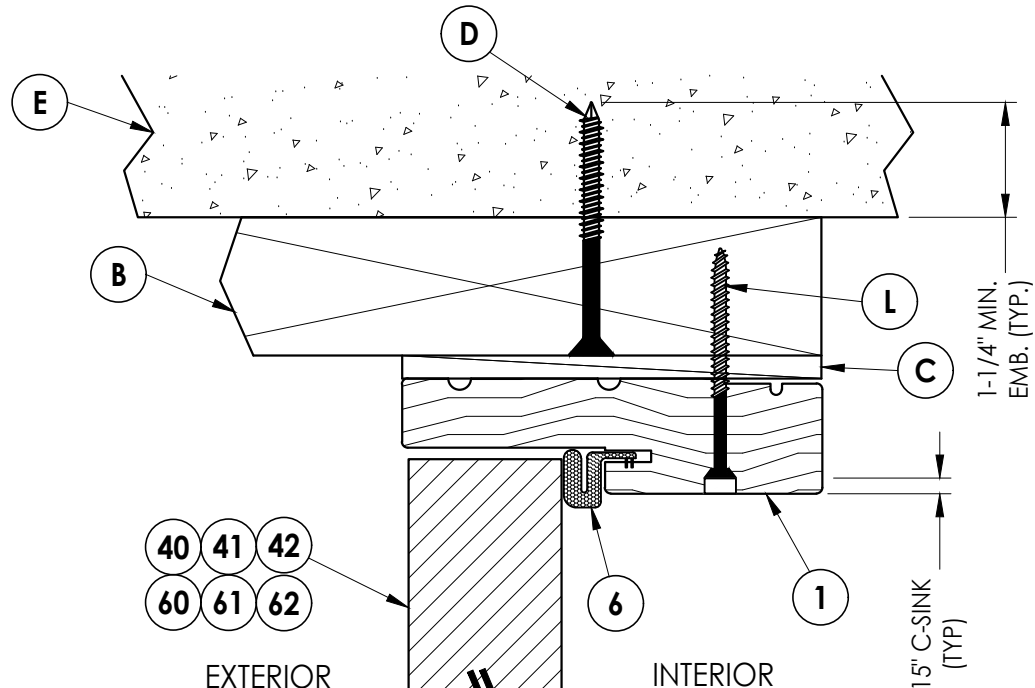

3
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

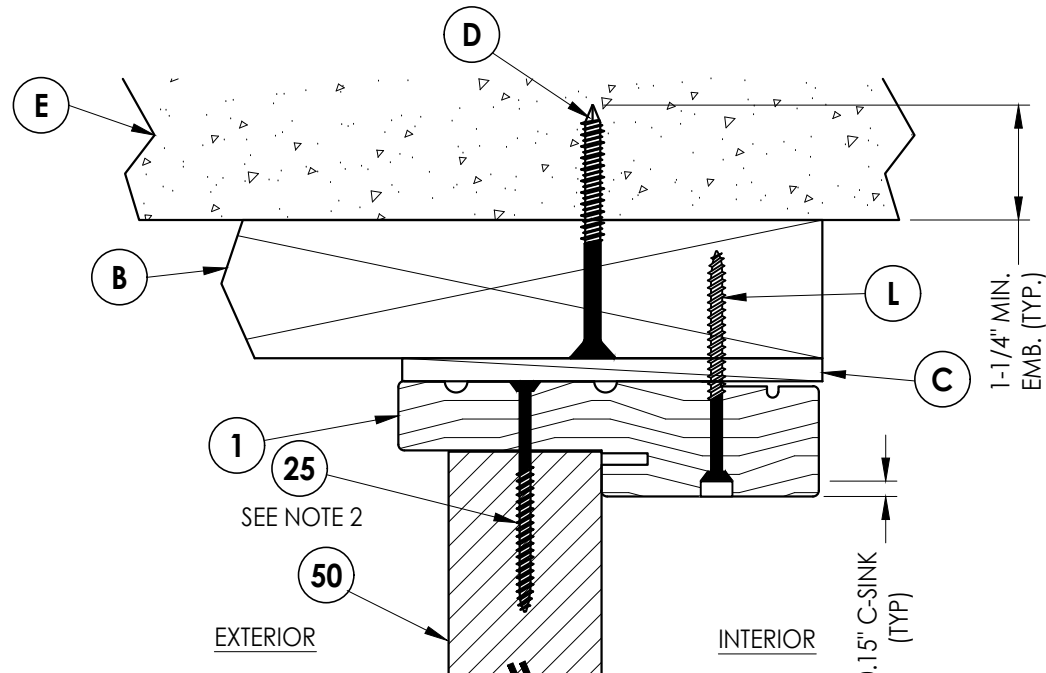

4
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409





RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	Therma-Tru STEEL DOOR
PART OR ASSEMBLY:	HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC LFS

DATE:	10/11/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21132.3
SHEET	6 OF 14


1. Sidelite assembly screws located 8" from top and 8" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

[illegible]


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.

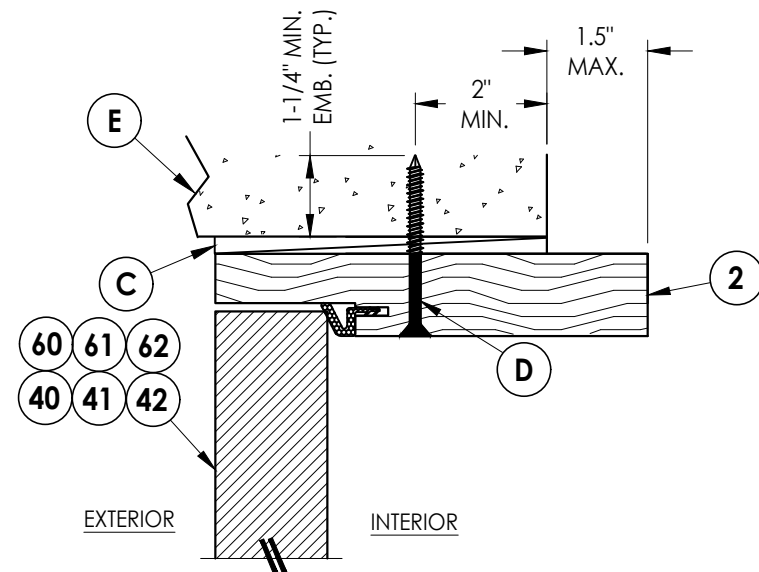


3 **HORIZONTAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

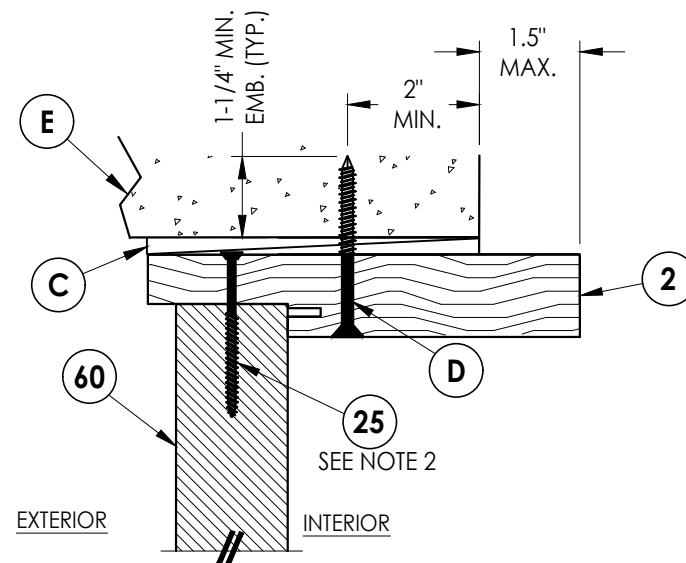


4 **VERTICAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

Notes:

1. Sidelite assembly screws located 8" from top and 8" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3' from each end (2 screws along head jamb).

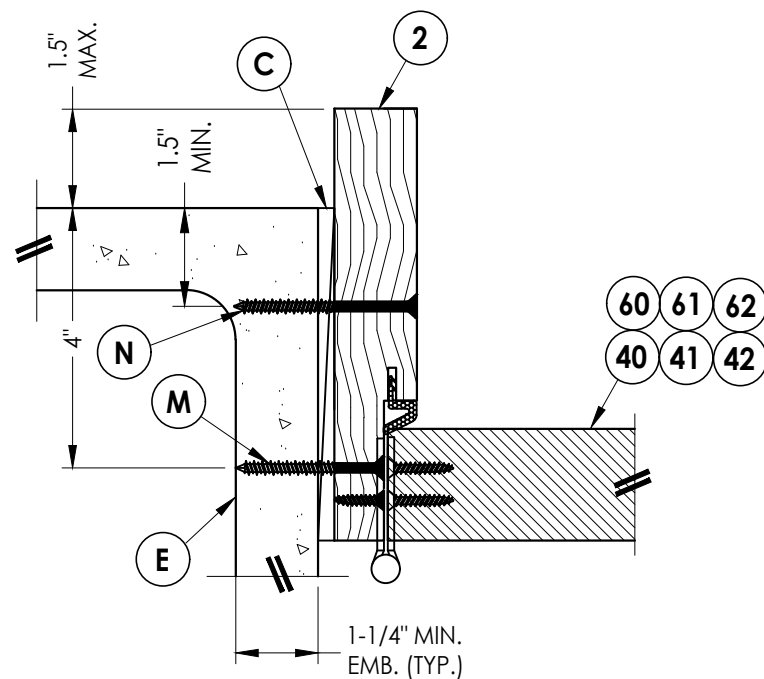

1 **HORIZONTAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb





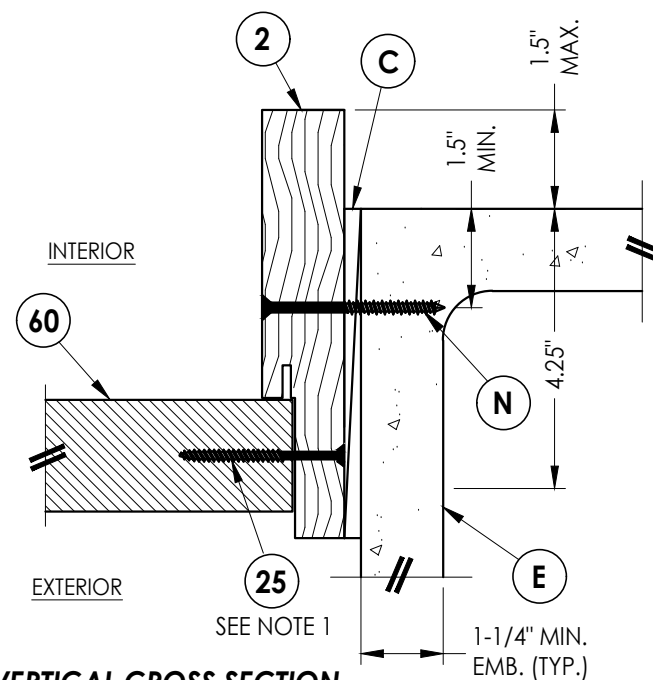


2 **VERTICAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

DATE: 10/11/17		PRODUCT:		Documents Prepared By:	
SCALE: N.T.S.		THERMA-TRU		Lyndon F. Schmidt	
DWG. BY: JK		STEEL DOOR		P.E. No. 43409	
CHK. BY: LFS		PART OR ASSEMBLY:		 BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
DRAWING NO.: FL-21132.3		HORIZONTAL & VERTICAL			
SHEET 8 OF 14		SECTIONS (DIRECT TO MASONRY)			
		LFS			
		LFS			
NO. DATE		BY			
REVISONS					
2 8/07/23 UPDATE TO 8TH ED. (2023) FBC		LFS			
1 7/20/20 UPDATE TO 7th ED (2020) FBC		LFS			

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

- Notes:
- Sill Item #'s 16, 32, 33, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 17 & 18 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - Sidelite assembly screws located 4" from each end (2 screws along sill).

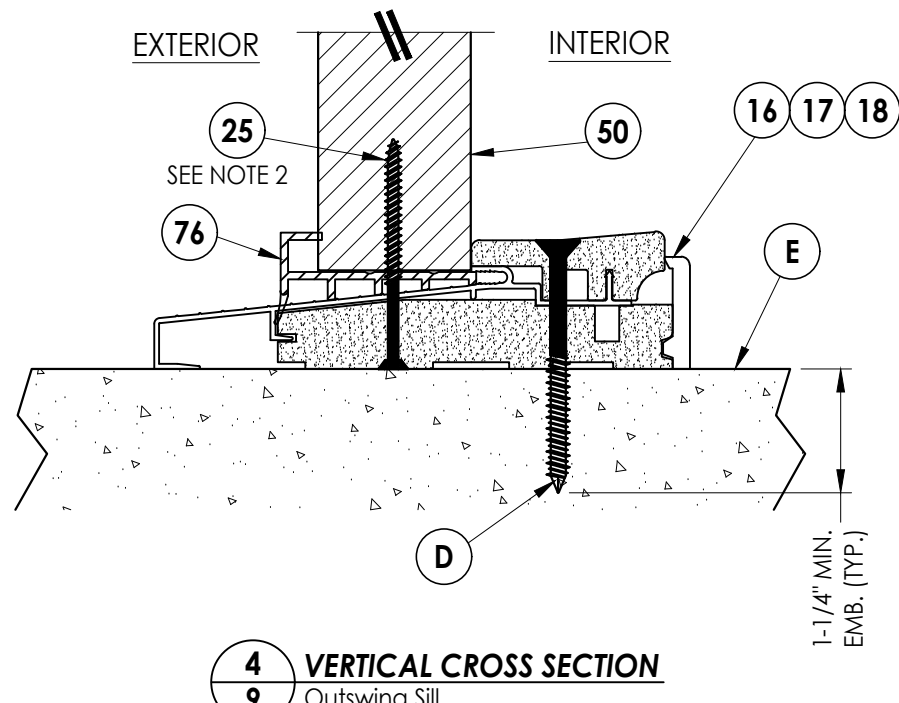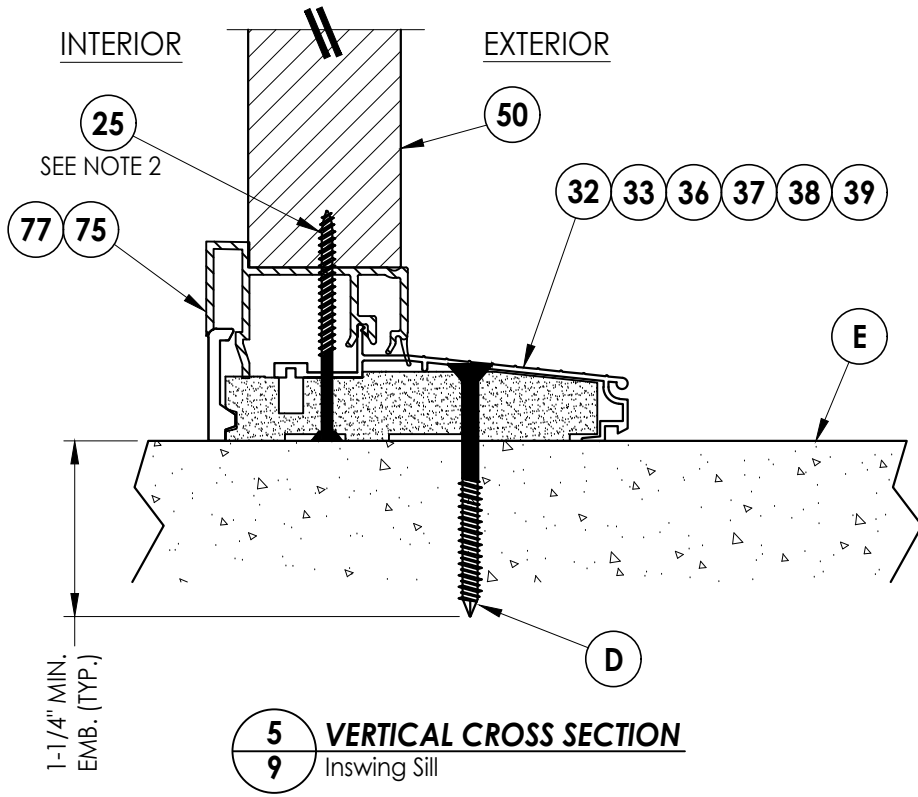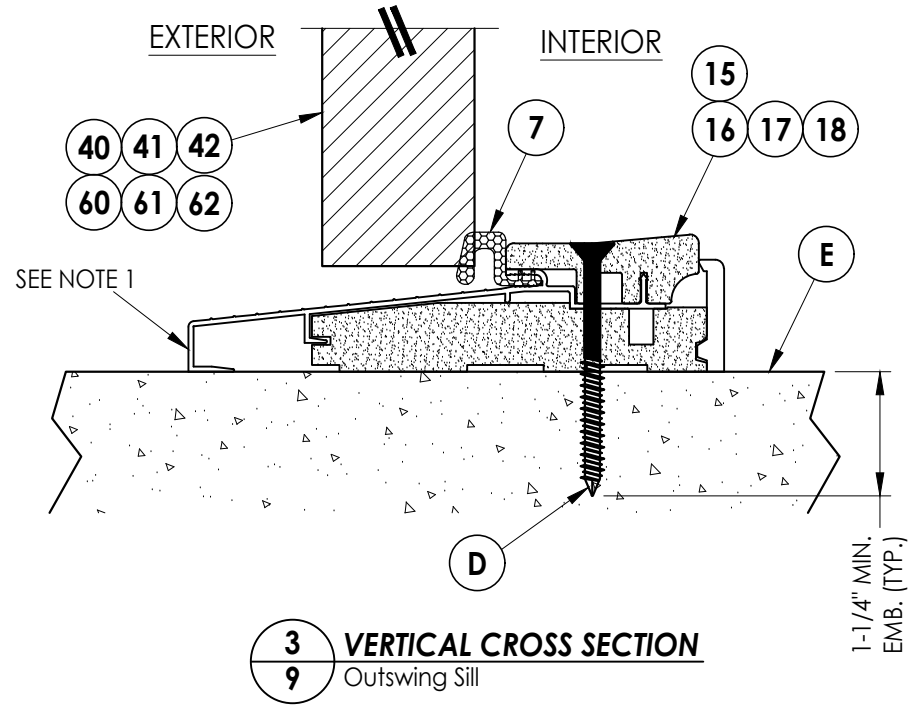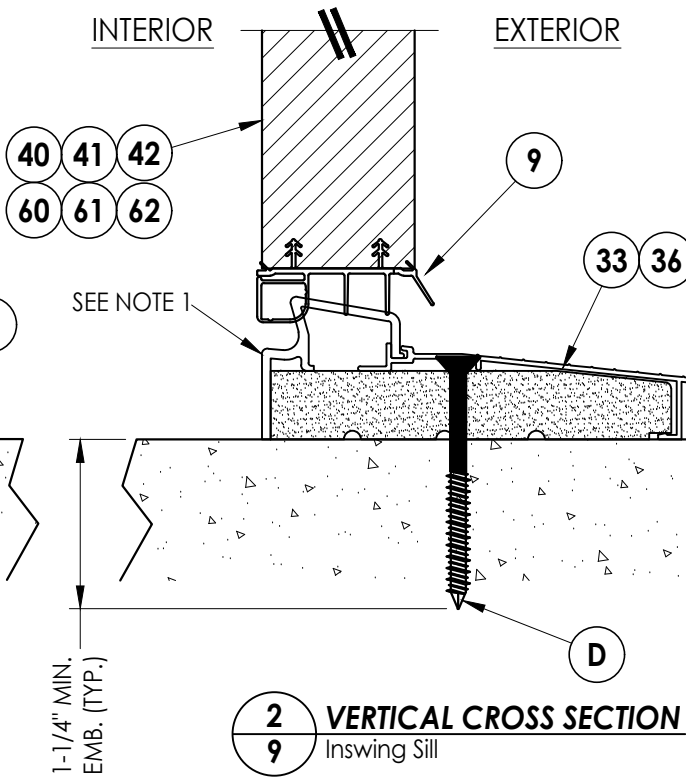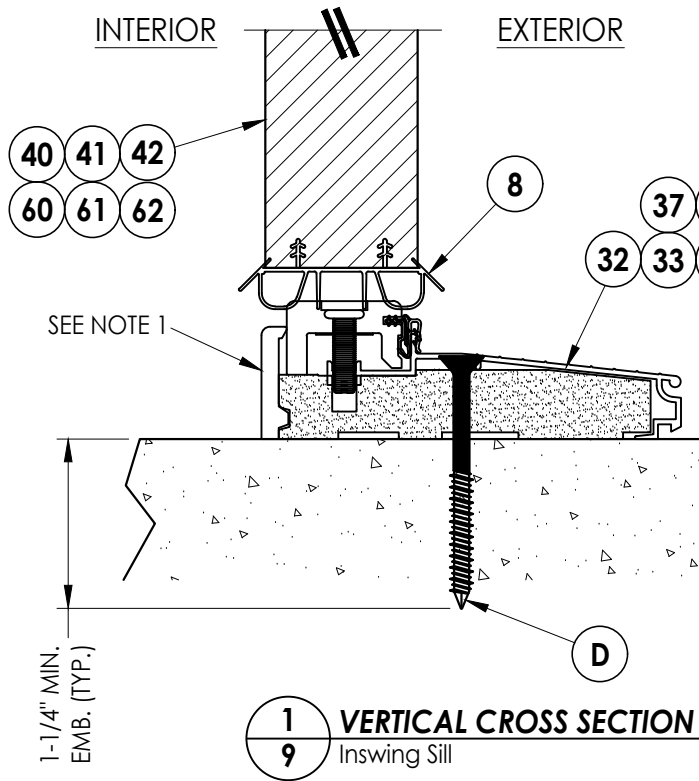

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU STEEL DOOR
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)


NO.	DATE	REVISIONS		
		BY	LFS	FBC
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/20/20	UPDATE TO 7th ED (2020)	FBC	LFS

DATE: 10/11/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21132.3
SHEET 9 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

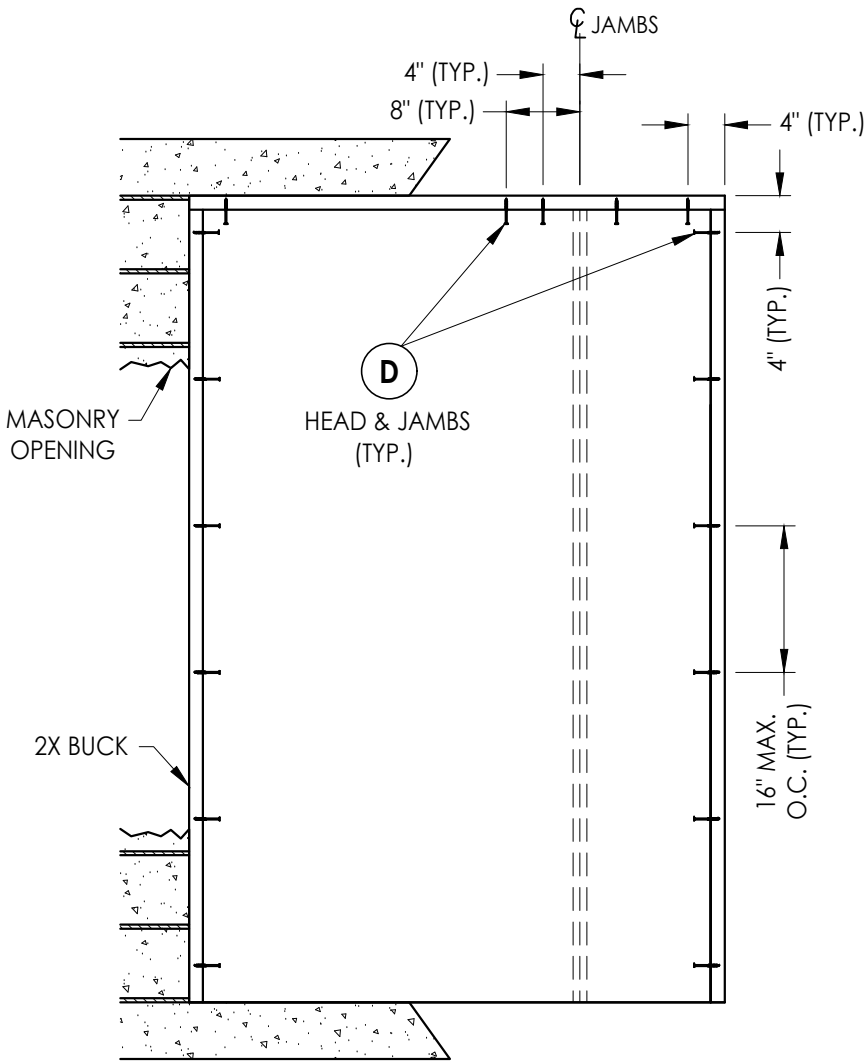

XO/OX

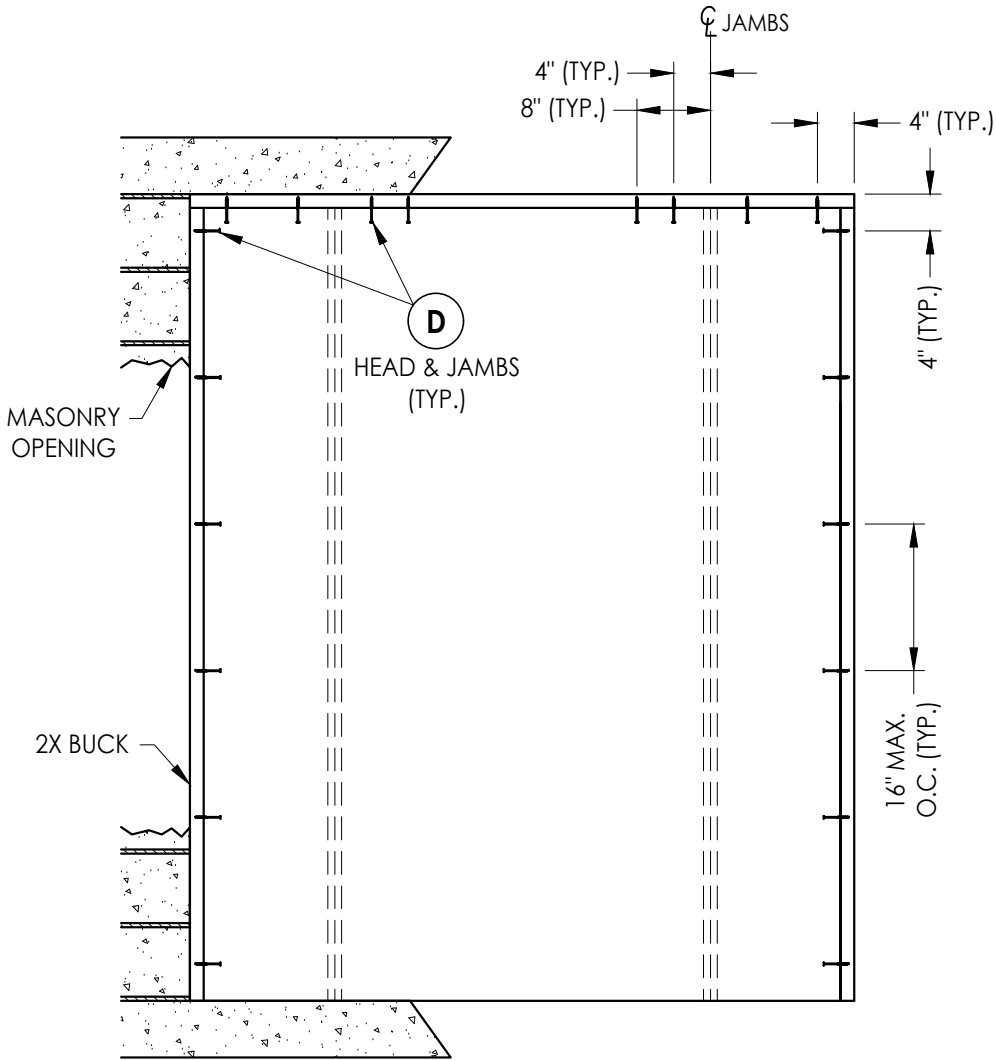


OXO


2X BUCK ANCHORING

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: THERMA-TRU STEEL DOOR				PART OR ASSEMBLY: BUCK ANCHORING			
				LFS	FBC	LFS	BY
2	8/07/23	UPDATE TO 8TH ED. (2023)					
1	7/20/20	UPDATE TO 7th ED (2020)					
NO	DATE						
REVISIONS							
DATE: 10/11/17							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-21132.3							
SHEET 10 OF 14							


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

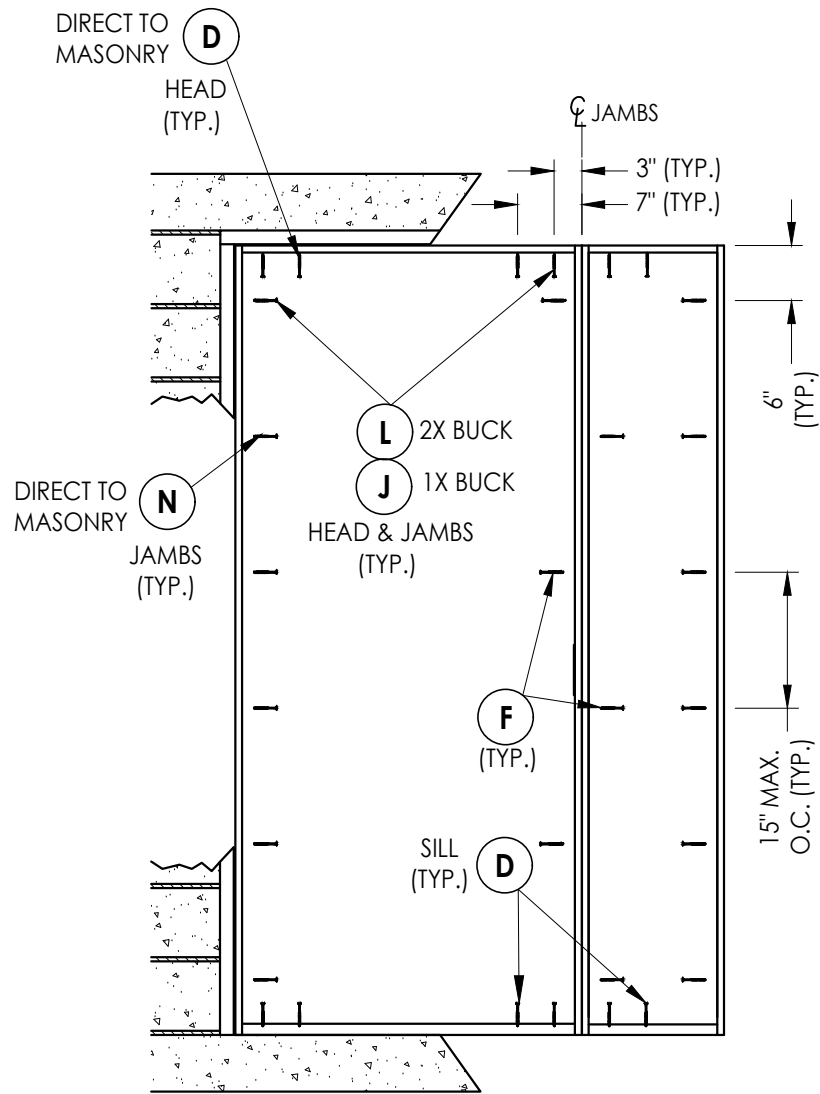

XO/OX

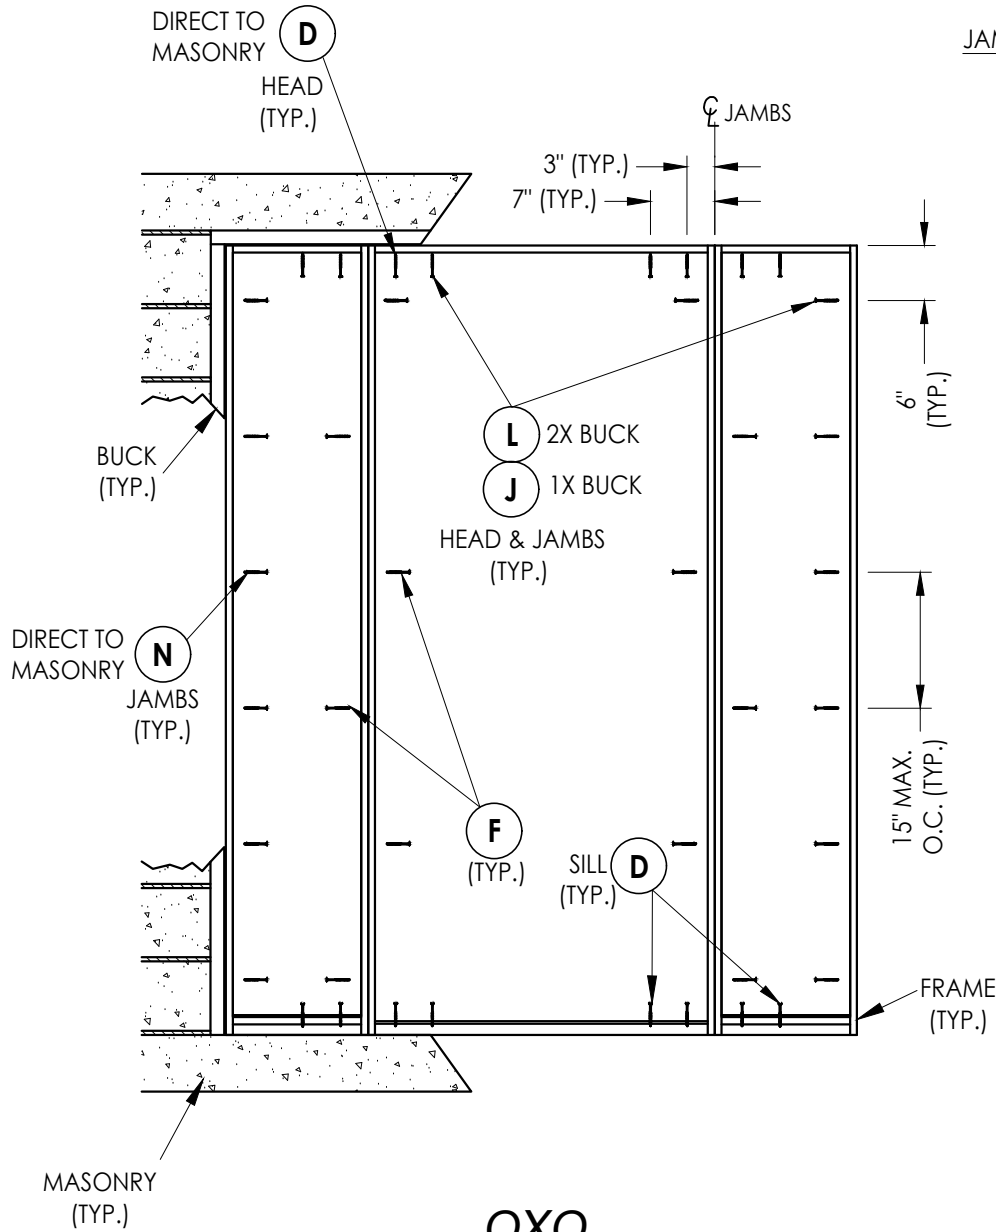

OXO

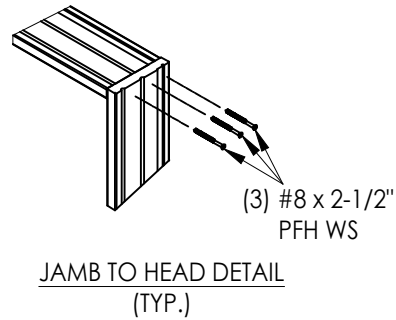

FRAME ANCHORING

DATE: 10/11/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21132.3

SHEET 11 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

FRAME ANCHORING


BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595


Phone No.: 813.659.9197

FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

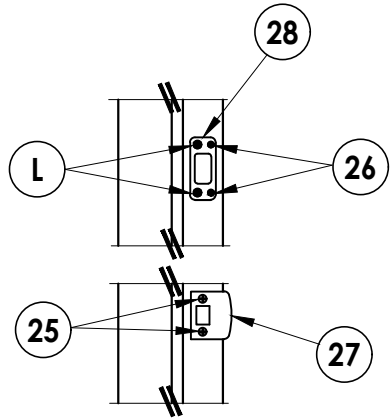


LATCH & DEADBOLT DETAIL
Kwikset

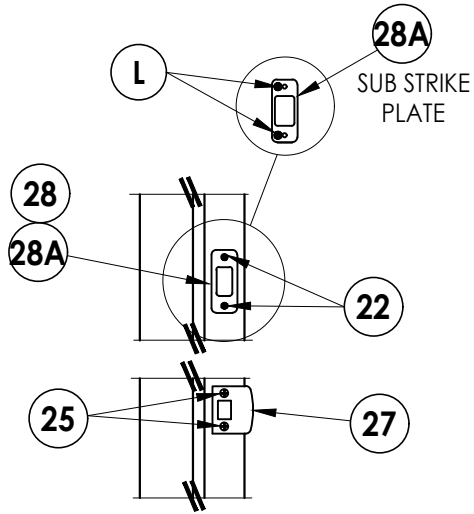


LATCH & DEADBOLT DETAIL
Schlage


LATCH & DEADBOLT STRIKE DETAILS

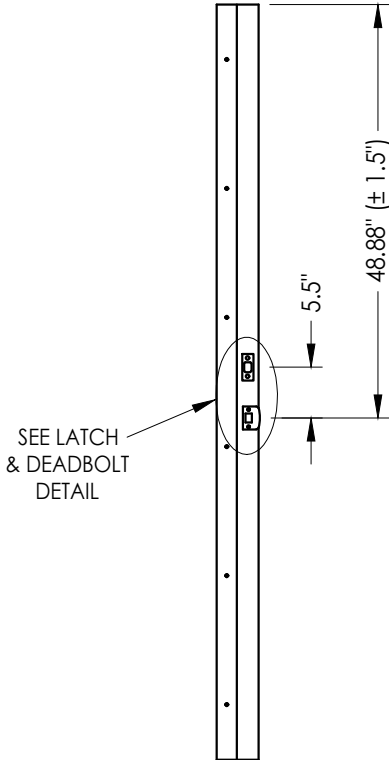

STRIKE JAMB
Latch and Deadbolt

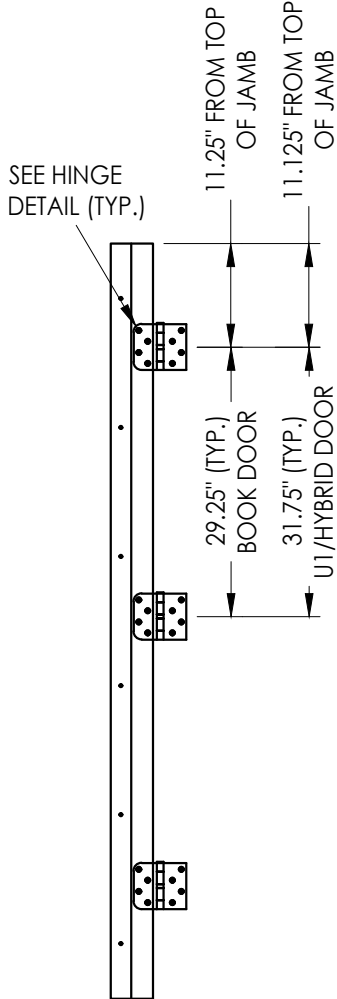


HINGE JAMB

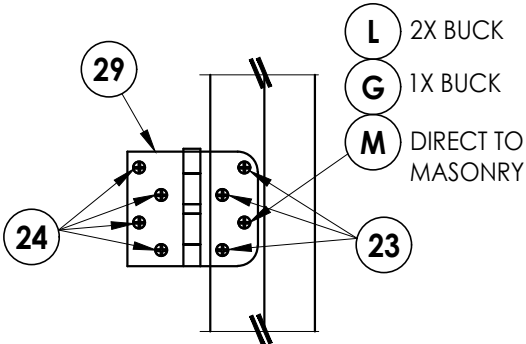


HINGE DETAIL

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: THERMA-TRU STEEL DOOR				PART OR ASSEMBLY: HARDWARE DETAILS			
				LFS	FBC	REVISIONS	
				2	8/07/23	UPDATE TO 8TH ED. (2023)	
				1	7/20/20	UPDATE TO 7th ED (2020)	
				NO.	DATE		
DATE: 10/11/17							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-21132.3							
SHEET 12 of 14							


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R2\FL-21132.1-5.dwg

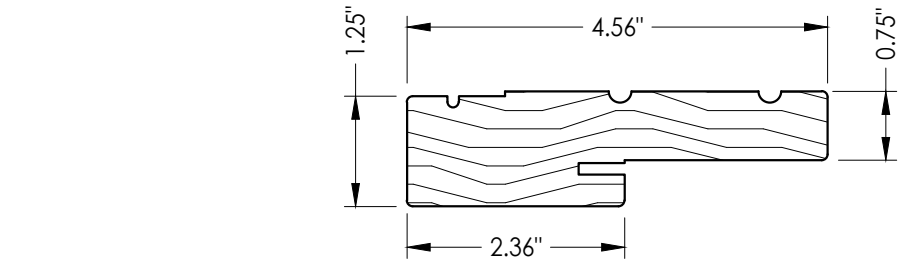


1 WOOD JAMB

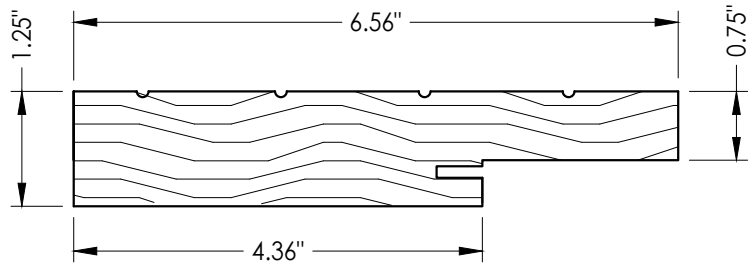


2 WOOD JAMB

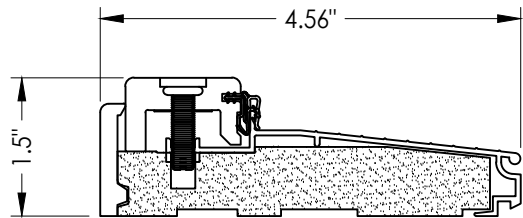


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

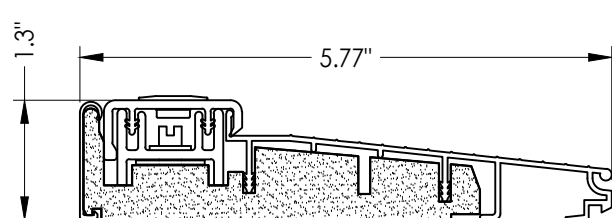


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

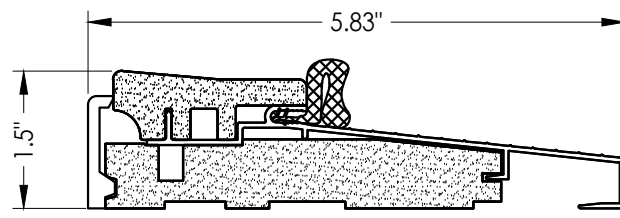


16 OUTSWING THRESHOLD
Composite Sill

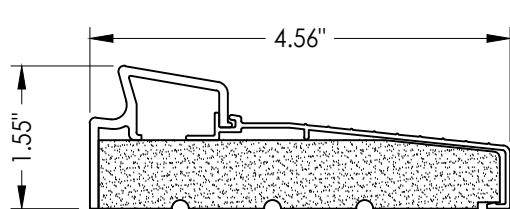


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

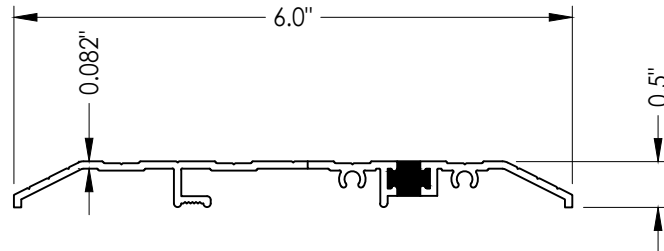


15 PUBLIC ACCESS THRESHOLD

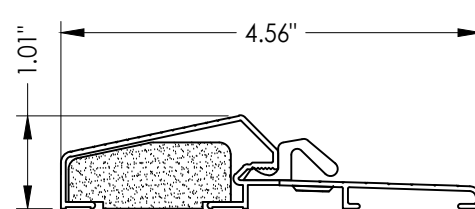


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

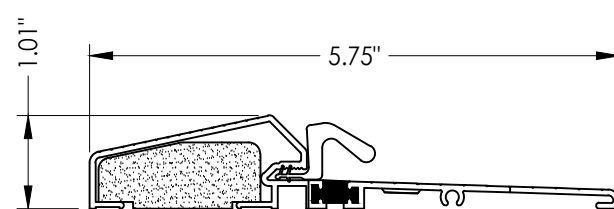


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

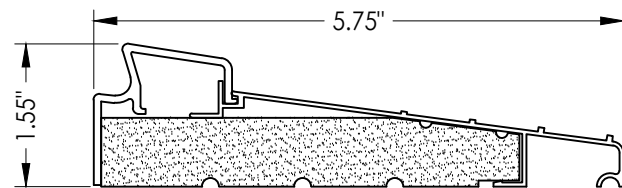


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

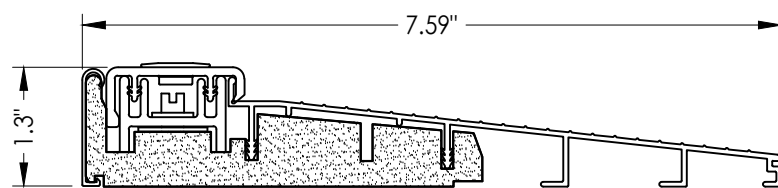


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

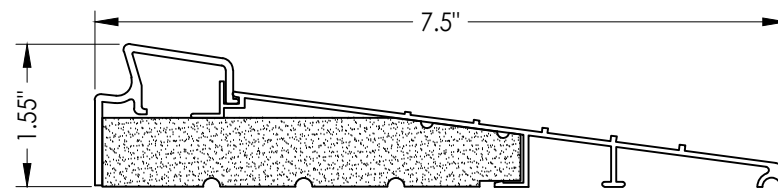


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

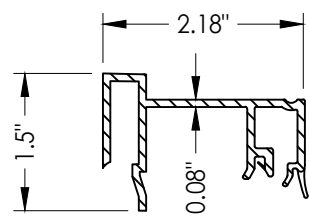


75 SIDELITE SPACER
Inswing




76 SIDELITE SPACER
Outswing

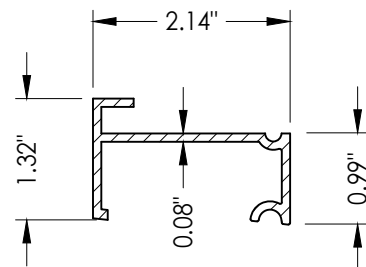


77 SIDELITE SPACER
Inswing



8 SWEEP



9 SWEEP



10 SWEEP

DATE: 10/11/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21132.3

SHEET 13 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS	BY
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC	LFS

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			29	4" X 4" HINGE	STEEL
F	#10 X 2" PFH WOOD SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	38	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	39	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	40	DOOR PANEL (BOOK) - "PROFILES" SERIES	-
2	JAMB (FINGER JOINT PINE)	WOOD	41	DOOR PANEL (HYBRID) - "PROFILES" SERIES	-
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	42	DOOR PANEL (U1) - "PROFILES" SERIES	-
7	WEATHERSTRIP (LONG REACH)	FOAM	50	SIDELITE (FULL LITE)	-
8	SWEEP	VINYL	60	DOOR PANEL (BOOK) - "TRADITIONS" SERIES	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	61	DOOR PANEL (HYBRID) - "TRADITIONS" SERIES	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	62	DOOR PANEL (U1) - "TRADITIONS" SERIES	-
11	#8-10 X 1-1/2" PLASCREW	STEEL	75	SIDELITE SPACER (INSWING)	PVC
12	#6-18 X 1-3/4" PFH SCREW	STEEL	76	SIDELITE SPACER (OUTSWING)	PVC
15	PUBLIC ACCESS THRESHOLD	ALUM	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
16	OUTSWING THRESHOLD	ALUM/COMP	CONCRETE ANCHOR NOTES:		
17	OUTSWING THRESHOLD	ALUM/COMP			
18	OUTSWING THRESHOLD	ALUM/COMP			
22	#8 x 3/4" PFH WOOD SCREW	STEEL			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]