

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg




Profiles™ & Traditions

WOOD EDGE
"IMPACT" OPAQUE STEEL SINGLE DOOR
w/ "NON-IMPACT" SIDELITE(S)
INSWING/OUTSWING

GENERAL NOTES


1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, the opaque door complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. The opaque door meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996. The non-impact sidelites must be protected with an impact resistant covering complying with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes	8	Horizontal & Vertical Cross Sections (Direct to Masonry)
2	Door Panel Details "Profiles"	9	Vertical Cross Sections (Thresholds)
3	Door Panel Details "Traditions"	10	Buck Anchoring
4	Sidelite Panel and Glazing Details	11	Frame Anchoring
5	Elevations	12	Hardware Details
6	Horizontal & Vertical Cross Sections (2X Buck)	13	Components
7	Horizontal & Vertical Cross Sections (1X Buck)	14	Bill of Materials

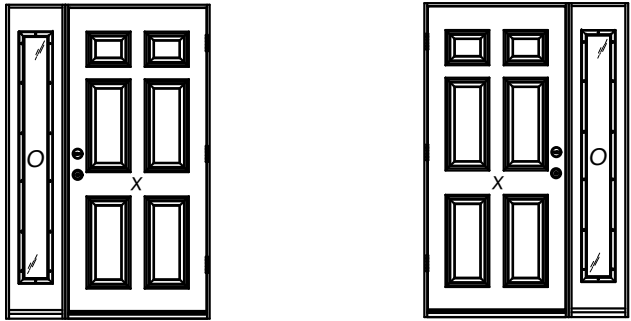


OX

XO

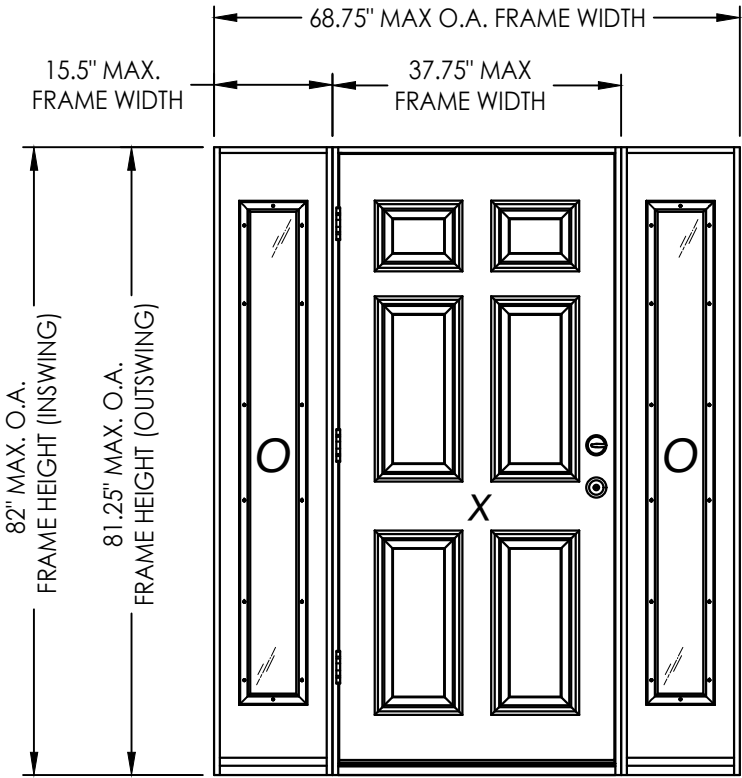

OXO

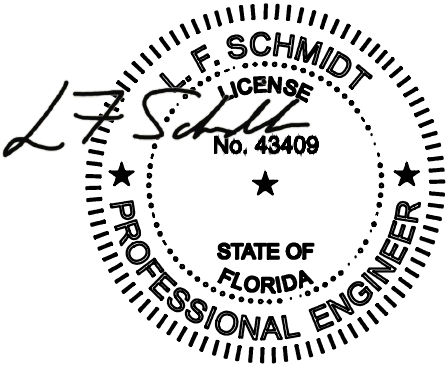

Digitally signed by Lyndon F Schmidt
Date: 2026.08.06 12:33:43 -04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
OX,XO,OXO "PROFILES"	+65.0	-65.0	+65.0	-65.0
OX,XO,OXO "TRADITIONS"	+50.0	-55.0	+50.0	-50.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

Therma-Tru Steel Door

Part or Assembly:
TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES


REVISIONS

3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/20/20	UPDATE TO 7th ED (2020)	FBC	LFS
NO.	DATE			BY



DATE: 10/11/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21132.3
SHEET 1 OF 14

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.

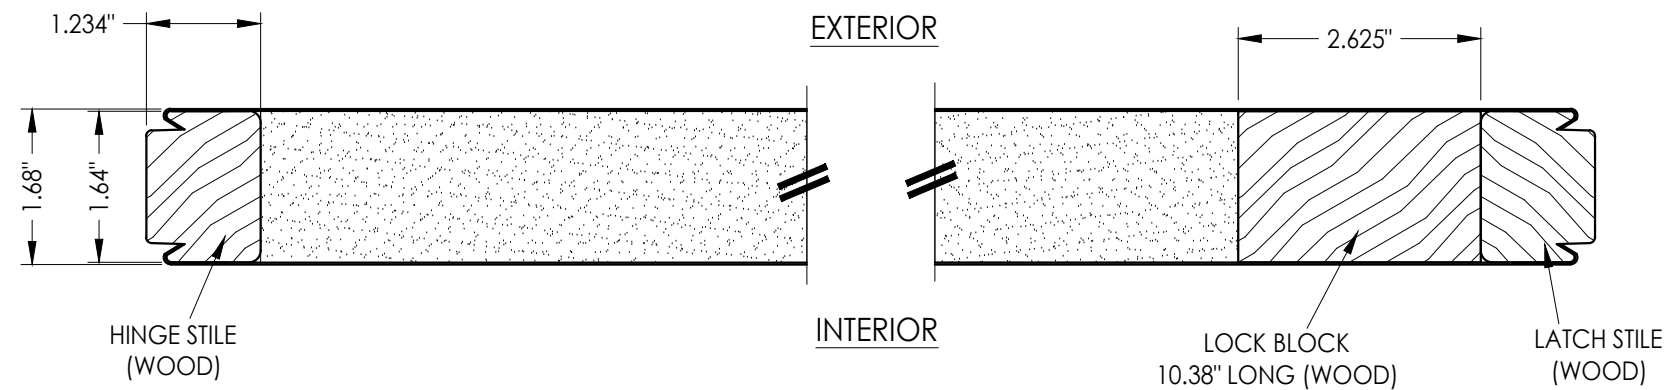

1 **HORIZONTAL CROSS SECTION**
2

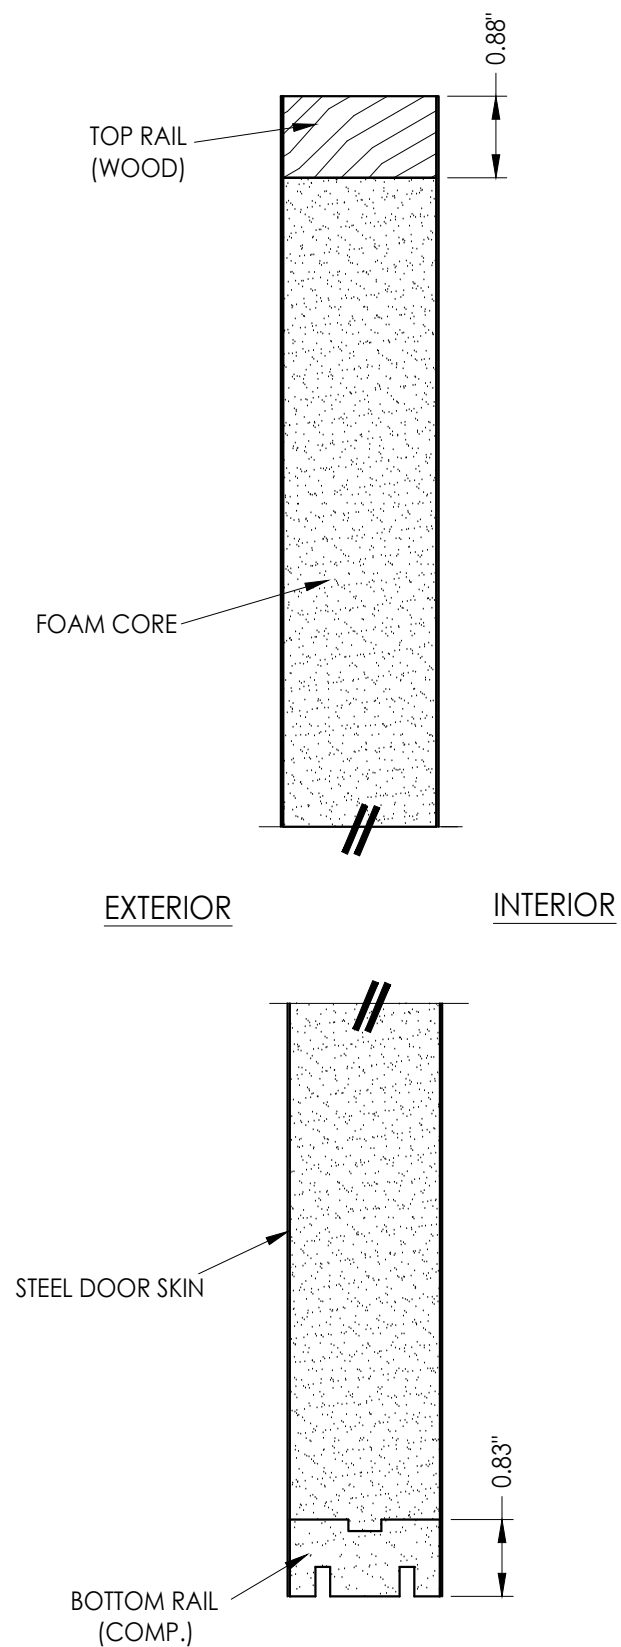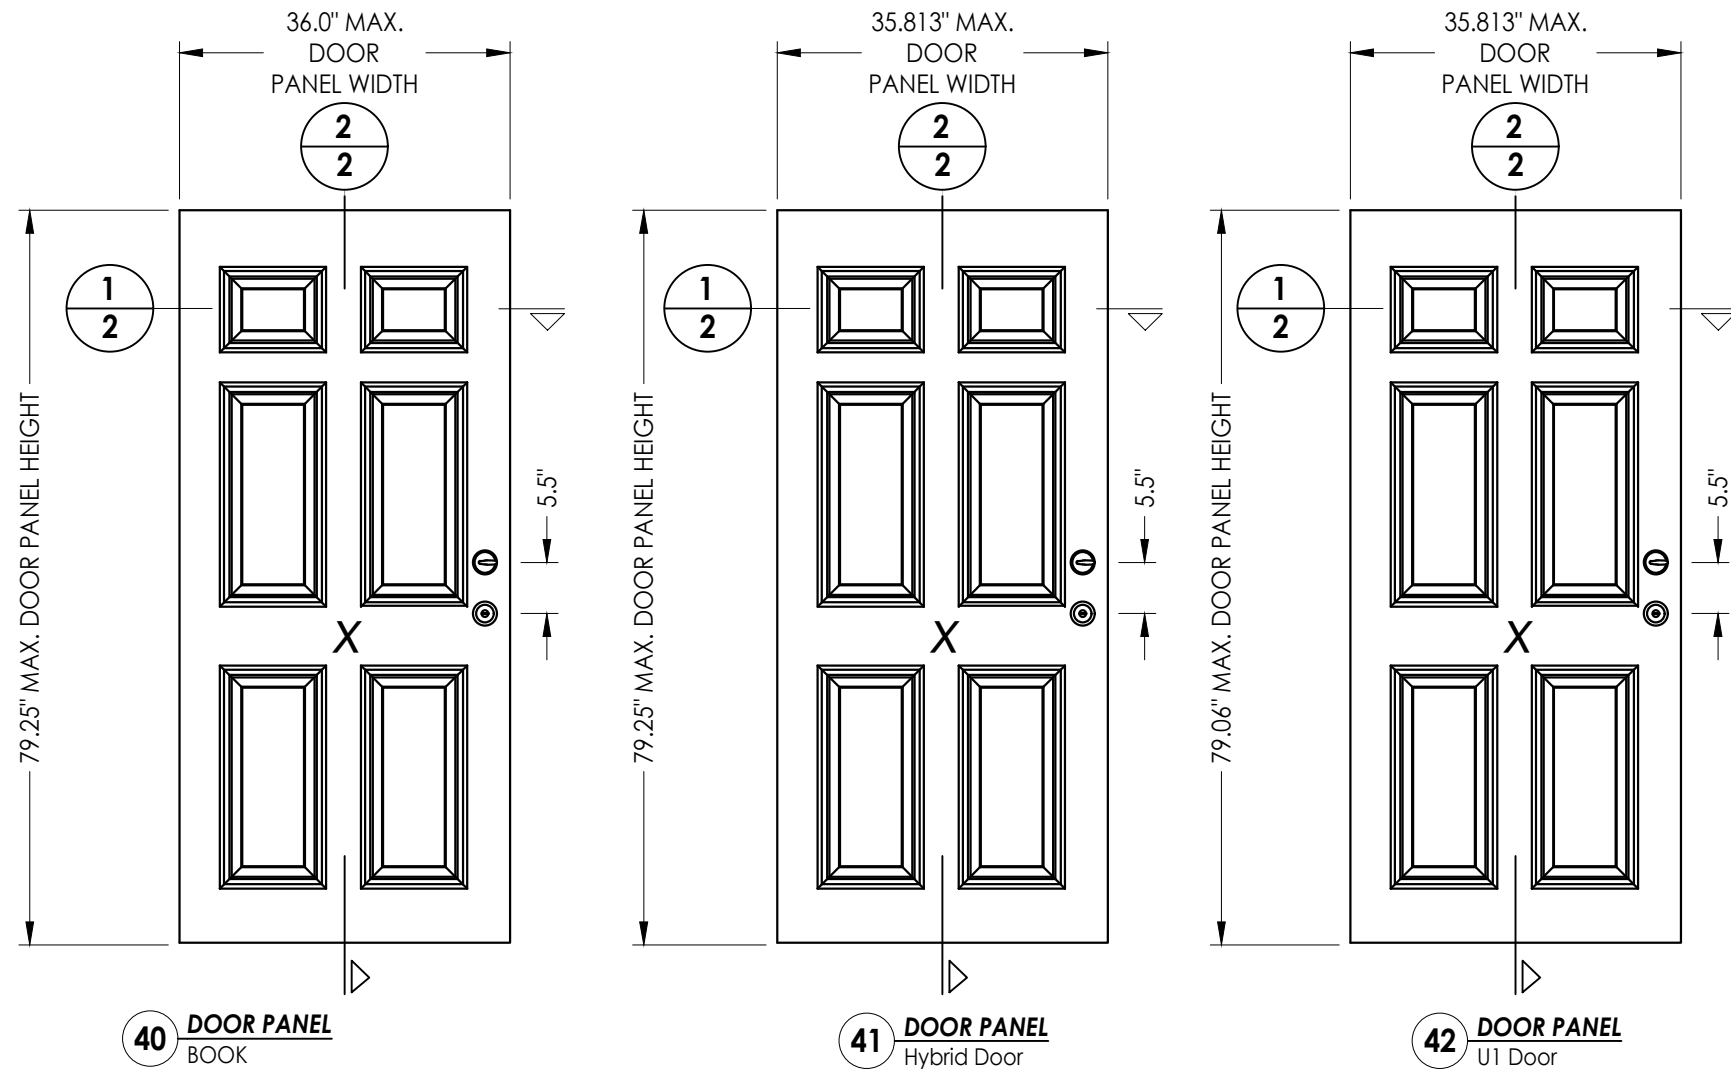

2 VERTICAL CROSS SECTION

"PROFILES" SERIES DOOR PANEL

STEEL DOOR SKIN: 24 GA. (0.022" MIN. THICKNESS, $F_y = 48,470$ PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

"PROFILES"

DOOR PANEL DETAILS

[illegible]

DATE: 10/11/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:



FL-21132.3

SHEET 2 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

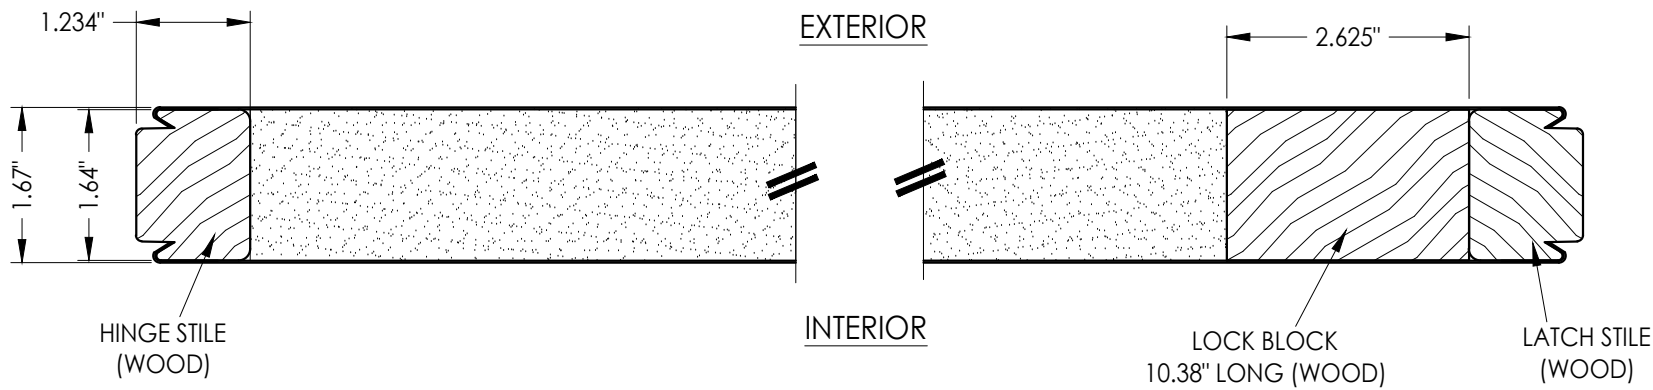

1
3 **HORIZONTAL CROSS SECTION**

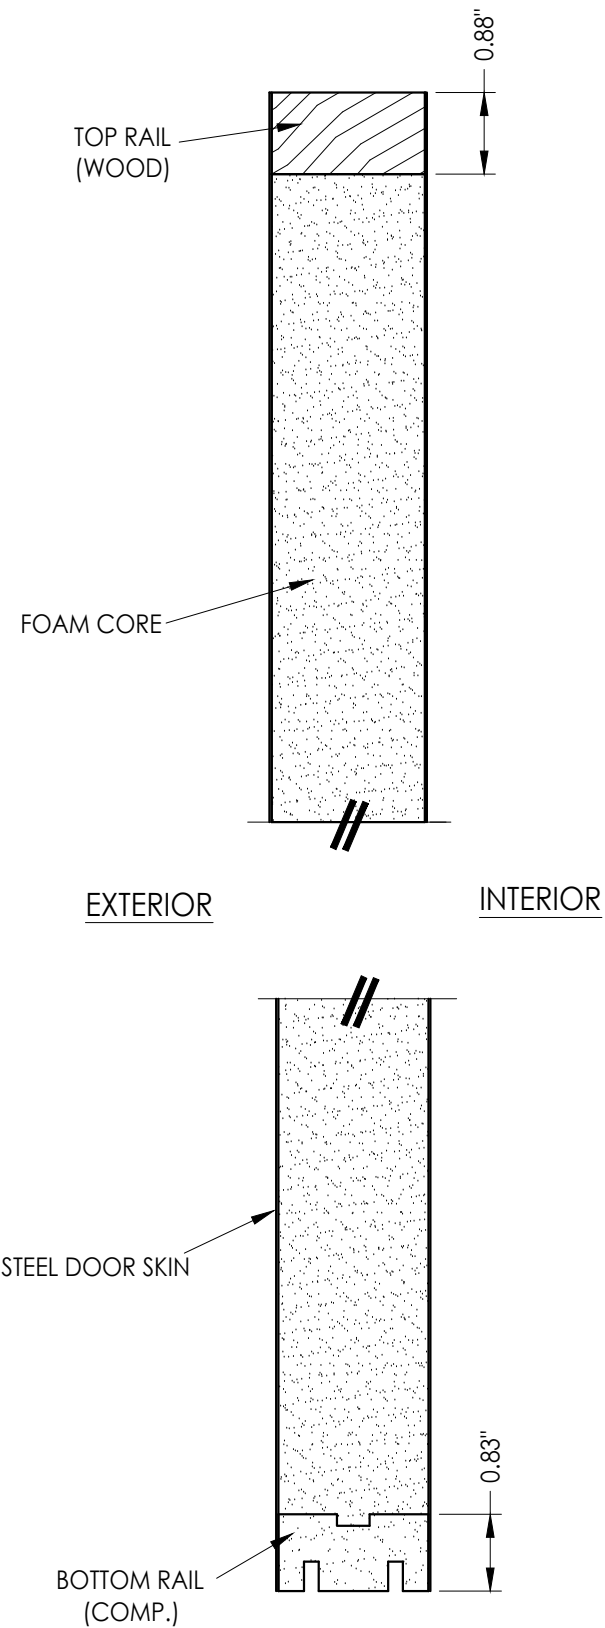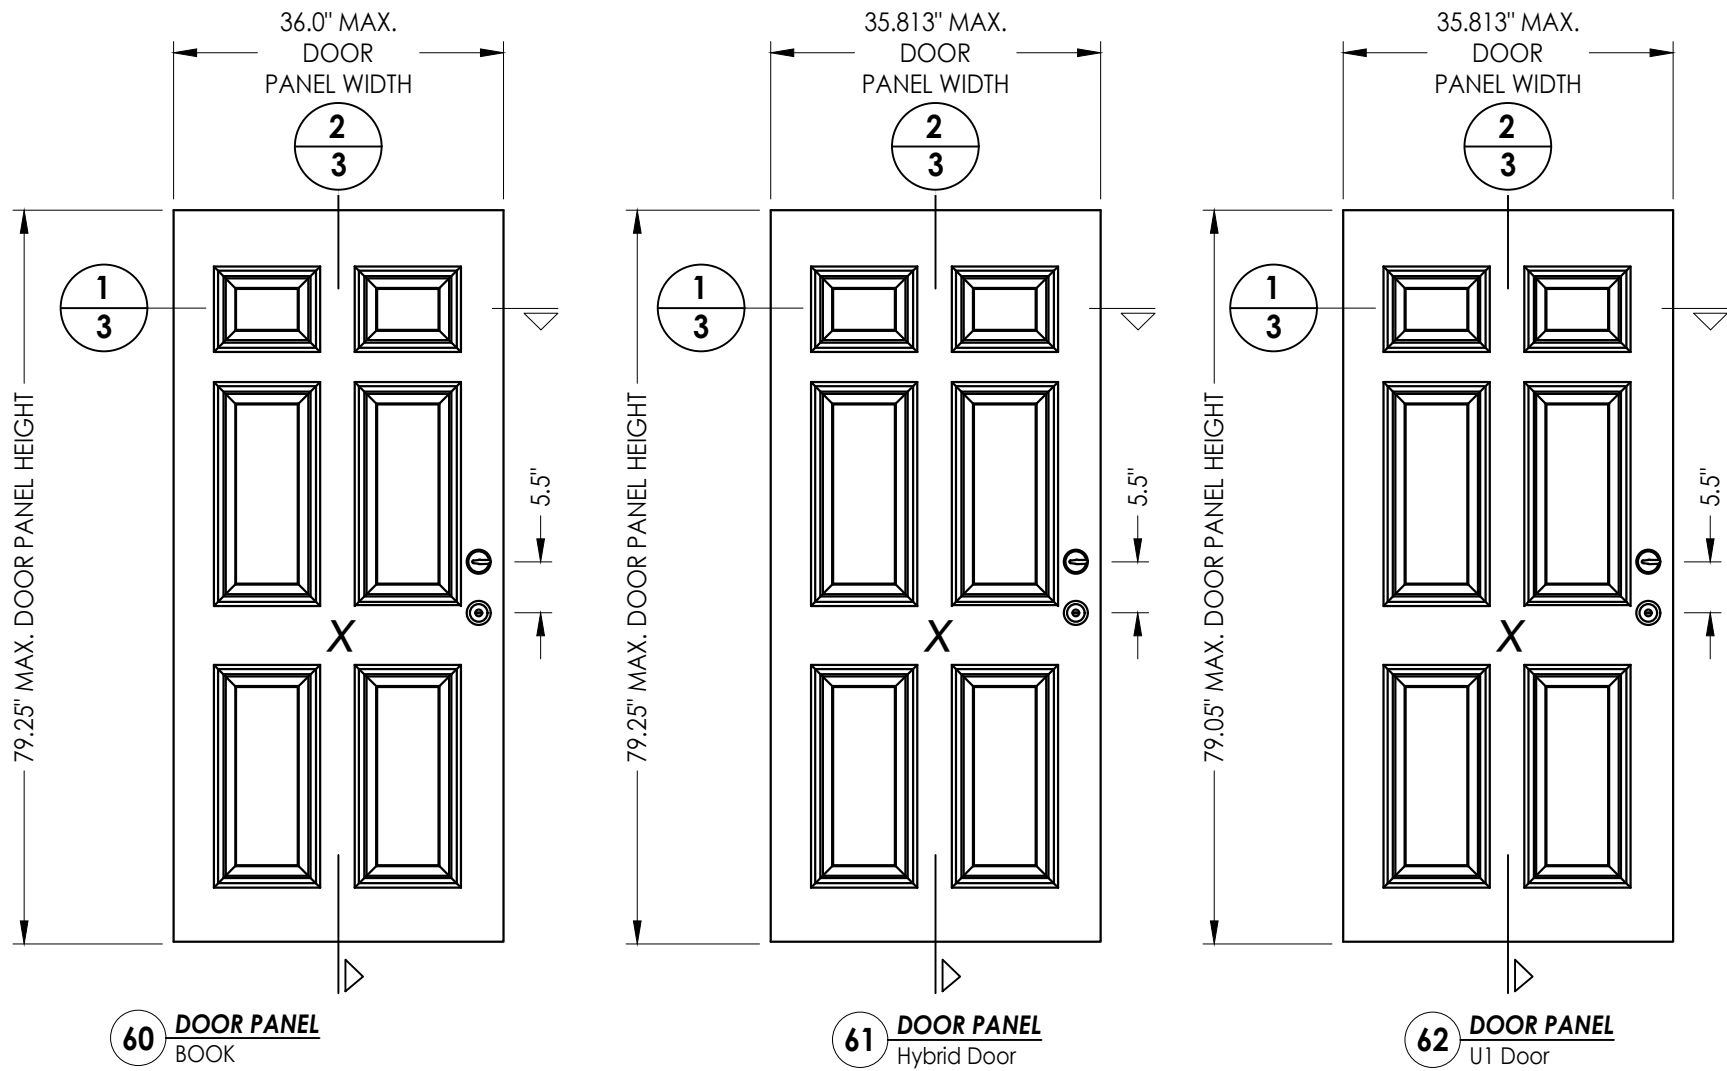

2
3 **VERTICAL CROSS SECTION**

"TRADITIONS" SERIES DOOR PANEL

STEEL DOOR SKIN: 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
"TRADITIONS"
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC LFS
		BY

DATE: 10/11/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21132.3
SHEET 3 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

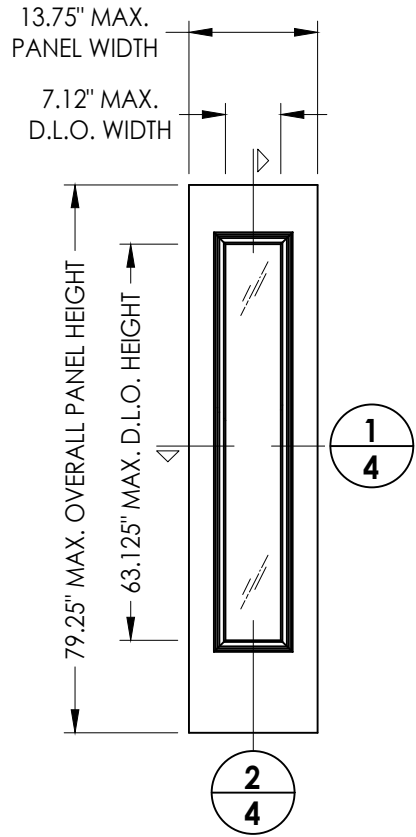


50 SIDELITE PANEL

NOTE:


1. Spacing for item #11 & #12 (lite frame screws) is as follows: From the top down on sides; 3", 14.75", 26.5", 38.25", 50.5" & 62.25". There are (2) screws both top and bottom at 4.25" in from each corner.

SIDELITE PANEL


STEEL SKIN "PROFILES": 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)
STEEL SKIN "TRADITIONS": 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)
SIDELITE WOOD COMPONENTS: PINE (SG >= 0.42)

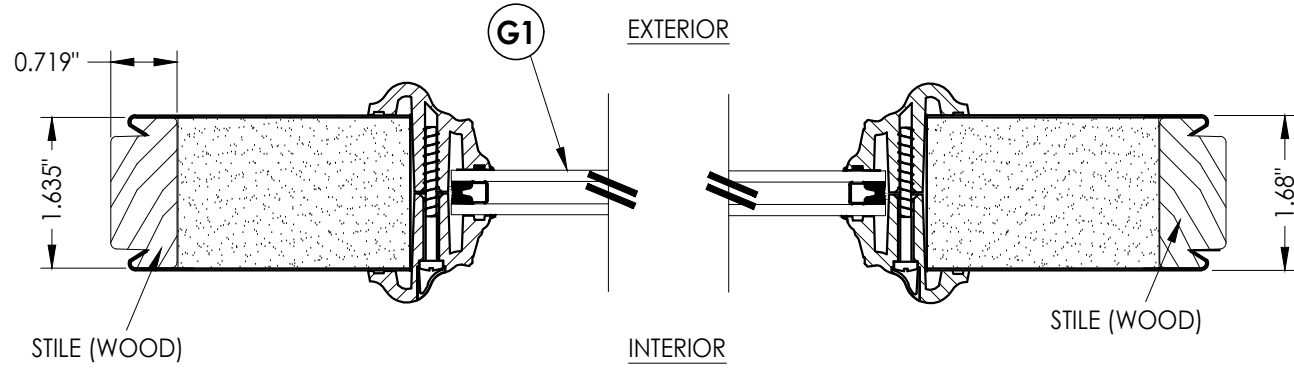


1/4 HORIZONTAL CROSS SECTION

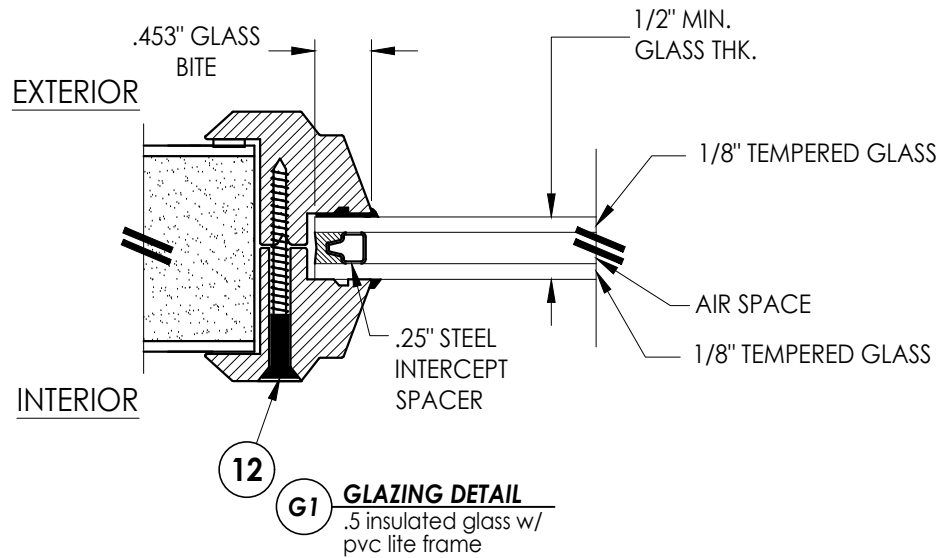


G1 GLAZING DETAIL
.5 insulated glass w/
pvc lite frame

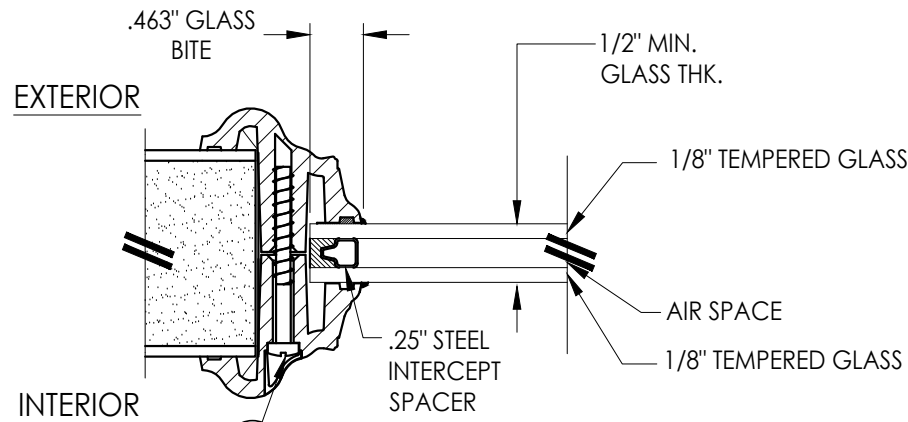

G1 GLAZING DETAIL
.5 insulated glass w/
bts lite frame

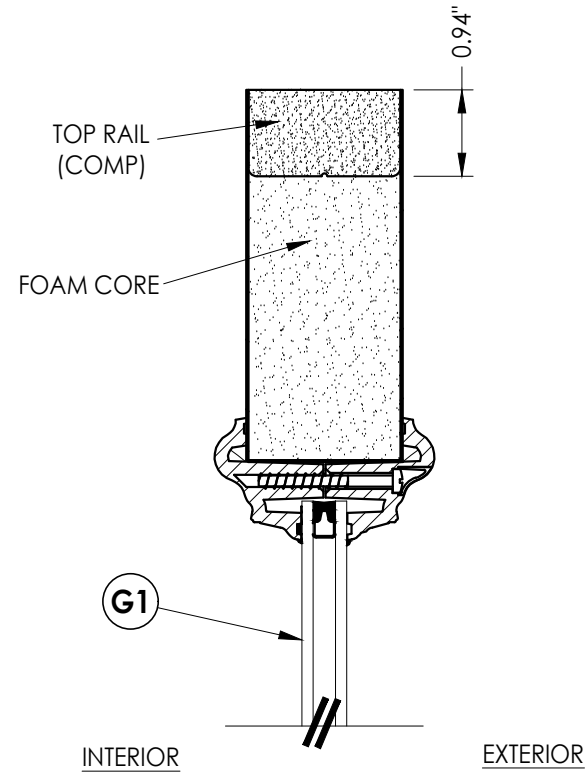

2/4 VERTICAL CROSS SECTION

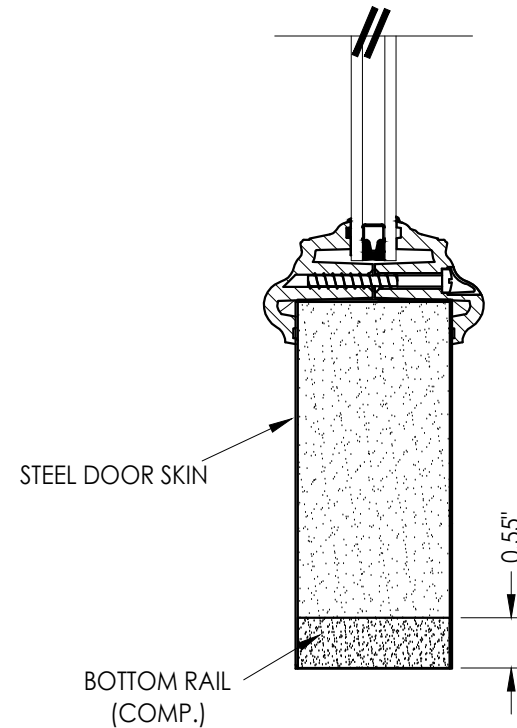

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
SIDELITE PANEL / GLAZING
DETAILS

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC LFS

DATE: 10/11/17


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-21132.3


SHEET 4 OF 14

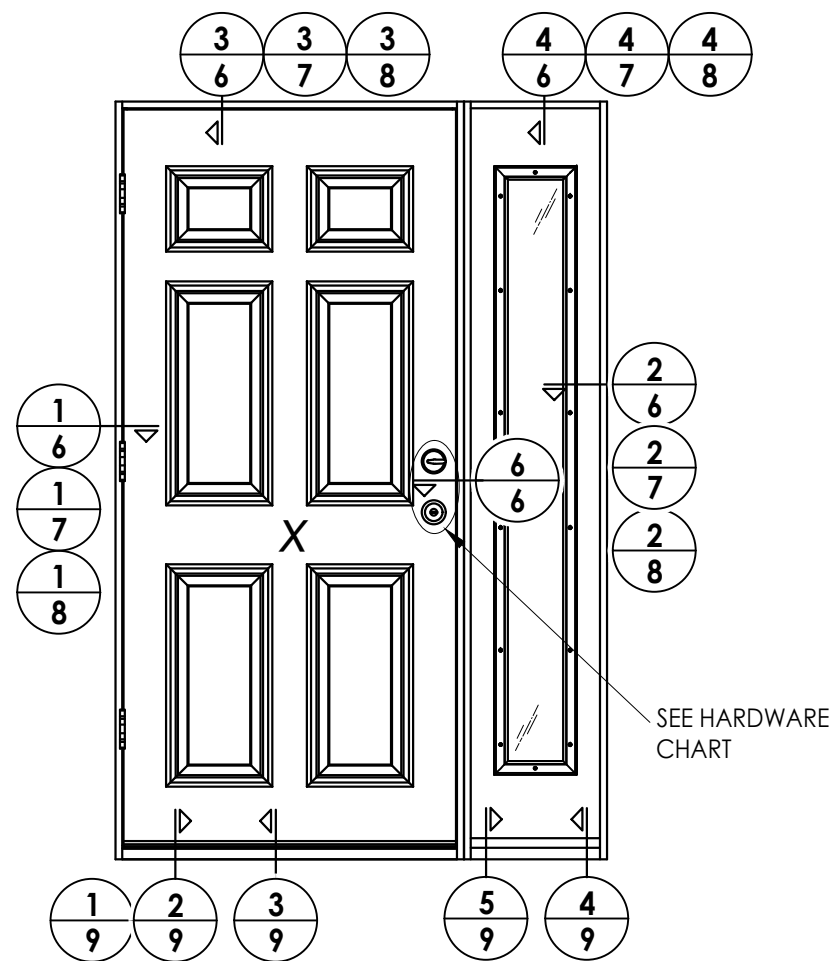

ELEVATION
XO

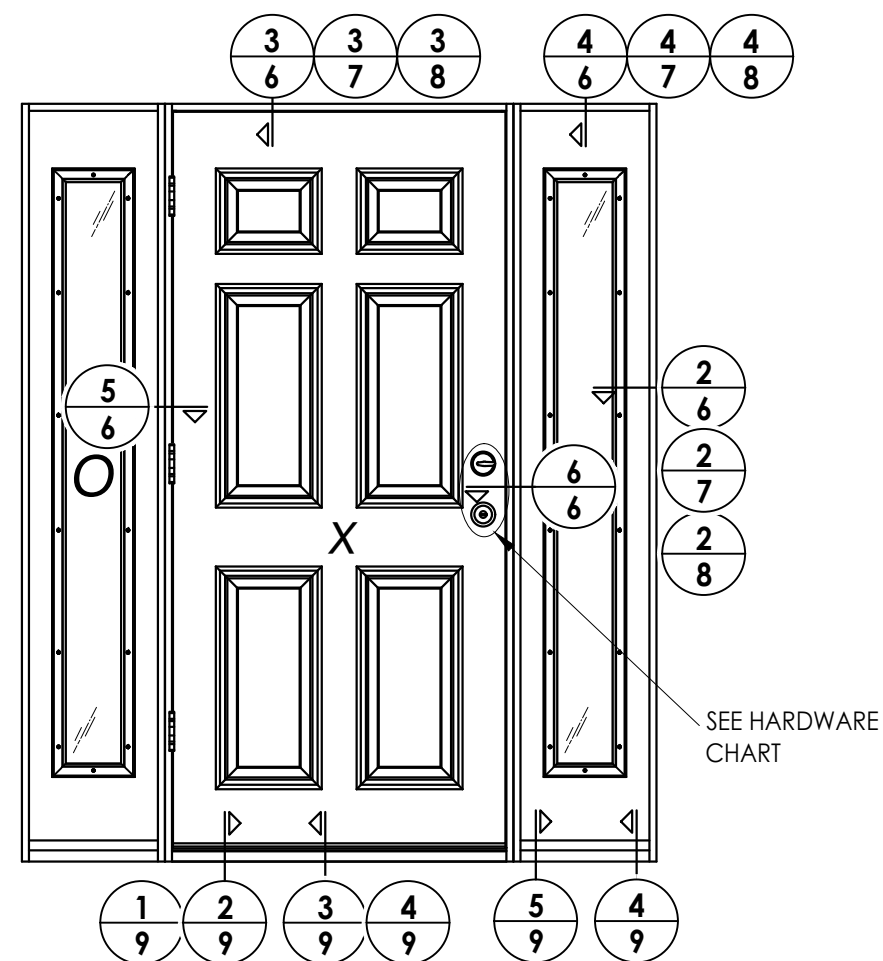

ELEVATION
OXO

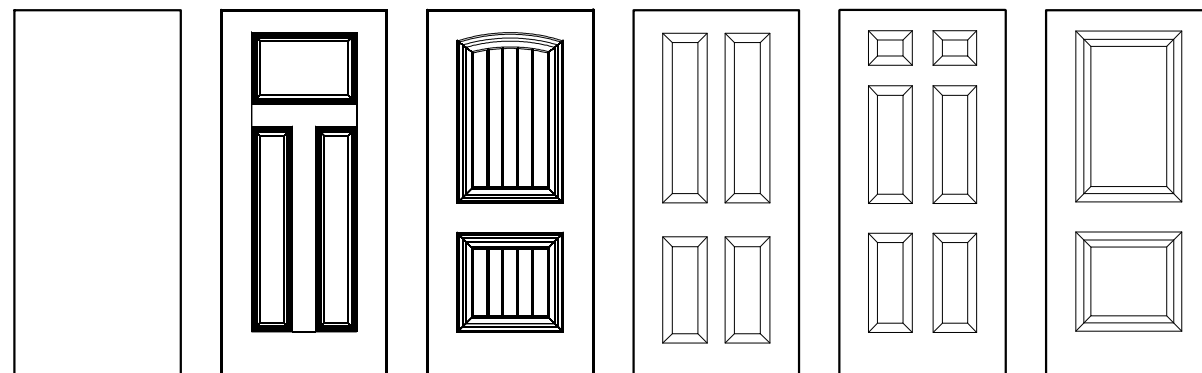

Hardware Table		
Manufacturer	Model	
Schlage	Knob:	F51
	Deadbolt:	B60
Kwikset	Knob:	Signature Series
	Deadbolt:	Signature Series (980)

3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
1	7/20/20	UPDATE TO 7th ED (2020)	FBC	LFS	
NO.	DATE			BY	


DATE:	10/11/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21132.3
SHEET	5 OF 14

PRODUCT:	THERMA-TRU STEEL DOOR
PART OR ASSEMBLY:	ELEVATIONS


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

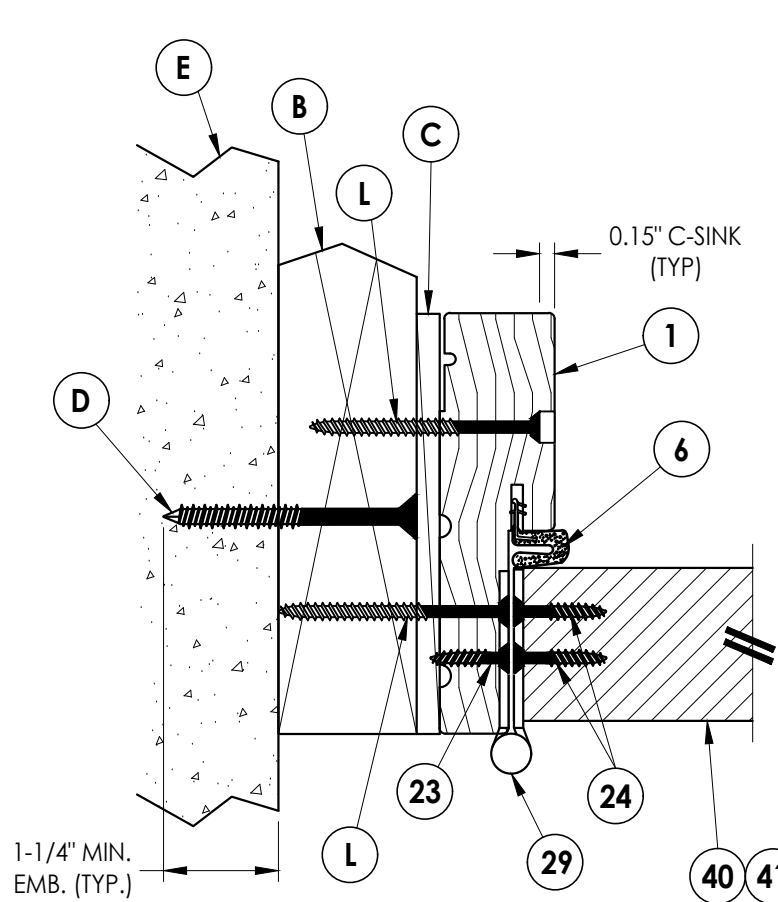


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

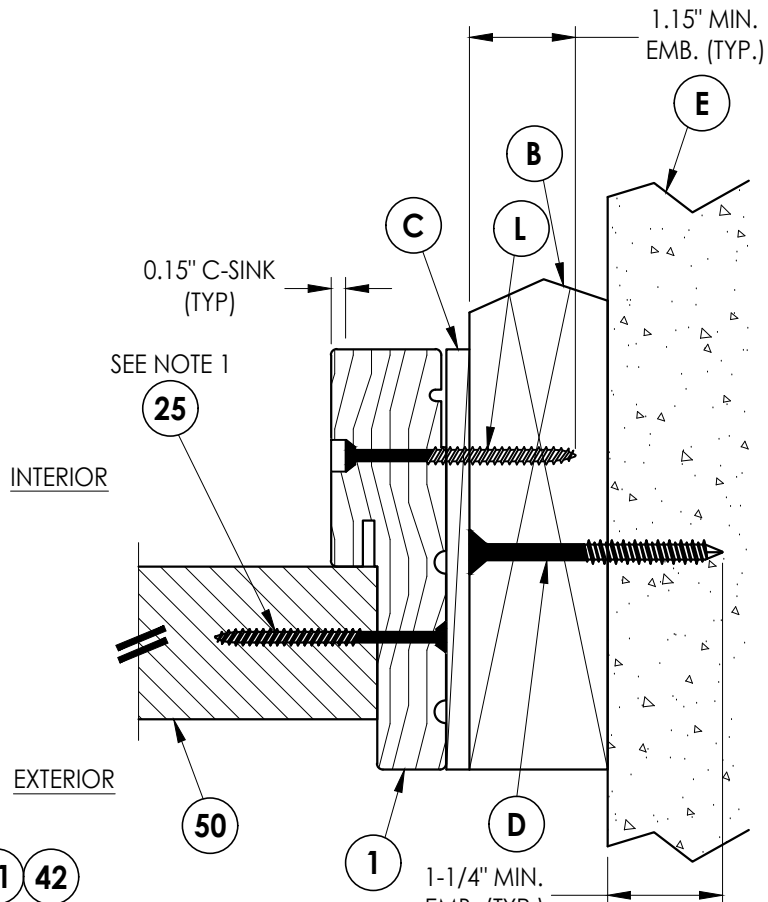

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

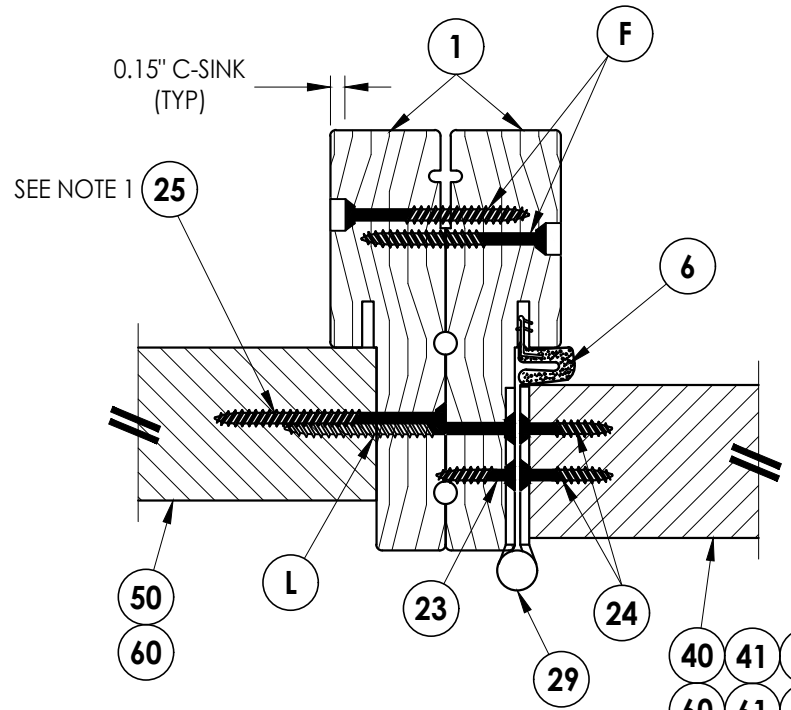


5
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

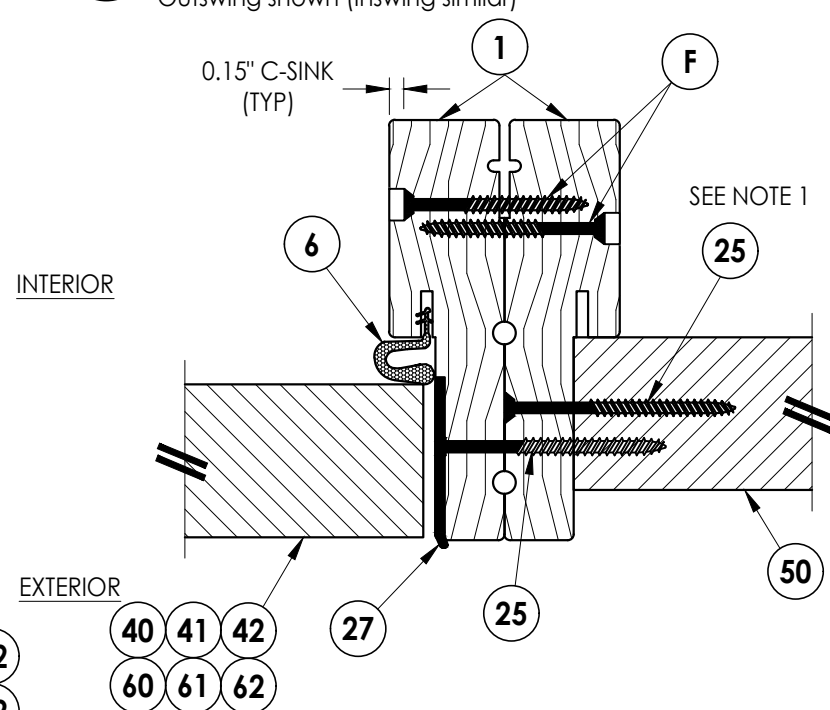


6
6 **HORIZONTAL CROSS SECTION**
Outswing shown (Inswing similar)

Notes:

1. Sidelite assembly screws located 8" from top and 8" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

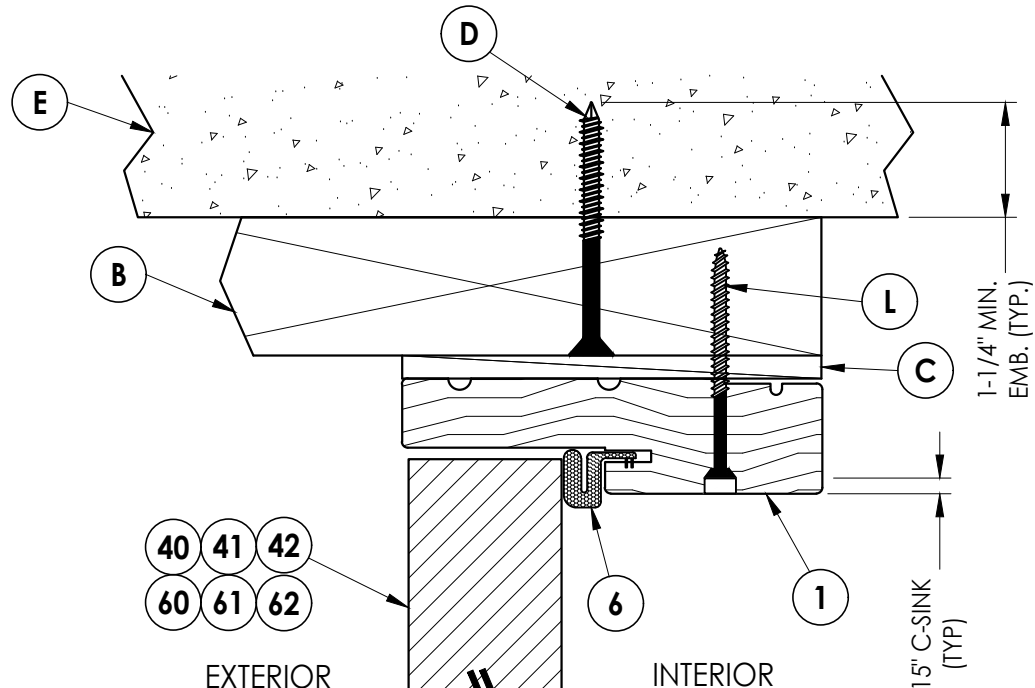

3
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

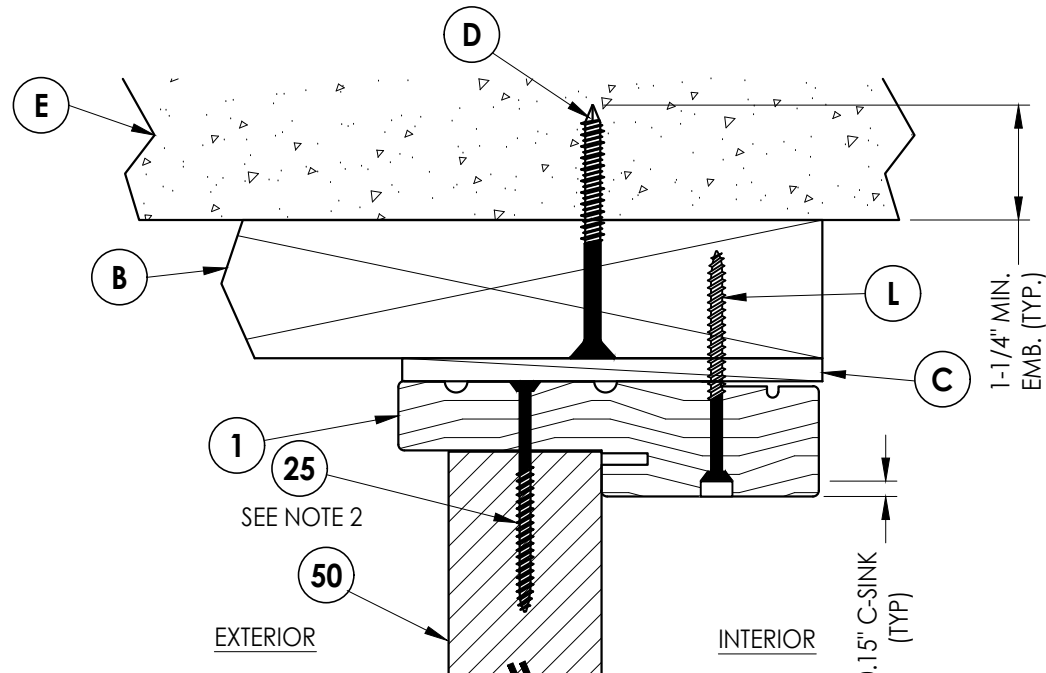

4
6 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC LFS

DATE: 10/11/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:

FL-21132.3


SHEET 6 OF 14

1. Sidelite assembly screws located 8" from top and 8" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

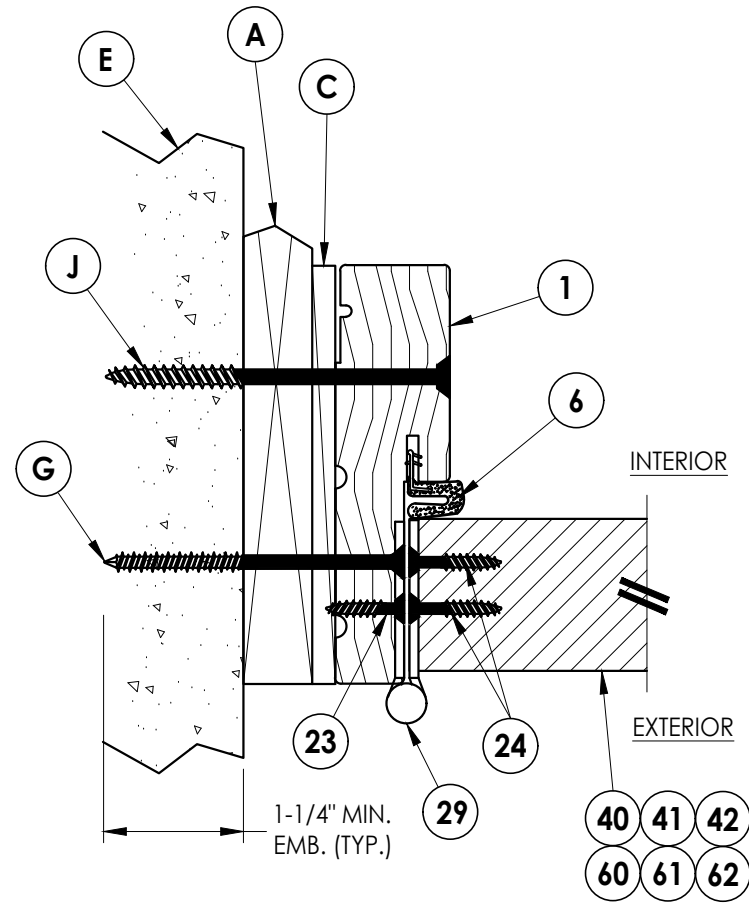


1 7 **HORIZONTAL CROSS SECTION**

Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

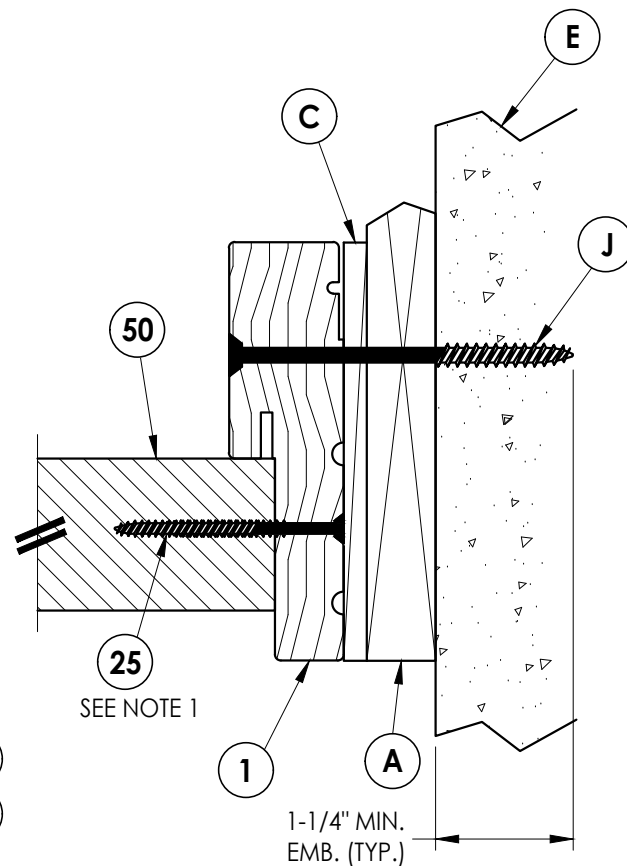


2 7 **HORIZONTAL CROSS SECTION**

Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

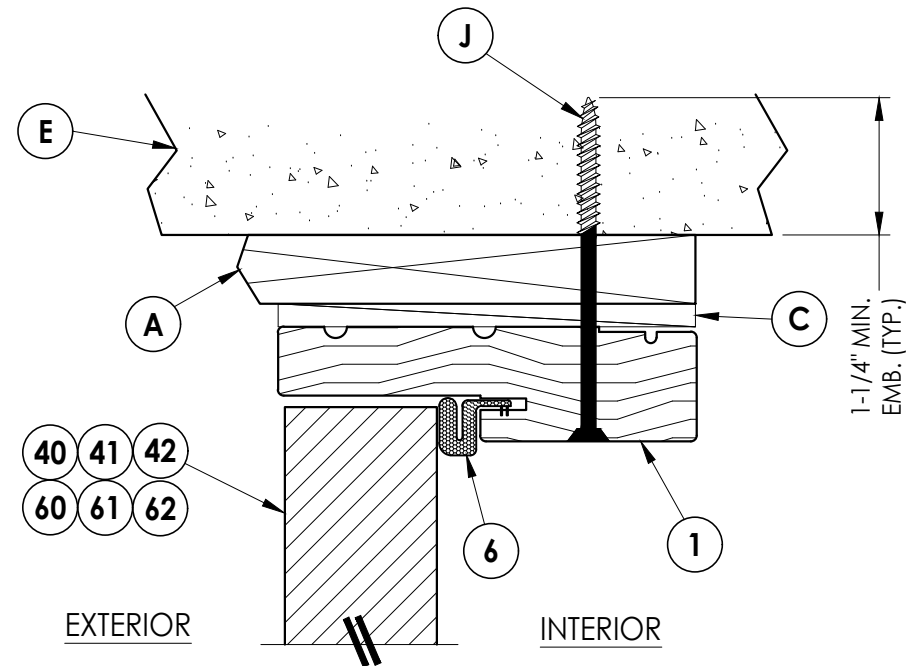

3 **VERTICAL CROSS SECTION**
7 Shown w/ 1X sub-buck
 Outswing shown (Inswing similar)

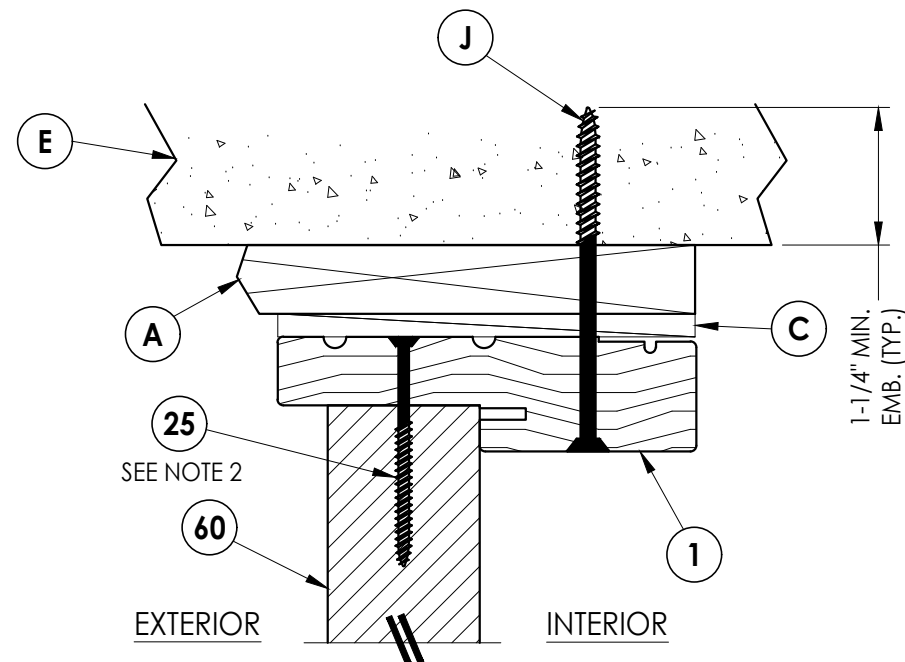


4 **VERTICAL CROSS SECTION**
7 Shown w/ 1X sub-buck
 Outswing shown (Inswing similar)

[illegible]


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.

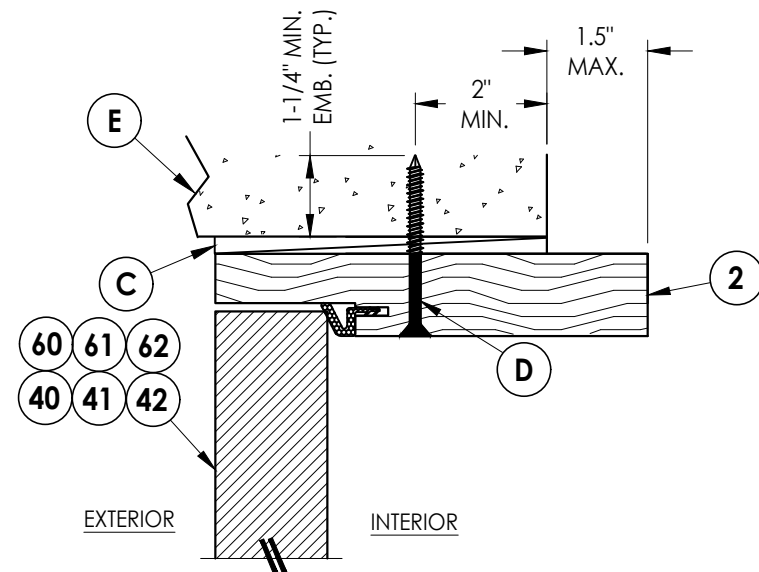


3 **HORIZONTAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

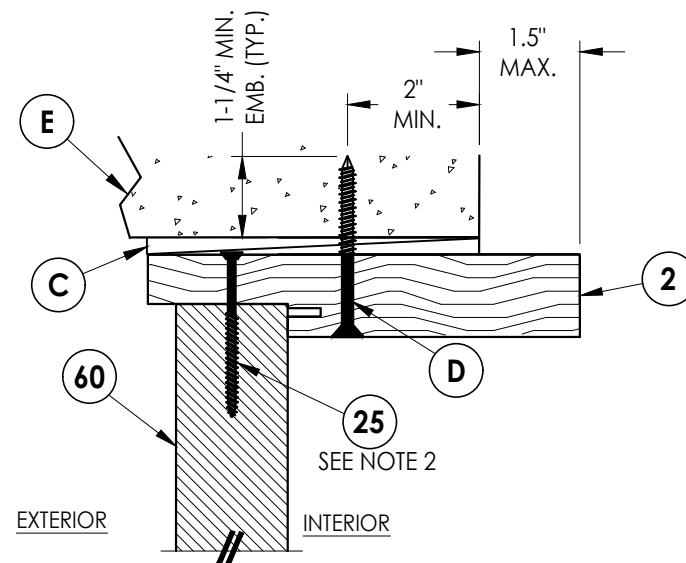


4 **VERTICAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

Notes:

1. Sidelite assembly screws located 8" from top and 8" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

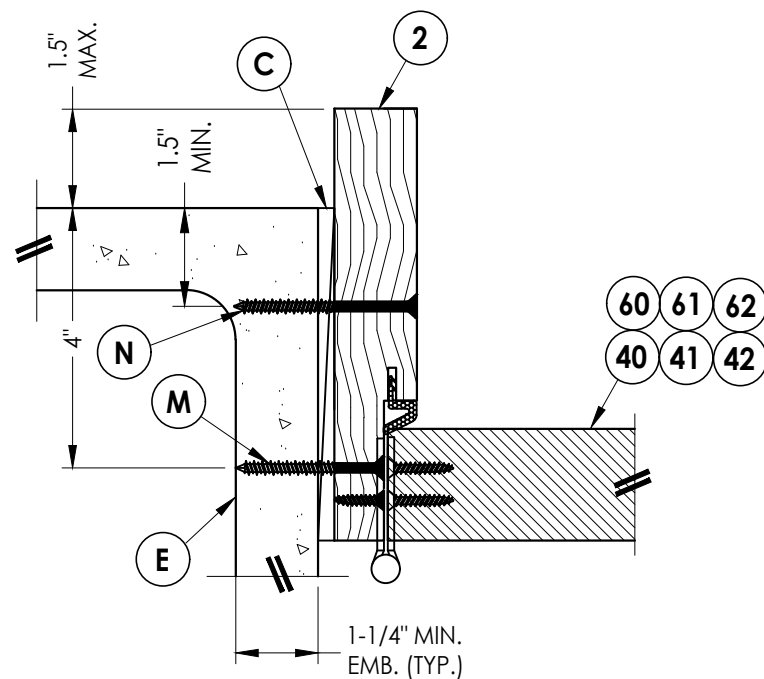

1 **HORIZONTAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb





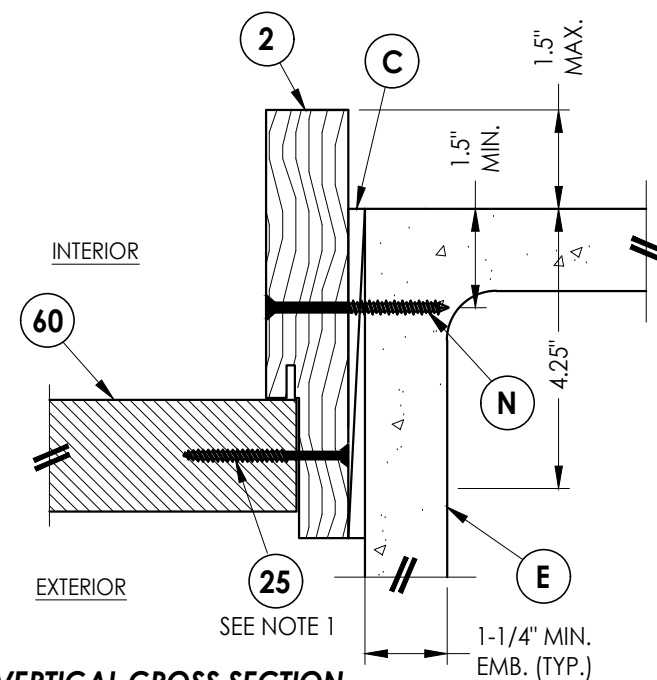


2 **VERTICAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

DATE: 10/11/17				PRODUCT:				Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409			
SCALE: N.T.S.				THERMA-TRU STEEL DOOR				RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
DWG. BY: JK				PART OR ASSEMBLY:							
CHK. BY: LFS				HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)							
DRAWING NO.: FL-21132.3											
SHEET 8 OF 14											

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

- Notes:
- Sill Item #'s 16, 32, 33, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 17 & 18 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - Sidelite assembly screws located 4" from each end (2 screws along sill).

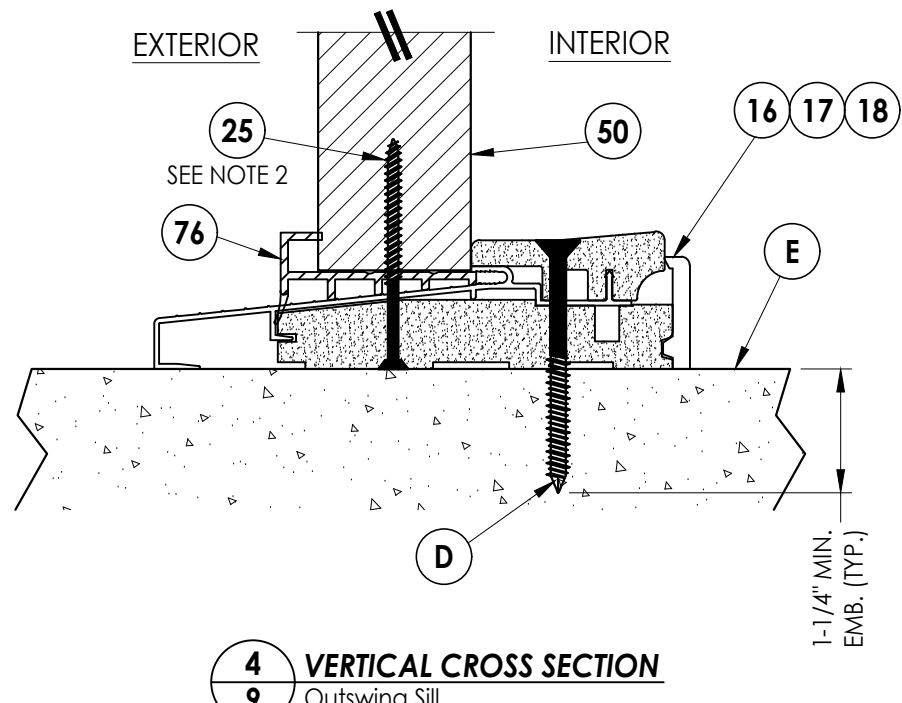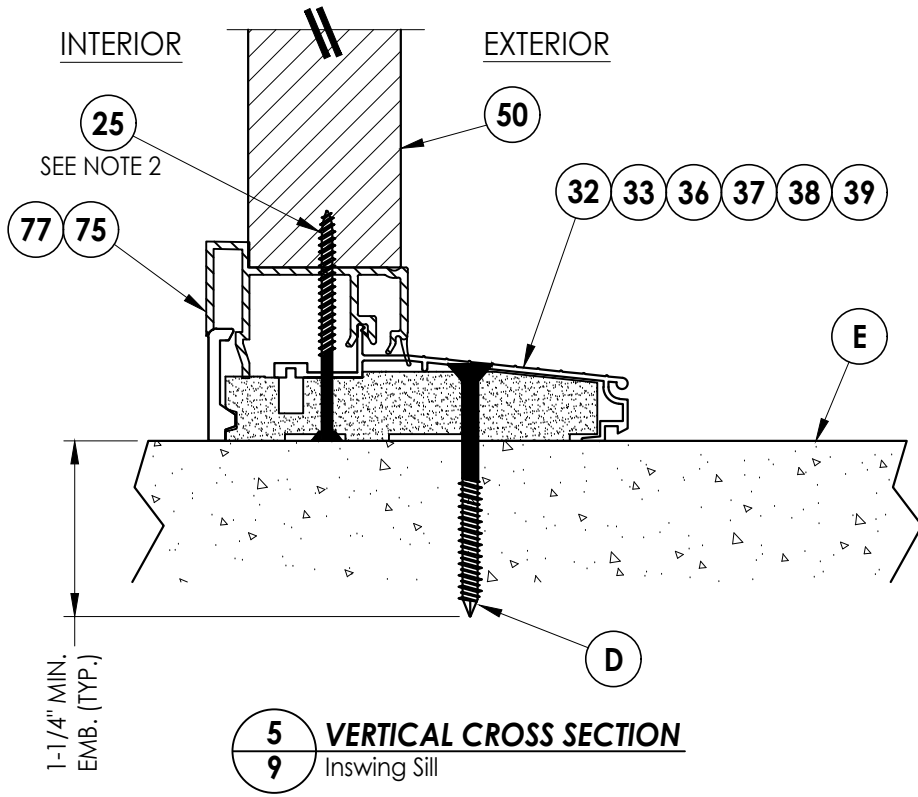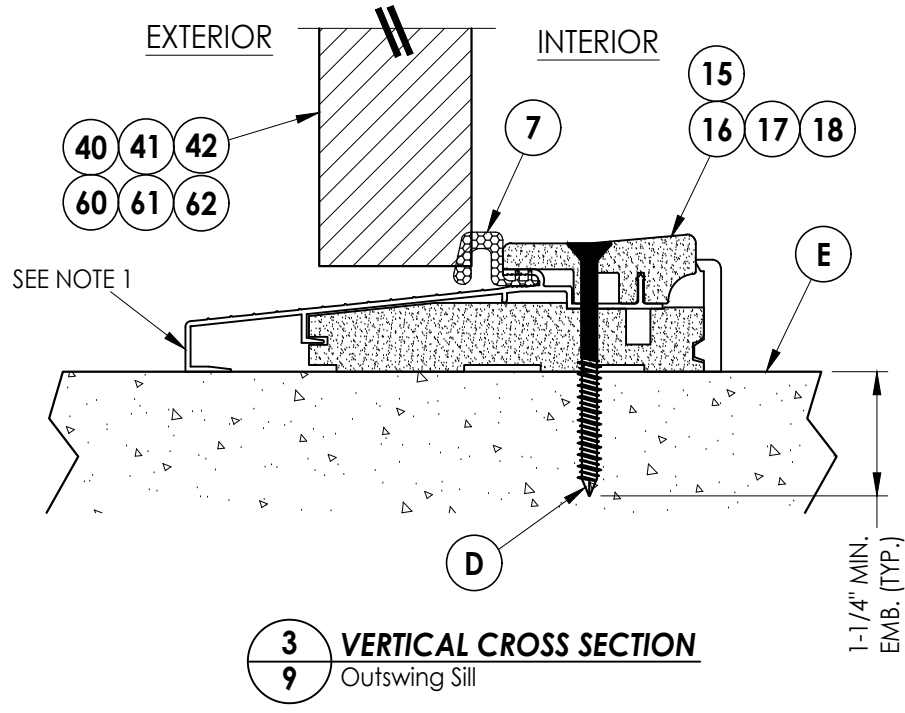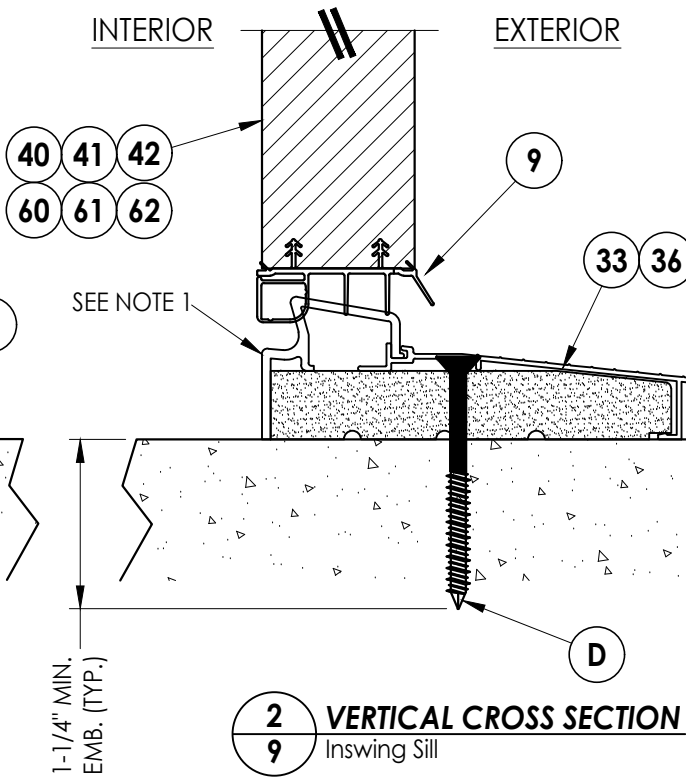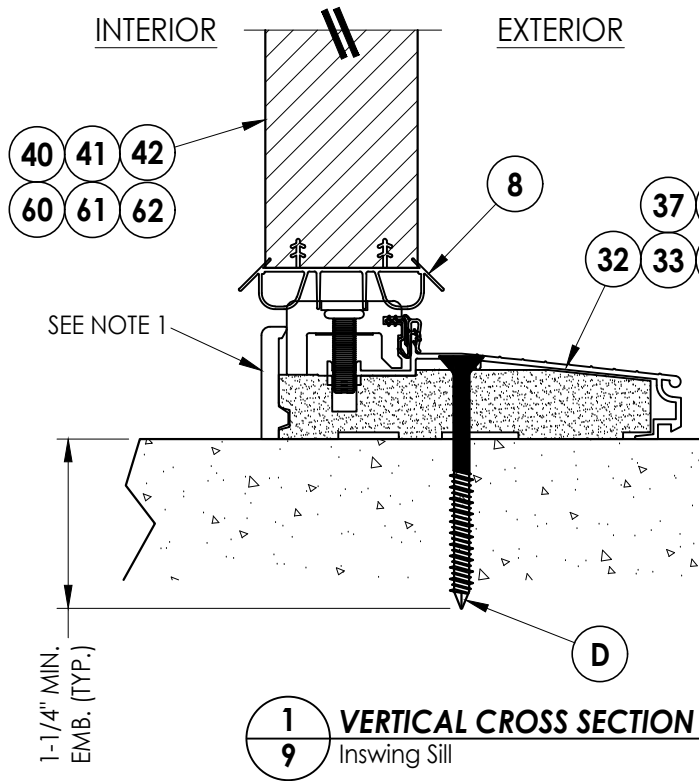

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU STEEL DOOR
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)


NO.	DATE	REVISIONS			
		BY	DATE	DESCRIPTION	DATE
3	7/03/26	LFS		UPDATE TO 9TH ED. (2026) FBC	
2	8/07/23	LFS		UPDATE TO 8TH ED. (2023) FBC	
1	7/20/20	LFS		UPDATE TO 7th ED (2020) FBC	

DATE: 10/11/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21132.3
SHEET 9 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

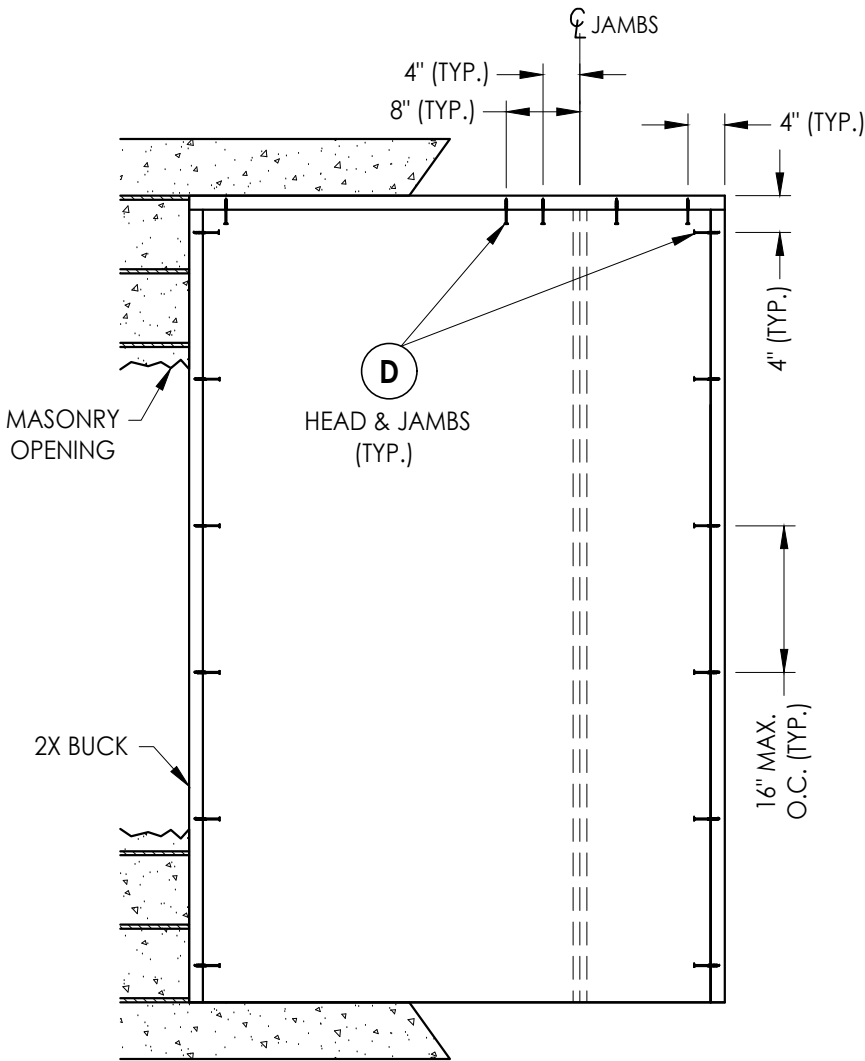

XO/OX

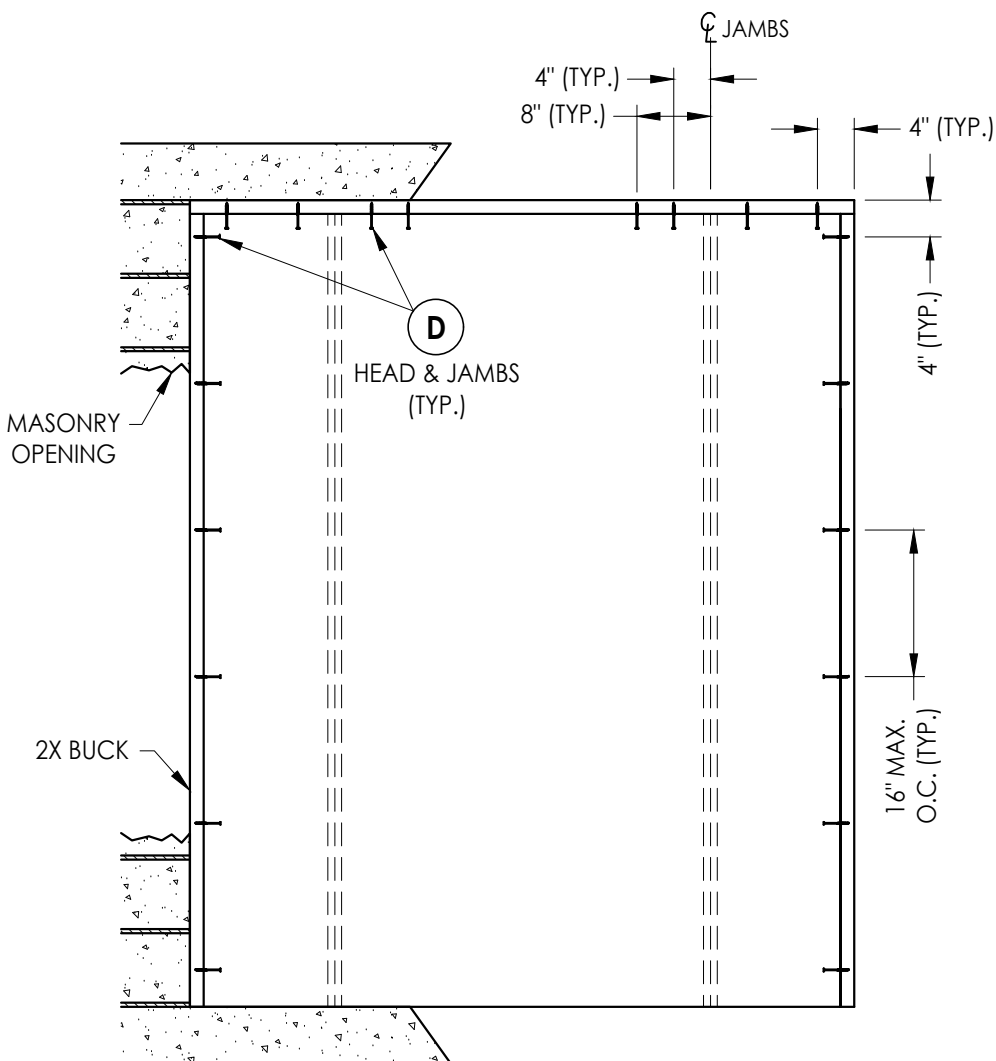


OXO


2X BUCK ANCHORING

DATE: 10/11/17			SHEET 10 OF 14		
SCALE: N.T.S.			DRAWING NO.: FL-21132.3		
DWG. BY: JK			CHK. BY: LFS		
NO			BY		
DATE			REVISIONS		
3	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
2	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
1	7/20/20	UPDATE TO 7th ED (2020)	FBC	LFS	
PRODUCT: THERMA-TRU STEEL DOOR					
PART OR ASSEMBLY: BUCK ANCHORING					
Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409					
BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813					


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

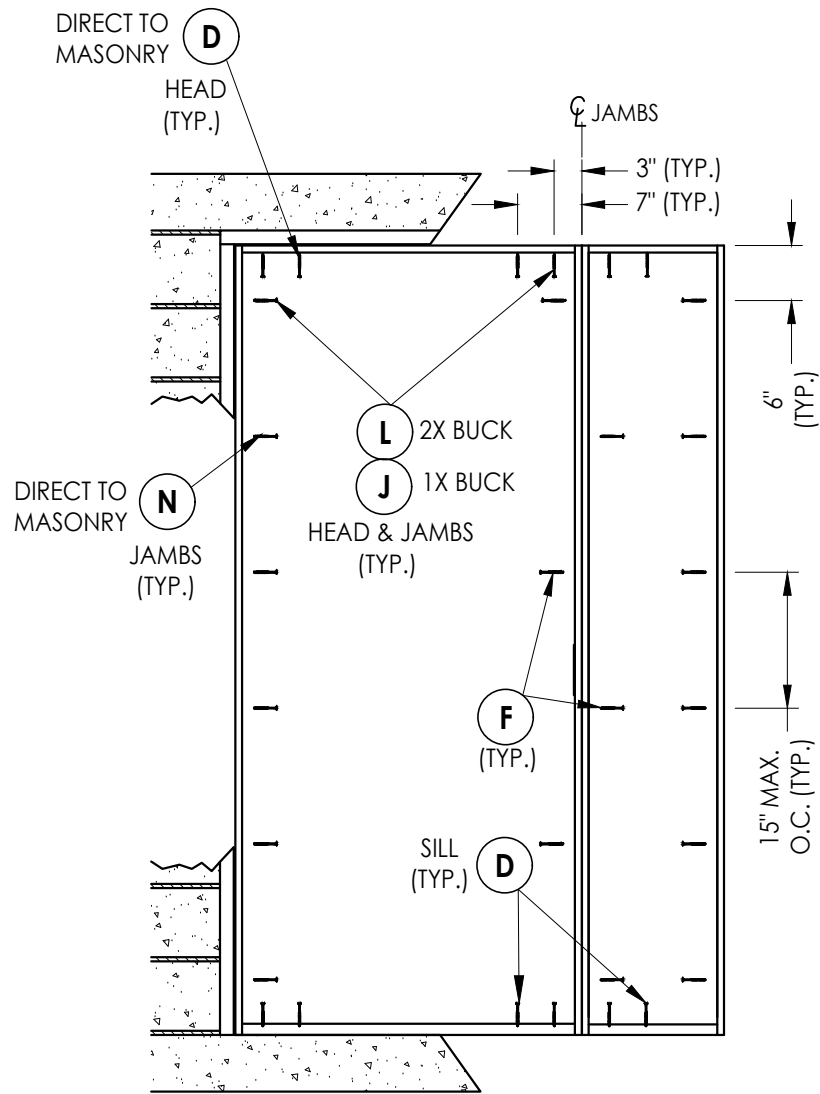

XO/OX

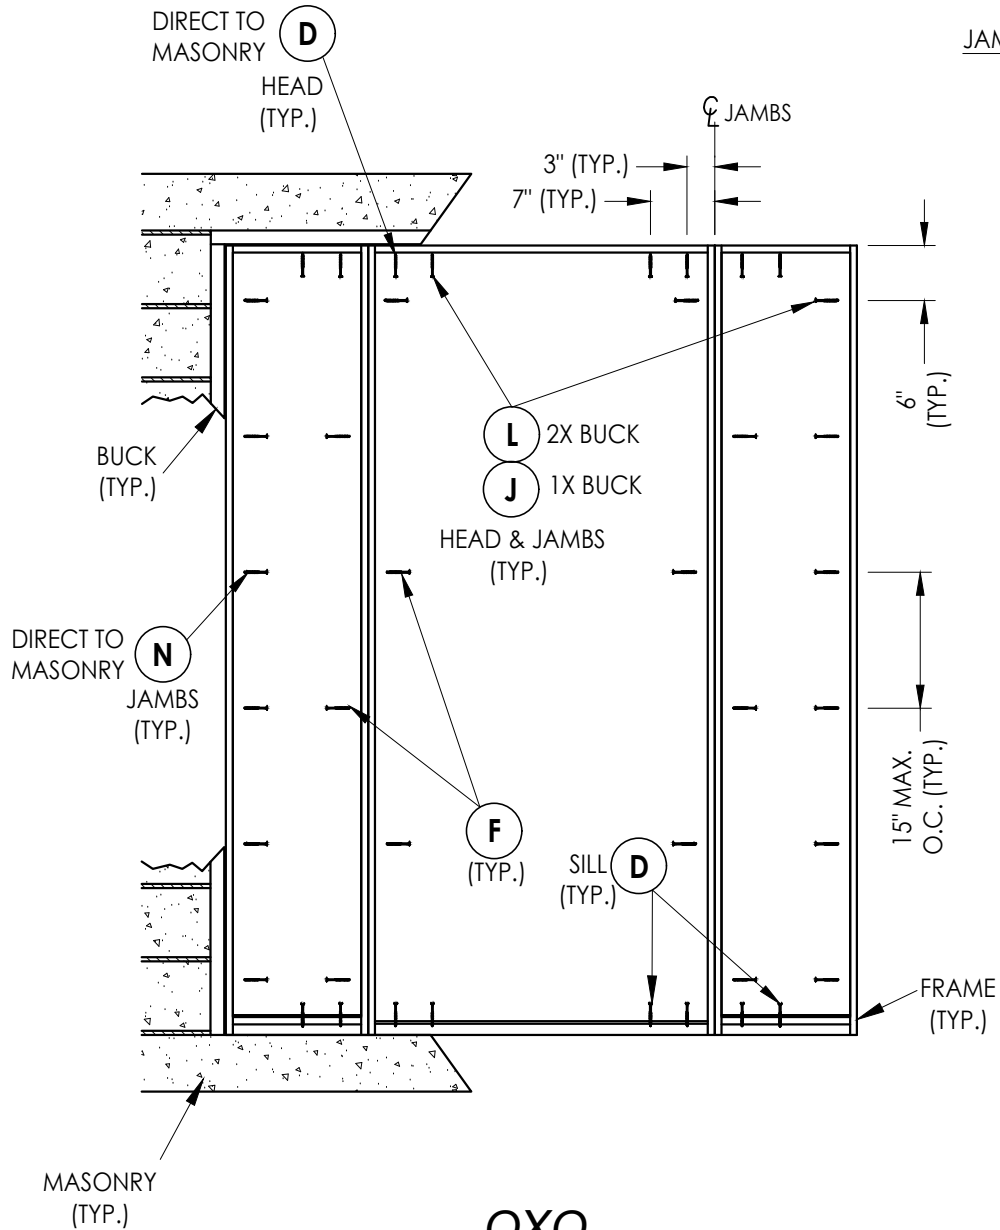

OXO

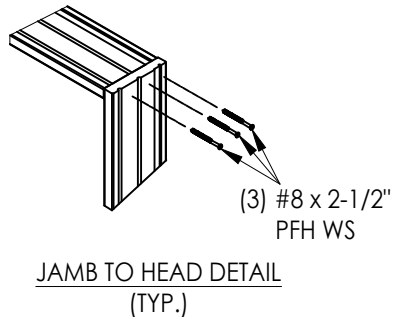

FRAME ANCHORING

REVISIONS	
NO.	DATE
3	7/03/26
2	8/07/23
1	7/20/20


DATE:	10/11/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21132.3
SHEET	11 OF 14

PRODUCT:	THERMA-TRU STEEL DOOR
PART OR ASSEMBLY:	FRAME ANCHORING


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

**BUILDING CONSULTANTS, INC.**
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

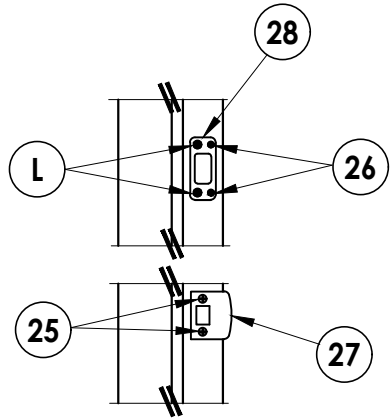


LATCH & DEADBOLT DETAIL
Kwikset

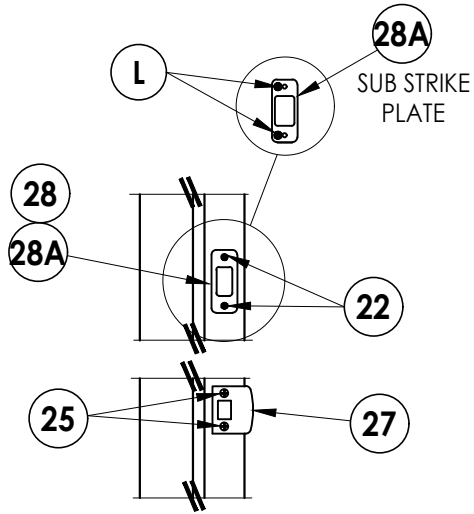


LATCH & DEADBOLT DETAIL
Schlage


LATCH & DEADBOLT STRIKE DETAILS

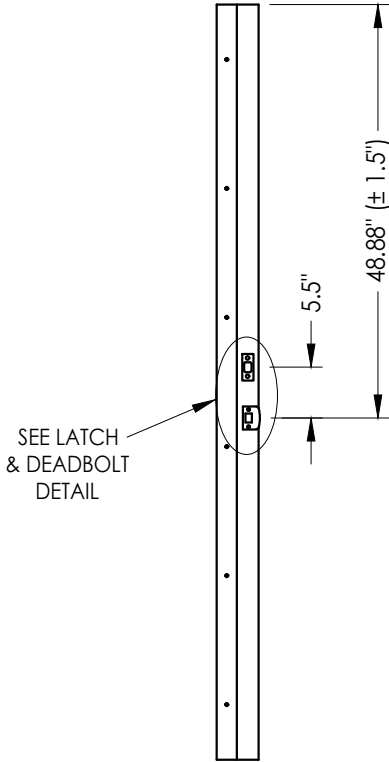

STRIKE JAMB
Latch and Deadbolt

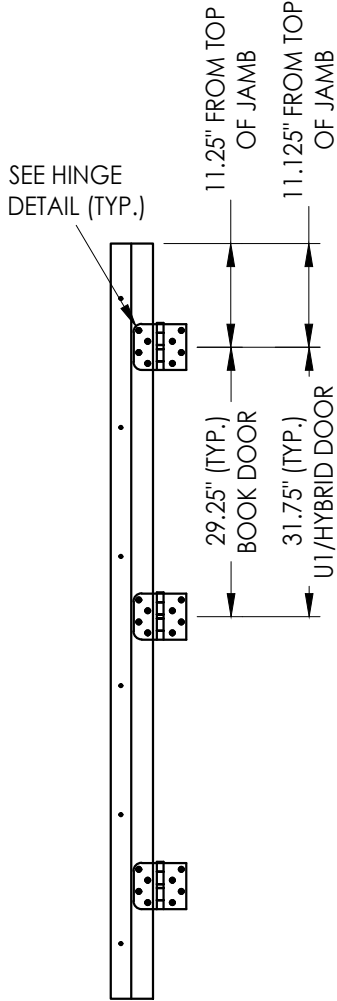

HINGE JAMB

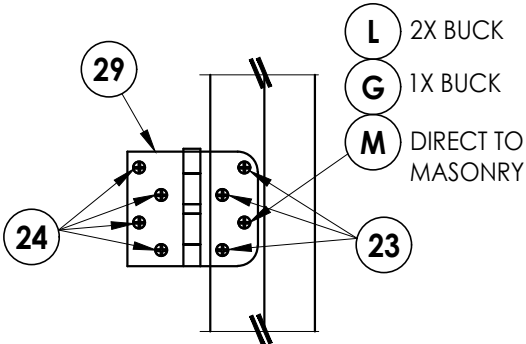

HINGE DETAIL

NO.	DATE	REVISIONS
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC LFS
		BY

DATE: 10/11/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-21132.3

SHEET 12 of 14


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21132 R3\FL-21132.1-5.dwg

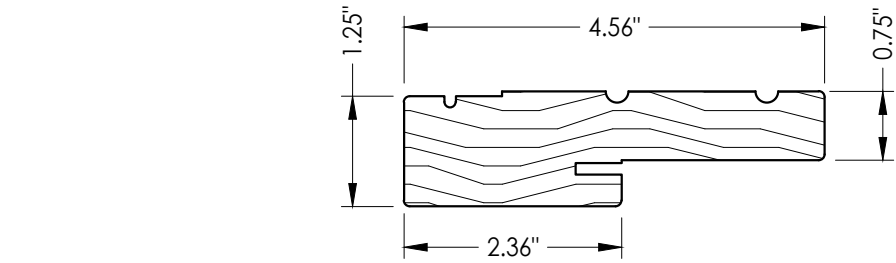


1 WOOD JAMB

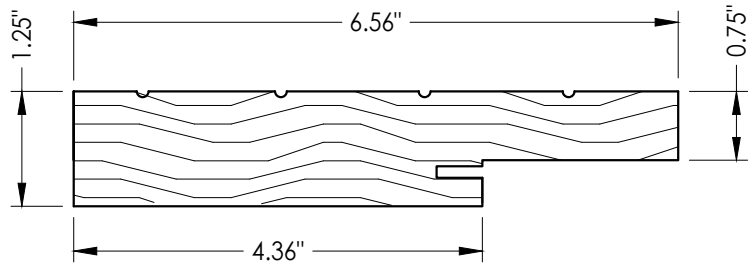


2 WOOD JAMB

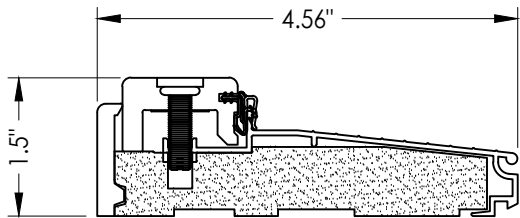


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

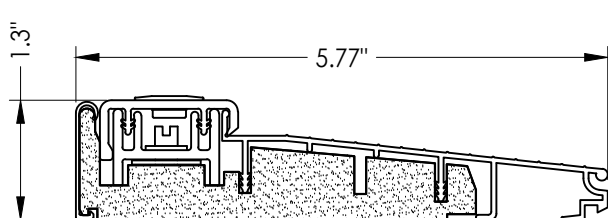


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

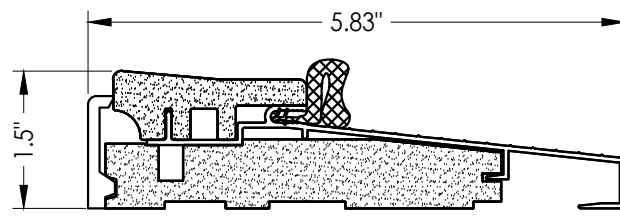


16 OUTSWING THRESHOLD
Composite Sill

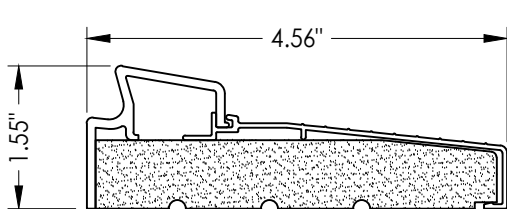


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

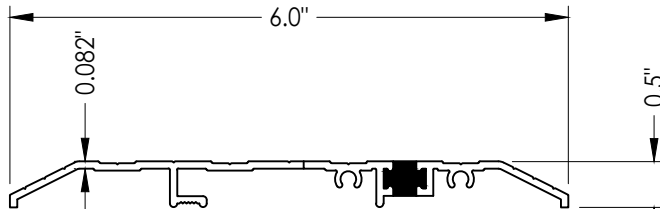


15 PUBLIC ACCESS THRESHOLD

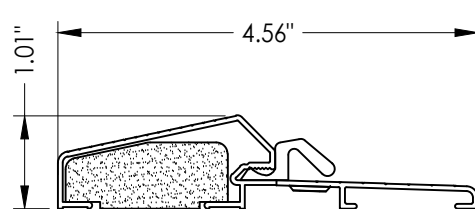


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

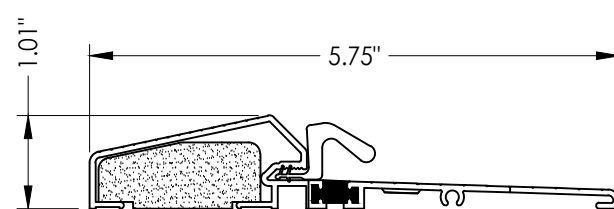


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

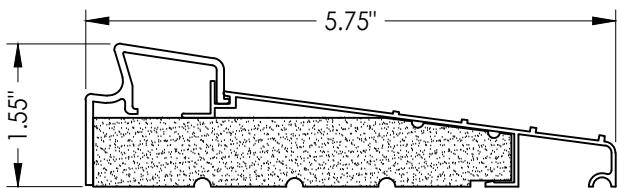


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

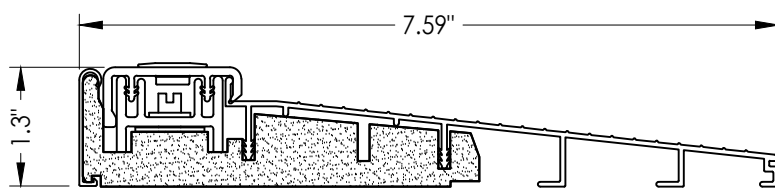


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

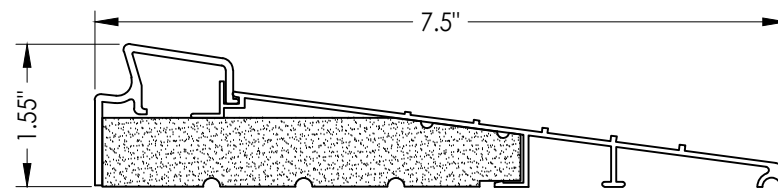


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

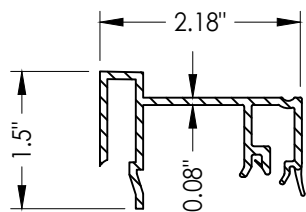


75 SIDELITE SPACER
Inswing




76 SIDELITE SPACER
Outswing

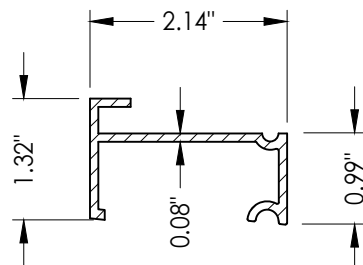


77 SIDELITE SPACER
Inswing



8 SWEEP



9 SWEEP



10 SWEEP

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS	BY
3	7/03/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/20/20	UPDATE TO 7th ED (2020) FBC	LFS

DATE: 10/11/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21132.3

SHEET 13 OF 14

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			29	4" X 4" HINGE	STEEL
F	#10 X 2" PFH WOOD SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	38	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	39	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	40	DOOR PANEL (BOOK) - "PROFILES" SERIES	-
2	JAMB (FINGER JOINT PINE)	WOOD	41	DOOR PANEL (HYBRID) - "PROFILES" SERIES	-
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	42	DOOR PANEL (U1) - "PROFILES" SERIES	-
7	WEATHERSTRIP (LONG REACH)	FOAM	50	SIDELITE (FULL LITE)	-
8	SWEEP	VINYL	60	DOOR PANEL (BOOK) - "TRADITIONS" SERIES	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	61	DOOR PANEL (HYBRID) - "TRADITIONS" SERIES	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	62	DOOR PANEL (U1) - "TRADITIONS" SERIES	-
11	#8-10 X 1-1/2" PLASCREW	STEEL	75	SIDELITE SPACER (INSWING)	PVC
12	#6-18 X 1-3/4" PFH SCREW	STEEL	76	SIDELITE SPACER (OUTSWING)	PVC
15	PUBLIC ACCESS THRESHOLD	ALUM	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
16	OUTSWING THRESHOLD	ALUM/COMP	CORROSION RESISTANCE - SALTWATER ENVIRONMENTS Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or 1711.2 CONCRETE ANCHOR NOTES:		
17	OUTSWING THRESHOLD	ALUM/COMP			
18	OUTSWING THRESHOLD	ALUM/COMP			
22	#8 x 3/4" PFH WOOD SCREW	STEEL			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

RV

PRODUCT:

THERMA-TRU
 STEEL DOOR

PART OR ASSEMBLY:

BILL OF MATERIALS

3	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS	
2	8/07/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS	
1	7/20/20	UPDATE TO 7th ED	(2020)	FBC	LFS	
NO.	DATE					
						REVISIONS

DATE: 10/11/17

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21132.3

SHEET 14 OF 14

[illegible]