





Fiber-Classic® & Smooth-Star®

WOOD EDGE
GLAZED FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"NON-IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
6. Fiber-Classic & Smooth-Star Door panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details
3	Door Panel Details
4	Elevations
5	Horizontal & Vertical Cross Sections (2X Buck)
6	Horizontal & Vertical Cross Sections (1X Buck)
7	Horizontal & Vertical Cross Sections (Direct to Masonry)
8	Vertical Cross Sections (Thresholds)
9	Buck & Frame Anchoring
10	Hardware Details
11	Glazing Details
12	Components
13	Bill of Materials

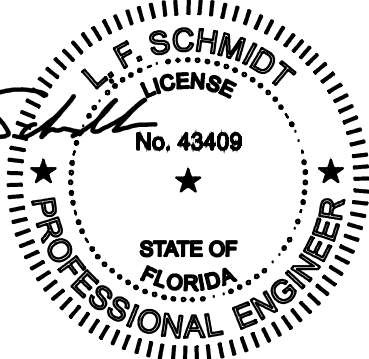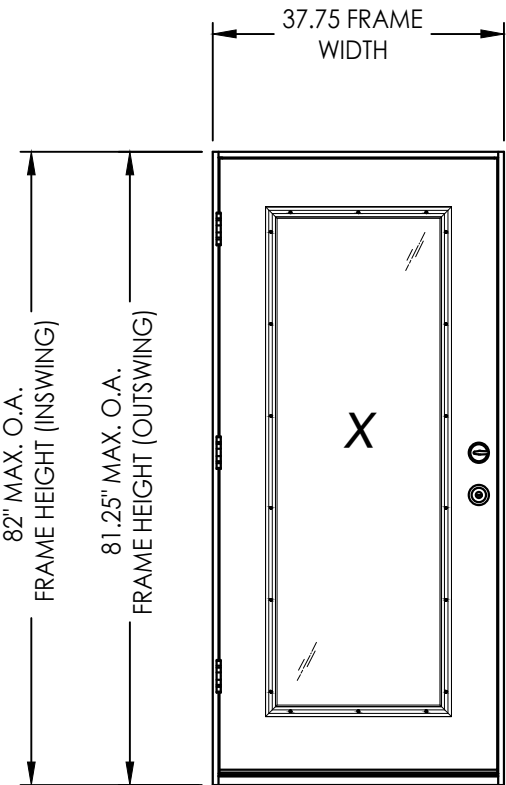

Digitally signed by Lyndon F Schmidt
Date: 2023.08.23 16:04:03 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

CONFIG.	LITE INSERT	DOOR GLAZING MAX. D.L.O.	LOCK HARDWARE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
				POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	Lip Lite	21.12" X 63.12"	Latch & Deadbolt	+50.0	-50.0	+50.0	-50.0
X			Multipoint	+50.0	-50.0	+50.0	-50.0
X	Molded Open	21.12" X 63.12"	Latch & Deadbolt	+50.0	-50.0	+50.0	-50.0
X			Multipoint	+55.0	-55.0	+60.0	-60.0
X	Flush Glazed	24.12" X 63.38"	Latch & Deadbolt	+55.0	-65.0	+55.0	-55.0
X			Multipoint	+55.0	-65.0	+55.0	-55.0
X	Flush Glazed	26.0" X 63.38"	Latch & Deadbolt	+55.0	-65.0	+55.0	-55.0
X			Multipoint	+50.0	-50.0	+50.0	-50.0

See Sheet 4 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION	NOTE	MT
2	3/10/18	REVISE FLUSH GLAZING		RW
1	11/15/17	RECESSED PANEL NOTATION		JK
	NO. 1	DATE		BY
REVISIONS				

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS







DRAWING NO.: FL-21133.9

SHEET 1 OF 13

© 2017 R.W. BUILDING CONSULTANTS INC.

Building Consultants, Inc.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

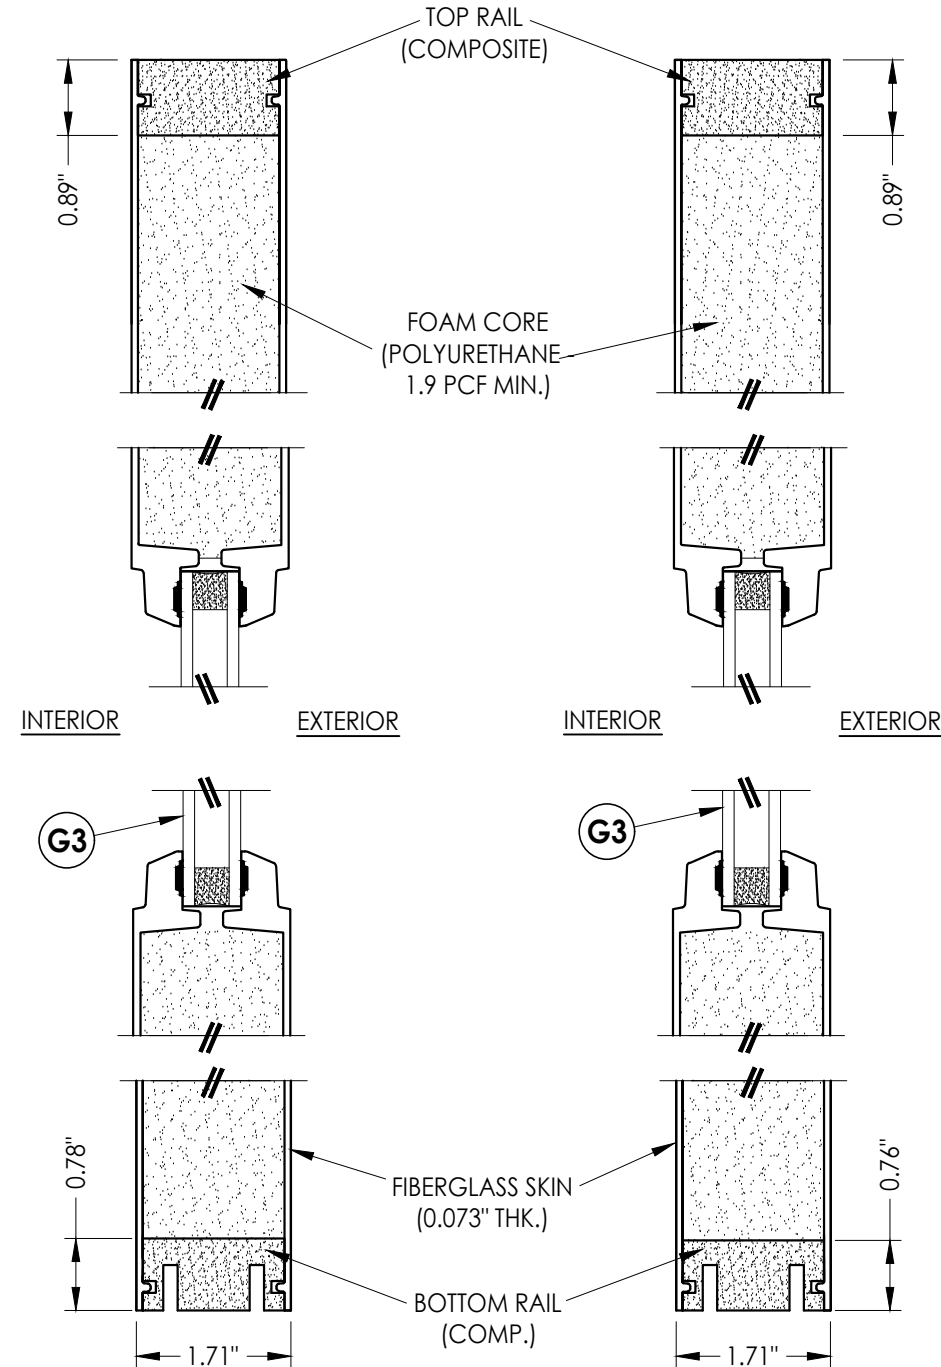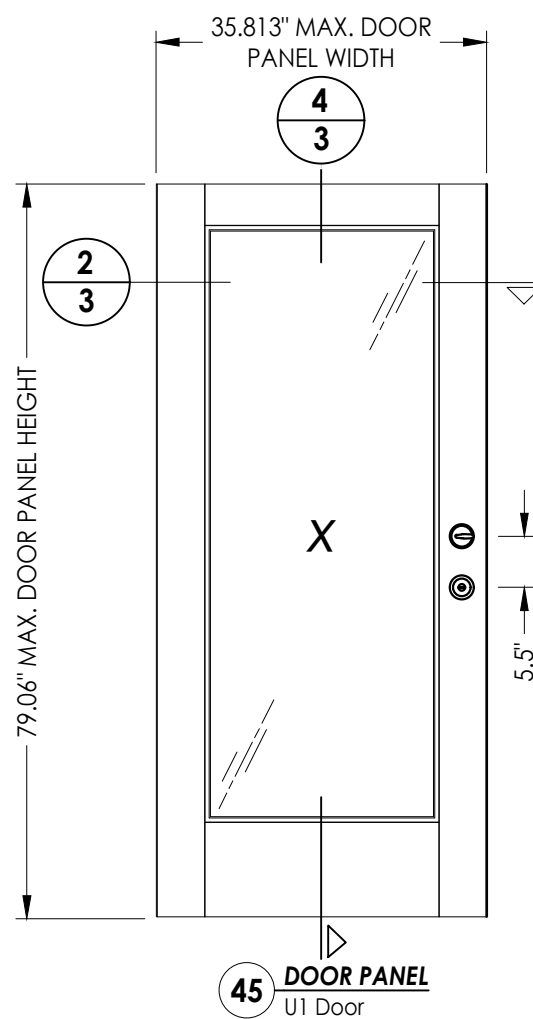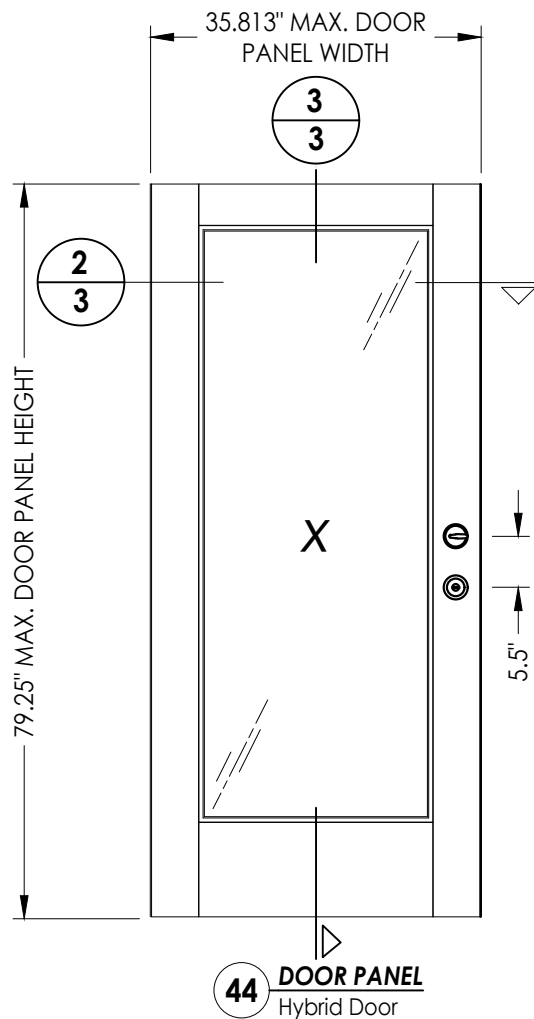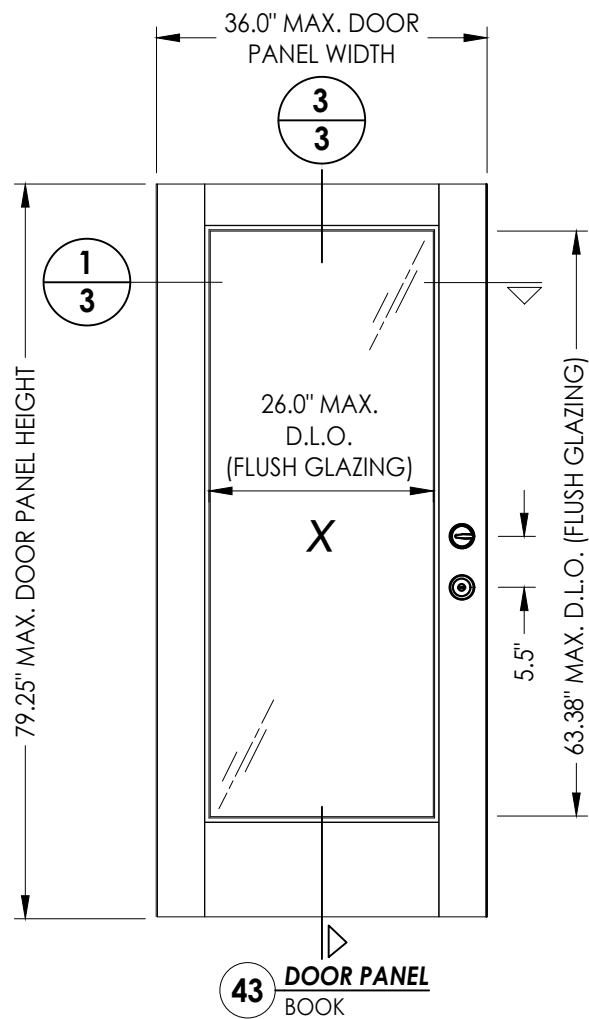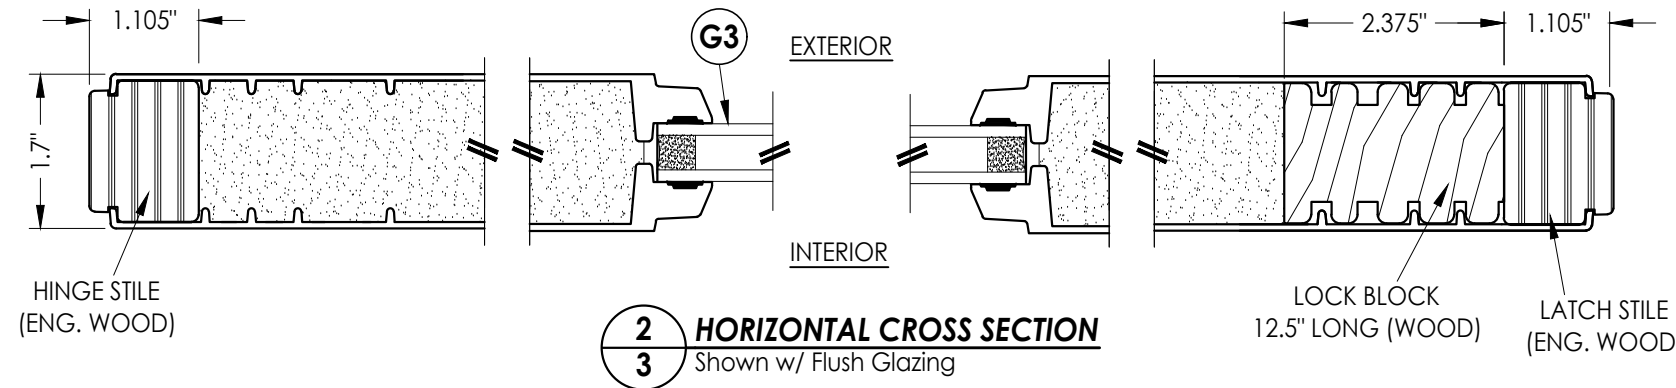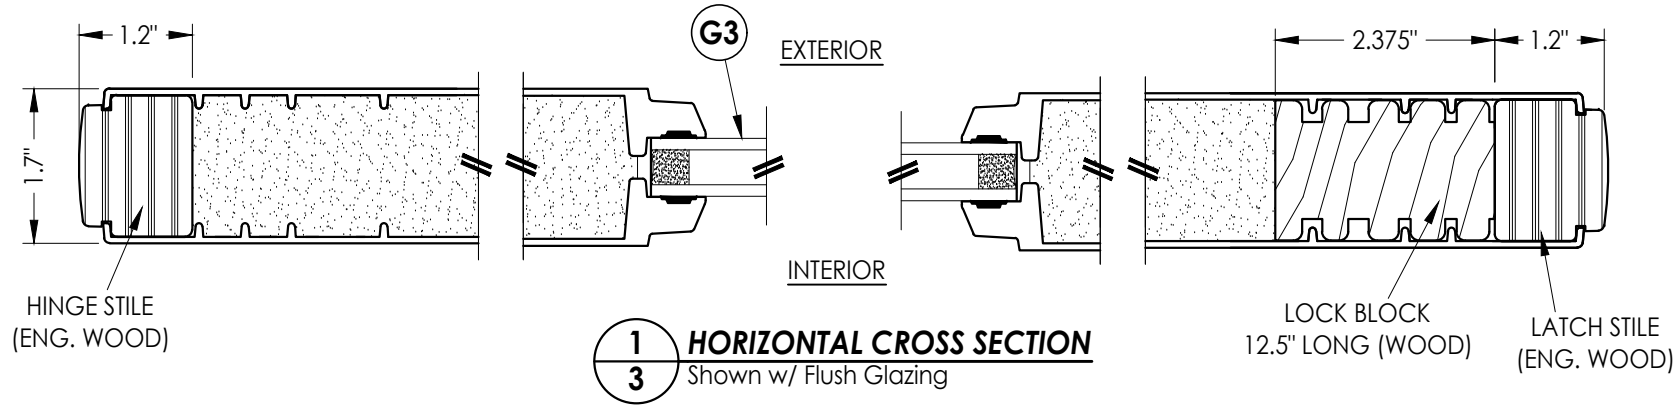

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
5	8/23/23	UPDATE TO 8TH ED. (2023) FBC
4	7/16/20	UPDATE TO 7TH ED. (2020) FBC
3	10/10/18	REV. DOOR PANEL OPTION NOTE
2	3/10/18	REVISE FLUSH GLAZING
1	11/15/17	RECESSED PANEL NOTATION

DATE: 07/07/17


SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21133.9

SHEET 3 OF 13

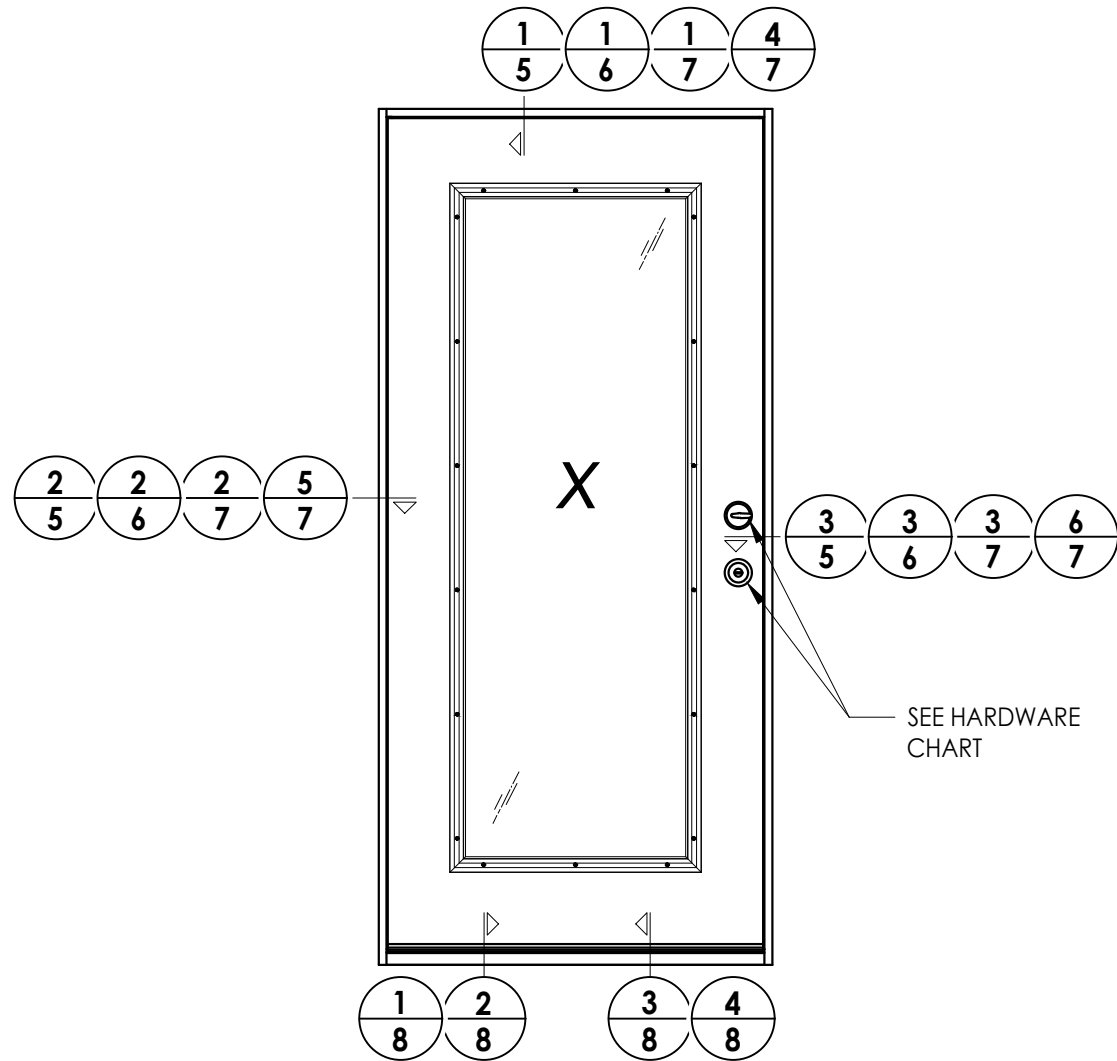

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB: F51 DEADBOLT: B60	
KWIKSET	KNOB: SIGNATURE SERIES DEADBOLT: SIGNATURE SERIES (980)	
HOPPE	MULTIPOINT : HLS 9000 SERIES (3 pt. Manual Tongue)	

Fiber-Classic/Smooth-Star Door Panel Options

Products approved include all embossed and recessed panel doors.
Similar glazed panel configurations are allowed.
Panels shown are for illustration and are representative only.

5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION	NOTE	MT
2	3/10/18	REVISE FLUSH GLAZING		RW
1	11/15/17	RECESSED PANEL NOTATION		JK
NO.	DATE			BY
			REVISIONS	


DATE:	07/07/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21133.9
SHEET	4 OF 13

PRODUCT: THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY: ELEVATIONS

RW BUILDING CO
P.O. Box 2
Phone No.:
FBPE Regis


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

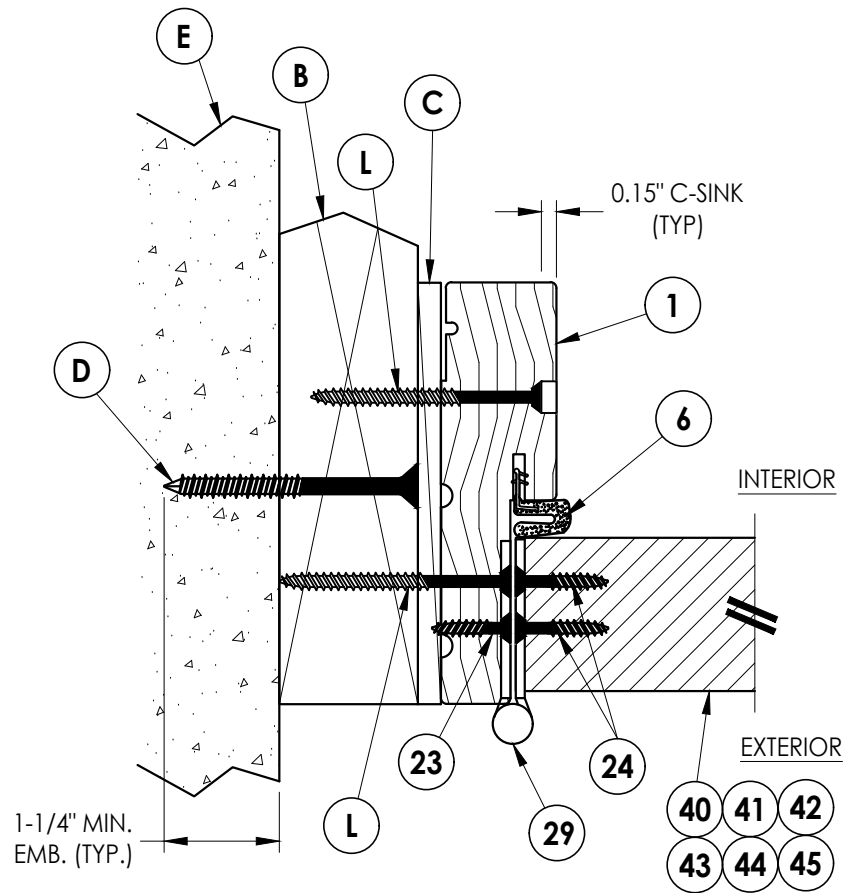

2 HORIZONTAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

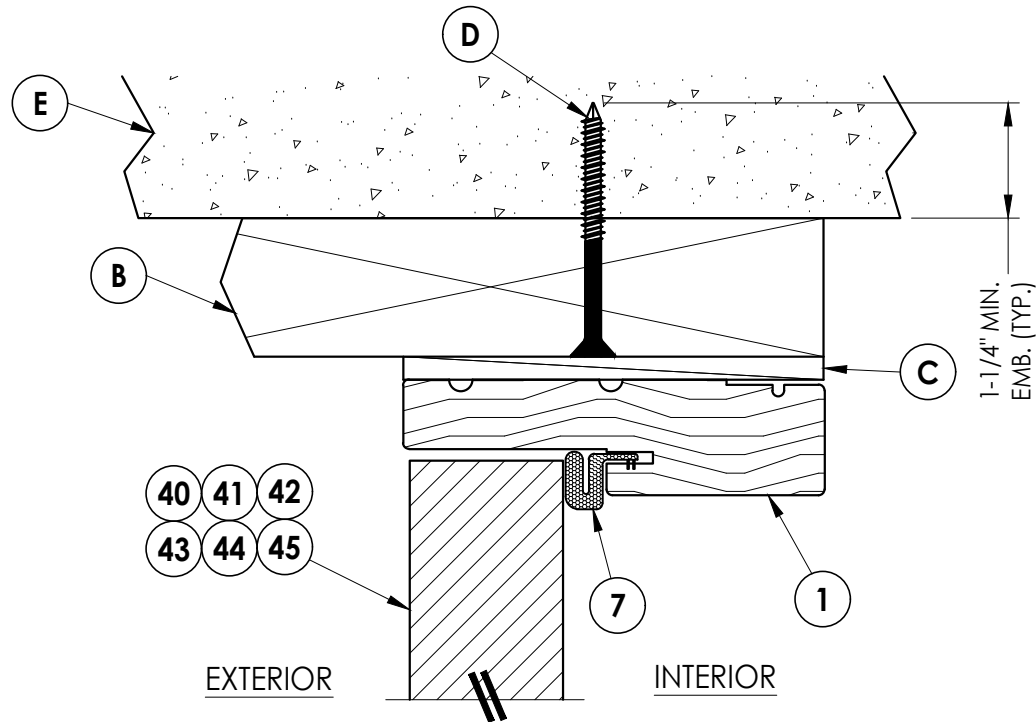

1 VERTICAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

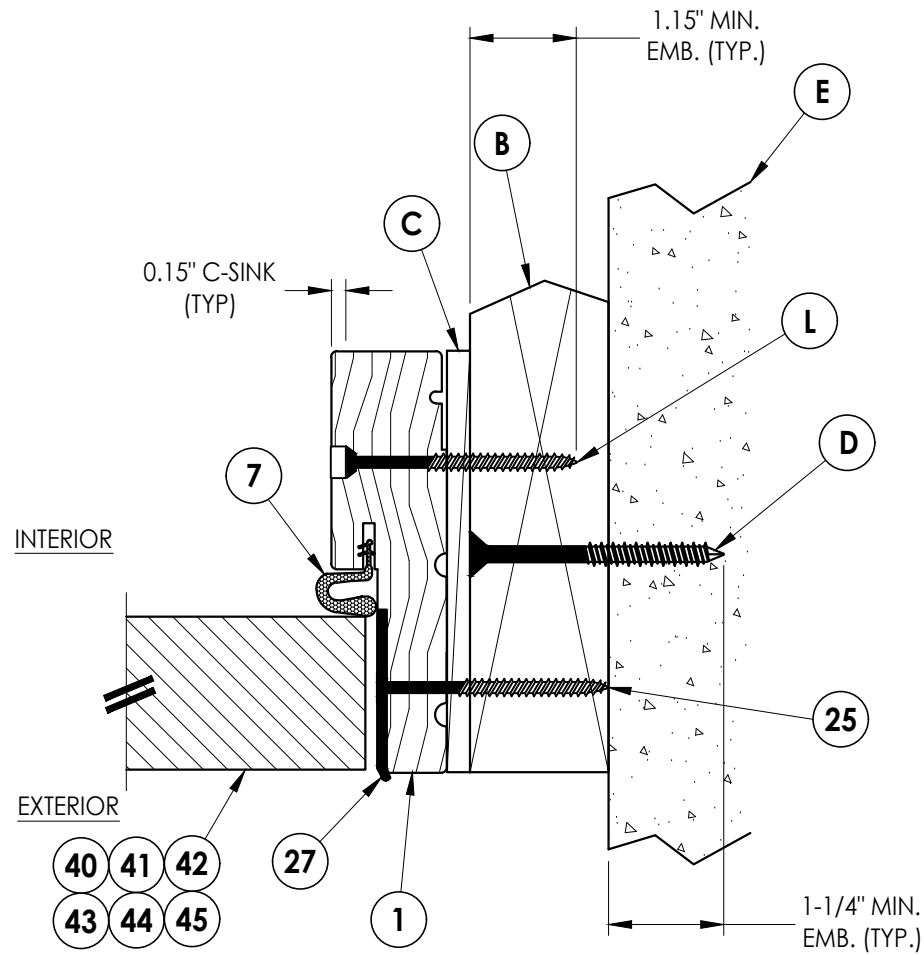


3 HORIZONTAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

NO.	DATE	REVISIONS					
		BY	JK	RW	MT	FBC	LFS
5	8/23/23	DATE	DATE	DATE	DATE	DATE	DATE
4	7/16/20	DATE	DATE	DATE	DATE	DATE	DATE
3	10/10/18	DATE	DATE	DATE	DATE	DATE	DATE
2	3/10/18	DATE	DATE	DATE	DATE	DATE	DATE
1	11/15/17	DATE	DATE	DATE	DATE	DATE	DATE


DATE: 07/07/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21133.9
SHEET 5 OF 13

PRODUCT:	Therma-Tru FIBERGLASS DOOR
PART OR ASSEMBLY:	HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)

Documents Prepared By:	Lyndon F. Schmidt P.E. No. 43409
RW	BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813

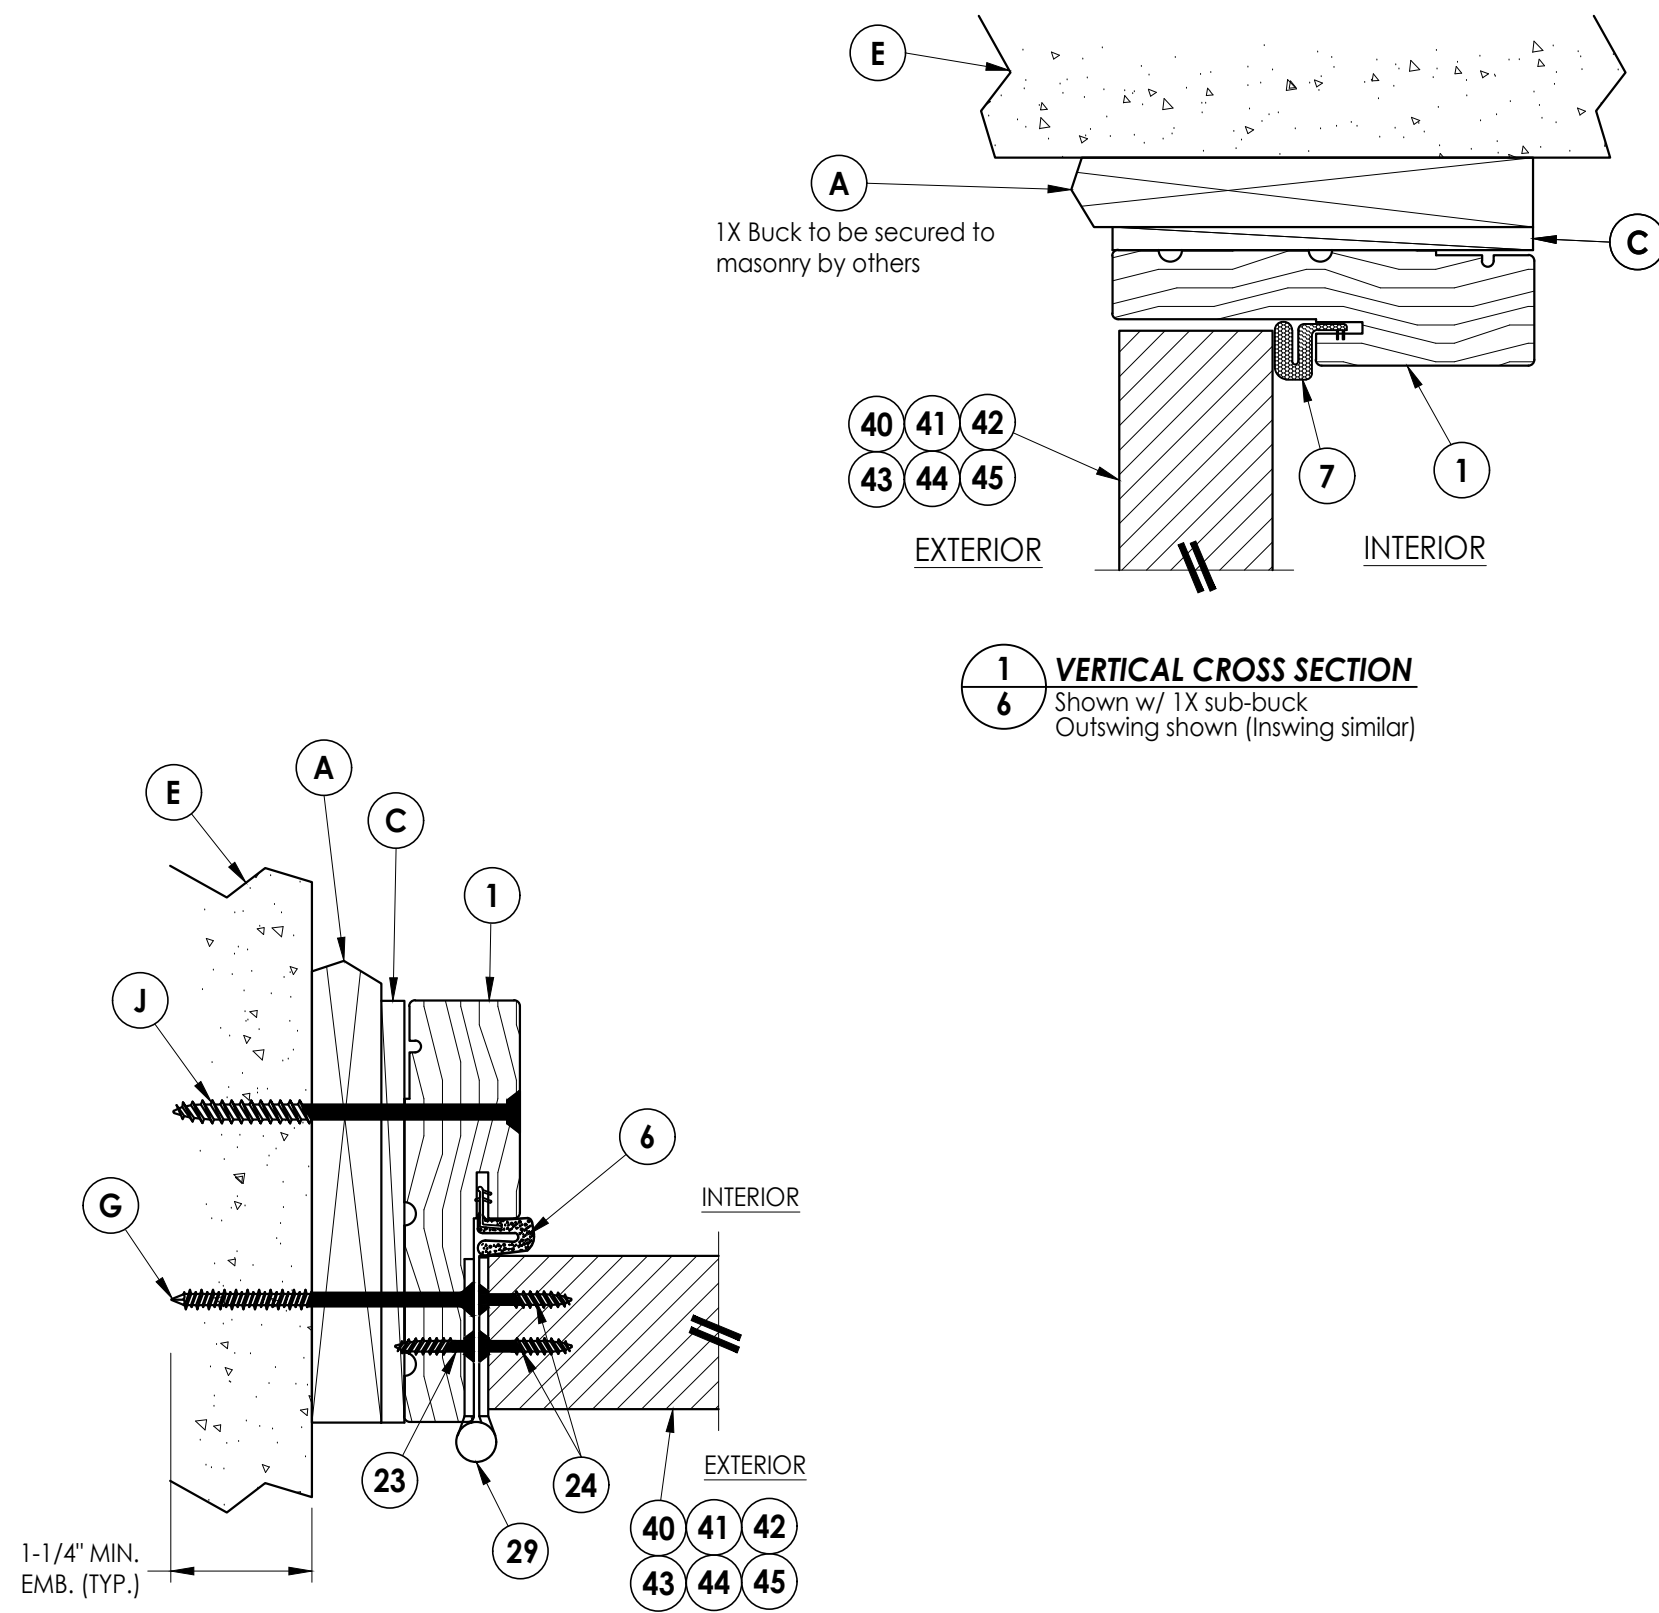

1 **VERTICAL CROSS SECTION**
6 Shown w/ 1X sub-buck
 Outswing shown (Inswing similar)

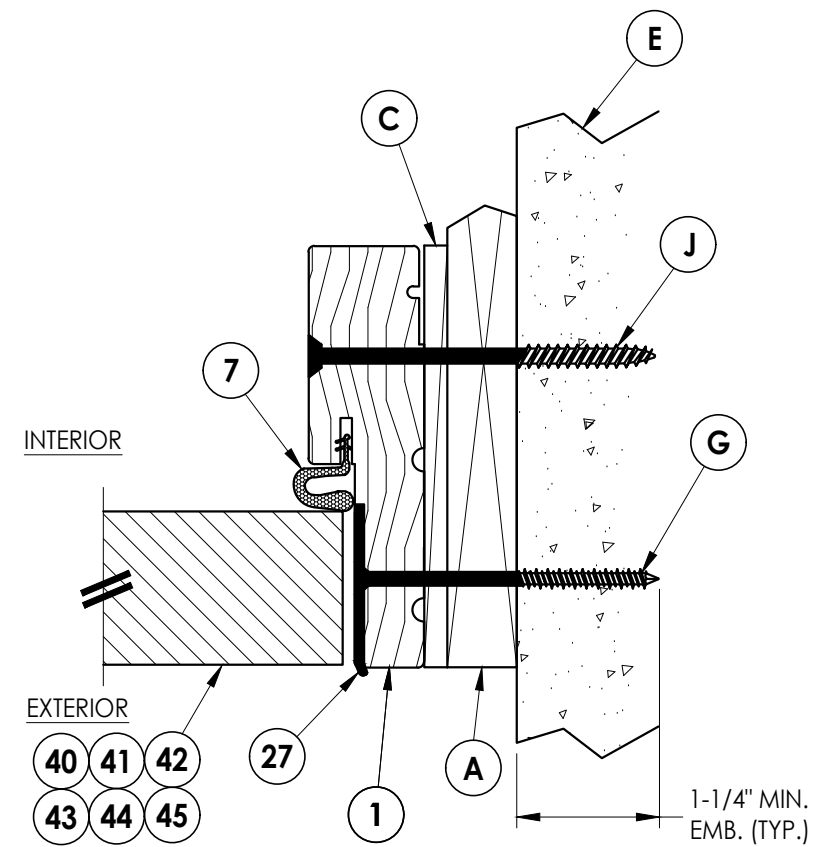

3 6 **HORIZONTAL CROSS SECTION**

Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION	NOTE	MT
2	3/10/18	REVISE FLUSH GLAZING		RW
1	11/15/17	RECESSED PANEL NOTATION		JK
NO.	DATE			BY
REVISIONS				


DATE:	07/07/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21133.9
SHEET	6 OF 13

PRODUCT: THERMA-TRU FIBERGLASS DOOR	PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (1X BUCK)
--	---


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

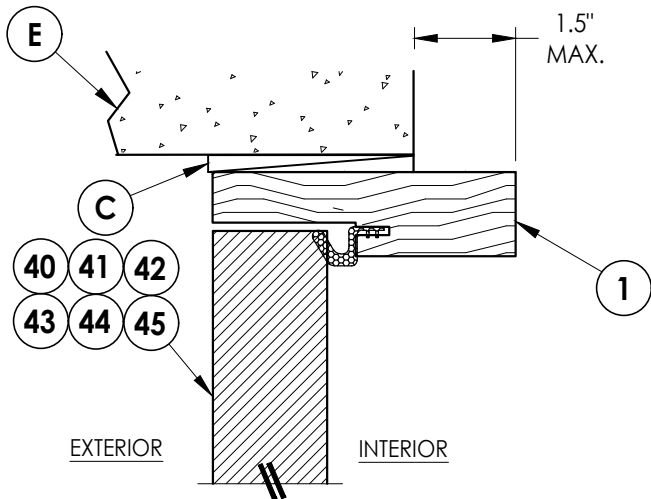


1 **VERTICAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

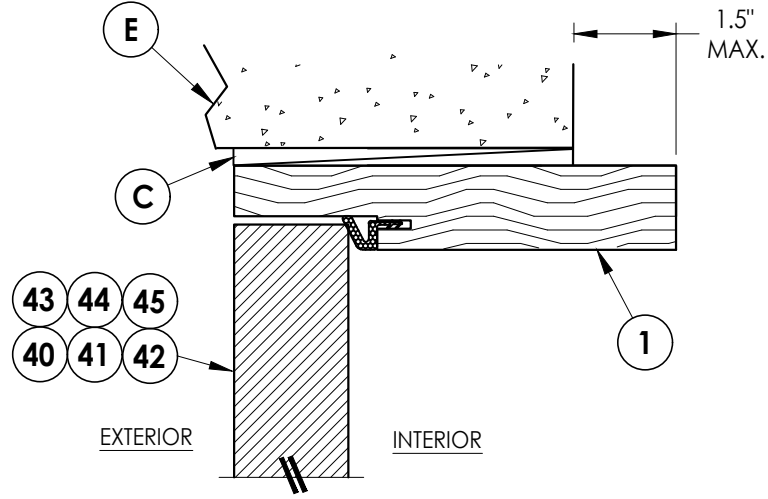


4 **VERTICAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb


DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 55 PSF
w/ SECURITY STRIKE = ± 60 PSF

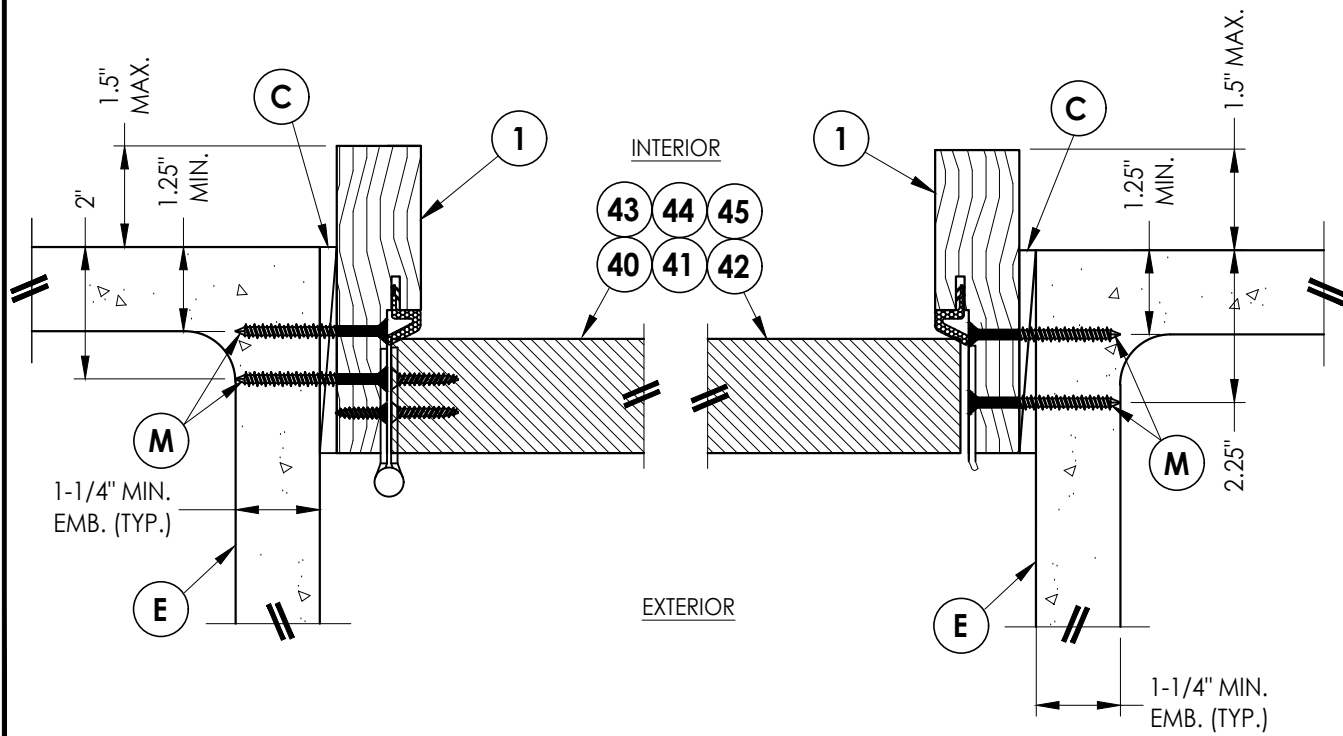


2 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

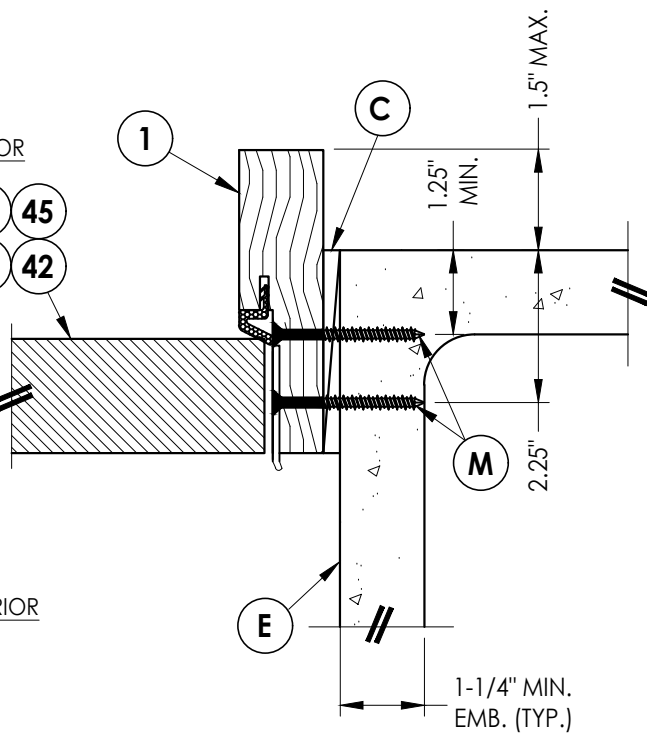

3 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

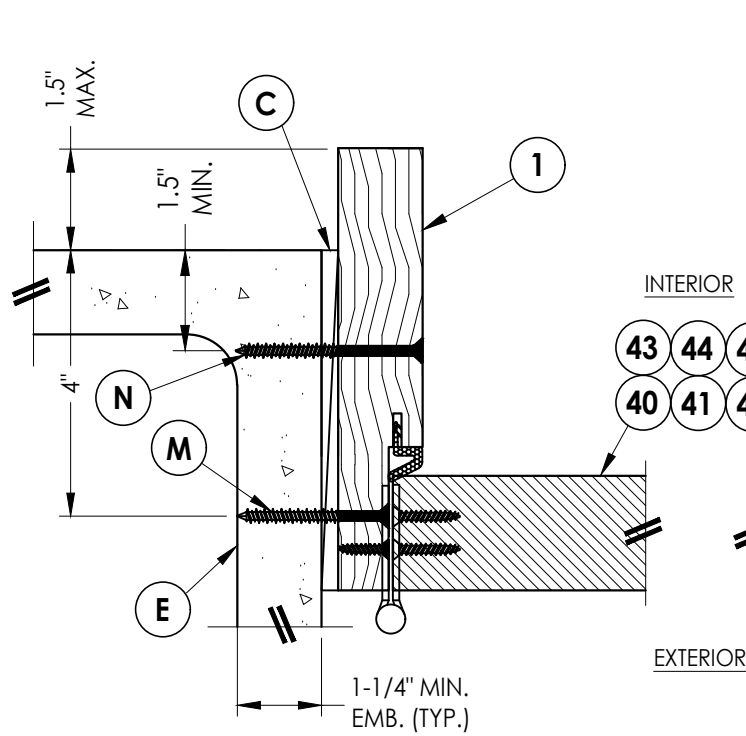

5 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

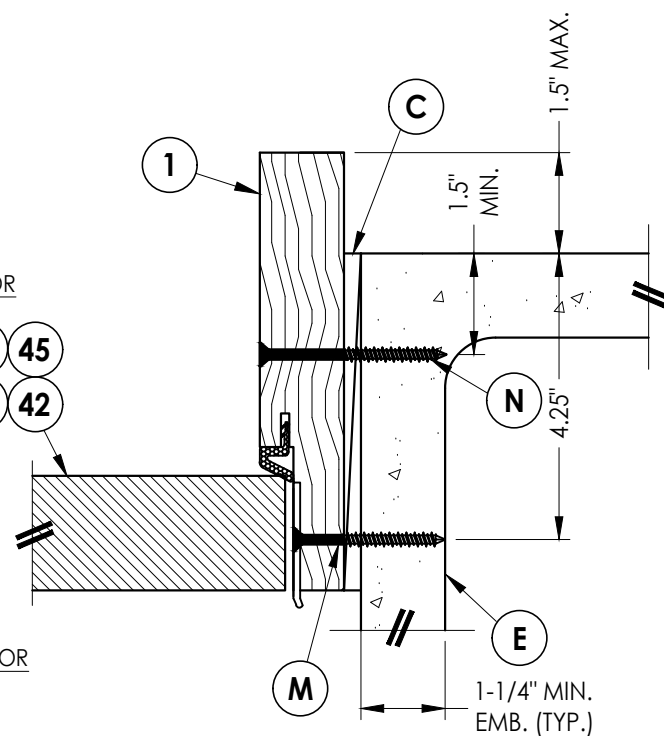

6 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

	NO.	DATE	REVISIONS
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC
4	7/16/20	UPDATE TO 7th ED (2020)	FBC
3	10/10/18	REV. DOOR PANEL OPTION	NOTE
2	3/10/18	REVISE FLUSH GLAZING	RW
1	11/15/17	RECESSED PANEL NOTATION	JK
			BY

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-21133.9


SHEET 7 OF 13

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg


- Notes:
- 1. Sill Item #'s 16, 32, 33, 36, 37, 38, 39, 50, 51, 52, 53, 54 & 55 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws or (3) 2.5" staples at each end.
 - 2. Sill Item #'s 17 & 18 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
 - 3. Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS screws at each end.

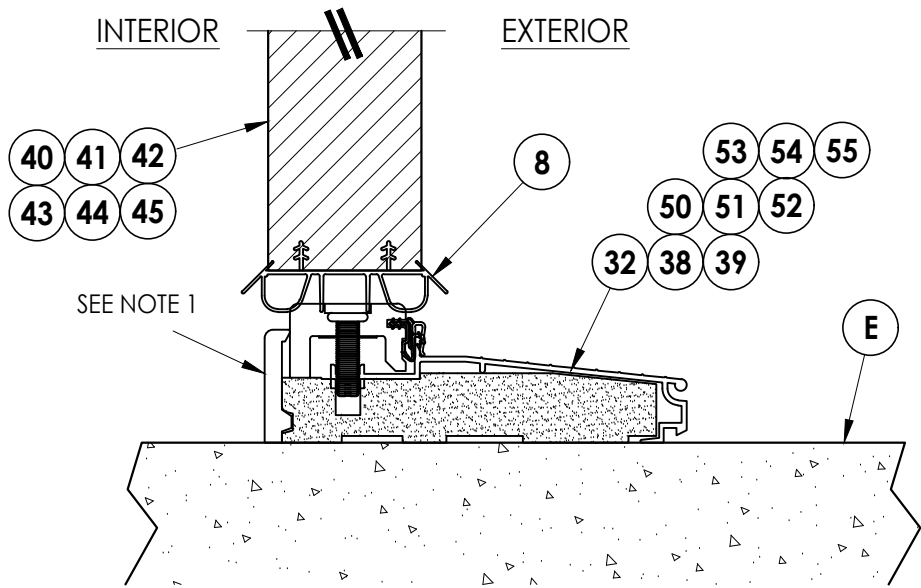


1 **VERTICAL CROSS SECTION**
8 Inswing Sill

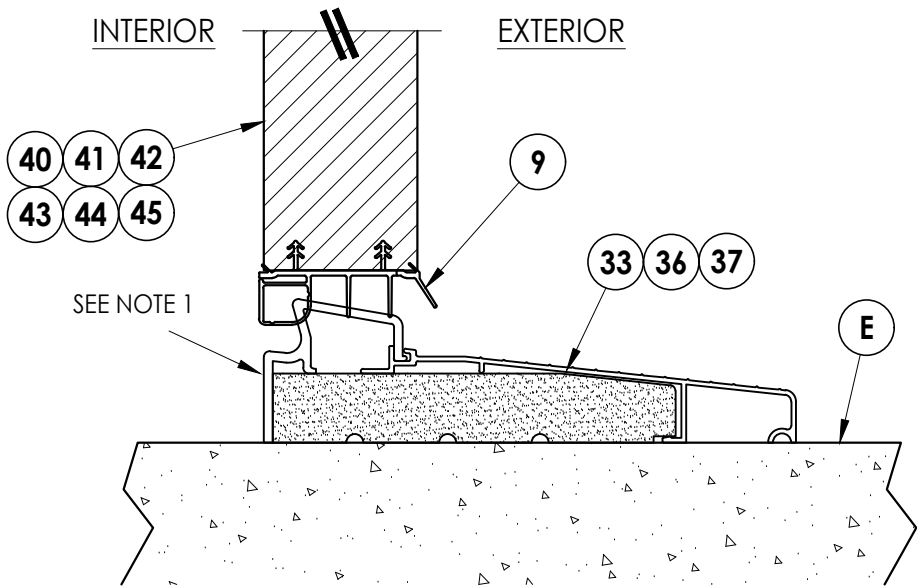

2 **VERTICAL CROSS SECTION**
8 Inswing Sill

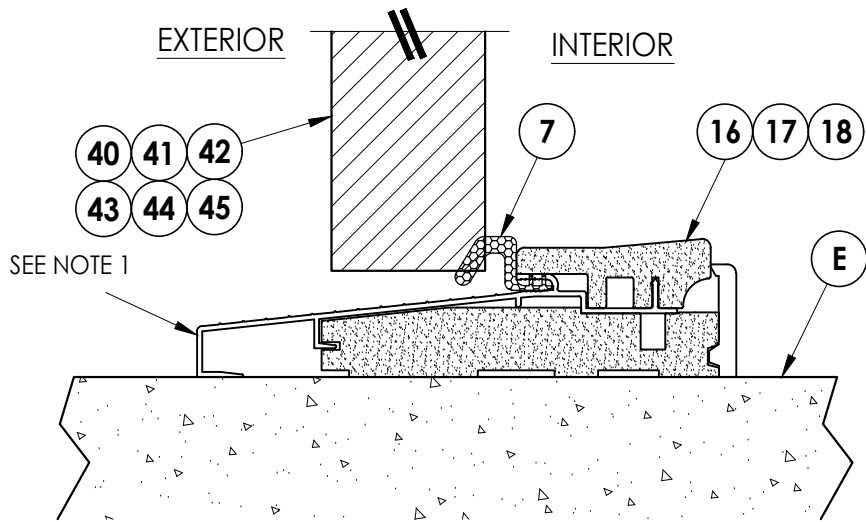


3 **VERTICAL CROSS SECTION**
8 Outswing Sill

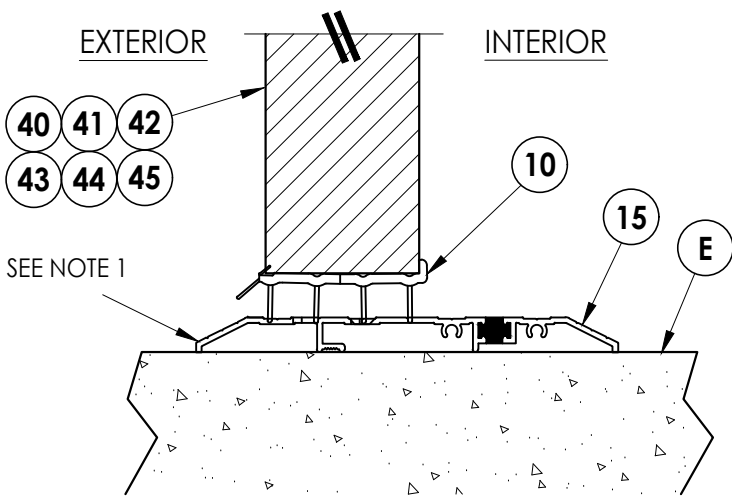


4 **VERTICAL CROSS SECTION**
8 Public Access Sill


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)	
5	8/23/23	UPDATE TO 8TH ED. (2023) FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020) FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION NOTE	MT
2	3/10/18	REVISE FLUSH GLAZING	RW
1	11/15/17	RECESSED PANEL NOTATION	JK
NO.	DATE		BY
REVISIONS			
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.9			
SHEET 8 OF 13			

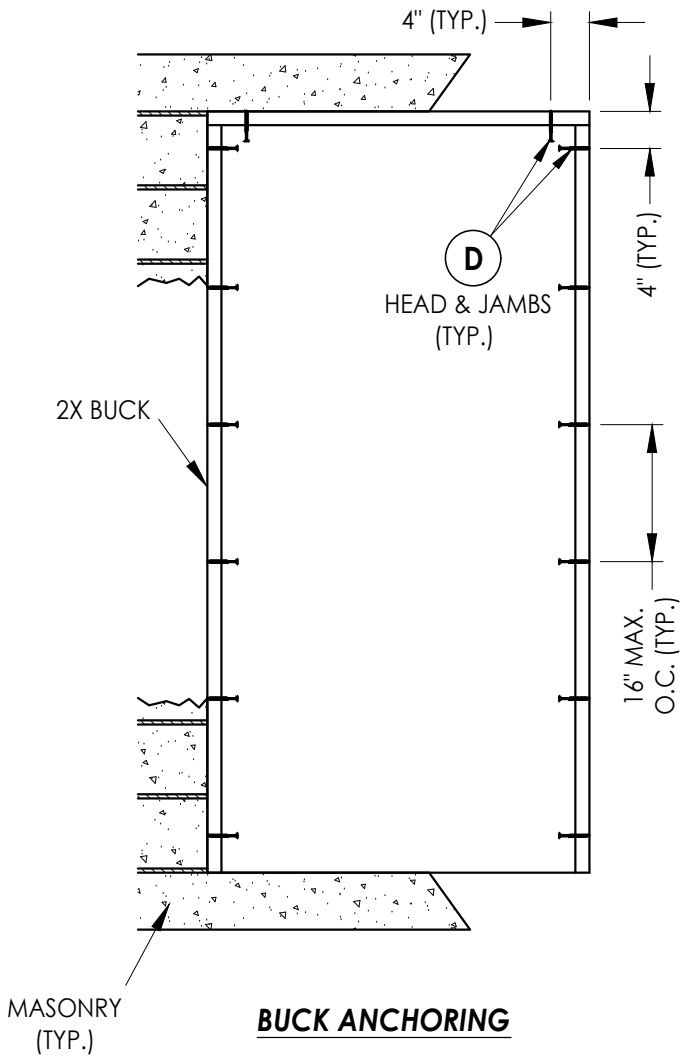

BUCK ANCHORING

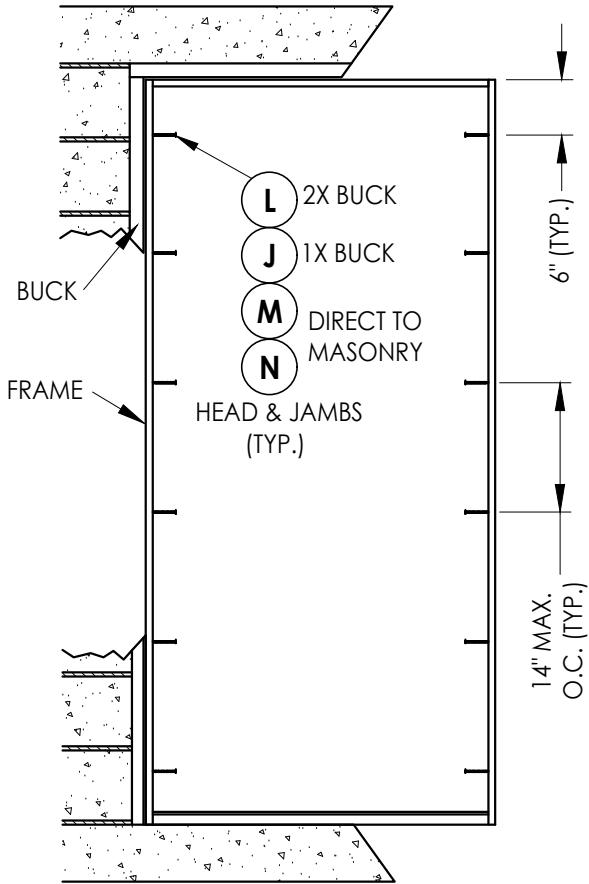



FRAME ANCHORING

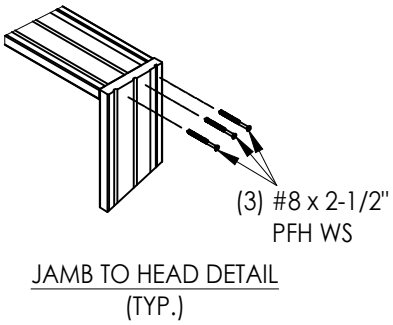








JAMB TO HEAD DETAIL
(TYP.)

DATE: 07/07/17		8/23/23		UPDATE TO 8TH ED. (2023)	FBC	LFS	PRODUCT: THERMA-TRU FIBERGLASS DOOR	Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813
SCALE: N.T.S.		7/16/20		UPDATE TO 7th ED (2020)	FBC	PO			
DWG. BY: JK		3/10/18		REV. DOOR PANEL OPTION NOTE	MT	RW			
CHK. BY: LFS		11/15/17		RECESSED PANEL NOTATION	JK	BY			
DRAWING NO.: FL-21133.9		NO. DATE		REVISIONS					
SHEET 9 OF 13		PART OR ASSEMBLY: BUCK AND FRAME ANCHORING							

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

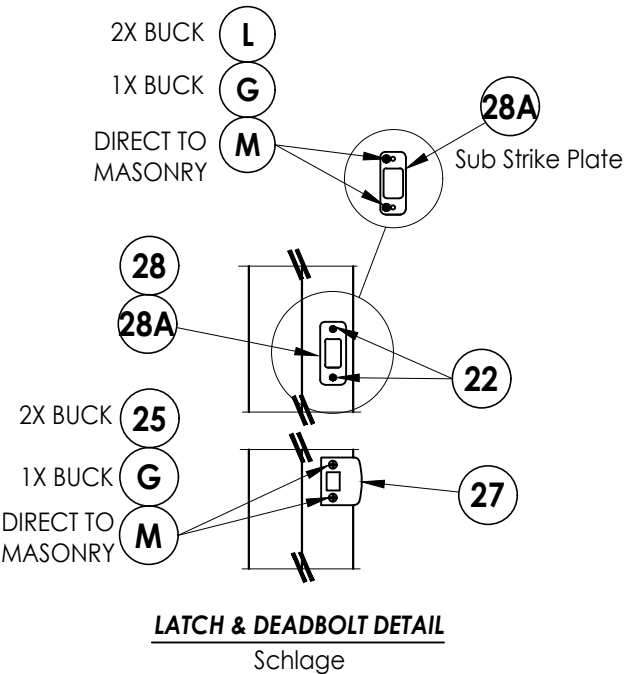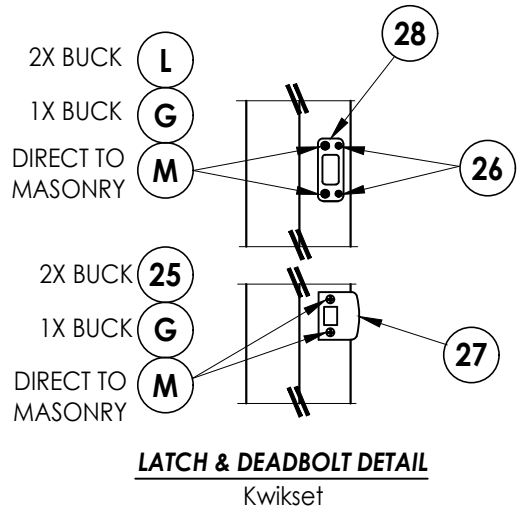

LATCH & DEADBOLT STRIKE DETAILS
(Standard Deadbolt Strike Plate)

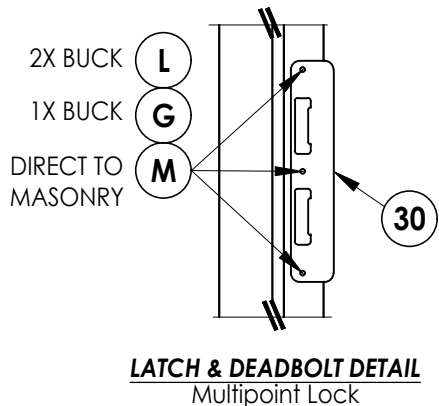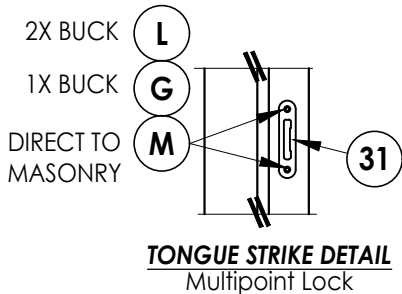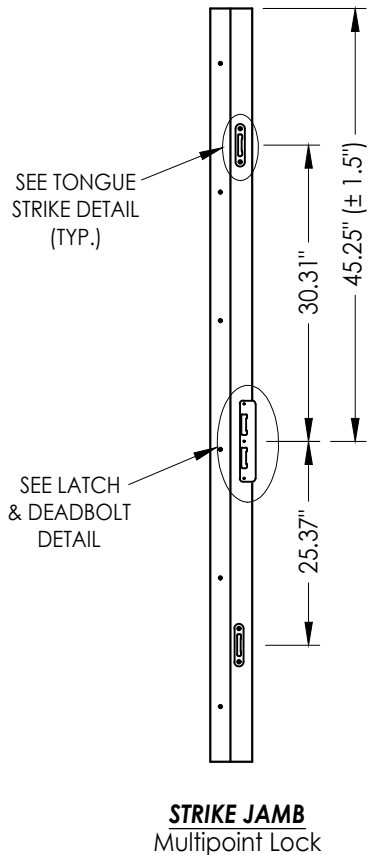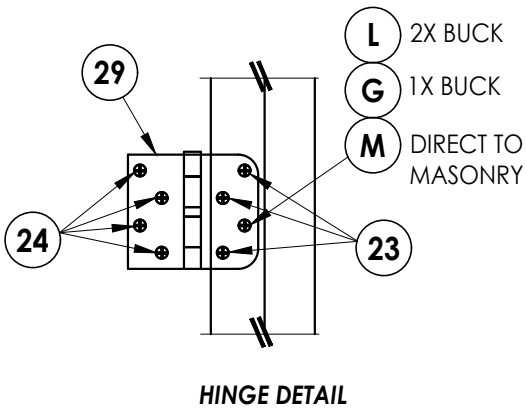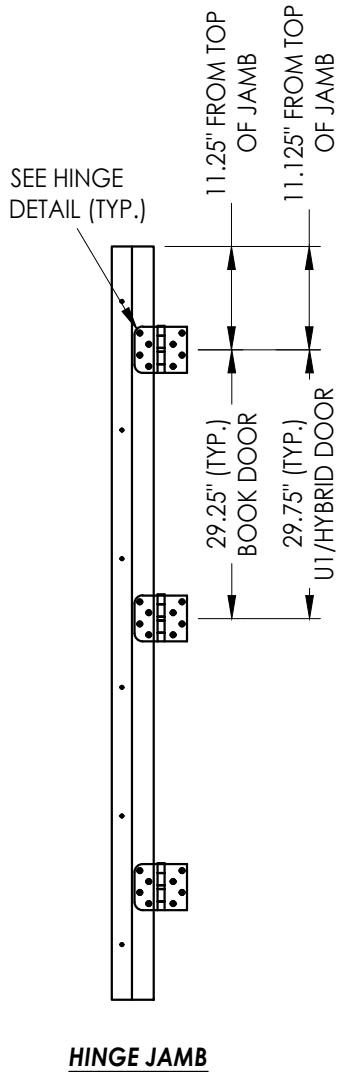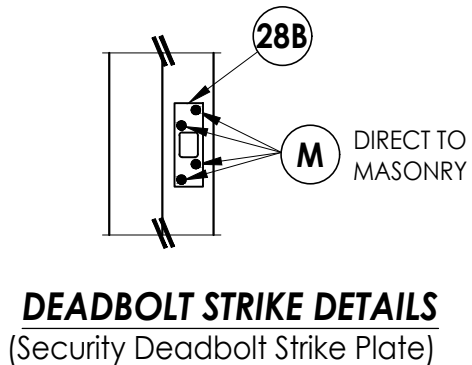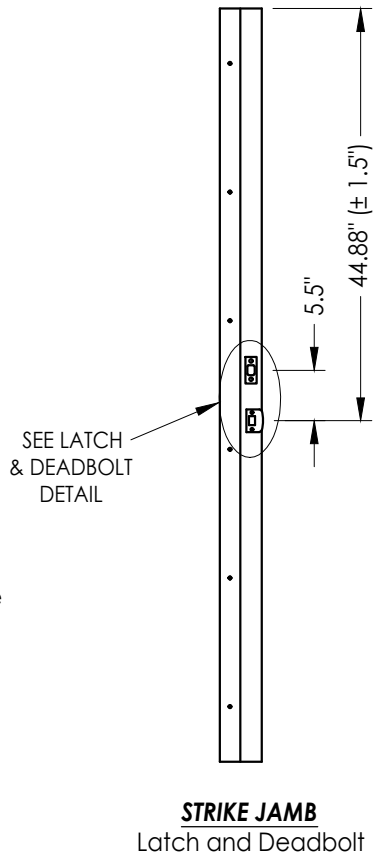

MULTIPOINT LOCK STRIKE DETAILS

NO.	DATE	REVISIONS				
		JK	BY	DATE	DESCRIPTION	REVISIONS
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS		
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO		
3	10/10/18	REV. DOOR PANEL OPTION	NOTE	MT		
2	3/10/18	REVISE FLUSH GLAZING		RW		
1	11/15/17	RECESSED PANEL NOTATION		JK		

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21133.9

SHEET 10 OF 13










Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HARDWARE DETAILS


BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

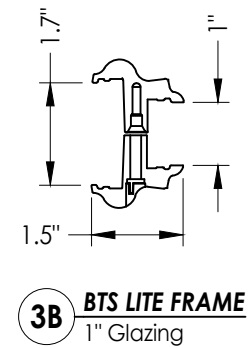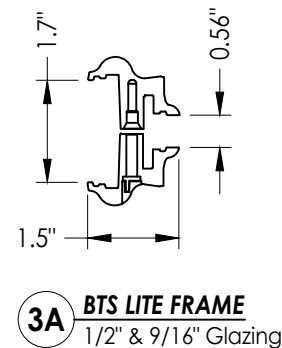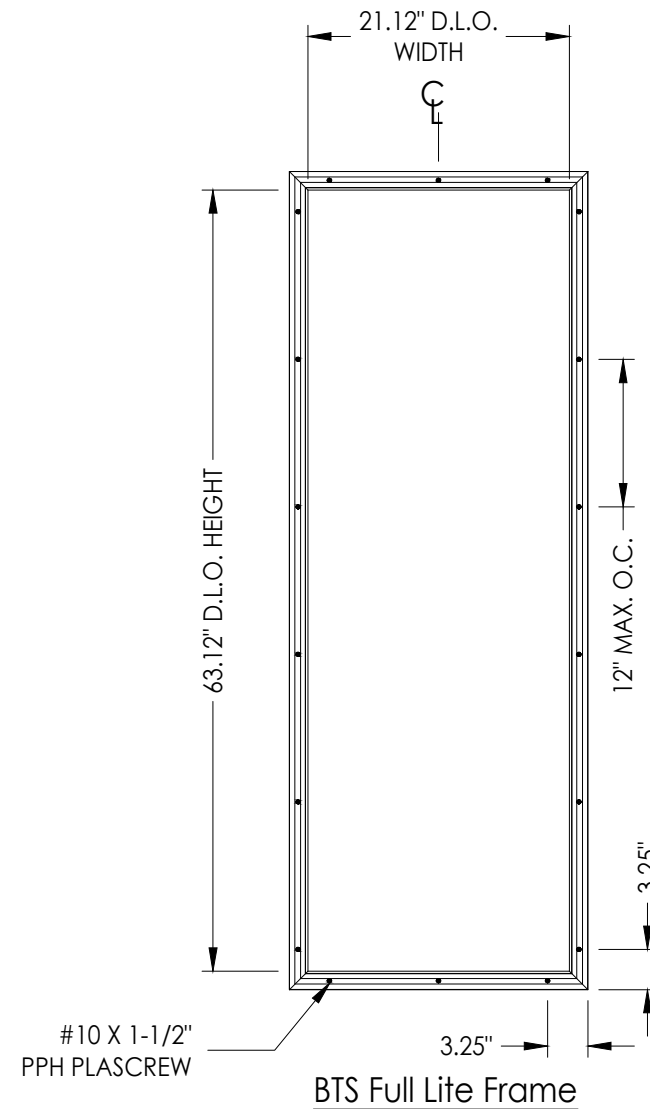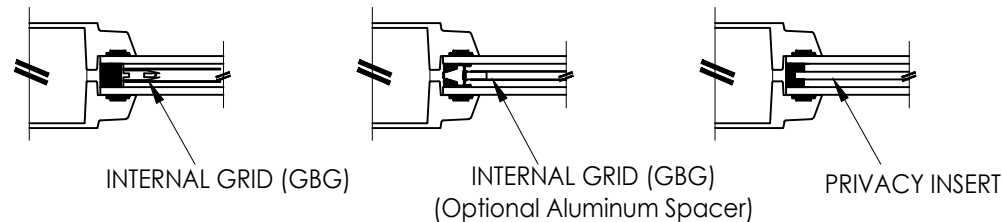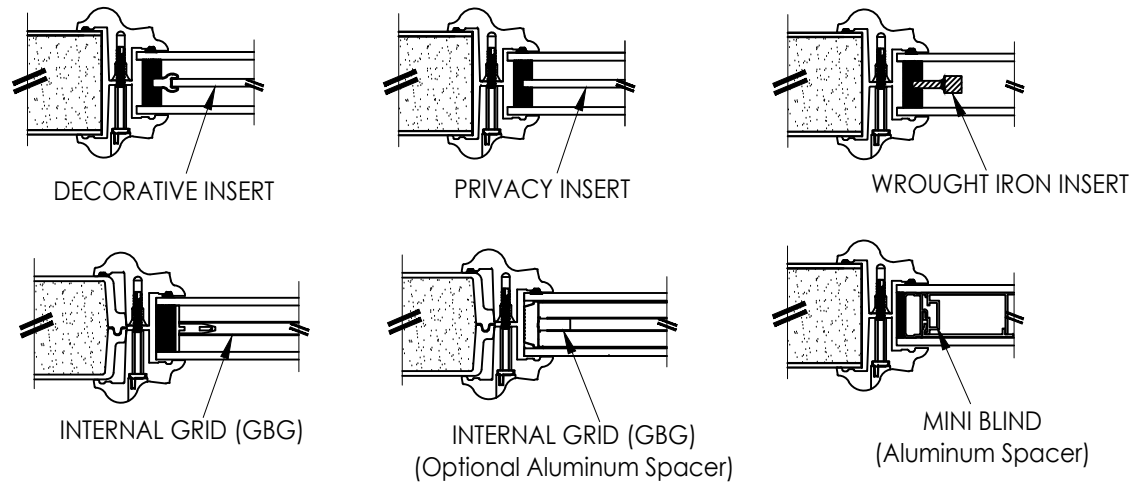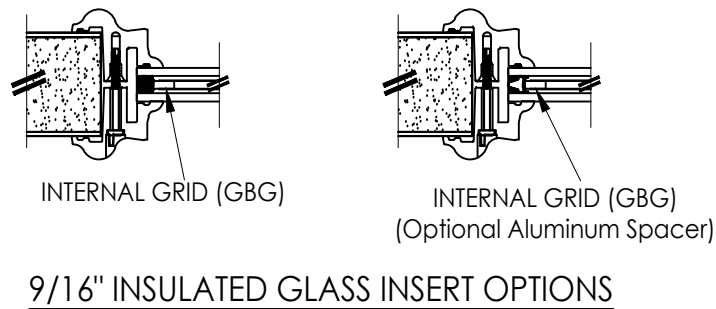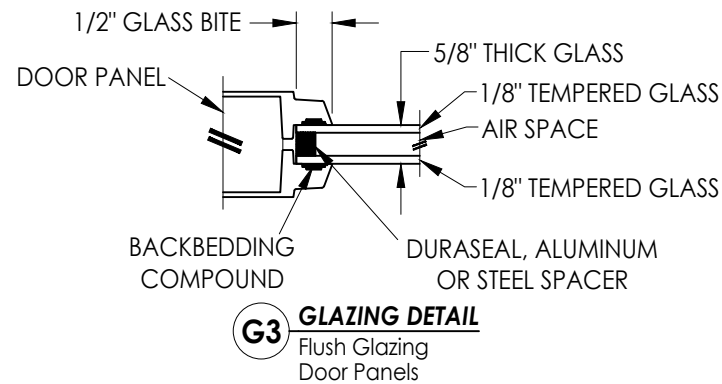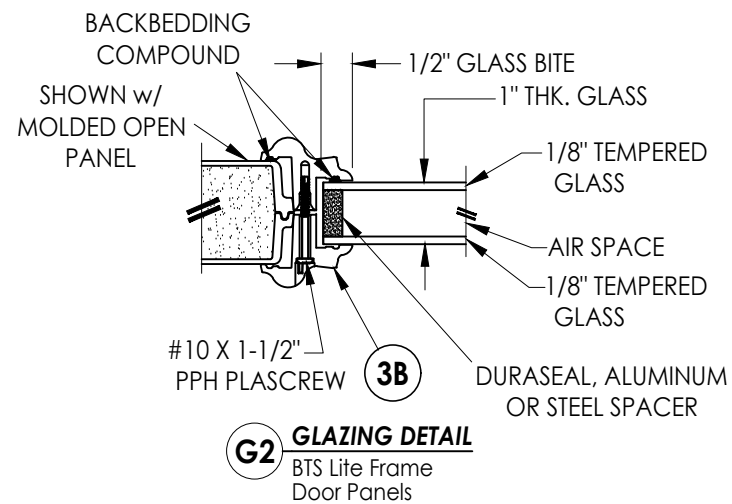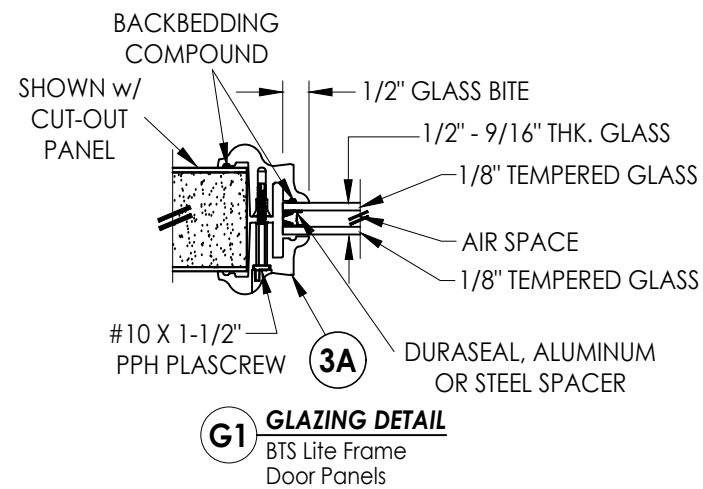


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: GLAZING DETAILS	
LFS	UPDATE TO 8TH ED. (2023)	FBC	REVISIONS
PO	UPDATE TO 7th ED (2020)	FBC	
MT	REV. DOOR PANEL OPTION	NOTE	
RW	2	3/10/18	REVISE FLUSH GLAZING
JK	1	11/15/17	RECESSED PANEL NOTATION
BY	NO.	DATE	
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.9			
SHEET 11 OF 13			


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

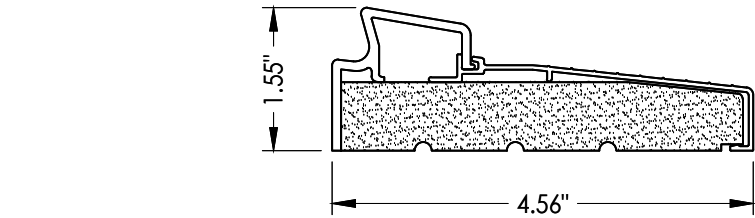


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

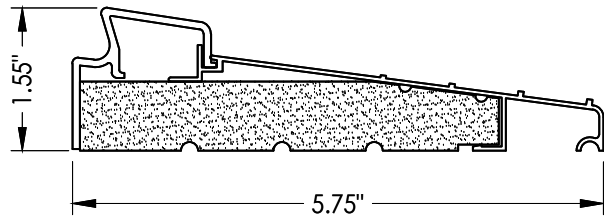


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

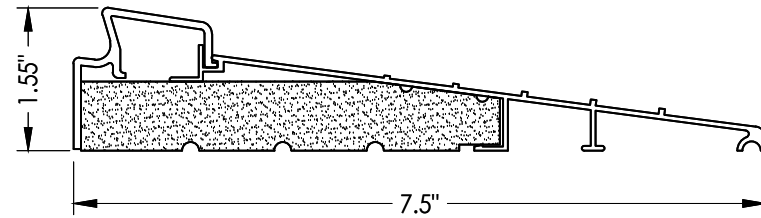


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

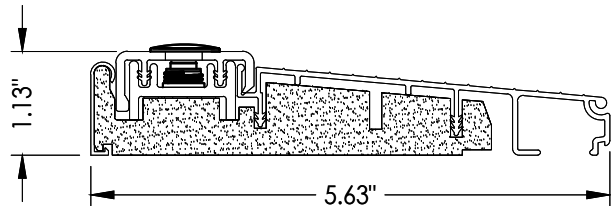


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

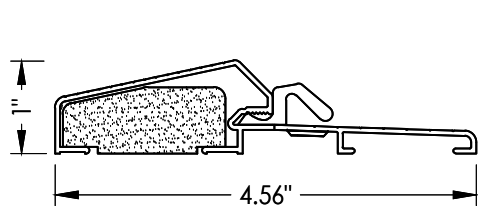


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

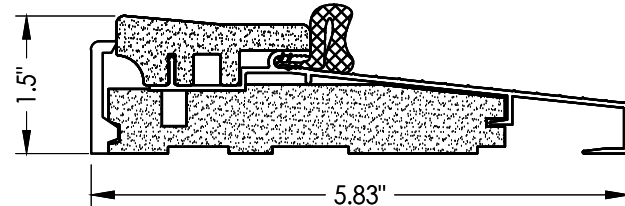


16 OUTSWING THRESHOLD *
Composite / Aluminum Sill

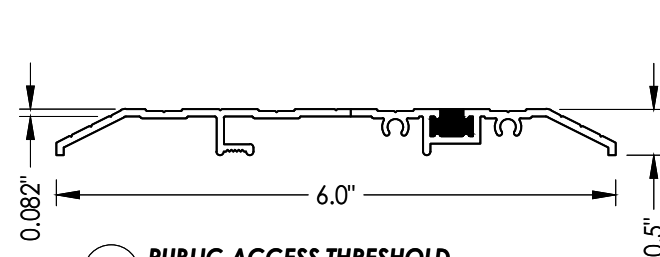


15 PUBLIC ACCESS THRESHOLD

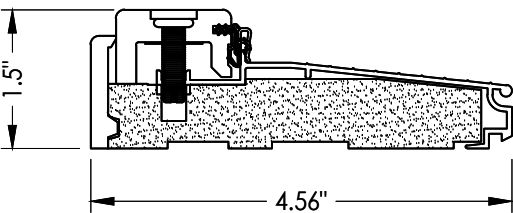


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

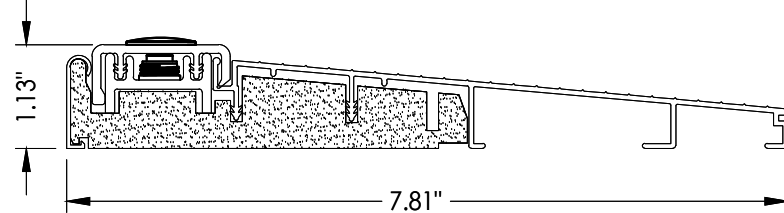


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

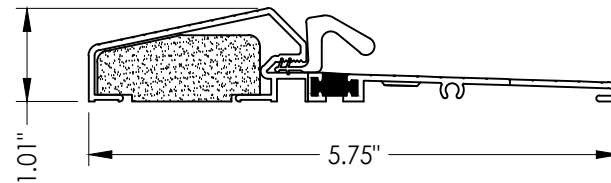


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

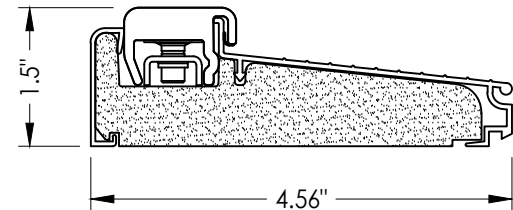


50 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

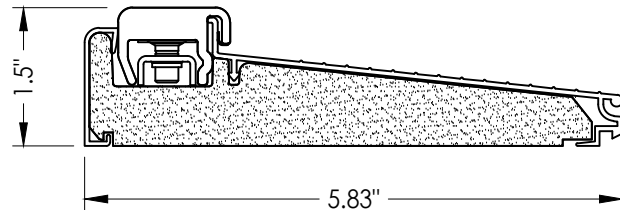


51 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

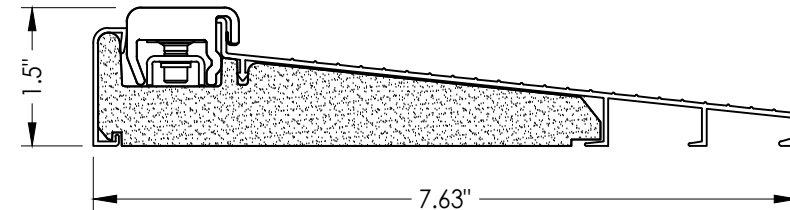


52 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

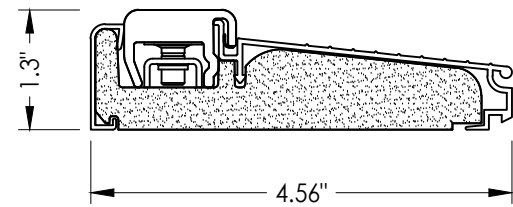

53 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

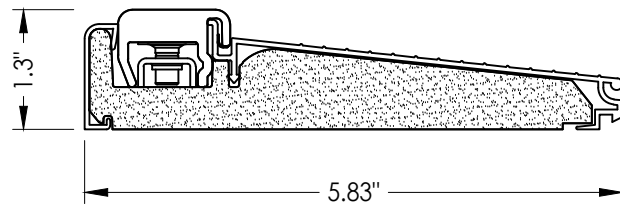

54 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

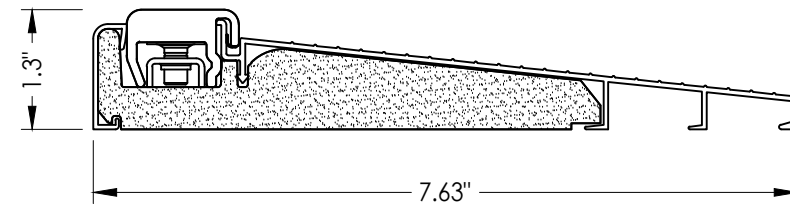

55 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS				
		DATE	BY	CHK	APP	REV
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS		
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO		
3	10/10/18	REV. DOOR PANEL OPTION	NOTE	MT		
2	3/10/18	REVISE FLUSH GLAZING		RW		
1	11/15/17	RECESSED PANEL NOTATION		JK		

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-21133.9

SHEET 12 OF 13

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R10\FL-21133.9-11.dwg

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	27	LATCH STRIKE PLATE	STEEL
C	1/4" MAX. SHIM SPACE	-	28	DEADBOLT STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28A	DEADBOLT SUB STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
			29	4" X 4" HINGE	STEEL
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	30	LATCH & DEADBOLT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	31	MULTIPOINT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	32	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	37	INSWING THRESHOLD	ALUM/COMP
2	JAMB (FINGER JOINT PINE)	WOOD	38	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	39	INSWING THRESHOLD	ALUM/COMP
7	WEATHERSTRIP (LONG REACH)	FOAM	40	DOOR PANEL (BOOK)	-
8	SWEEP	VINYL	41	DOOR PANEL (HYBRID)	-
9	SWEEP	VINYL	42	DOOR PANEL (U1)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	43	FLUSH GLAZED DOOR PANEL (BOOK)	-
15	ADA THRESHOLD	ALUM	44	FLUSH GLAZED DOOR PANEL (HYBRID)	-
16	OUTSWING THRESHOLD	ALUM/COMP	45	FLUSH GLAZED DOOR PANEL (U1)	-
17	OUTSWING THRESHOLD	ALUM/COMP	50	INSWING THRESHOLD	ALUM/COMP
18	OUTSWING THRESHOLD	ALUM/COMP	51	INSWING THRESHOLD	ALUM/COMP
22	#8 x 3/4" PFH WOOD SCREW	STEEL	52	INSWING THRESHOLD	ALUM/COMP
23	#10 x 3/4" PFH WOOD SCREW	STEEL	53	INSWING THRESHOLD	ALUM/COMP
24	#10 x 1" PFH WOOD SCREW	STEEL	54	INSWING THRESHOLD	ALUM/COMP
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL	55	INSWING THRESHOLD	ALUM/COMP

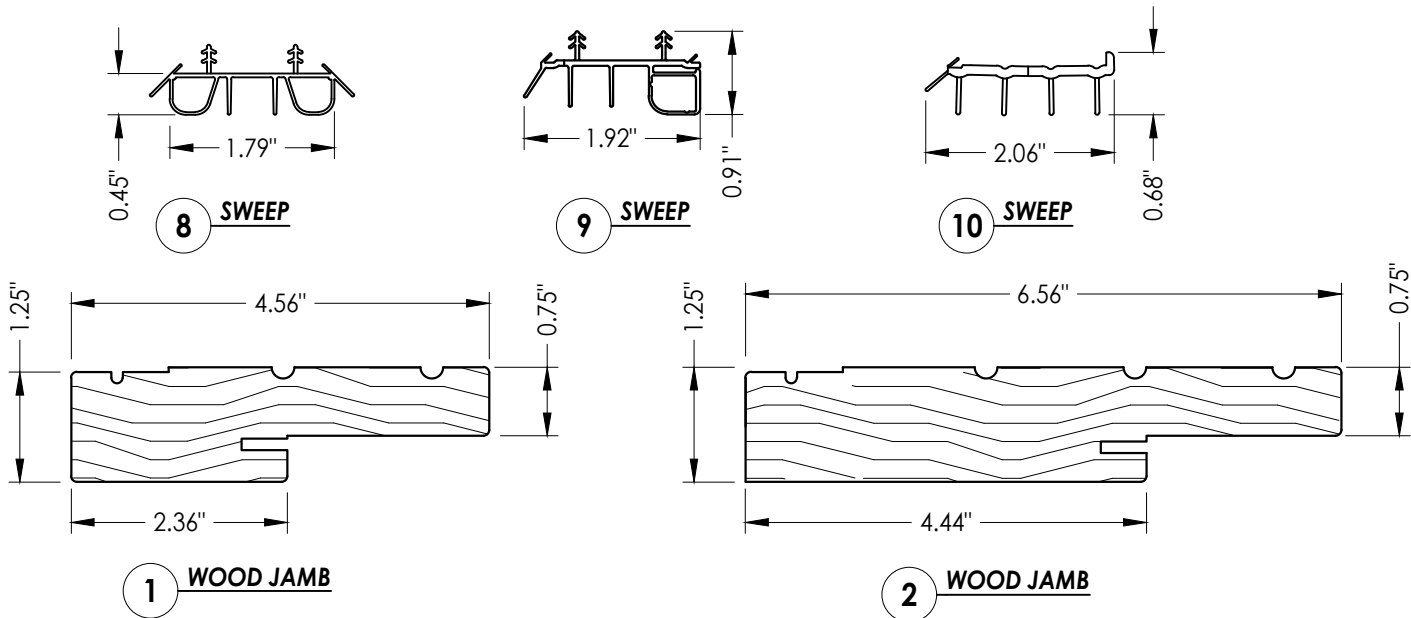

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
COMPONENTS &
BILL OF MATERIALS

	LFS	PO	MT	RW	JK	BY
8/23/23	UPDATE TO 8TH ED. (2023) FBC					
7/16/20	UPDATE TO 7th ED (2020) FBC					
10/10/18	REV. DOOR PANEL OPTION NOTE					
3/10/18	REVISE FLUSH GLAZING					
11/15/17	RECESSED PANEL NOTATION					
NO.	DATE					
REVISIONS						

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21133.9

SHEET 13 OF 13