




Fiber-Classic® & Smooth-Star®

WOOD EDGE
GLAZED FIBERGLASS SINGLE DOOR
w/ SIDELITE(S)
IN SWING/OUT SWING
"NON-IMPACT"

GENERAL NOTES

- 1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
- 4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- 5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
- 6. Fiber-Classic & Smooth-Star Door and Sidelite panels require the use of "J" part numbers and must be stained or painted within six months of installation.


TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes	9	Vertical Cross Sections (Thresholds)
2	Door Panel Details	10	Buck Anchoring
3	Door Panel Details	11	Frame Anchoring
4	Sidelite Panel Details	12	Hardware Details
5	Elevations	13	Glazing details
6	Horizontal & Vertical Cross Sections (2X Buck)	14	Components
7	Horizontal & Vertical Cross Sections (1X Buck)	15	Bill of Materials
8	Horizontal & Vertical Cross Sections (Direct to Masonry)		

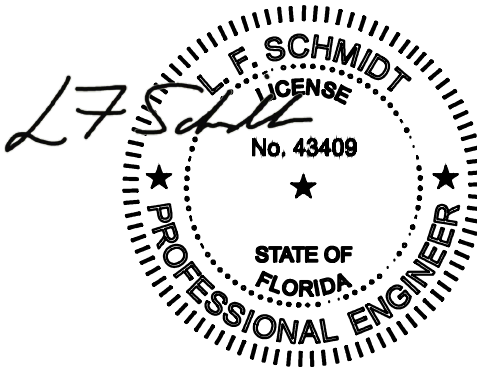

Digitally signed by
Lyndon F Schmidt
Date: 2026.08.06 14:51:00
-04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

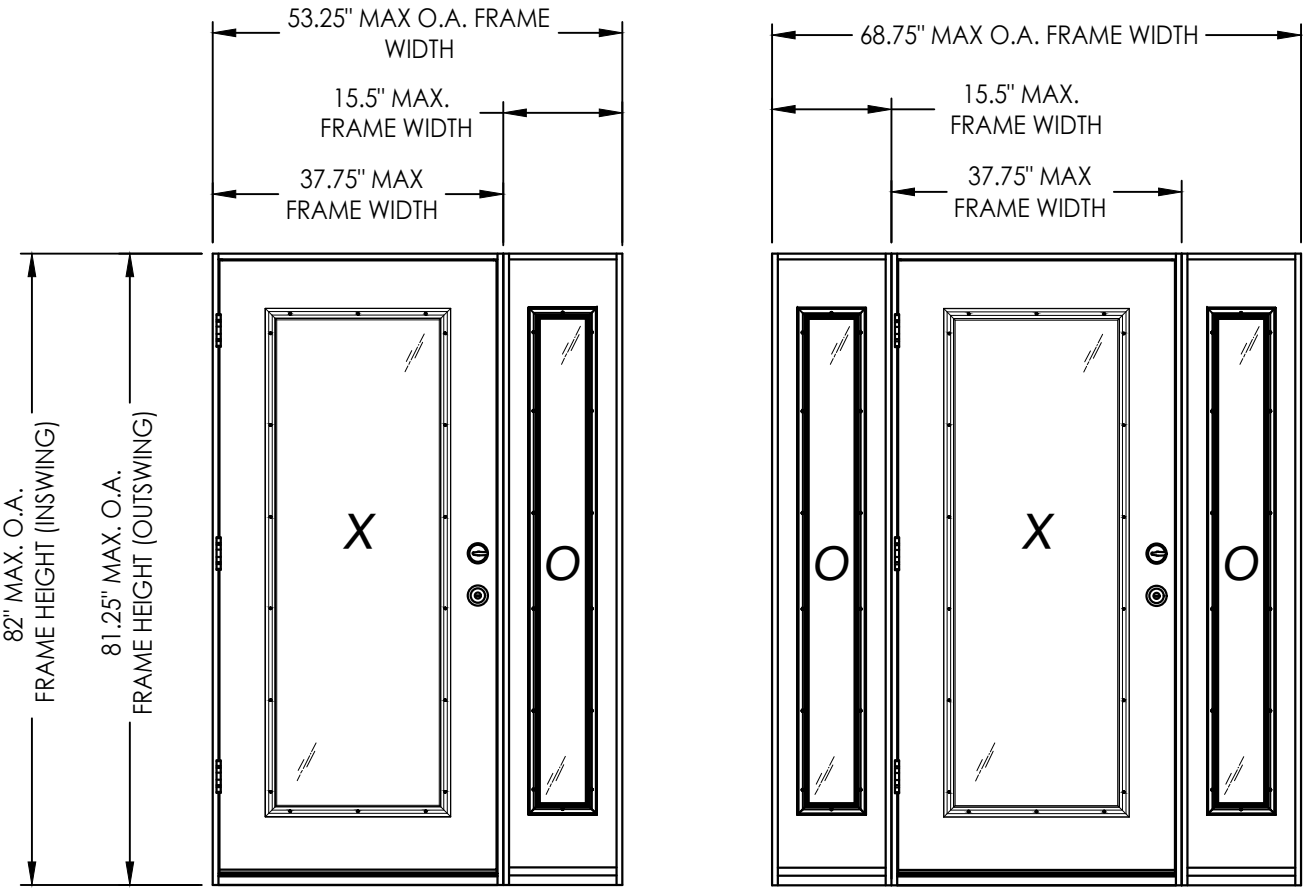

CONFIGURATION	DESIGN PRESSURE (PSF) IN SWING		DESIGN PRESSURE (PSF) OUT SWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XO, OX, OXO	+45.0	-50.0	+45.0	-45.0

See Sheet 5 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

LFS
FBC
PO
MT
RW
JK
BY

7/02/26
8/23/23
7/16/20
10/10/18
3/10/18
11/15/17
NO
DATE

UPDATE TO 9TH ED. (2026)
UPDATE TO 8TH ED. (2023)
UPDATE TO 7th ED (2020)
REV. DOOR PANEL OPTION
REVISE FLUSH GLAZING
RECESSED PANEL NOTATION



REVISIONS

DATE: 07/07/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21133.10
SHEET 1 of 15

© 2017 R.W. BUILDING CONSULTANTS INC.

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

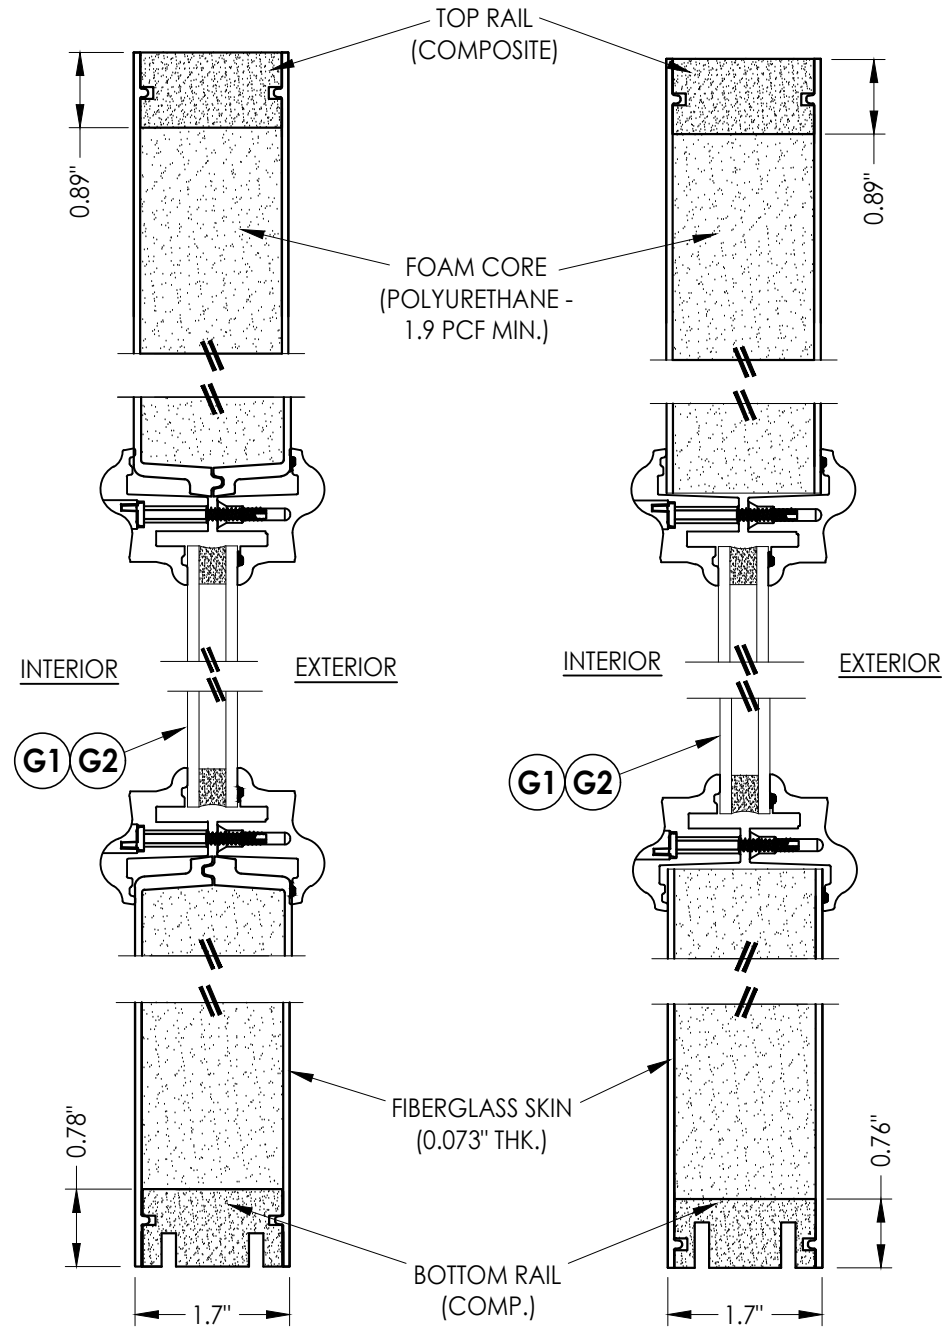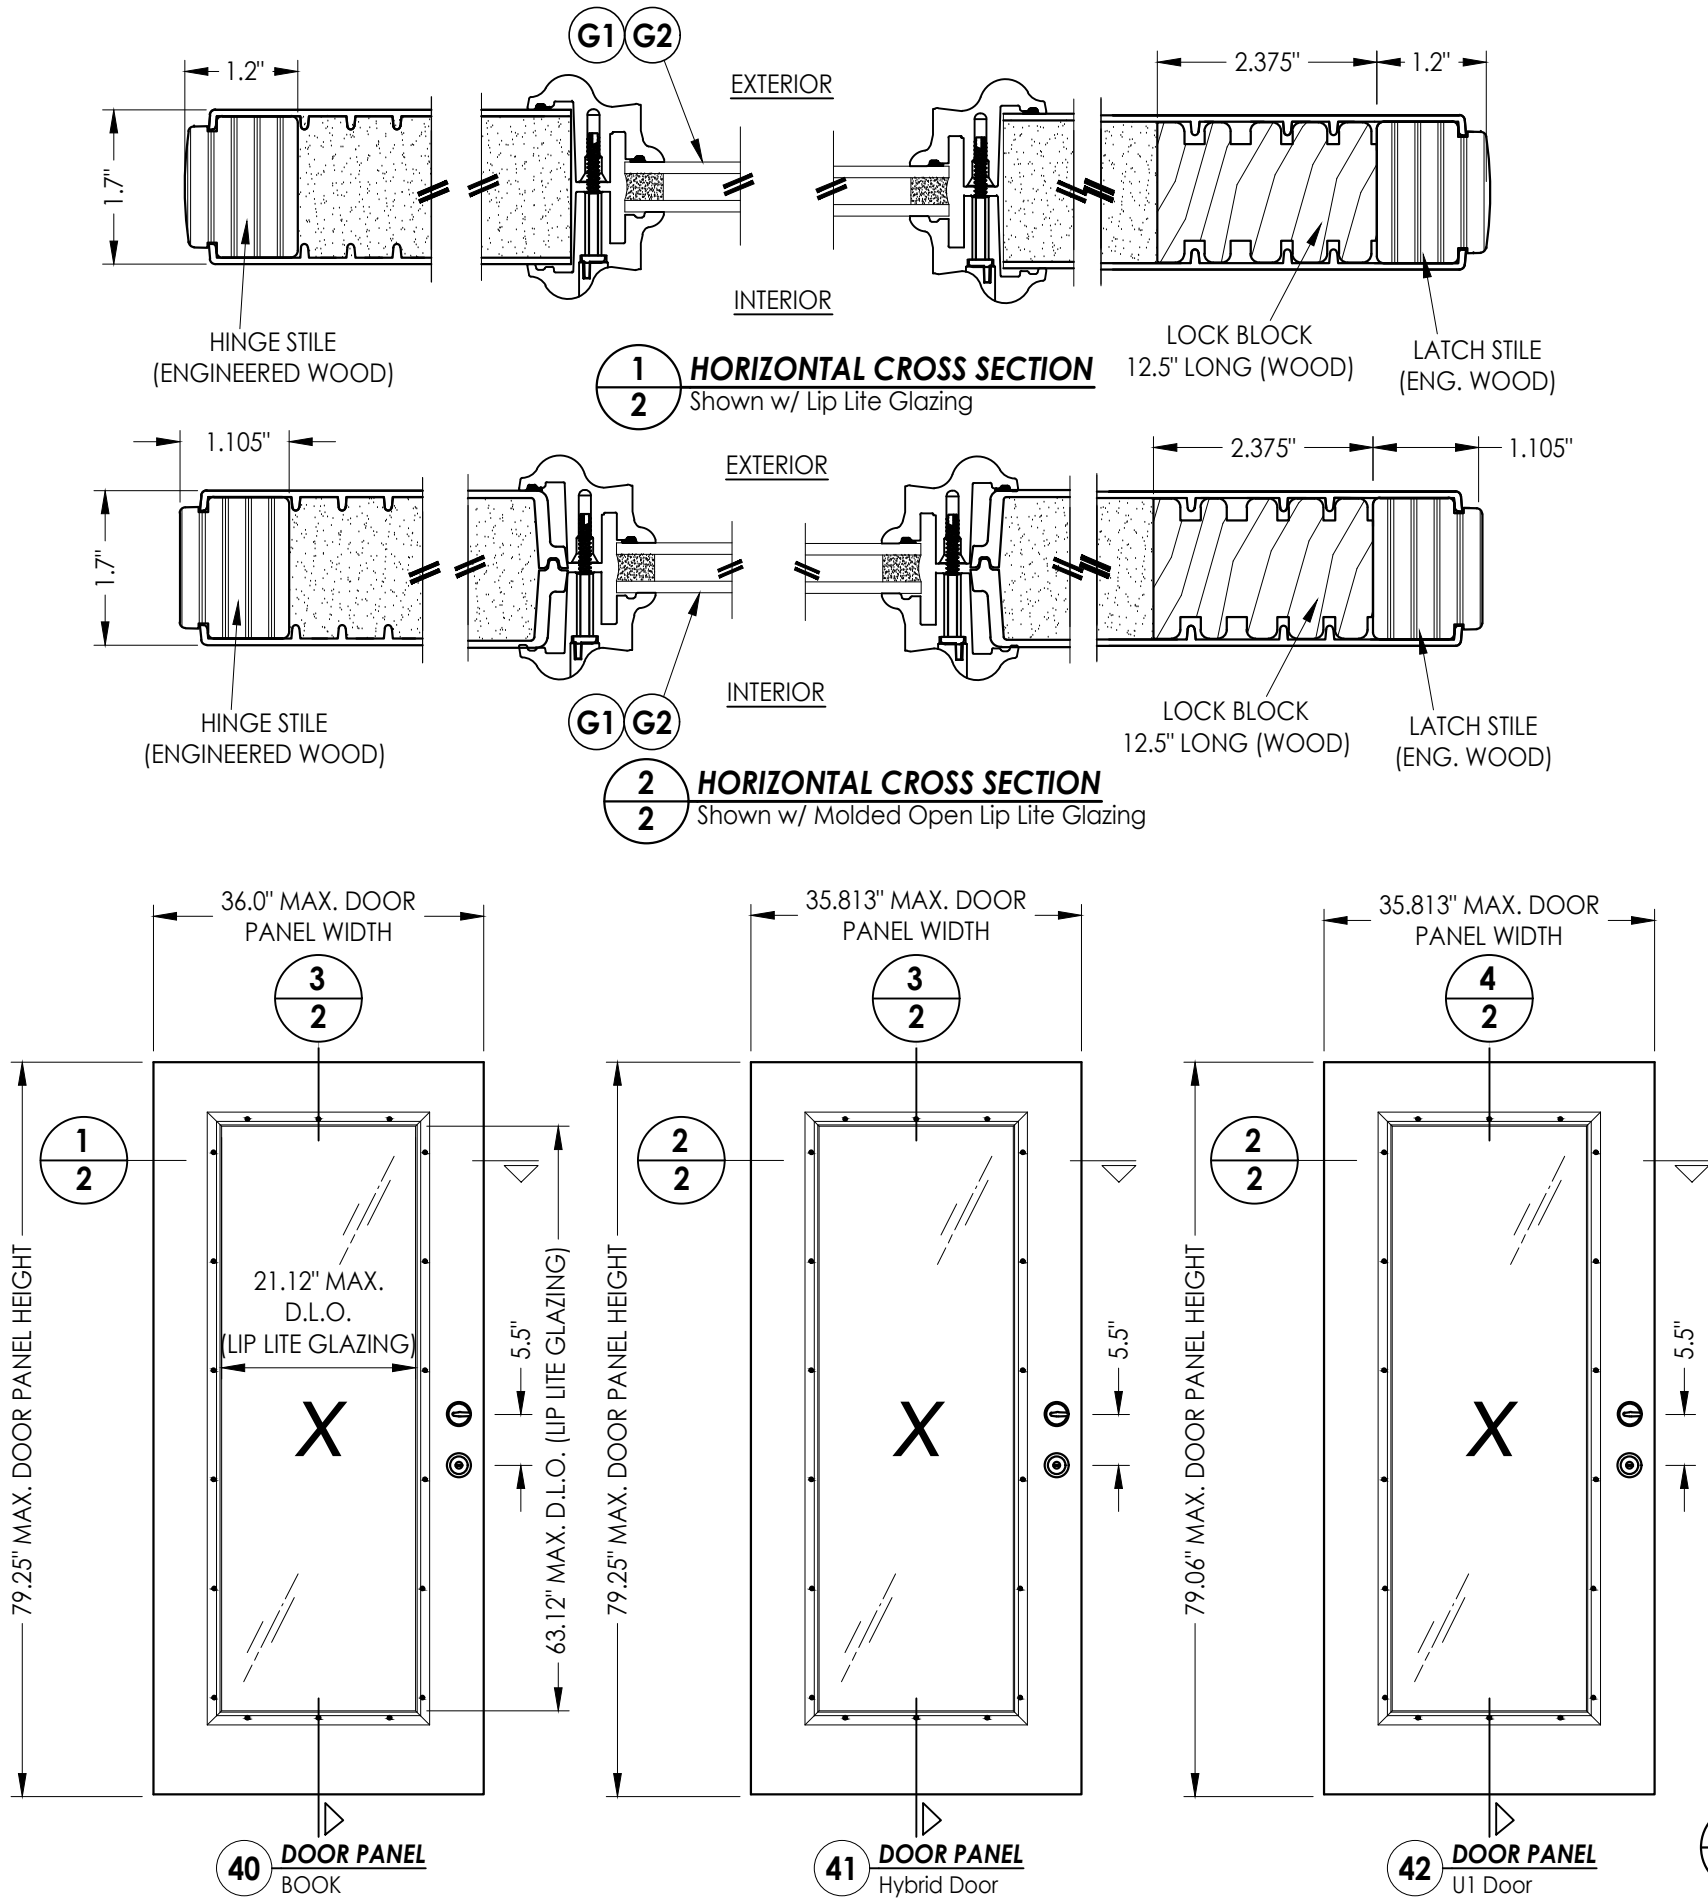

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
5	8/23/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	7/16/20	UPDATE TO 7th ED. (2020) FBC PO
3	10/10/18	REV. DOOR PANEL OPTION NOTE MT
2	3/10/18	REVISE FLUSH GLAZING RW
1	11/15/17	RECESSED PANEL NOTATION JK

DATE: 07/07/17





SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-21133.10

SHEET 2 OF 15

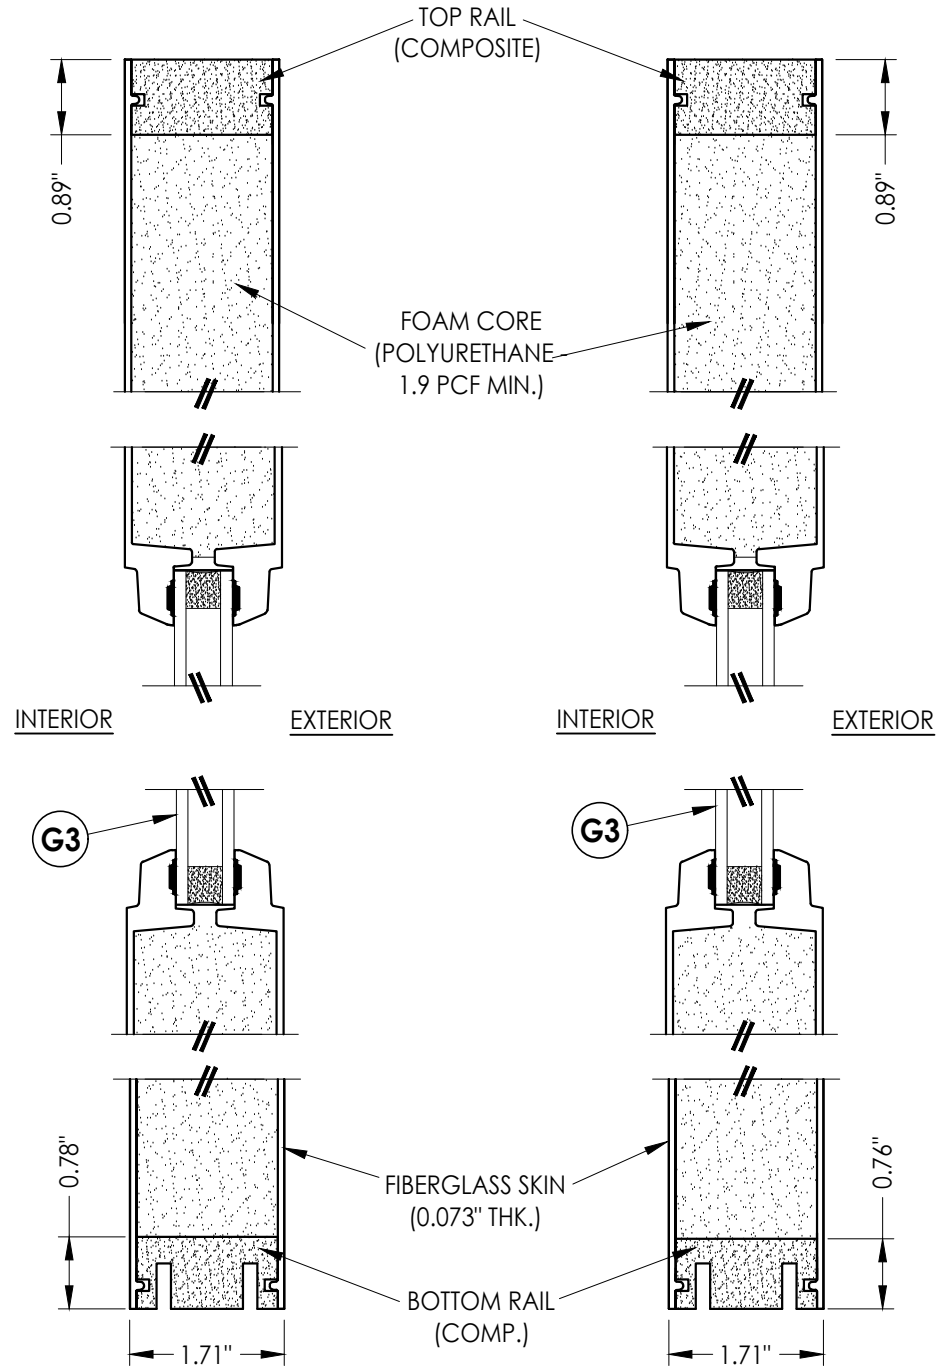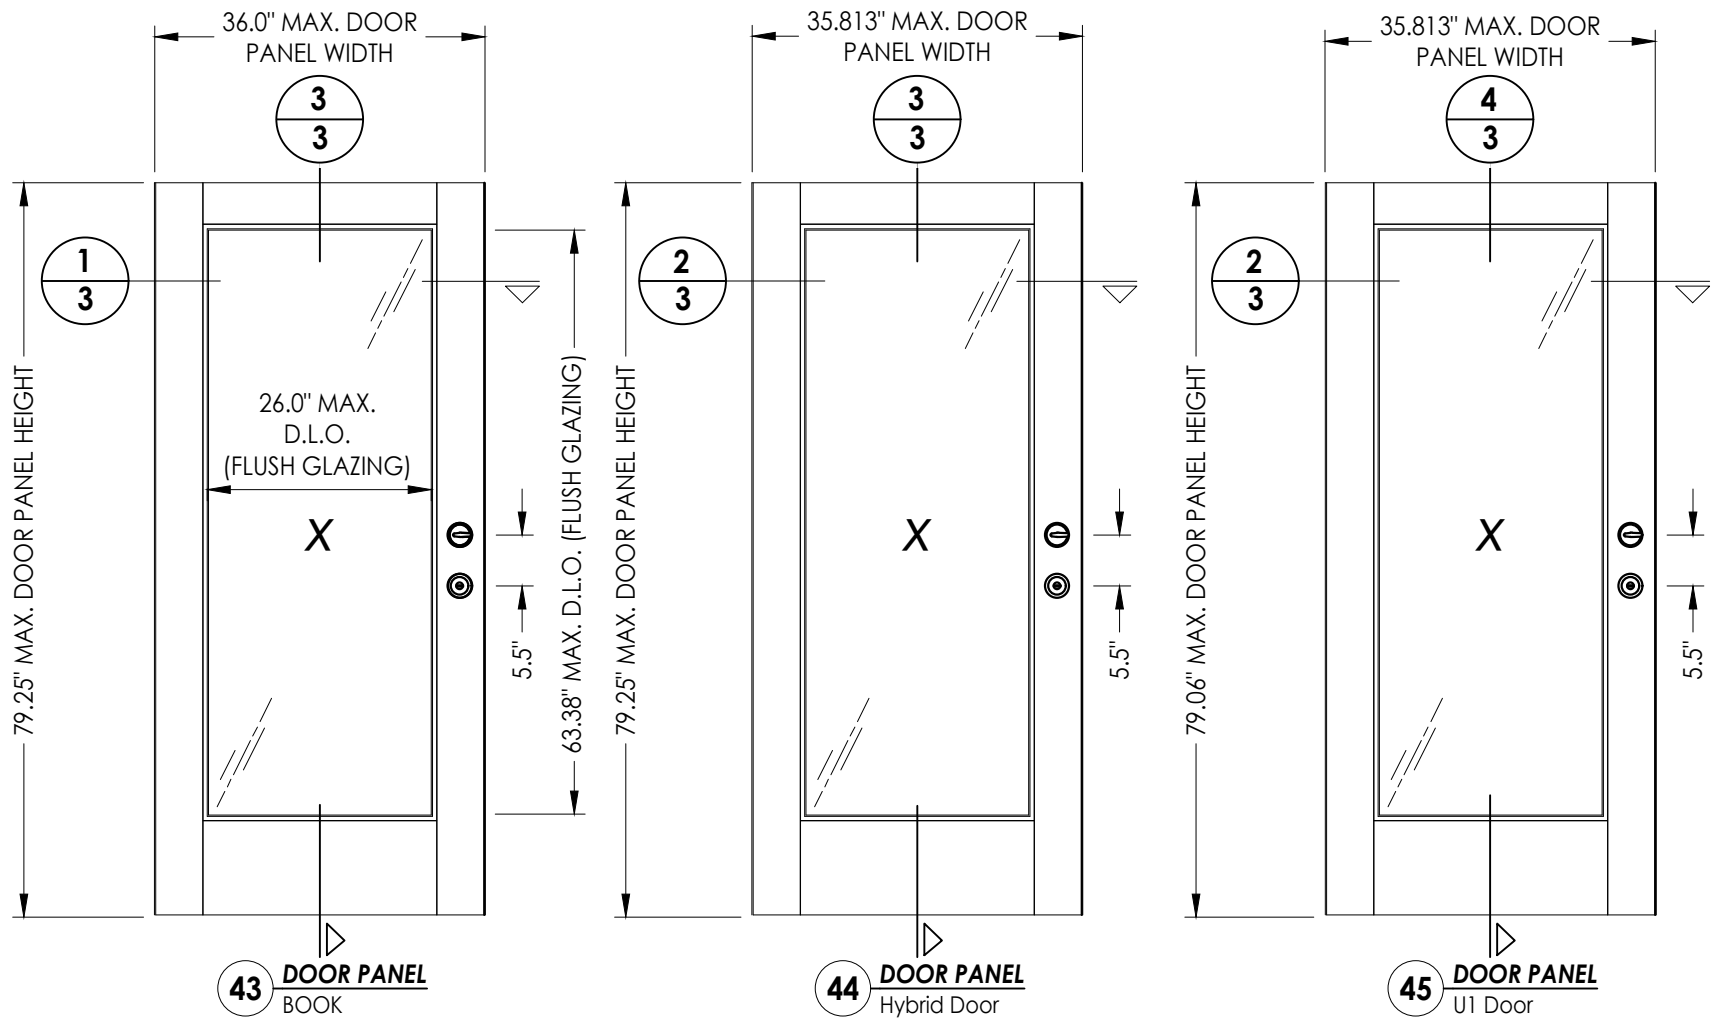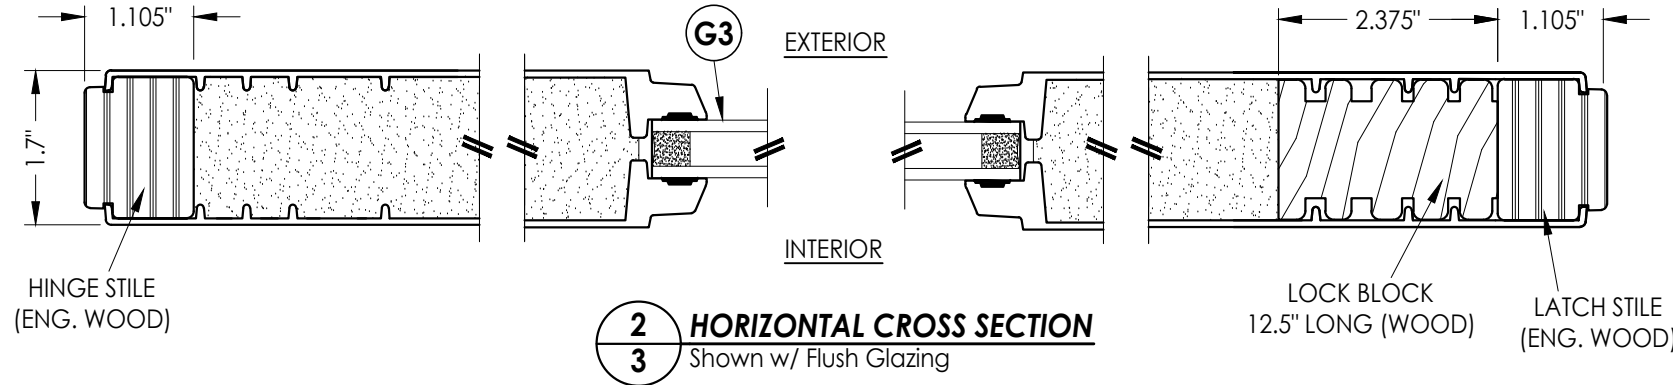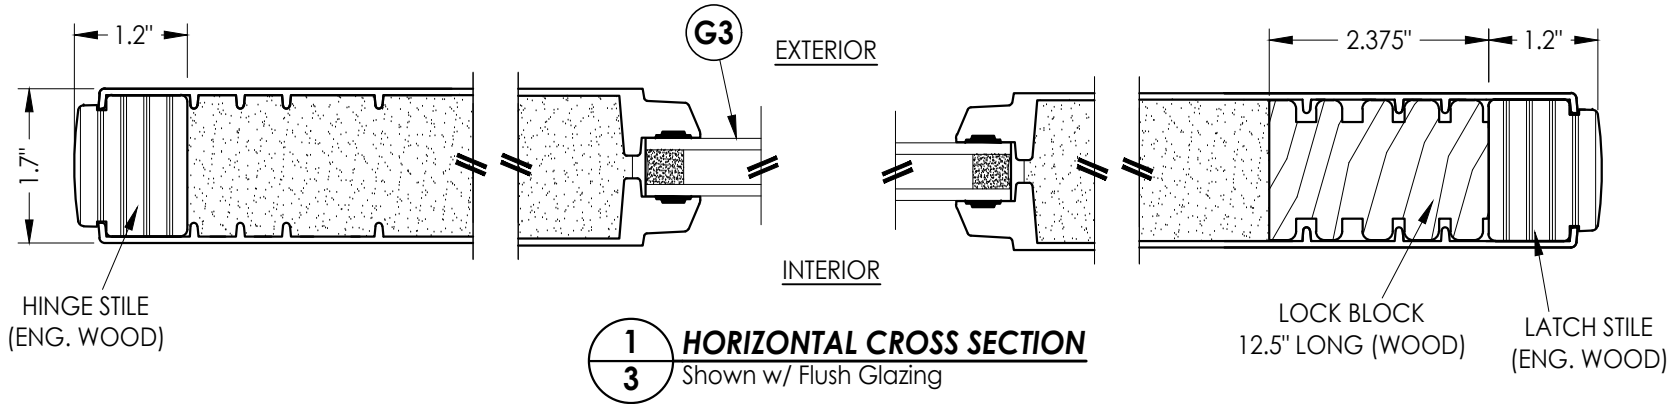


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Vairico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: DOOR PANEL DETAILS	
LFS	6	7/02/26	UPDATE TO 9TH ED. (2026)
LFS	5	8/23/23	UPDATE TO 8TH ED. (2023)
PO	4	7/16/20	UPDATE TO 7TH ED. (2020)
MT	3	10/10/18	REV. DOOR PANEL OPTION NOTE
RW	2	3/10/18	REVISE FLUSH GLAZING
JK	1	11/15/17	RECESSED PANEL NOTATION
BY		NO.	DATE
REVISIONS			
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.10			
SHEET 3 OF 15			



Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

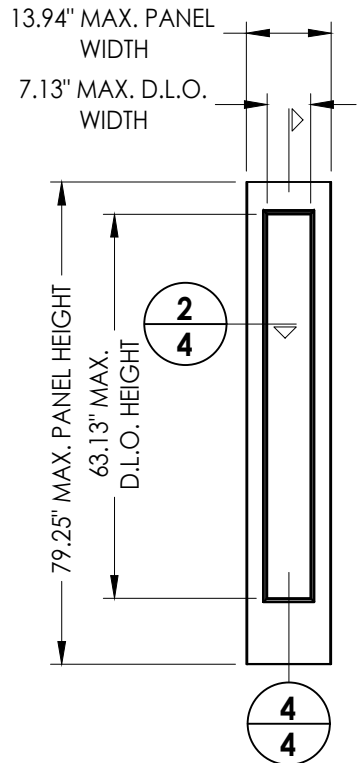


60 **SIDELITE PANEL**
Full Lite
Flush Glazed

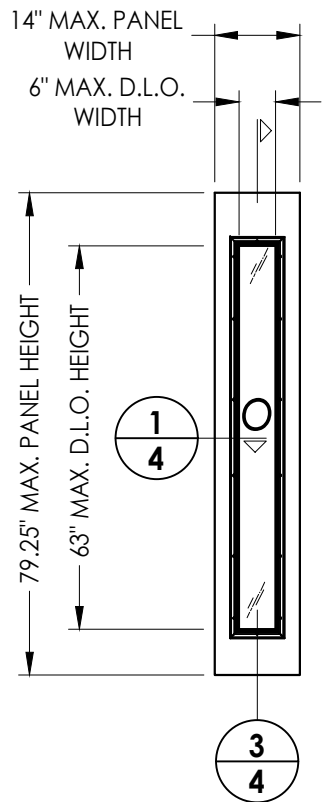


50 **SIDELITE PANEL**
Full Lite
Lip Lite

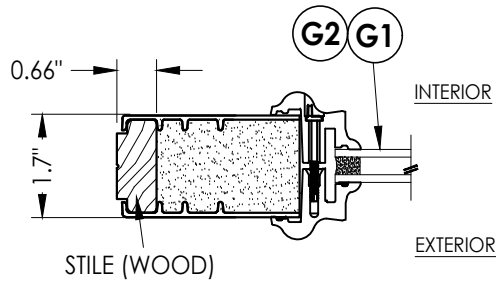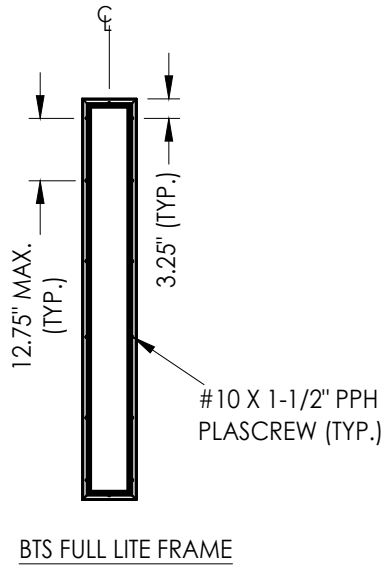


1 **HORIZONTAL CROSS SECTION**
4 Lip Lite Glazing

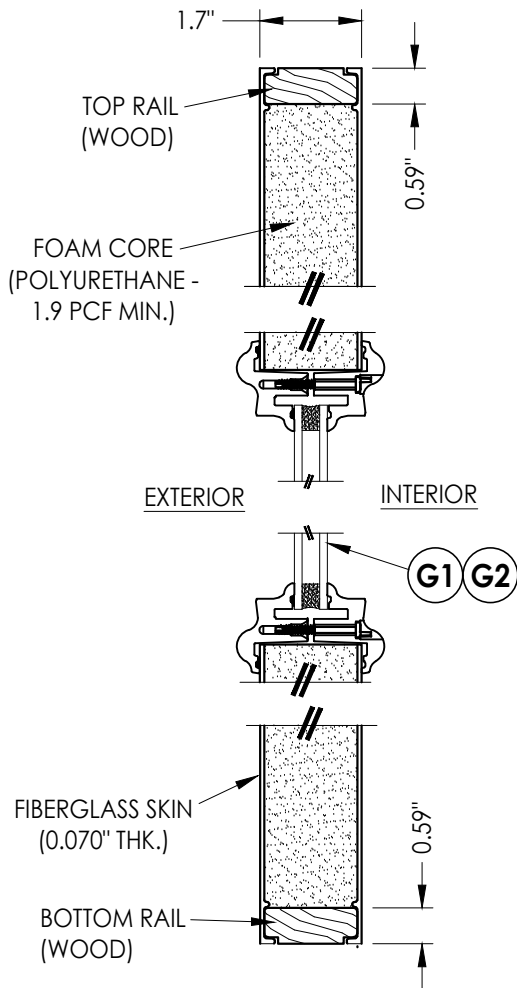

3 **VERTICAL CROSS SECTION**
4 Lip Lite Glazing Shown

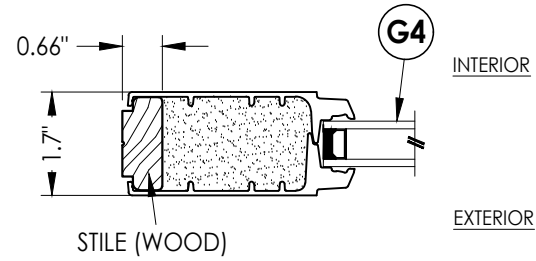

2 **HORIZONTAL CROSS SECTION**
4 Flush Glazing

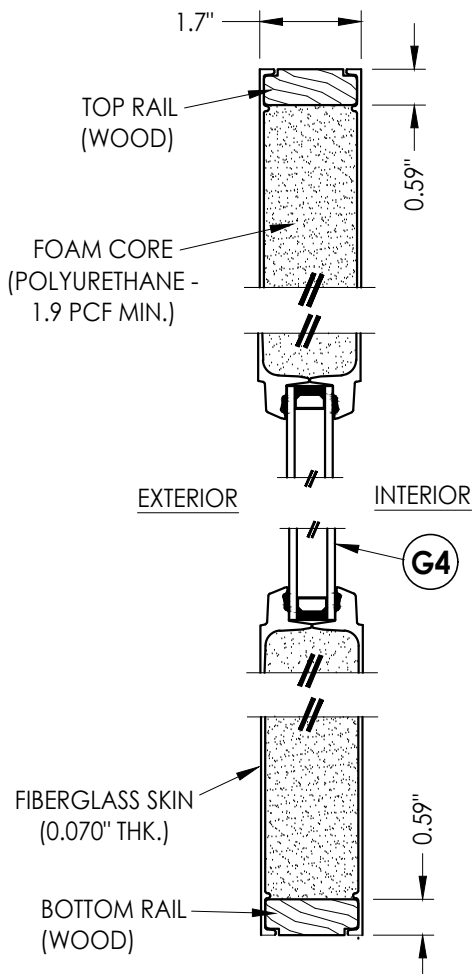

4 **VERTICAL CROSS SECTION**
4 Flush Glazing Shown

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
**THERMA TRU
FIBERGLASS DOOR**

PART OR ASSEMBLY:
SIDELITE PANEL DETAILS

NO.	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026) FBC
5	8/23/23	UPDATE TO 8TH ED. (2023) FBC
4	7/16/20	UPDATE TO 7TH ED. (2020) FBC
3	10/10/18	REV. DOOR PANEL OPTION NOTE
2	3/10/18	REVISE FLUSH GLAZING
1	11/15/17	RECESSED PANEL NOTATION

DATE: 8/10/16


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:
FL-21133.10


SHEET 4 OF 15

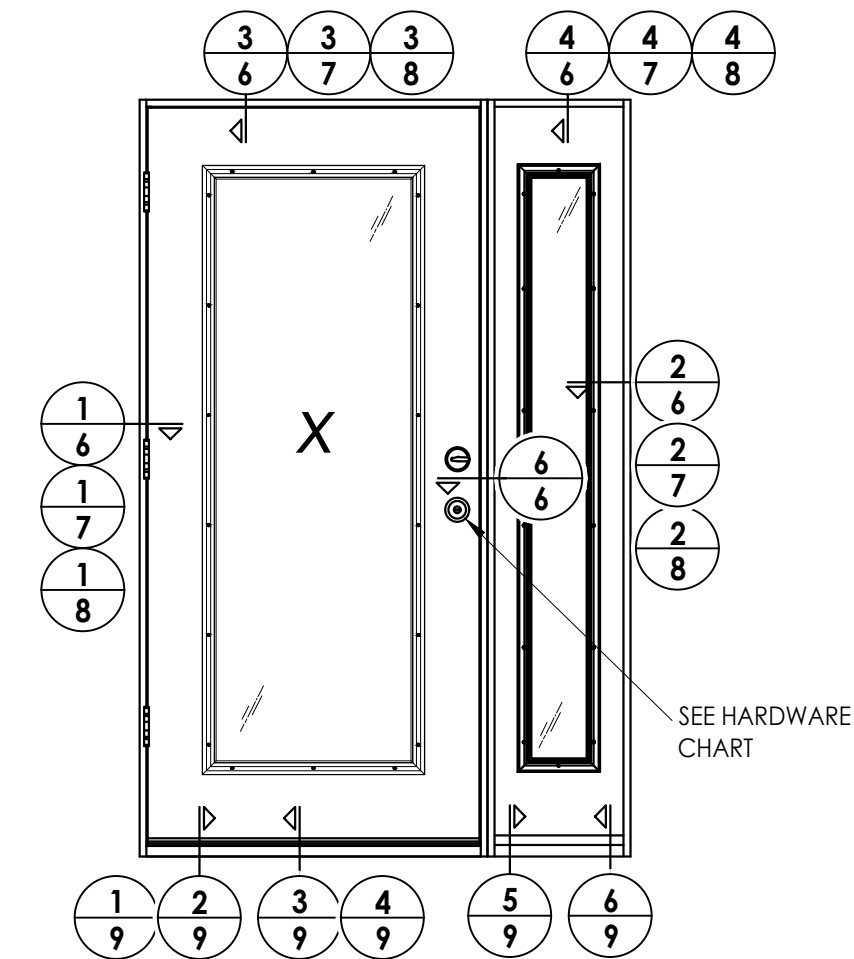

ELEVATION
XO

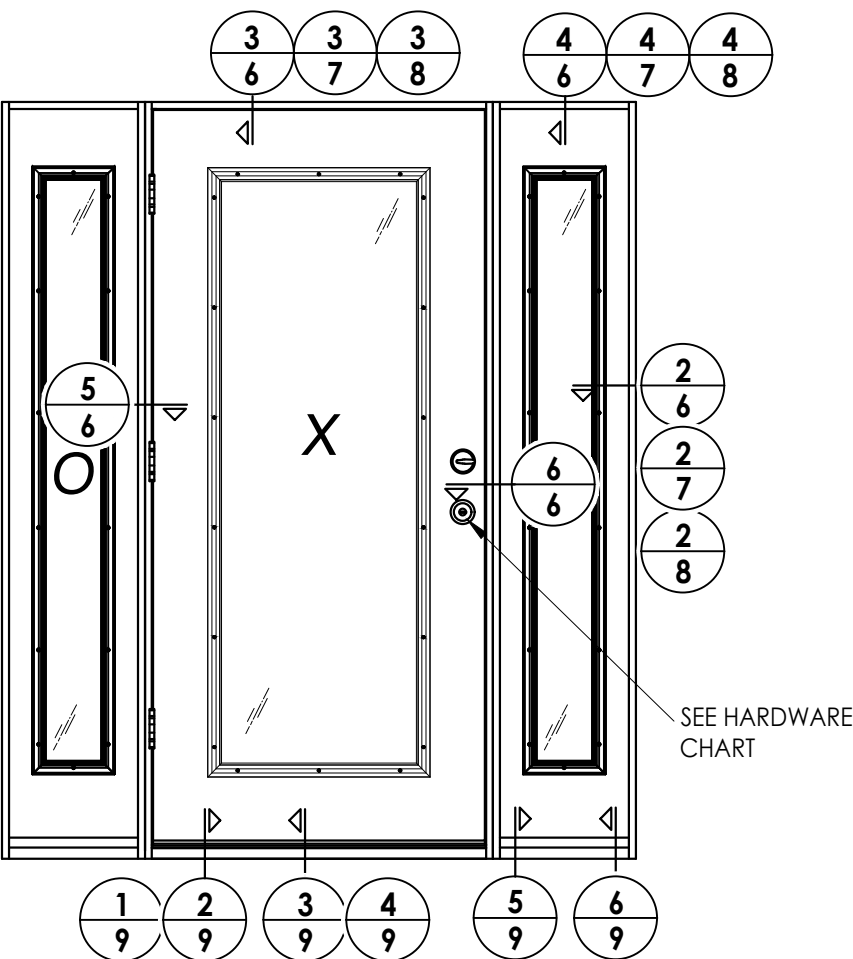

ELEVATION
OXO

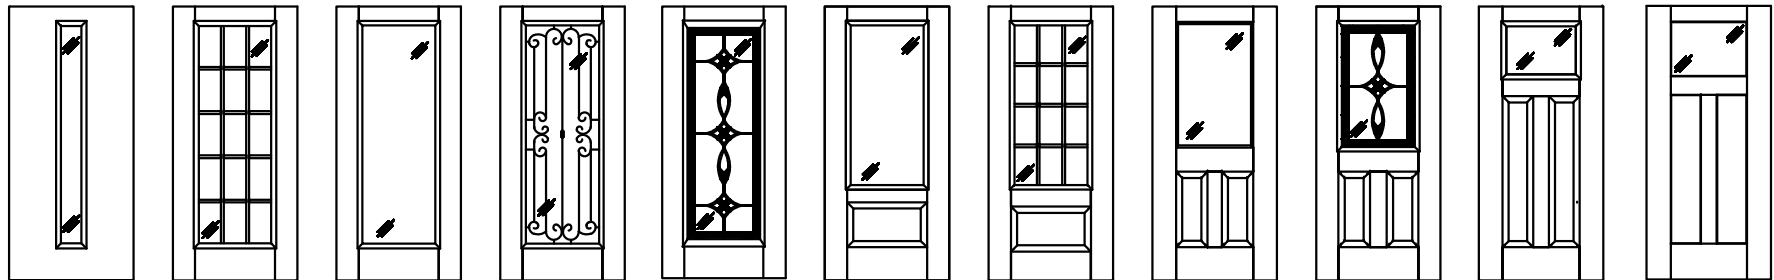

Fiber-Classic/Smooth-Star Door Panel Options

Products approved include all embossed and recessed panel doors.
Similar glazed panel configurations are allowed.
Panels shown are for illustration and are representative only.

HARDWARE TABLE	
MANUFACTURER	MODEL
SCHLAGE	KNOB: F51
	DEADBOLT: B60
KWIKSET	KNOB: SIGNATURE SERIES
	DEADBOLT: SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGART
	(3 pt. Manual Tongue)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS

67/02/26

58/23/23

47/16/20

310/10/18

23/10/18

111/15/17

UPDATE TO 9TH ED. (2026)

UPDATE TO 8TH ED. (2023)

UPDATE TO 7th ED (2020)

REV. DOOR PANEL OPTION

REVISE FLUSH GLAZING

RECESSED PANEL NOTATION

LFS

LFS

PO

MT

RW

JK

BY

FBC

FBC

FBC

NOTE

NO.

DATE

REVISIONS

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21133.10



SHEET 5 OF 15

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

© 2017 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

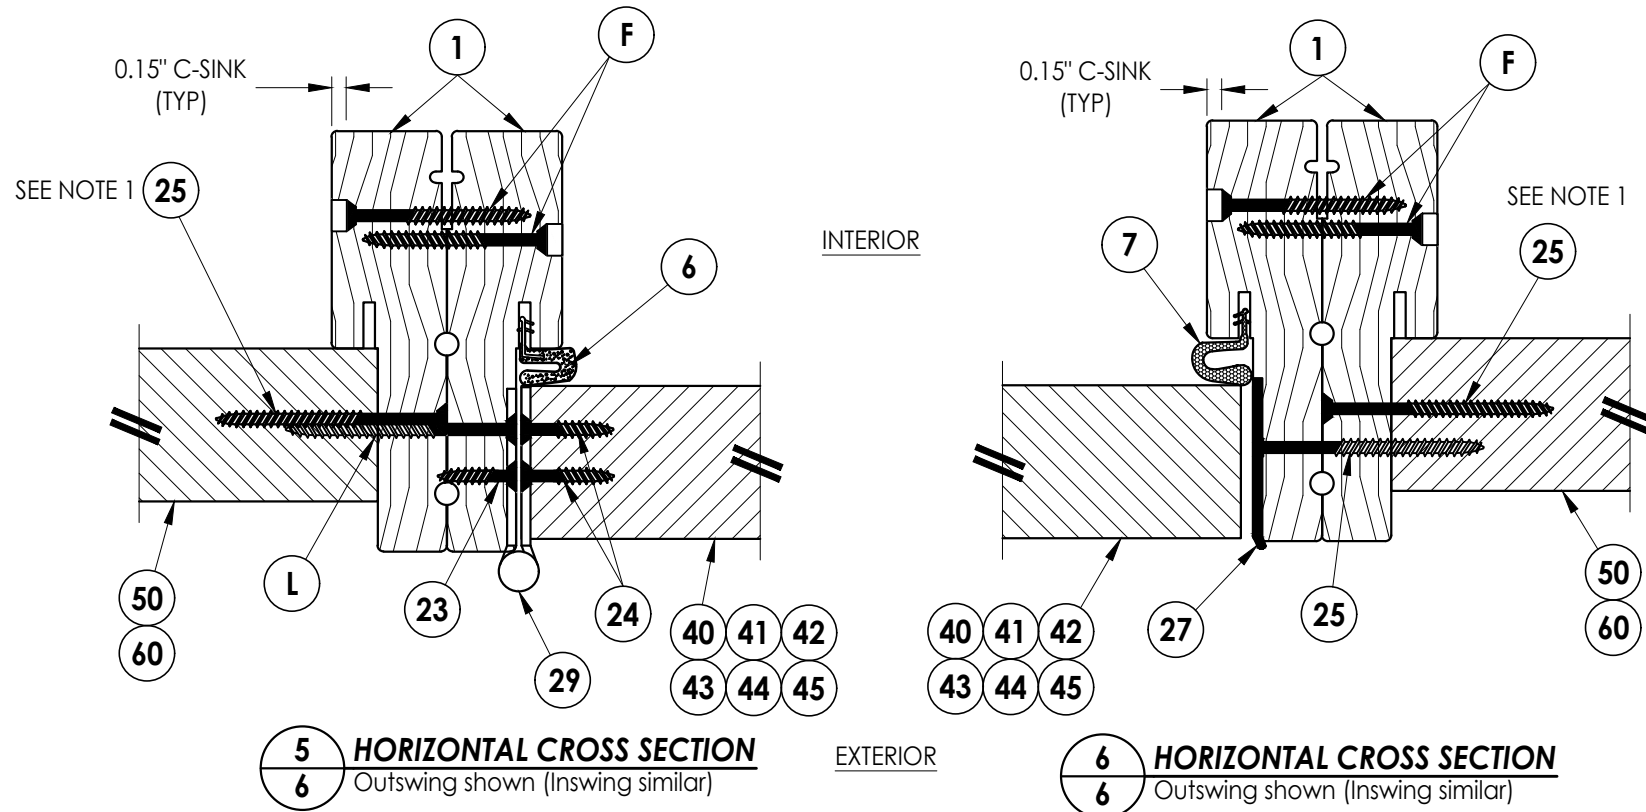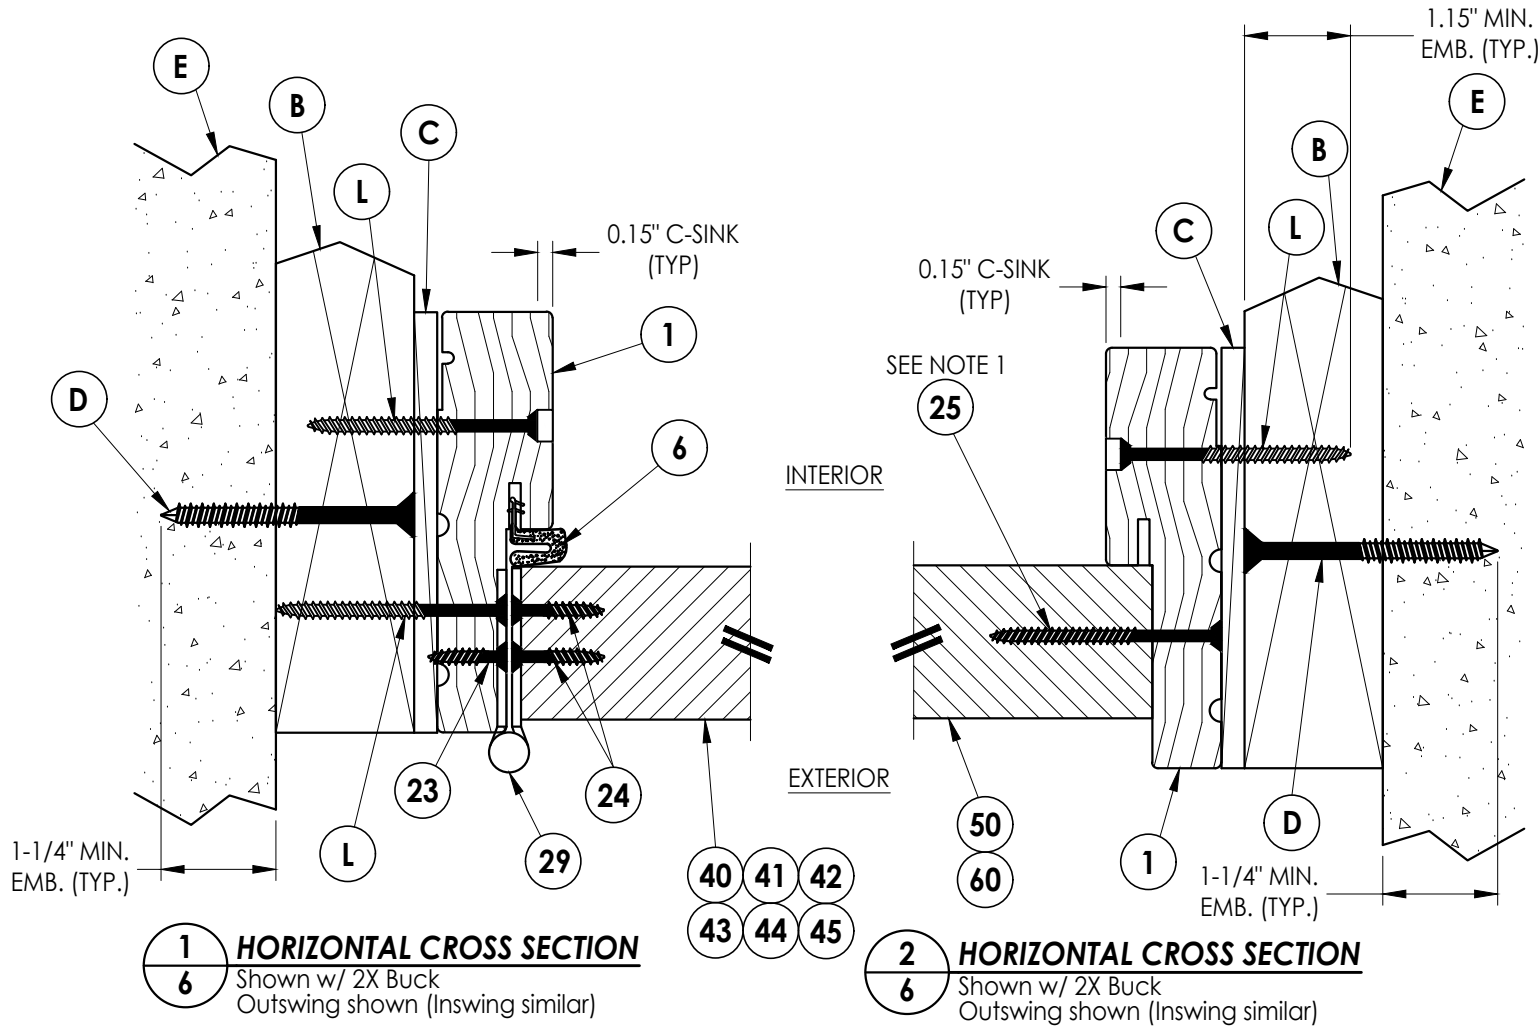

- Notes:
- Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 - Sidelite assembly screws located 3" from each end (2 screws along head jamb).

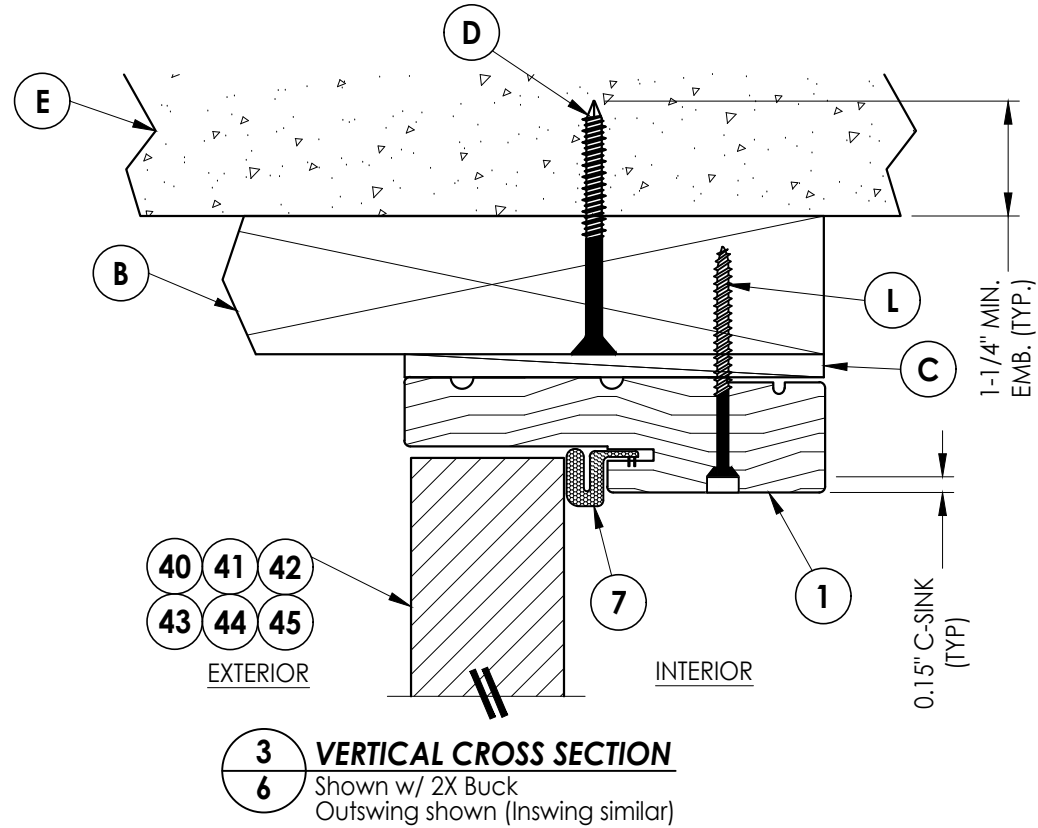

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

DATE	NO.	BY	REVISIONS
7/02/26	6	LFS	UPDATE TO 9TH ED. (2026) FBC
8/23/23	5	LFS	UPDATE TO 8TH ED. (2023) FBC
7/16/20	4	PO	UPDATE TO 7TH ED. (2020) FBC
10/10/18	3	MT	REV. DOOR PANEL OPTION NOTE
3/10/18	2	RW	REVISE FLUSH GLAZING
11/15/17	1	JK	RECESSED PANEL NOTATION

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-21133.10


SHEET 6 OF 15

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg


- Notes:
- 1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 - 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

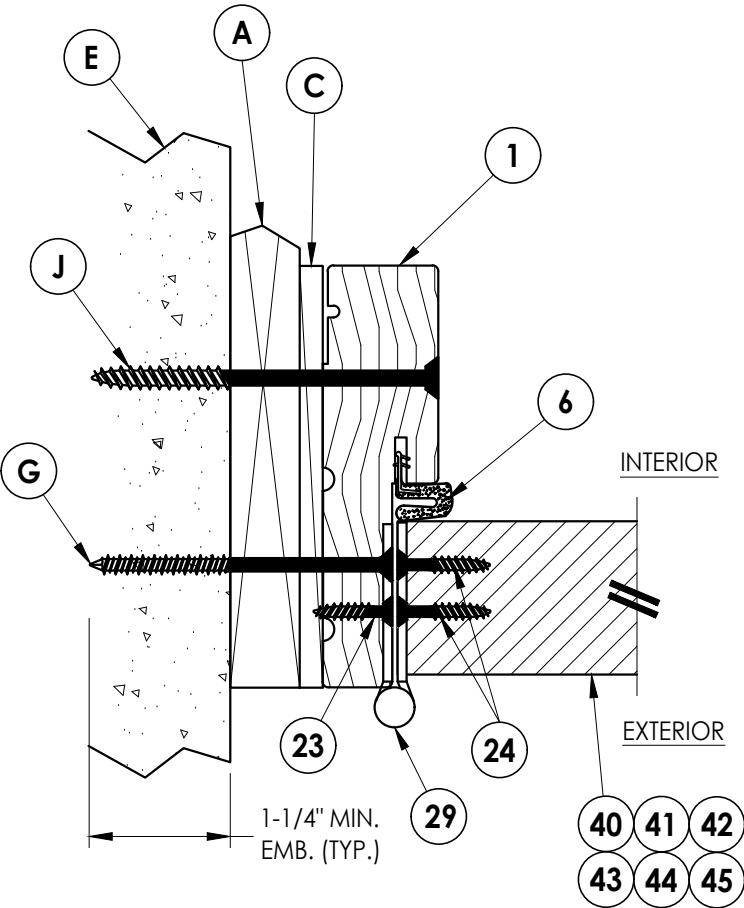


1
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

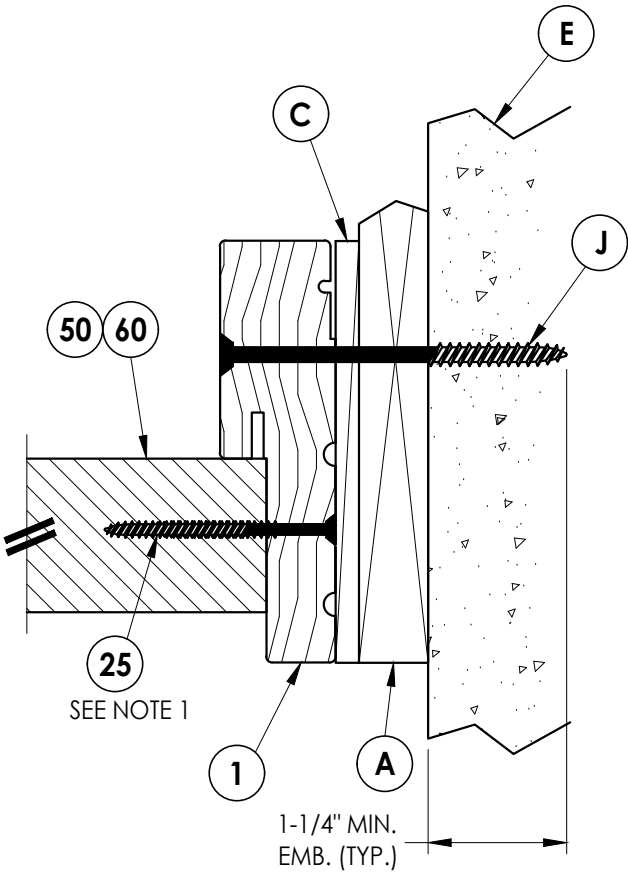

2
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

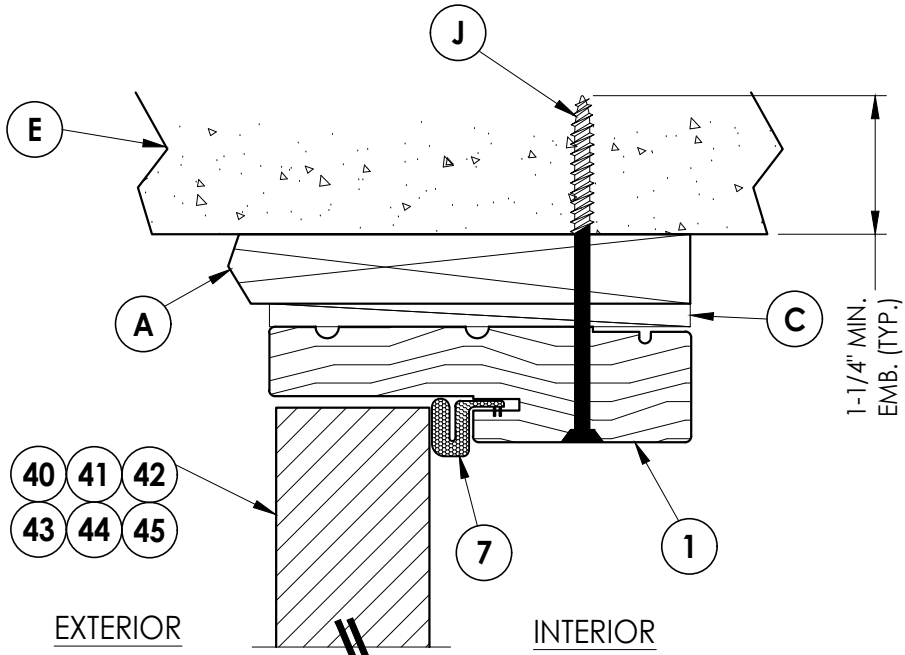

3
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

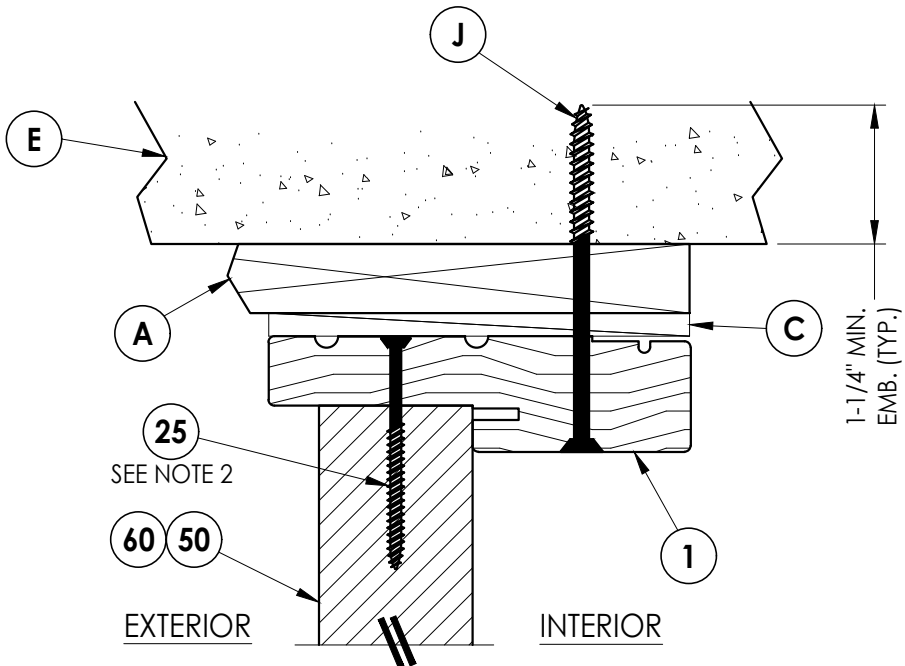

4
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION	NOTE	MT
2	3/10/18	REVISE FLUSH GLAZING		RW
1	11/15/17	RECESSED PANEL	NOTATION	JK
NO.	DATE			BY
REVISIONS				

DATE:	07/07/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21133.10
SHEET	7 OF 15

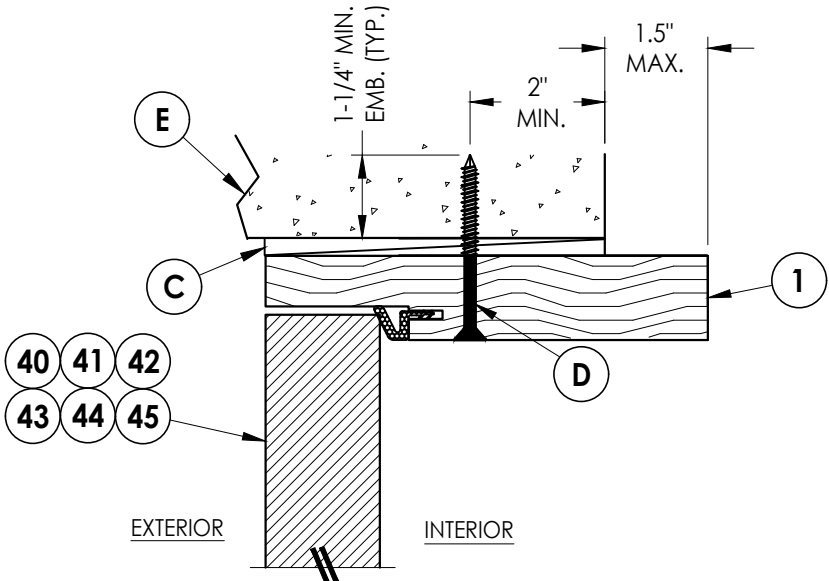


3 HORIZONTAL CROSS SECTION
8 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

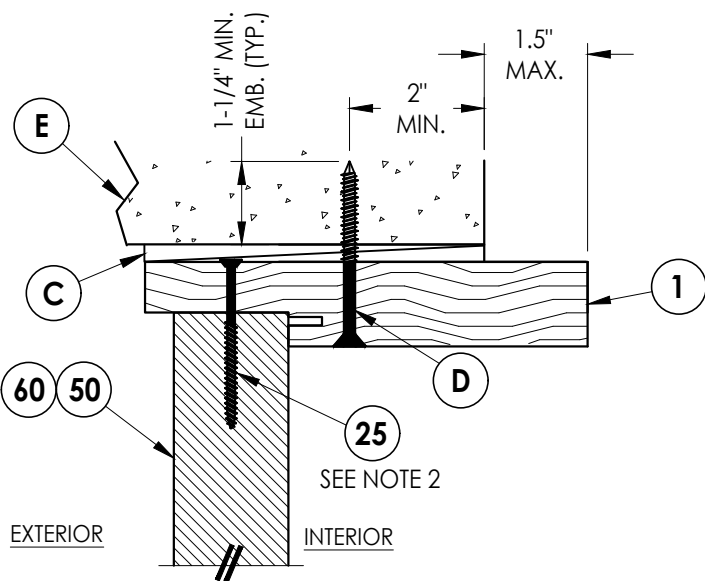


4 VERTICAL CROSS SECTION
8 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Notes:

1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

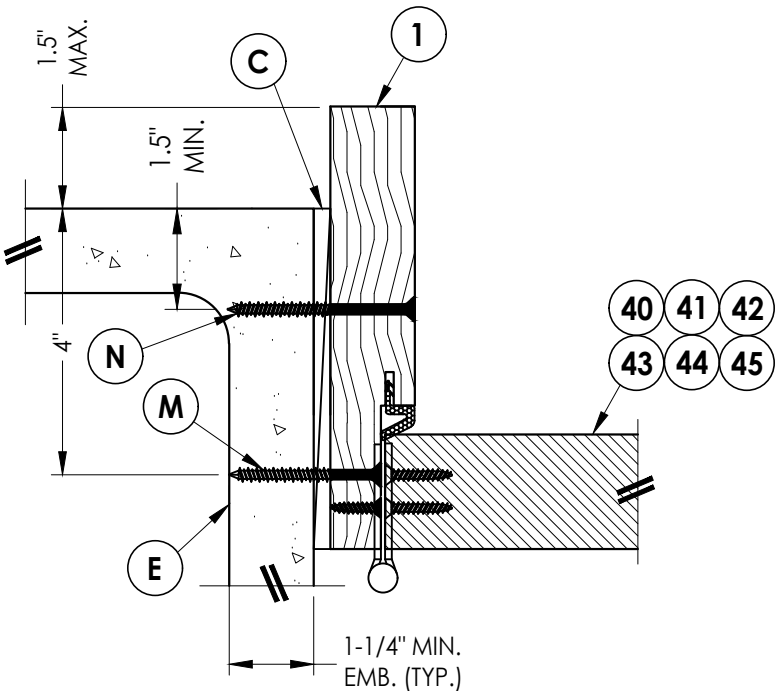

1 HORIZONTAL CROSS SECTION
8 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb






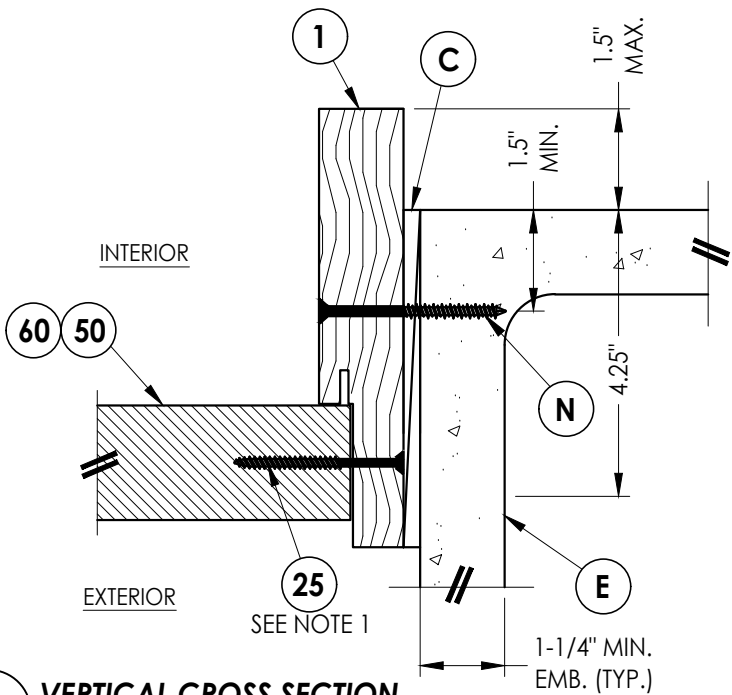


2 VERTICAL CROSS SECTION
8 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb



Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)	
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC
	7/16/20	UPDATE TO 7th ED (2020)	FBC
3	10/10/18	REV. DOOR PANEL OPTION	MT
2	3/10/18	REVISE FLUSH GLAZING	RW
1	11/15/17	RECESSED PANEL NOTATION	JK
NO.	DATE		BY
REVISIONS			
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.10			
SHEET 8 OF 15			

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

Notes:
1. Sill Item #'s 17, 18, 32, 34, 35, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 16 & 33 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS at each end.
2. Sidelite assembly screws located 4" from each end (2 screws along sill).

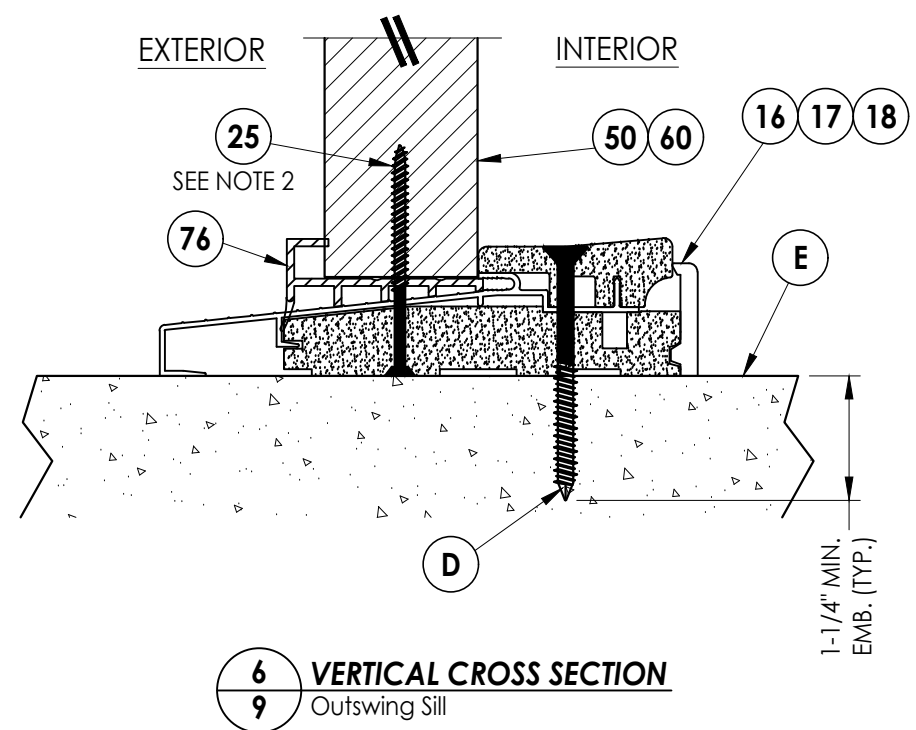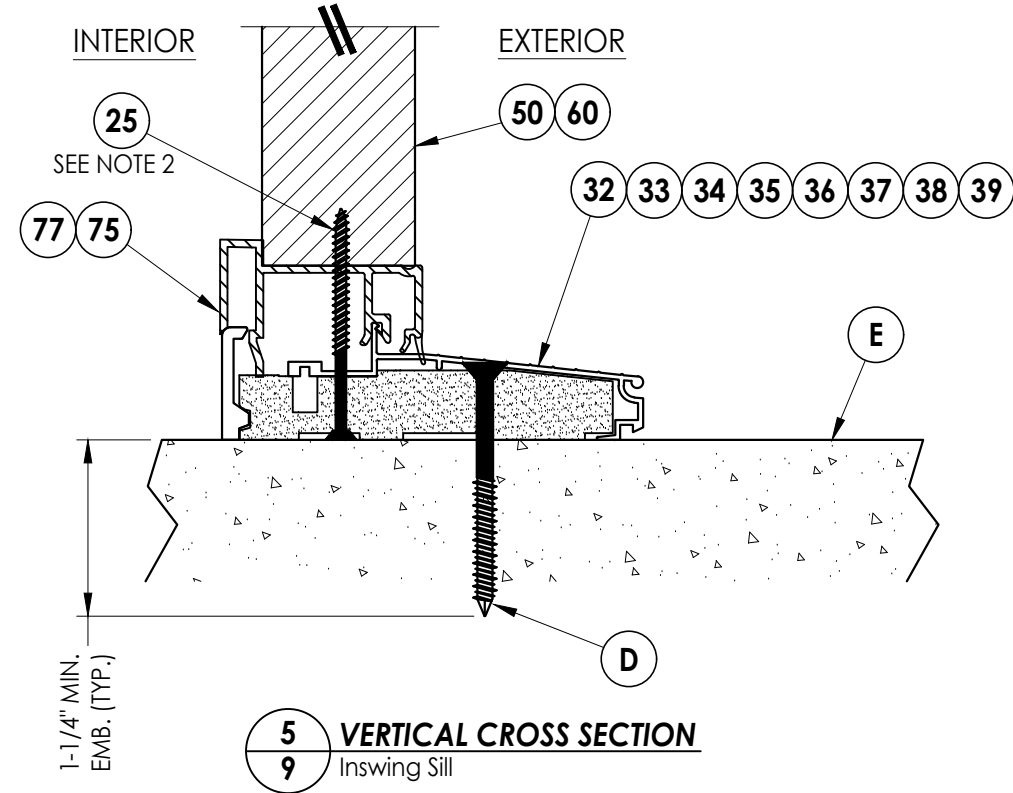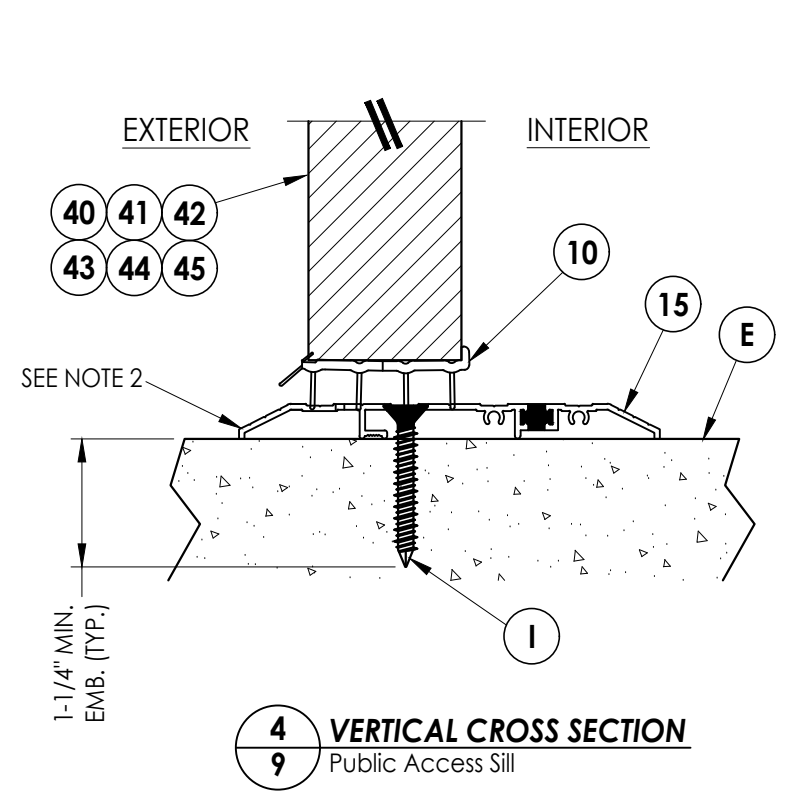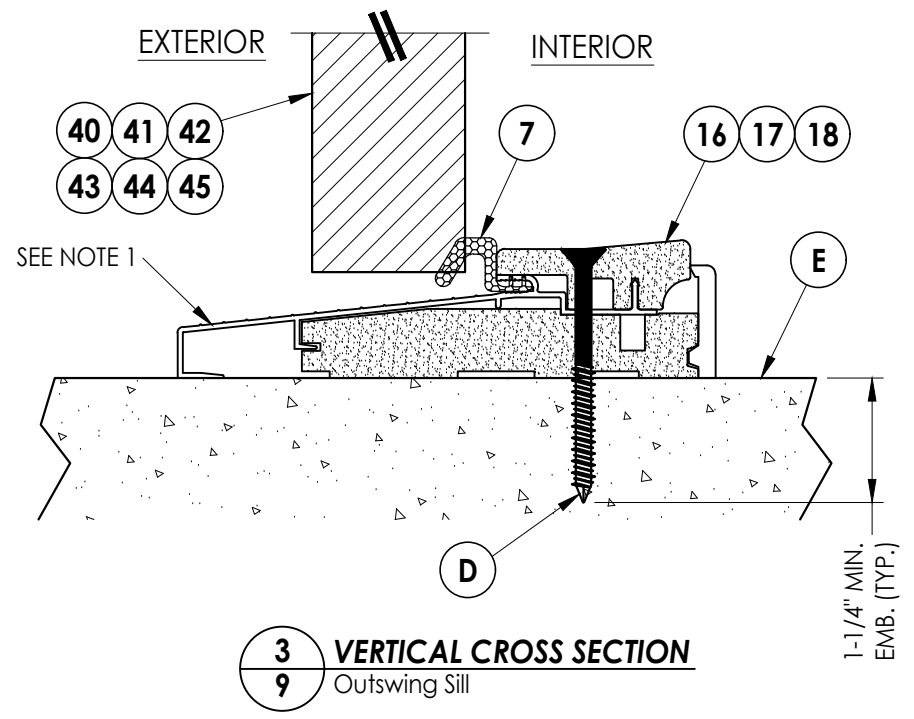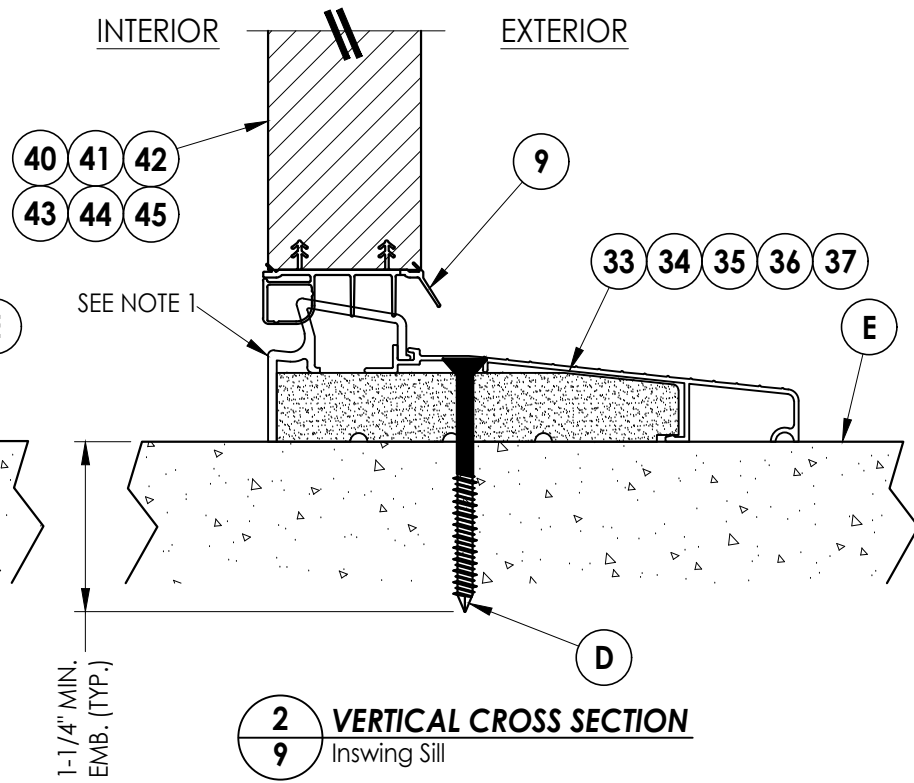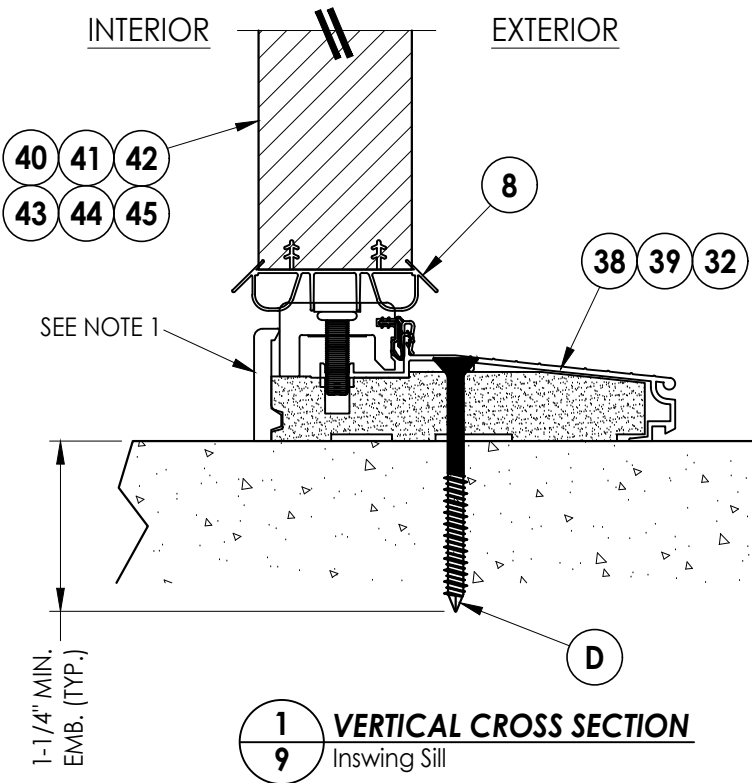


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)	
LFS	FBC	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026)	
5	8/23/23	UPDATE TO 8TH ED. (2023)	
4	7/16/20	UPDATE TO 7th ED. (2020)	
3	10/10/18	REV. DOOR PANEL OPTION NOTE	
2	3/10/18	REVISE FLUSH GLAZING	
1	11/15/17	RECESSED PANEL NOTATION	
NO.	DATE		
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.10			
SHEET 9 OF 15			

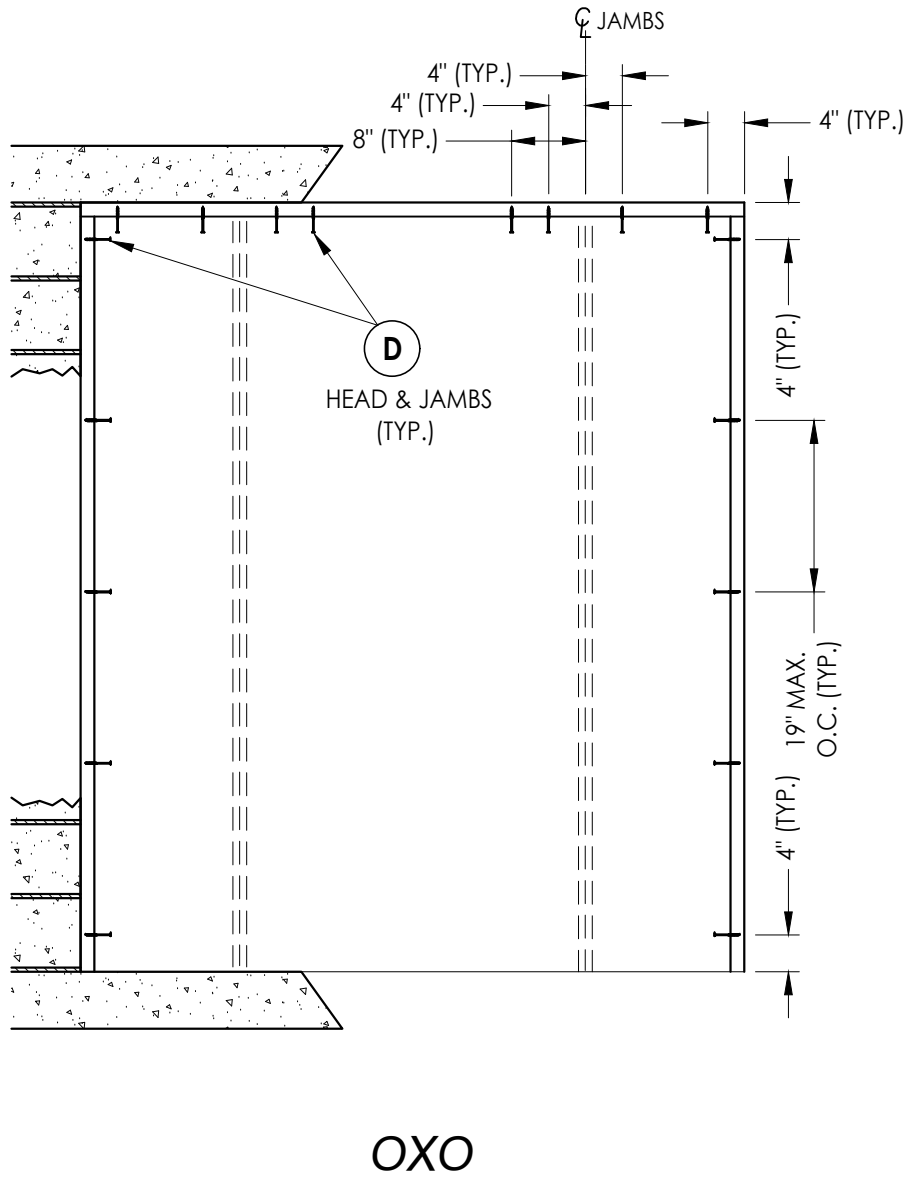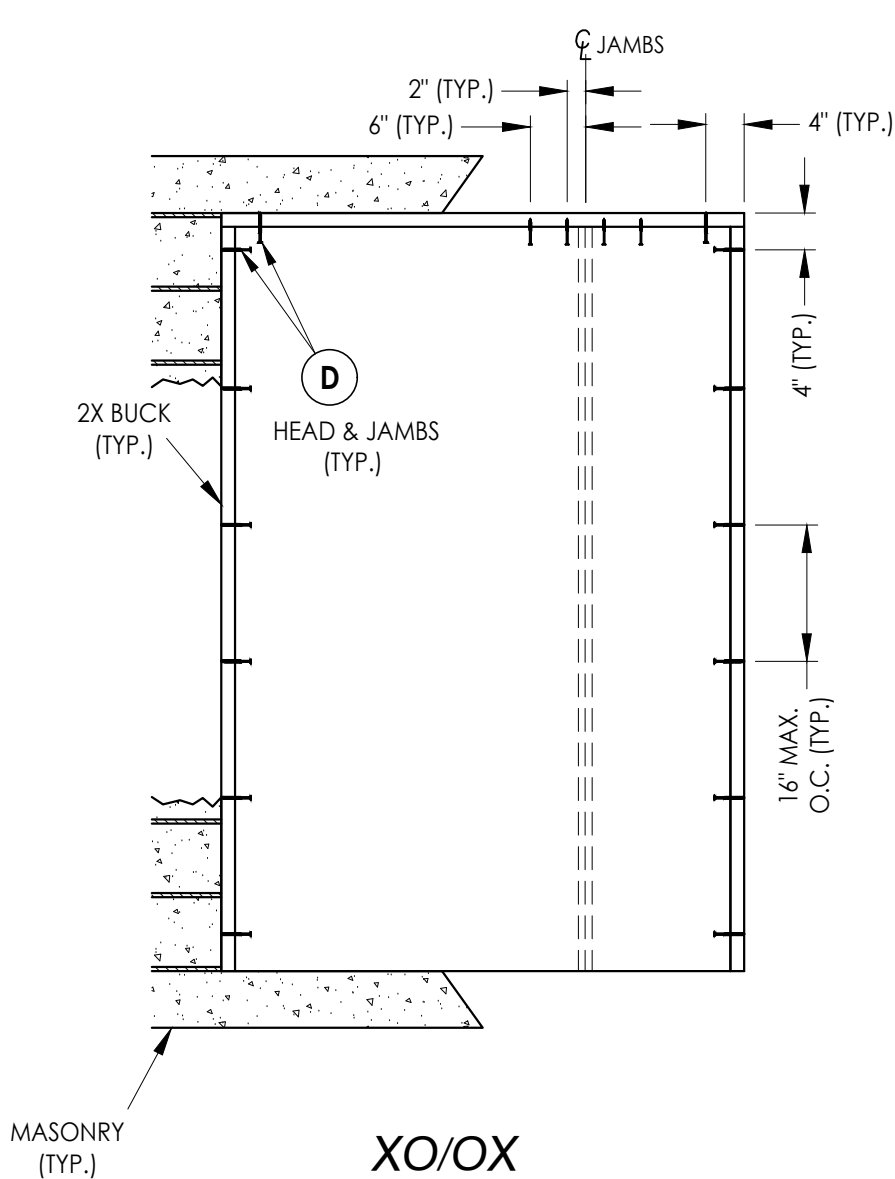


2X BUCK ANCHORING

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: BUCK ANCHORING	
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC
4	7/16/20	UPDATE TO 7th ED (2020)	FBC
3	10/10/18	REV. DOOR PANEL OPTION NOTE	MT
2	3/10/18	REVISE FLUSH GLAZING	RW
1	11/15/17	RECESSED PANEL NOTATION	JK
NO.	DATE		BY
REVISIONS			
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.10			
SHEET 10 OF 15			


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

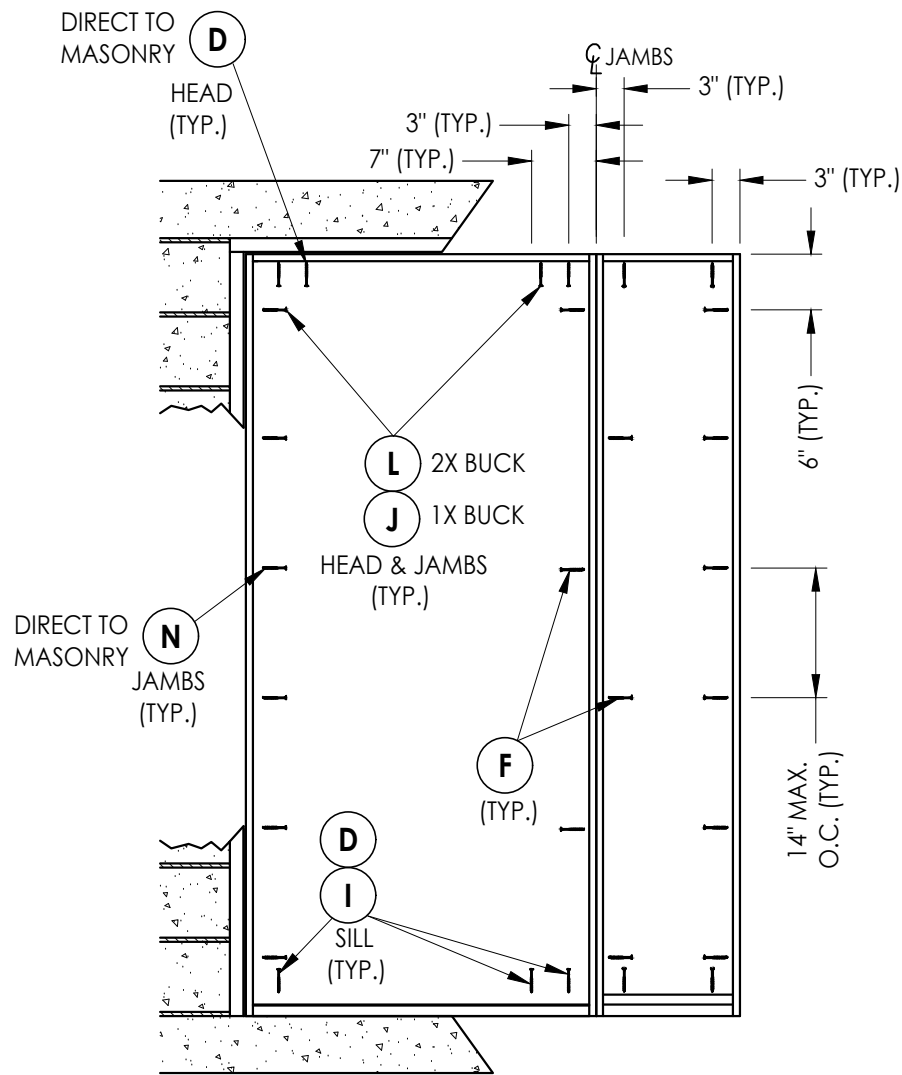

XO/OX

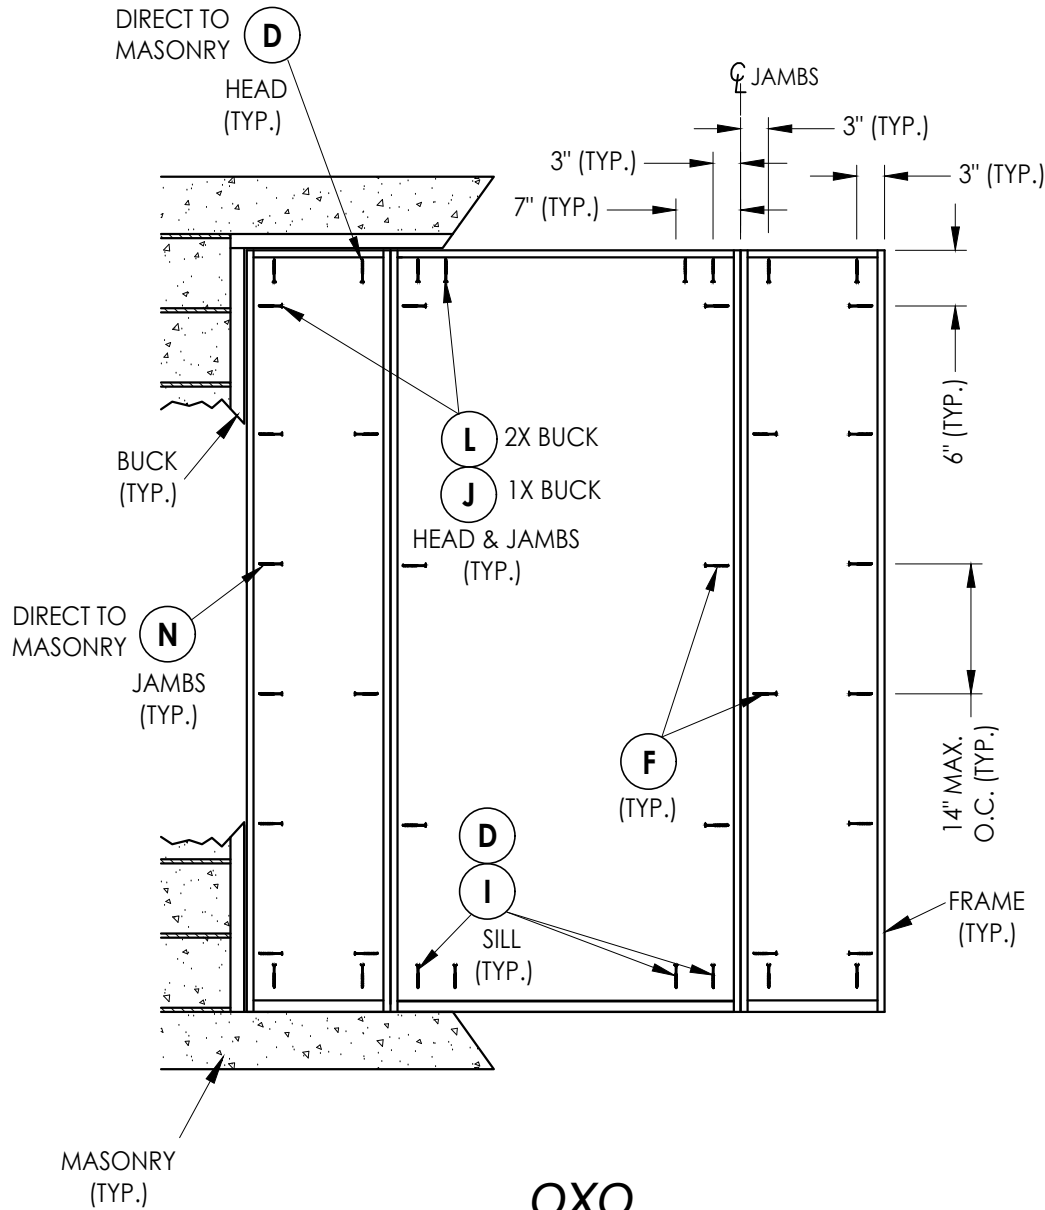


OXO

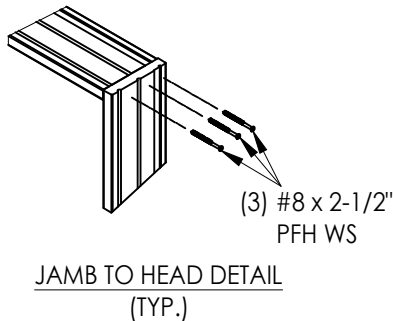


FRAME ANCHORING

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813		
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: FRAME ANCHORING		
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION NOTE	MT	
2	3/10/18	REVISE FLUSH GLAZING	RW	
1	11/15/17	RECESSED PANEL NOTATION	JK	
NO.	DATE			BY
REVISIONS				
DATE: 07/07/17				
SCALE: N.T.S.				
DWG. BY: JK				
CHK. BY: LFS				
DRAWING NO.: FL-21133.10				
SHEET 11 OF 15				


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

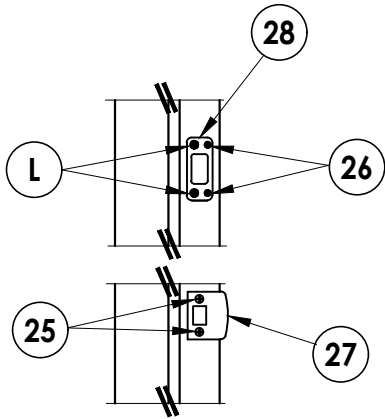


LATCH & DEADBOLT DETAIL
Kwikset

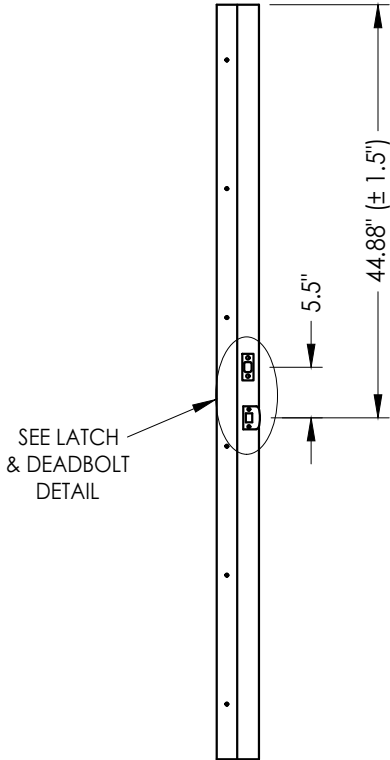


STRIKE JAMB
Latch and Deadbolt

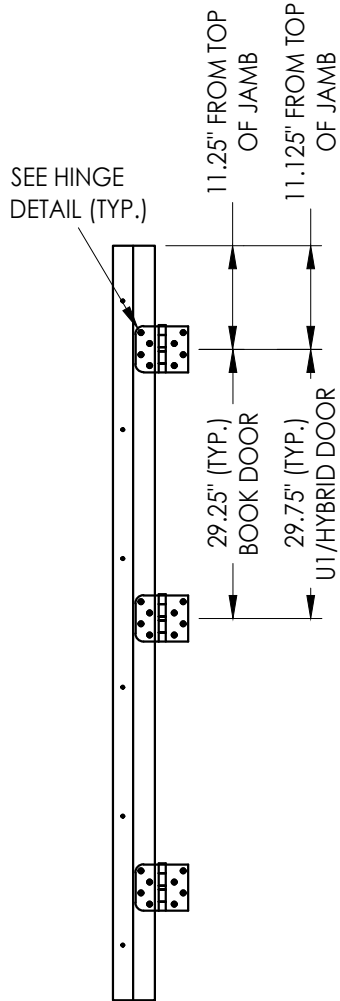


HINGE JAMB

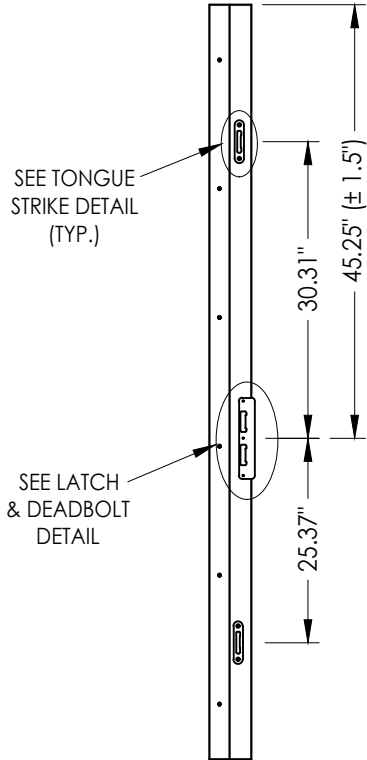


STRIKE JAMB
Multipoint Lock




TONGUE STRIKE DETAIL
Multipoint Lock

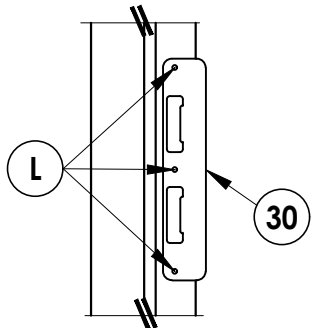

LATCH & DEADBOLT DETAIL
Multipoint Lock

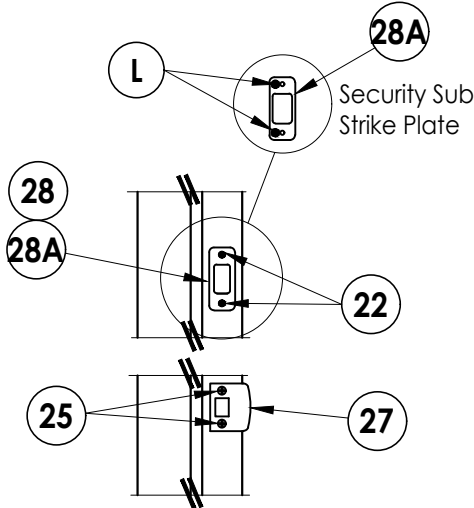

LATCH & DEADBOLT DETAIL
Schlage

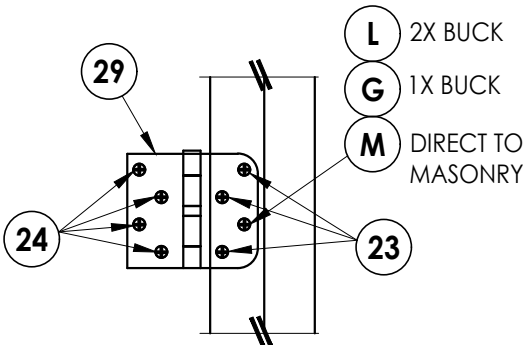


HINGE DETAIL

MULTIPOINT LOCK STRIKE DETAILS


LATCH & DEADBOLT STRIKE DETAILS

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: HARDWARE DETAILS	
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC
4	7/16/20	UPDATE TO 7th ED (2020)	FBC
3	10/10/18	REV. DOOR PANEL OPTION	NOTE
2	3/10/18	REVISE FLUSH GLAZING	RW
1	11/15/17	RECESSED PANEL NOTATION	JK
NO	DATE		BY
REVISIONS			
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21133.10			
SHEET 12 OF 15			


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

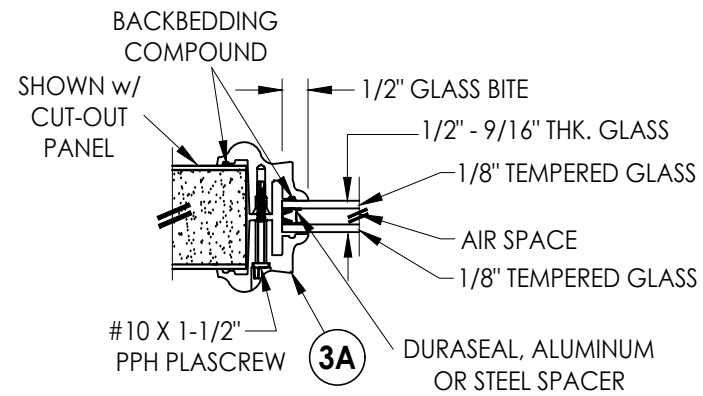


G1 GLAZING DETAIL
BTS Lite Frame
Door Panels & Sidelites

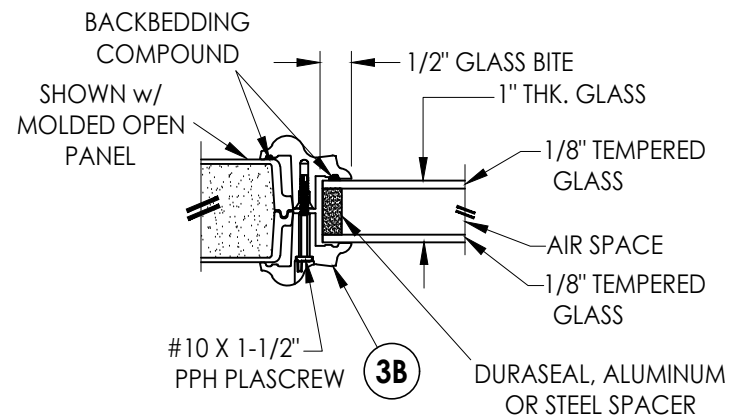


G2 GLAZING DETAIL
BTS Lite Frame
Door Panels & Sidelites

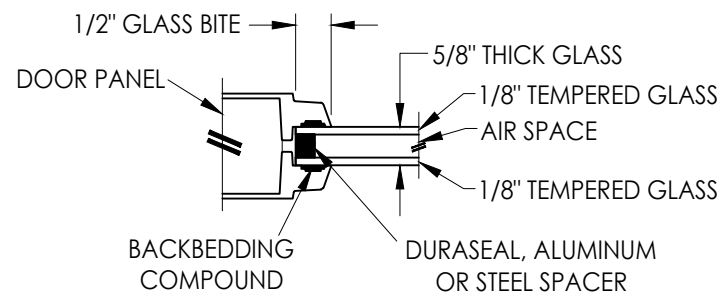


G3 GLAZING DETAIL
Flush Glazing
Door Panels

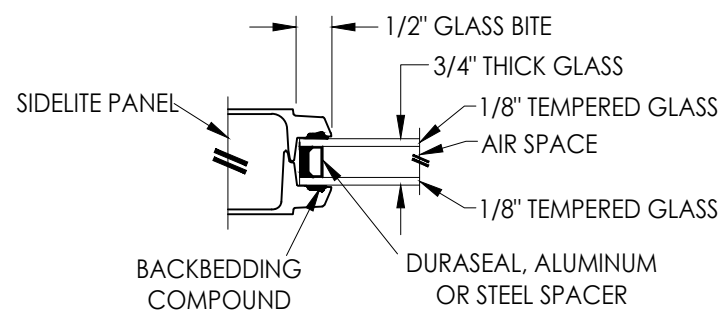


G4 GLAZING DETAIL
Flush Glazing
Sidelites

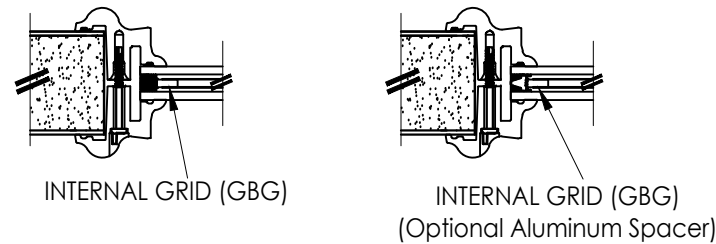


9/16" INSULATED GLASS INSERT OPTIONS

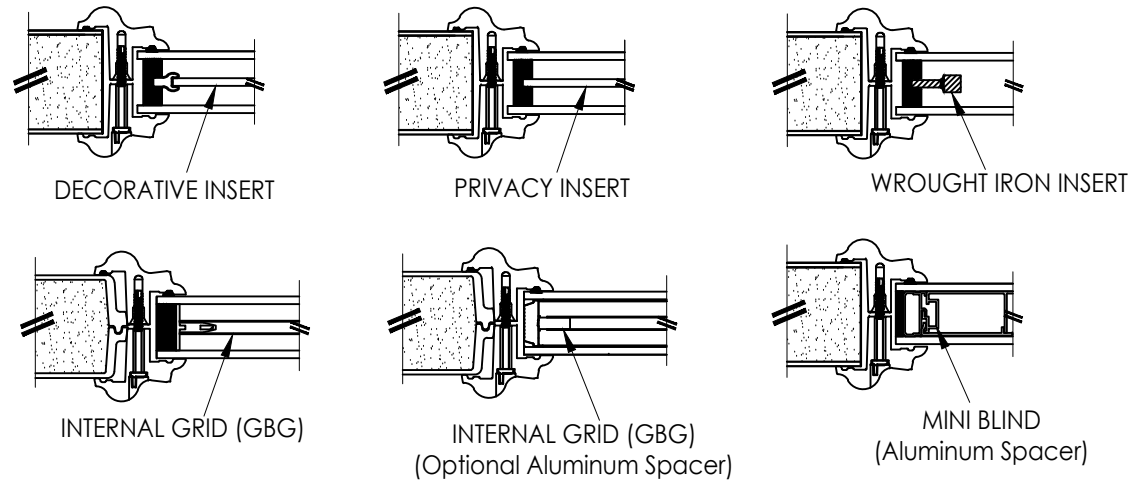




1" INSULATED GLASS INSERT OPTIONS

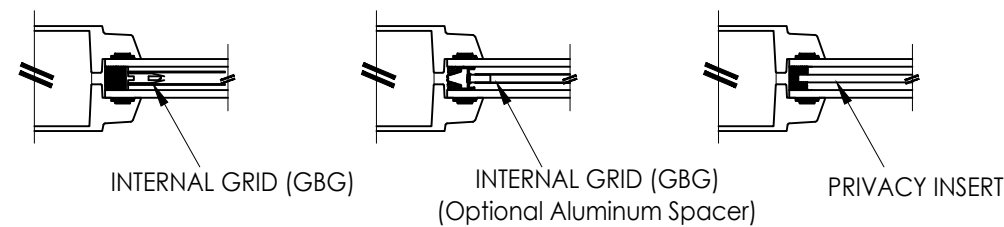

5/8" INSULATED GLASS INSERT OPTIONS

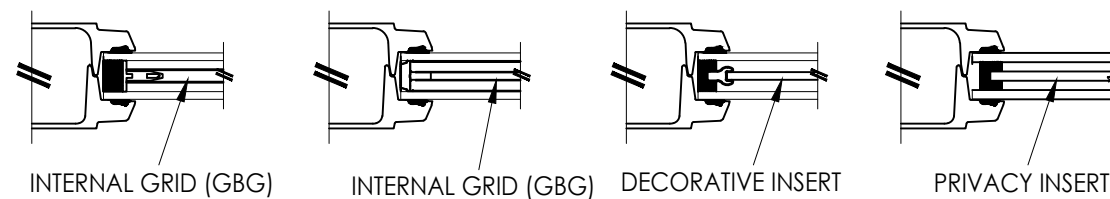

3/4" INSULATED GLASS INSERT OPTIONS

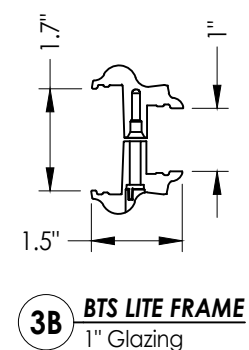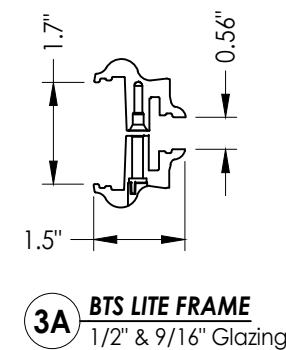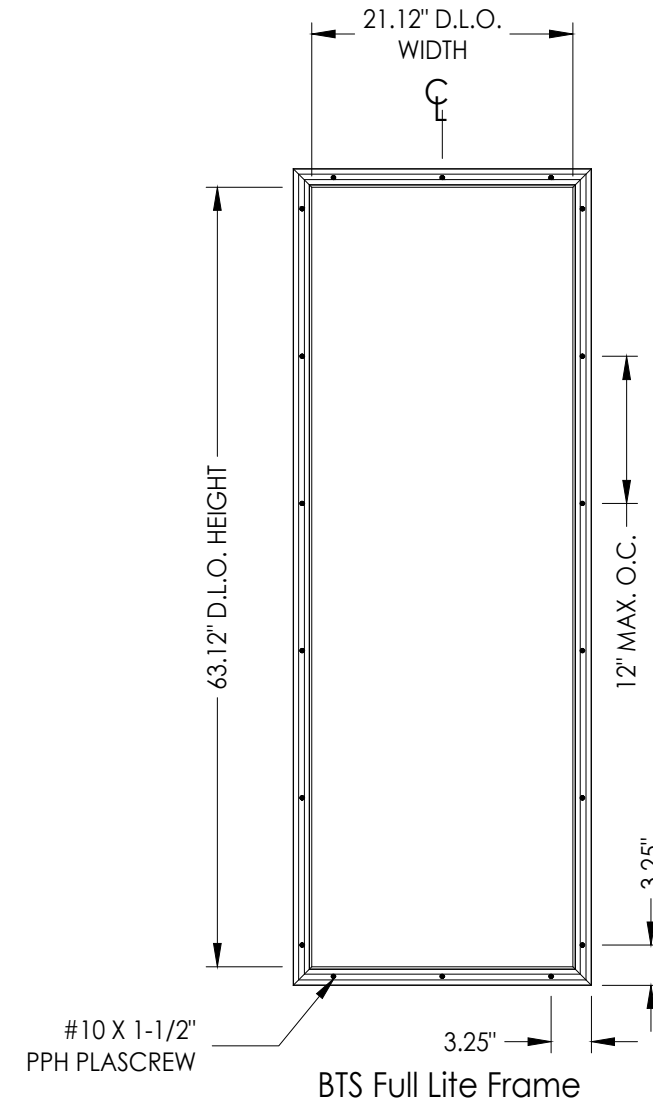

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

NO.	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026) FBC
5	8/23/23	UPDATE TO 8TH ED. (2023) FBC
4	7/16/20	UPDATE TO 7TH ED. (2020) FBC
3	10/10/18	REV. DOOR PANEL OPTION NOTE
2	3/10/18	REVISE FLUSH GLAZING
1	11/15/17	RECESSED PANEL NOTATION


DATE: 07/07/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21133.10
SHEET 13 OF 15

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

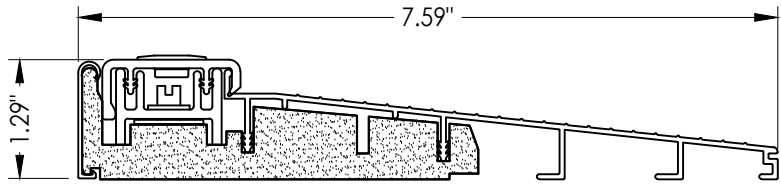


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

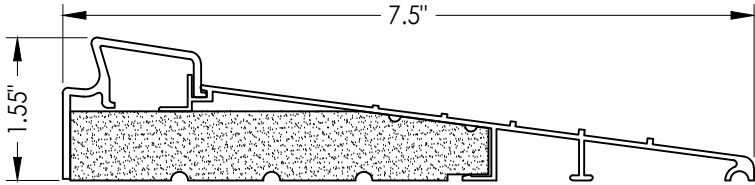


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

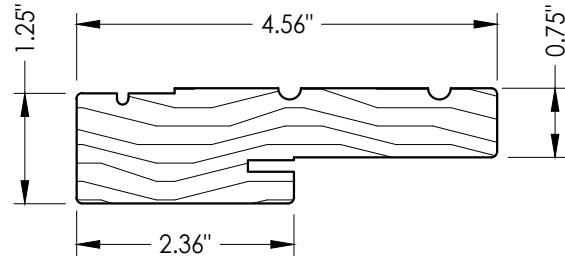


1 WOOD JAMB

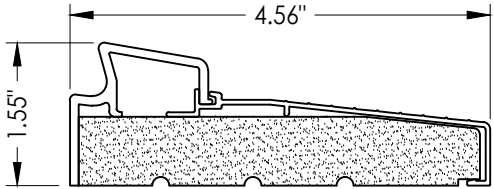


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

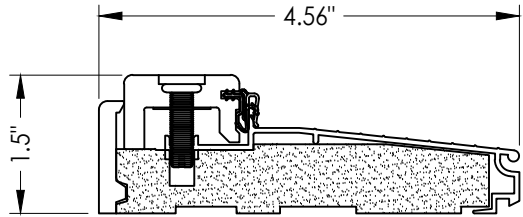


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

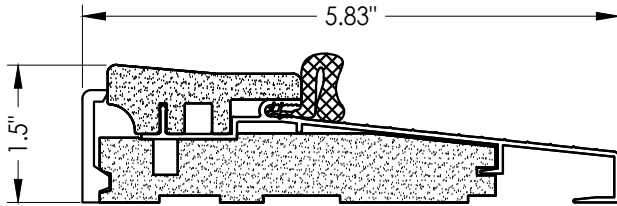


16 OUTSWING THRESHOLD
Composite Sill

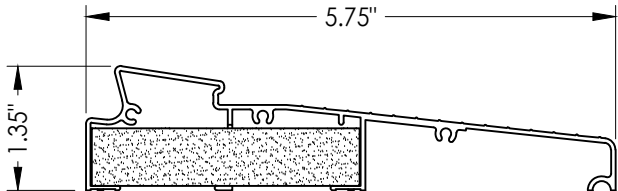


34 INSWING THRESHOLD
Inswing Moderate Climate Sill 1-3/8"

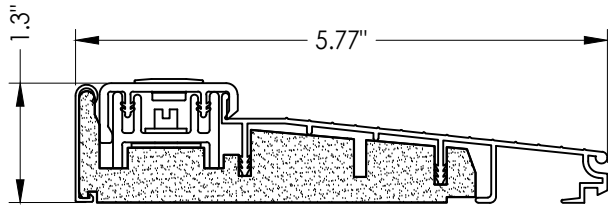


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

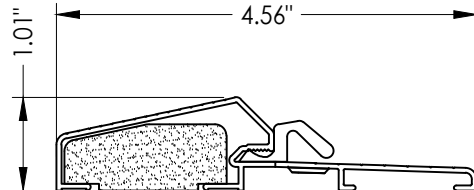


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

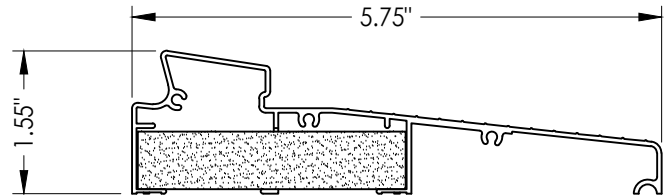


35 INSWING THRESHOLD
Inswing Moderate Climate Sill

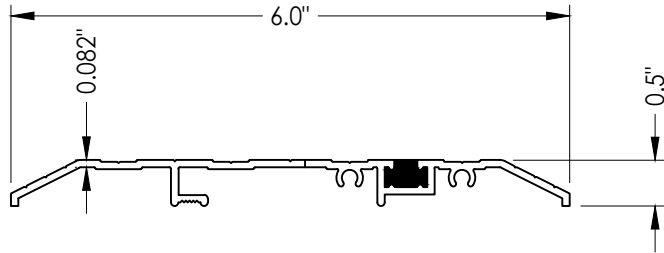


15 PUBLIC ACCESS THRESHOLD

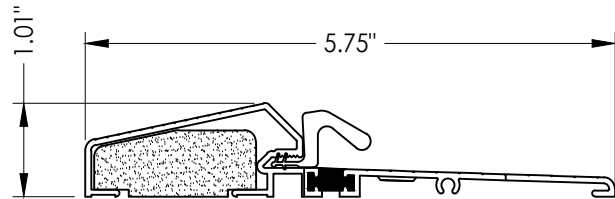


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

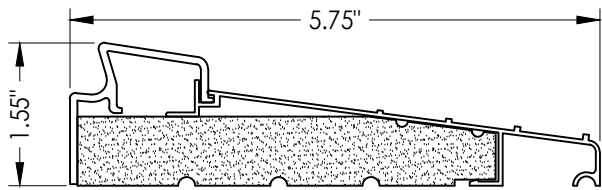


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill




8 SWEEP




9 SWEEP




10 SWEEP

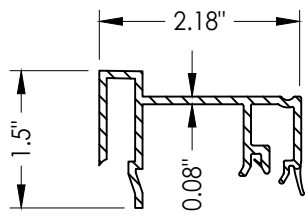

75 SIDELITE SPACER
Inswing



76 SIDELITE SPACER
Outswing

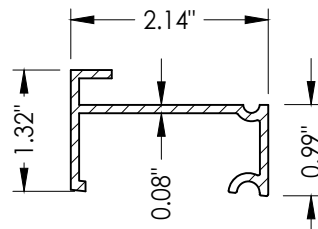

77 SIDELITE SPACER
Inswing
Moderate Climate Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
5	8/23/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
4	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
3	10/10/18	REV. DOOR PANEL OPTION NOTE	MT	RW
2	3/10/18	REVISE FLUSH GLAZING	RW	JK
1	11/15/17	RECESSED PANEL NOTATION	BY	BY
NO.	DATE			

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21133.10

SHEET 14 OF 15

Z:\2023 FBC Drawings\Therma-Tru\FL-21133 R12\FL-21133.9-11.dwg

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	27	LATCH STRIKE PLATE	STEEL
C	1/4" MAX. SHIM SPACE	-	28	DEADBOLT STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28A	DEADBOLT SUB STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	29	4" X 4" HINGE	STEEL
			30	LATCH & DEADBOLT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
F	#10 X 2" PFH WOOD SCREW	STEEL	31	MULTIPOINT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	34	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	35	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	38	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	39	INSWING THRESHOLD	ALUM/COMP
7	WEATHERSTRIP (LONG REACH)	FOAM	40	DOOR PANEL (BOOK)	-
8	SWEEP	VINYL	41	DOOR PANEL (HYBRID)	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	42	DOOR PANEL (U1)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	43	FLUSH GLAZED DOOR PANEL (BOOK)	-
15	PUBLIC ACCESS THRESHOLD	ALUM	44	FLUSH GLAZED DOOR PANEL (HYBRID)	-
16	OUTSWING THRESHOLD	ALUM/COMP	45	FLUSH GLAZED DOOR PANEL (U1)	-
17	OUTSWING THRESHOLD	ALUM/COMP	50	SIDELITE (FULL LITE)	-
18	OUTSWING THRESHOLD	ALUM/COMP	60	SIDELITE (FLUSH GLAZED)	-
22	#8 x 3/4" PFH WOOD SCREW	STEEL	75	SIDELITE SPACER (INSWING)	-
23	#10 x 3/4" PFH WOOD SCREW	STEEL	76	SIDELITE SPACER (OUTSWING)	-
24	#10 x 1" PFH WOOD SCREW	STEEL	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	-
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL			

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

- CONCRETE ANCHOR NOTES:
- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
 - Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
 - Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

- WOOD SCREW INSTALLATION NOTES:
- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS

LFS

FBC

(2026)

UPDATE TO 9TH ED.

6

LFS

FBC

(2023)

UPDATE TO 8TH ED.

5

PO

FBC

(2020)

UPDATE TO 7th ED

4

MT

NOTE

REV. DOOR PANEL OPTION

3

10/10/18

RW

GLAZING

REVISE FLUSH

2

3/10/18

JK

NOTATION

RECESSED PANEL

1

11/15/17

BY

NO.

DATE

REVISIONS

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21133.10

SHEET 15 OF 15

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813