


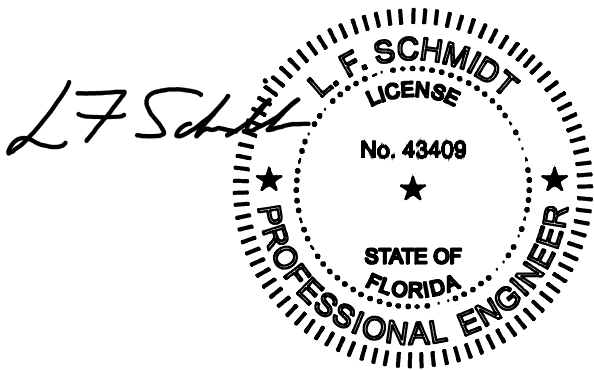

Digitally signed by Lyndon F Schmidt
Date: 2023.08.21 10:02:31 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.


THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

WOOD EDGE
OPAQUE FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"NON-IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
4. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
5. Benchmark Door panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details
3	Elevations
4	Horizontal & Vertical Cross Sections (2X Buck)
5	Horizontal & Vertical Cross Sections (1X Buck)
6	Horizontal & Vertical Cross Sections (Direct to Masonry)
7	Vertical Cross Sections (Thresholds)
8	Buck & Frame Anchoring
9	Hardware Details
10	Components
11	Bill of Materials

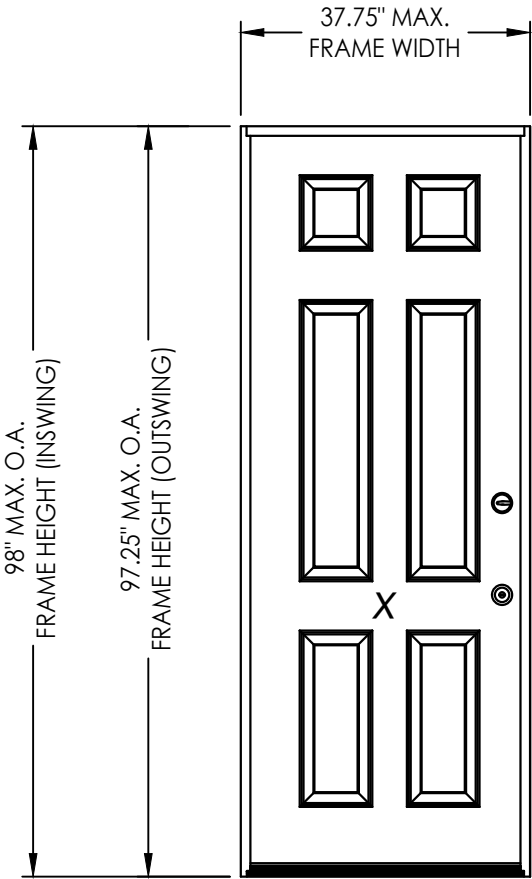

CONFIGURATION	LOCK HARDWARE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	Latch & Deadbolt	+67.0	-67.0	+67.0	-67.0

See Sheet 3 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

37/16/20
7/16/20
2
10/08/18
REV. DOOR PANEL OPTION NOTE

PO
MT
JK
BY

DATE

REVISIONS

DATE: 07/07/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-21135.3

SHEET 1 OF 11


BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg

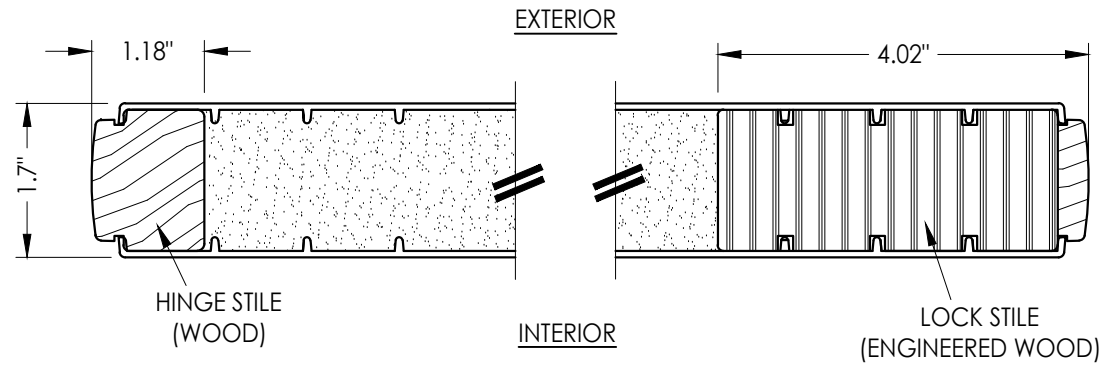


1
2 **HORIZONTAL CROSS SECTION**

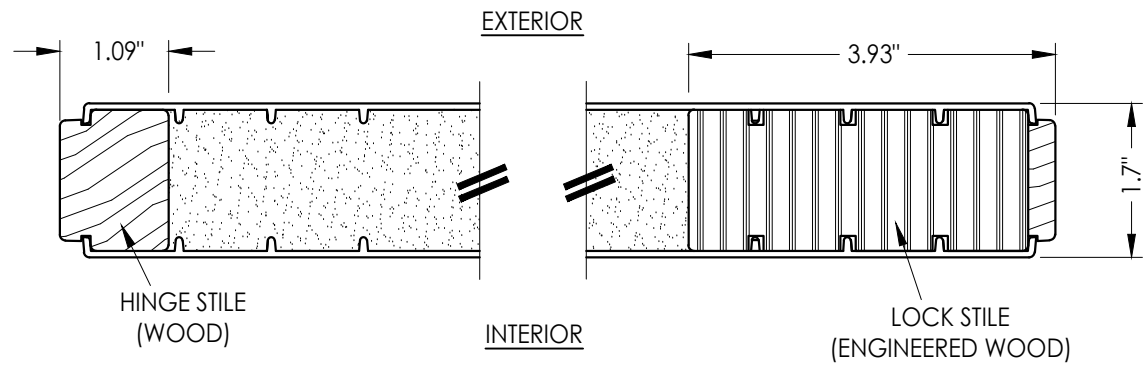


2
2 **HORIZONTAL CROSS SECTION**

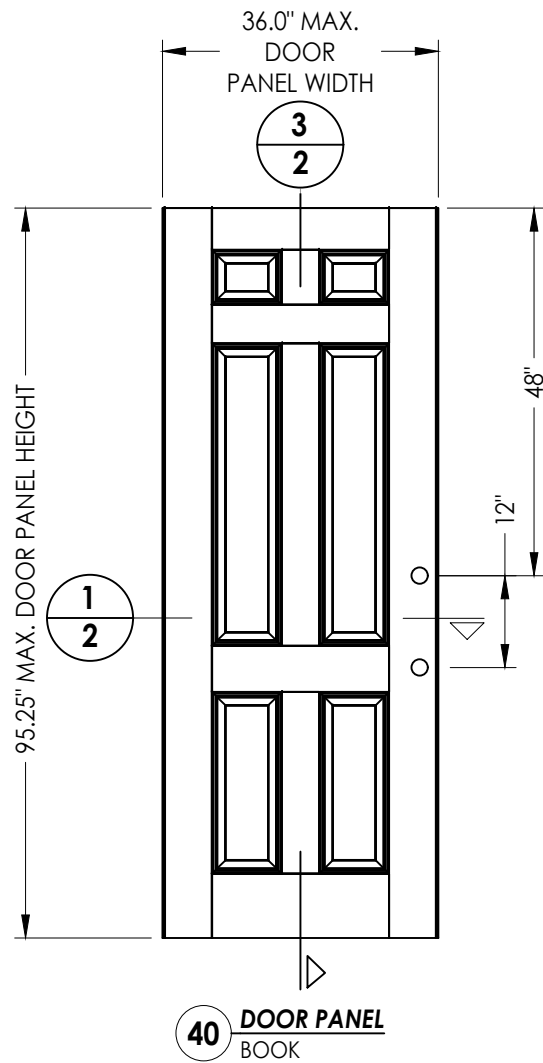


40 **DOOR PANEL**
BOOK

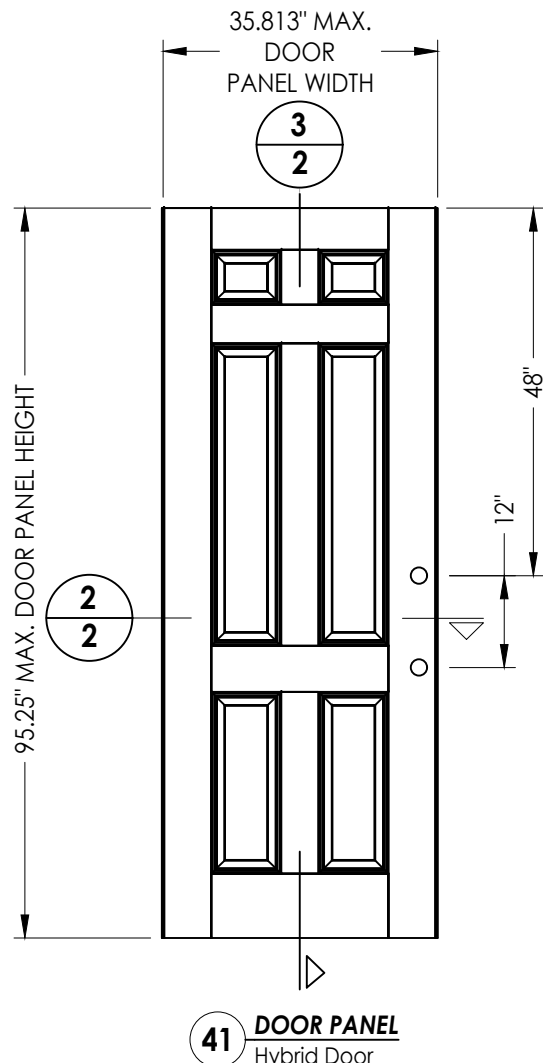

41 **DOOR PANEL**
Hybrid Door

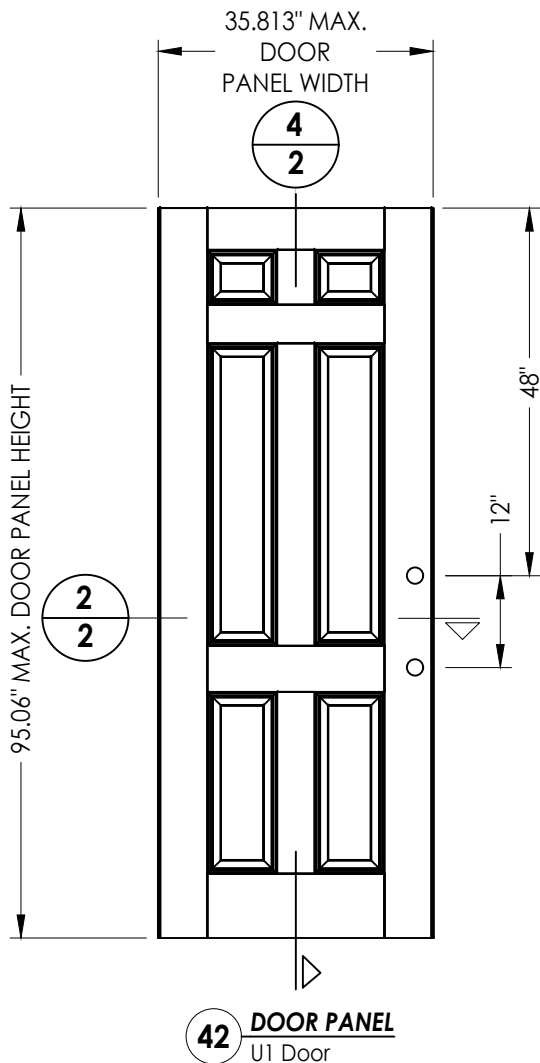

42 **DOOR PANEL**
U1 Door

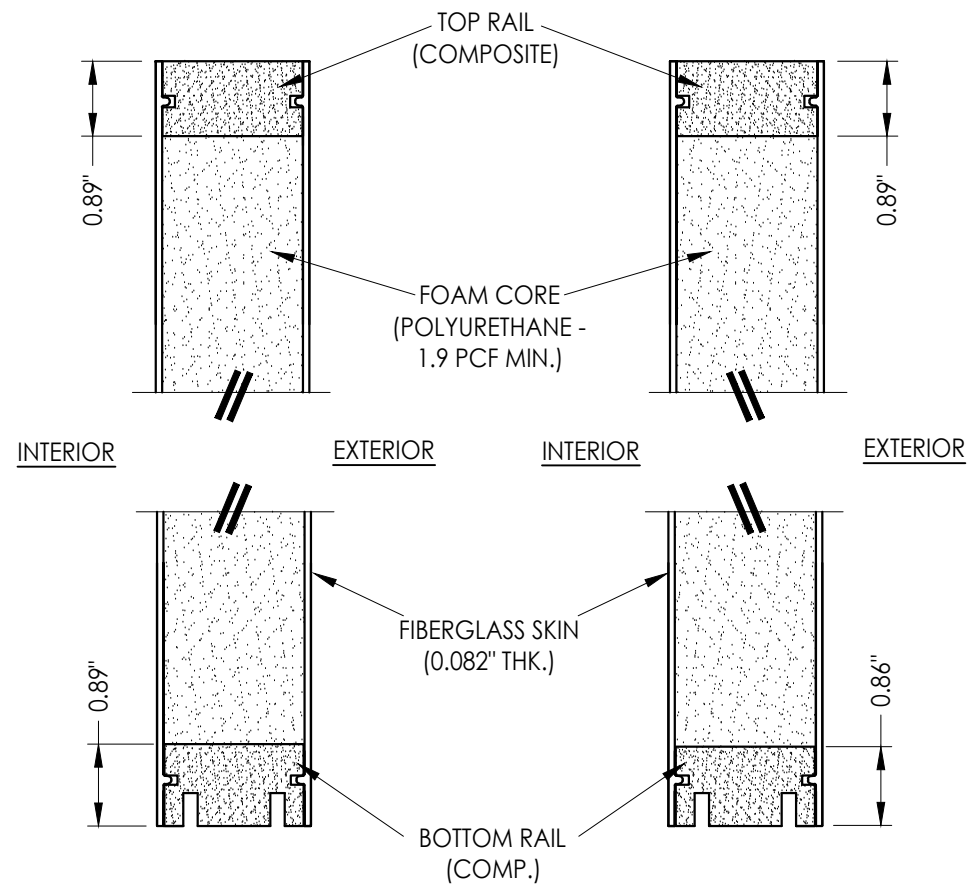

3
2 **VERTICAL CROSS SECTION**

4
2 **VERTICAL CROSS SECTION**

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
3	7/16/20	UPDATE TO 7th ED (2020) FBC
2	10/08/18	REV. DOOR PANEL OPTION NOTE
1	12/03/17	RECESSED PANEL NOTATION

DATE: 07/07/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21135.3
SHEET 2 OF 11

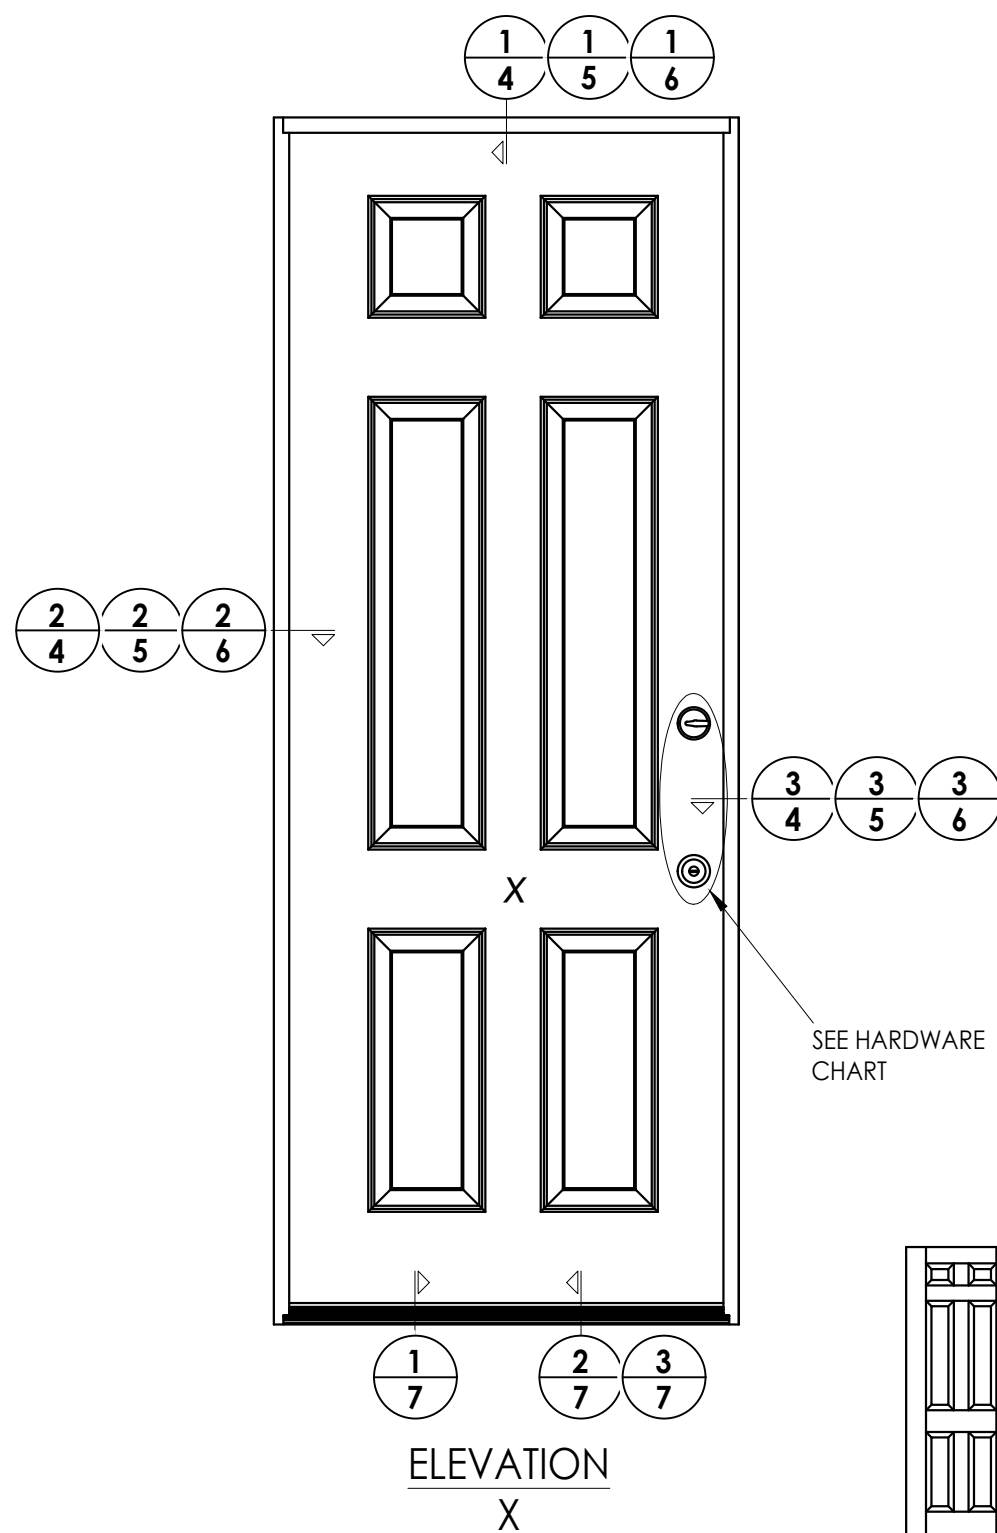

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB:	F51
	DEADBOLT:	B60
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)

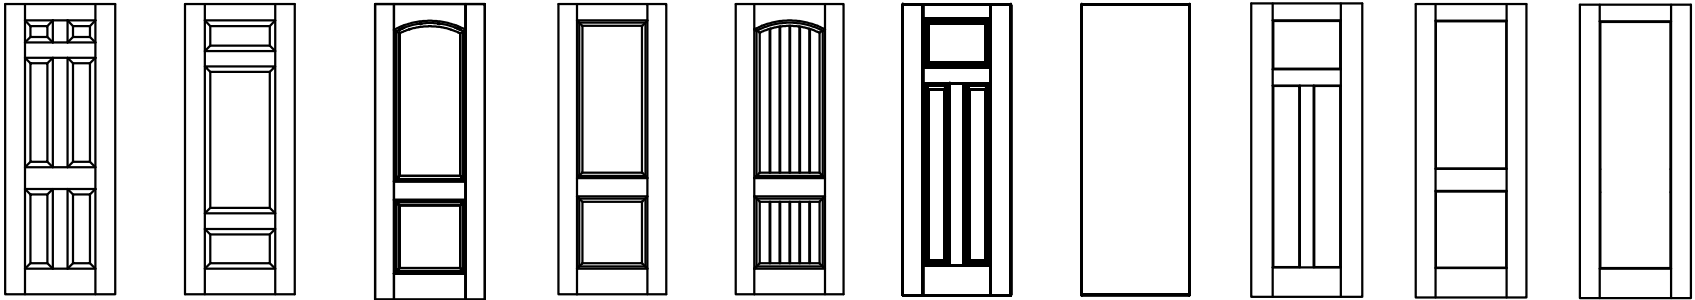

Benchmark Door Panel Options


Products approved include all embossed and recessed panel doors.
Similar opaque panel configurations are allowed.
Panels shown are for illustration and are representative only.

[illegible]


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg

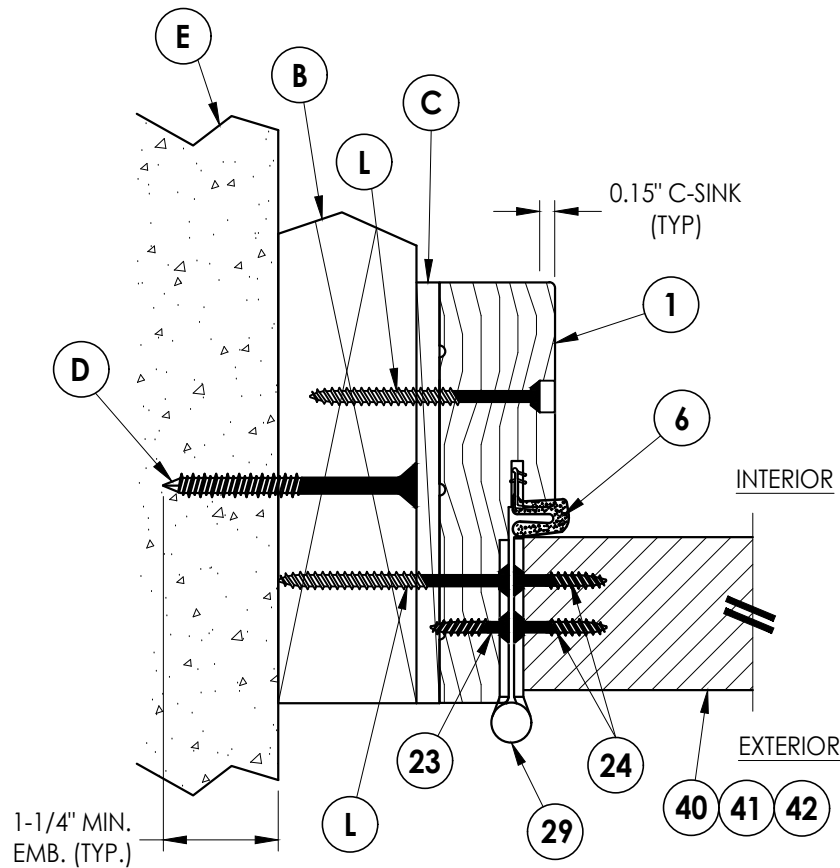

2 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

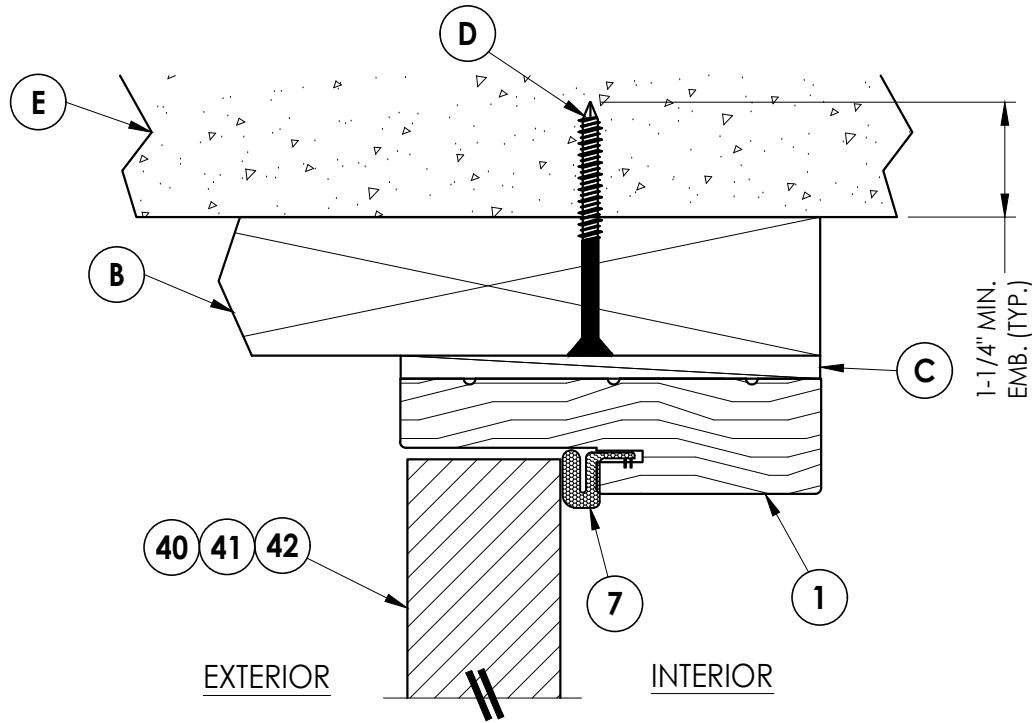

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

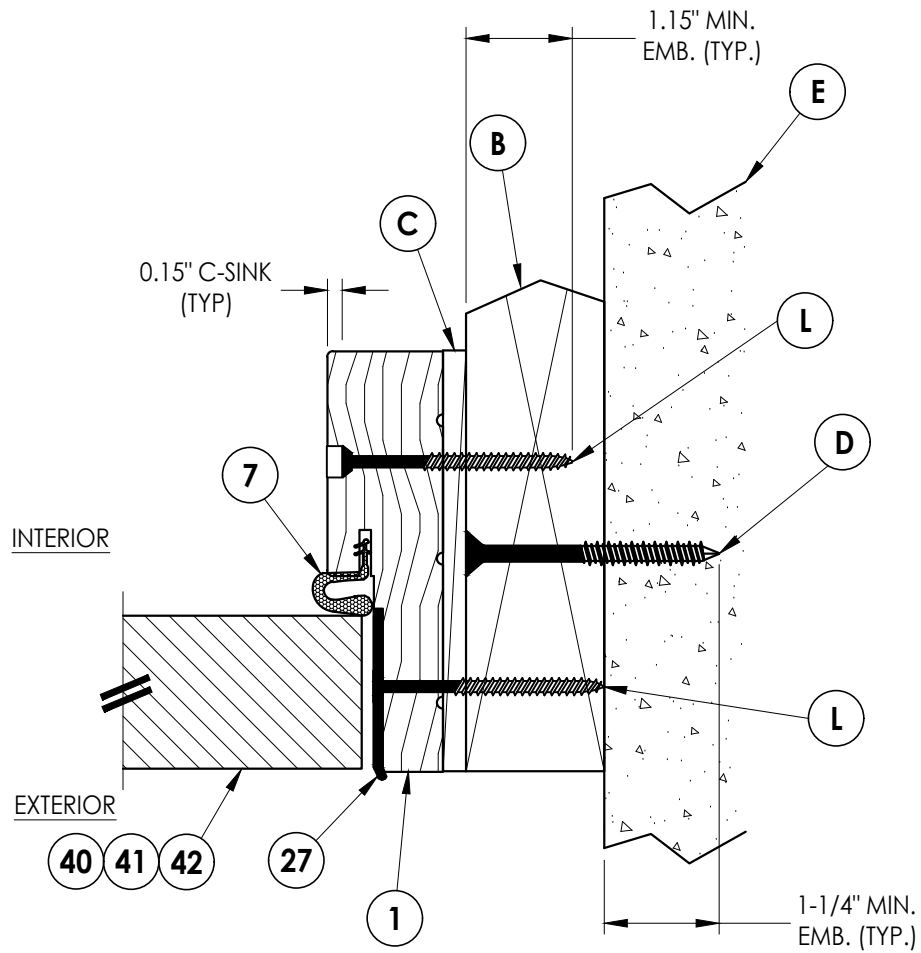


3 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	
NO.	DATE	REVISIONS	BY
3	7/16/20	UPDATE TO 7th ED (2020) FBC	PO
2	10/08/18	REV. DOOR PANEL OPTION NOTE	MT
1	12/03/17	RECESSED PANEL NOTATION	JK
DATE: 07/07/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21135.3			
SHEET 4 OF 11			


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg

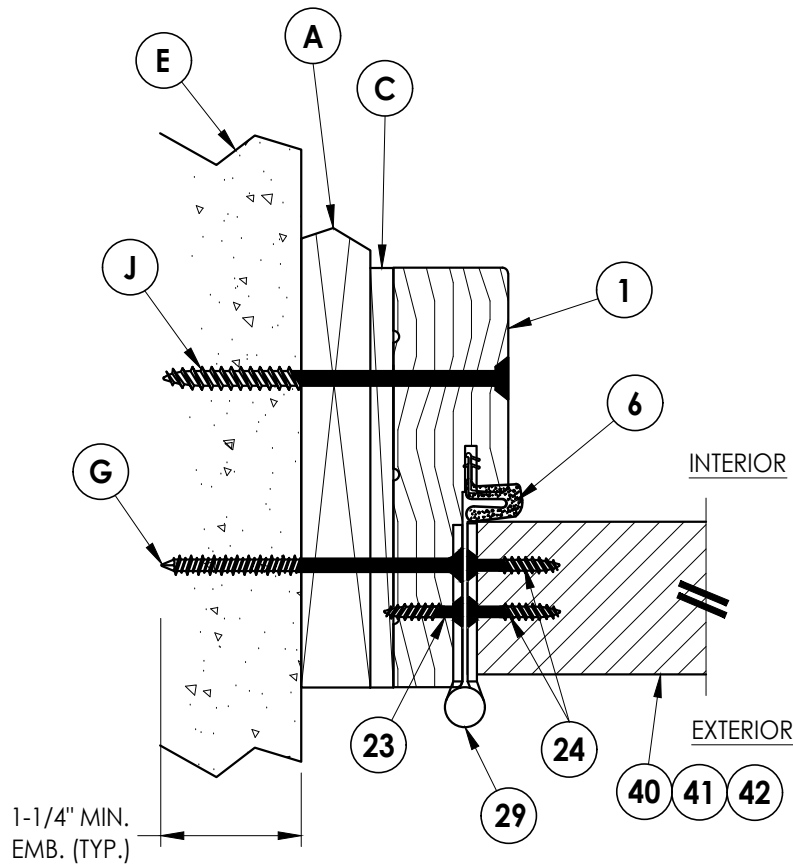

2
5 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

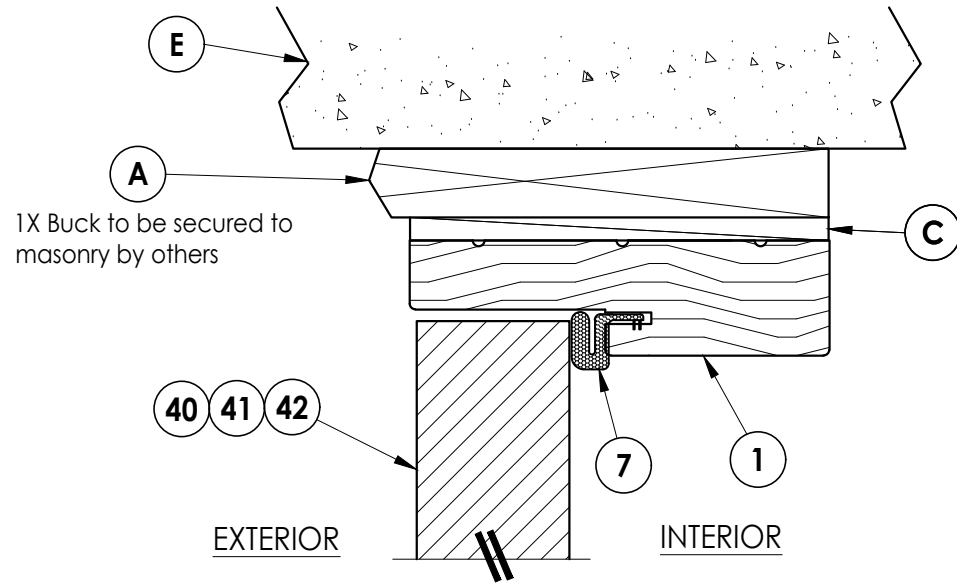

1
5 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

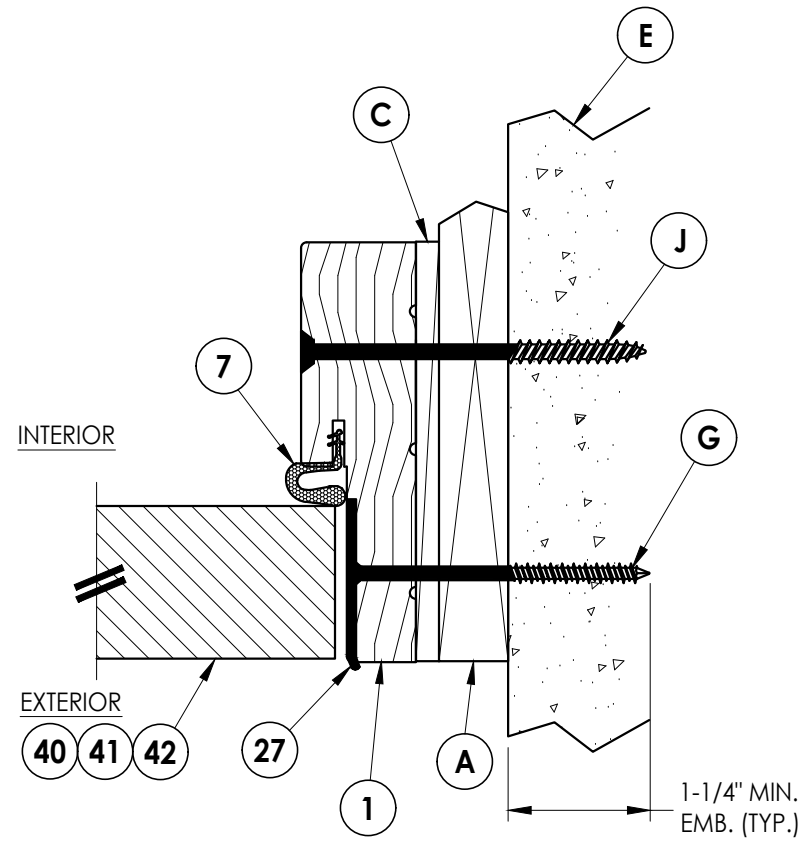

3
5 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS
3	7/16/20	UPDATE TO 7th ED (2020) FBC
2	10/08/18	REV. DOOR PANEL OPTION NOTE
1	12/03/17	RECESSED PANEL NOTATION
NO.	DATE	BY

DATE: 07/07/17

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-21135.3

SHEET 5 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg

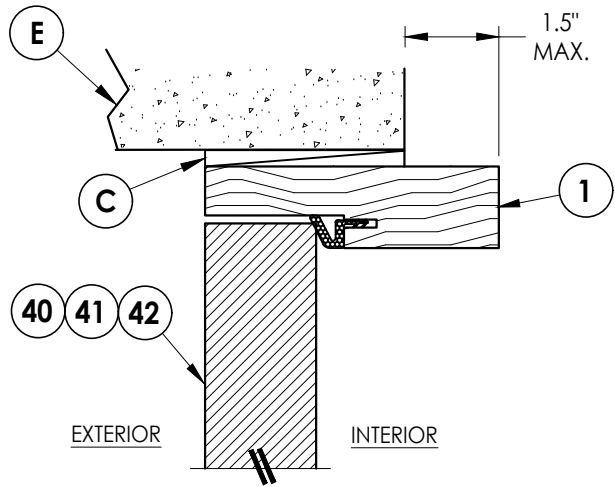


1
6 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

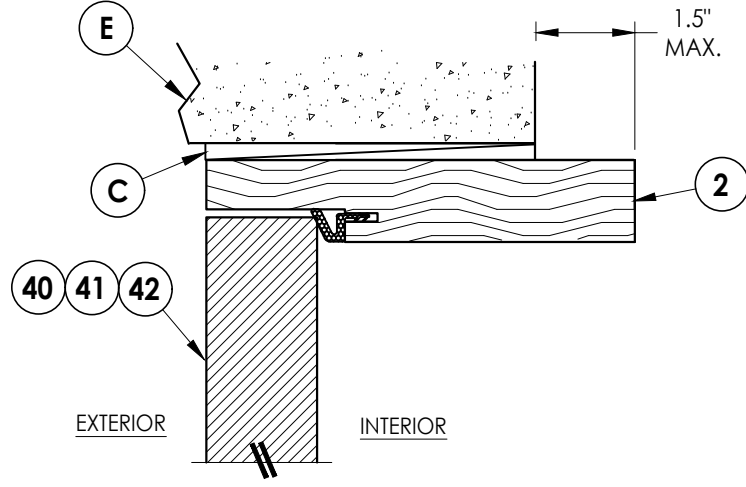


4
6 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 47 PSF
w/ SECURITY STRIKE = ± 55 PSF

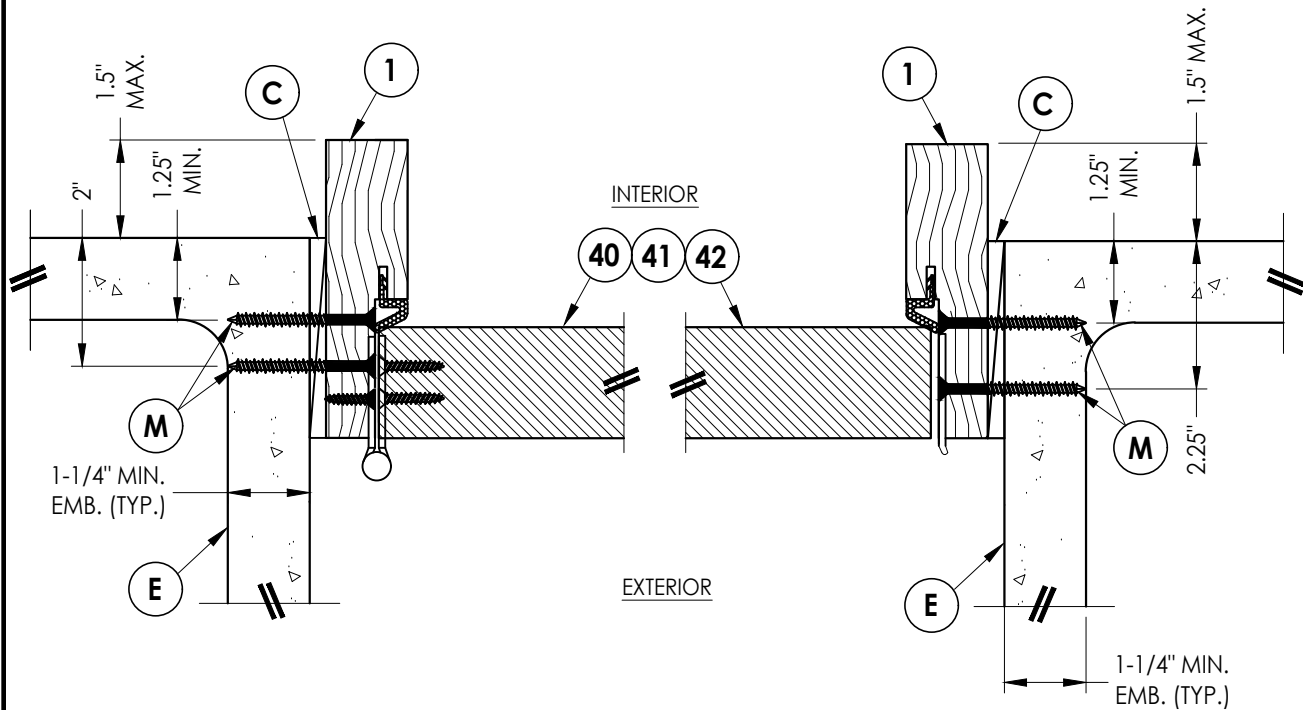

2
6 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

3
6 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

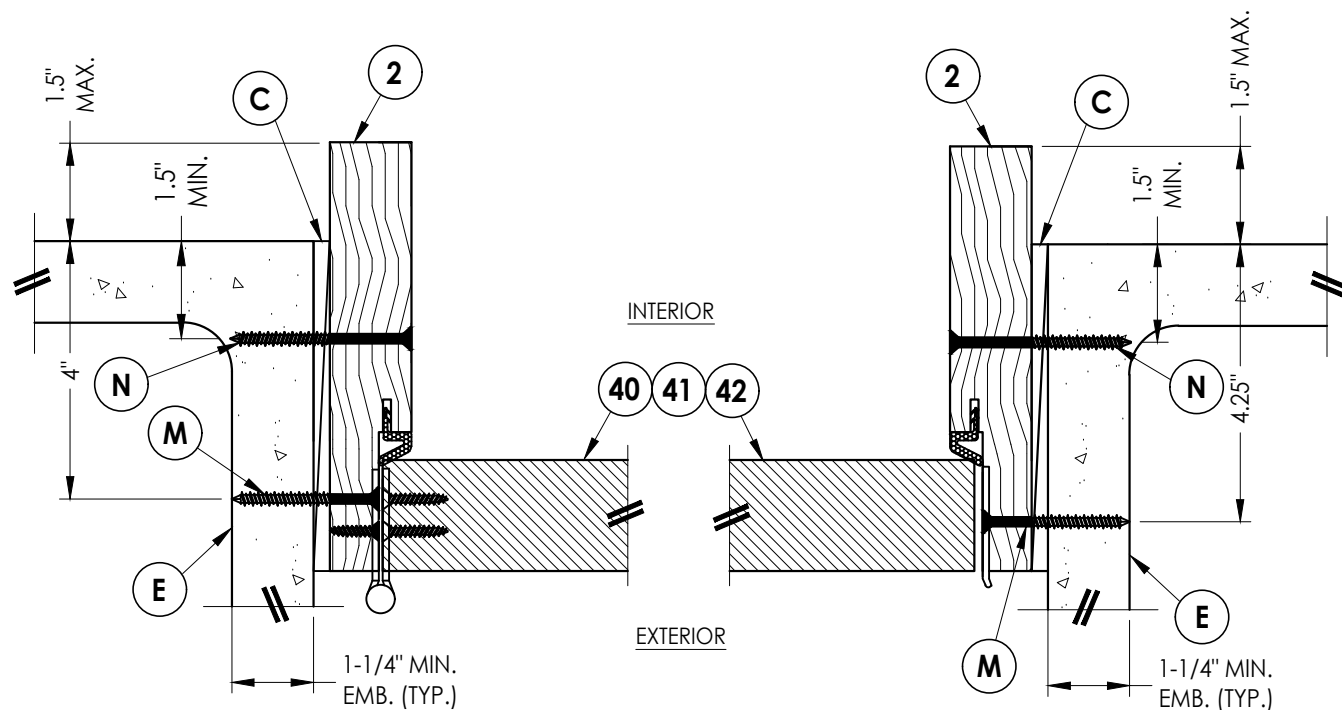

5
6 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

6
6 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: THERMA-TRU
FIBERGLASS DOOR
PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
3	7/16/20	UPDATE TO 7th ED (2020) FBC
2	10/08/18	REV. DOOR PANEL OPTION NOTE
1	12/03/17	RECESSED PANEL NOTATION


DATE: 07/07/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21135.3
SHEET 6 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg


- Notes:
- Sill Item #'s 32, 38, 39, 50, 51, 52, 53, 54 & 55 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws or (3) 2.5" staples at each end.
 - Sill Item #'s 16, 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
 - Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS screws at each end.

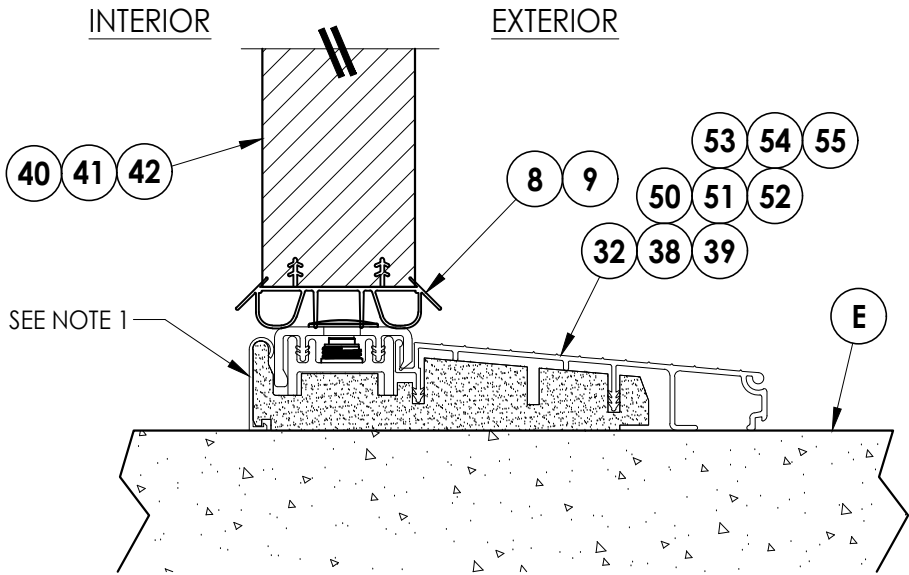

1
7 **VERTICAL CROSS SECTION**
Inswing Sill

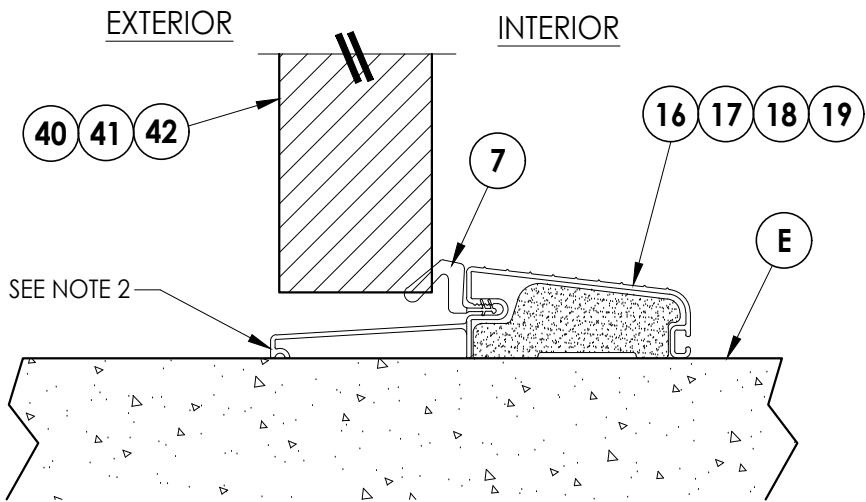

2
7 **VERTICAL CROSS SECTION**
Outswing Sill

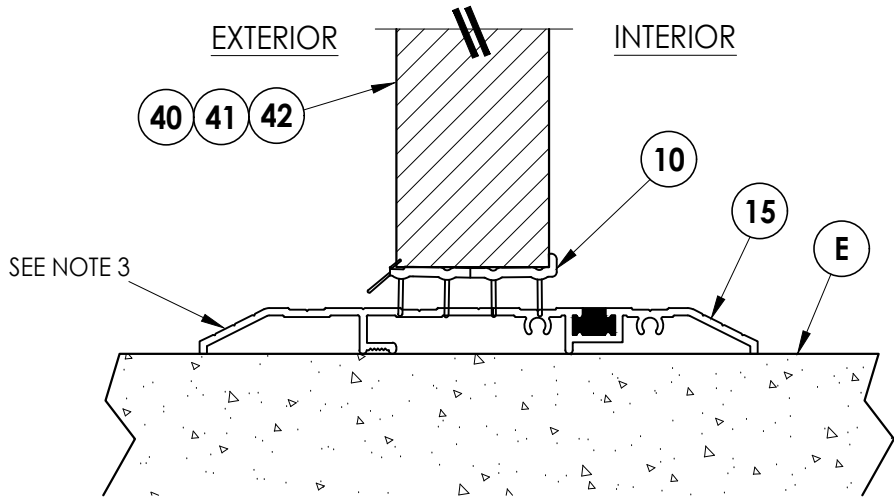

3
7 **VERTICAL CROSS SECTION**
Public Access Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS
3	7/16/20	UPDATE TO 7th ED (2020) FBC
2	10/08/18	REV. DOOR PANEL OPTION NOTE
1	12/03/17	RECESSED PANEL NOTATION
PO		
MT		
JK		
BY		

DATE: 07/07/17





SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-21135.3

SHEET 7 OF 11

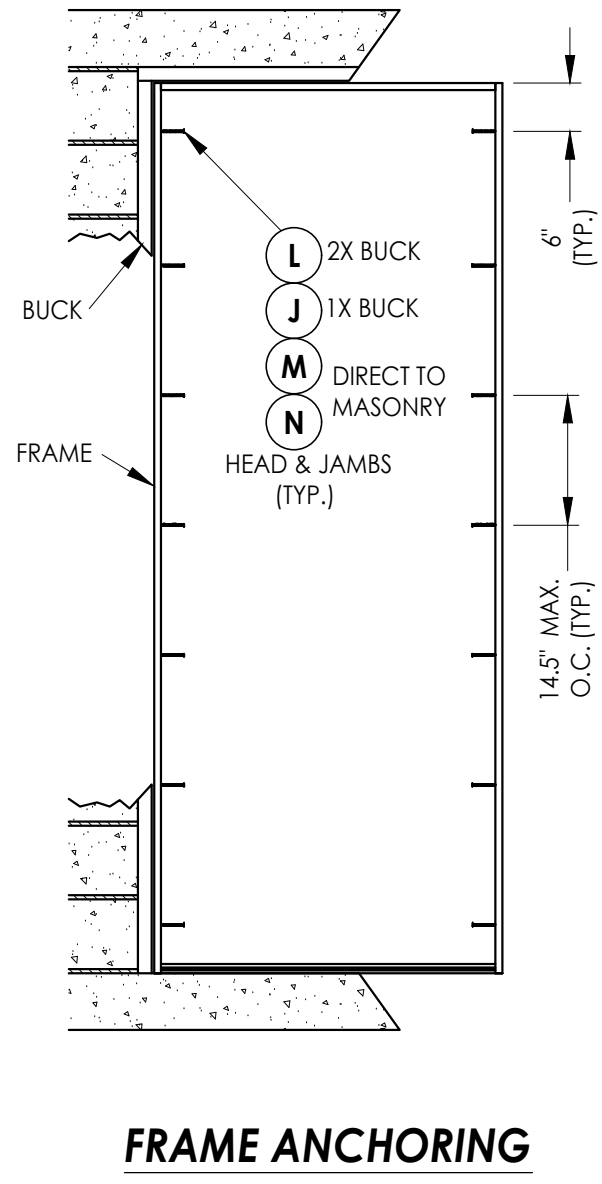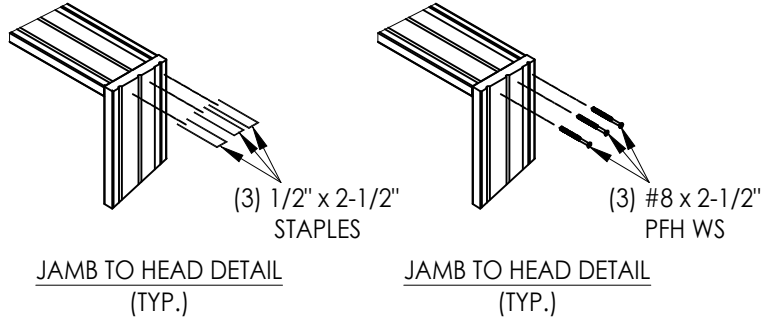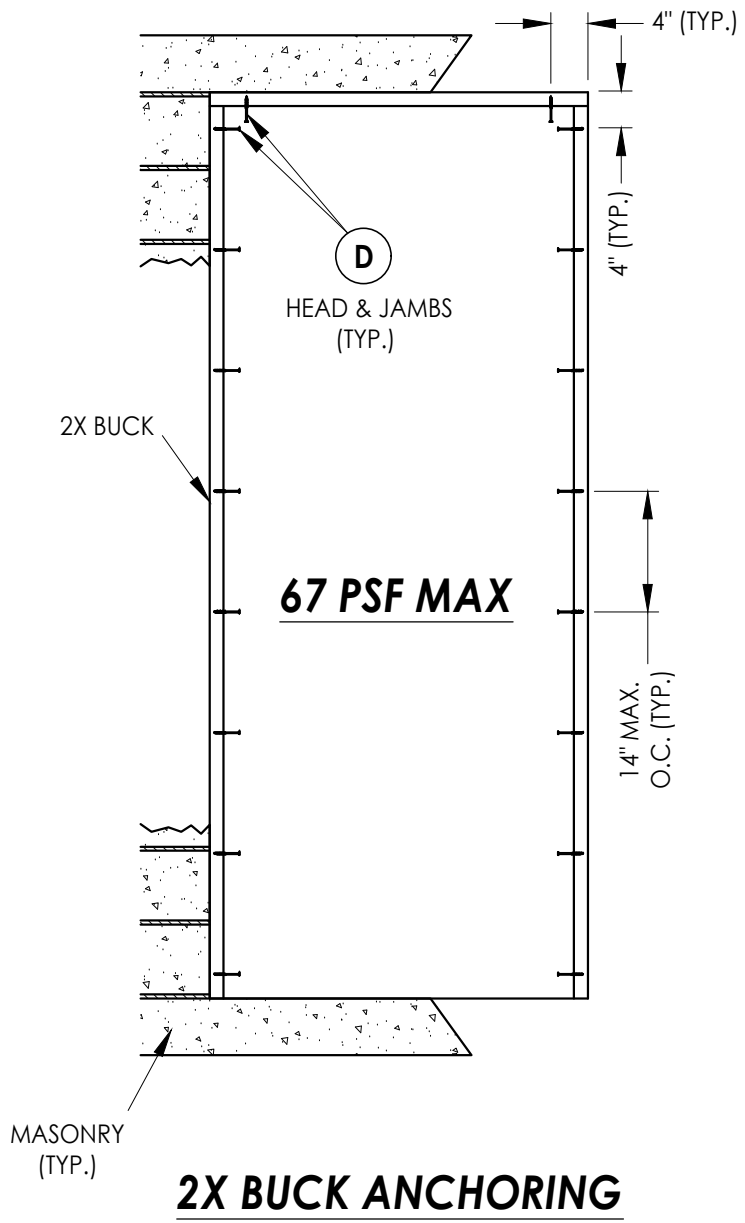
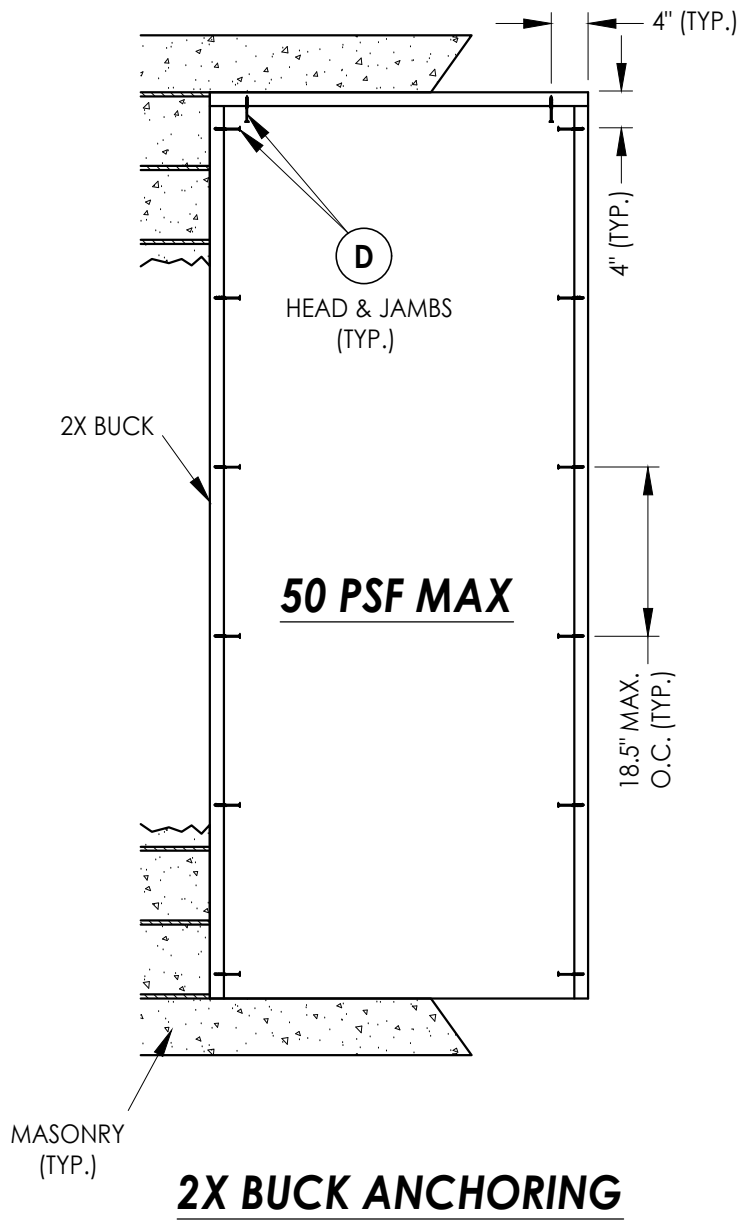


3	7/16/20	UPDATE TO 7th ED (2020)	FBC						PO
2	10/08/18	REV. DOOR PANEL OPTION	NOTE						MT
1	12/03/17	RECESSED PANEL NOTATION							JK
NO.	DATE								BY
									REVISIONS
DATE: 07/07/17									
SCALE: N.T.S.									
DWG. BY: JK									
CHK. BY: LFS									
DRAWING NO.: FL-21135.3									
SHEET 8 OF 11									





PRODUCT:	THERMA-TRU FIBERGLASS DOOR
PART OR ASSEMBLY:	BUCK AND FRAME ANCHORING

RW

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg

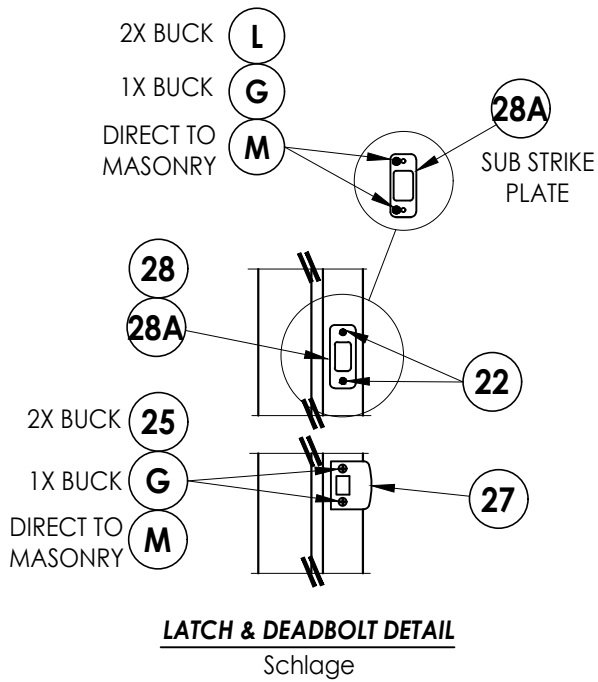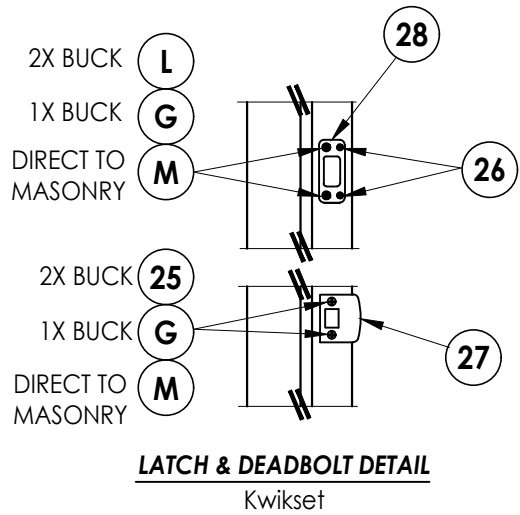

LATCH & DEADBOLT STRIKE DETAILS

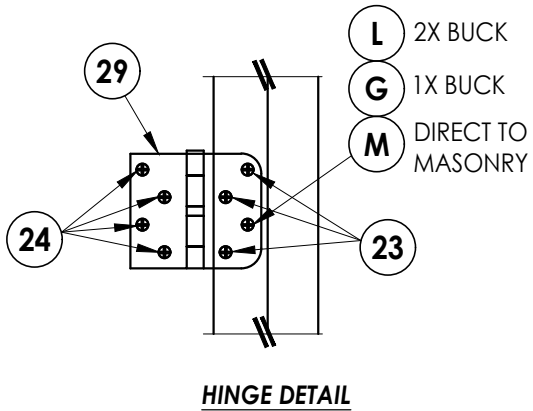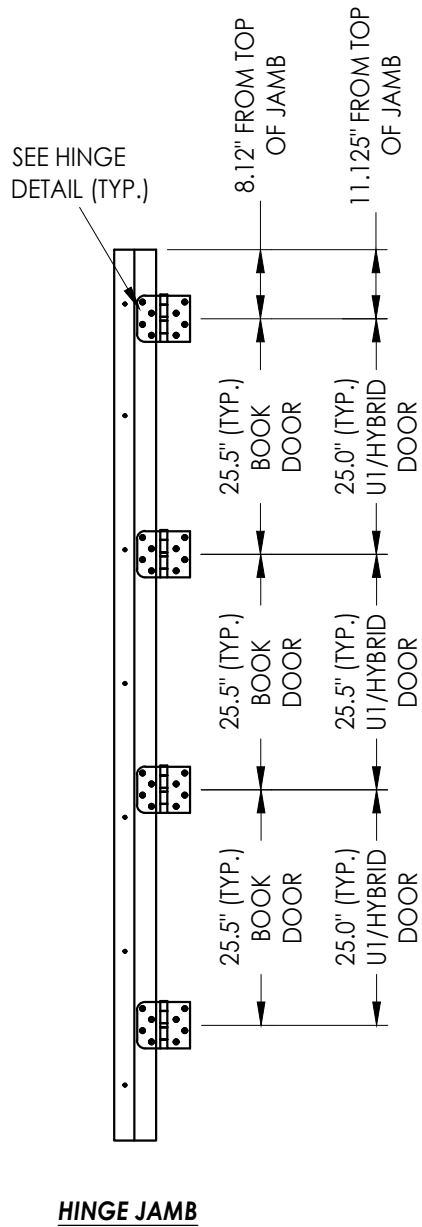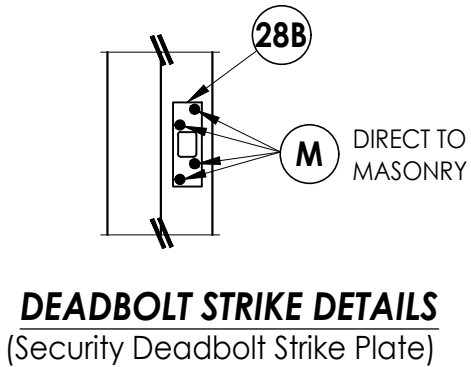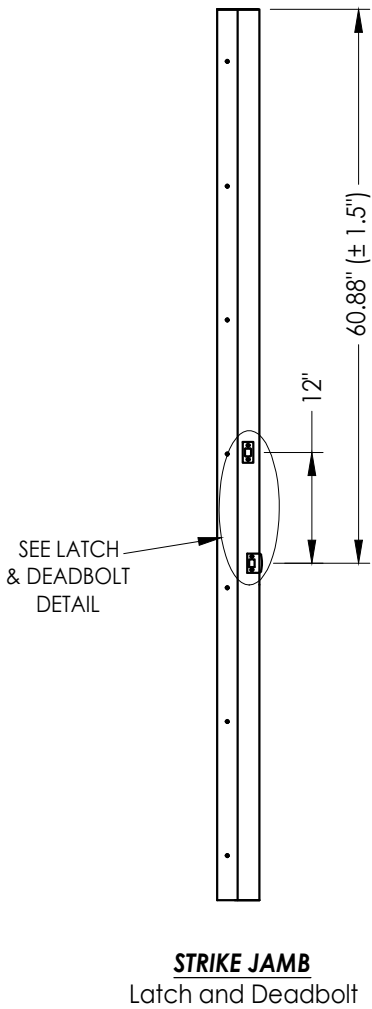


PRODUCT:			
THERMA-TRU FIBERGLASS DOOR			
PART OR ASSEMBLY:			
HARDWARE DETAILS			
REVISIONS			
NO.	DATE	BY	JK
3	7/16/20	PO	FBC
2	10/08/18	MT	NOTE
1	12/03/17	JK	NOTATION

DATE:	07/07/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21135.3
SHEET	9 OF 11


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R6\FL-21135.1-4.dwg

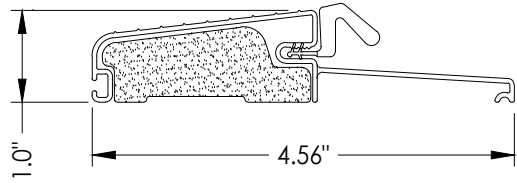


16 OUTSWING THRESHOLD
Composite Sill

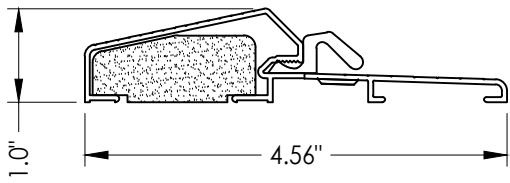


17 OUTSWING THRESHOLD
Composite / Aluminum Sill




8 SWEEP




9 SWEEP

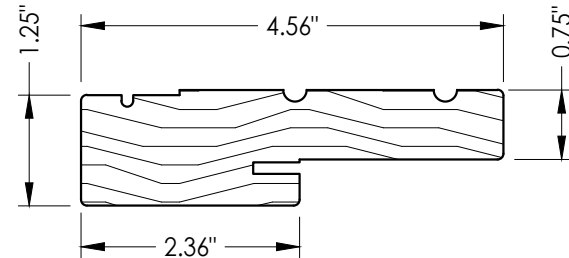


1 WOOD JAMB

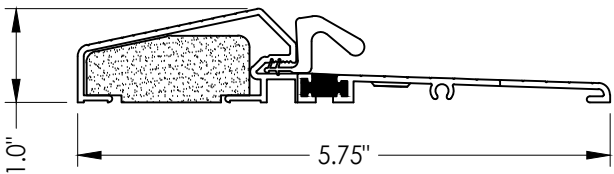


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

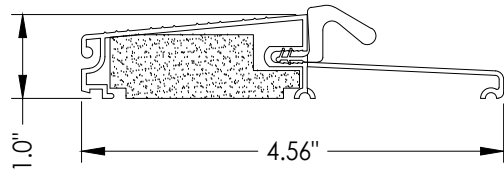


19 OUTSWING THRESHOLD
Composite Sill




10 SWEEP

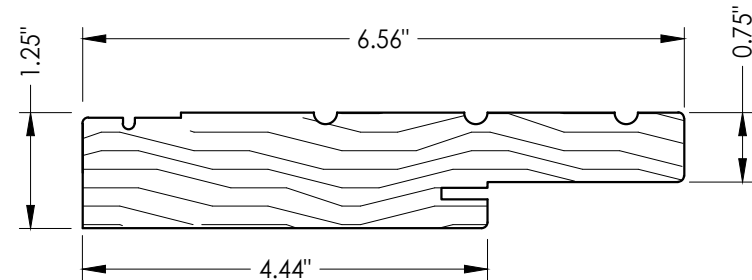


2 WOOD JAMB

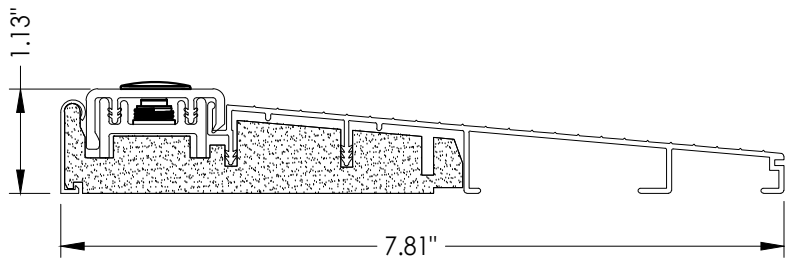


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

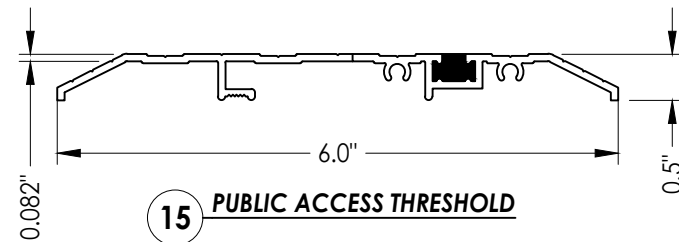


15 PUBLIC ACCESS THRESHOLD

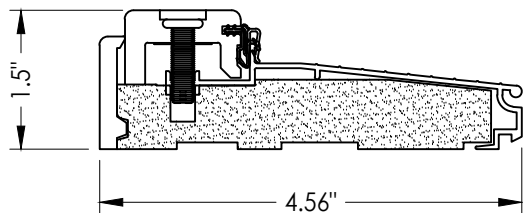


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

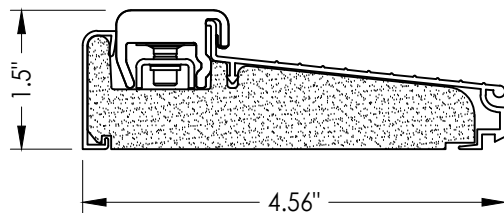


50 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

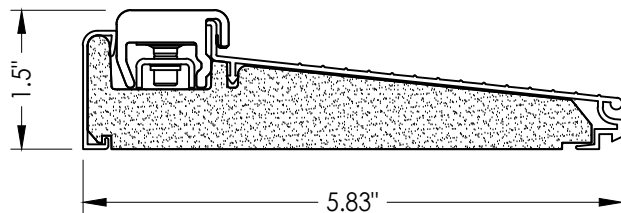


51 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

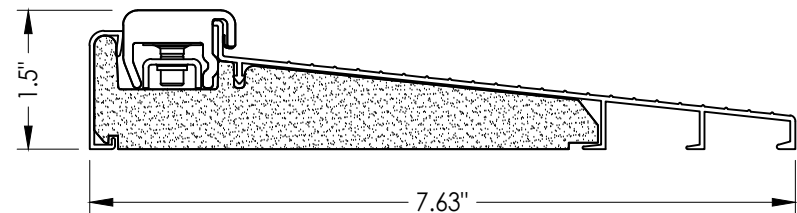


52 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

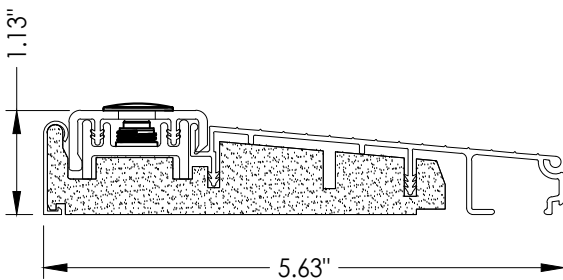


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

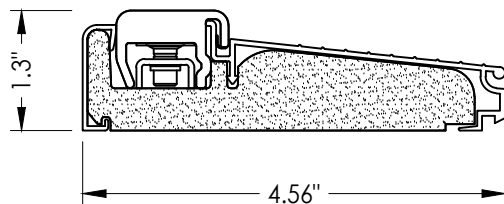

53 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

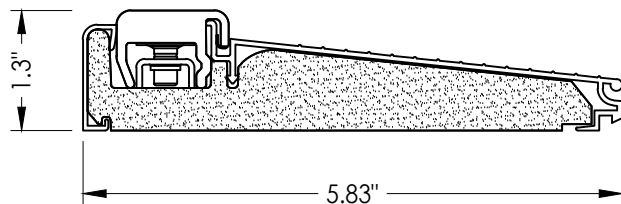

54 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

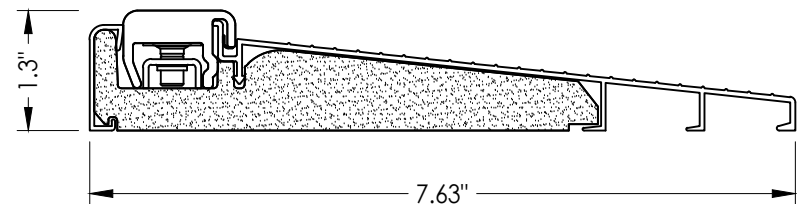

55 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
3	7/16/20	UPDATE TO 7th ED (2020) FBC
2	10/08/18	REV. DOOR PANEL OPTION NOTE
1	12/03/17	RECESSED PANEL NOTATION

DATE:	07/07/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21135.3
SHEET	10 OF 11

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE (STANDARD)	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	29	4" X 4" HINGE	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	32	IN swing THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	38	IN swing THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	39	IN swing THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	40	DOOR PANEL (BOOK)	-
1	JAMB (FINGER JOINT PINE)	WOOD	41	DOOR PANEL (HYBRID)	-
2	JAMB (FINGER JOINT PINE)	WOOD	42	DOOR PANEL (U1)	-
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	50	IN swing THRESHOLD	ALUM/COMP
7	WEATHERSTRIP (LONG REACH)	FOAM	51	IN swing THRESHOLD	ALUM/COMP
8	SWEEP	VINYL	52	IN swing THRESHOLD	ALUM/COMP
9	SWEEP	VINYL	53	IN swing THRESHOLD	ALUM/COMP
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	54	IN swing THRESHOLD	ALUM/COMP
15	PUBLIC ACCESS THRESHOLD	ALUM	55	IN swing THRESHOLD	ALUM/COMP
16	OUT swing THRESHOLD	ALUM/COMP			
17	OUT swing THRESHOLD	ALUM/COMP			
18	OUT swing THRESHOLD	ALUM/COMP			
19	OUT swing THRESHOLD	ALUM/COMP			
22	#8 x 3/4" PFH WOOD SCREW	STEEL			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]