


COMPOSITE EDGE
OPAQUE FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"NON-IMPACT"

GENERAL NOTES


1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
4. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
5. Benchmark Door panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details
3	Elevations
4	Horizontal & Vertical Cross Sections (2X Buck)
5	Horizontal & Vertical Cross Sections (1X Buck)
6	Horizontal & Vertical Cross Sections (Direct to Masonry)
7	Vertical Cross Sections (Thresholds)
8	Buck & Frame Anchoring
9	Hardware Details
10	Components
11	Bill of Materials

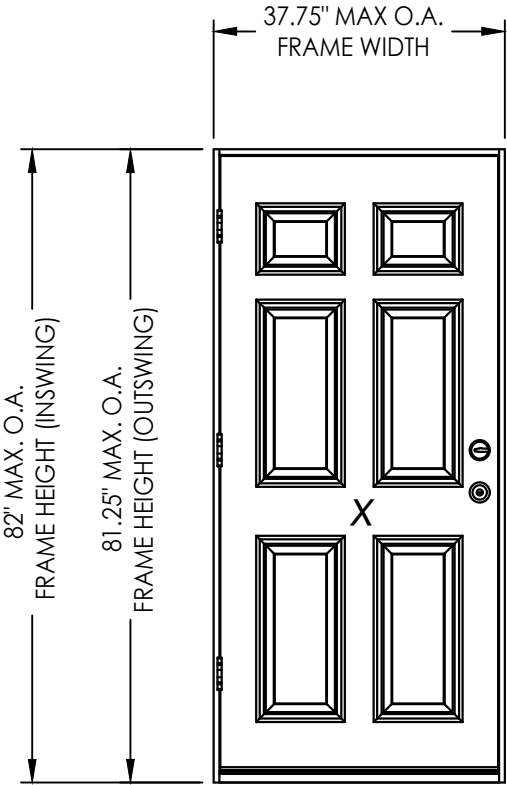

CONFIGURATION	LOCK HARDWARE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	Latch & Deadbolt	+67.0	-67.0	+67.0	-67.0

See Sheet 3 for Hardware Specifications

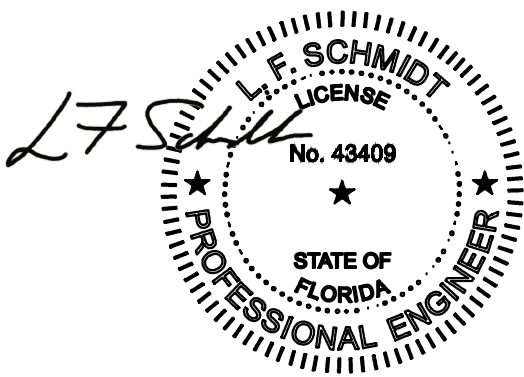

Digitally signed by
Lyndon F Schmidt
Date: 2026.08.06 16:12:51
-04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:

THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

REVISIONS


NO.	DATE	DESCRIPTION
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC
1	7/16/20	UPDATE TO 7th ED (2020) FBC

DATE: 03/07/20
SCALE: N.T.S.
DWG. BY: TJ
CHK. BY: LFS
DRAWING NO.: FL-21135.10
SHEET 1 OF 11


© 2020 R.W. BUILDING CONSULTANTS INC.

Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

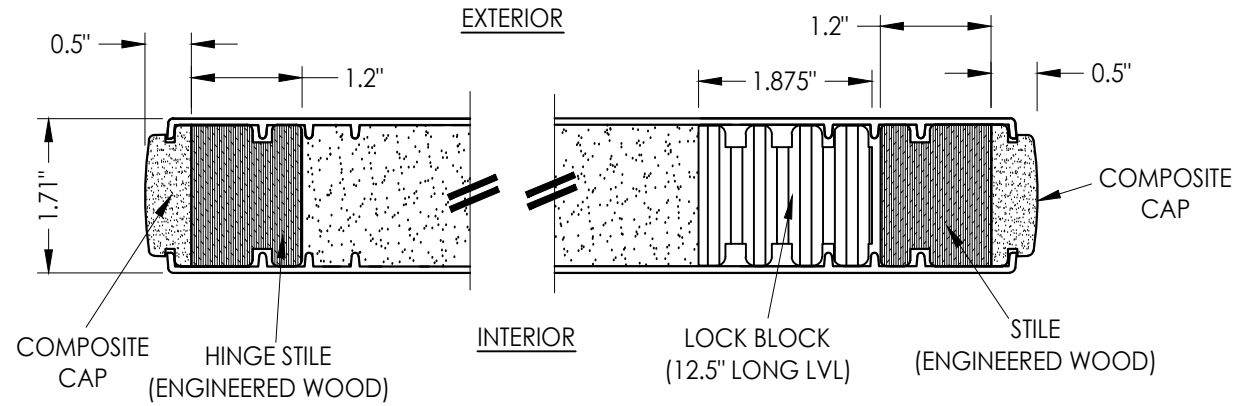


1
2 HORIZONTAL CROSS SECTION

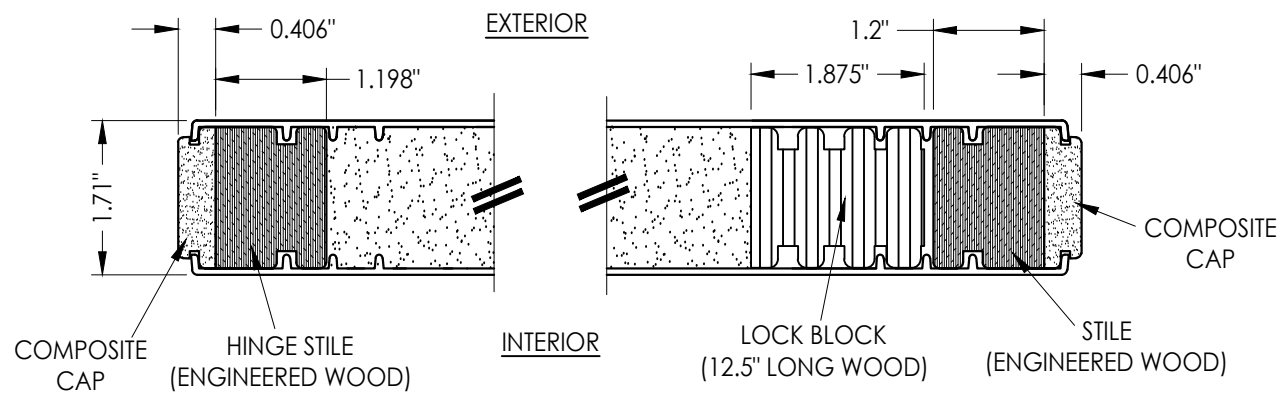


2
2 HORIZONTAL CROSS SECTION

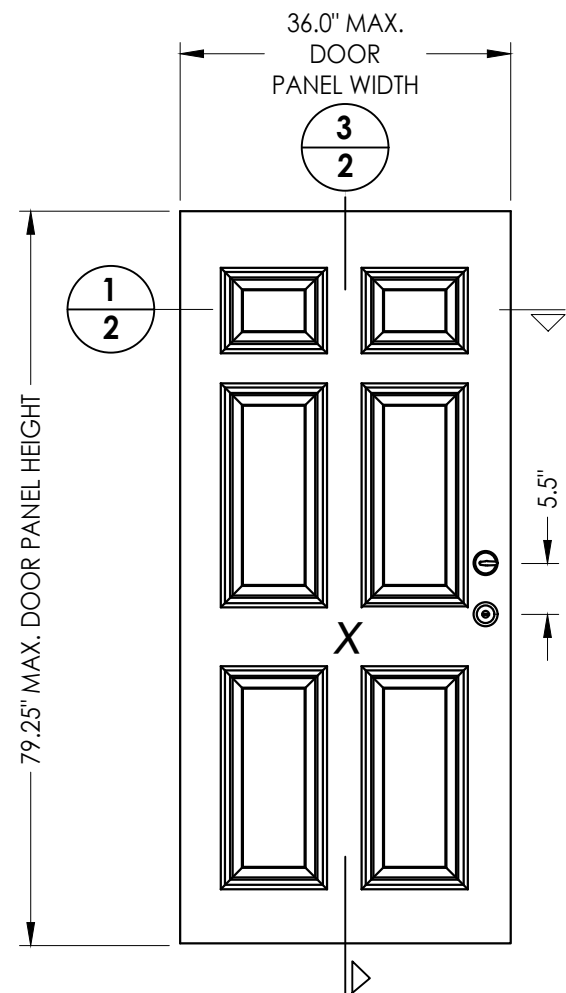


40 DOOR PANEL BOOK

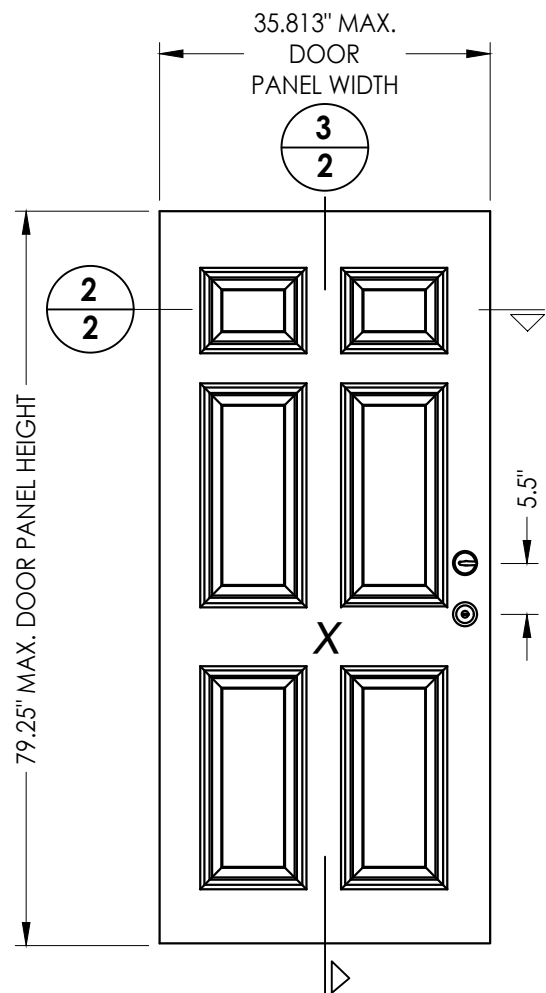

41 DOOR PANEL Hybrid Door

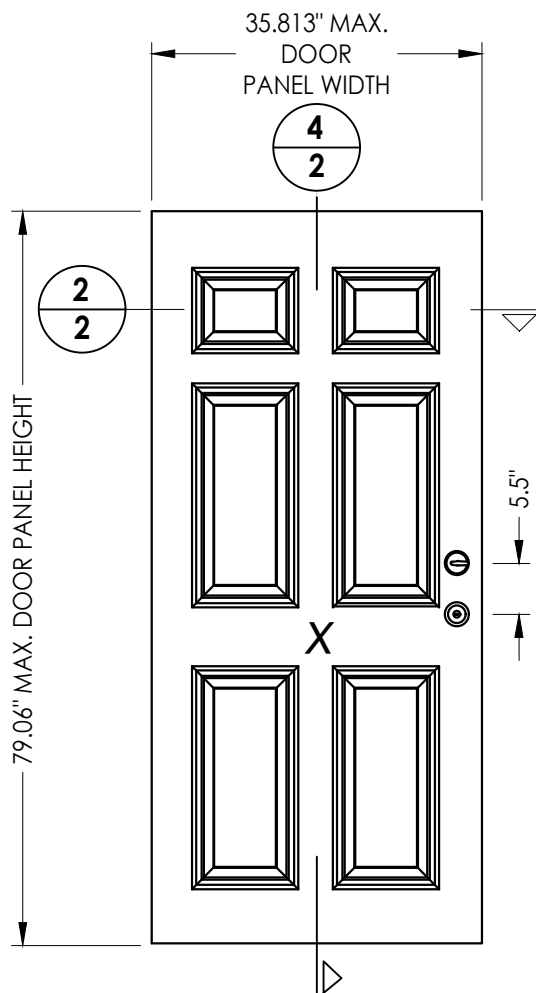

42 DOOR PANEL U1 Door

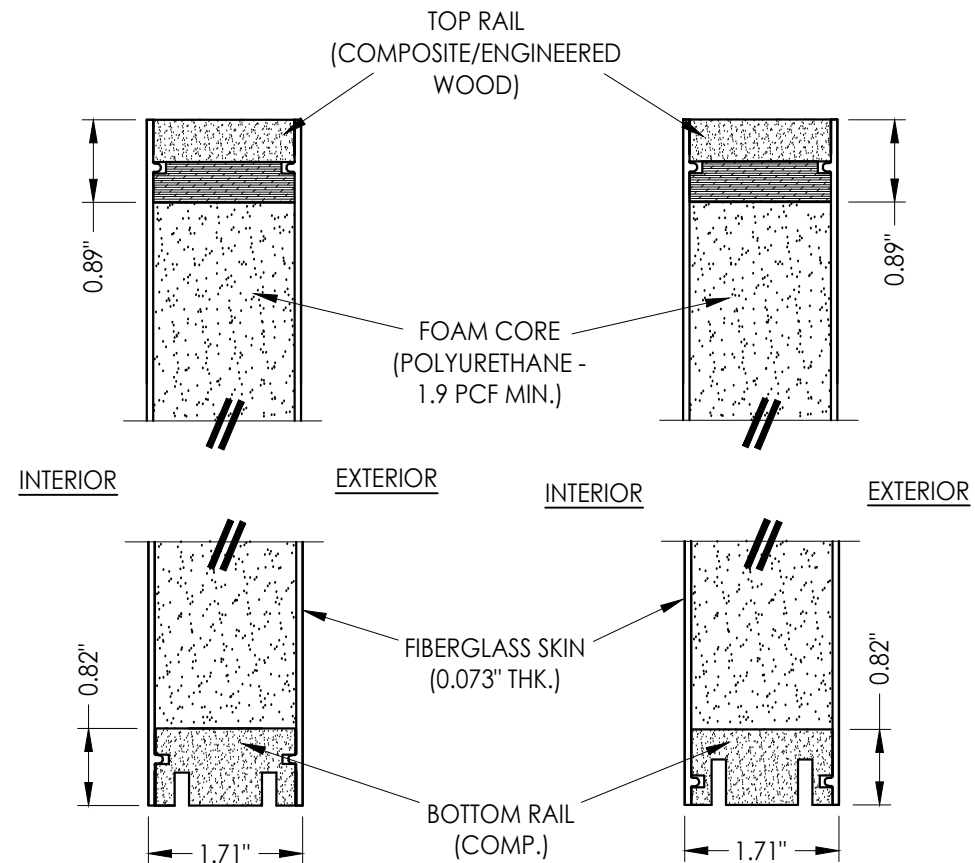

3
2 VERTICAL CROSS SECTION

4
2 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020) FBC PO
		BY

DATE: 03/07/20


SCALE: N.T.S.

DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.: FL-21135.10

SHEET 2 OF 11

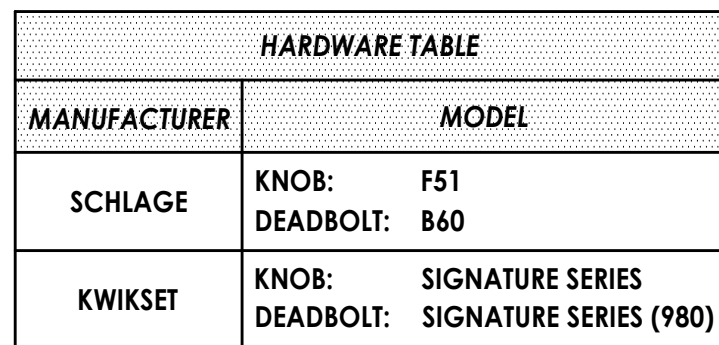

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB:	F51
	DEADBOLT:	B60
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)



Products approved include all embossed and recessed panel doors.
Similar opaque panel configurations are allowed.
Panels shown are for illustration and are representative only.

[illegible]

DATE: 03/07/20

SCALE: *N.T.S.*

DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.:

FL-21135.10

SHEET 3 OF 11


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PARSONS BUILDING CONSULTANTS, INC.


P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2020 R.W. BUILDING CONSULTANTS INC.


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

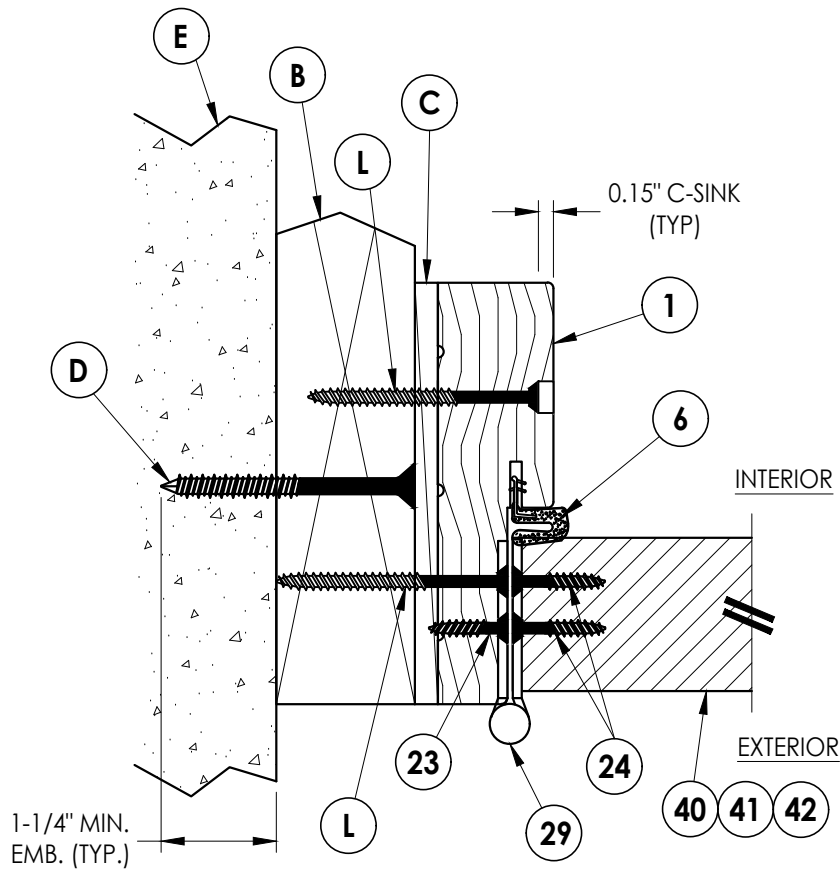

2 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

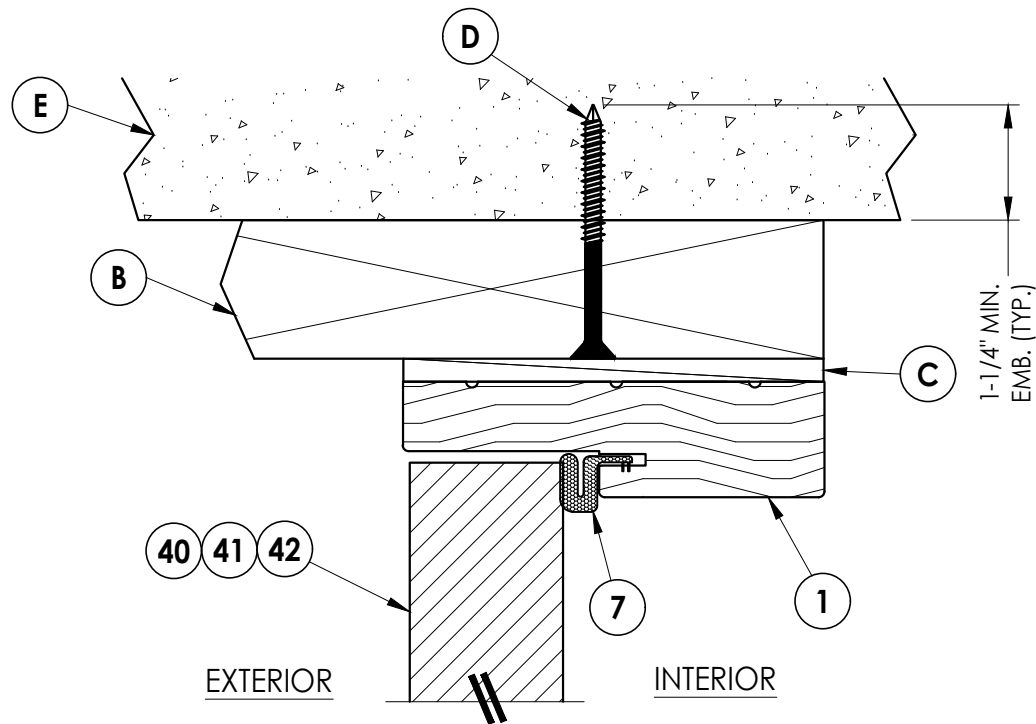

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

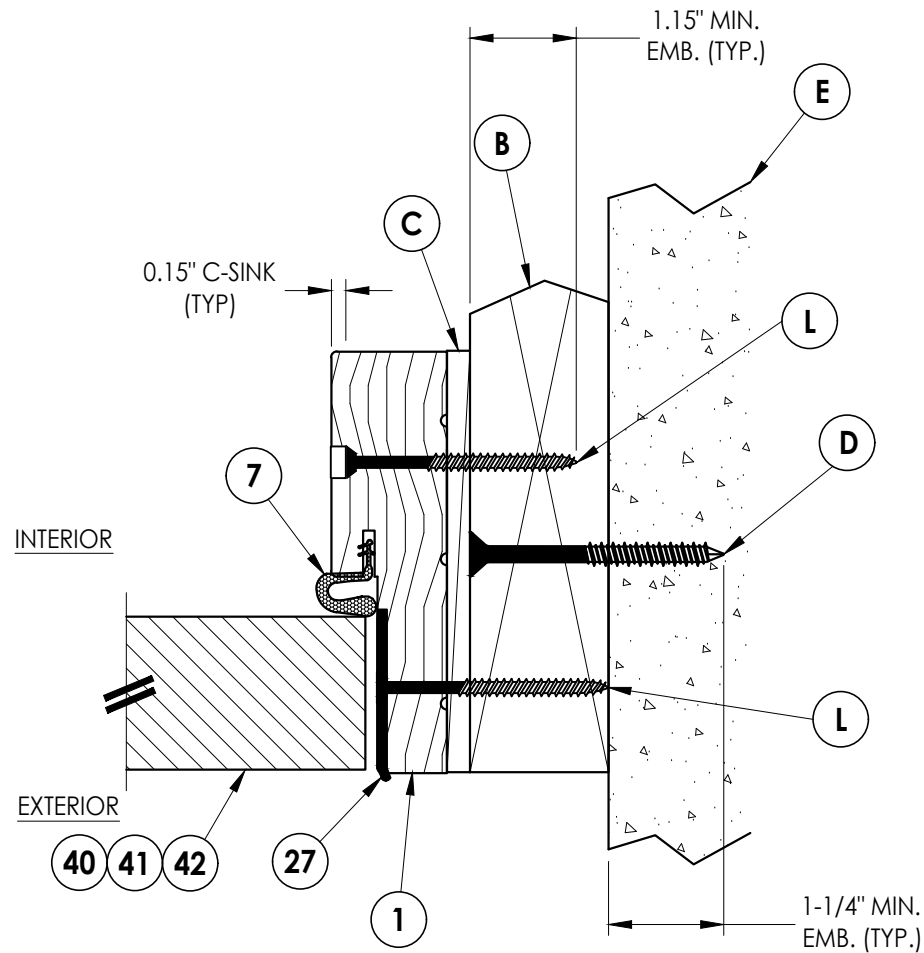


3 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	
REVISIONS			
NO.	DATE	BY	
3	7/2/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020)	FBC PO
DATE: 03/07/20			
SCALE: N.T.S.			
DWG. BY: TJ			
CHK. BY: LFS			
DRAWING NO.: FL-21135.10			
SHEET 4 OF 11			


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

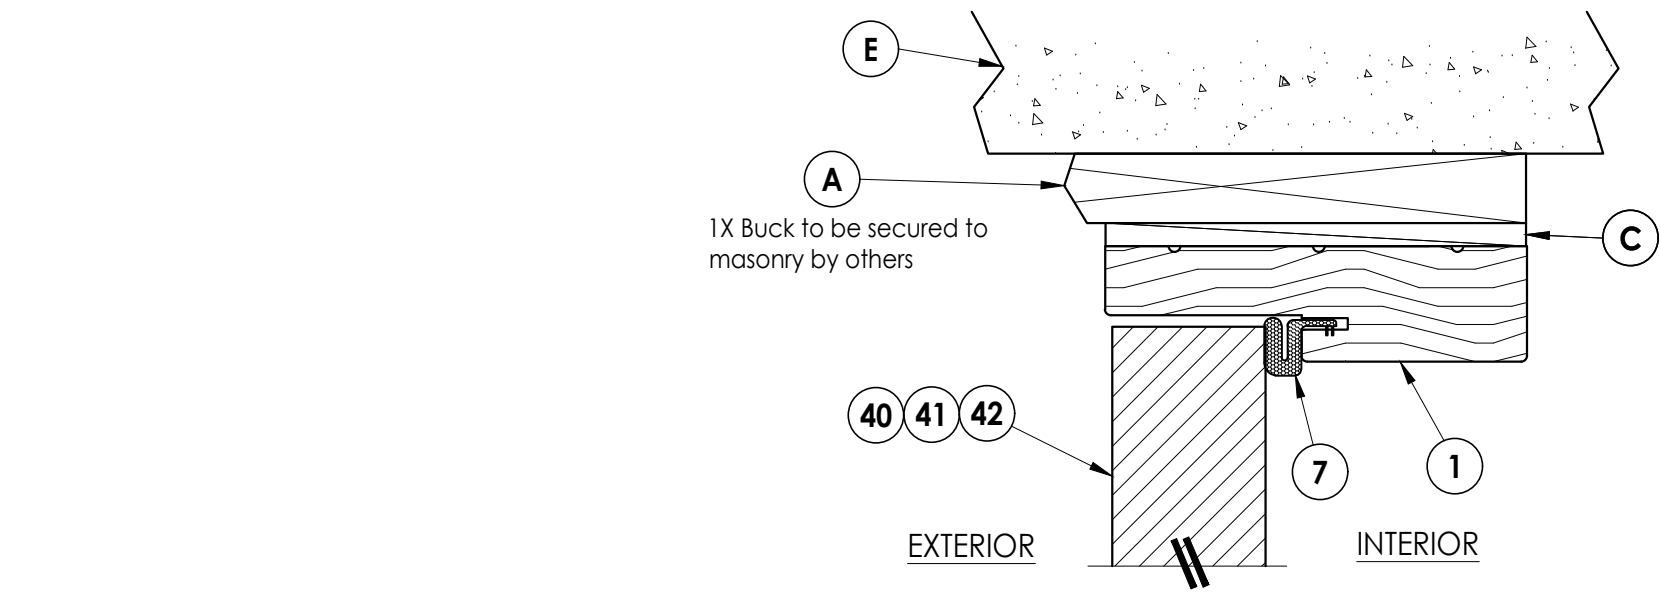

1 **VERTICAL CROSS SECTION**
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

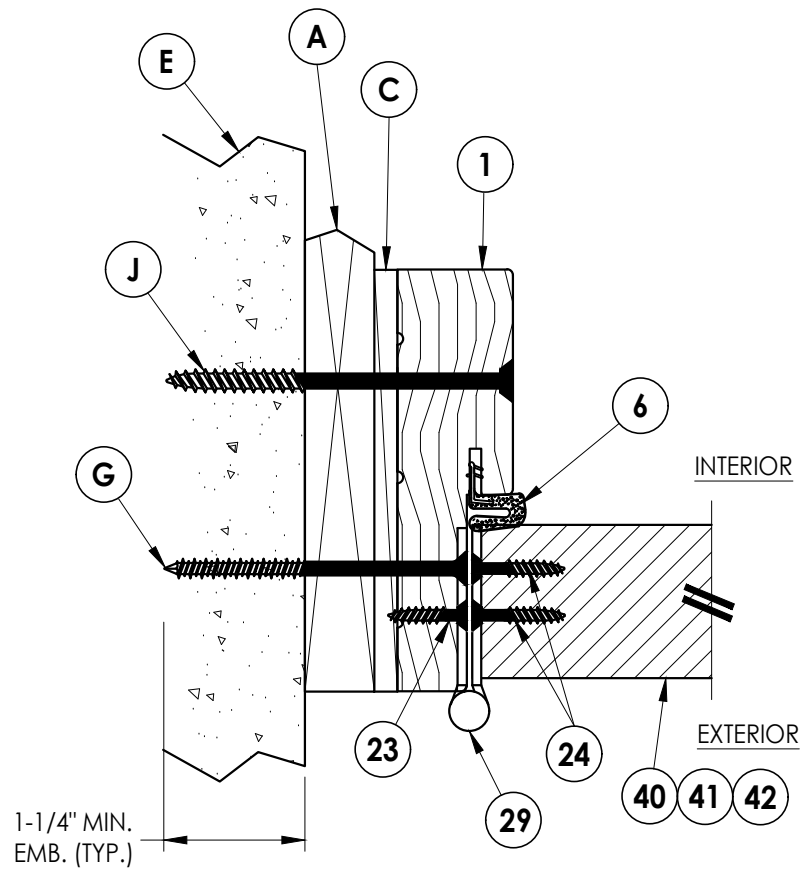

2 **HORIZONTAL CROSS SECTION**
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

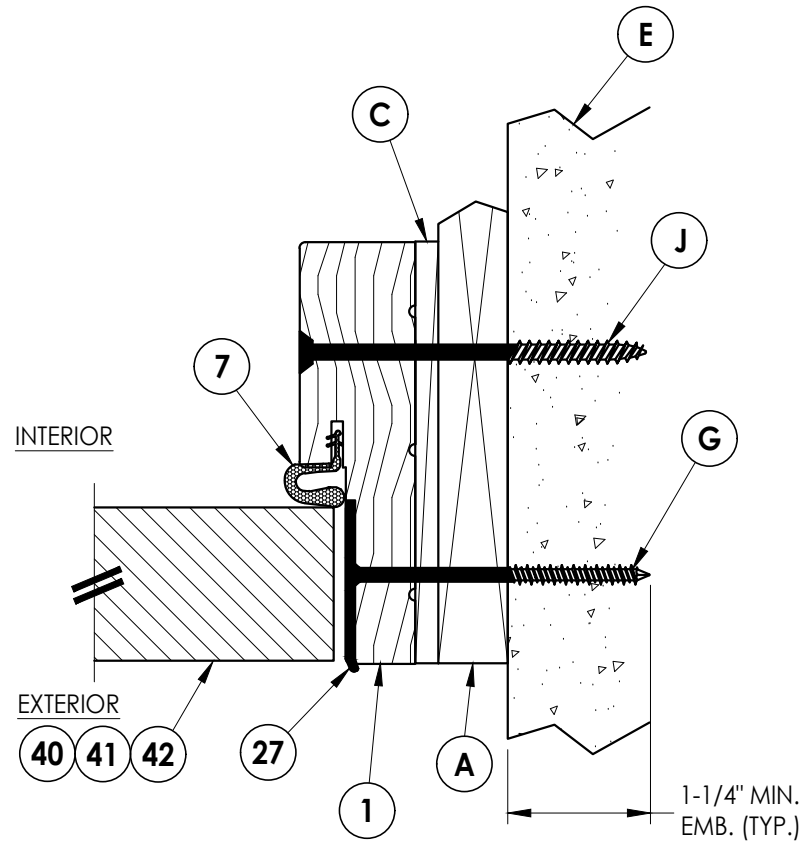

3 **HORIZONTAL CROSS SECTION**
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020) FBC PO
		BY

DATE: 03/07/20

SCALE: N.T.S.

DWG. BY: TJ


CHK. BY: LFS

DRAWING NO.:


FL-21135.10

SHEET 5 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

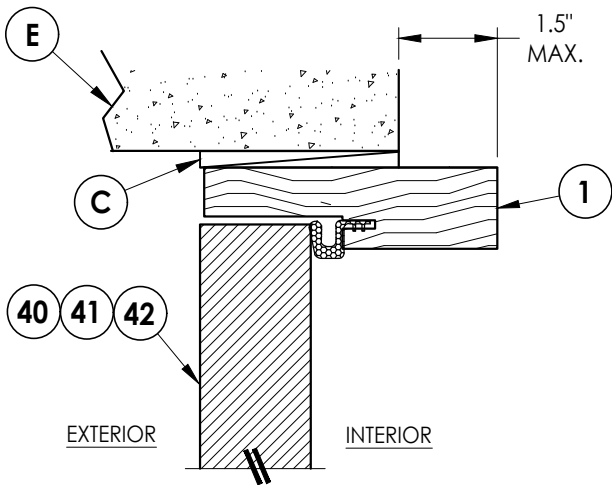


1/6 VERTICAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

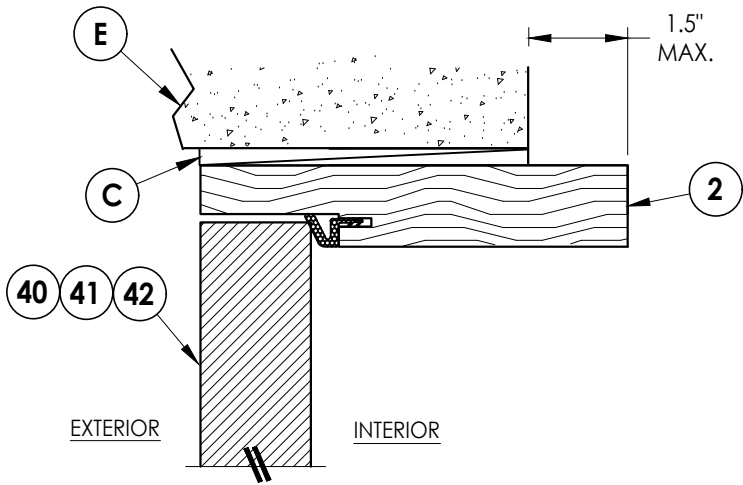


4/6 VERTICAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 55 PSF
w/ SECURITY STRIKE = ± 65 PSF

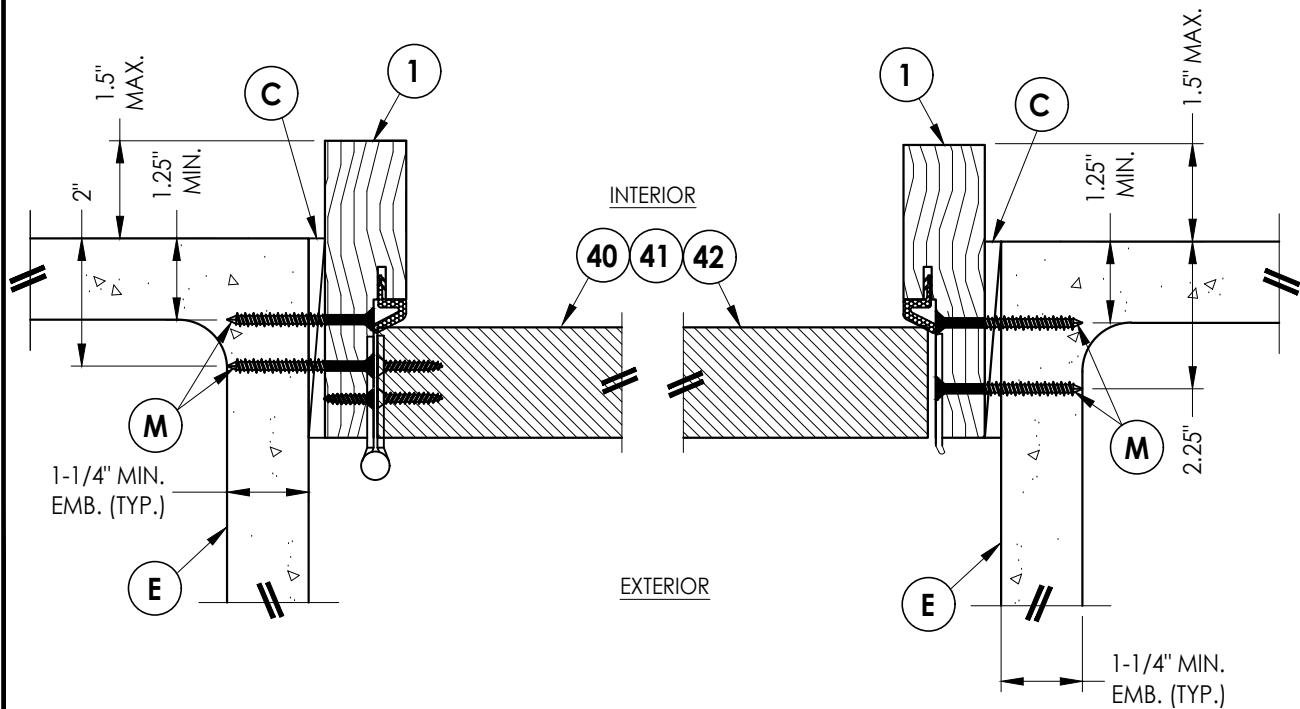

2/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

3/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

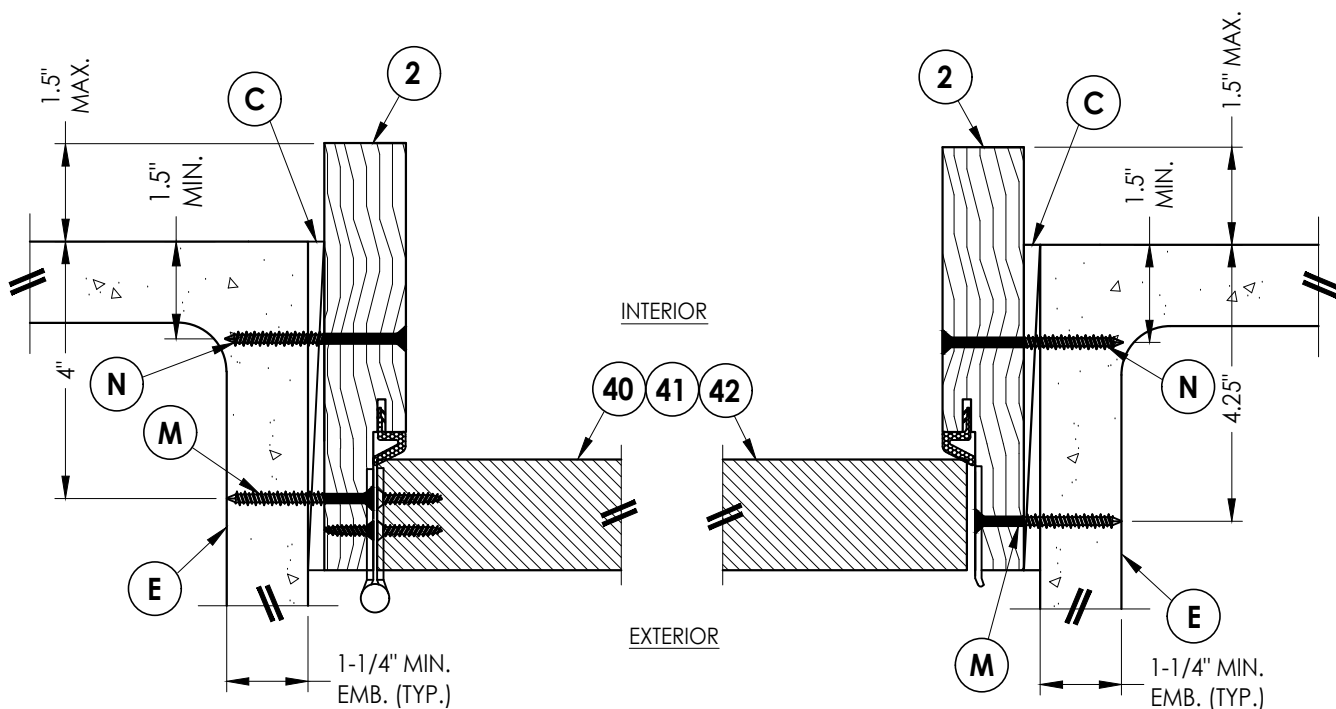

5/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

6/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 03/07/20

SCALE: N.T.S.

DWG. BY: TJ


CHK. BY: LFS

DRAWING NO.:
FL-21135.10


SHEET 6 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg


- Notes:
- Sill Item #'s 32, 38, 39, 50, 51, 52, 53, 54 & 55 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws or (3) 2.5" staples at each end.
 - Sill Item #'s 16, 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
 - Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS screws at each end.

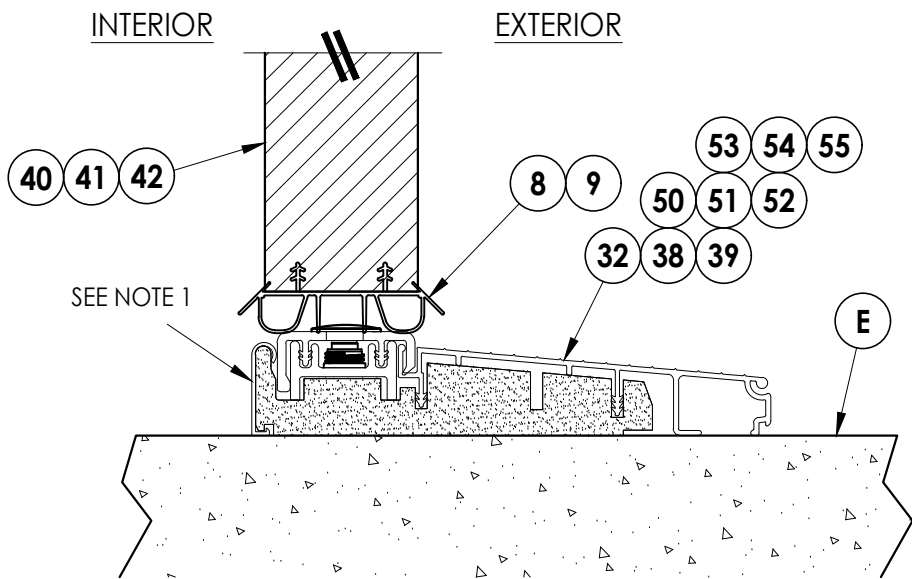

1
7 **VERTICAL CROSS SECTION**
Inswing Sill

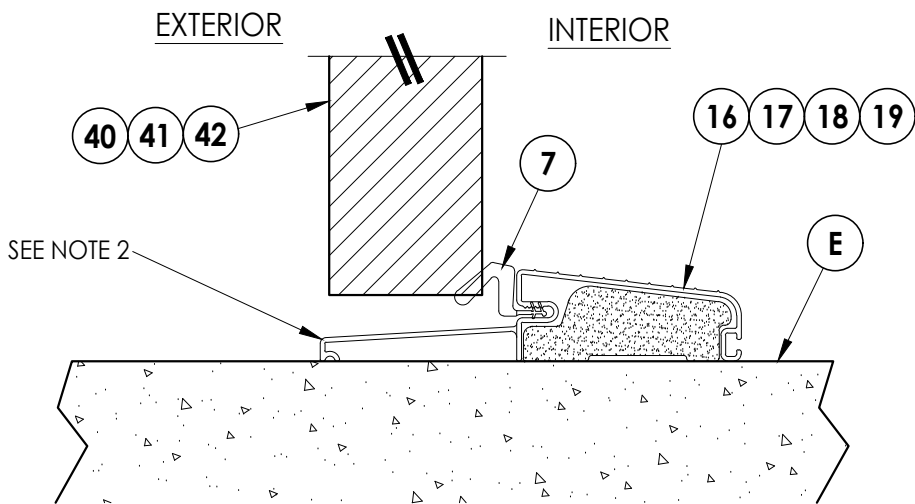

2
7 **VERTICAL CROSS SECTION**
Outswing Sill

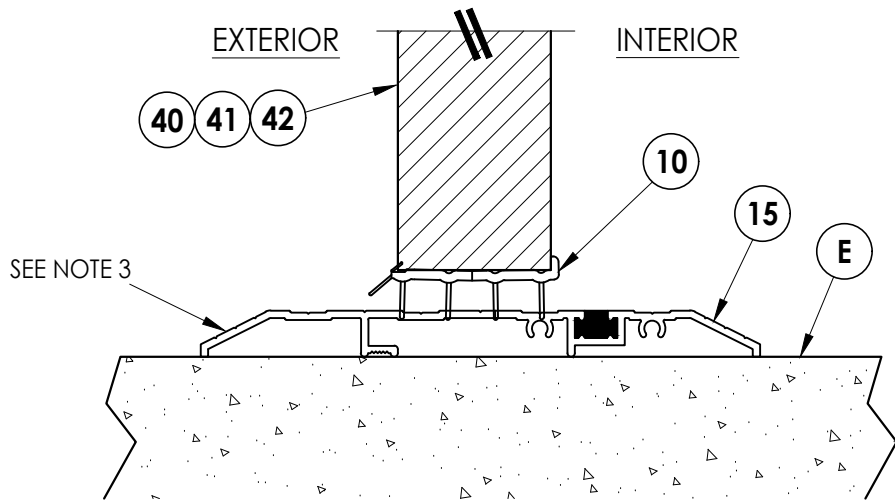

3
7 **VERTICAL CROSS SECTION**
Public Access Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 03/07/20

SCALE: N.T.S.





DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.:
FL-21135.10

SHEET 7 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

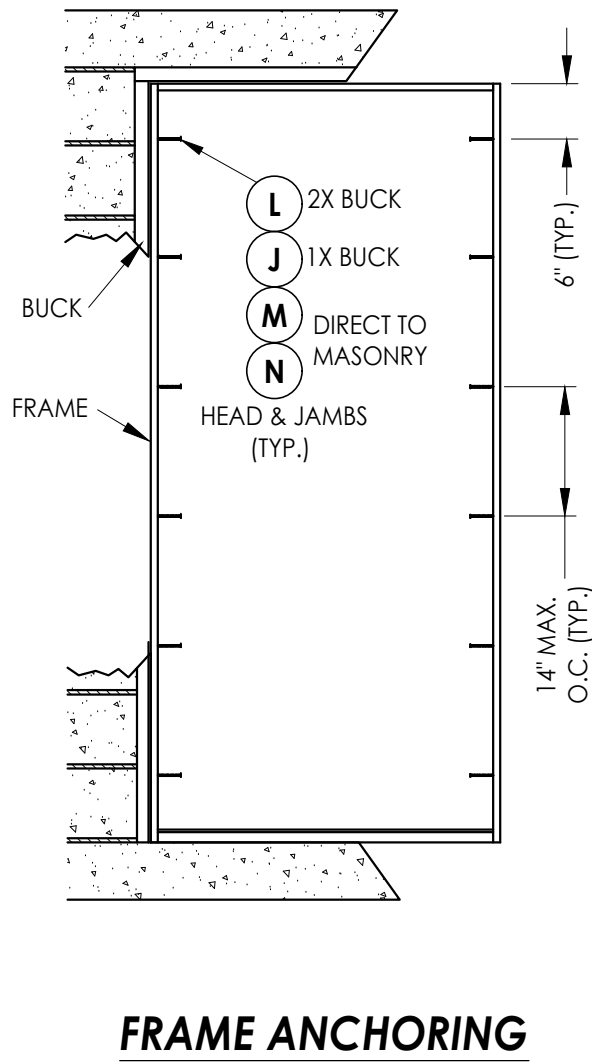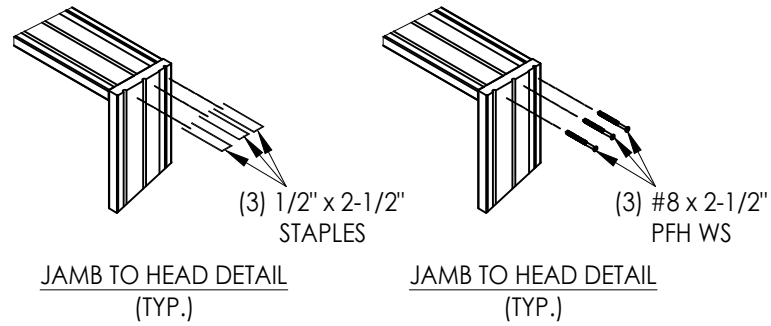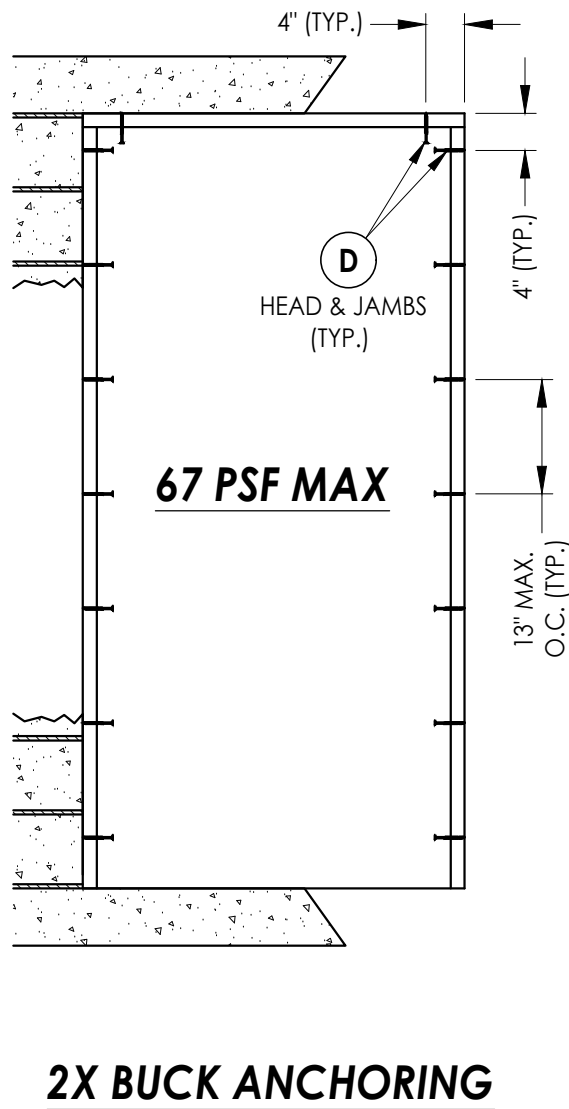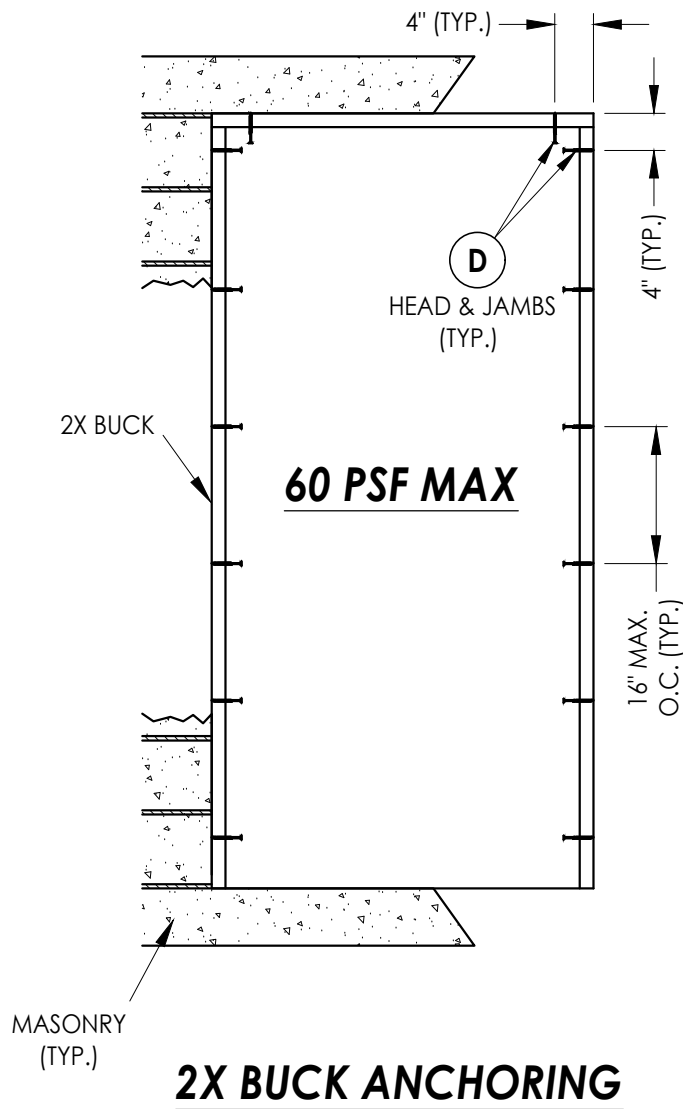


DATE		NO.		DATE	
03/07/20		3		7/2/26	
SCALE: N.T.S.		2		8/21/23	
DWG. BY: TJ		1		7/16/20	
CHK. BY: LFS				UPDATE TO 7th ED (2020) FBC	
DRAWING NO.: FL-21135.10				BY	
SHEET 8 OF 11				REVISIONS	


PRODUCT:	
THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:	
BUCK & FRAME ANCHORING	

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

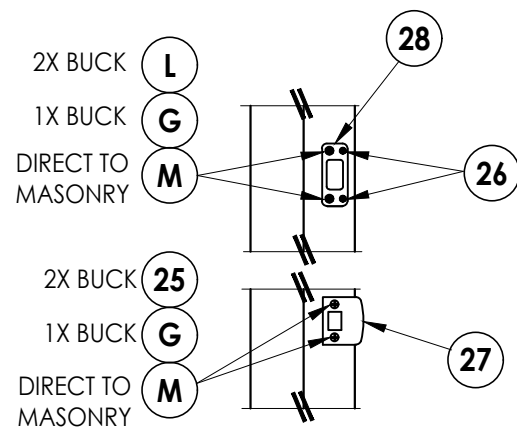


LATCH & DEADBOLT DETAIL
Kwikset

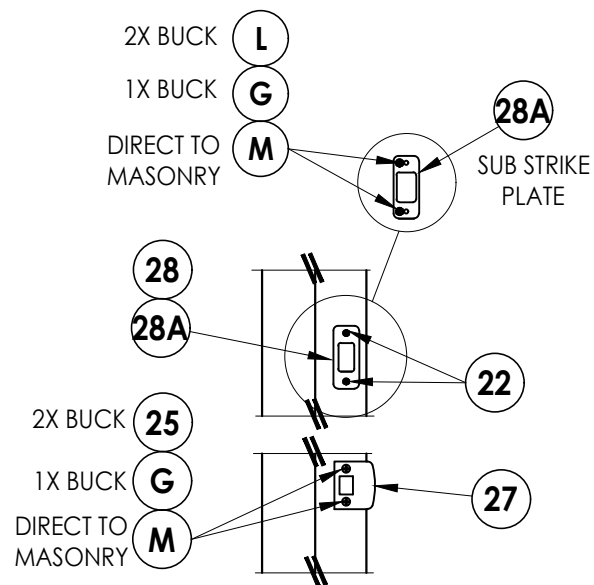

LATCH & DEADBOLT DETAIL
Schlage


LATCH & DEADBOLT STRIKE DETAILS

(Standard Deadbolt Strike Plate)

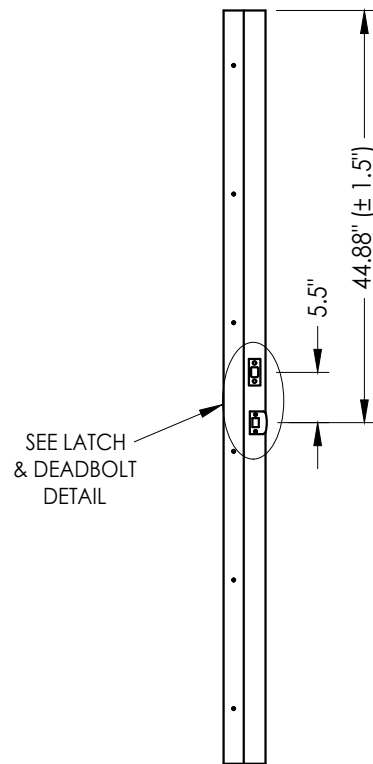


STRIKE JAMB

Latch and Deadbolt

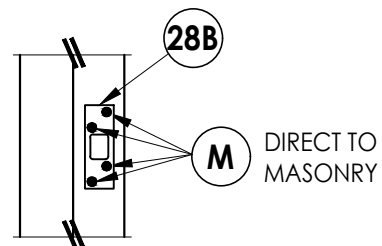


DEADBOLT STRIKE DETAILS

(Security Deadbolt Strike Plate)

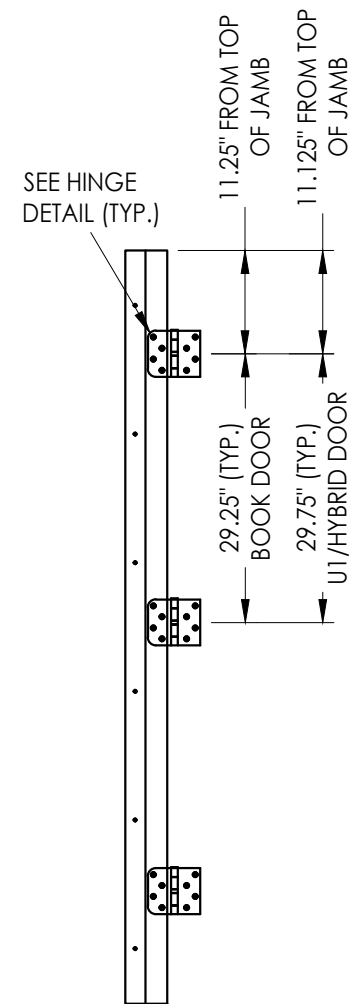

HINGE JAMB

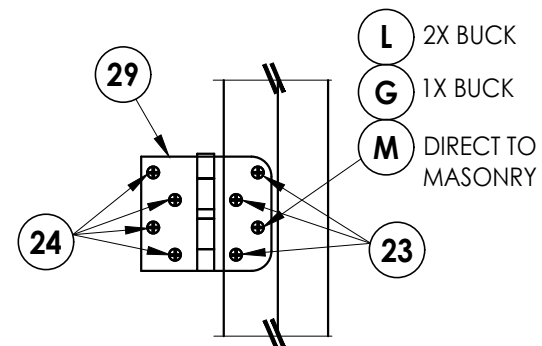

HINGE DETAIL


3	7/2/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
2	8/21/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
1	7/16/20	UPDATE TO 7th ED	(2020)	FBC	PO
NO.	DATE				BY
					REVISIONS

DATE:	03/07/20
SCALE:	N.T.S.
DWG. BY:	TJ
CHK. BY:	LFS
DRAWING NO.:	FL-21135.10
SHEET	9 OF 11


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R²W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

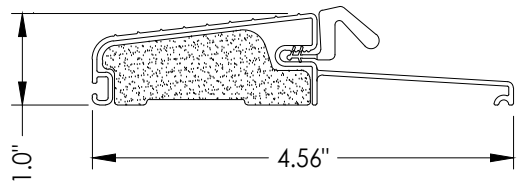


16 OUTSWING THRESHOLD
Composite Sill

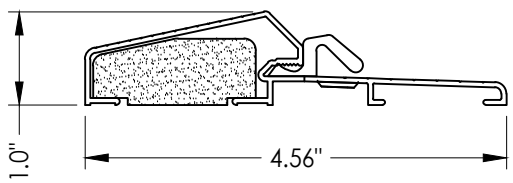


17 OUTSWING THRESHOLD
Composite / Aluminum Sill




8 SWEEP




9 SWEEP

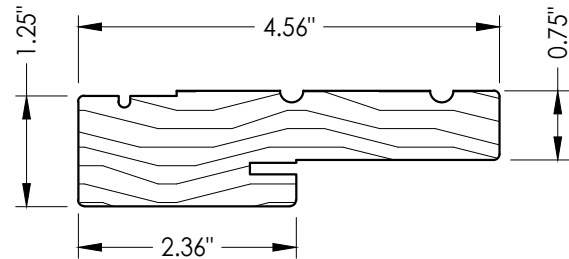


1 WOOD JAMB

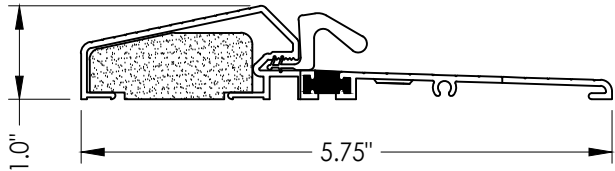


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

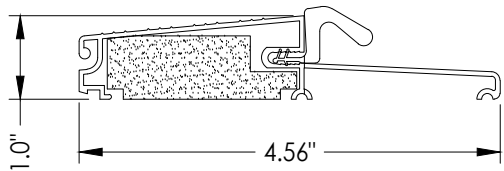


19 OUTSWING THRESHOLD
Composite Sill




10 SWEEP

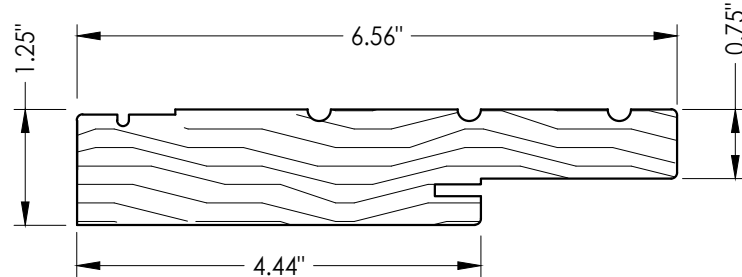


2 WOOD JAMB

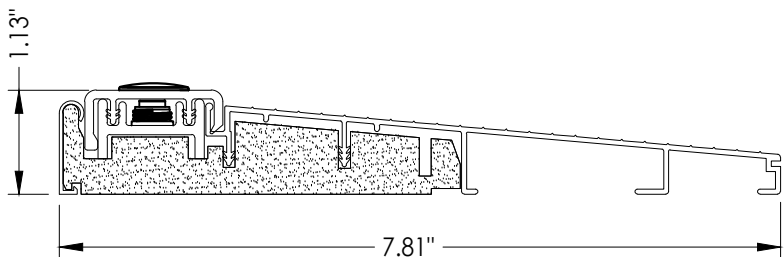


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

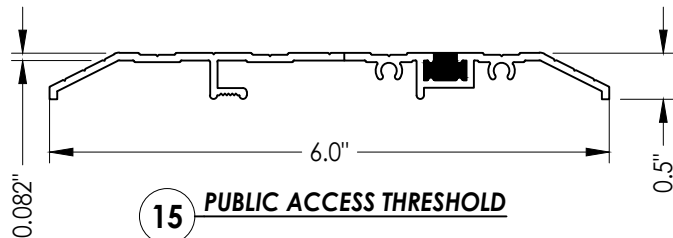


15 PUBLIC ACCESS THRESHOLD

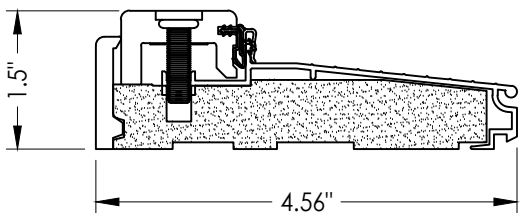


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

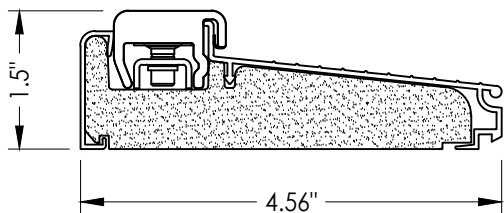


50 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

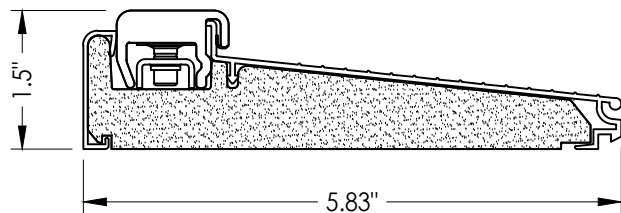


51 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

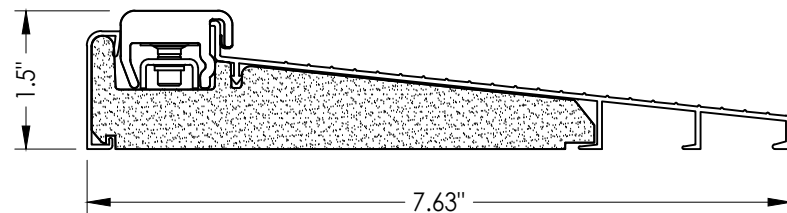


52 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

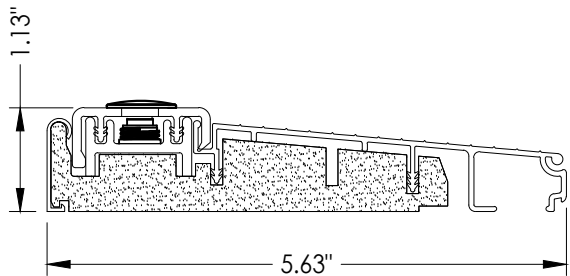


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

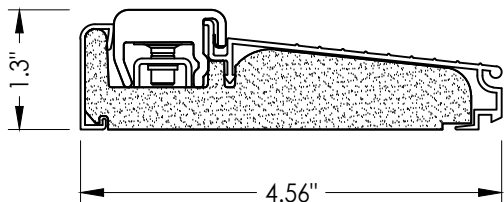

53 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

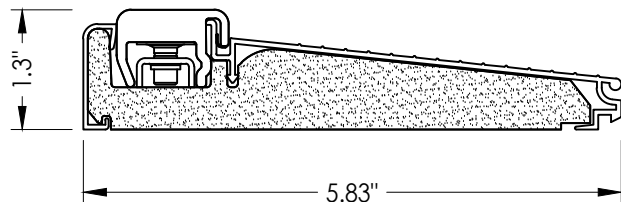

54 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

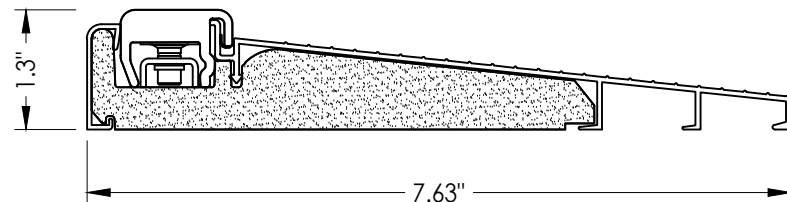

55 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED. (2020) FBC PO

DATE: 03/07/20

SCALE: N.T.S.

DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.:

FL-21135.10

SHEET 10 OF 11

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
26	#8 x 5/8" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE (STANDARD)	STEEL
28A	DEADBOLT SUB STRIKE PLATE	STEEL
28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
29	4" X 4" HINGE	STEEL
32	INSWING THRESHOLD	ALUM/COMP
38	INSWING THRESHOLD	ALUM/COMP
39	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL (BOOK)	-
41	DOOR PANEL (HYBRID)	-
42	DOOR PANEL (U1)	-
50	INSWING THRESHOLD	ALUM/COMP
51	INSWING THRESHOLD	ALUM/COMP
52	INSWING THRESHOLD	ALUM/COMP
53	INSWING THRESHOLD	ALUM/COMP
54	INSWING THRESHOLD	ALUM/COMP
55	INSWING THRESHOLD	ALUM/COMP

CONCRETE ANCHOR NOTES:
Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

[illegible]