


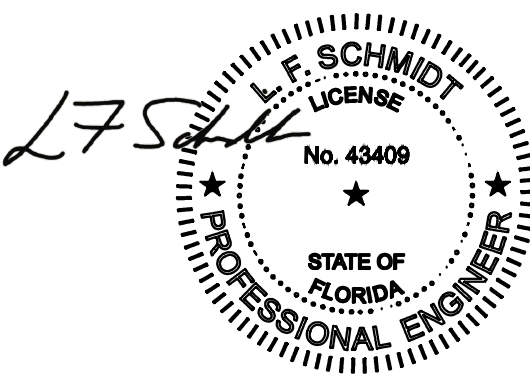

Digitally signed by
Lyndon F Schmidt
Date: 2026.08.06
16:12:23 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.

Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.


THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

COMPOSITE EDGE
OPAQUE FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"NON-IMPACT"

GENERAL NOTES

- 1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- 4. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
- 5. Benchmark Door panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details
3	Elevations
4	Horizontal & Vertical Cross Sections (2X Buck)
5	Horizontal & Vertical Cross Sections (1X Buck)
6	Horizontal & Vertical Cross Sections (Direct to Masonry)
7	Vertical Cross Sections (Thresholds)
8	Buck & Frame Anchoring
9	Hardware Details
10	Components
11	Bill of Materials

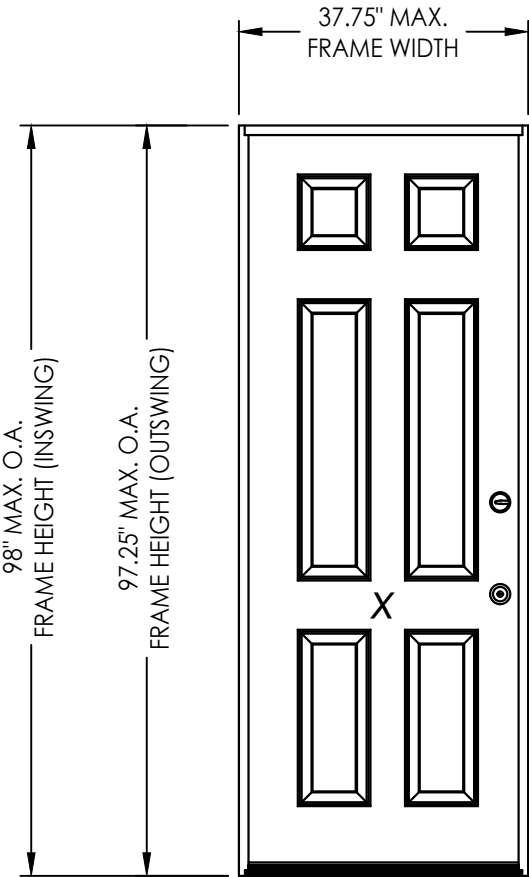

CONFIGURATION	LOCK HARDWARE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	Latch & Deadbolt	+67.0	-67.0	+67.0	-67.0

See Sheet 3 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

DATE: 03/07/20

SCALE: N.T.S.

DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.: FL-21135.12


SHEET 1 OF 11

REVISIONS


3	7/2/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/21/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/16/20	UPDATE TO 7th ED (2020)	FBC	PO
NO.	DATE			BY

© 2020 R.W. BUILDING CONSULTANTS INC.

Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

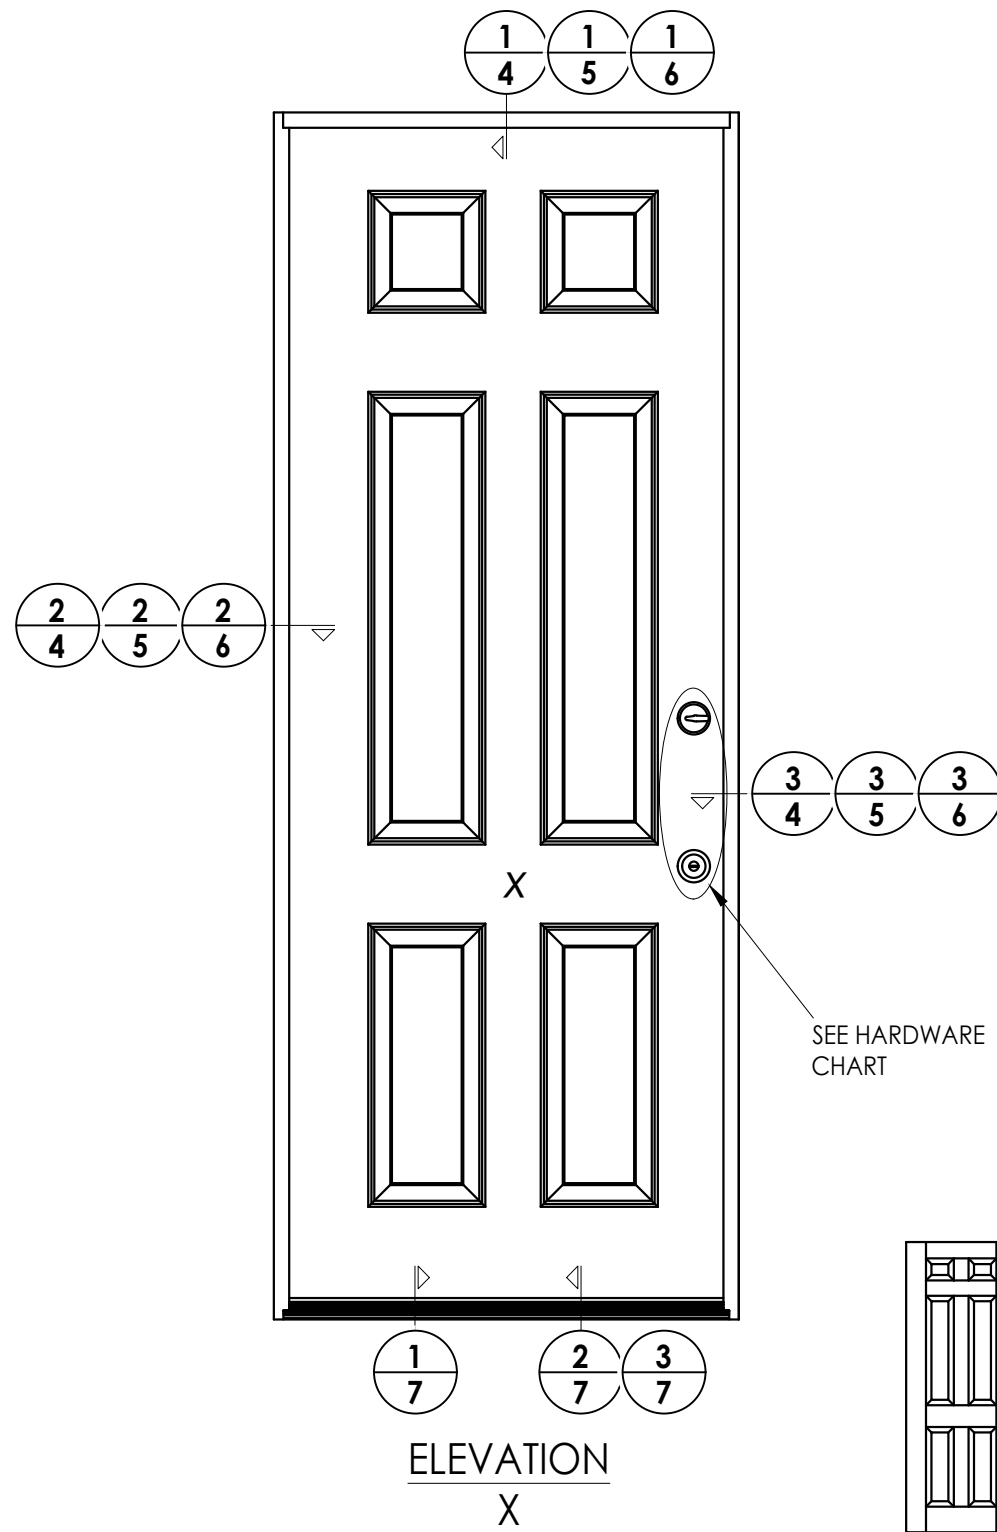

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB: F51 DEADBOLT: B60	
KWIKSET	KNOB: SIGNATURE SERIES DEADBOLT: SIGNATURE SERIES (980)	

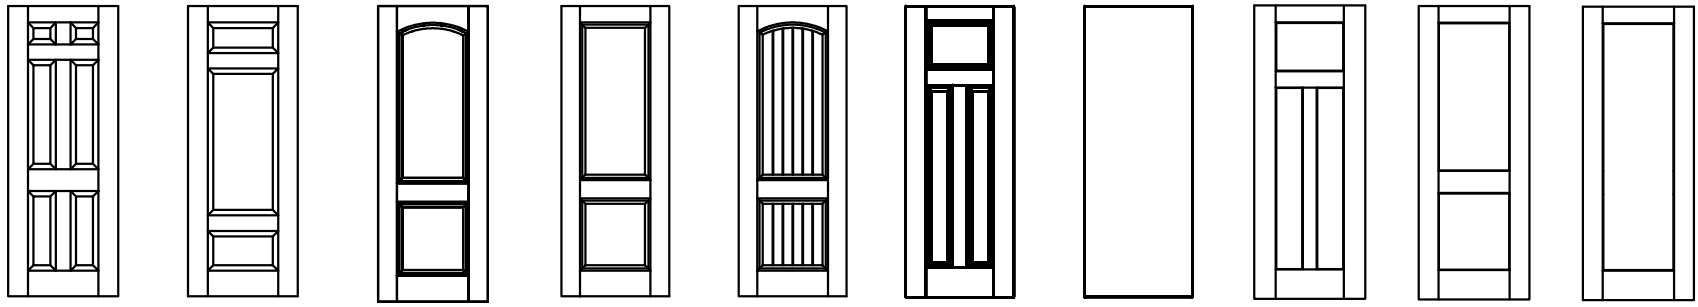


Benchmark Door Panel Options


Products approved include all embossed and recessed panel doors.
Similar opaque panel configurations are allowed.
Panels shown are for illustration and are representative only.

[illegible]


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

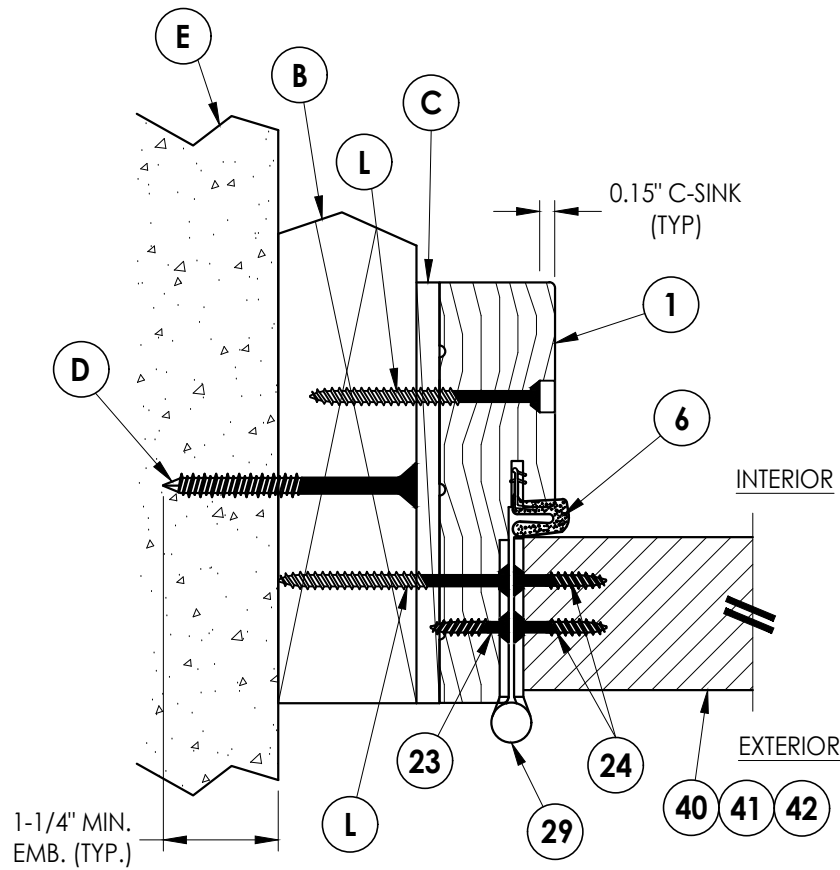

2 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

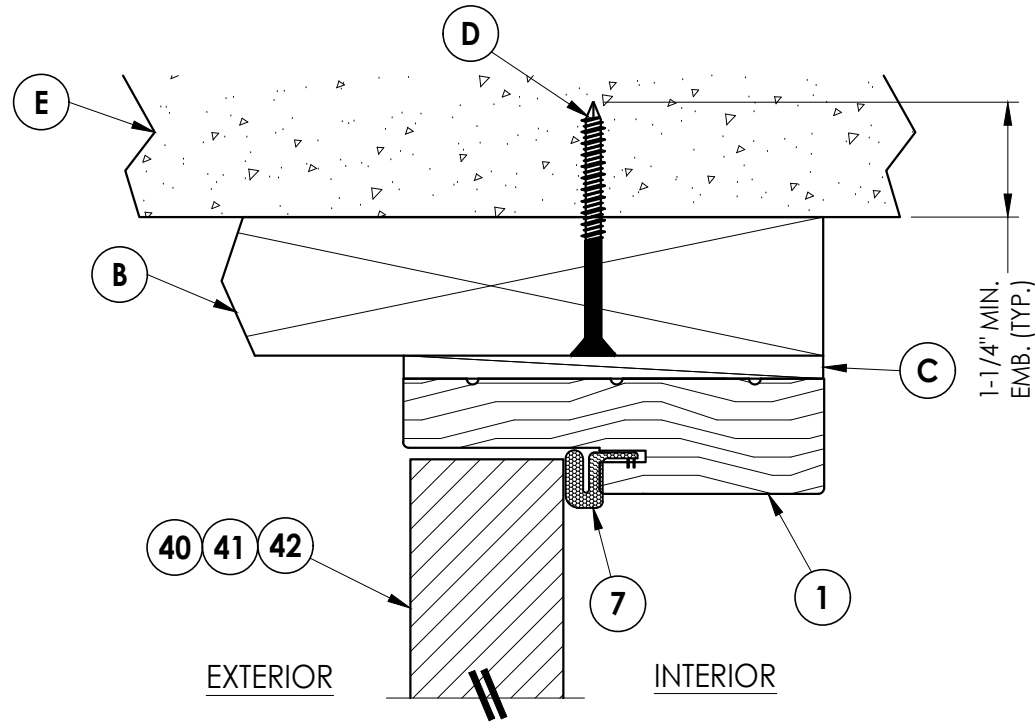

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

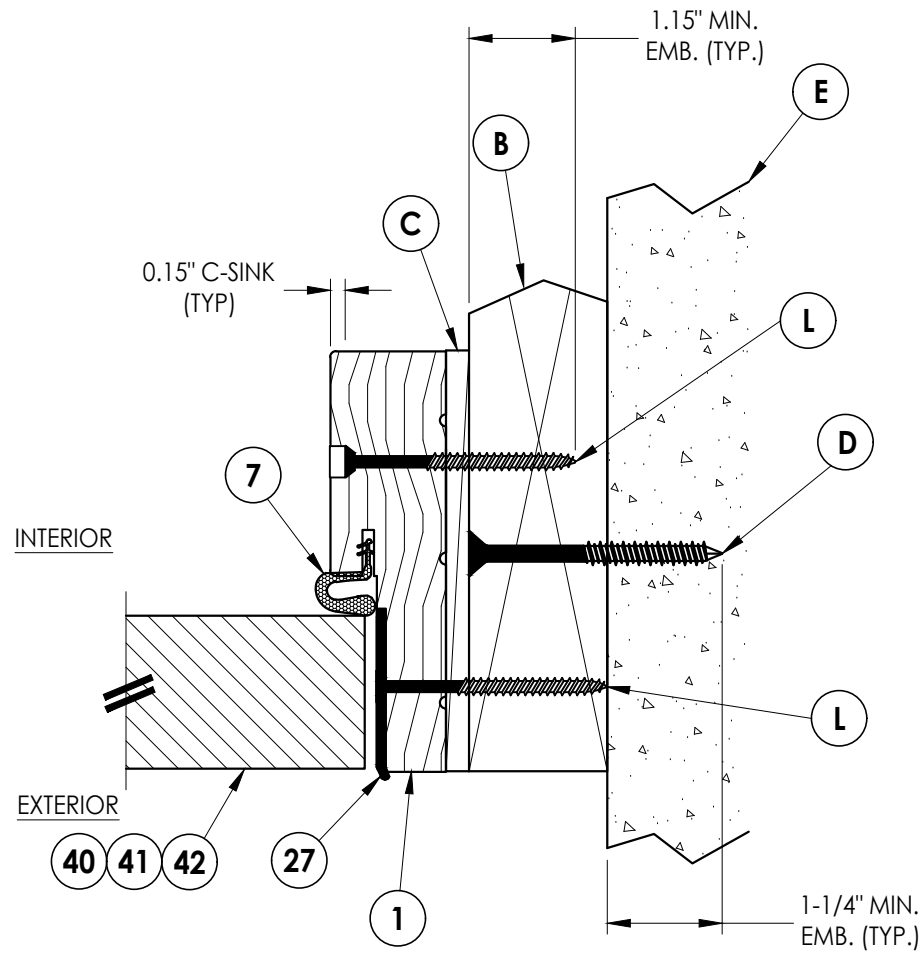


3 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	
REVISIONS			
NO.	DATE	BY	
3	7/2/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020)	FBC PO
DATE: 03/07/20			
SCALE: N.T.S.			
DWG. BY: TJ			
CHK. BY: LFS			
DRAWING NO.: FL-21135.12			
SHEET 4 OF 11			


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

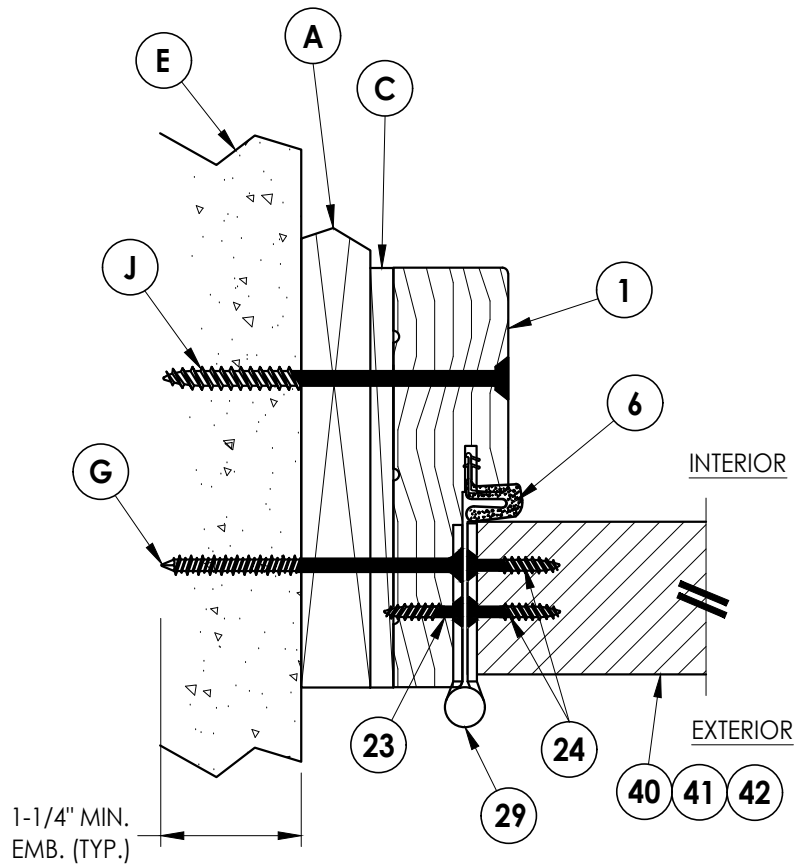

2 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

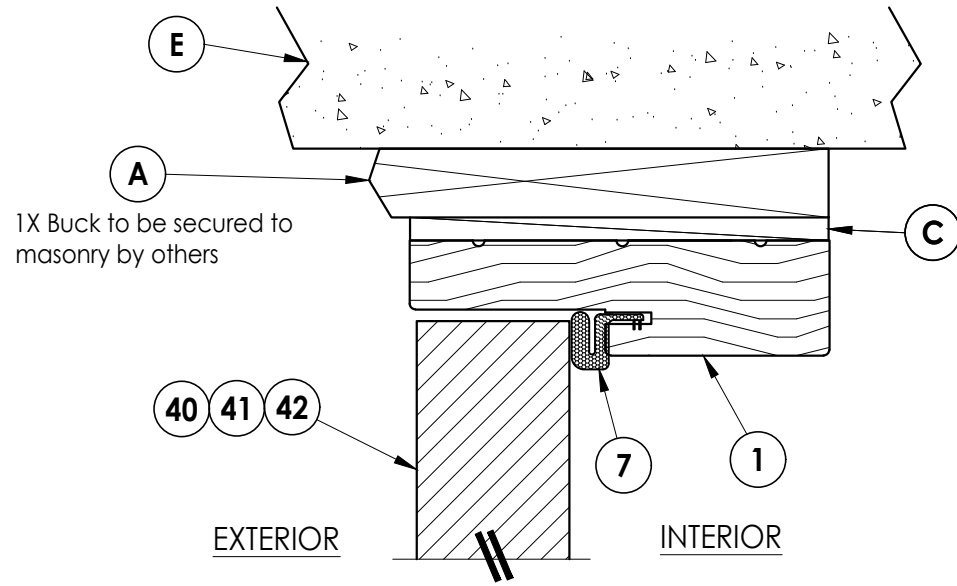

1 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

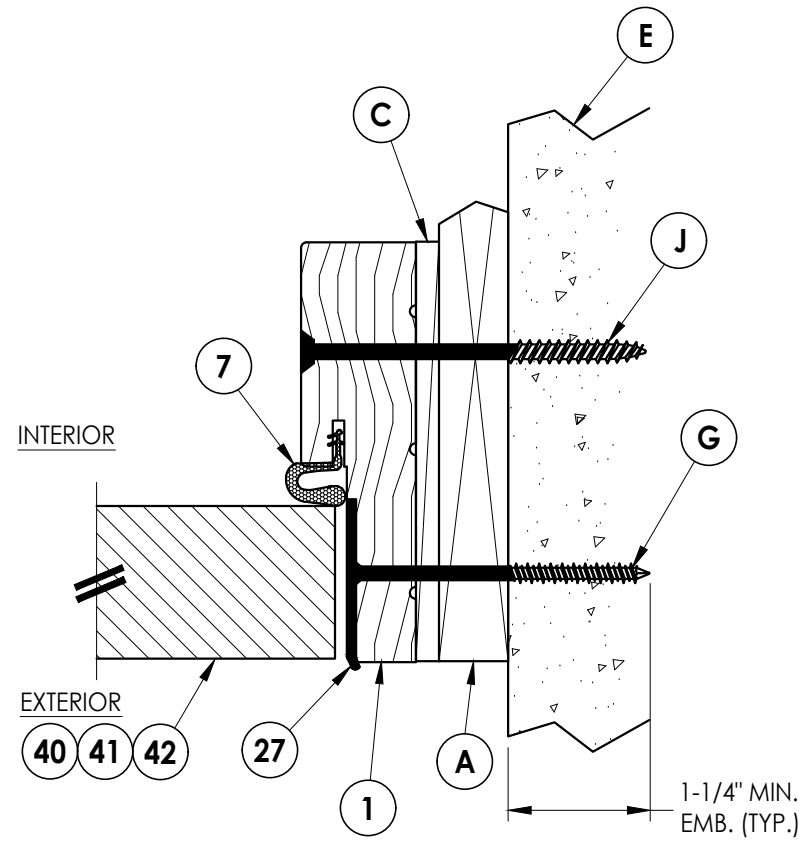

3 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 03/07/20

SCALE: N.T.S.


DWG. BY: TJ

CHK. BY: LFS


DRAWING NO.:

FL-21135.12

SHEET 5 OF 11

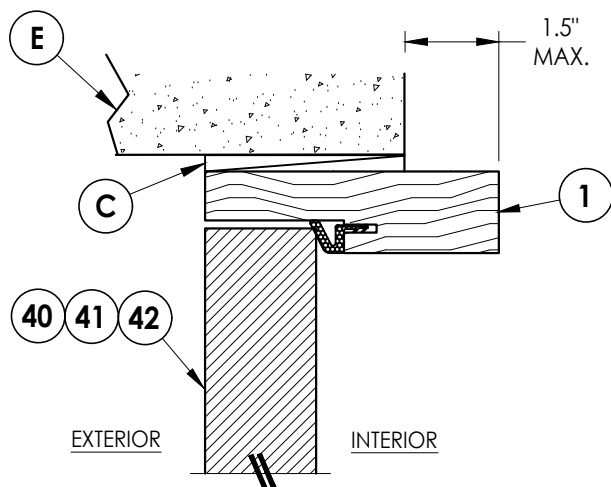


1 **VERTICAL CROSS SECTION**
6 Shown Direct to Masonry
 Outswing only w/ 4-9/16" jamb

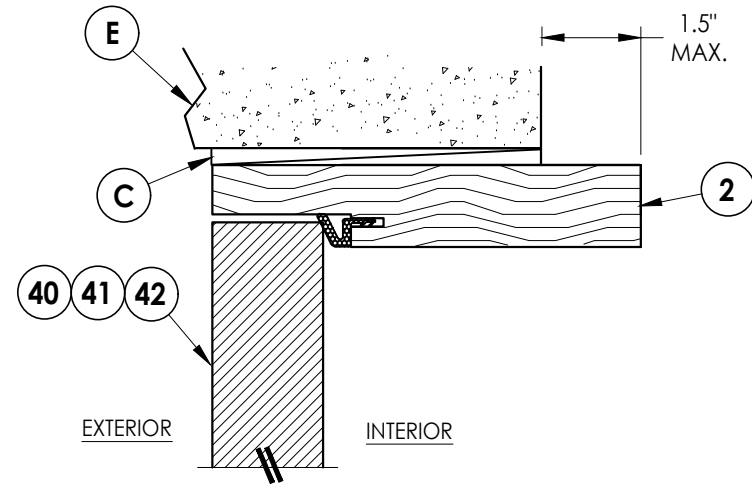


4 **VERTICAL CROSS SECTION**
6 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 47 PSF
w/ SECURITY STRIKE = ± 55 PSF

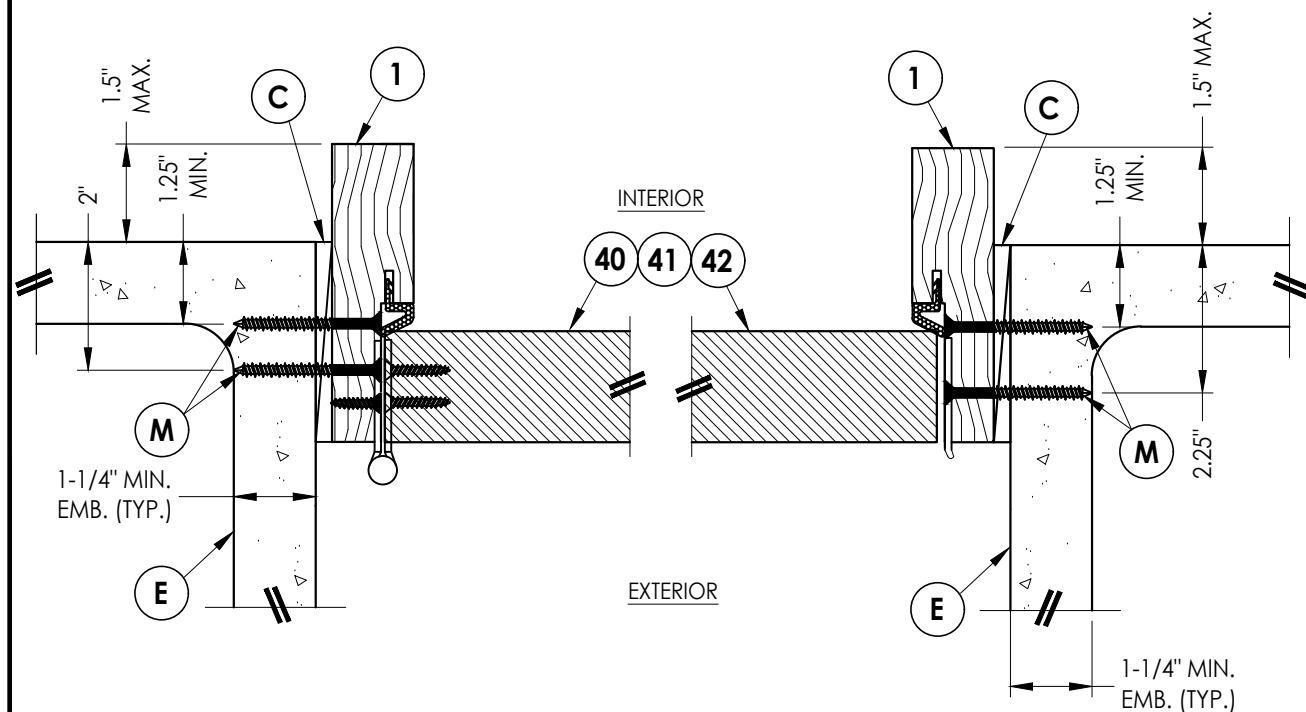

2 HORIZONTAL CROSS SECTION
6 Shown Direct to Masonry
 Outswing only w/ 4-9/16" jamb

3 **HORIZONTAL CROSS SECTION**
6 Shown Direct to Masonry
 Outswing only w/ 4-9/16" jamb

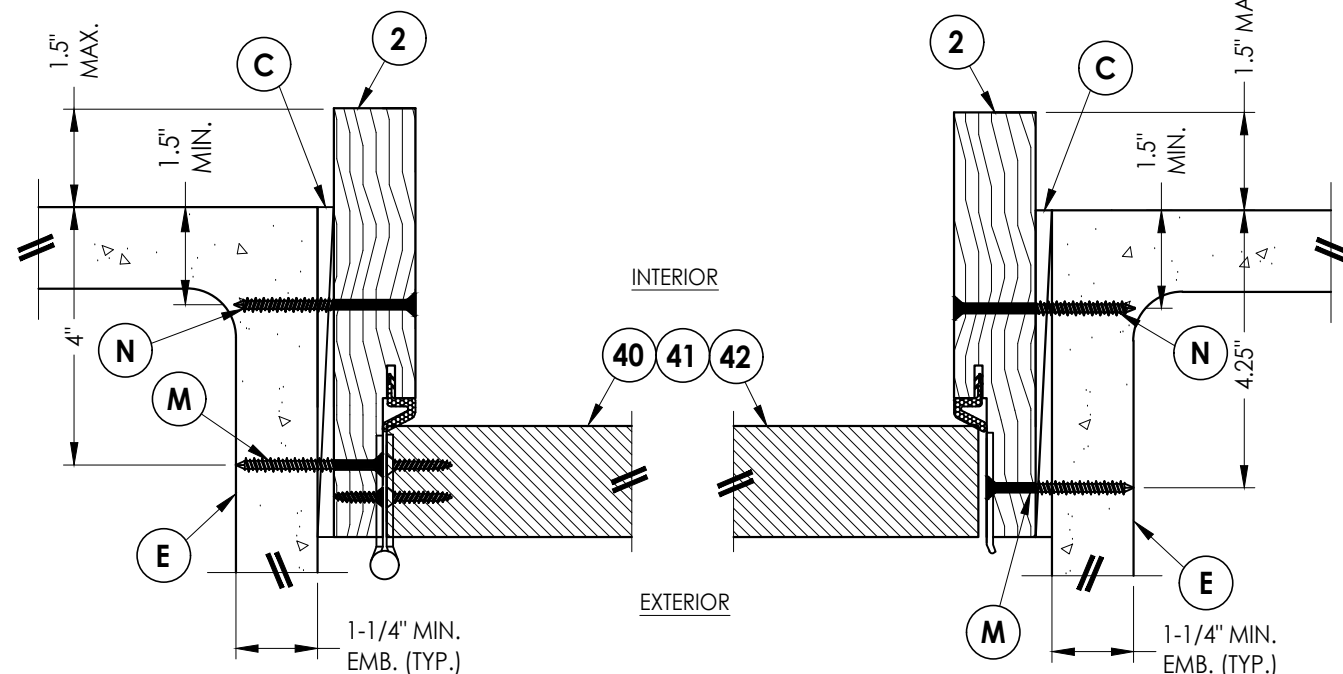

5 HORIZONTAL CROSS SECTION

6 Shown Direct to Masonry Outswing only w/ 6-9/16" jamb

6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


1. Sill Item #'s 32, 38, 39, 50, 51, 52, 53, 54 & 55 are attached to jambs w/ (3) #8 X 2-1/2" pph screws or (3) 2.5" staples at each end.
2. Sill Item #'s 16, 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pph screws at each end.
3. Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS screws at each end.

[illegible]


R^gW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2020 R.W. BUILDING CONSULTANTS INC.




Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

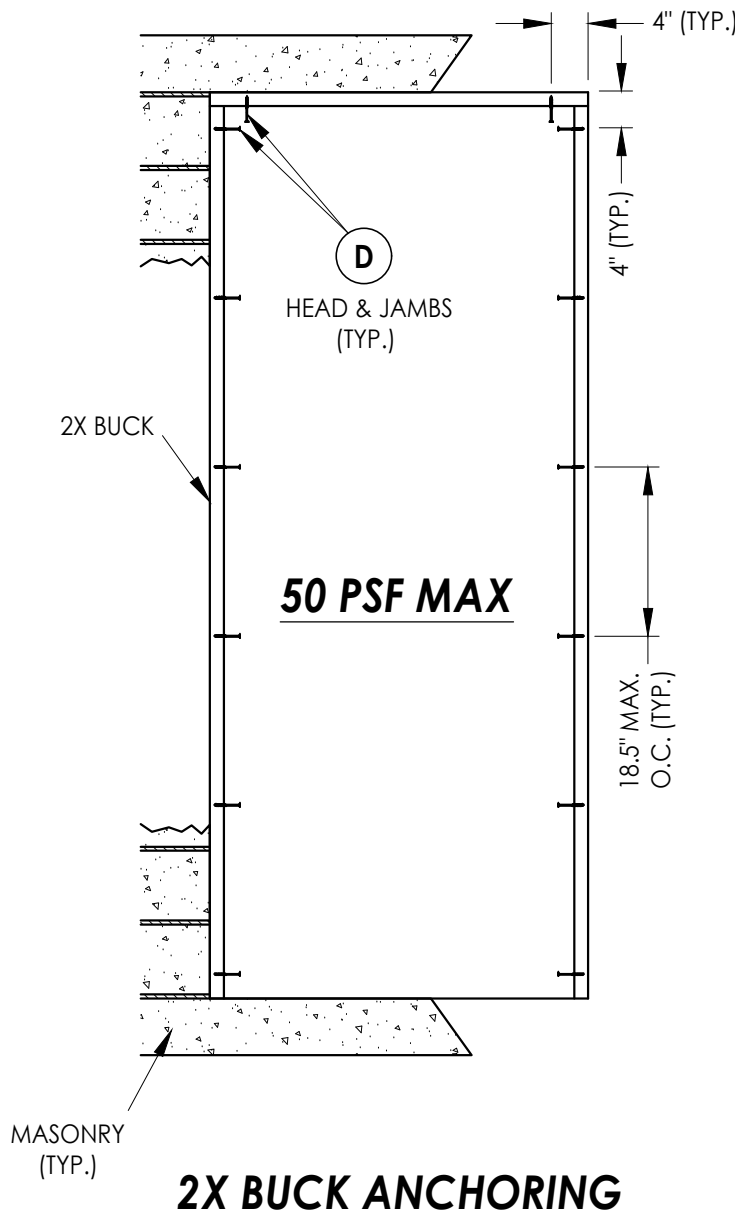

2X BUCK ANCHORING

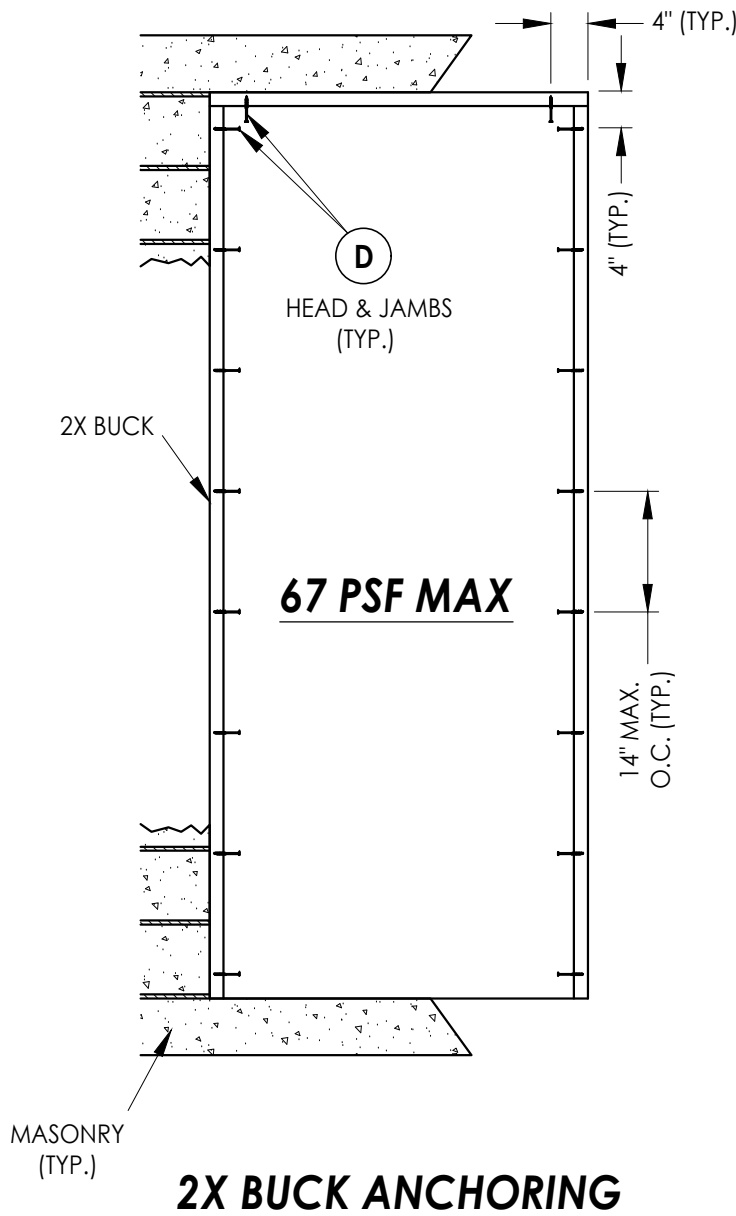

2X BUCK ANCHORING

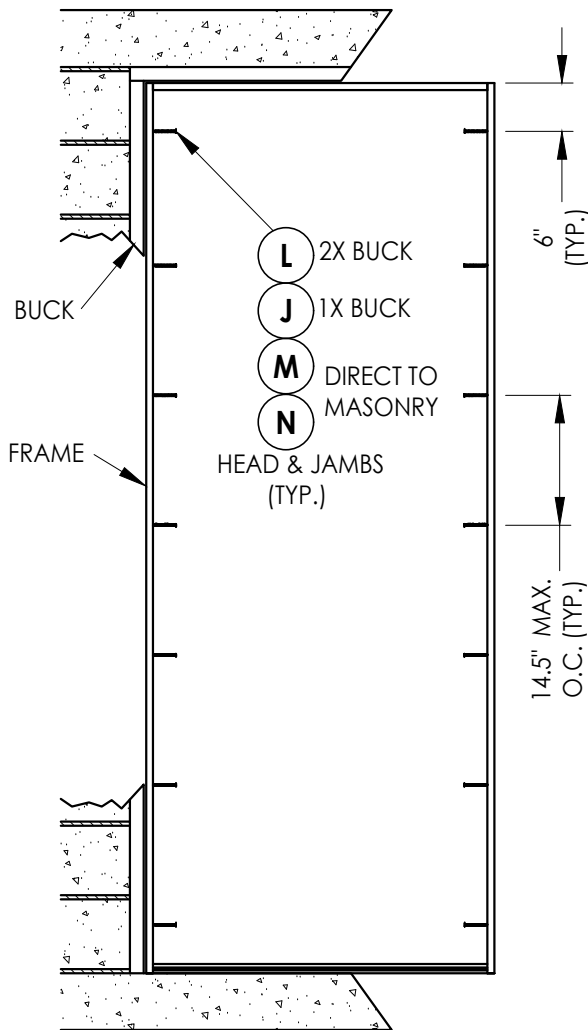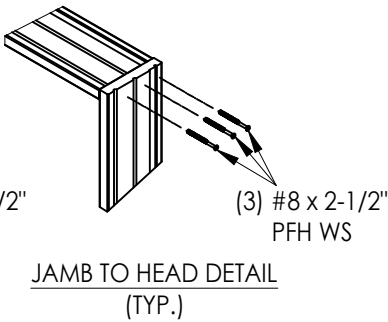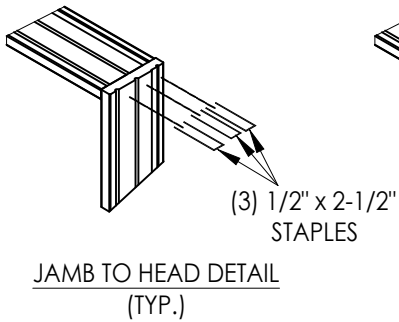

FRAME ANCHORING


DATE		NO.		DATE		BY		REVISIONS	
03/07/20		3		7/2/26		UPDATE TO 9TH ED. (2026)		FBC	
SCALE: N.T.S.		2		8/21/23		UPDATE TO 8TH ED. (2023)		FBC	
DWG. BY: TJ		1		7/16/20		UPDATE TO 7th ED (2020)		FBC	
CHK. BY: LFS									
DRAWING NO.: FL-21135.12									
SHEET 8 OF 11									

PRODUCT:		PART OR ASSEMBLY:	
THERMA-TRU FIBERGLASS DOOR		BUCK AND FRAME ANCHORING	

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

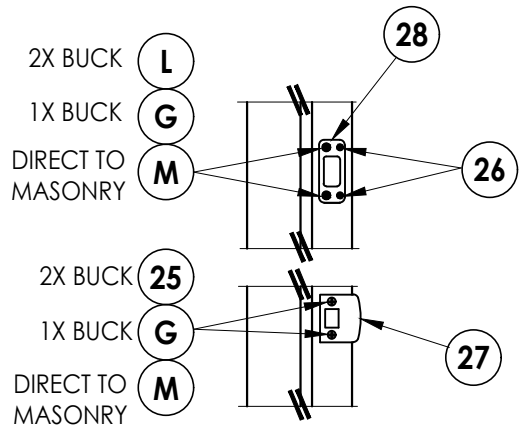

LATCH & DEADBOLT DETAIL


Kwikset

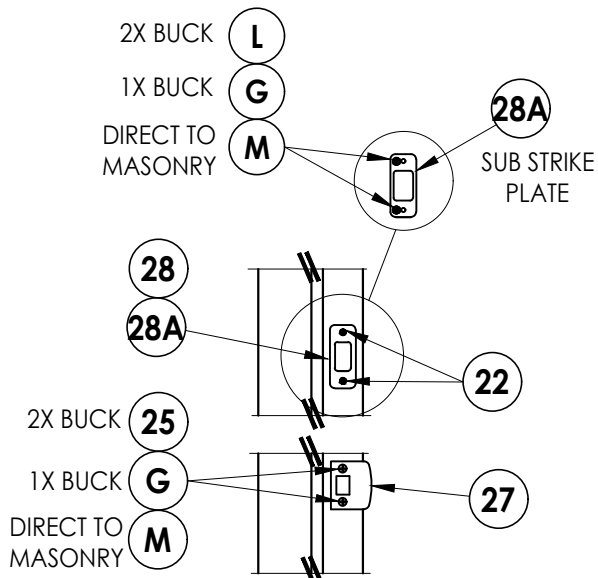

LATCH & DEADBOLT DETAIL


Schlage

LATCH & DEADBOLT STRIKE DETAILS

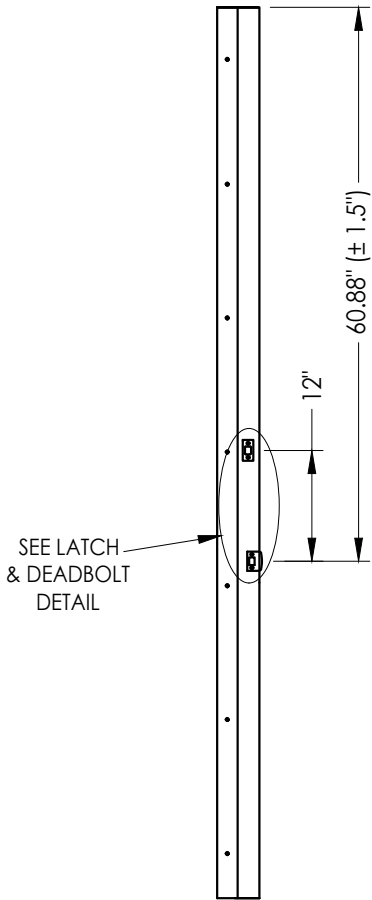


STRIKE JAMB

Latch and Deadbolt

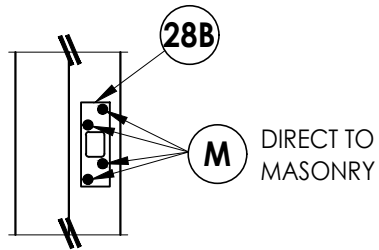


DEADBOLT STRIKE DETAILS

(Security Deadbolt Strike Plate)

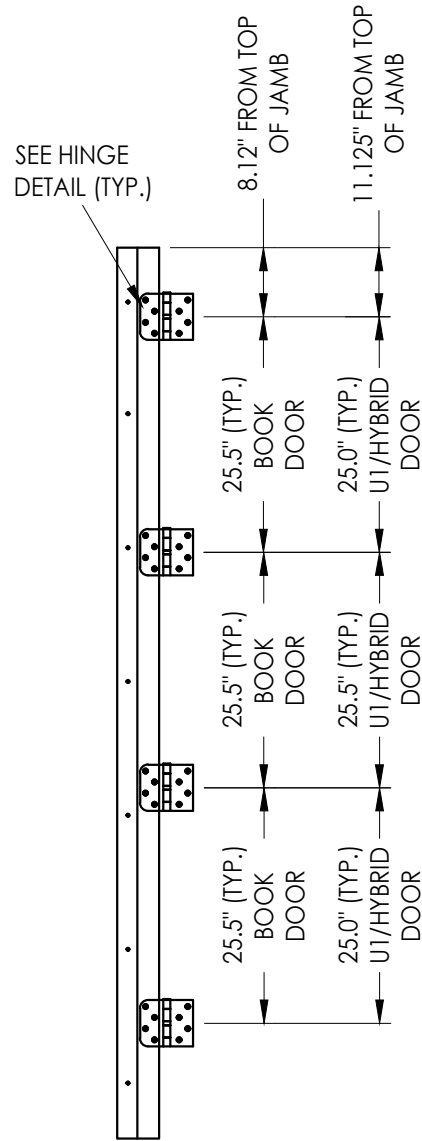

HINGE JAMB

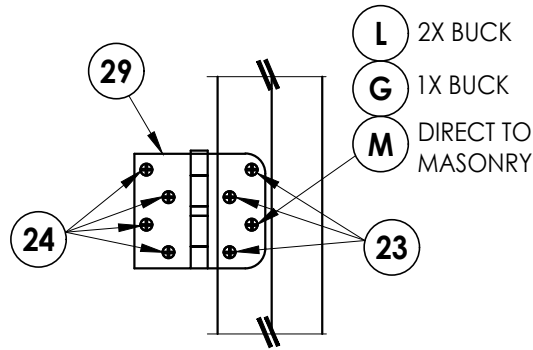

HINGE DETAIL

REVISIONS			
NO.	DATE	BY	PO
3	7/2/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020)	FBC PO

DATE: 03/07/20

SCALE: N.T.S.

DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.:

FL-21135.12

SHEET 9 OF 11


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HARDWARE DETAILS


Z:\2023 FBC Drawings\Therma-Tru\FL-21135 R7\FL-21135.10-13.dwg

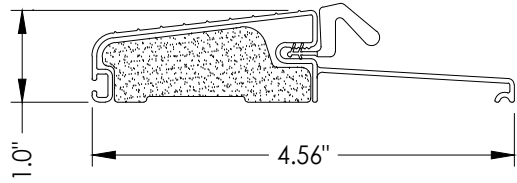


16 OUTSWING THRESHOLD
Composite Sill

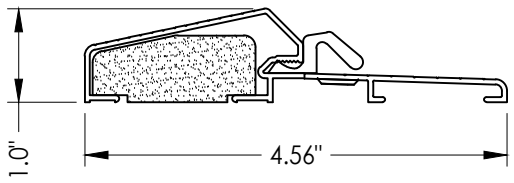


17 OUTSWING THRESHOLD
Composite / Aluminum Sill




8 SWEEP




9 SWEEP

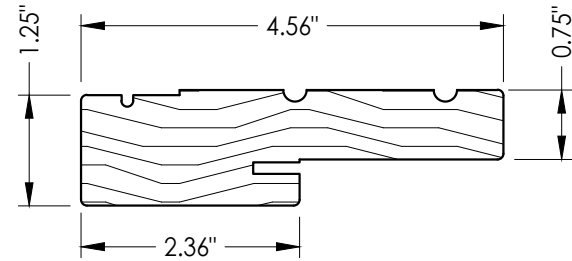


1 WOOD JAMB

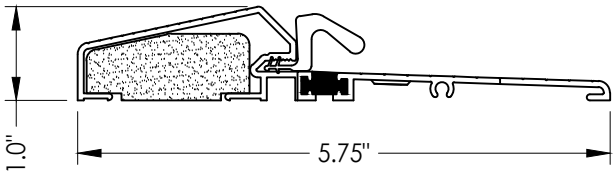


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

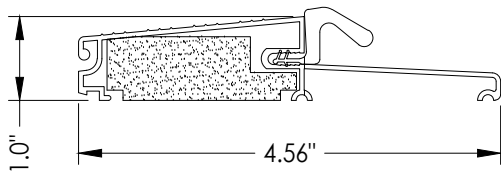


19 OUTSWING THRESHOLD
Composite Sill




10 SWEEP

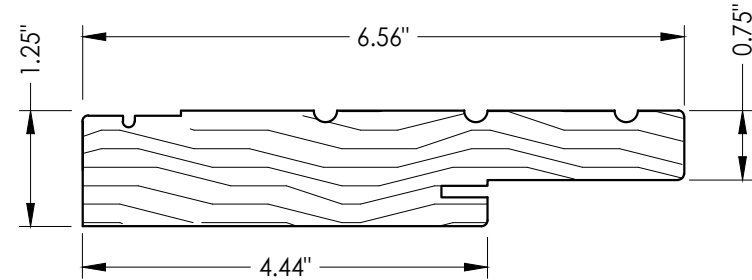


2 WOOD JAMB

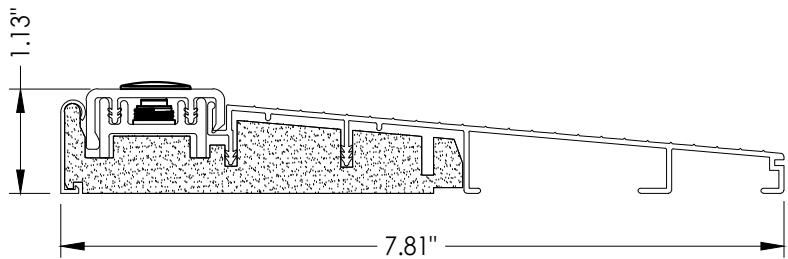


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

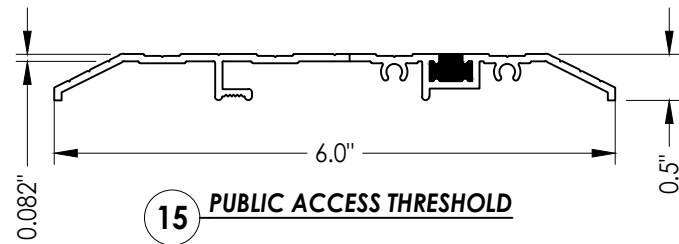


15 PUBLIC ACCESS THRESHOLD

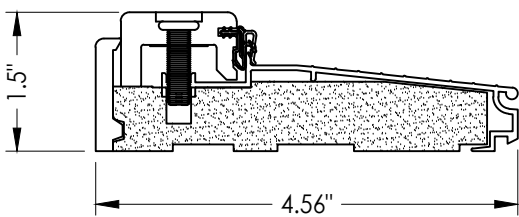


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

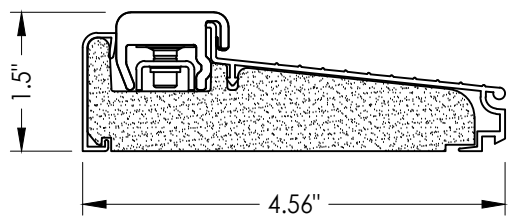


50 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

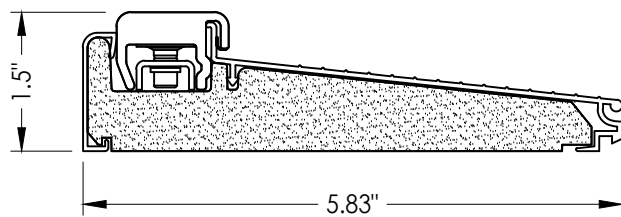


51 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

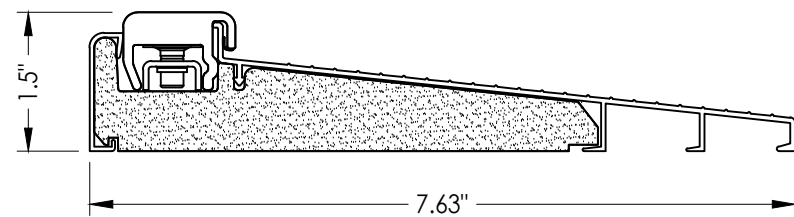


52 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

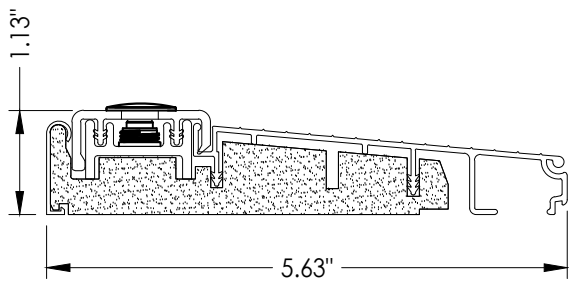


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

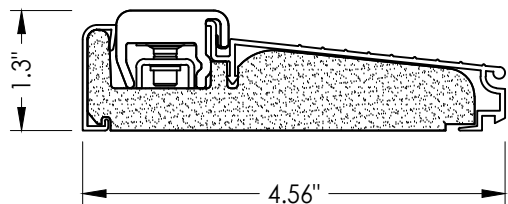

53 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

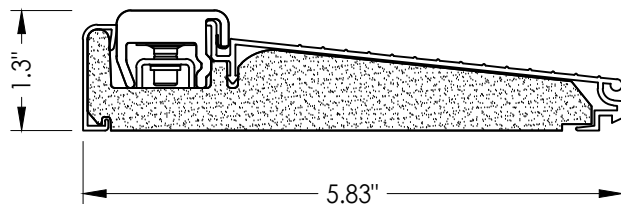

54 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

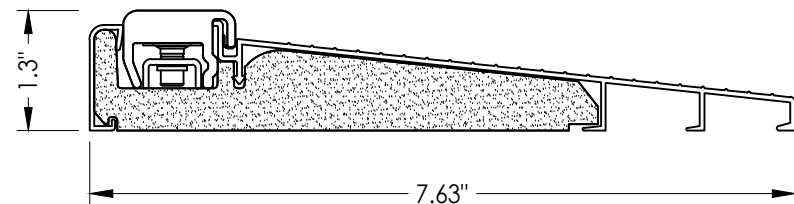

55 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
3	7/2/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/21/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/16/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 03/07/20

SCALE: N.T.S.

DWG. BY: TJ

CHK. BY: LFS

DRAWING NO.: FL-21135.12

SHEET 10 OF 11

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
26	#8 x 5/8" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE (STANDARD)	STEEL
28A	DEADBOLT SUB STRIKE PLATE	STEEL
28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
29	4" X 4" HINGE	STEEL
32	INSWING THRESHOLD	ALUM/COMP
38	INSWING THRESHOLD	ALUM/COMP
39	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL (BOOK)	-
41	DOOR PANEL (HYBRID)	-
42	DOOR PANEL (U1)	-
50	INSWING THRESHOLD	ALUM/COMP
51	INSWING THRESHOLD	ALUM/COMP
52	INSWING THRESHOLD	ALUM/COMP
53	INSWING THRESHOLD	ALUM/COMP
54	INSWING THRESHOLD	ALUM/COMP
55	INSWING THRESHOLD	ALUM/COMP

CONCRETE ANCHOR NOTES:
Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:
Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

© 2020 R.W. BUILDING CONSULTANTS INC.