




Fiber-Classic® & Smooth-Star®

WOOD EDGE
OPAQUE FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"IMPACT" DOOR w/ "NON-IMPACT" SIDELITES

GENERAL NOTES

1. This product evaluation drawing has been developed in compliance with the 8th Edition (2023) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with FBC Section 1626 and does not require an impact resistant covering. The non-impact sidelite(s) must be protected with an impact resistant covering complying with FBC Section 1626.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1. The non-impact sidelite(s) must be protected with an impact resistant covering complying with FBC Sections 1609.1.2 & R301.2.1.2.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors and all sills used under sidelites meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
8. Fiber-Classic & Smooth-Star Sidelite panels require the use of "J" part numbers and must be stained or painted within six months of installation.


TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes	8	Vertical Cross Sections (Thresholds)
2	Door Panel Details	9	Buck Anchoring
3	Sidelite Panel Details	10	Frame Anchoring
4	Elevations	11	Hardware Details
5	Horizontal & Vertical Cross Sections (2X Buck)	12	Glazing Details
6	Horizontal & Vertical Cross Sections (1X Buck)	13	Components
7	Horizontal & Vertical Cross Sections (Direct to Masonry)	14	Bill of Materials

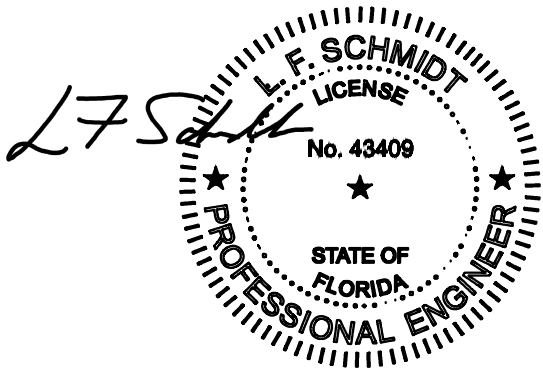

Digitally signed by Lyndon F Schmidt
Date: 2023.08.18 14:05:16 -04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

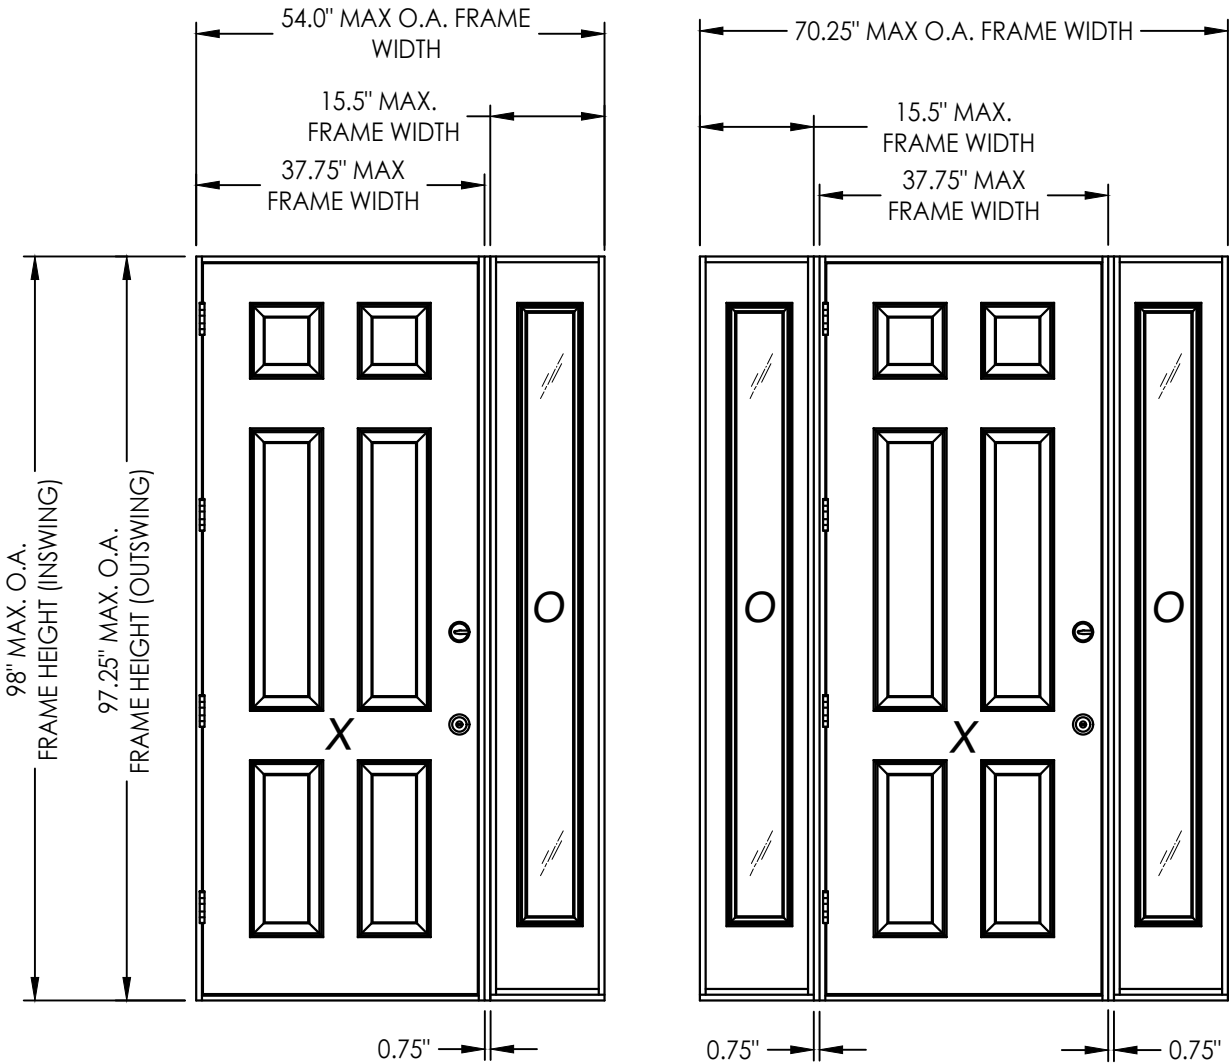

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XO, OX, OXO	+65.0	-65.0	+65.0	-65.0

See Sheet 4 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21142.15

SHEET 1 OF 14

Part or Assembly:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

REVISIONS




2 8/18/23 UPDATE TO 8TH ED. (2023) FBC

1 7/15/20 UPDATE TO 7th ED (2020) FBC





NO. DATE

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

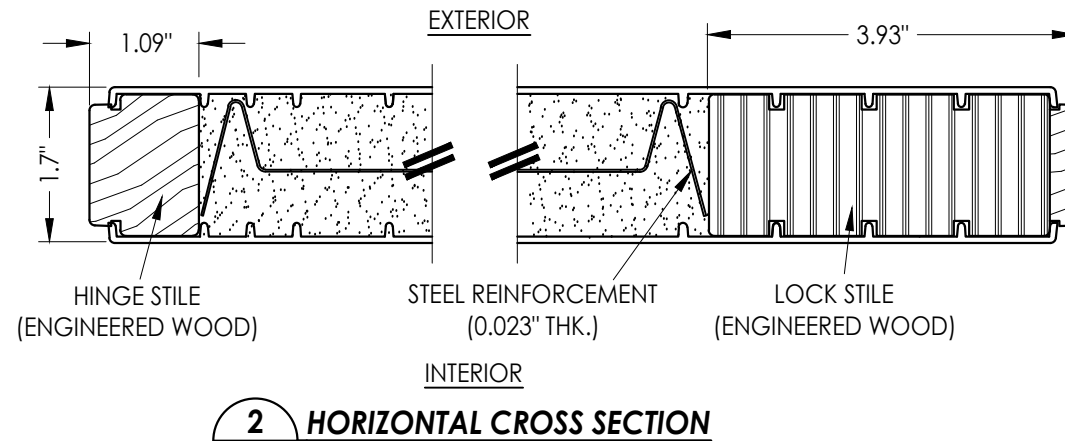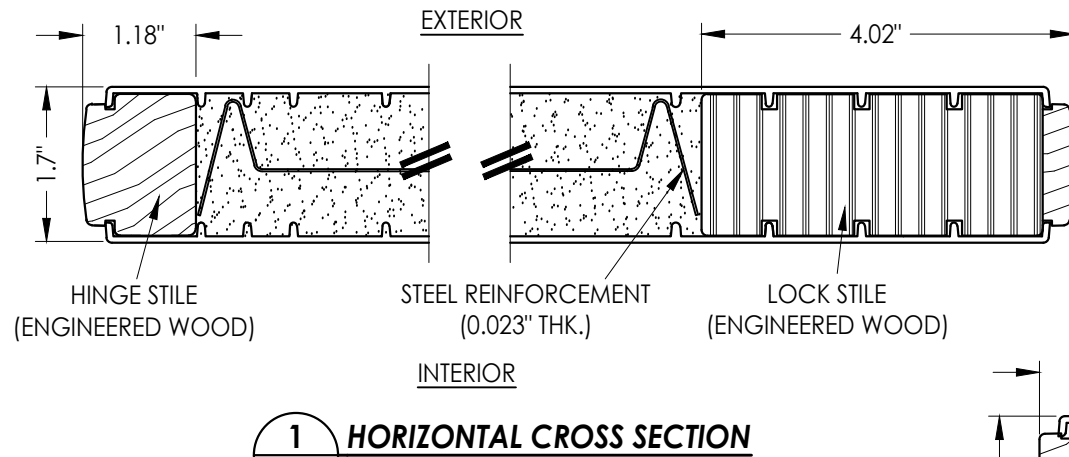
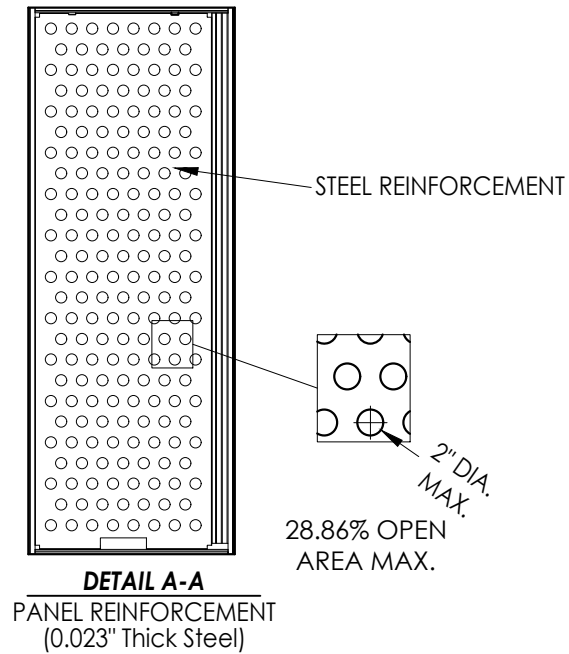


* #8 X 2.5\"

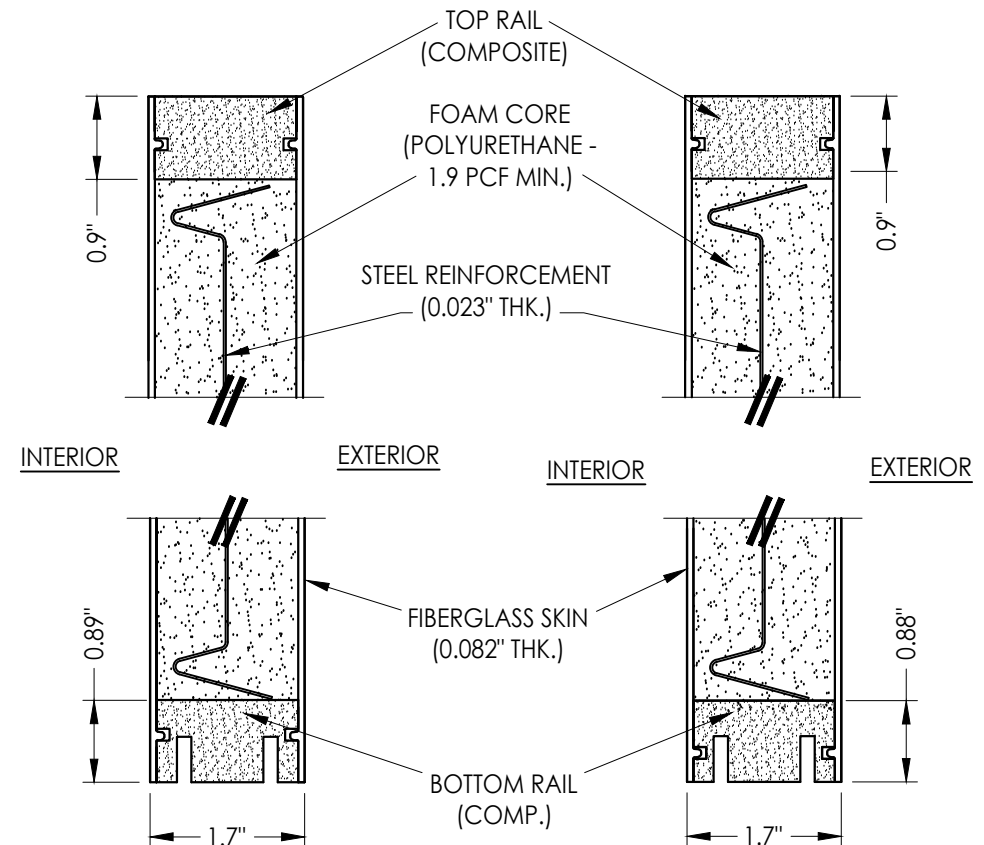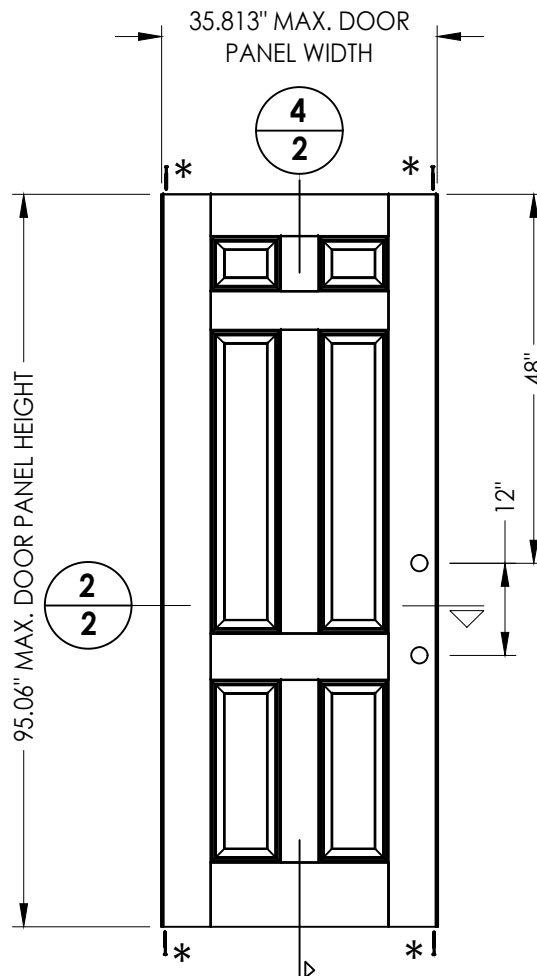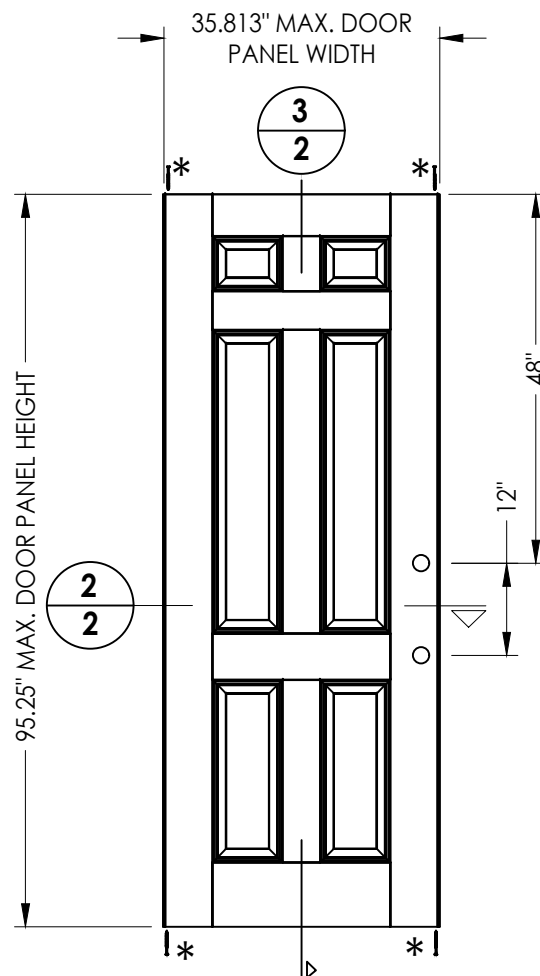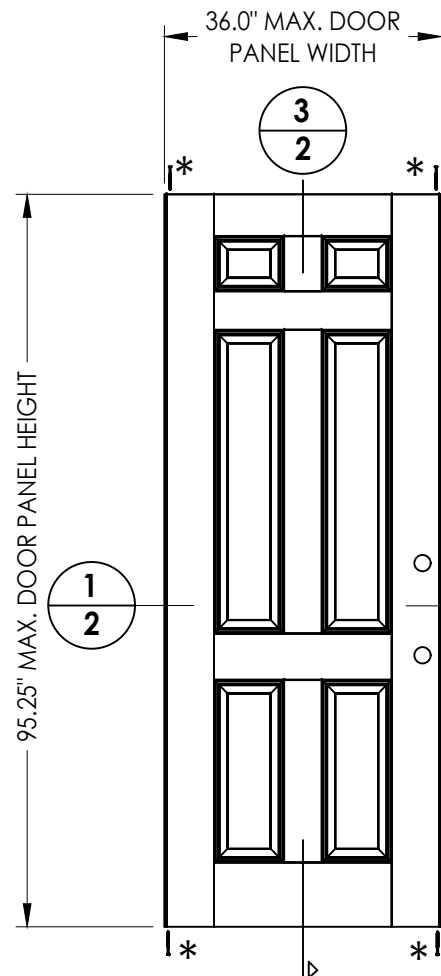


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		 BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR			
PART OR ASSEMBLY: DOOR PANEL DETAILS			
		LFS	
		PO	
		BY	
		REVISIONS	

G:\2023 FBC Drawings\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

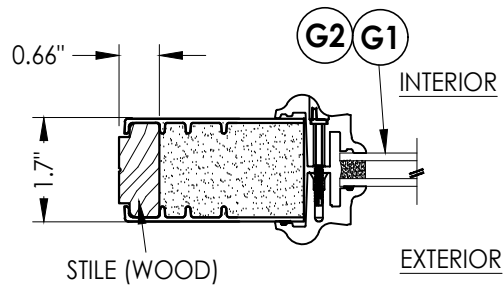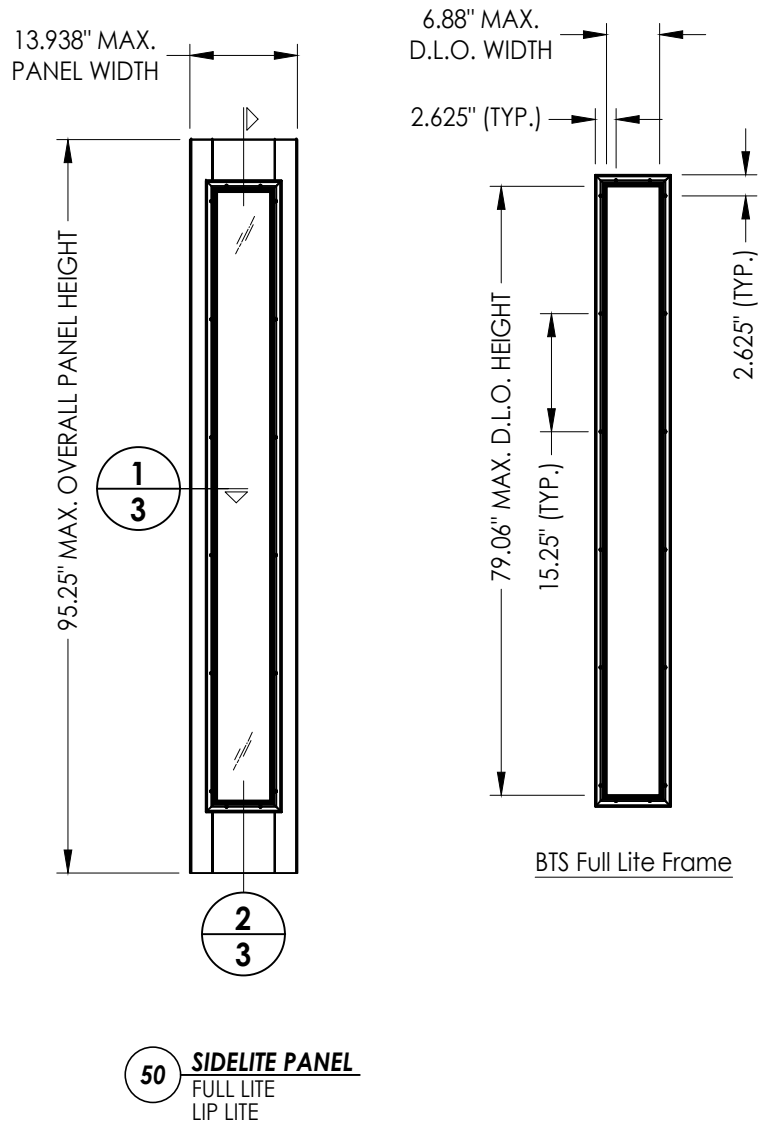

1
3 HORIZONTAL CROSS SECTION
Lip Lite Glazing

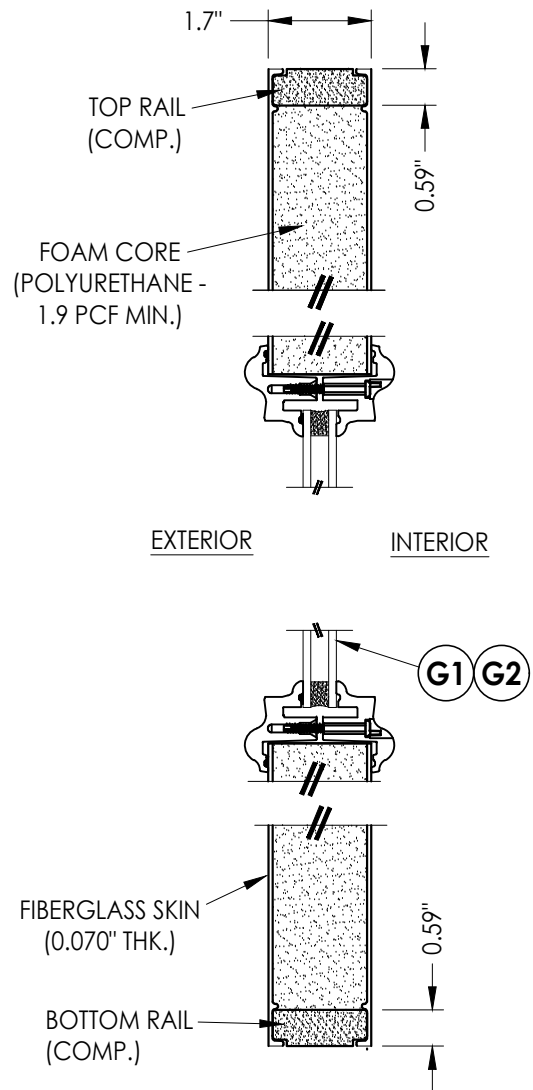

2
3 VERTICAL CROSS SECTION
Lip Lite Glazing


PRODUCT: THERMA-TRU FIBERGLASS DOOR				PART OR ASSEMBLY: SIDELITE PANEL DETAILS			
				LFS	FBC		
				PO	FBC		
				NO.	DATE		
				REVISIONS			
				2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC
				1	7/15/20	UPDATE TO 7th ED (2020)	FBC
DATE: 12/22/16							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-21142.15							
SHEET 3 OF 14							

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


© 2016 R.W. BUILDING CONSULTANTS INC.

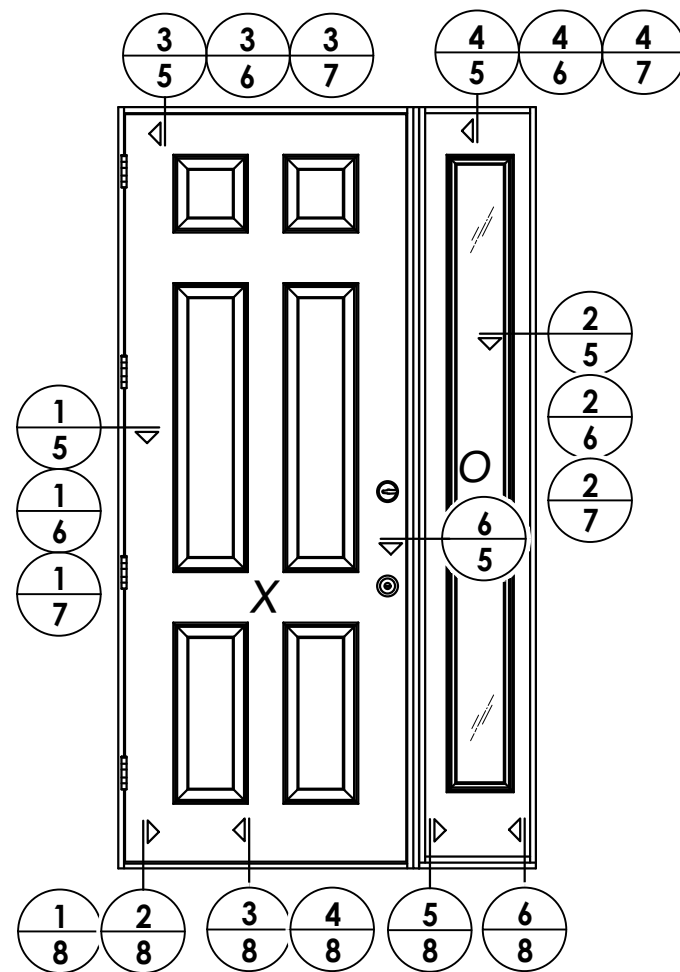

ELEVATION
XO

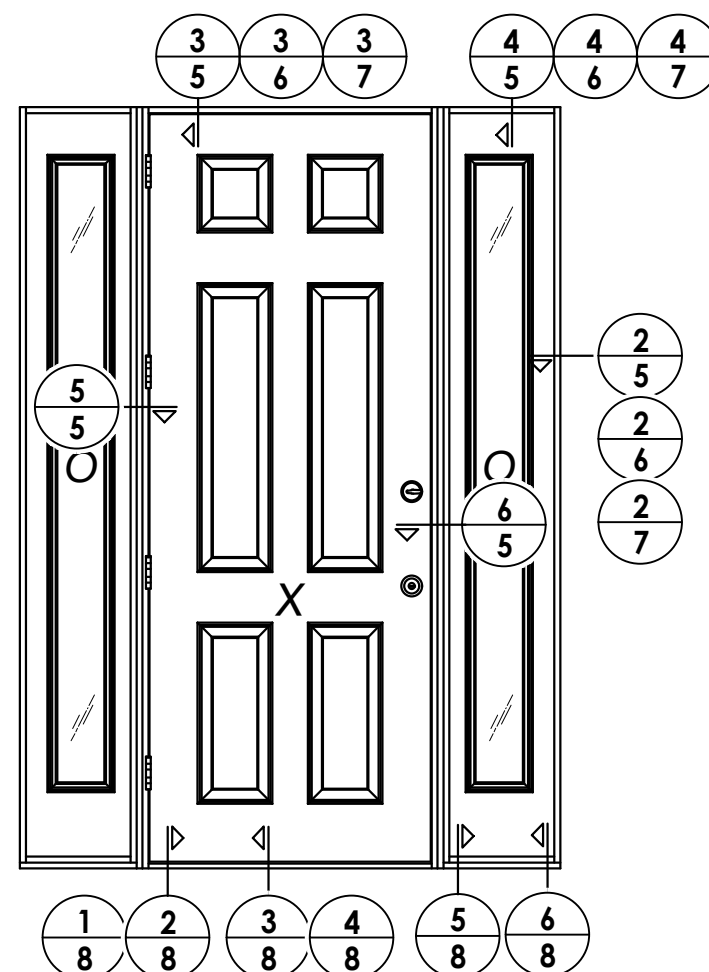

ELEVATION
OXO

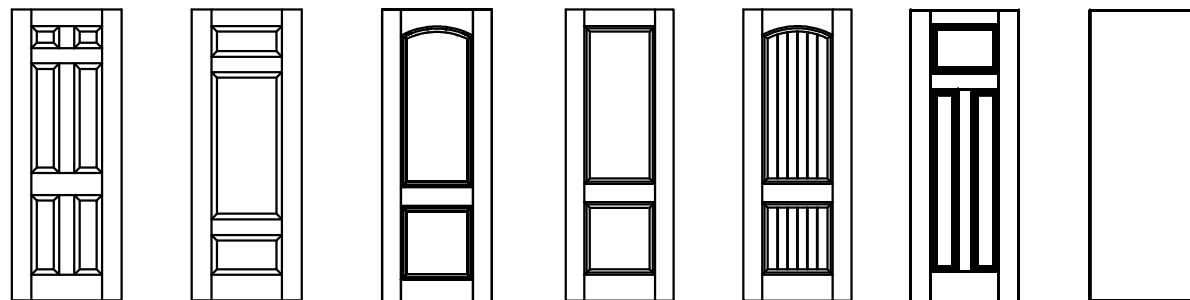

Fiber-Classic/Smooth-Star Door Panel Options

Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

HARDWARE TABLE	
MANUFACTURER	MODEL
SCHLAGE	KNOB: F51 DEADBOLT: B60
KWIKSET	KNOB: SIGNATURE SERIES DEADBOLT: SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGART (3 pt. Manual Tongue)


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2016 R.W. BUILDING CONSULTANTS INC.


G:\2023 FBC DRAWINGS\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

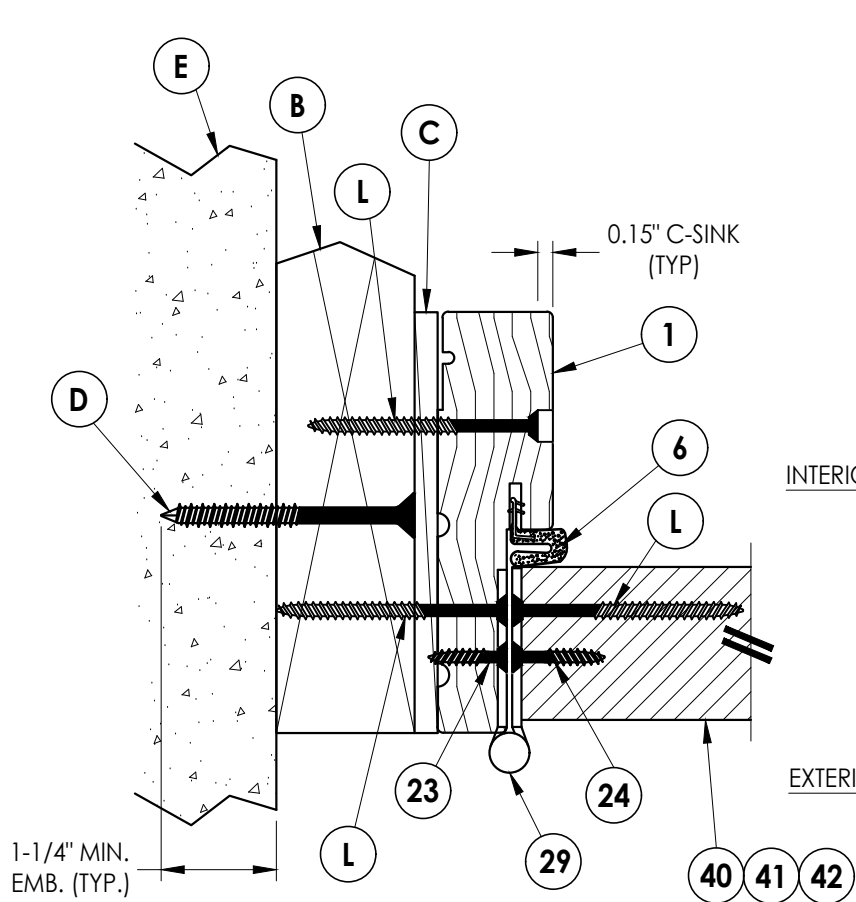


1 HORIZONTAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

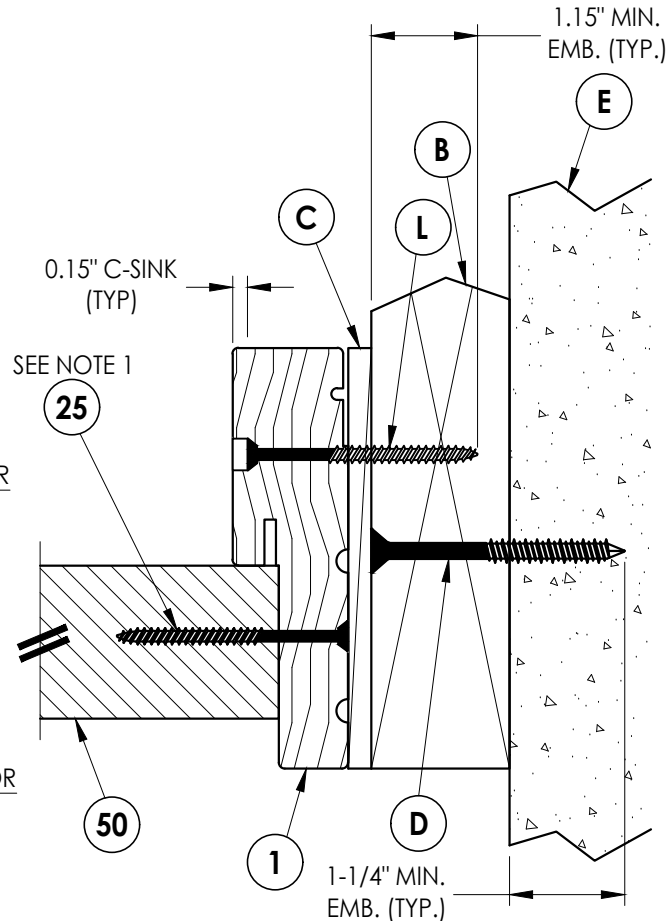


2 HORIZONTAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

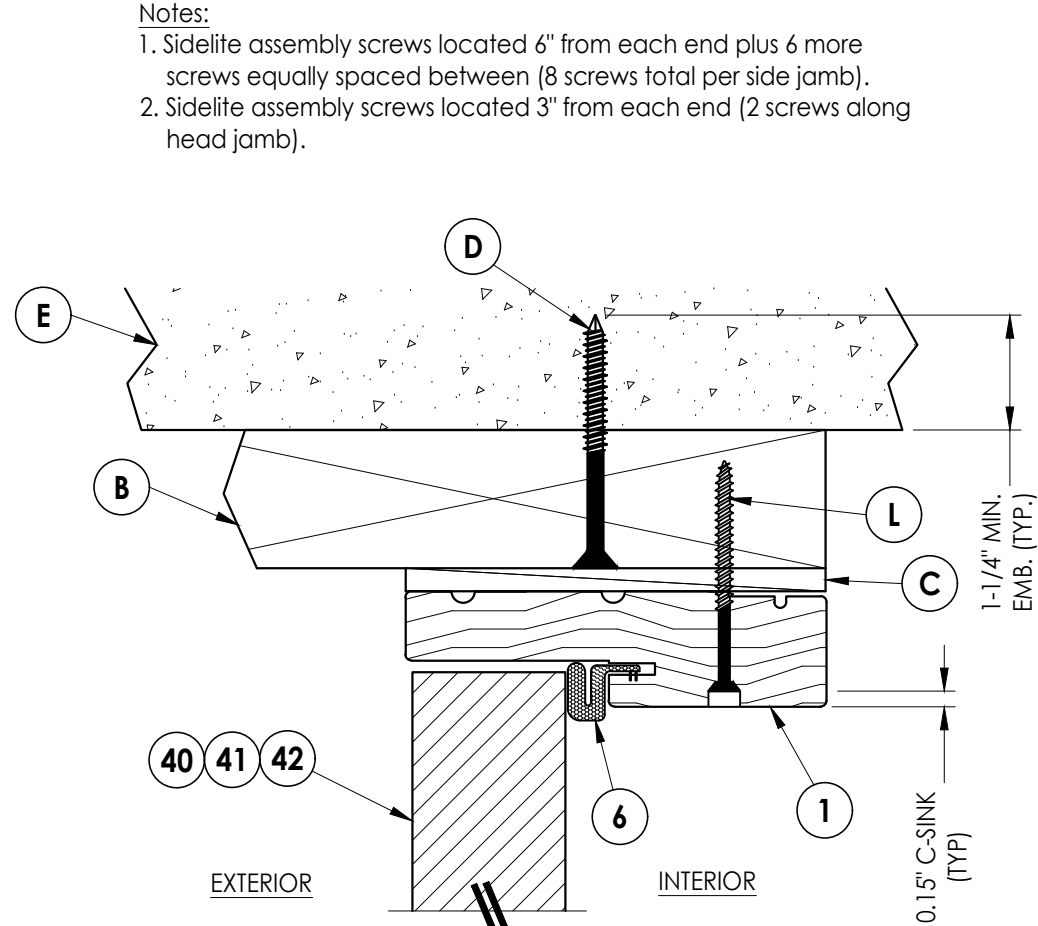


3 VERTICAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

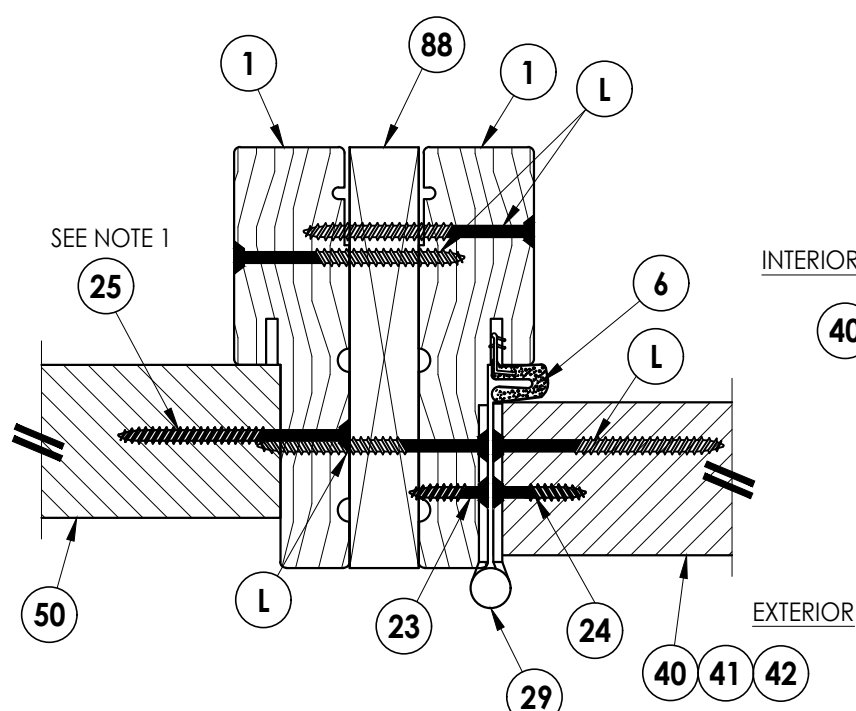

5 HORIZONTAL CROSS SECTION
5 Outswing shown (Inswing similar)

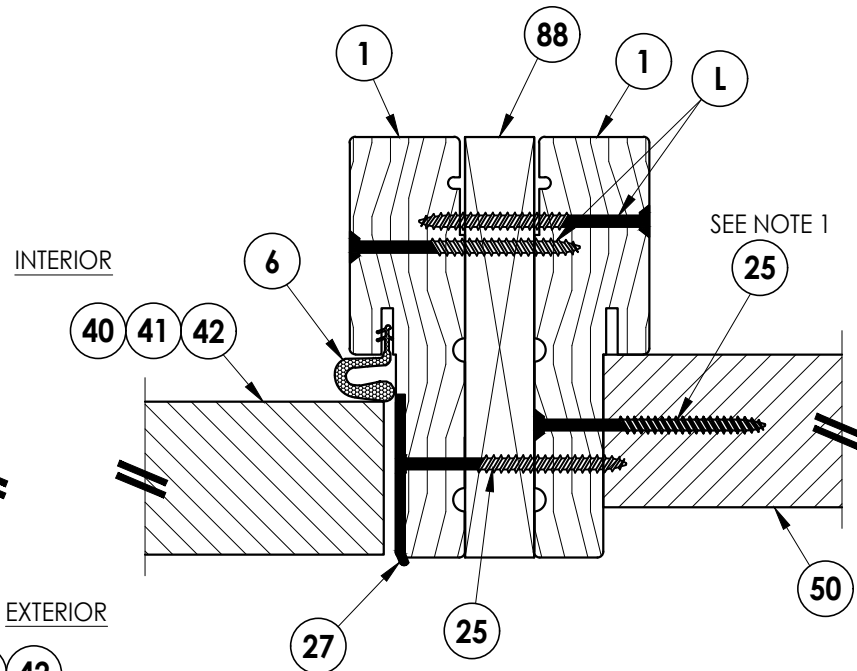

6 HORIZONTAL CROSS SECTION
5 Outswing shown (Inswing similar)

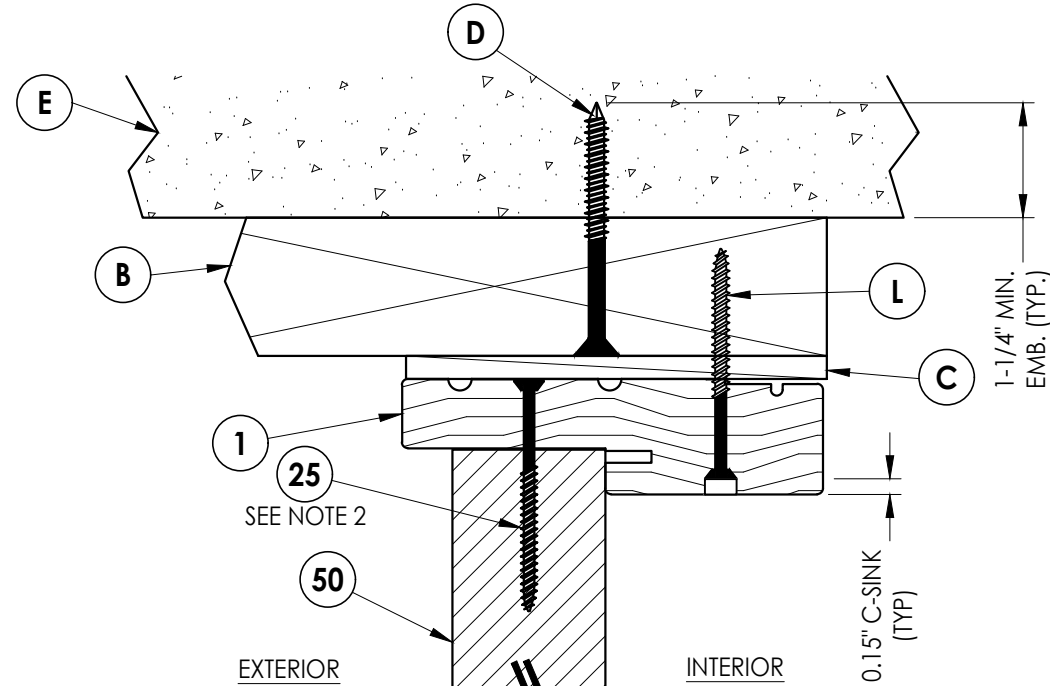

4 VERTICAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

Notes:

1. Sidelite assembly screws located 6" from each end plus 6 more screws equally spaced between (8 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC
1	7/15/20	UPDATE TO 7th ED (2020) FBC

DATE: 12/22/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-21142.15

SHEET 5 OF 14


- Notes:
1. Sidelite assembly screws located 6" from each end plus 6 more screws equally spaced between (8 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

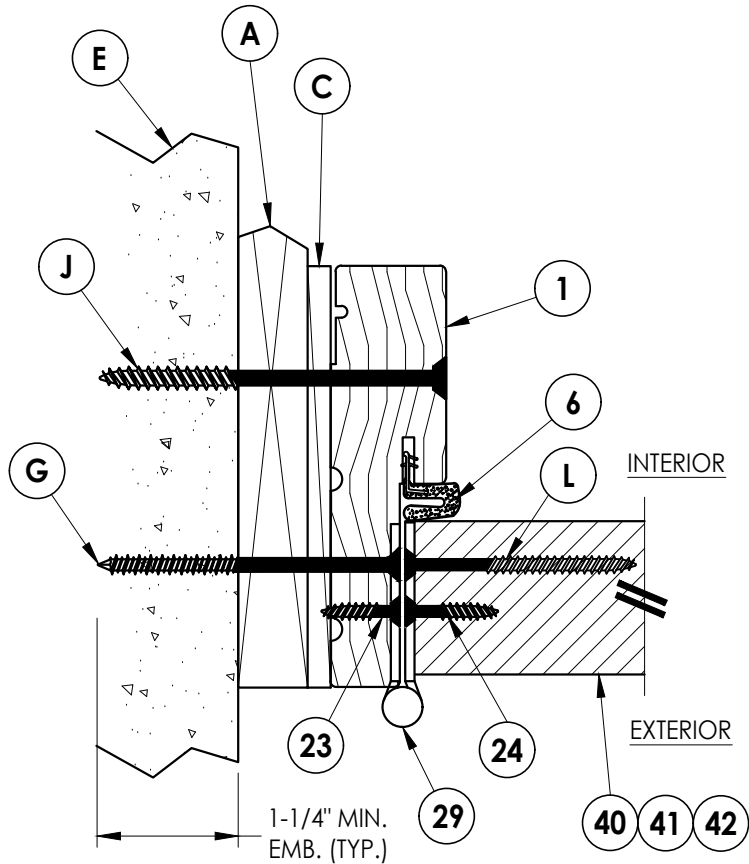


1
6 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

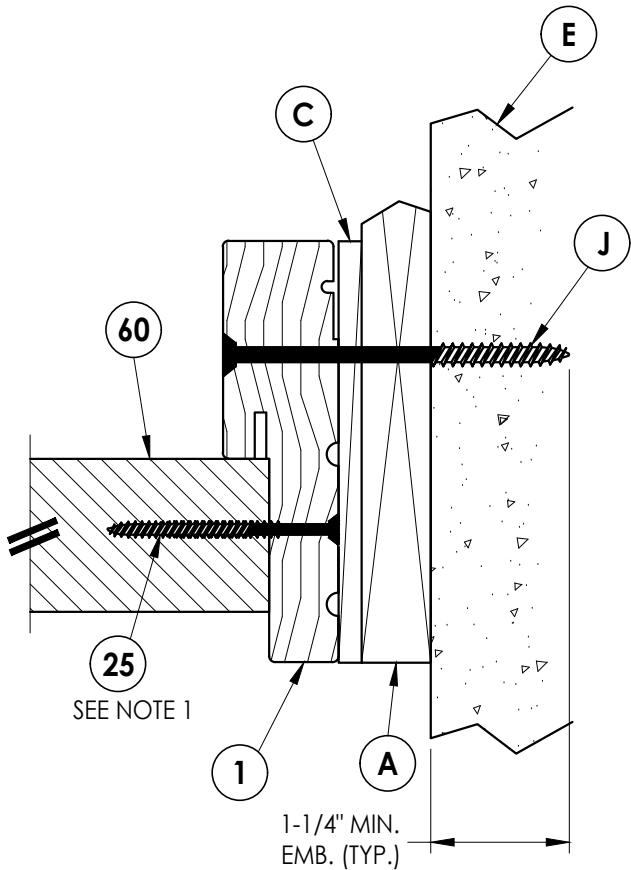

2
6 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

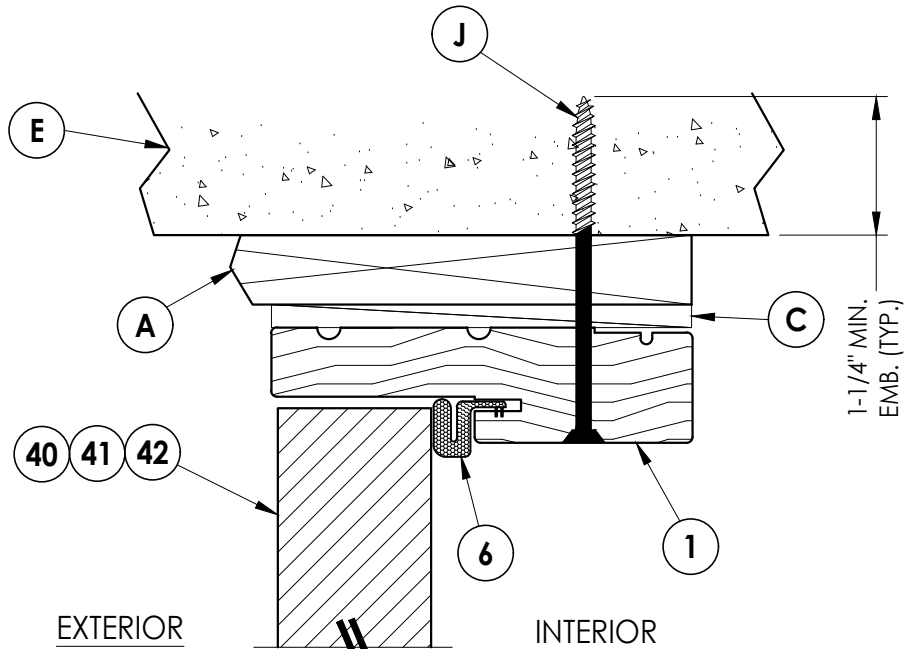

3
6 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

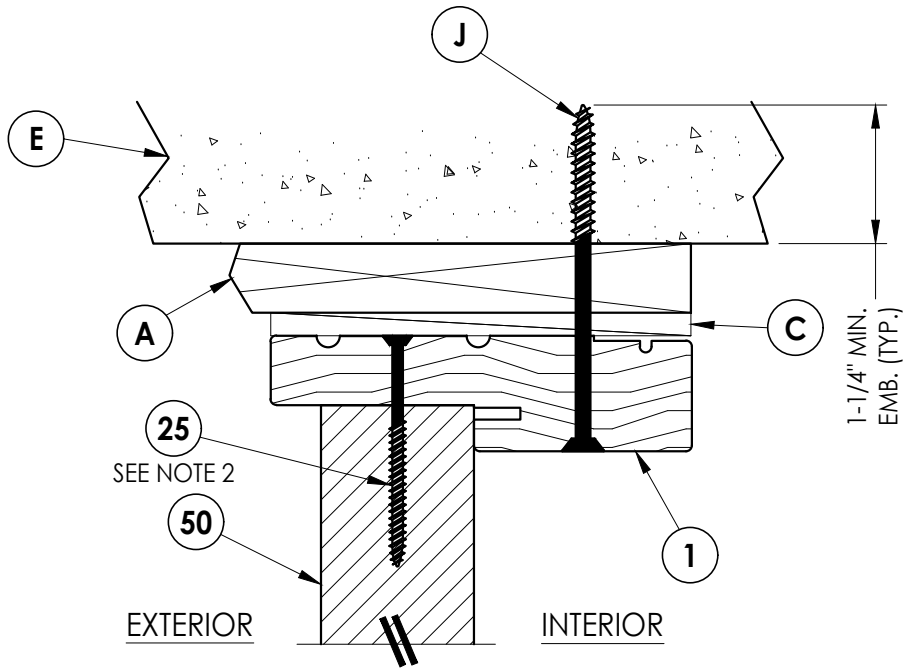

4
6 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

REVISIONS		NO.	DATE	BY
2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC	PO

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-21142.15

SHEET 6 OF 14

G:\2023 FBC DRAWINGS\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

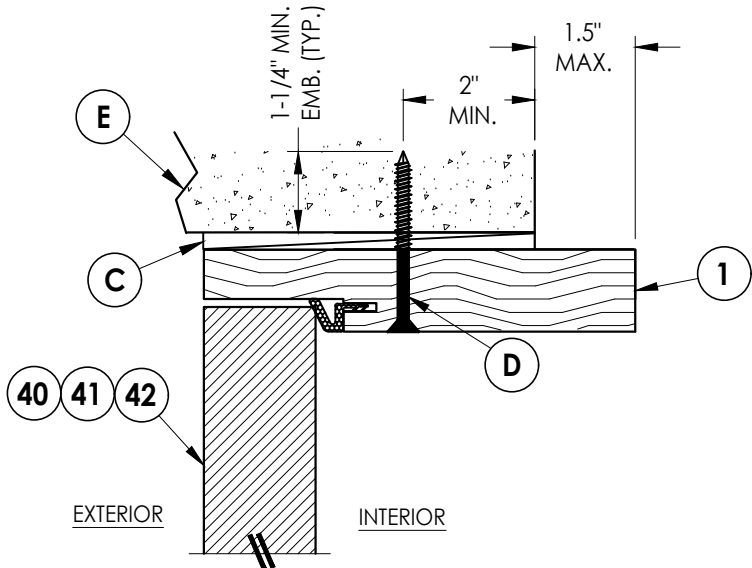


3 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

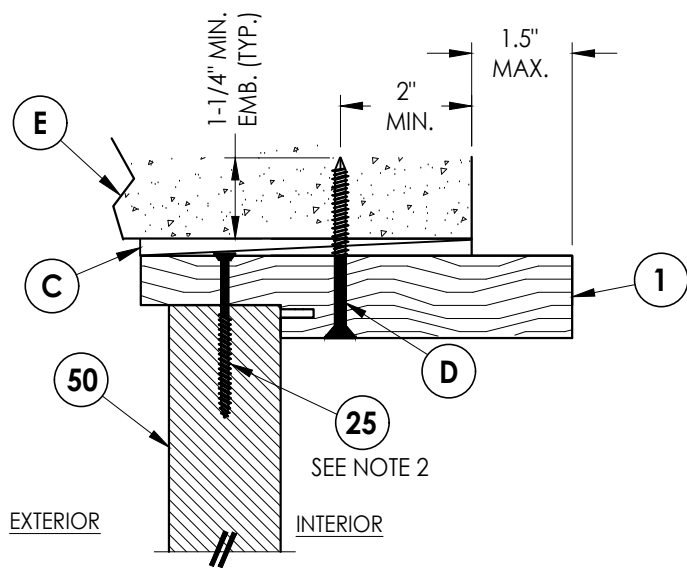


4 **VERTICAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

- Notes:
1. Sidelite assembly screws located 6" from each end plus 6 more screws equally spaced between (8 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

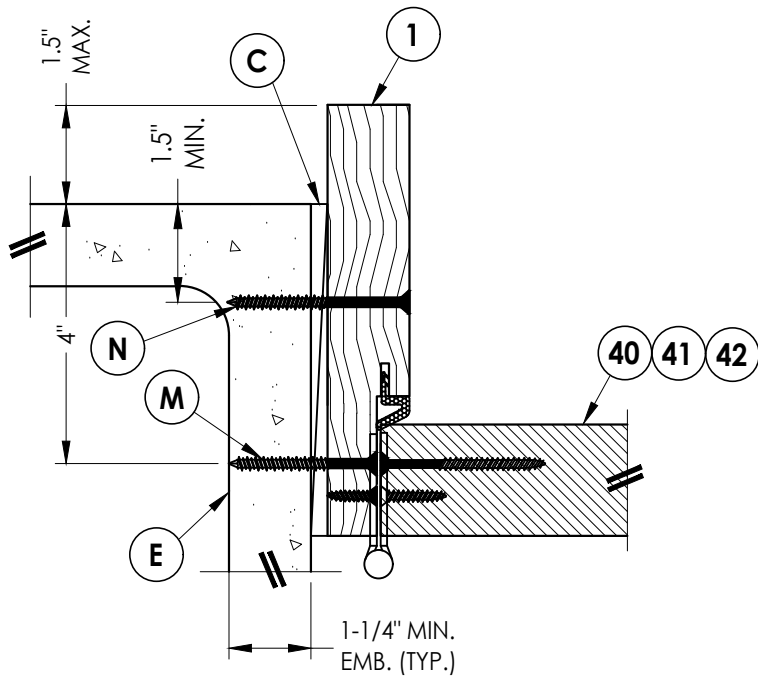

1 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

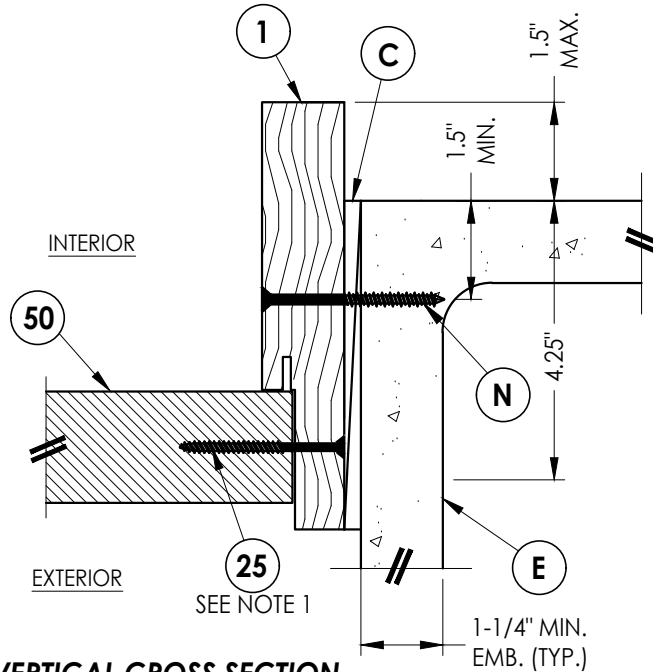

2 **VERTICAL CROSS SECTION**
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR







PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC
1	7/15/20	UPDATE TO 7th ED (2020) FBC

DATE: 12/22/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21142.15
SHEET 7 OF 14

G:\2023 FBC DRAWINGS\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

- Notes:
1. Sill Item #'s 17, 18, 19, 32, 34, 35, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pph screws at each end.
Sill Item #'s 16 & 33 are attached to jambs w/ (2) #8 X 2-1/2" pph screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
2. Sidelite assembly screws located 4" from each end (2 screws along sill).

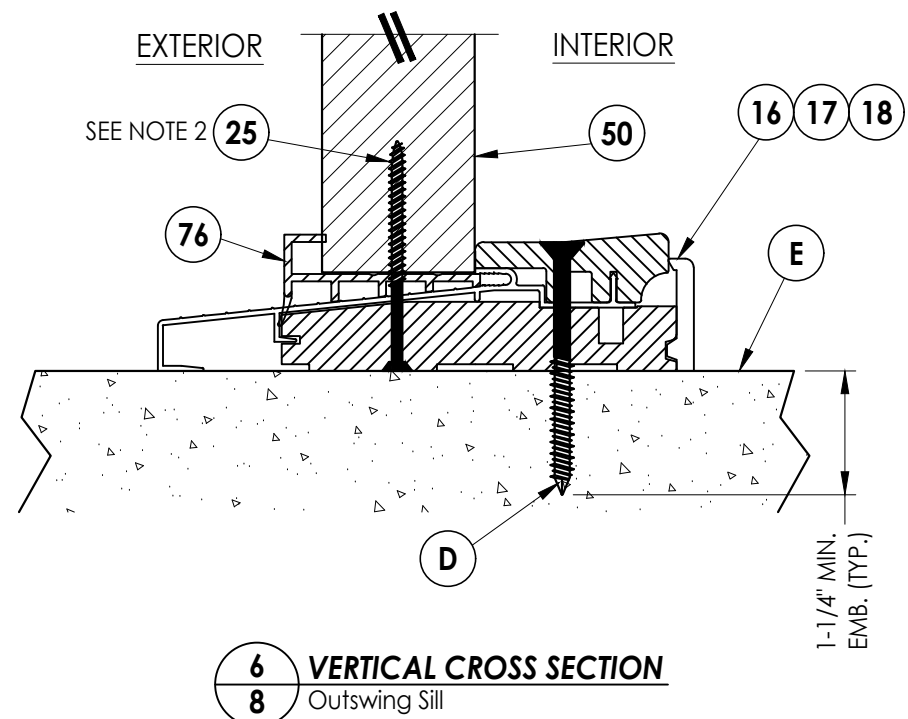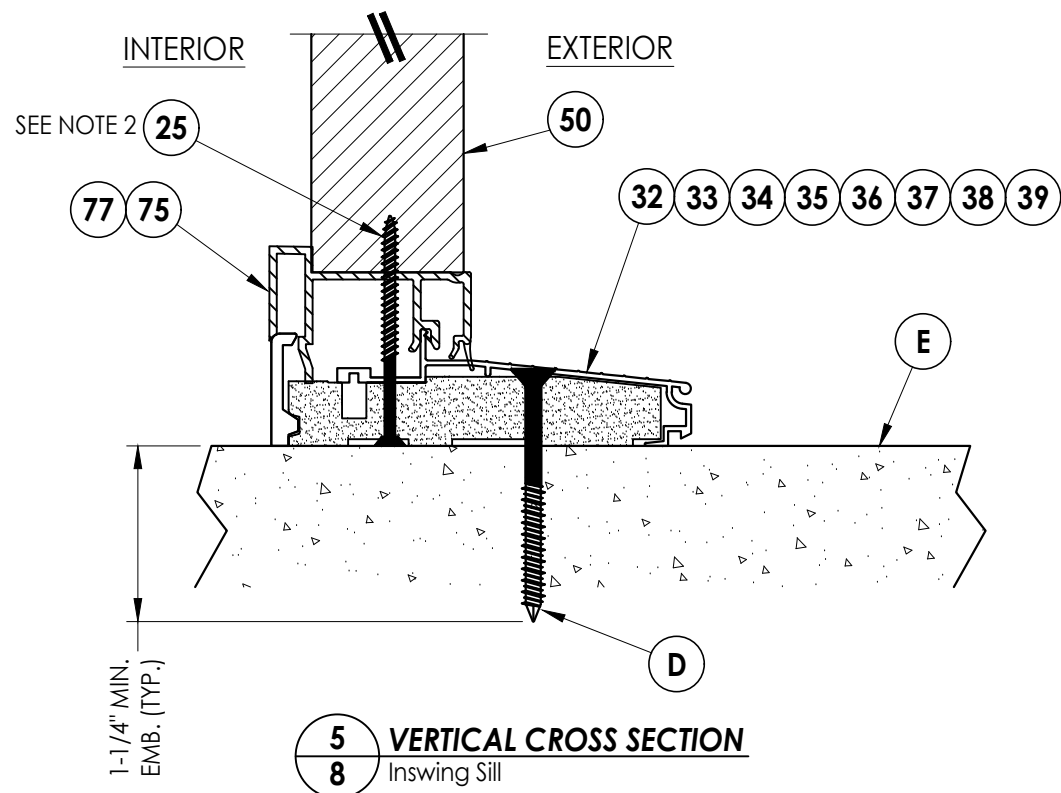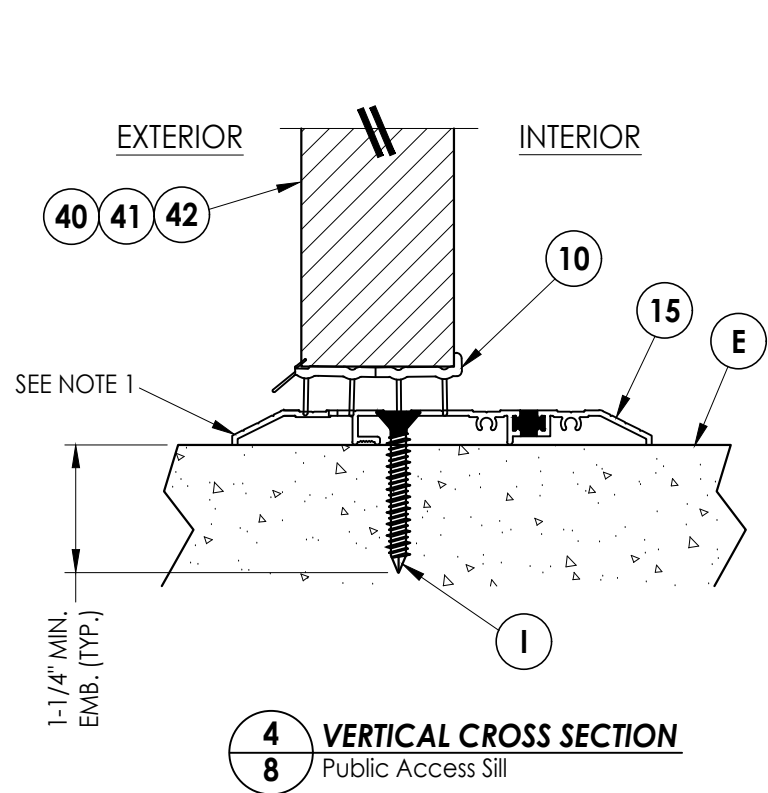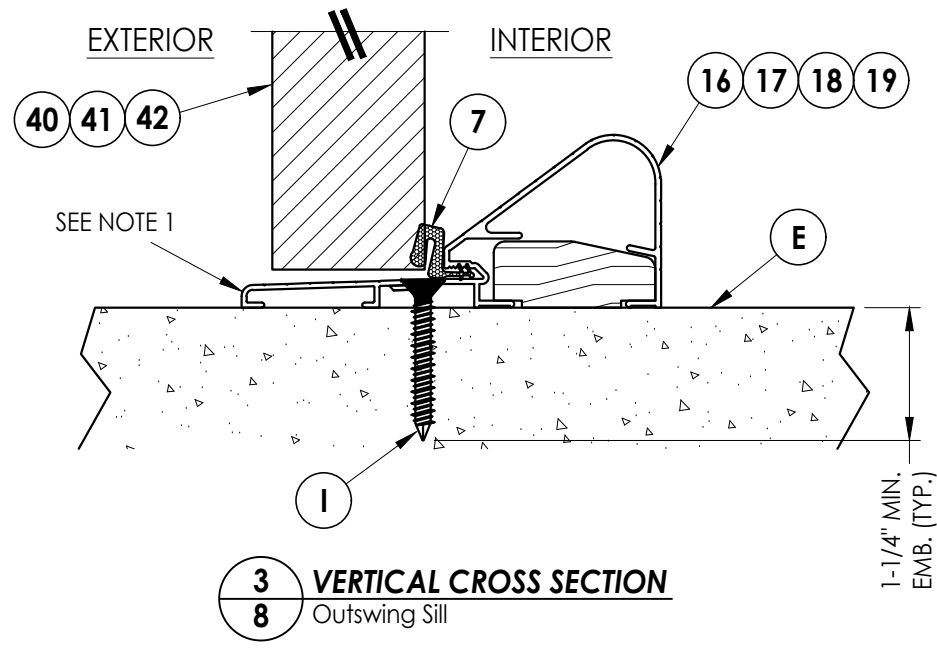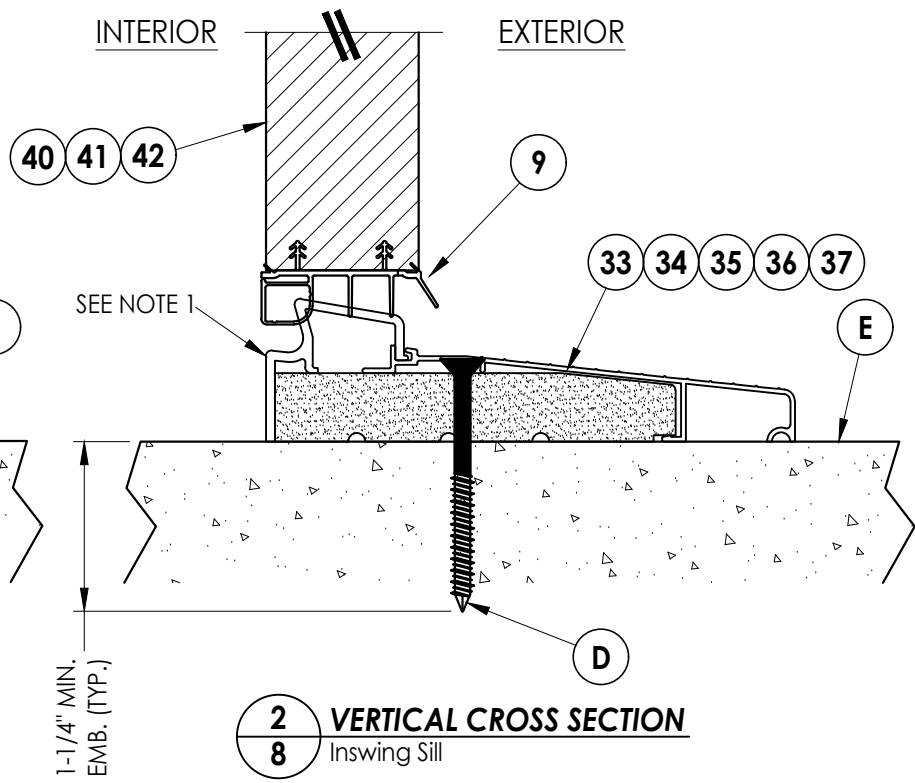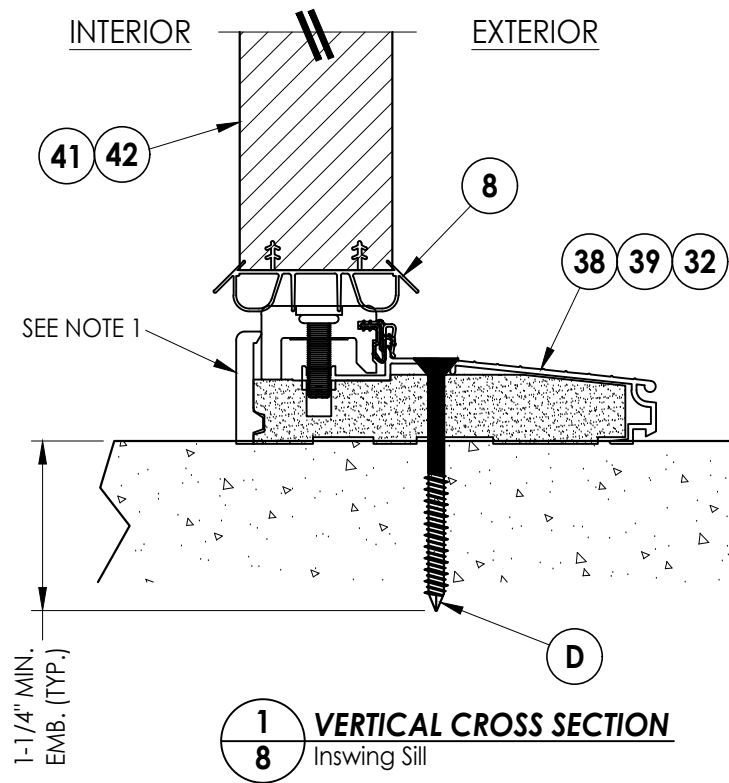

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC
1	7/15/20	UPDATE TO 7th ED (2020) FBC

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21142.15

SHEET 8 OF 14


Technical drawing of a window frame assembly. The drawing shows a cross-section of the window frame and its connection to the surrounding structure. Key components and dimensions include:

- Window Frame:** The main structure of the window, shown in a cross-section.
- Head & Jambs (TYP.):** The top and side frames of the window.
- 2X BUCK (TYP.):** A structural member supporting the window frame.
- MASONRY (TYP.):** The surrounding wall structure.
- Dimensions:**
 - 4" (TYP.): Dimension for the top of the head frame.
 - 8" (TYP.): Dimension for the top of the jamb frame.
 - 4" (TYP.): Dimension for the side of the jamb frame.
 - 23" MAX. O.C. (TYP.): Maximum on-center spacing for the masonry.
- Labels:**
 - D:** A circular callout pointing to the head and jamb frames.
 - OXO:** A label at the bottom of the drawing.


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^gW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

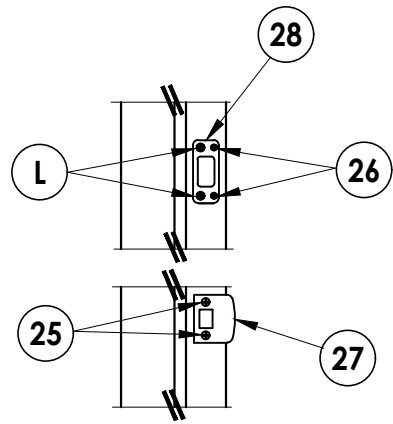


LATCH & DEADBOLT DETAIL

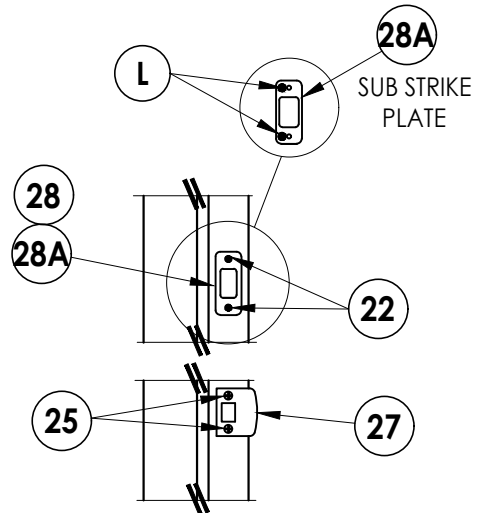


LATCH & DEADBOLT DETAIL
Schlage


LATCH & DEADBOLT STRIKE DETAILS

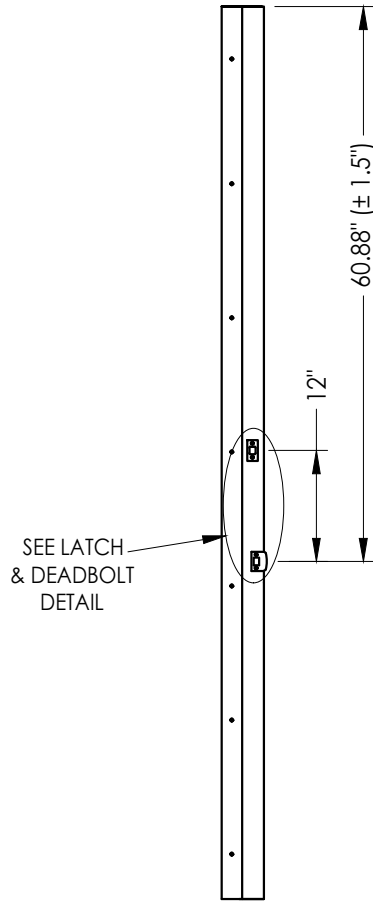


STRIKE JAMB
Latch and Deadbolt

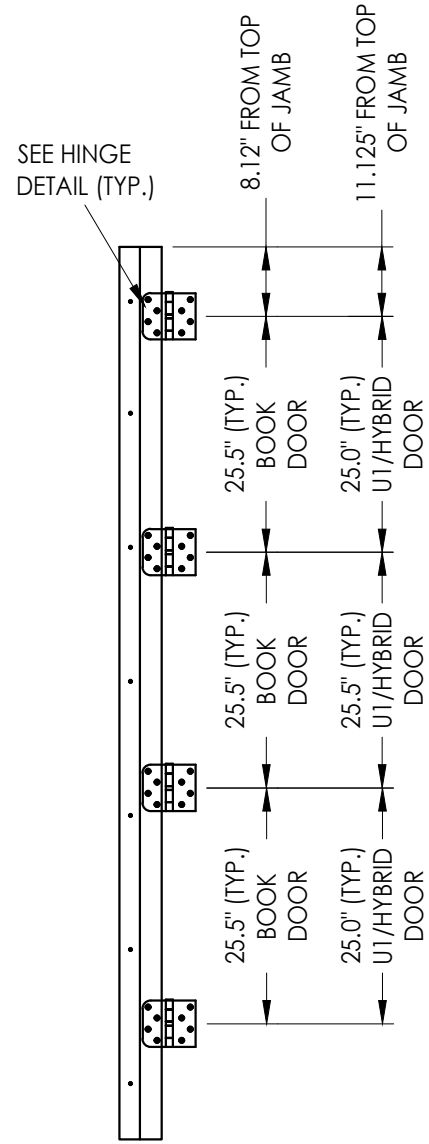


HINGE JAMB

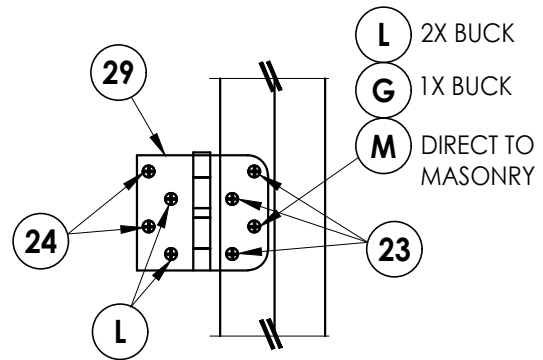


HINGE DETAIL

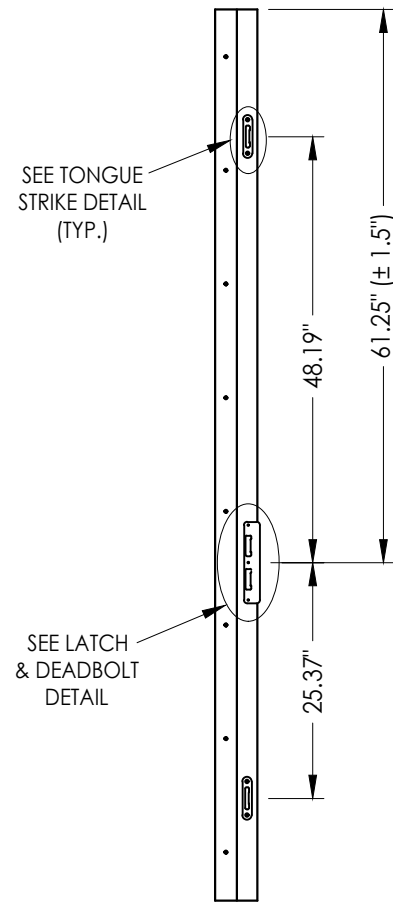

STRIKE JAMB
Multipoint Lock



TONGUE STRIKE DETAIL
Multipoint Lock

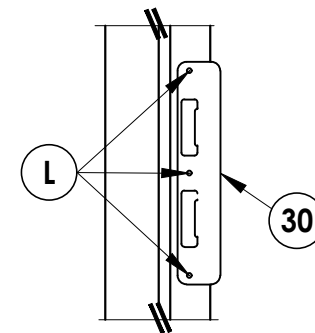

LATCH & DEADBOLT DETAIL
Multipoint Lock







MULTIPOINT LOCK STRIKE DETAILS

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

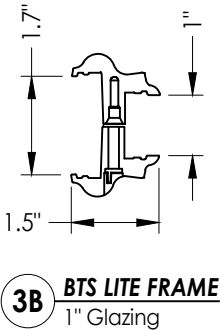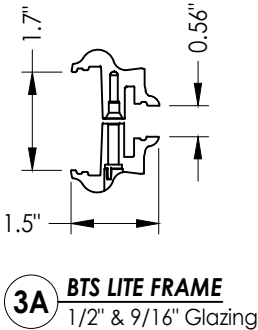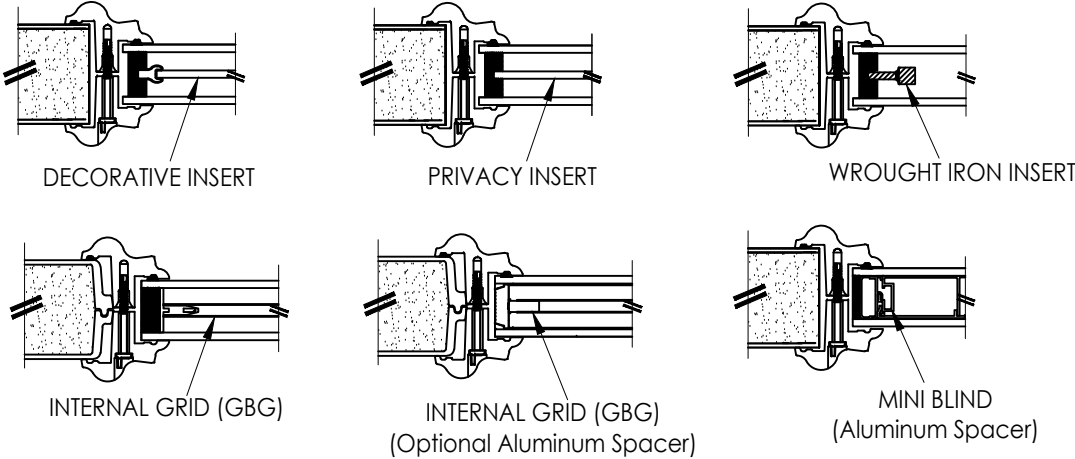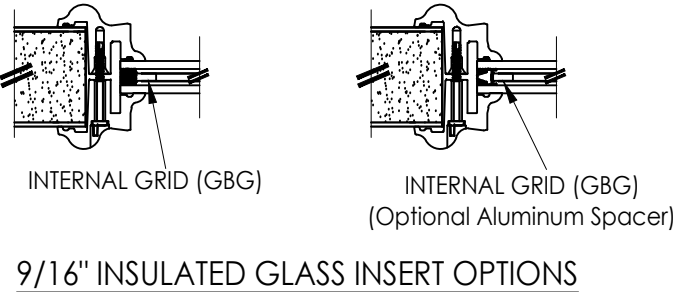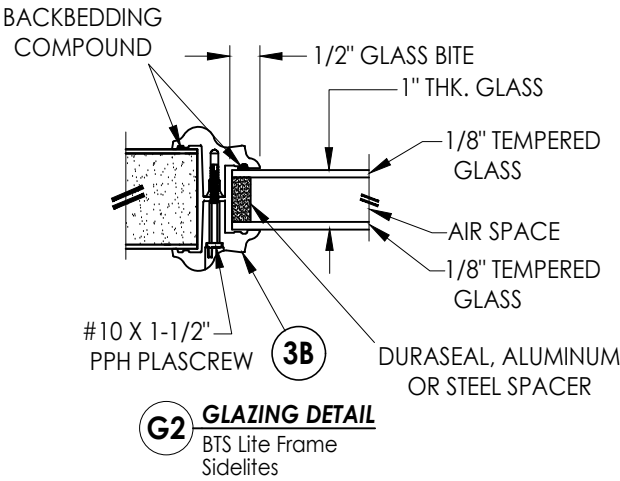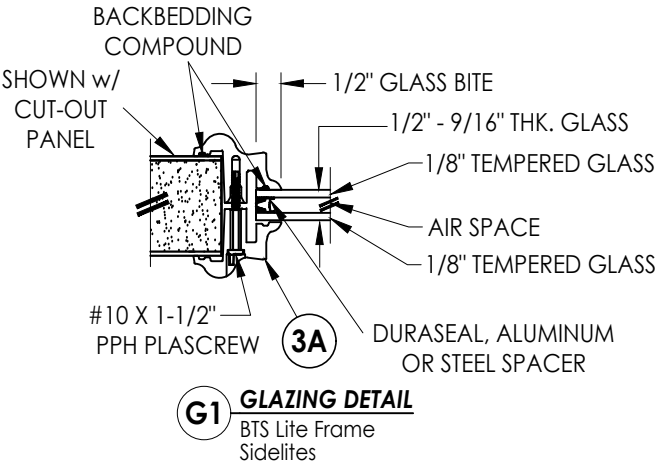

DATE: 12/22/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21142.15
SHEET 12 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


R.W. BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:
GLAZING DETAILS

NO.	DATE	REVISIONS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC
1	7/15/20	UPDATE TO 7th ED (2020) FBC


G:\2023 FBC DRAWINGS\Therma-Tru\FL-21142 R3\FL-21142.13-16.dwg

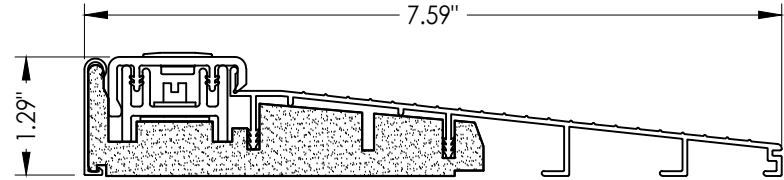


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

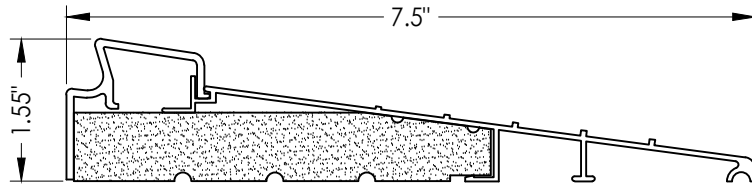


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

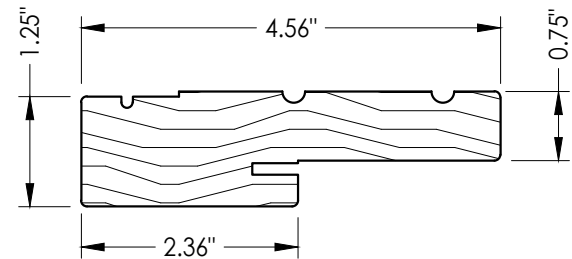


1 WOOD JAMB

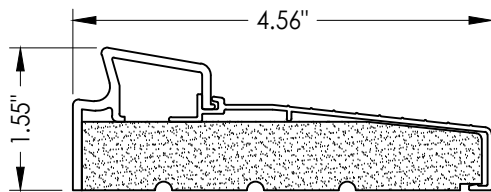


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

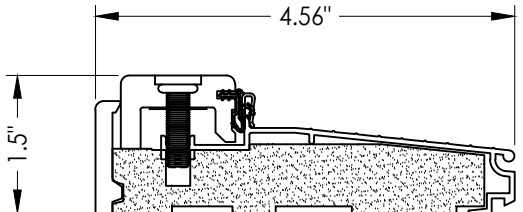


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

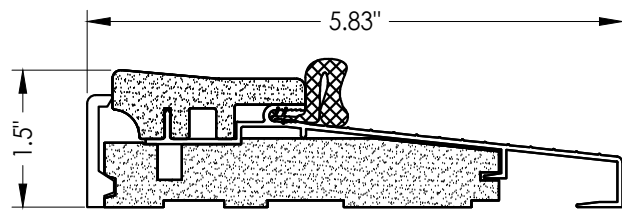


16 OUTSWING THRESHOLD
Composite Sill

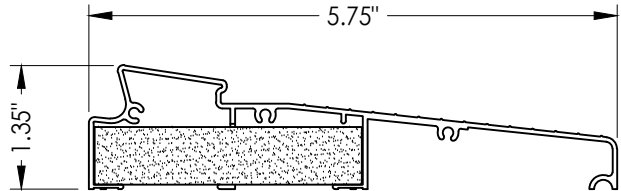


34 INSWING THRESHOLD
Inswing Moderate Climate Sill 1-3/8"

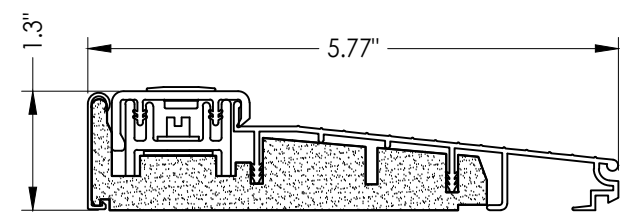


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

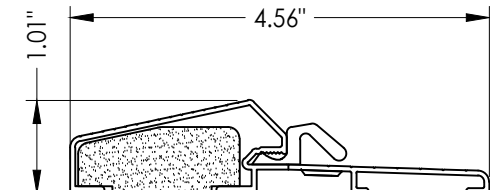


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

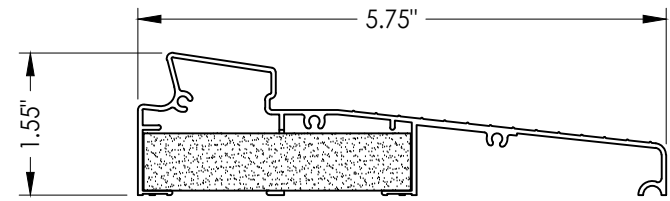


35 INSWING THRESHOLD
Inswing Moderate Climate Sill

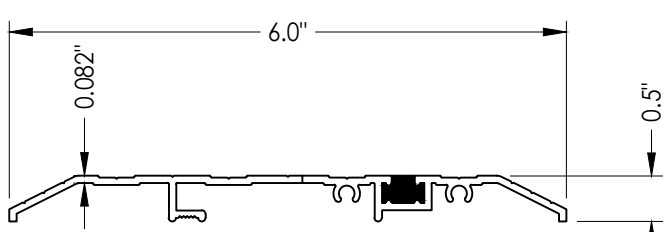


15 PUBLIC ACCESS THRESHOLD

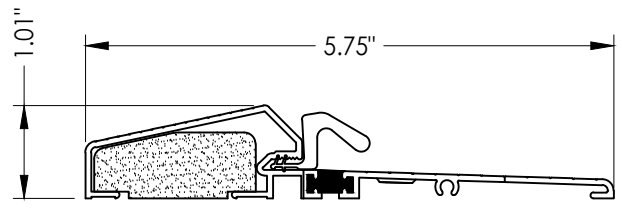


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

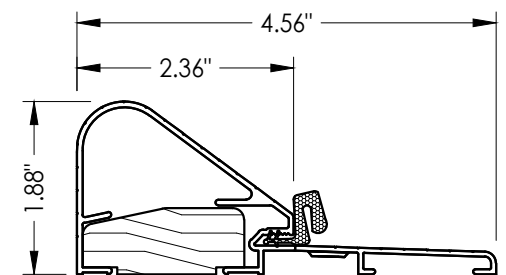


19 COASTAL OUTSWING THRESHOLD
Wood / Aluminum Sill

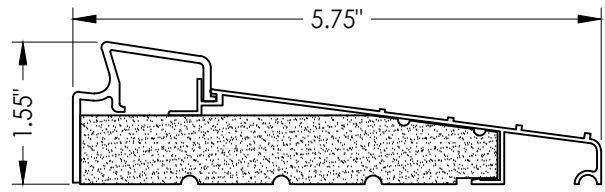


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill




8 SWEEP




9 SWEEP




10 SWEEP

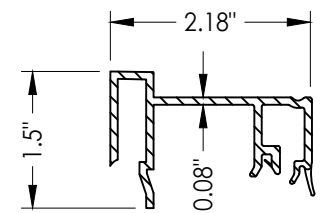

75 SIDELITE SPACER
Inswing



76 SIDELITE SPACER
Outswing

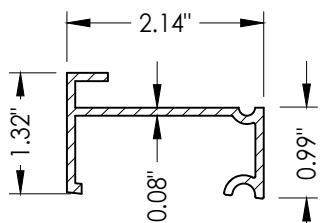

77 SIDELITE SPACER
Inswing
Moderate Climate Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC
1	7/15/20	UPDATE TO 7th ED (2020) FBC

DATE:	12/22/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21142.15
SHEET	13 OF 14

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			29	4" X 4" HINGE	STEEL
F	#10 X 2" PFH WOOD SCREW	STEEL	30	LATCH & DEADBOLT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	31	MULTIPOINT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	34	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	35	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	36	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	37	INSWING THRESHOLD	ALUM/COMP
7	WEATHERSTRIP (LONG REACH)	FOAM	38	INSWING THRESHOLD	ALUM/COMP
8	SWEEP	VINYL	39	INSWING THRESHOLD	ALUM/COMP
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	40	DOOR PANEL (BOOK)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	41	DOOR PANEL (HYBRID)	-
15	ADA THRESHOLD	ALUM	42	DOOR PANEL (U1)	-
16	OUTSWING THRESHOLD	ALUM/COMP	50	SIDELITE (FULL LITE)	-
17	OUTSWING THRESHOLD	ALUM/COMP	60	SIDELITE (HALF LITE)	-
18	OUTSWING THRESHOLD	ALUM/COMP	75	SIDELITE SPACER (INSWING)	PVC
19	COASTAL OUTSWING THRESHOLD	ALUM/ WOOD	76	SIDELITE SPACER (OUTSWING)	PVC
22	#8 x 3/4" PFH WOOD SCREW	STEEL	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
23	#10 x 3/4" PFH WOOD SCREW	STEEL	88	1X MULLION (SG >= 0.55)	WOOD
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

DATE: 12/22/16		PRODUCT:		Documents Prepared By:	
SCALE: N.T.S.		THERMA-TRU		Lyndon F. Schmidt	
DWG. BY: JK		FIBERGLASS DOOR		P.E. No. 43409	
CHK. BY: LFS		PART OR ASSEMBLY:		BUILDING CONSULTANTS, INC.	
DRAWING NO.: FL-21142.15		BILL OF MATERIALS		P.O. Box 230, Valrico, FL 33595	
SHEET 14 OF 14		LFS		Phone No.: 813.659.9197	
		FBC		FBPE Registry No. 9813	
		PO			
		BY			
		NO. DATE			
		2 8/18/23			
		1 7/15/20			
		UPDATE TO 8TH ED. (2023)			
		UPDATE TO 7th ED (2020)			
		REVISIONS			