


Fiber-Classic® & Smooth-Star®

**WOOD EDGE
OPAQUE FIBERGLASS DOUBLE DOOR
INSWING/OUTSWING
"IMPACT" DOOR w/ "NON-IMPACT" SIDELITES**

GENERAL NOTES

1. This product evaluation drawing has been developed in compliance with the 9th Edition (2026) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with FBC Section 1626 and does not require an impact resistant covering. The non-impact sidelite(s) must be protected with an impact resistant covering complying with FBC Section 1626.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996. The non-impact sidelite(s) must be protected with an impact resistant covering complying with FBC Sections 1609.1.2 & R301.2.1.2.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors and all sills used under sidelites meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
8. Fiber-Classic & Smooth-Star Sidelite panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes	8	Vertical Cross Sections (Thresholds)
2	Door Panel Details	9	Buck & Frame Anchoring
3	Sidelite Panel Details	10	Hardware Details
4	Elevations	11	Glazing Details
5	Horizontal & Vertical Cross Sections (2X Buck)	12	Components
6	Horizontal & Vertical Cross Sections (1X Buck)	13	Bill of Materials
7	Horizontal & Vertical Cross Sections (Direct to Masonry)		

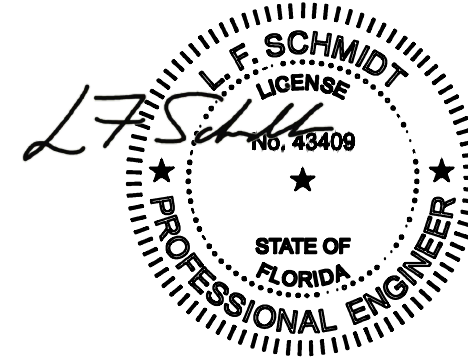


Digitally signed by
Lyndon F Schmidt
Date: 2026.08.07
13:51:52 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.

Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

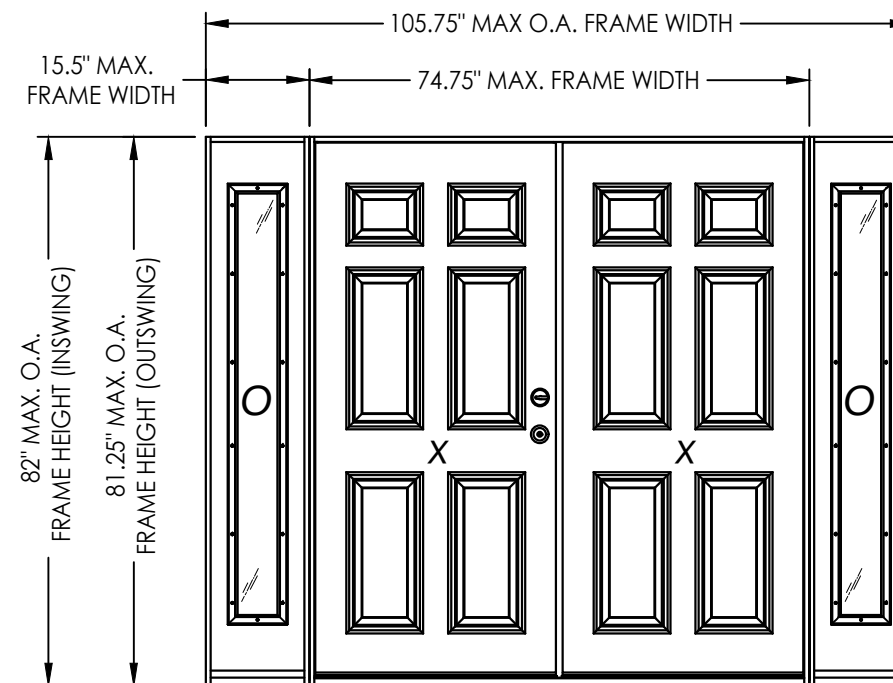

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
OXXO	+60.0	-60.0	+60.0	-60.0

See Sheet 4 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

[illegible]

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:

FL-21142.14

SHEET 1 OF 13


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

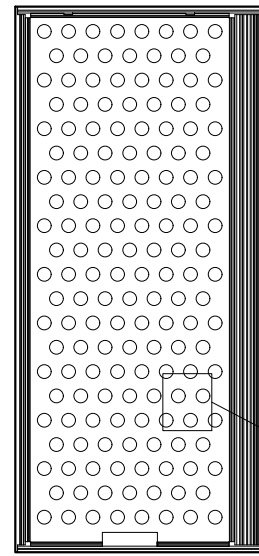


DETAIL A-A
PANEL REINFORCEMENT
(0.023" Thick Steel)

STEEL REINFORCEMENT
28.86% OPEN
AREA MAX.


* #8 X 2.5" PFH WS (TYP. @ EACH DOOR CORNER)

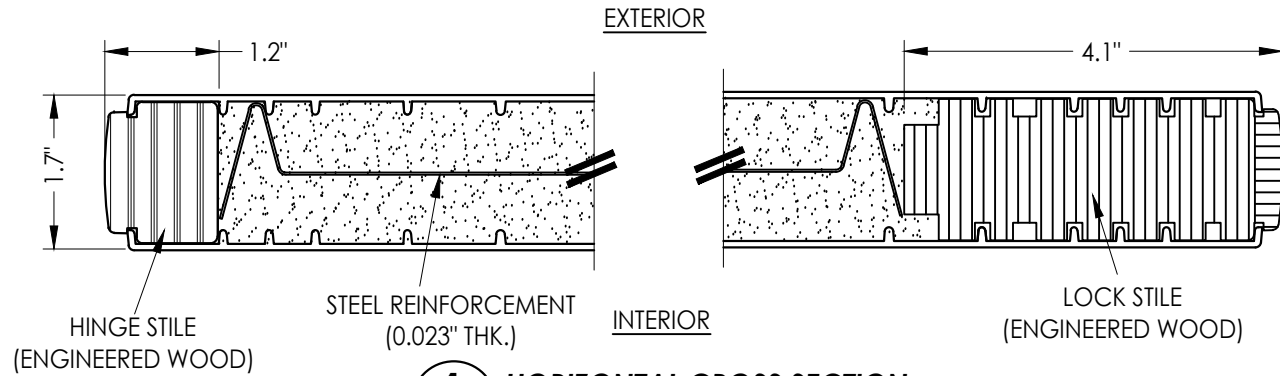


1
2 **HORIZONTAL CROSS SECTION**

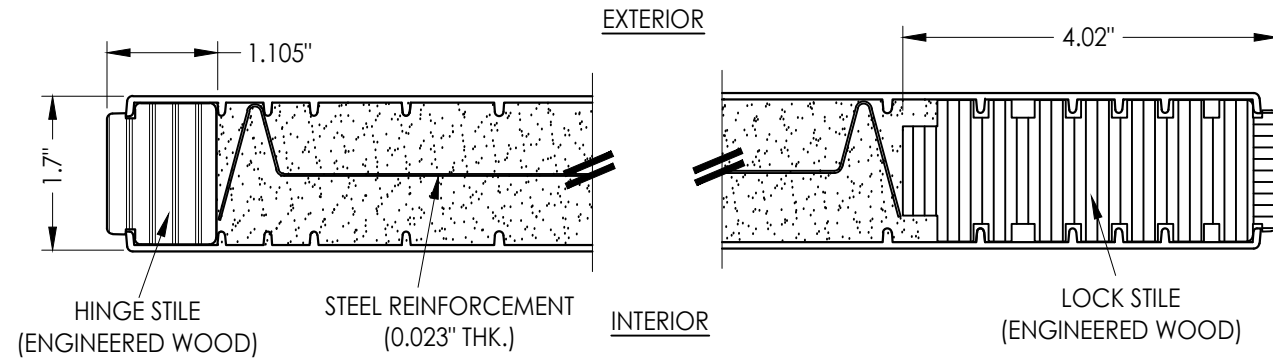


2
2 **HORIZONTAL CROSS SECTION**

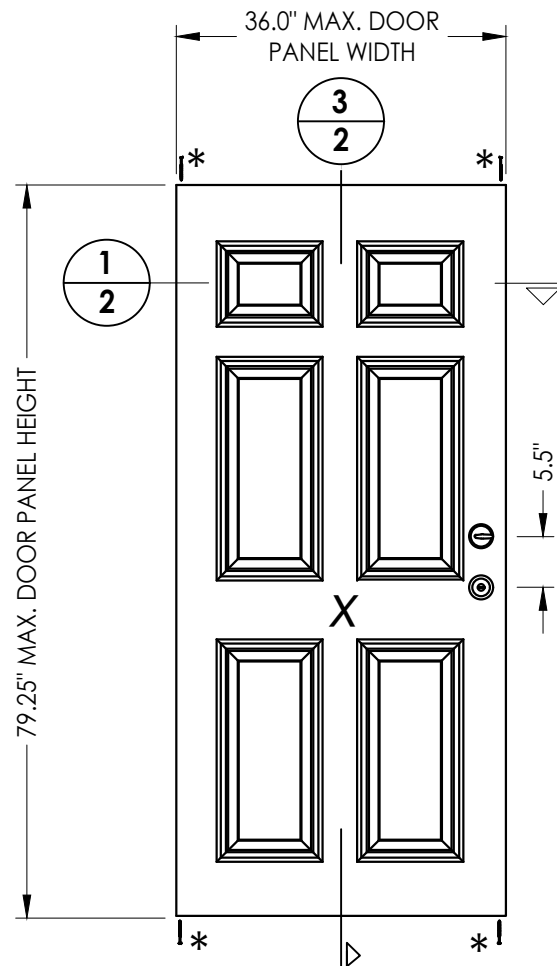


40 **DOOR PANEL**
BOOK

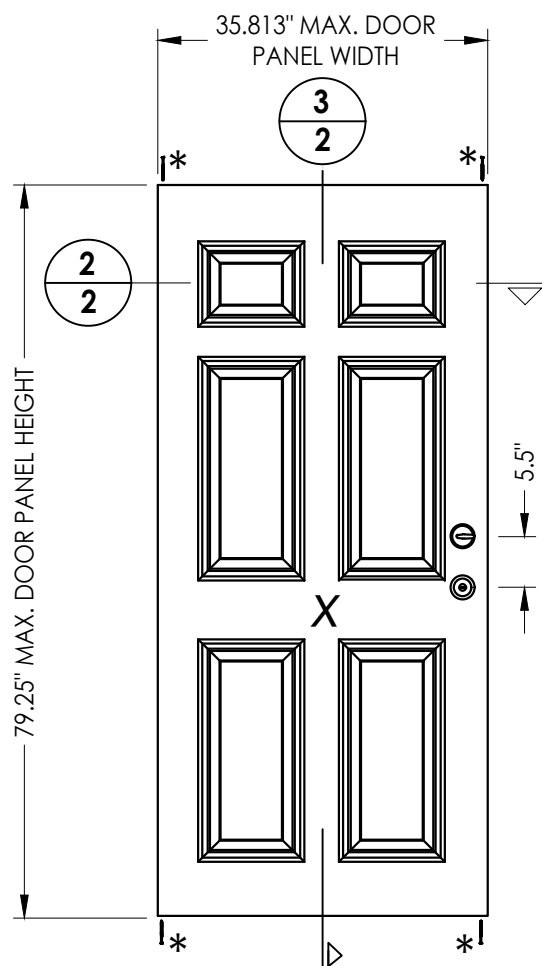


41 **DOOR PANEL**
Hybrid Door

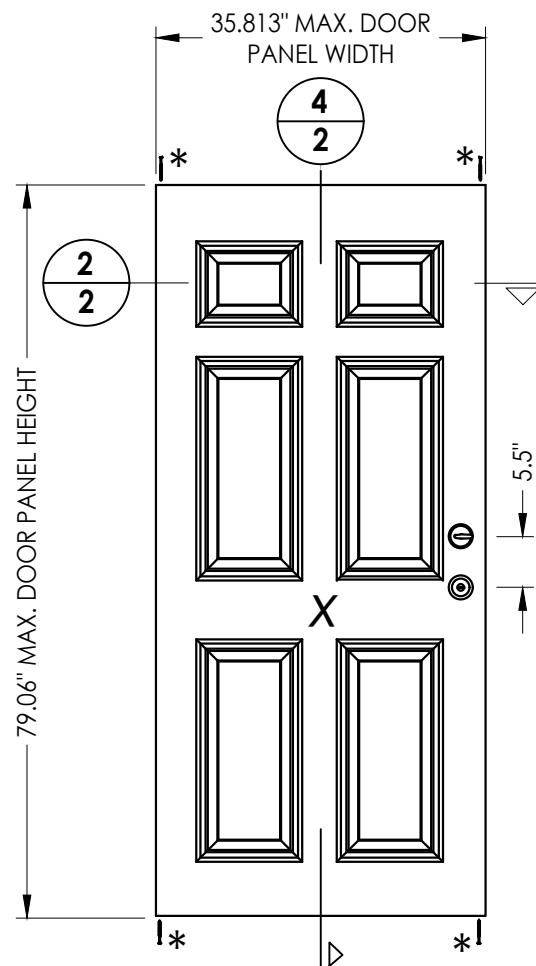

42 **DOOR PANEL**
U1 Door

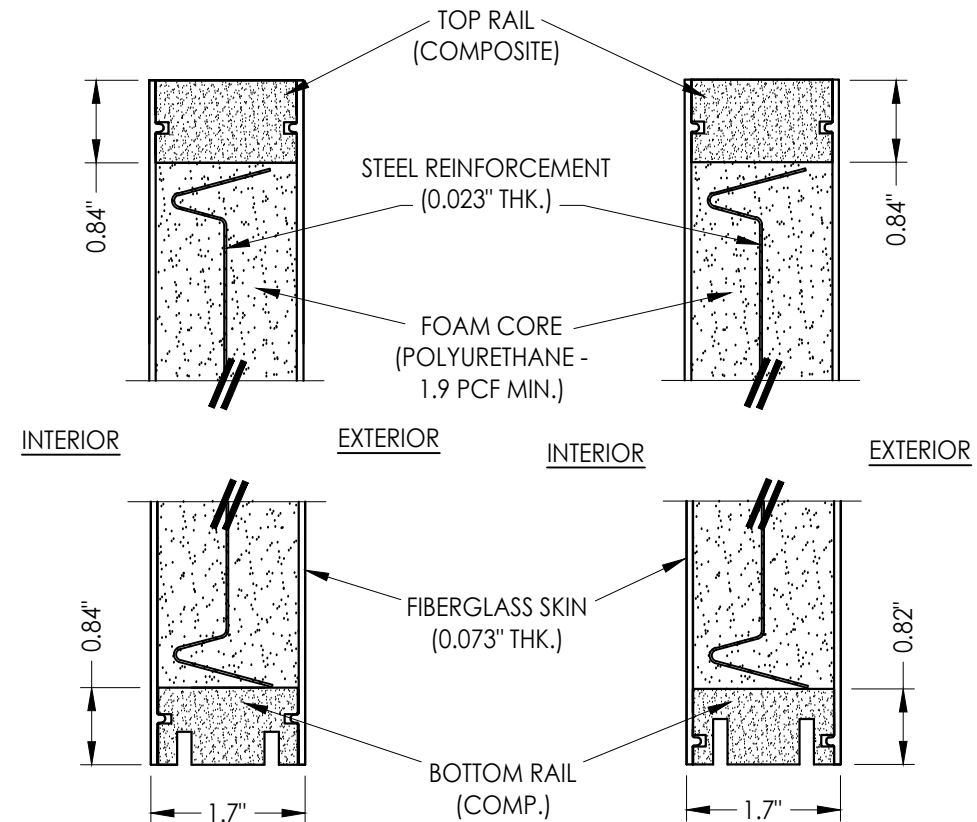

3
2 **VERTICAL CROSS SECTION**

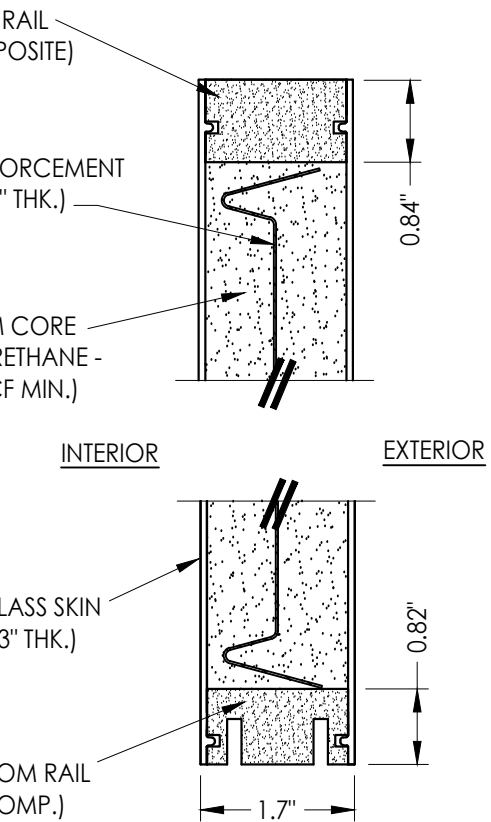

4
2 **VERTICAL CROSS SECTION**

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

REVISIONS			
NO.	DATE	BY	
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO
DATE: 12/22/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21142.14			
SHEET 2 OF 13			


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

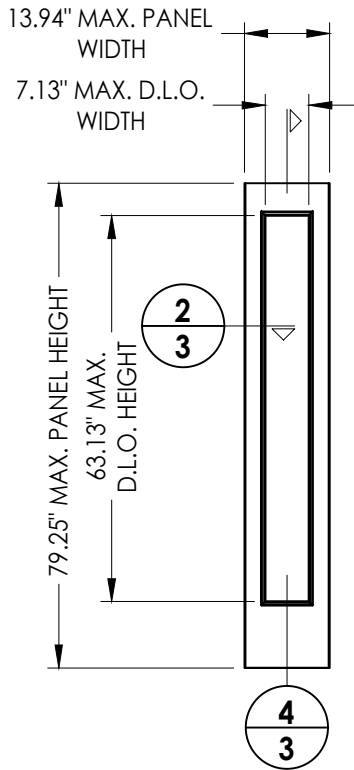


60 SIDELITE PANEL
Full Lite
Flush Glazed

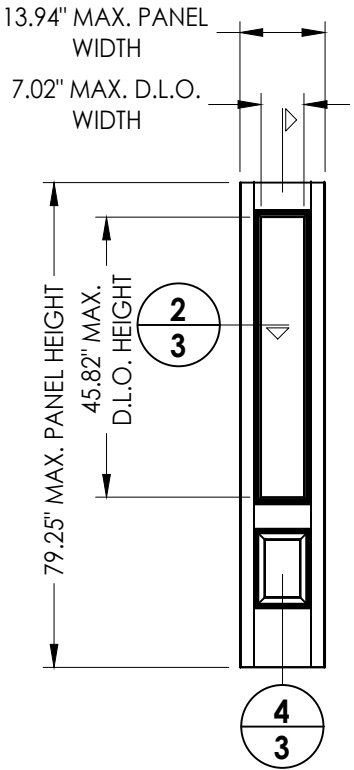




60 SIDELITE PANEL
3/4 Lite
Flush Glazed

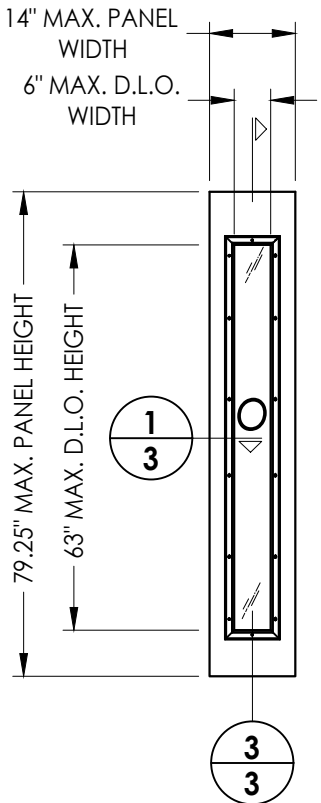


50 SIDELITE PANEL
Full Lite
Lip Lite

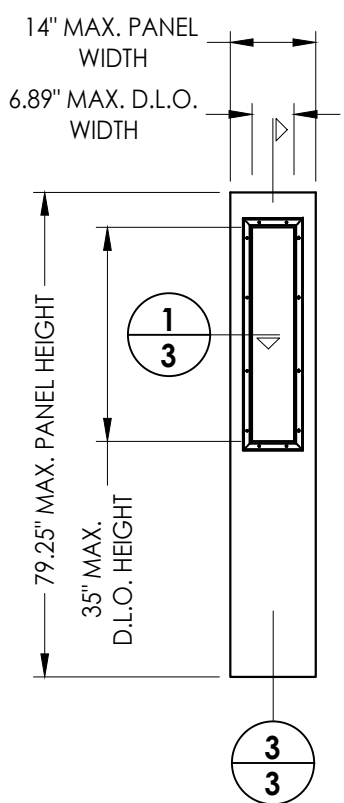


50 SIDELITE PANEL
Half Lite
Lip Lite

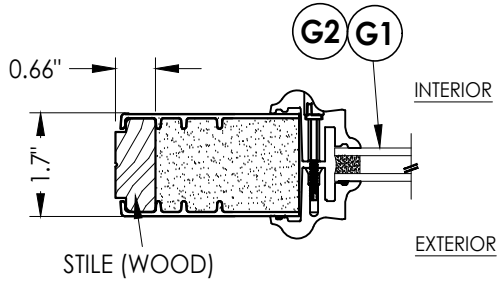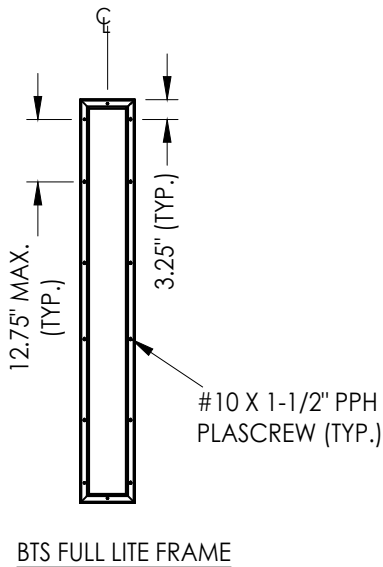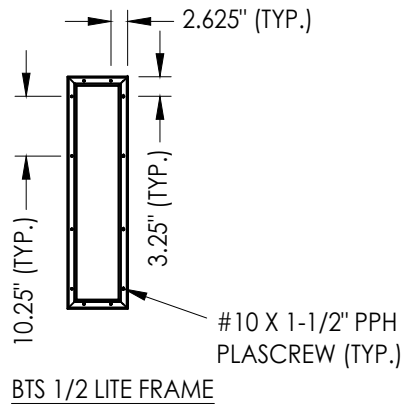


1 HORIZONTAL CROSS SECTION
3 Lip Lite Glazing

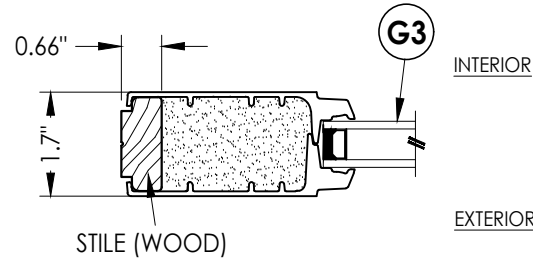

2 HORIZONTAL CROSS SECTION
3 Flush Glazing

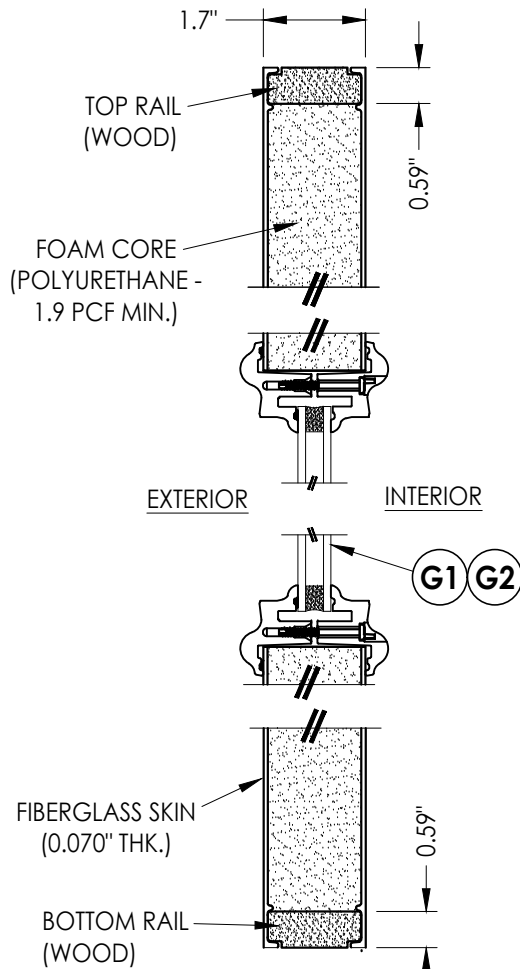

3 VERTICAL CROSS SECTION
3 Lip Lite Glazing Shown

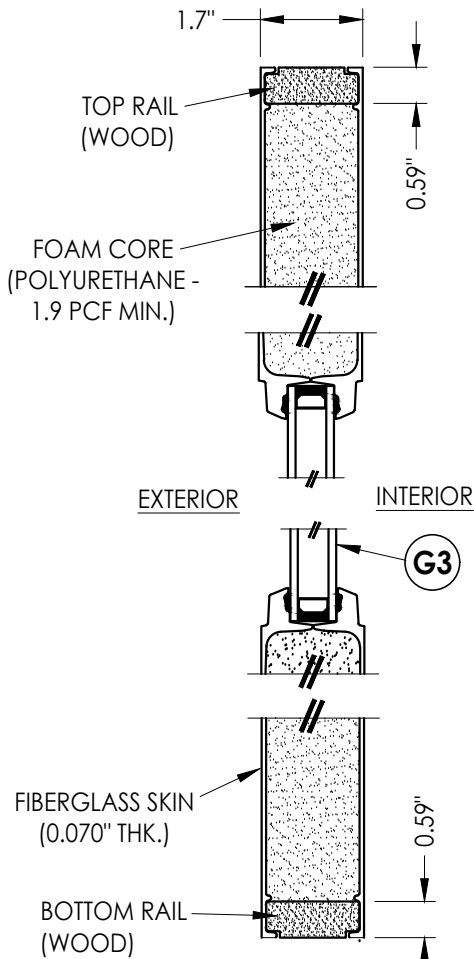

4 VERTICAL CROSS SECTION
3 Flush Glazing Shown

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-21142.14

SHEET 3 OF 13

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)



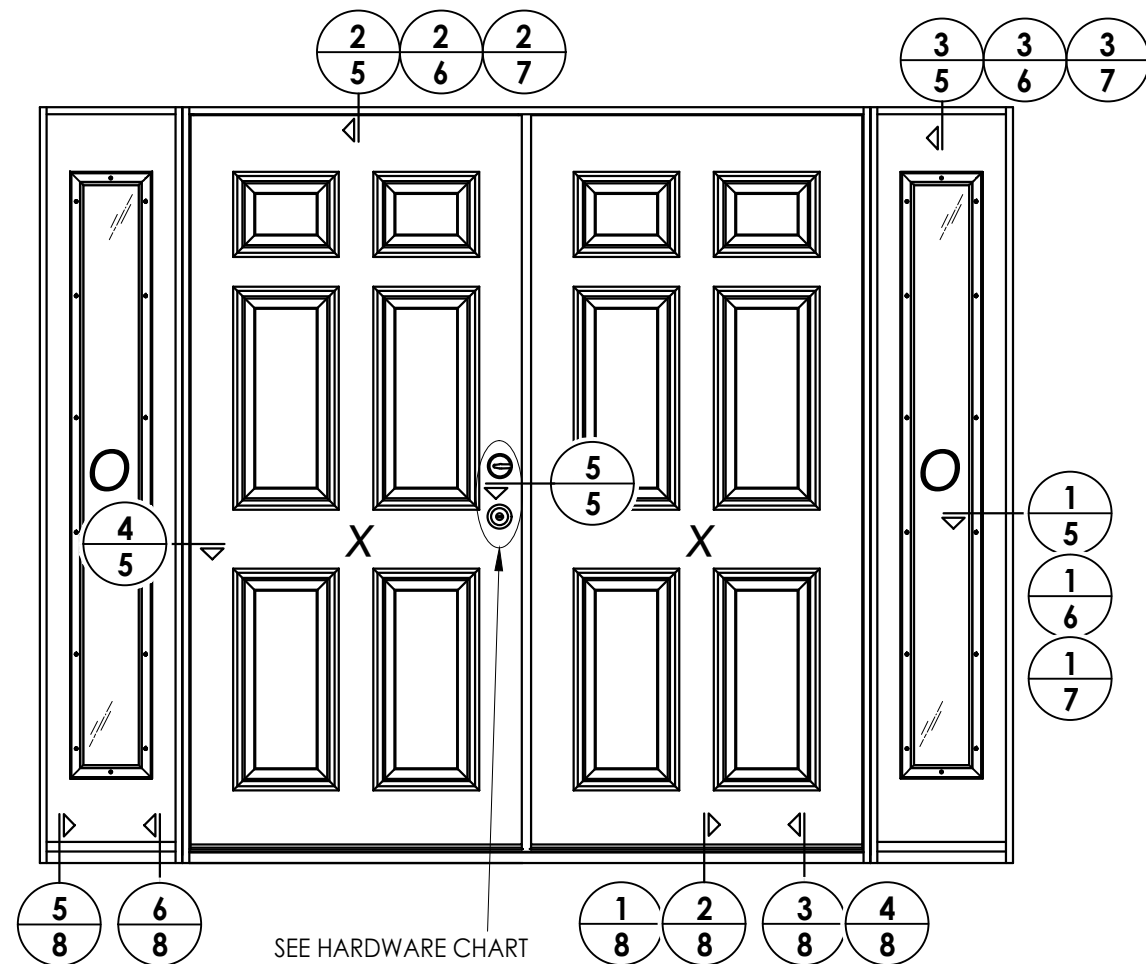


HARDWARE TABLE	
MANUFACTURER	MODEL
SCHLAGE	KNOB: F51 DEADBOLT: B60
KWIKSET	KNOB: SIGNATURE SERIES DEADBOLT: SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGART (3 pt. Manual Tongue)

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairco, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

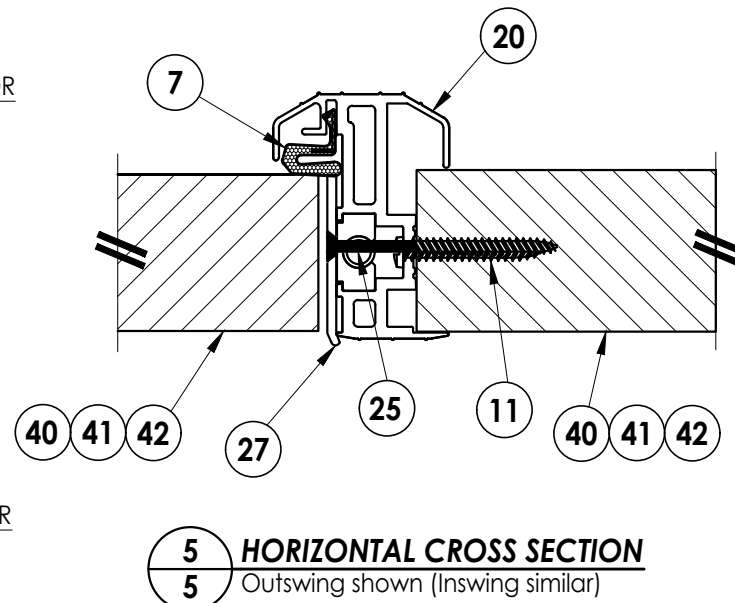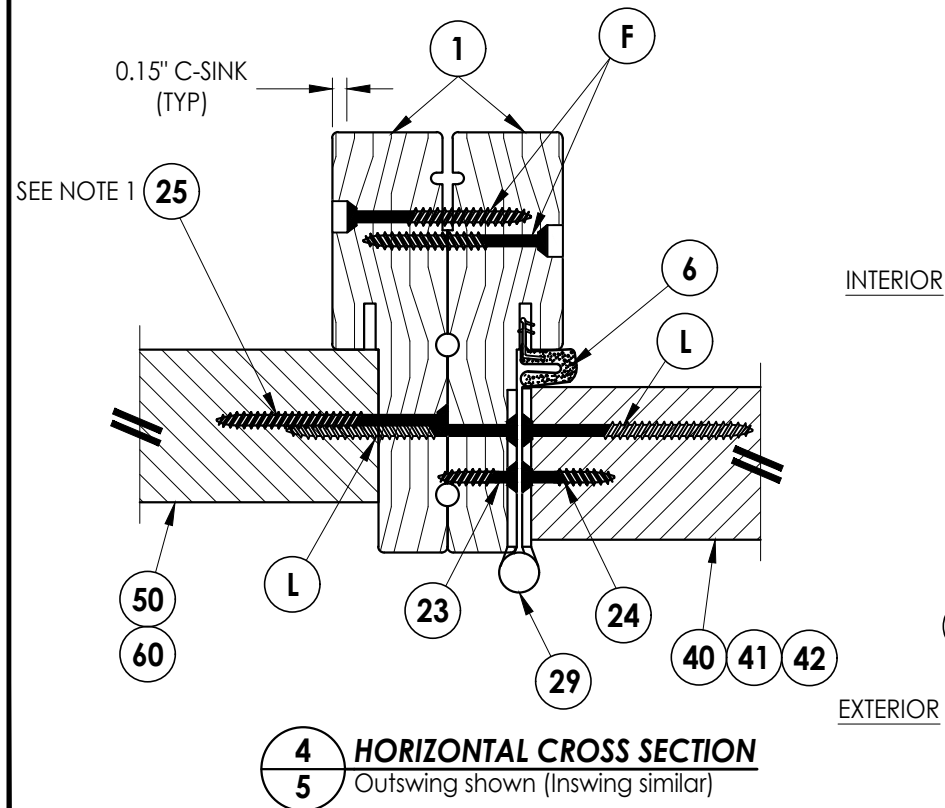

Technical drawing of a window assembly cross-section, showing exterior and interior views. The drawing includes the following labels and dimensions:




- Labels:** A, B, C, D, E, L, 1, 6, 40, 41, 42.
- Dimensions:**
 - 1-1/4" MIN. EMB. (TYP.)
 - 0.15" C-SINK (TYP)
- Views:** EXTERIOR (left) and INTERIOR (right).
- Components:**
 - A:** Exterior weatherstripping.
 - B:** Window frame.
 - C:** Window sash.
 - D:** Bolt.
 - E:** Sealant.
 - L:** Locking bolt.
 - 1:** Window sash.
 - 6:** Window frame.
 - 40, 41, 42:** Window frame.

2 VERTICAL CROSS SECTION
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

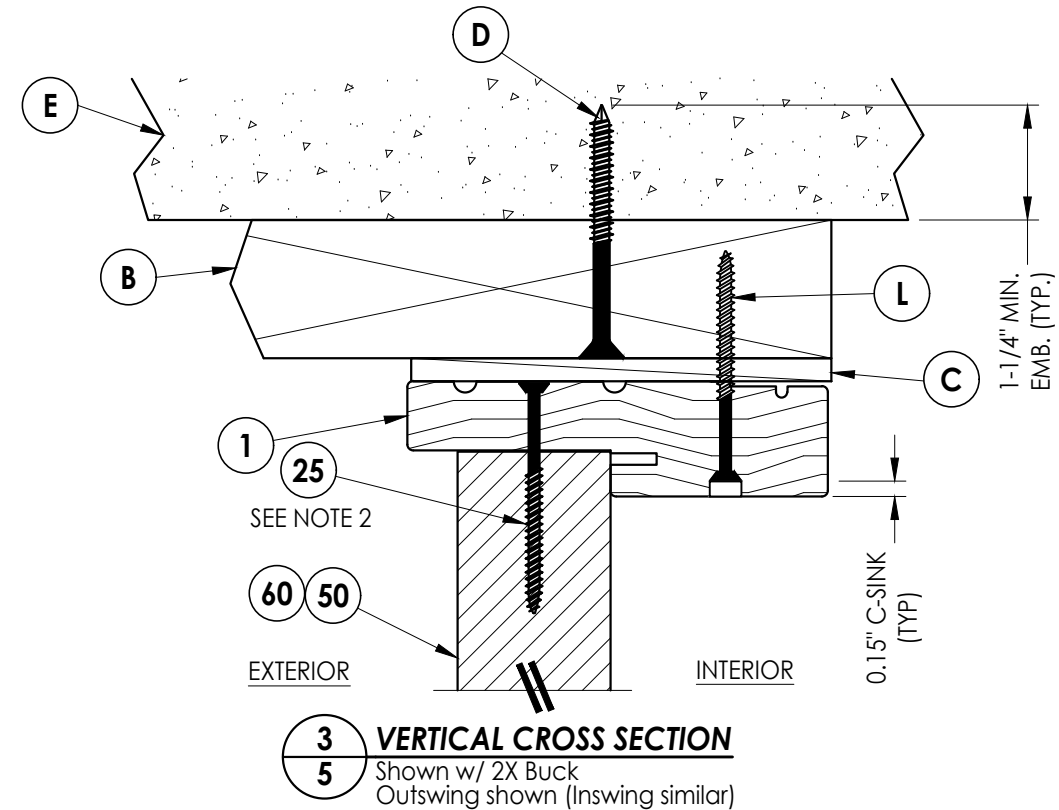[illegible]

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

1. Sidelite assembly screws located 6" from each end and 5 more screws equally spaced between (7 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

[illegible]







Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2016 R.W. BUILDING CONSULTANTS INC.

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

- Notes:
- 1. Sill Item #'s 17, 18, 19, 32, 34, 35, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 16 & 33 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - 2. Sidelite assembly screws located 4" from each end (2 screws along sill).

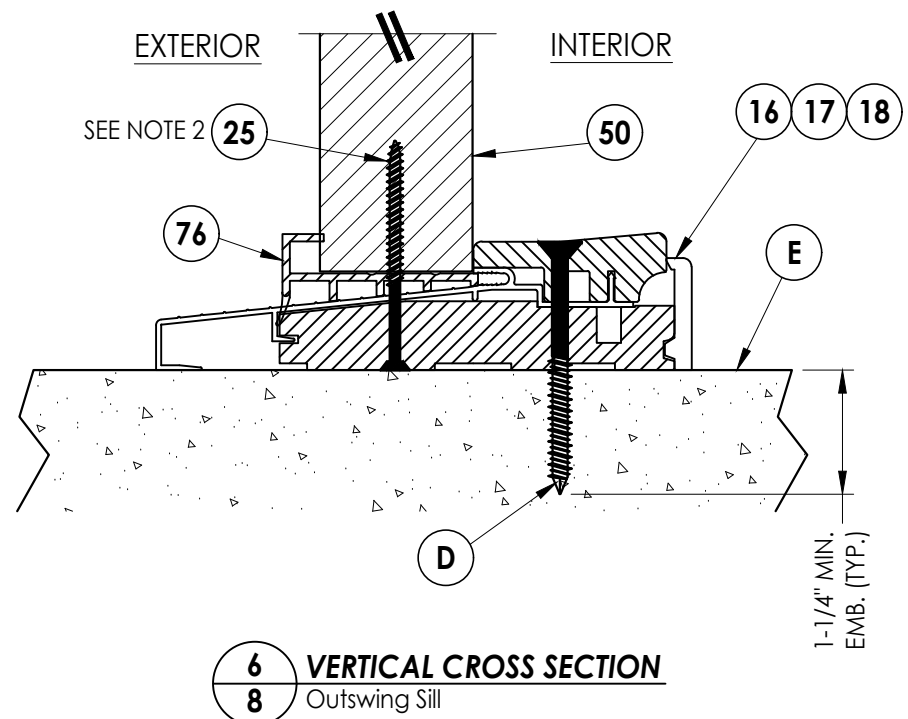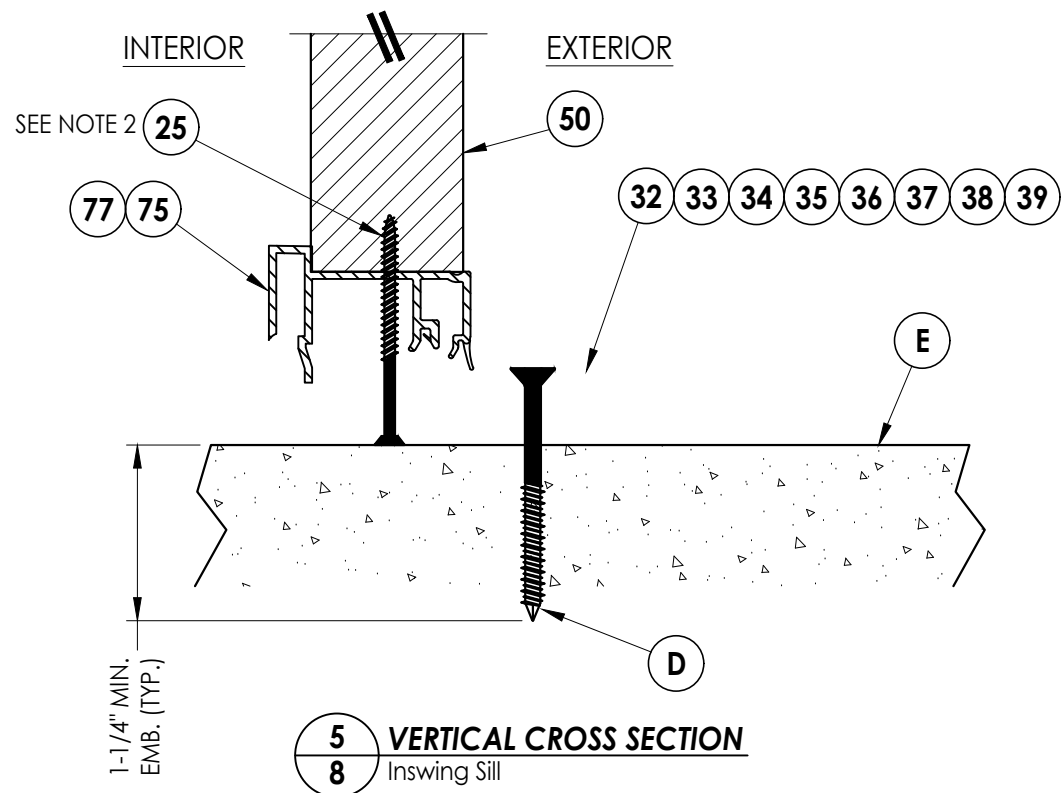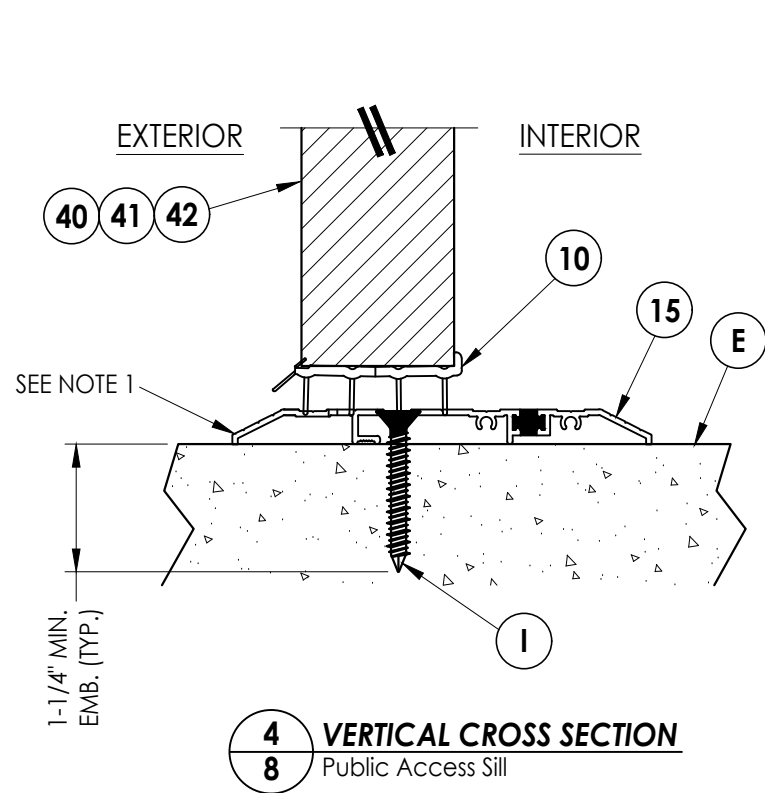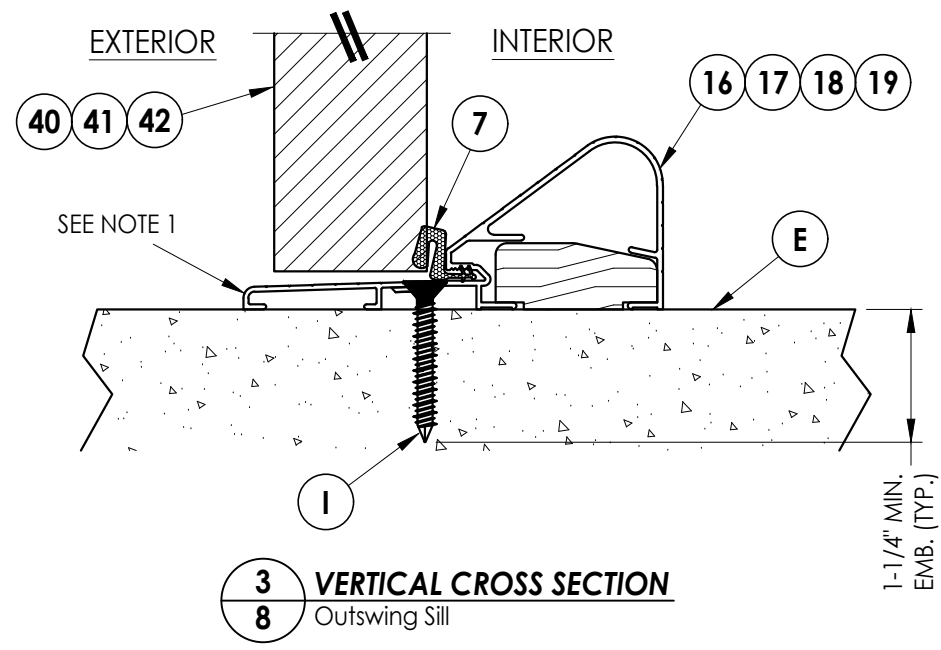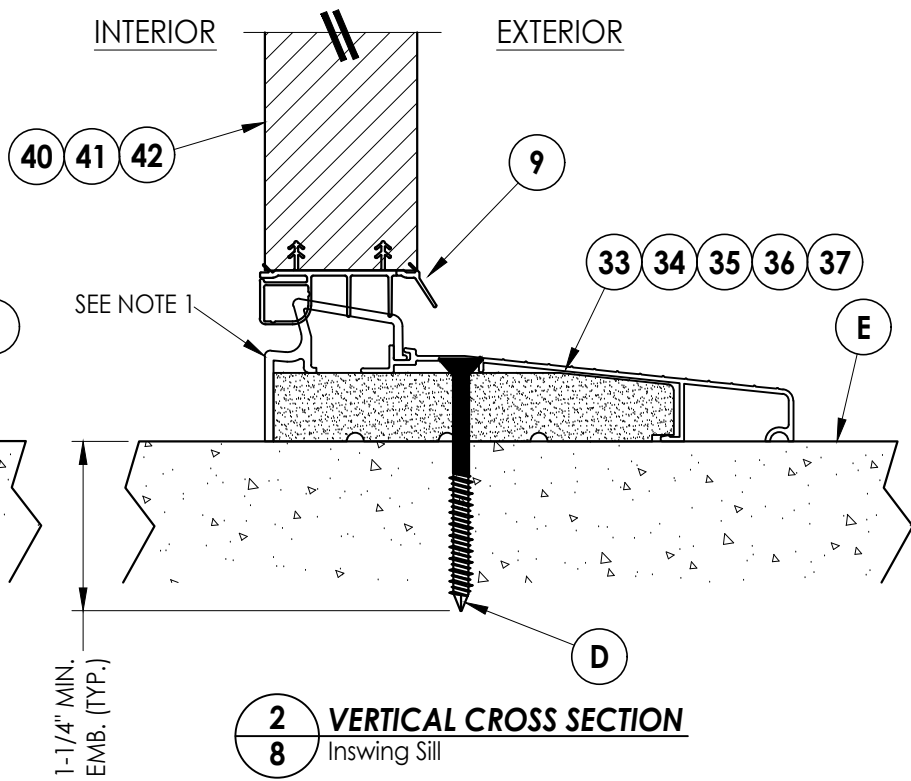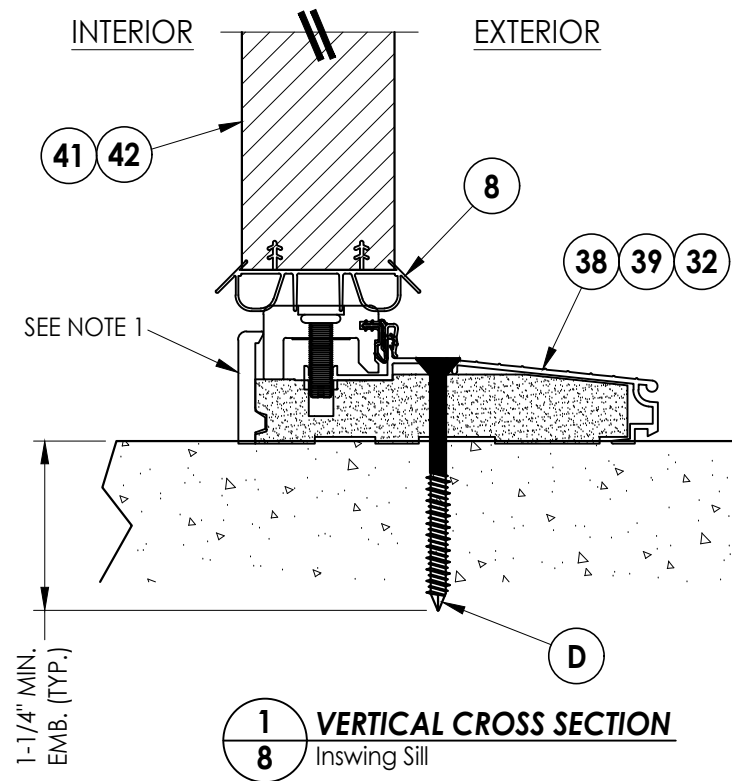

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)


NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 12/22/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21142.14
SHEET 8 OF 13


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

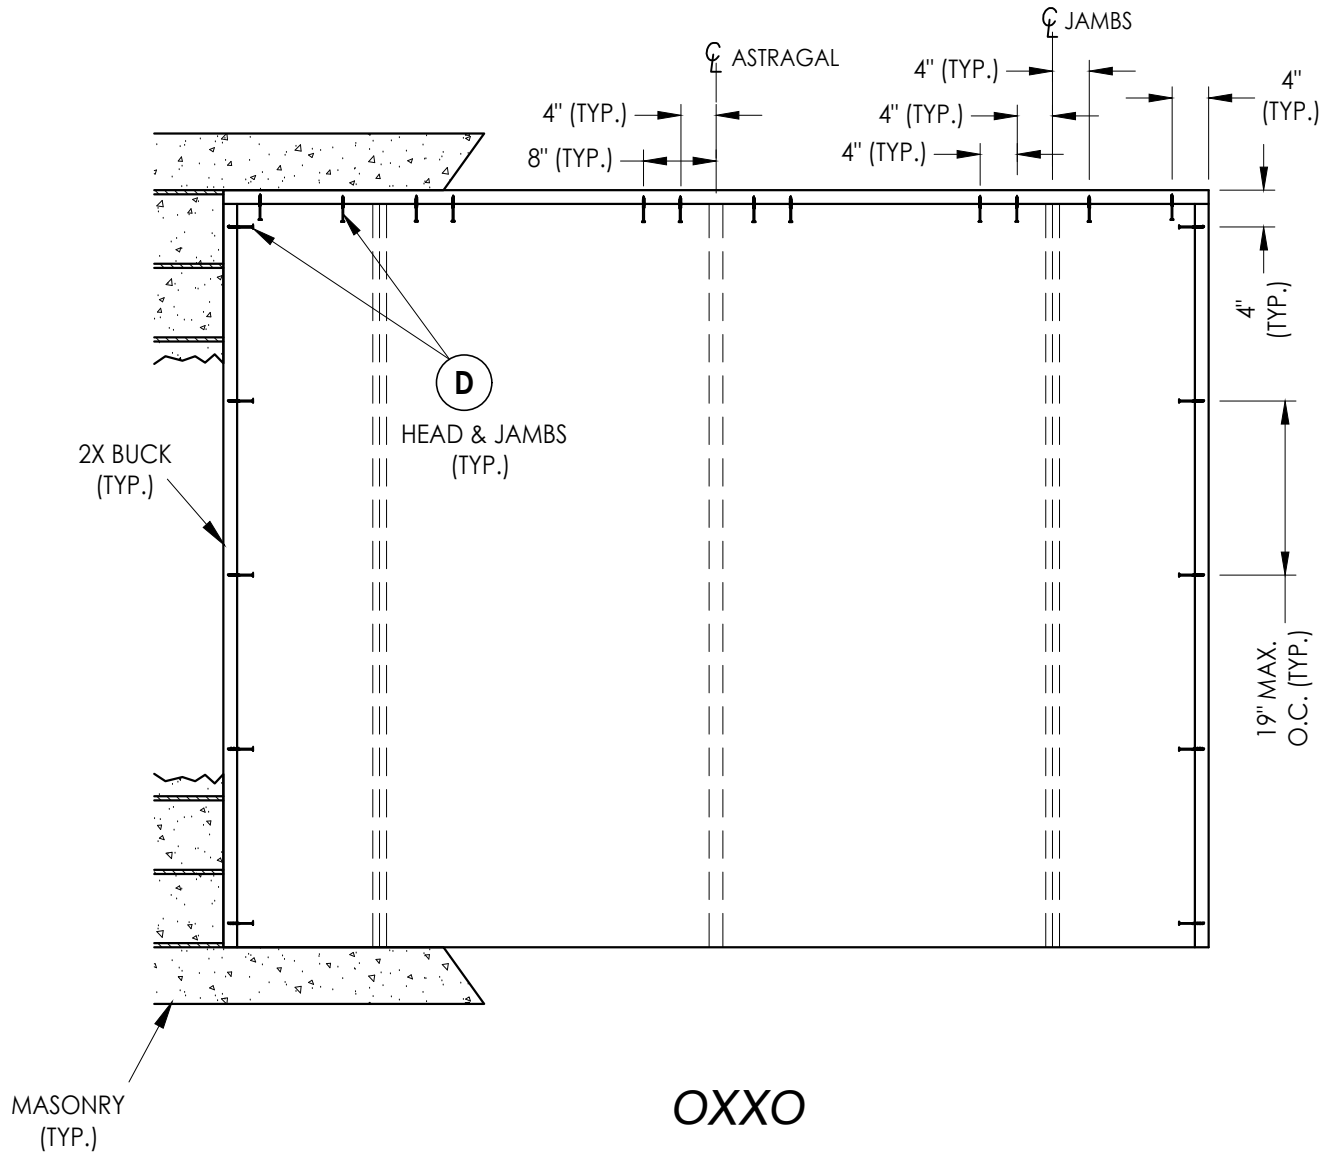

2X BUCK ANCHORING

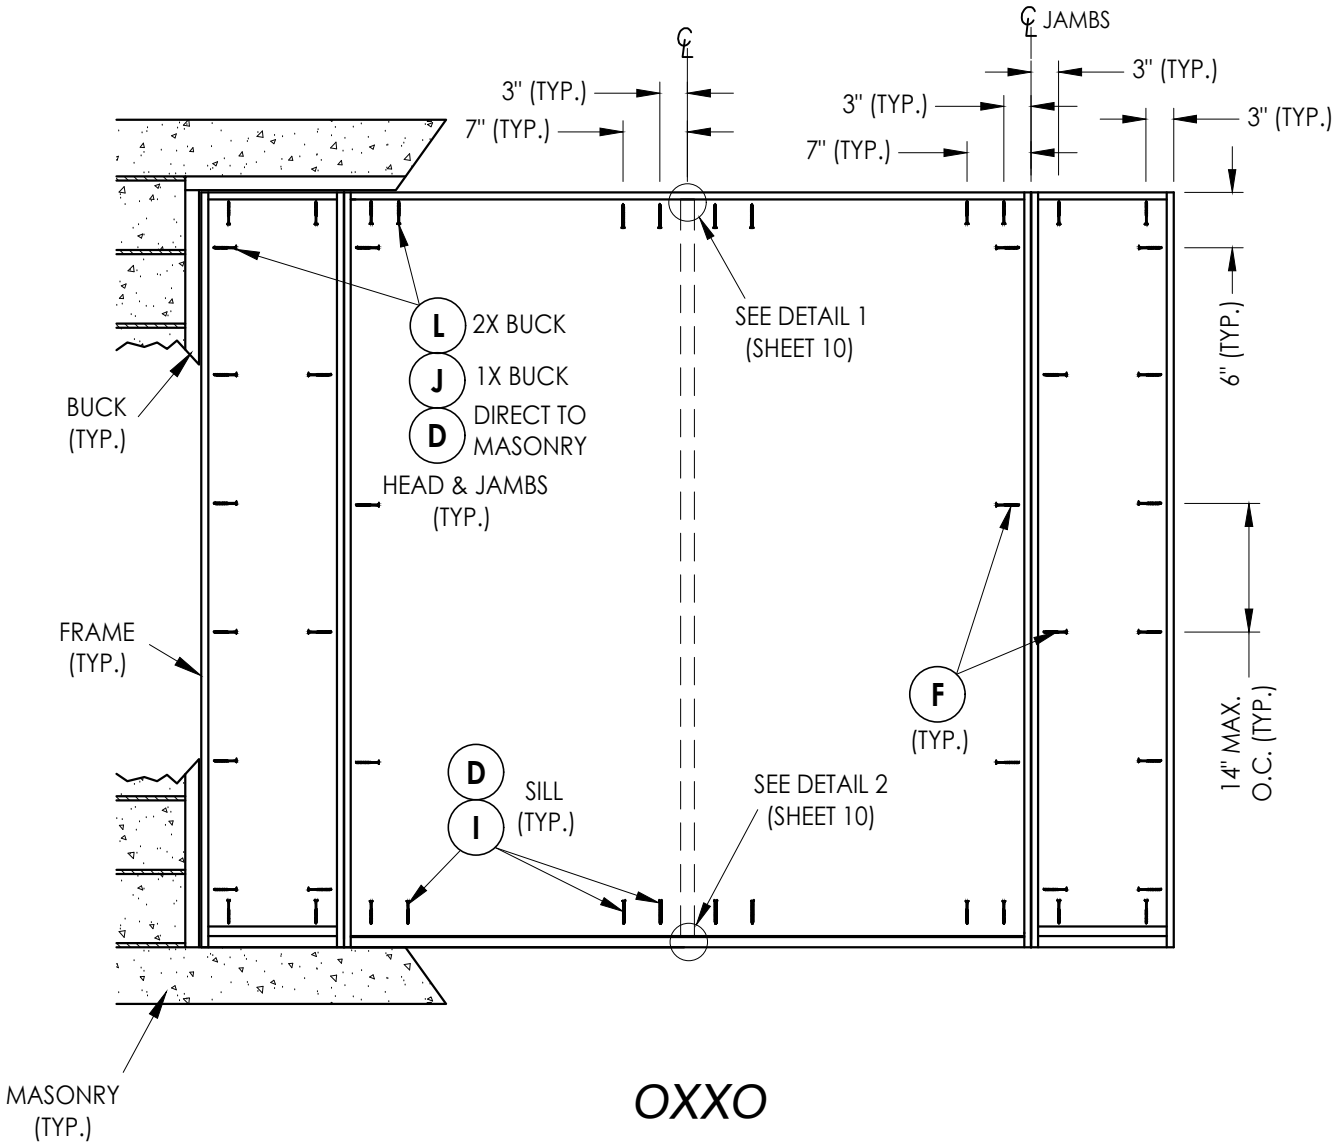

FRAME ANCHORING

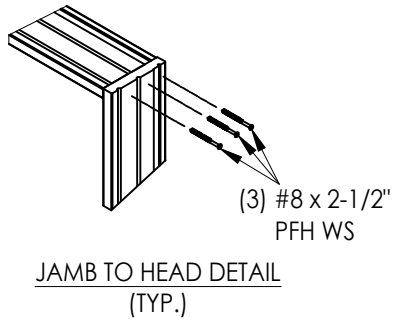

NO	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21142.14

SHEET 9 OF 13

PRODUCT:

THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:

BUCK & FRAME ANCHORING


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

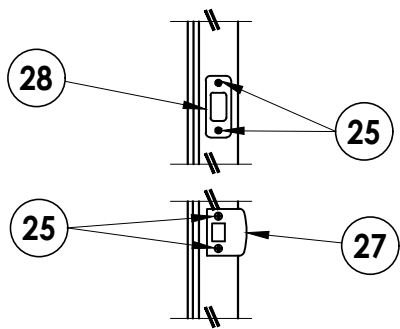




LATCH & DEADBOLT DETAIL
Schlage / Kwikset

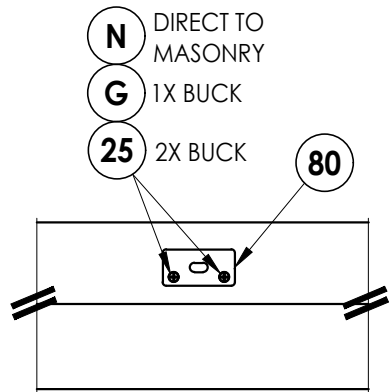


DETAIL 1
Coastal Astragal Strike Plate @ Head

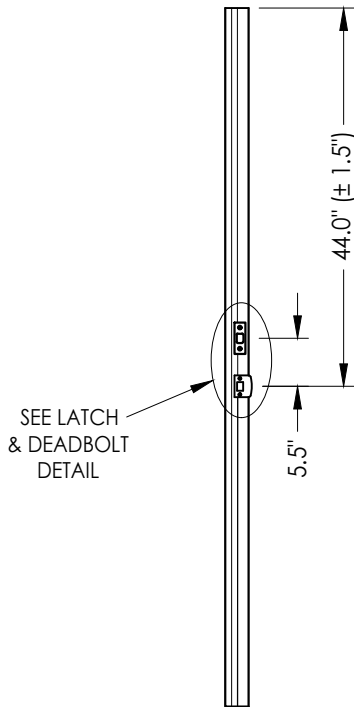


ASTRAGAL
Latch and Deadbolt

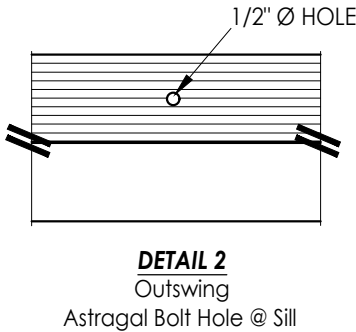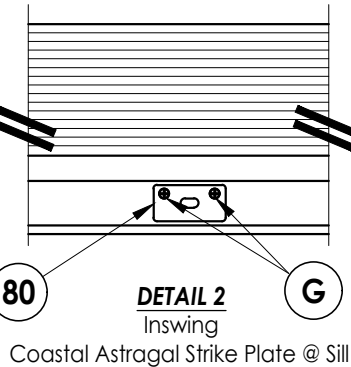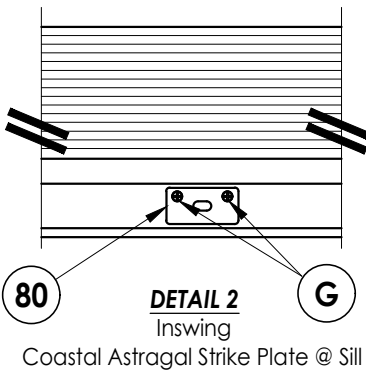


LATCH & DEADBOLT STRIKE DETAILS

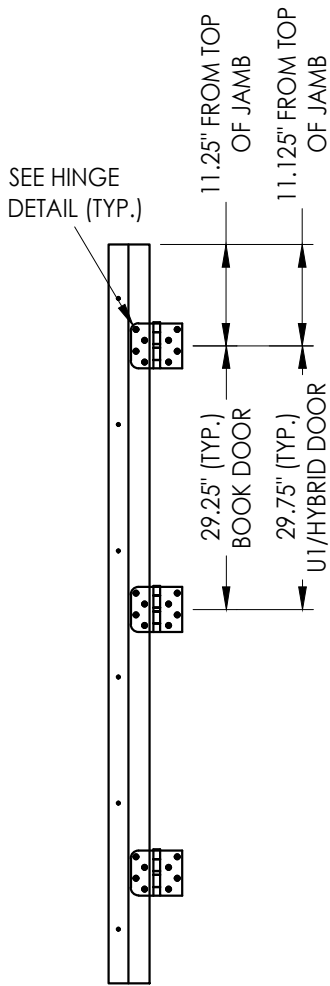


HINGE JAMB

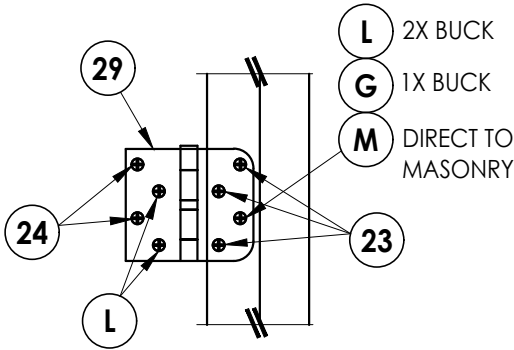


HINGE DETAIL

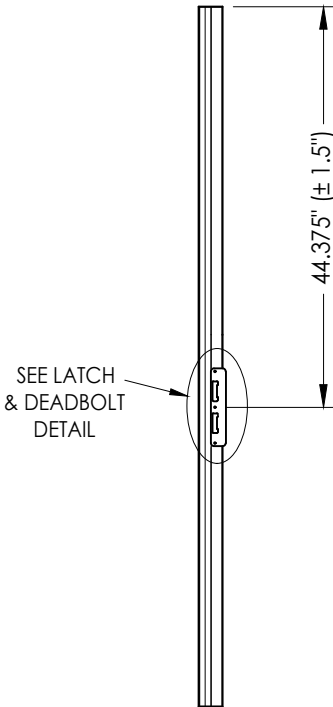



ASTRAGAL
Multipoint Lock

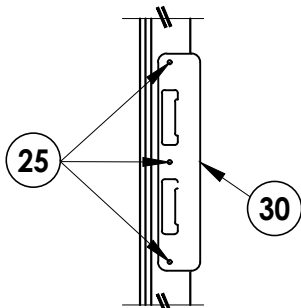

LATCH & DEADBOLT DETAIL
Multipoint Lock

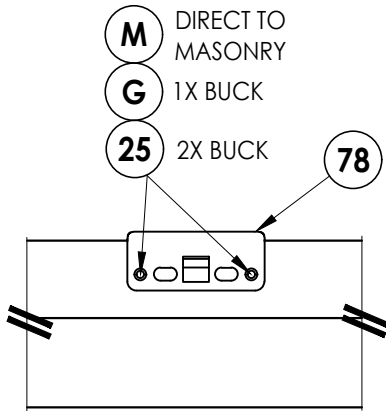

DETAIL 1
Multipoint Lock Strike Plate @ Head

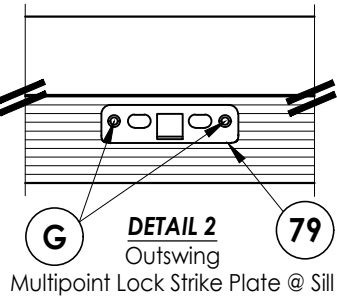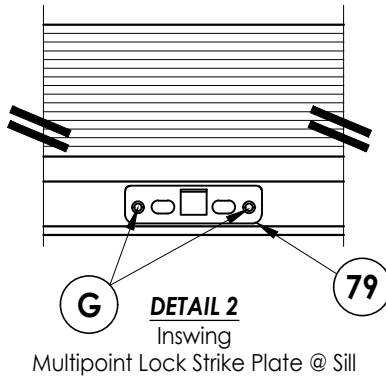

MULTIPOINT LOCK STRIKE DETAILS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HARDWARE DETAILS

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 12/22/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-21142.14

SHEET 10 OF 13


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

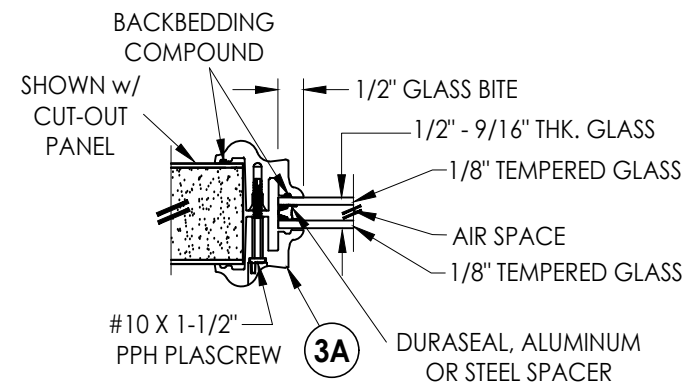


G1 GLAZING DETAIL
BTS Lite Frame
Sidelites

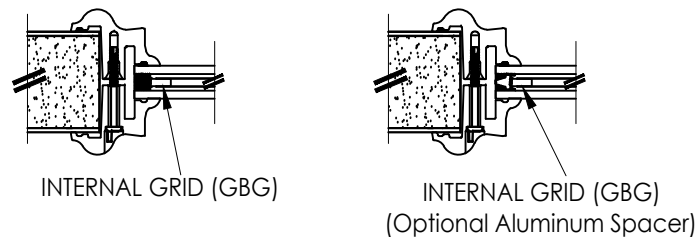


9/16" INSULATED GLASS INSERT OPTIONS

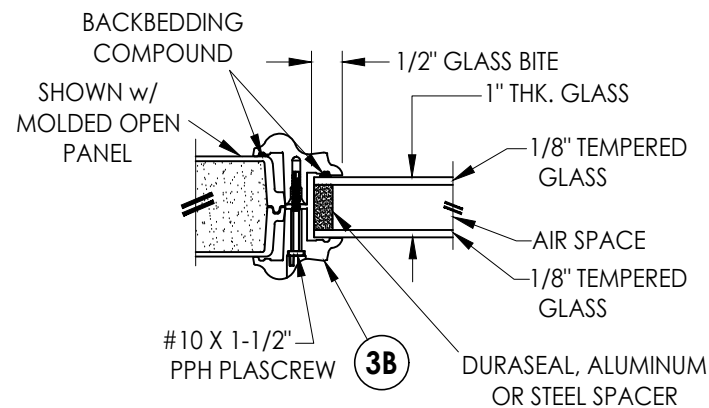


G2 GLAZING DETAIL
BTS Lite Frame
Sidelites

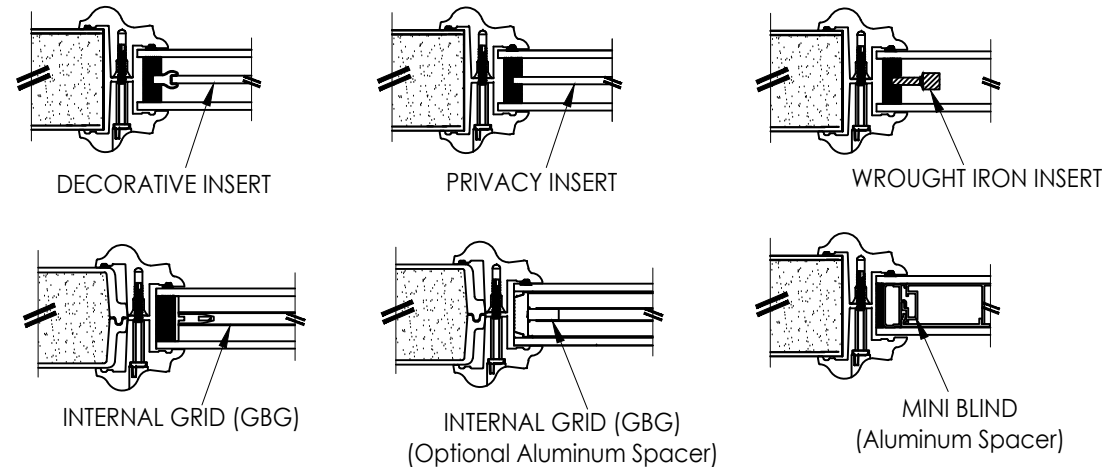


1" INSULATED GLASS INSERT OPTIONS

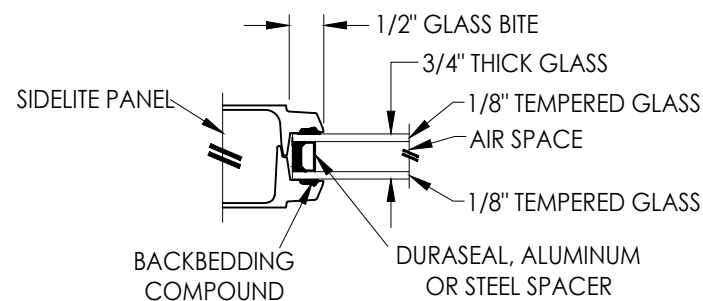


G3 GLAZING DETAIL
Flush Glazing
Sidelites

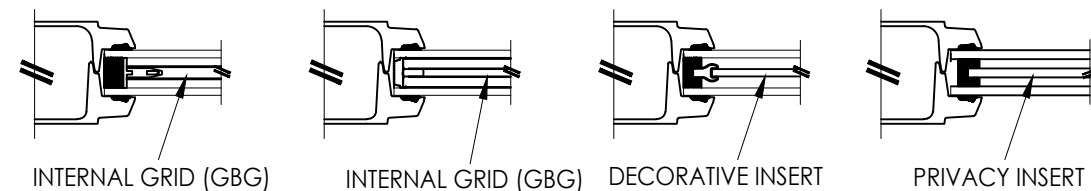

3/4" INSULATED GLASS INSERT OPTIONS

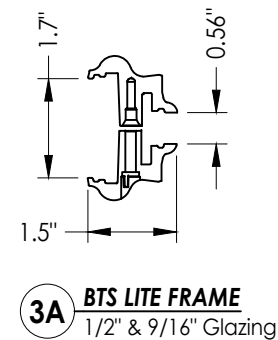

3A BTS LITE FRAME
1/2" & 9/16" Glazing



3B BTS LITE FRAME
1" Glazing

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
GLAZING DETAILS

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-21142.14

SHEET 11 OF 13


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.13-16.dwg

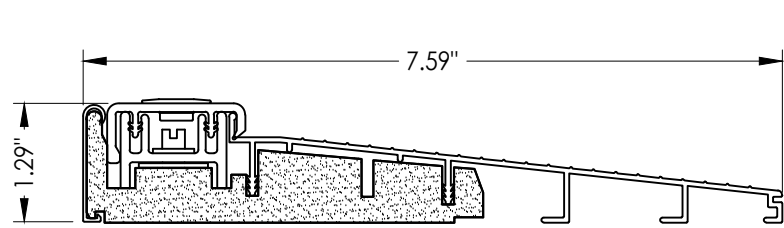


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

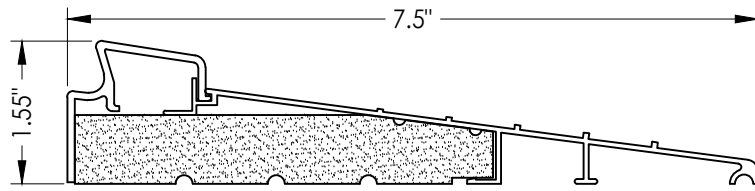


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

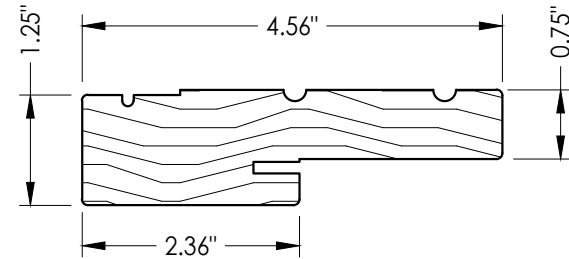


1 WOOD JAMB

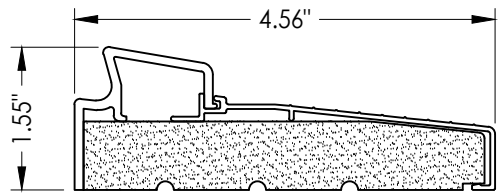


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

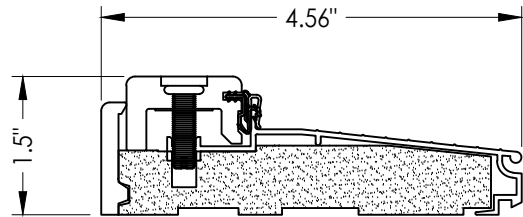


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

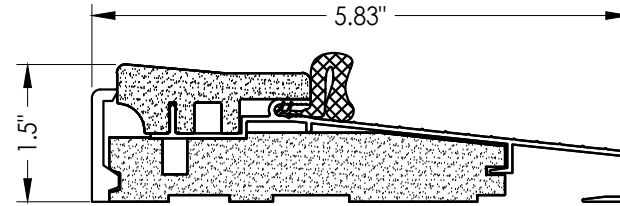


16 OUTSWING THRESHOLD
Composite Sill

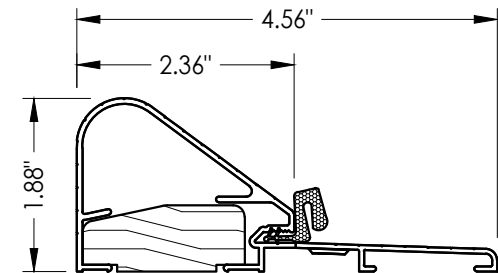


19 COASTAL OUTSWING THRESHOLD
Wood / Aluminum Sill

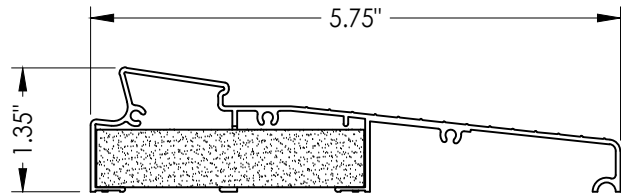


34 INSWING THRESHOLD
Inswing Moderate Climate Sill 1-3/8"

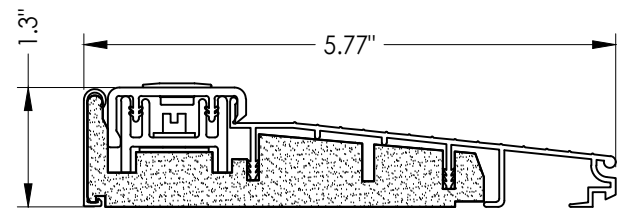


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

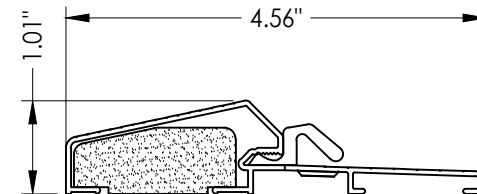


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

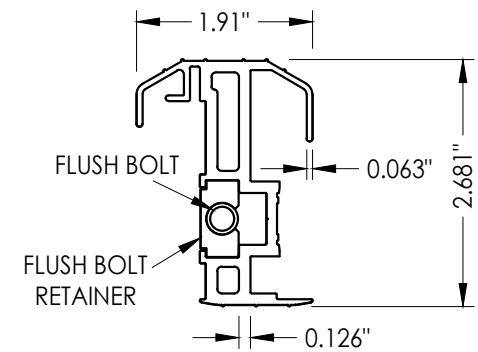


20 COASTAL ALUMINUM ASTRAGAL

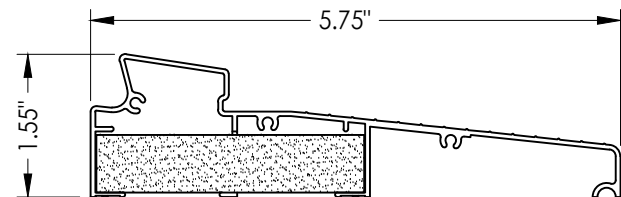


35 INSWING THRESHOLD
Inswing Moderate Climate Sill

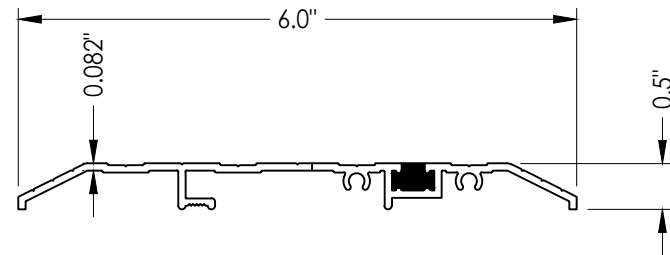


15 PUBLIC ACCESS THRESHOLD

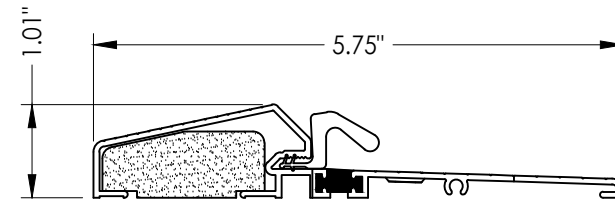


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

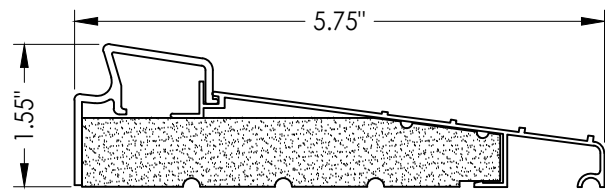


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill




8 SWEEP




9 SWEEP




10 SWEEP

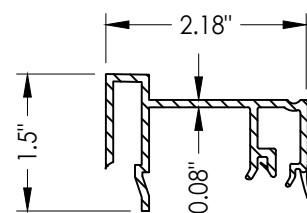

75 SIDELITE SPACER
Inswing



76 SIDELITE SPACER
Outswing

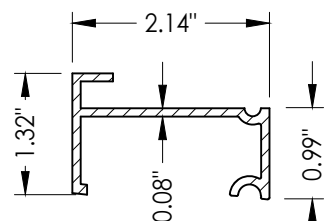

77 SIDELITE SPACER
Inswing
Moderate Climate Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS	BY
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC	PO

DATE: 12/22/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21142.14
SHEET 12 OF 13

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	29	4" X 4" HINGE	STEEL
			32	INSWING THRESHOLD	ALUM/COMP
F	#10 X 2" PFH WOOD SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	34	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	35	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	37	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	38	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	39	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	40	DOOR PANEL (BOOK)	-
7	WEATHERSTRIP (LONG REACH)	FOAM	41	DOOR PANEL (HYBRID)	-
8	SWEEP	VINYL	42	DOOR PANEL (U1)	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	50	SIDELITE (FULL LITE)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	60	SIDELITE (HALF LITE)	-
11	#10 X 1-3/4" PFH WOOD SCREW	STEEL	75	SIDELITE SPACER (INSWING)	PVC
15	ADA THRESHOLD	ALUM	76	SIDELITE SPACER (OUTSWING)	PVC
16	OUTSWING THRESHOLD	ALUM/COMP	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
17	OUTSWING THRESHOLD	ALUM/COMP	78	MULTIPOINT LOCK STRIKE PLATE @ HEAD	STEEL
18	OUTSWING THRESHOLD	ALUM/COMP	79	MULTIPOINT LOCK STRIKE PLATE @ SILL	STEEL
19	COASTAL OUTSWING THRESHOLD	ALUM/ WOOD	80	ASTRAGAL STRIKE PLATE	STEEL
20	COASTAL ALUMINUM ASTRAGAL	ALUM			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

DATE: 12/22/16		REVISIONS	
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-21142.14			
SHEET 13 OF 13			
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO
NO.	DATE		BY
PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		BILL OF MATERIALS	
Documents Prepared By:		<i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
Lyndon F. Schmidt P.E. No. 43409			