




**WOOD EDGE
GLAZED FIBERGLASS DOUBLE DOOR
w/ or w/out SIDELITES
INSWING/OUTSWING
"IMPACT"**

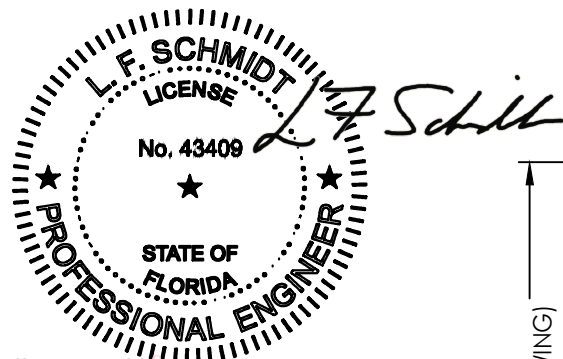

Digitally signed by Lyndon F
Schmidt
Date: 2026.08.07 13:46:05 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

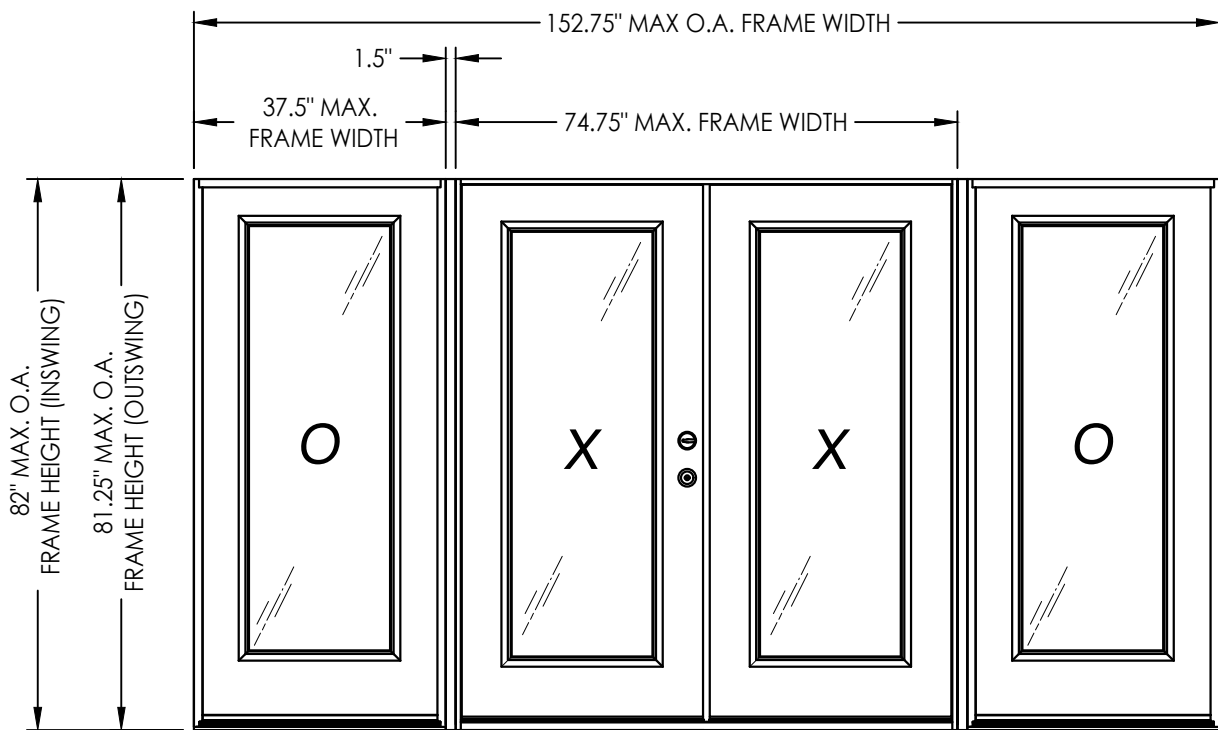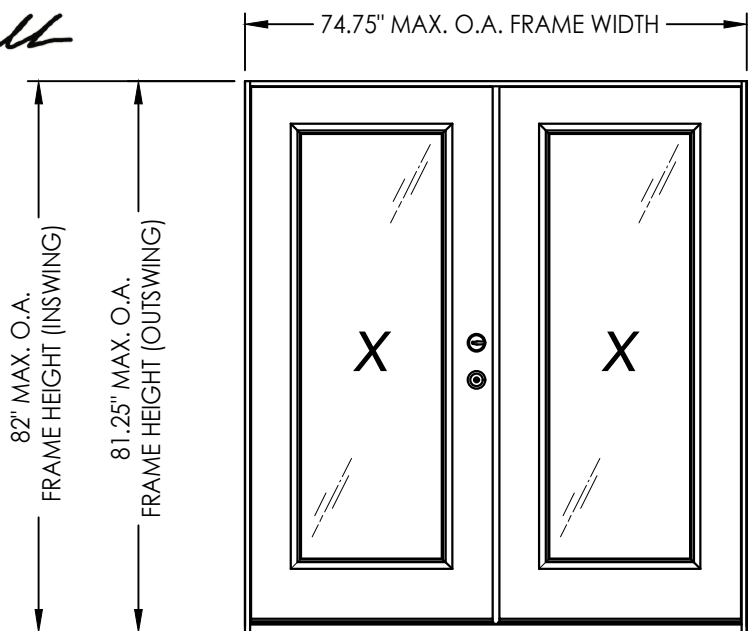

GENERAL NOTES

1. This product evaluation drawing has been developed in compliance with the 9th Edition (2026) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the FBC and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets the water infiltration requirements for the "HVHZ".
8. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.


TABLE OF CONTENTS			
SHEET#	DESCRIPTION	SHEET#	
1	Typical Elevations, Design Pressures & General Notes	8	Vertical Cross Sections (Thresholds)
2	Door Panel Details	9	Buck Anchoring
3	Sidelite Panel Details	10	Frame Anchoring
4	Elevations	11	Hardware Details
5	Horizontal & Vertical Cross Sections (2X Buck)	12	Glazing Details
6	Horizontal & Vertical Cross Sections (1X Buck)	13	Components
7	Horizontal & Vertical Cross Sections (Direct to Masonry)	14	Bill of Materials

CONFIGURATION	LOCK HARDWARE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX, OXXO	Latch & Deadbolt	+50.0	-50.0	+50.0	-50.0
XX, OXXO	Multipoint	+55.0	-55.0	+55.0	-55.0

See Sheet 4 for Hardware Specifications

[illegible]

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

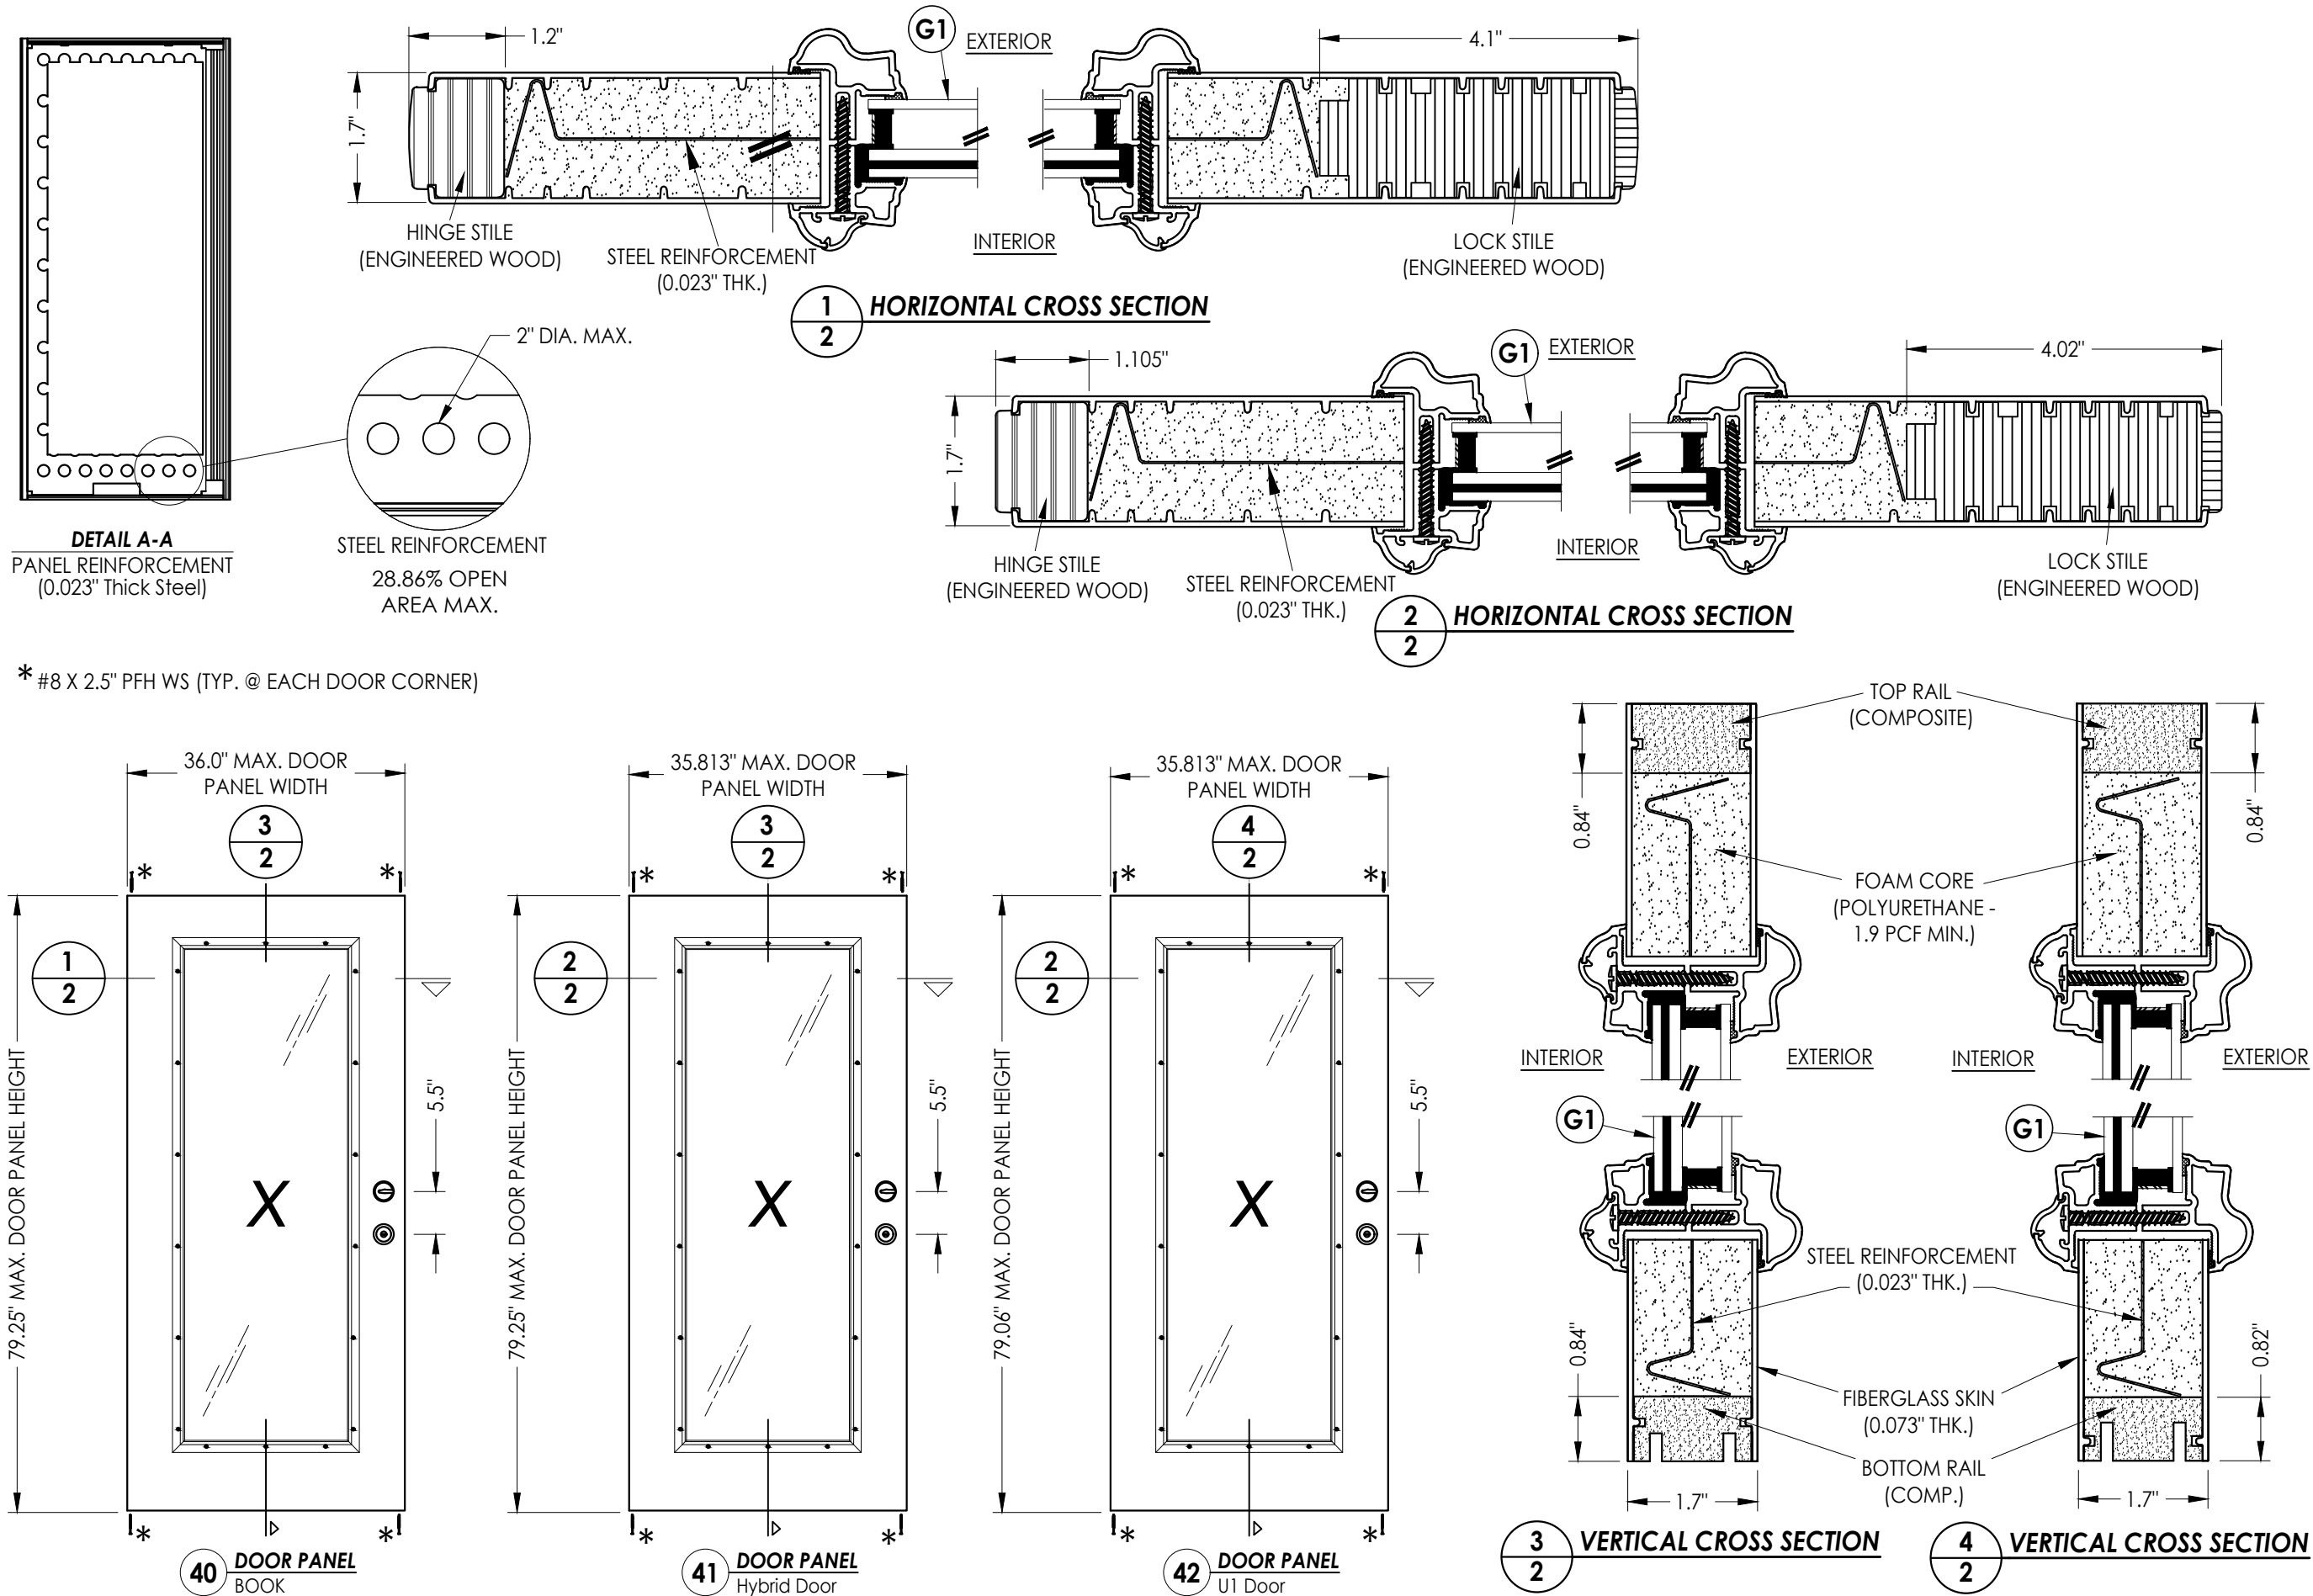

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS	BY
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC	PO

DATE: 12/22/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS




DRAWING NO.: FL-21142.9

SHEET 2 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

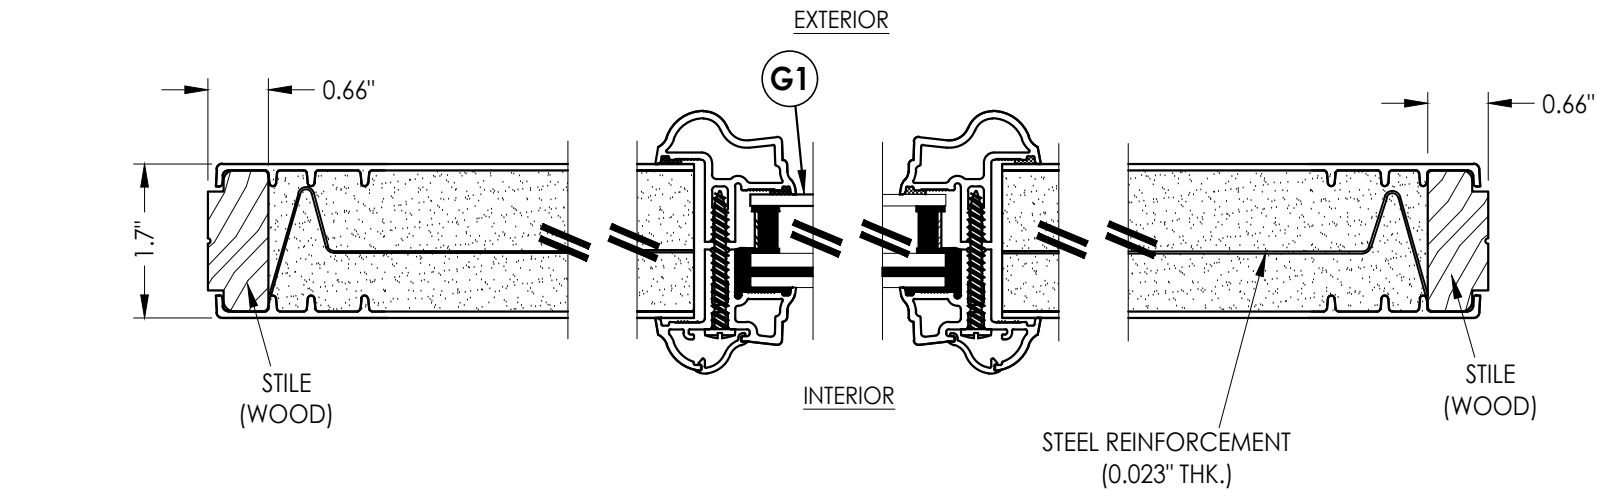


1
3 HORIZONTAL CROSS SECTION

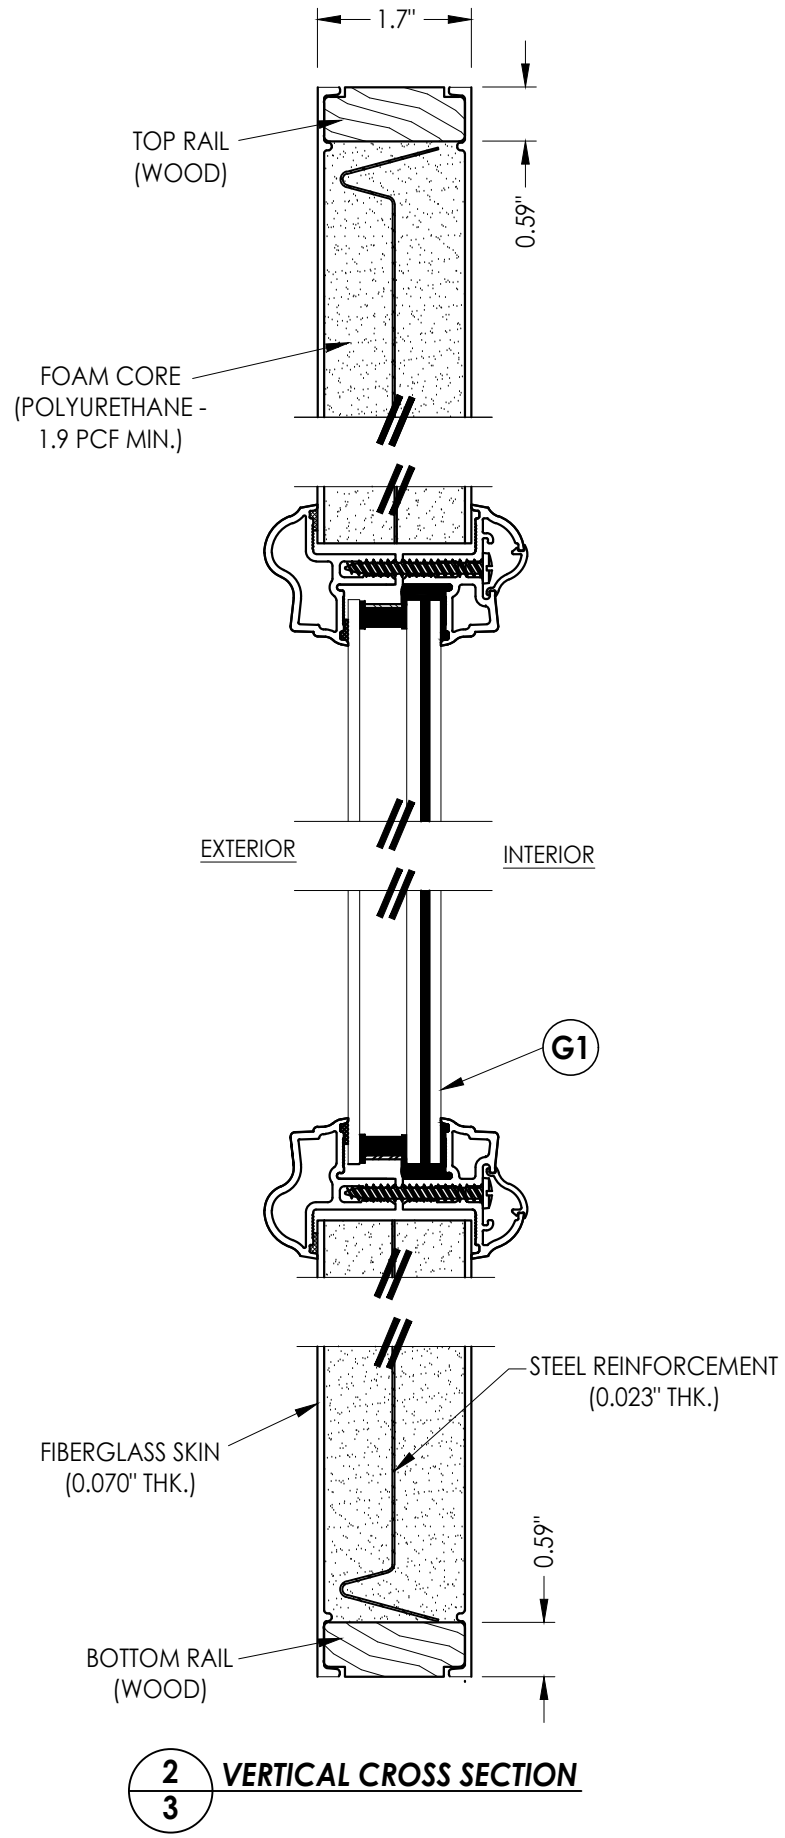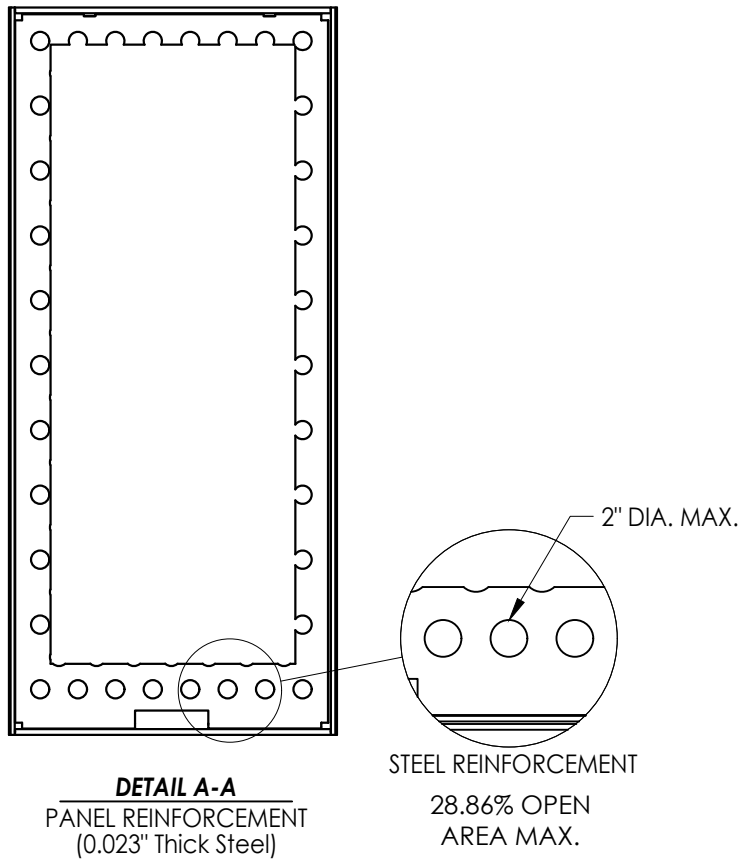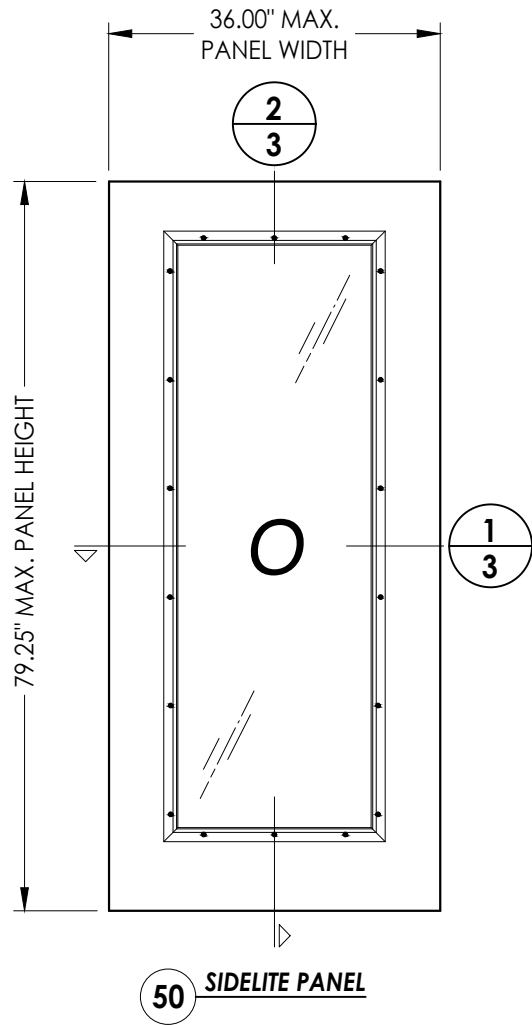


2
3 VERTICAL CROSS SECTION

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

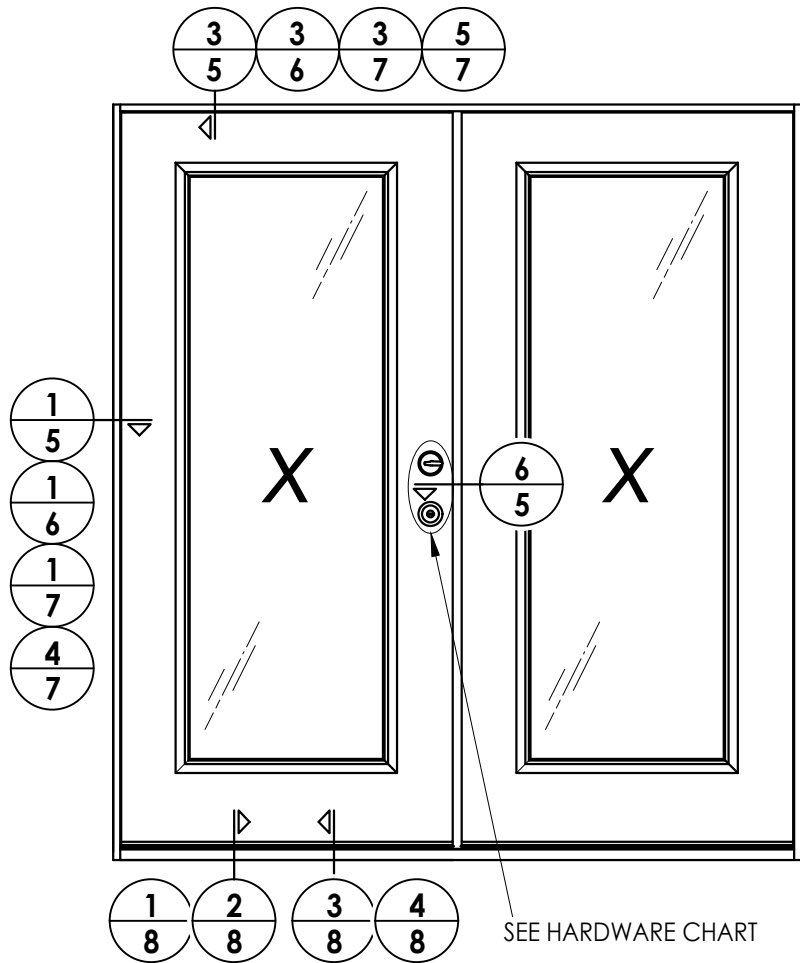

ELEVATION
XX

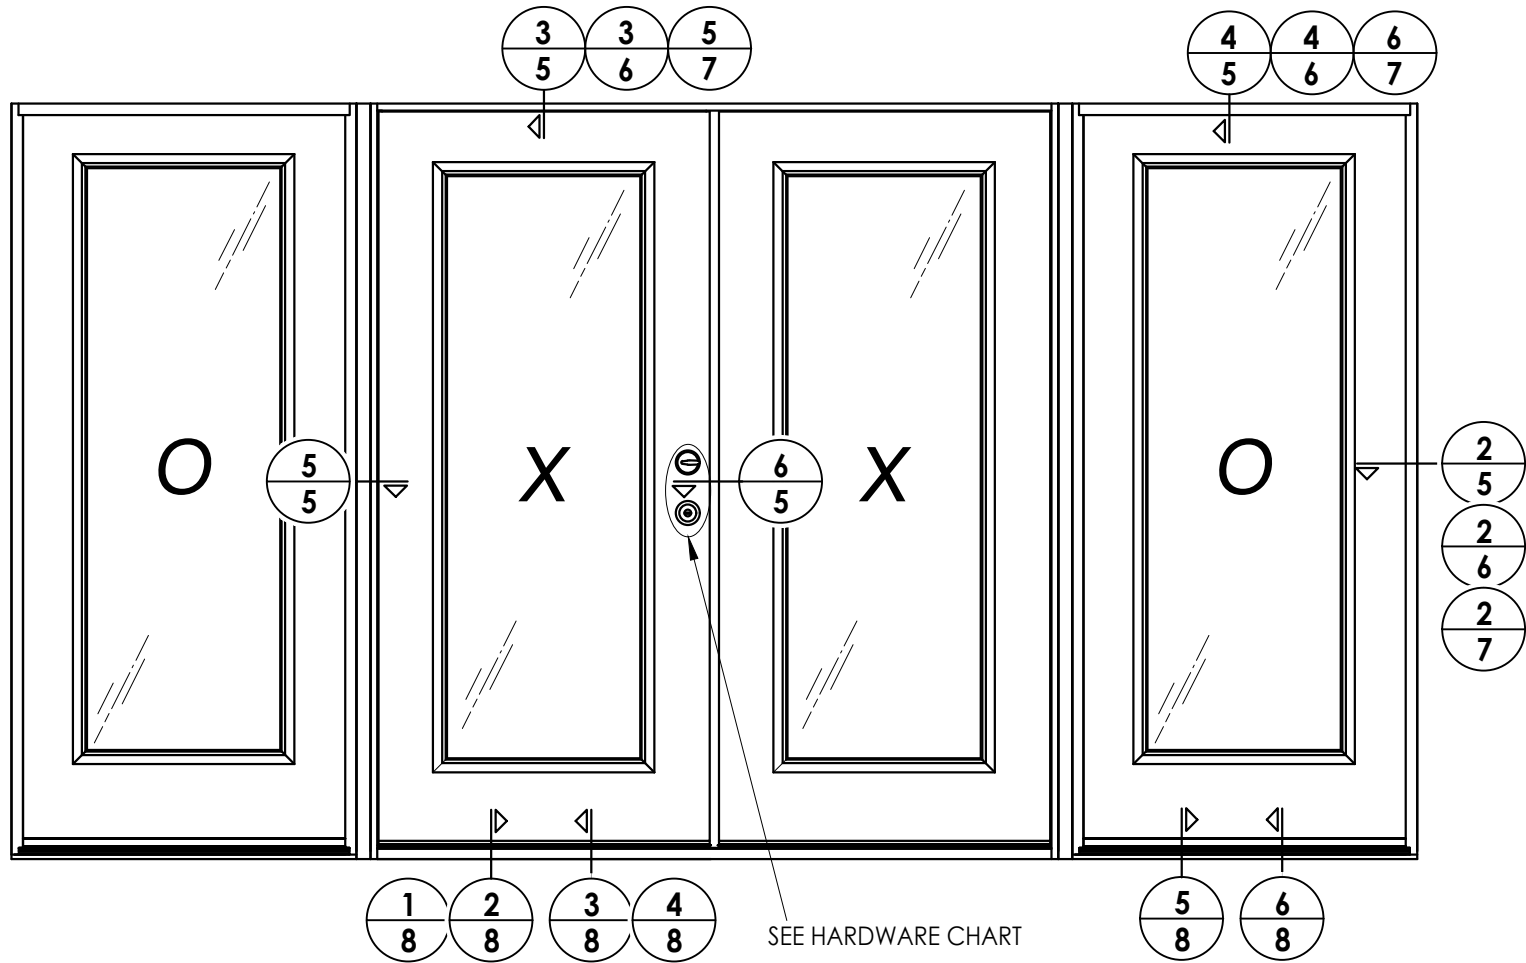

ELEVATION
OXXO

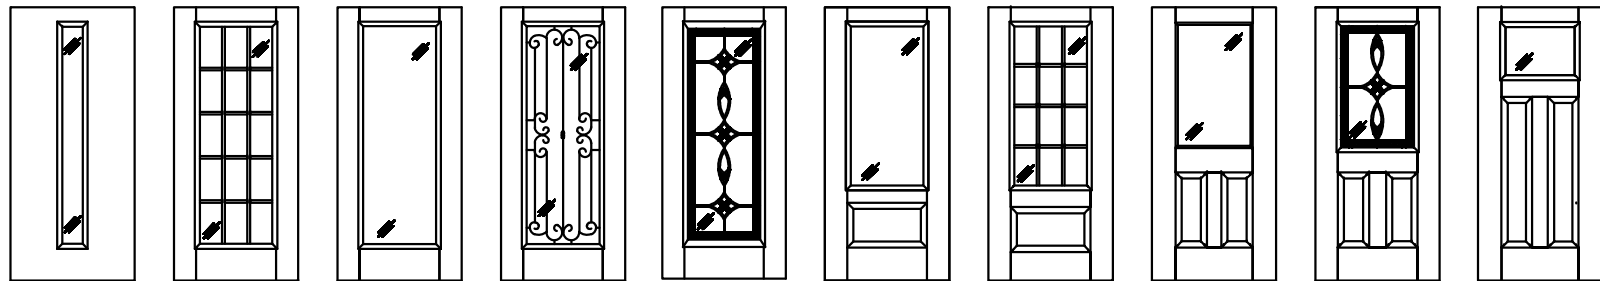

Fiber-Classic/Smooth-Star Door Panel Options

Panel options shown are for illustration and are representative only
(similar glazed panel configurations are allowed)

HARDWARE TABLE	
MANUFACTURER	MODEL
SCHLAGE	KNOB: F51
	DEADBOLT: B60
KWIKSET	KNOB: SIGNATURE SERIES
	DEADBOLT: SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGSB (3 pt. Manual Shootbolt)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

RW


PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS


REVISIONS	
NO.	DATE
3	7/02/26
2	8/18/23
1	7/15/20
DATE: 12/22/16	
SCALE: N.T.S.	
DWG. BY: JK	
CHK. BY: LFS	
DRAWING NO.: FL-21142.9	
SHEET 4 OF 14	

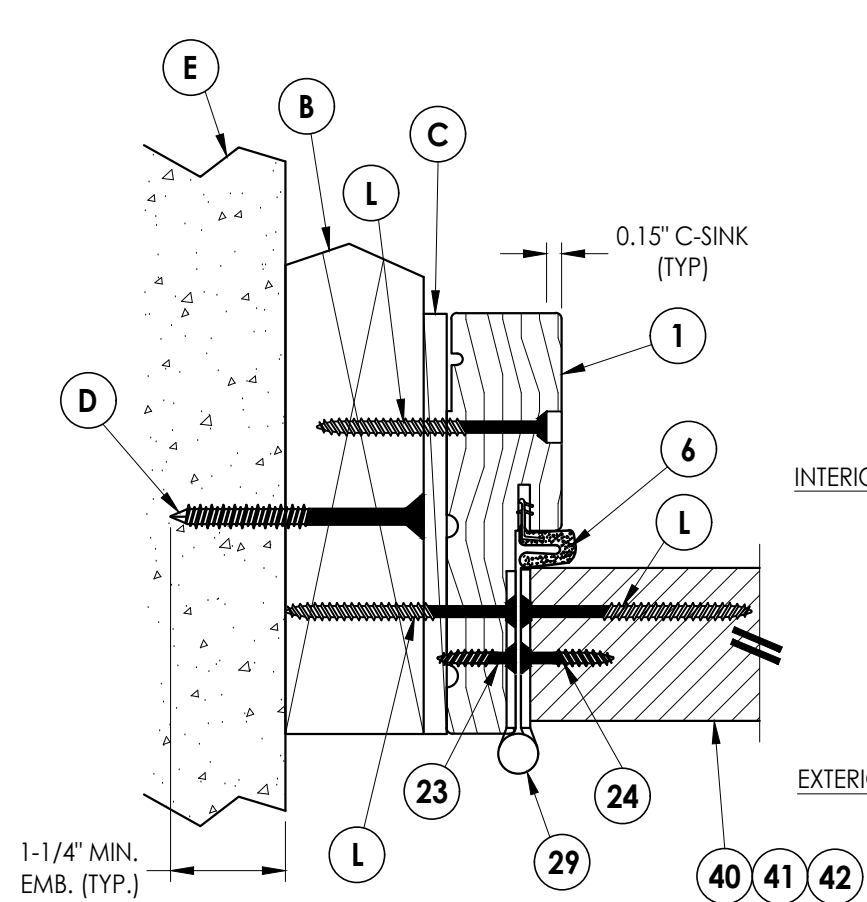


1 **HORIZONTAL CROSS SECTION**
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

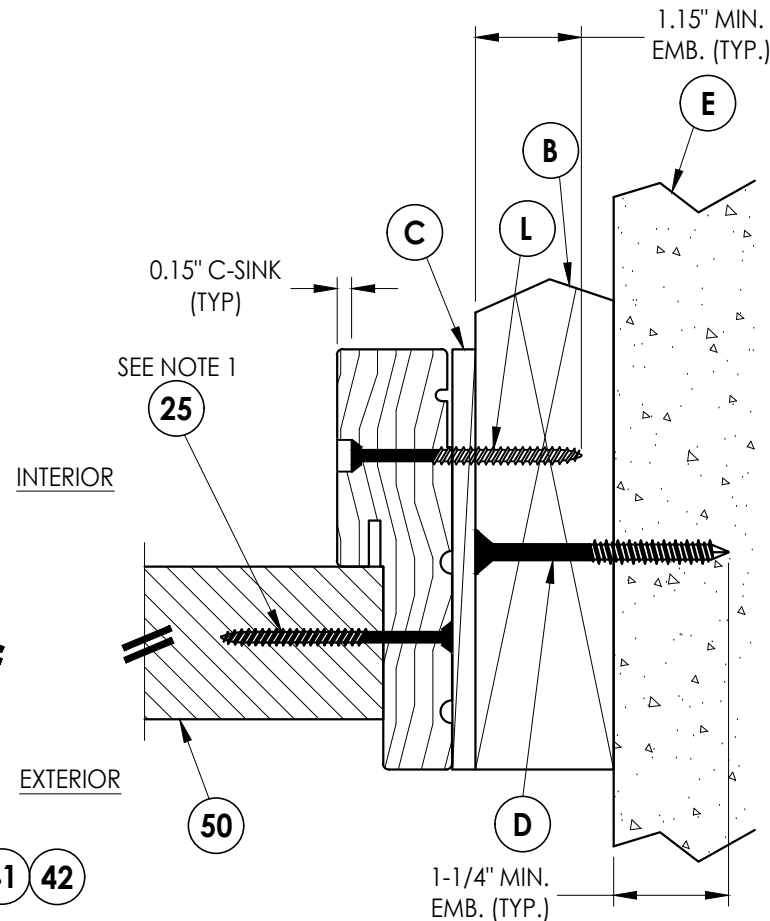


2 **HORIZONTAL CROSS SECTION**
5 Shown w/ 2X Buck
 Outswing shown (Inswing similar)

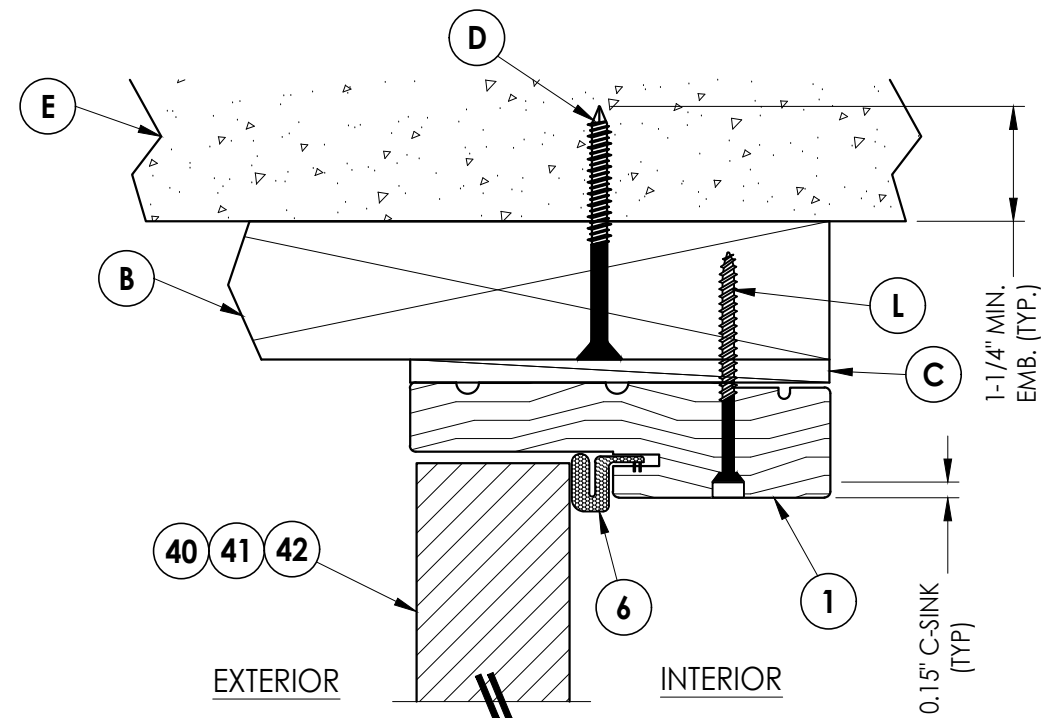


3 **VERTICAL CROSS SECTION**
5 Shown w/ 2X Buck
Outswing shown (Inswing similar)

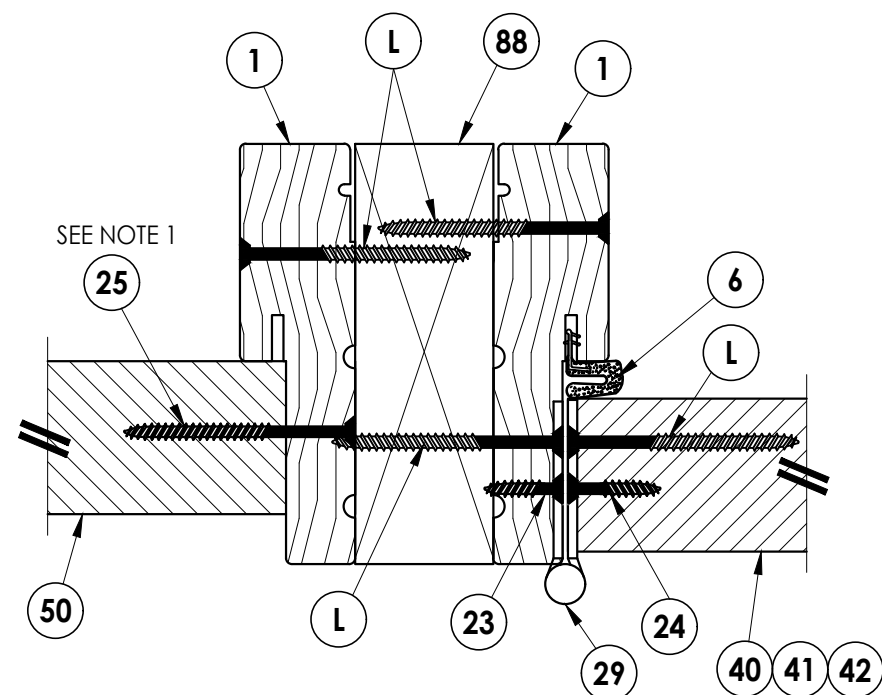

5 HORIZONTAL CROSS SECTION
5 Outswing shown (Inswing similar)

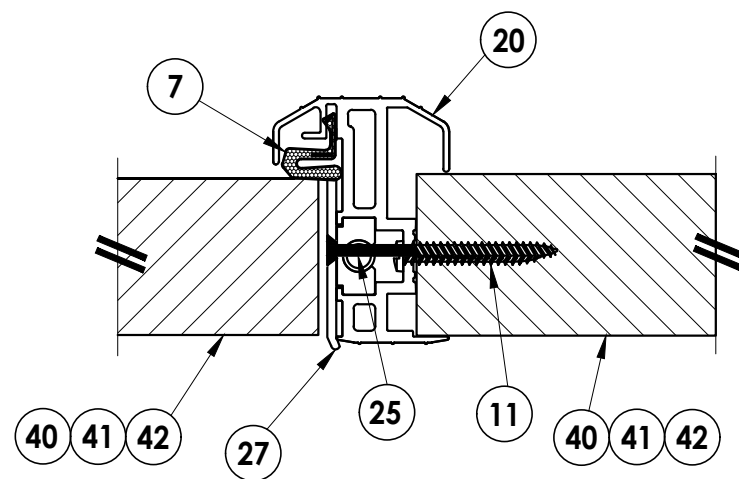

6 HORIZONTAL CROSS SECTION
5 Outswing shown (Inswing similar)

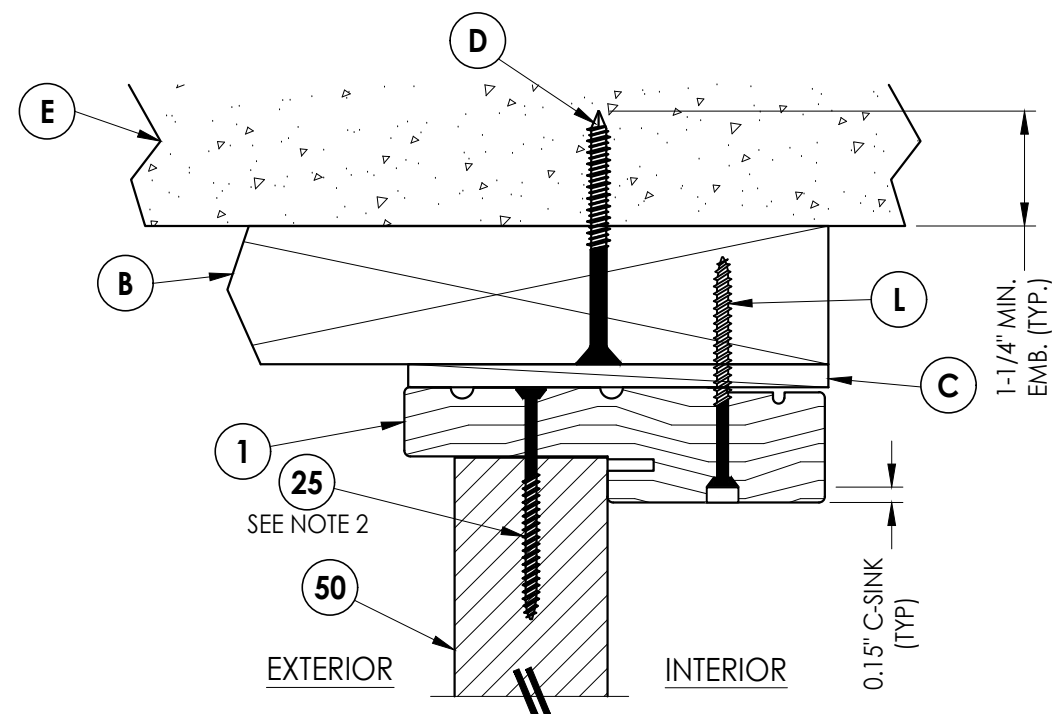

4 VERTICAL CROSS SECTION
5 Shown w/ 2X Buck
 Outswing shown (Inswing similar)

Notes:

1. Sidelite assembly screws located 6" from each end and 5 more screws equally spaced between (7 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PORT OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)


- Notes:
1. Sidelite assembly screws located 6" from each end and 5 more screws equally spaced between (7 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

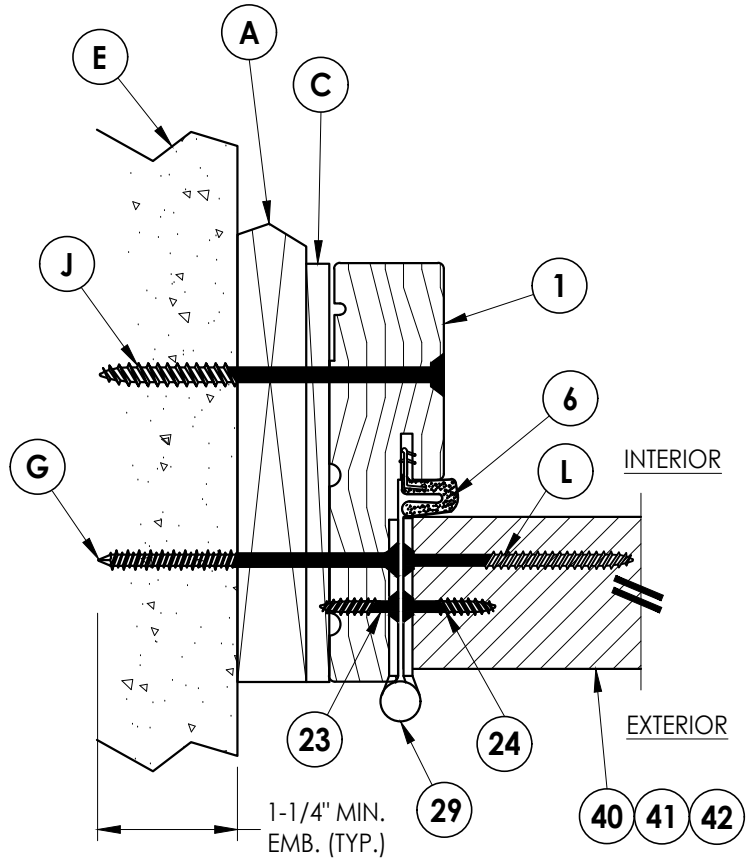


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

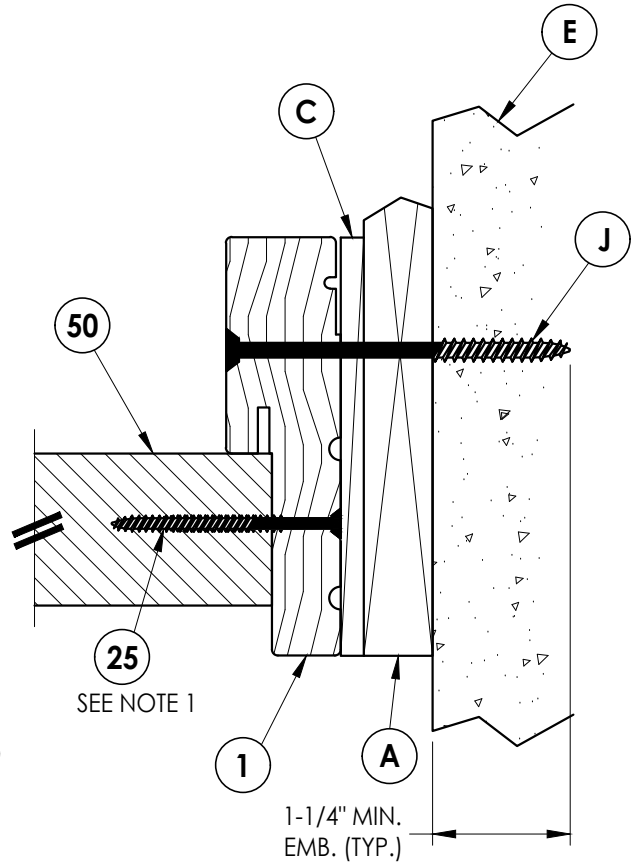

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

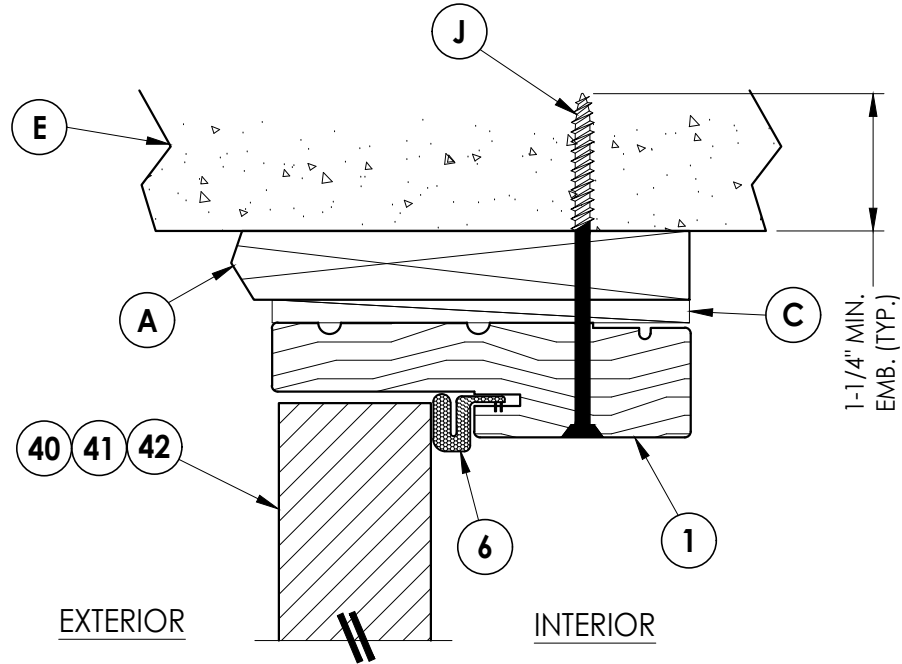

3
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

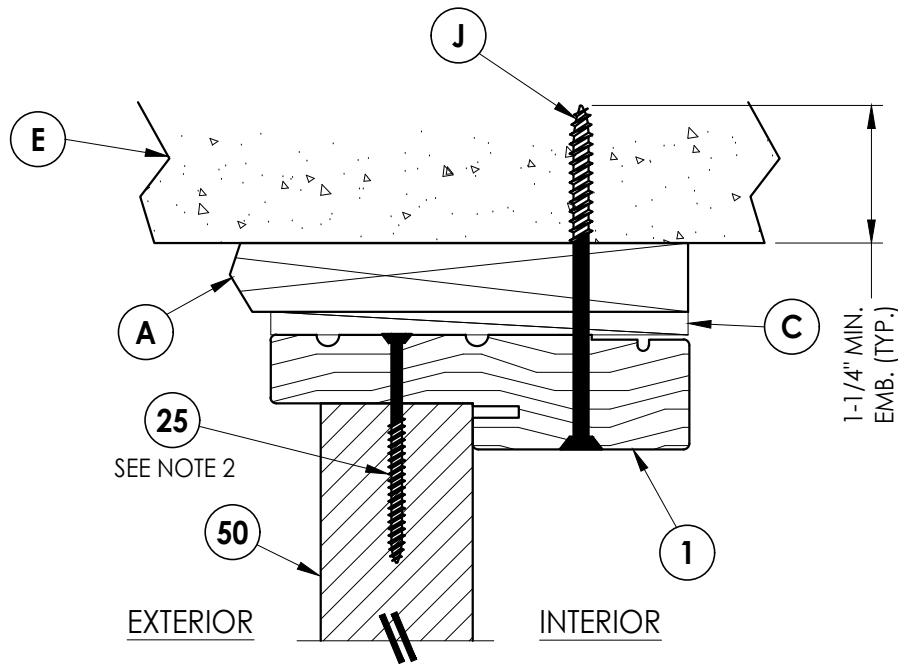

4
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)


REVISIONS		NO.	DATE	BY
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC	PO

DATE: 12/22/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21142.9
SHEET 6 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

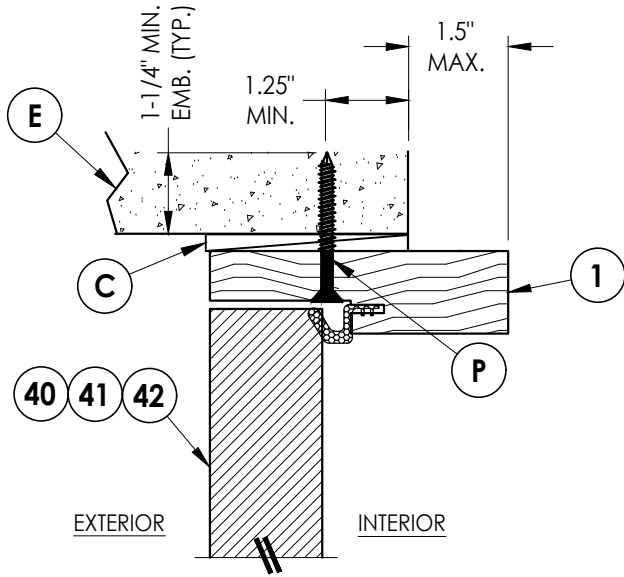

3
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

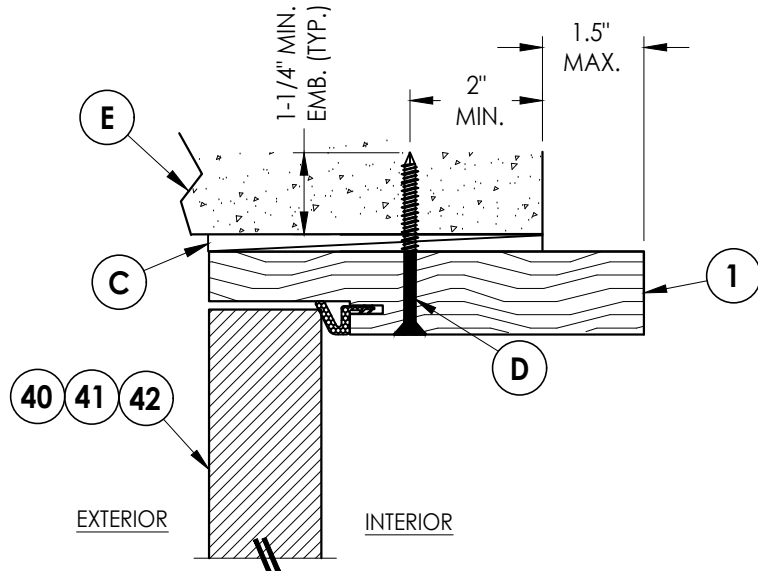


5
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

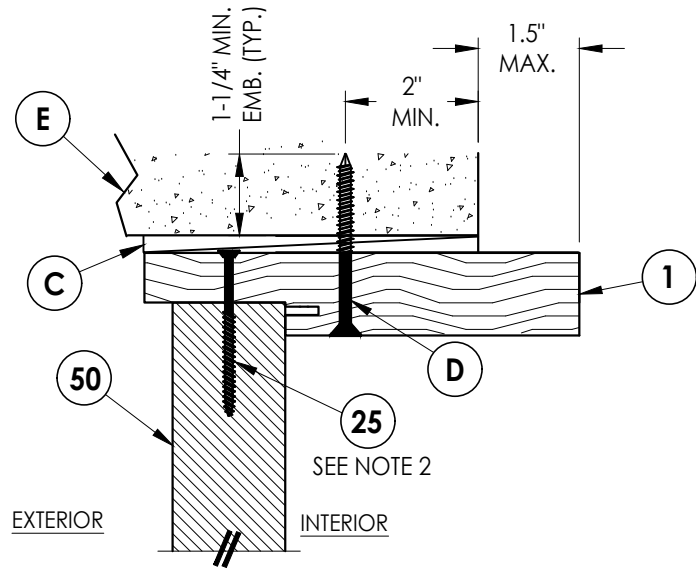


6
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb


- Notes:
1. Sidelite assembly screws located 6" from each end plus 5 more equally spaced between (7 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

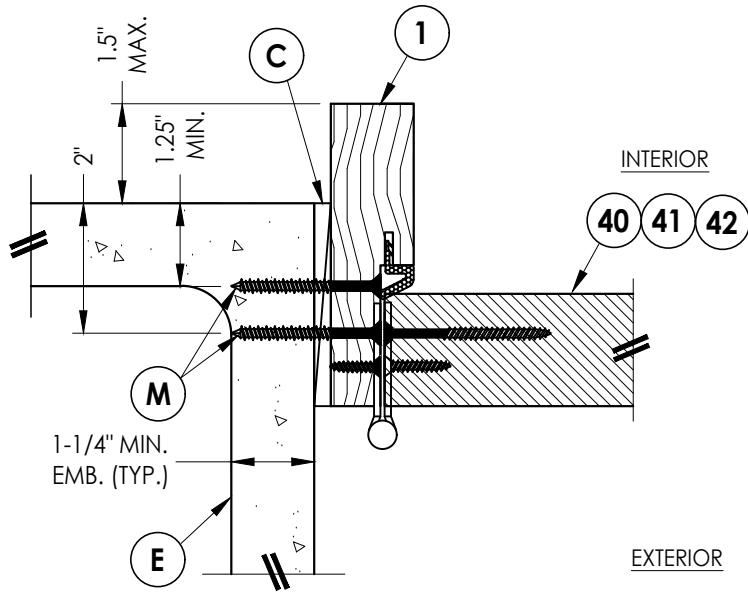

1
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

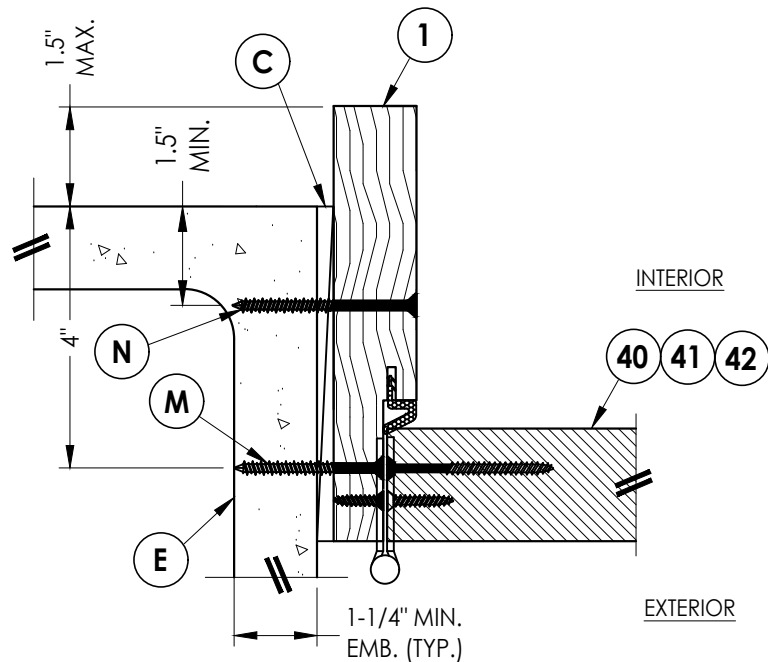

4
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

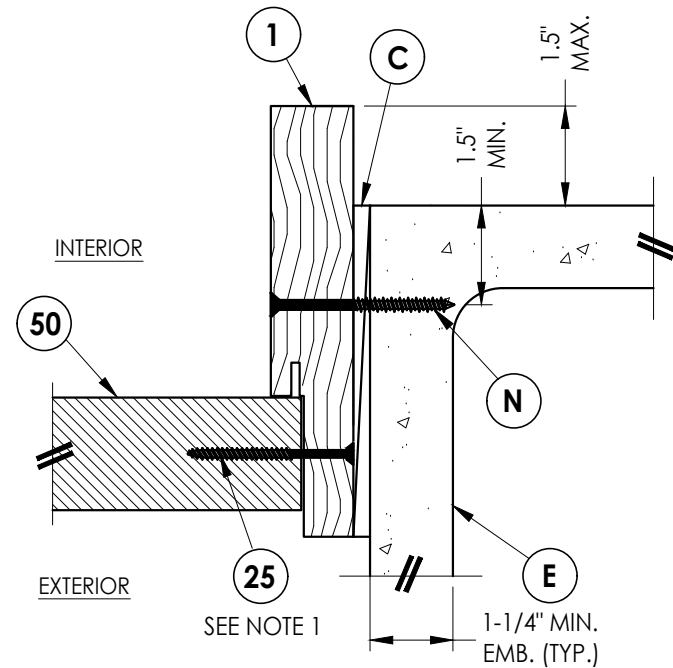

2
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813







PRODUCT: THERMA-TRU
FIBERGLASS DOOR
PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO
		BY

DATE: 8/10/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.:
FL-21142.9
SHEET 7 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

- Notes:
- Sill Item #'s 17, 18, 32, 34, 35, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 16 & 33 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - Sidelite assembly screws located 3" from each end & at centerline (3 screws along sill).

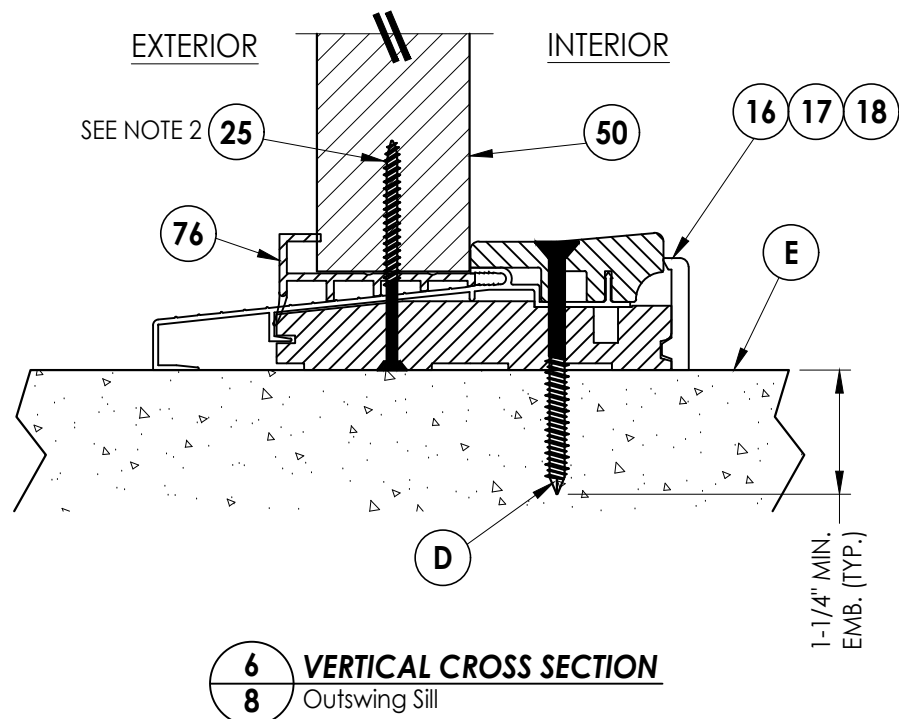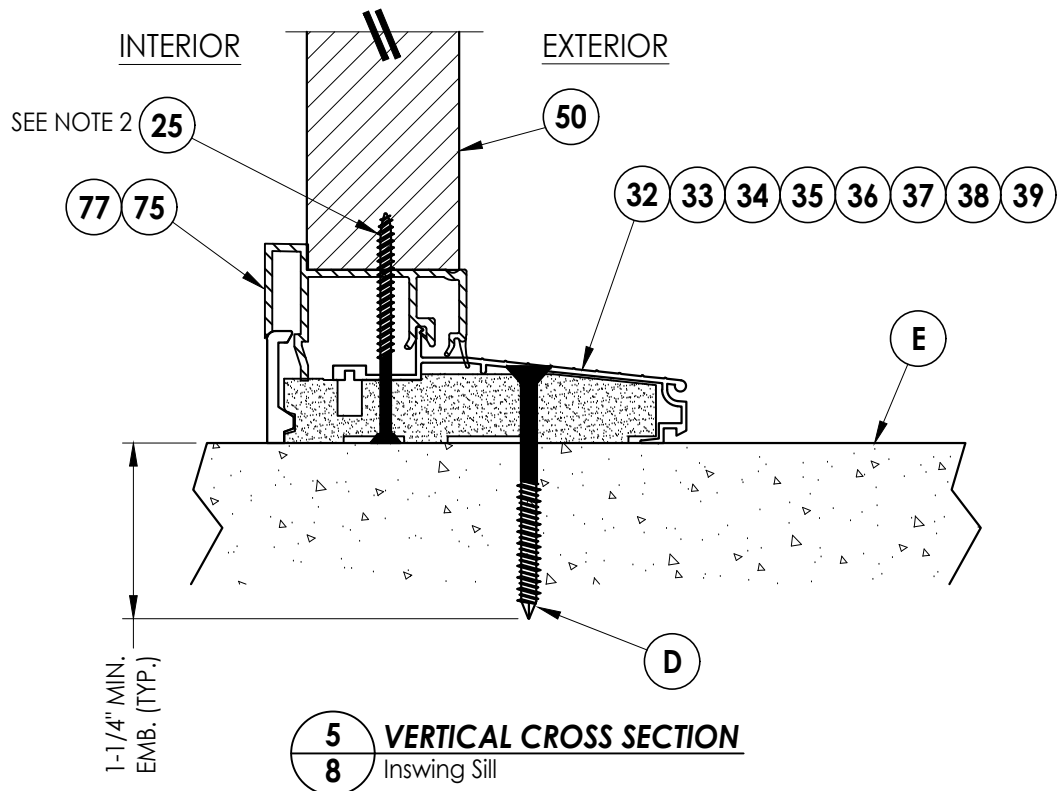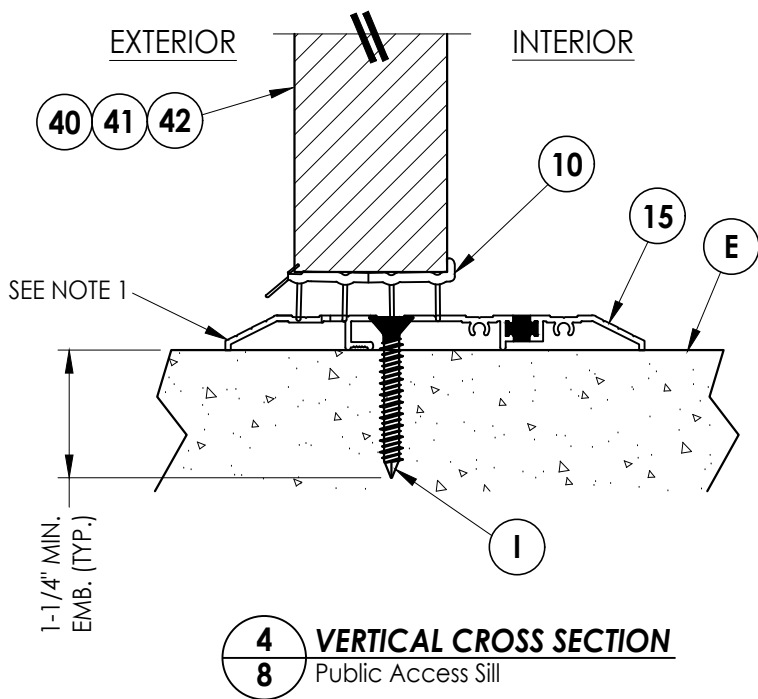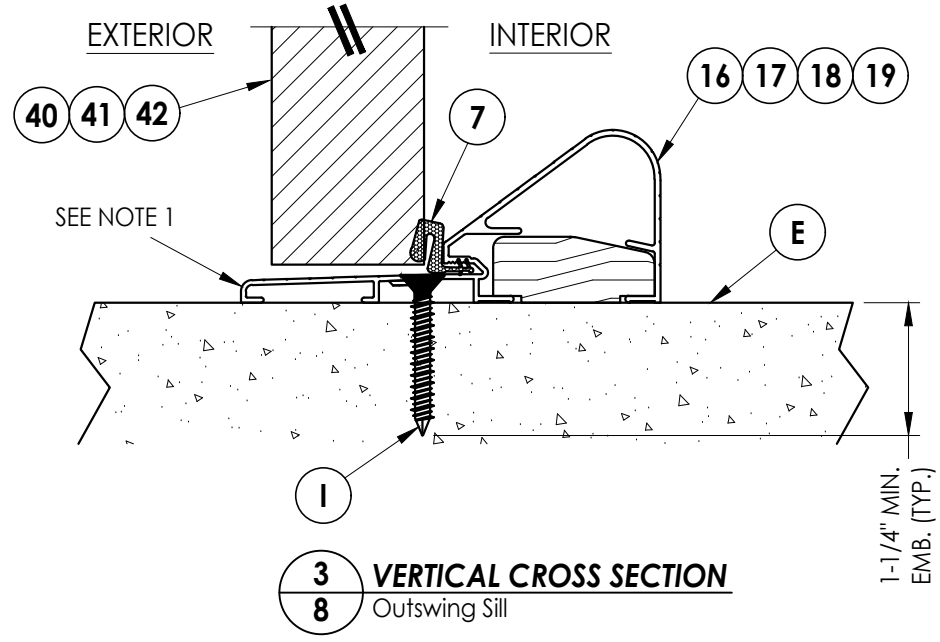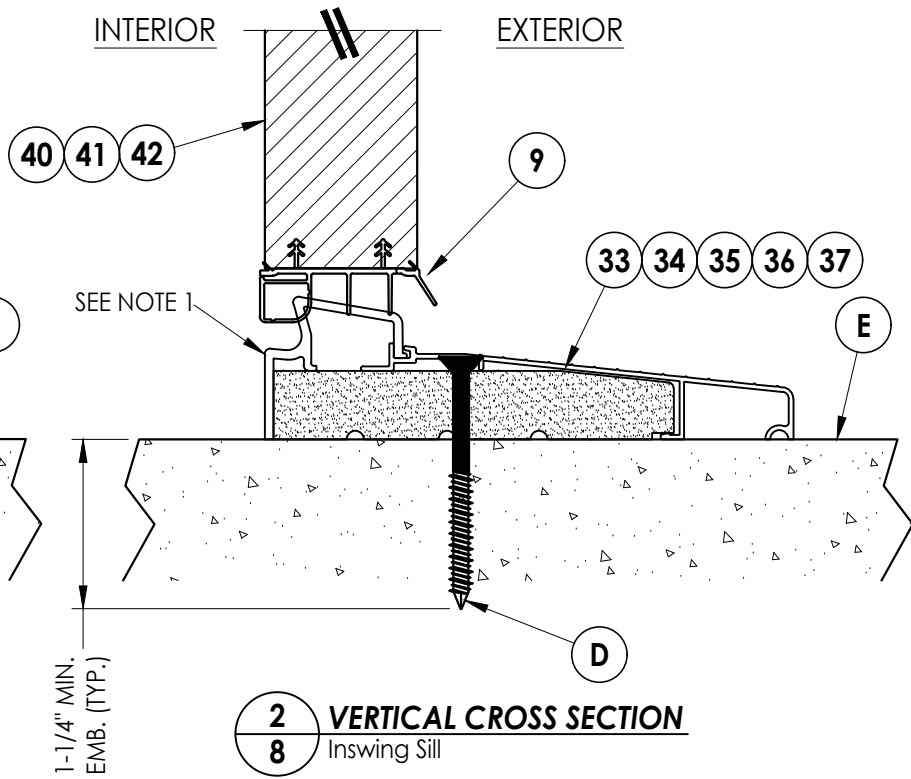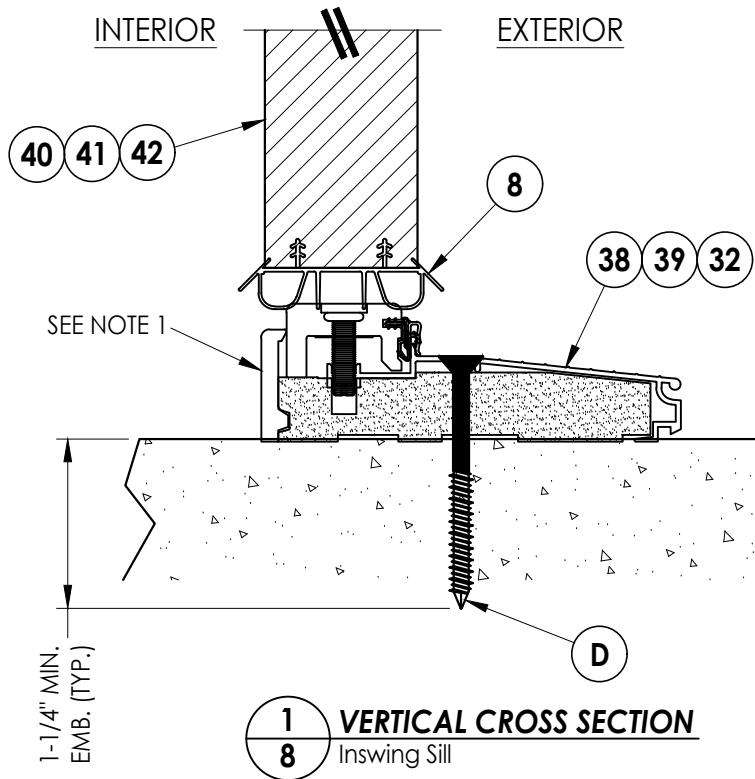

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO
		BY
DATE: 12/22/16		
SCALE: N.T.S.		
DWG. BY: JK		
CHK. BY: LFS		
DRAWING NO.: FL-21142.9		
SHEET 8 OF 14		

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

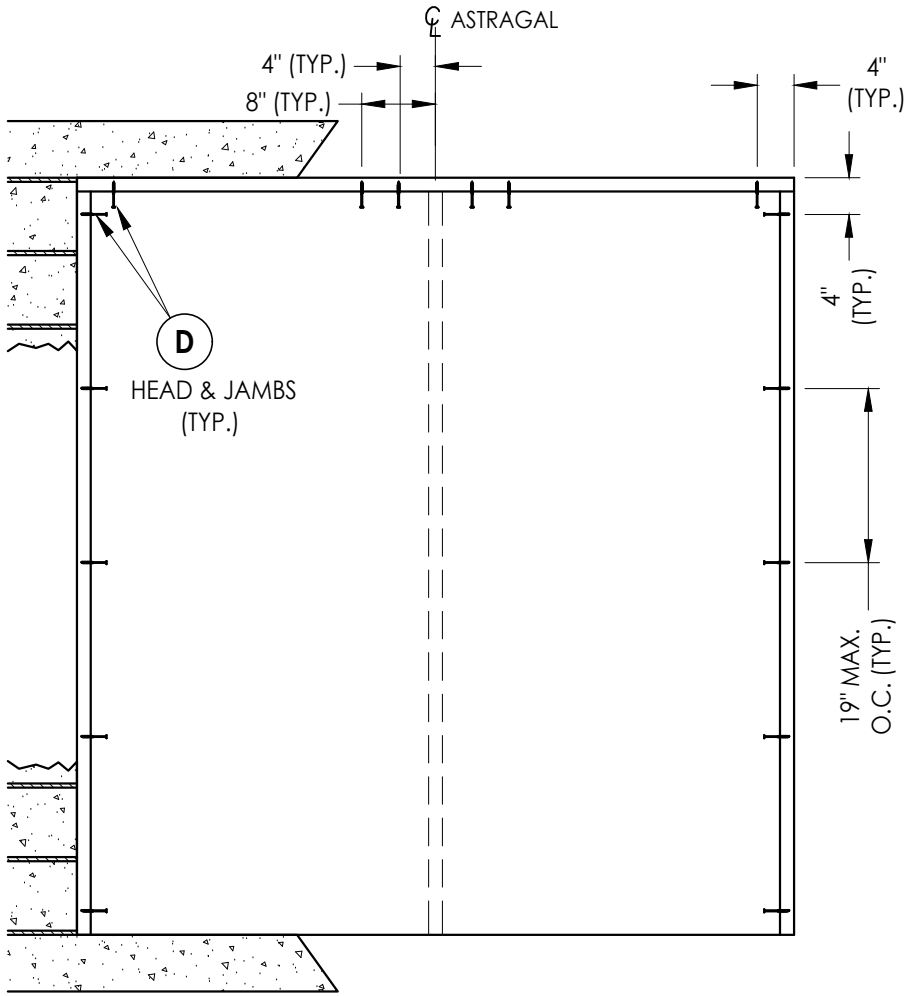

XX

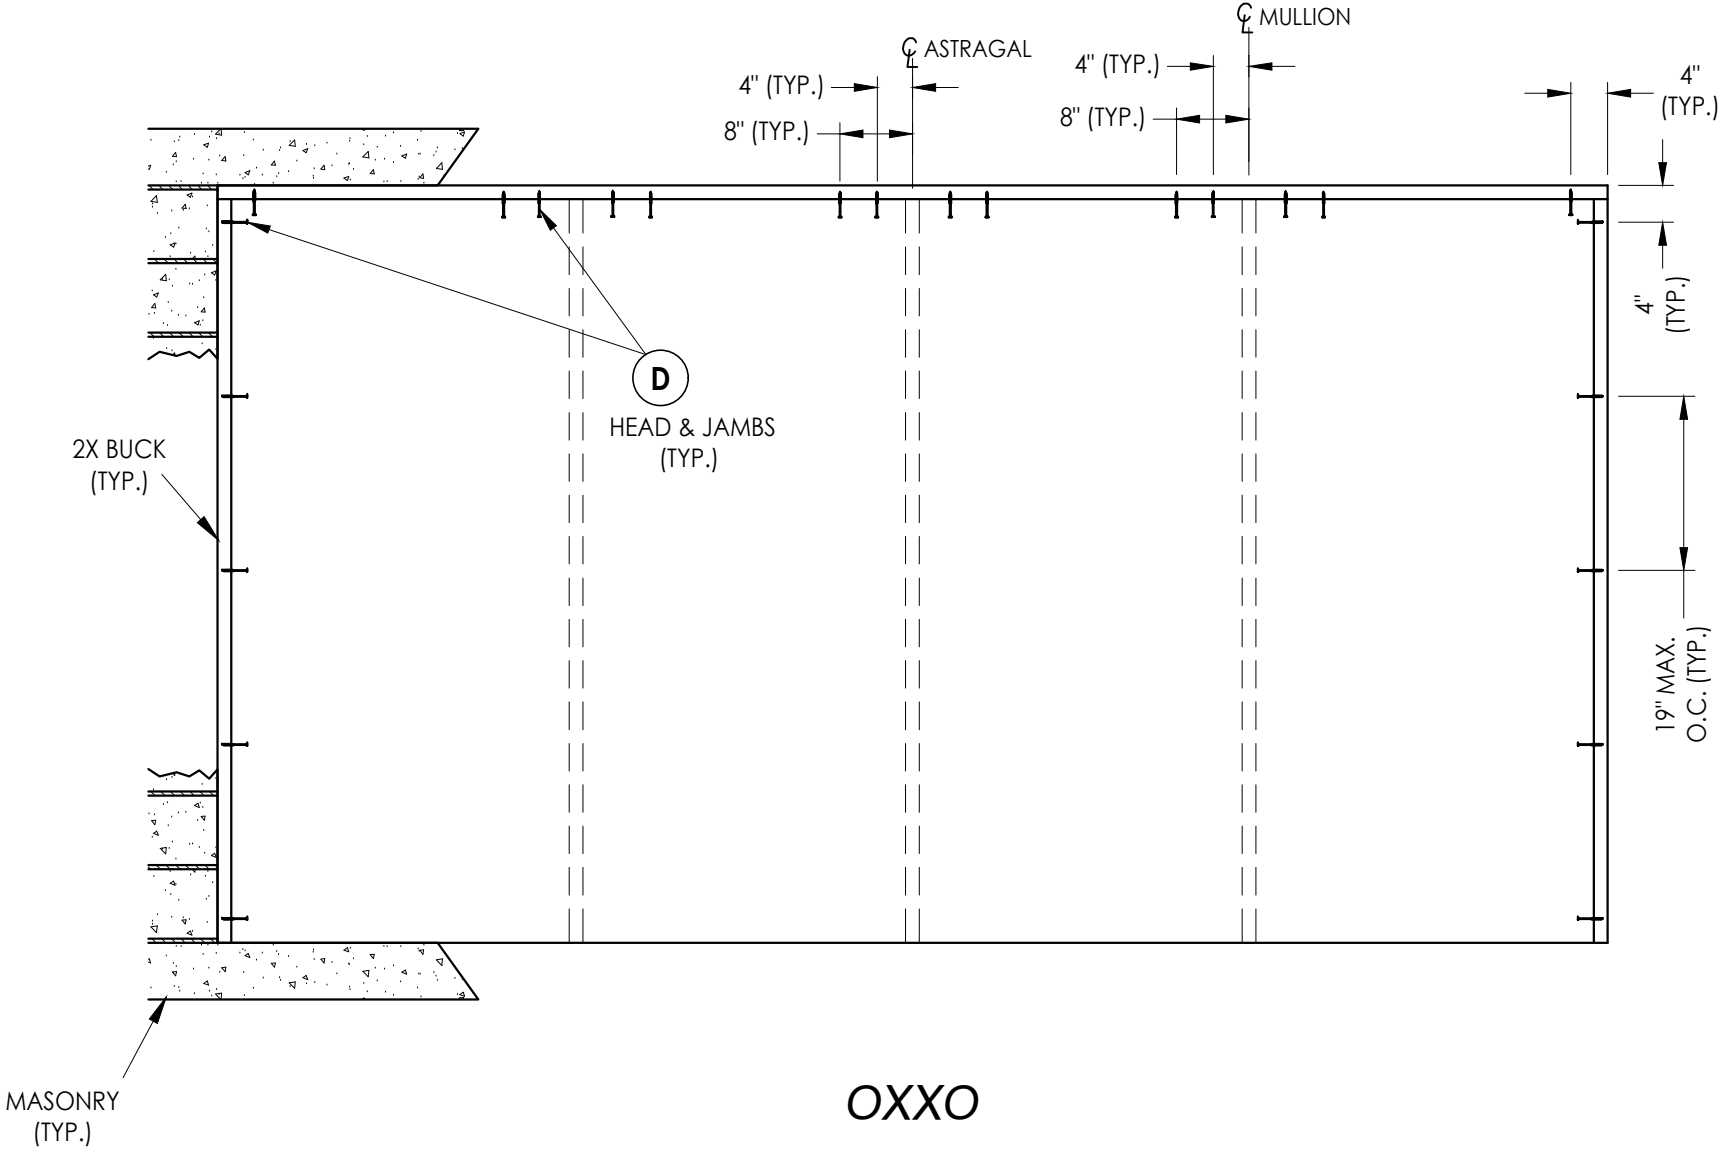

OXXO

2X BUCK ANCHORING

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-21142.9

SHEET 9 OF 14

PRODUCT:

Therma-Tru
FIBERGLASS DOOR

PART OR ASSEMBLY:

BUCK ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409



BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

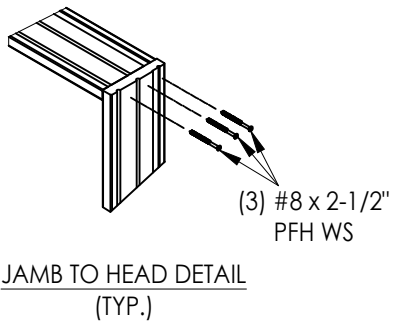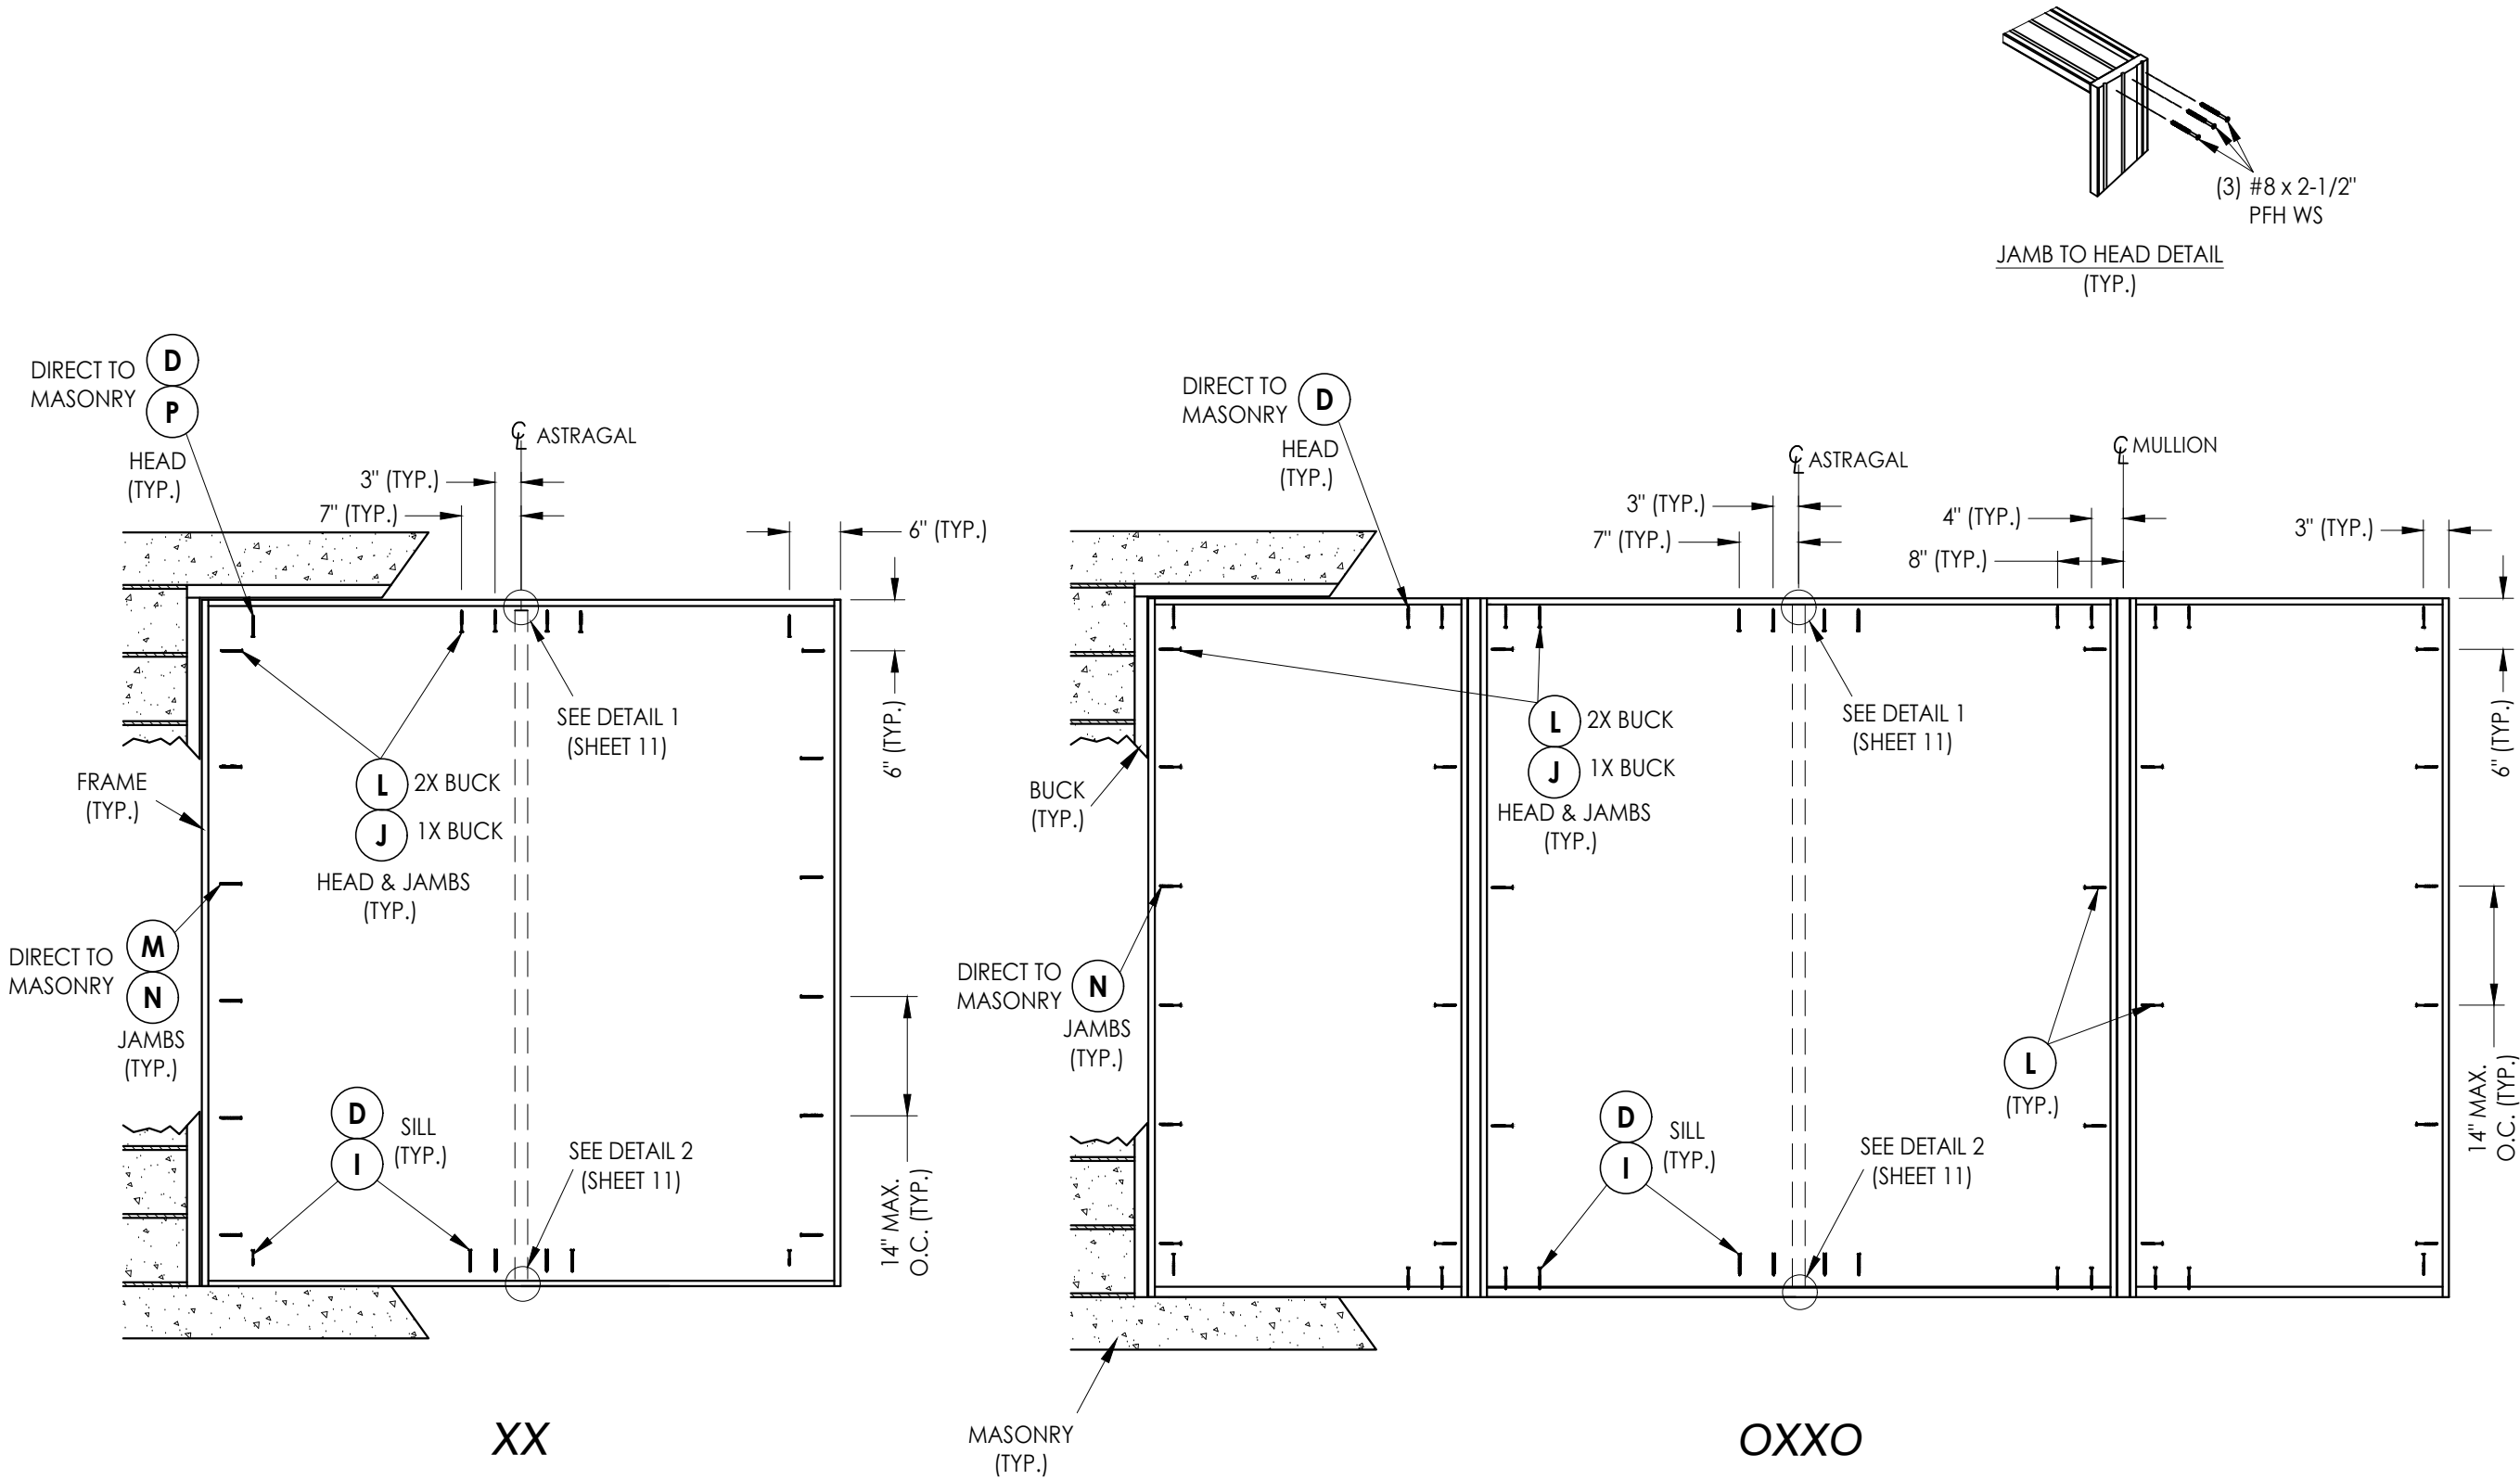

FRAME ANCHORING


PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		FRAME ANCHORING	
NO.	DATE	BY	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7TH ED. (2020)	FBC PO

DATE:	12/22/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21142.9
SHEET	10 OF 14


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

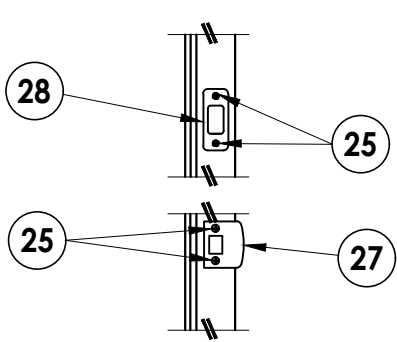


LATCH & DEADBOLT DETAIL
Schlage / Kwikset

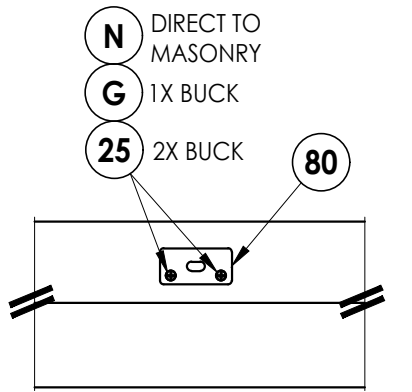


DETAIL 1
Coastal Astragal Strike Plate @ Head

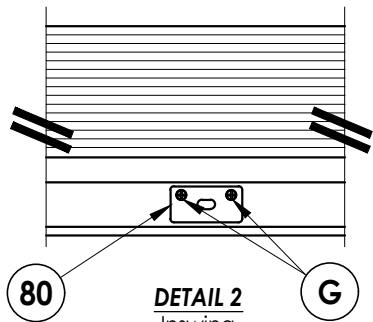


DETAIL 2
Inswing
Coastal Astragal Strike Plate @ Sill

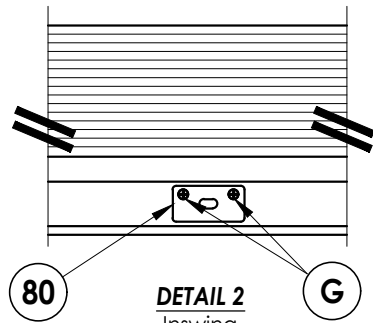

DETAIL 2
Inswing
Coastal Astragal Strike Plate @ Sill

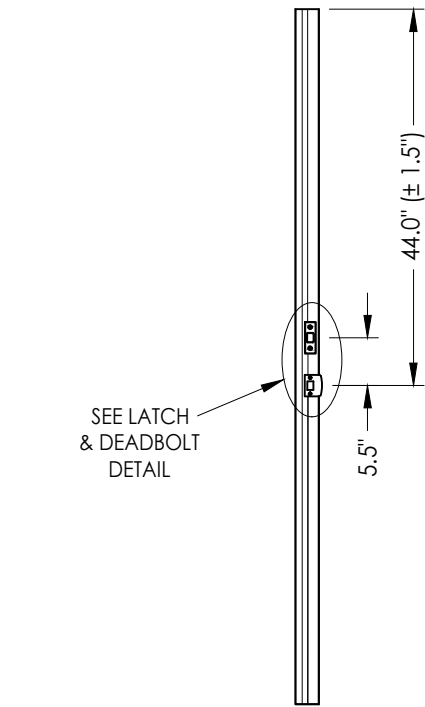


ASTRAGAL
Latch and Deadbolt

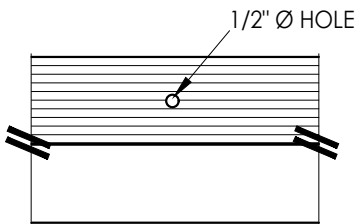


DETAIL 2
Outswing
Astragal Bolt Hole @ Sill


LATCH & DEADBOLT STRIKE DETAILS

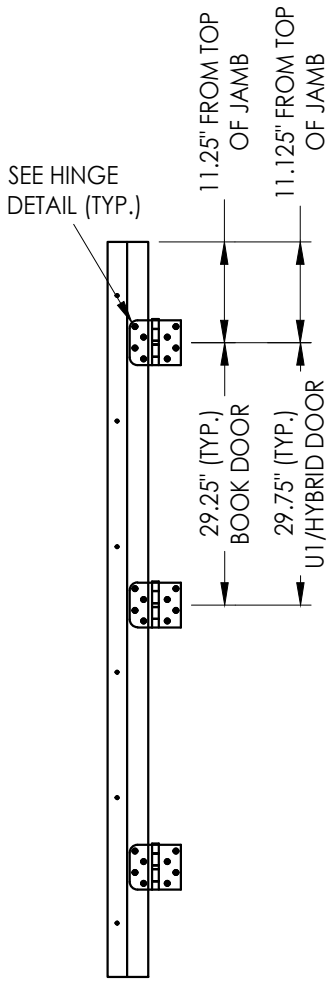


HINGE JAMB

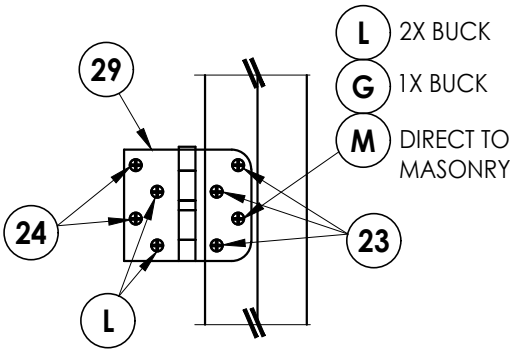


HINGE DETAIL

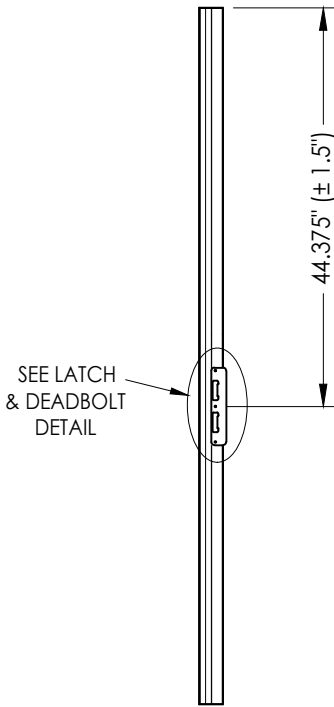


ASTRAGAL
Multipoint Lock

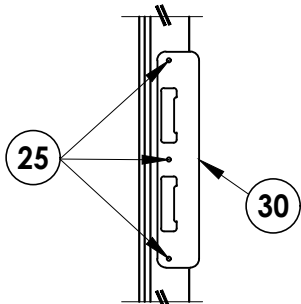


LATCH & DEADBOLT DETAIL
Multipoint Lock

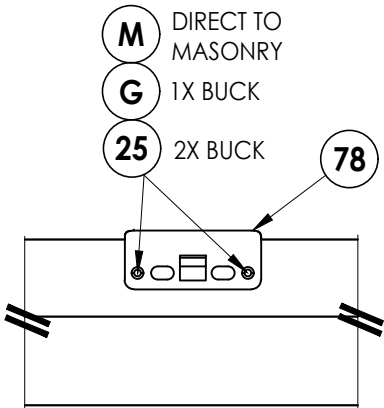

DETAIL 1
Multipoint Lock Strike Plate @ Head

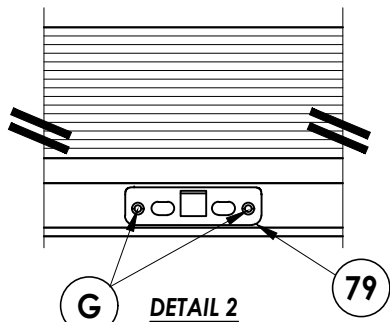

DETAIL 2
Inswing
Multipoint Lock Strike Plate @ Sill

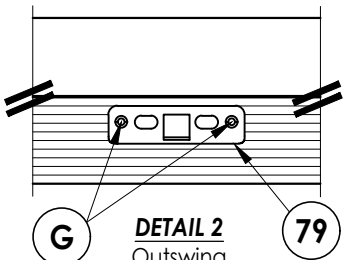

DETAIL 2
Outswing
Multipoint Lock Strike Plate @ Sill

MULTIPOINT LOCK STRIKE DETAILS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


RW

PRODUCT:	THERMA-TRU FIBERGLASS DOOR	
	PART OR ASSEMBLY: HARDWARE DETAILS	


NO.	DATE	REVISIONS			
		BY	PO	LFS	FBC
3	7/02/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
2	8/18/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
1	7/15/20	UPDATE TO 7th ED	(2020)	FBC	PO

DATE:	12/22/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21142.9
SHEET	11 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

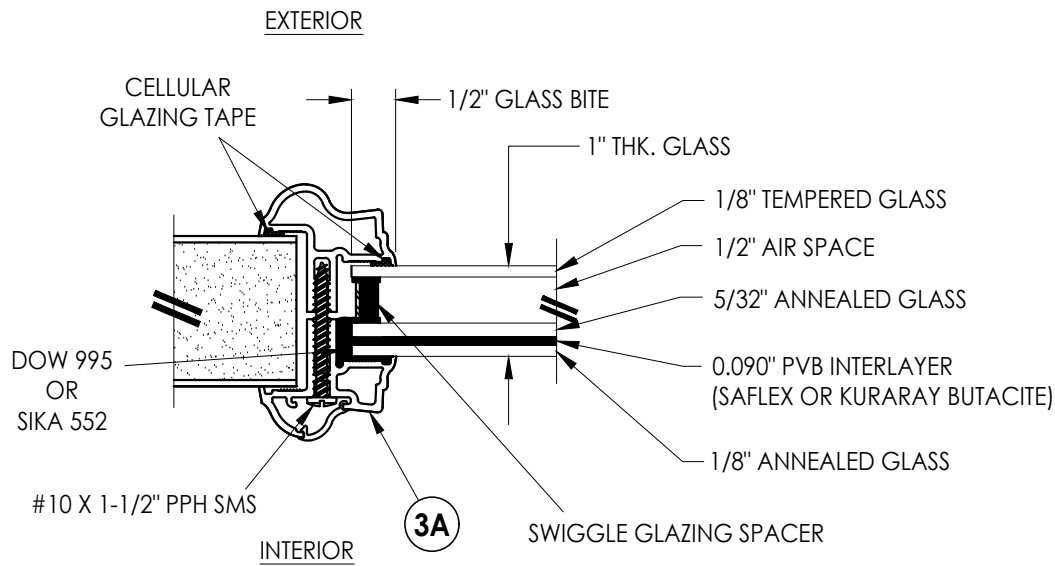


G1 GLAZING DETAIL
Aluminum Impact Lite Frame
Door Panels & Sidelites

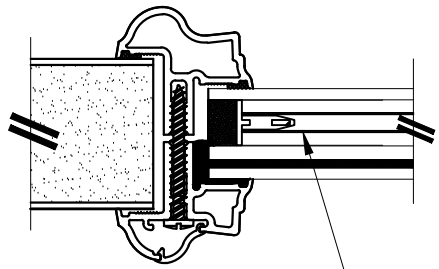


INTERNAL GRID (GBG)

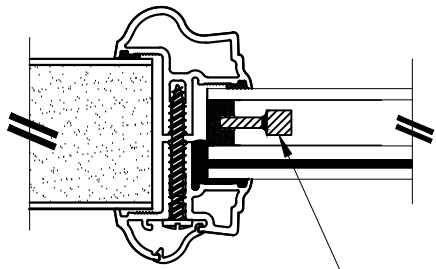

WROUGHT IRON INSERT

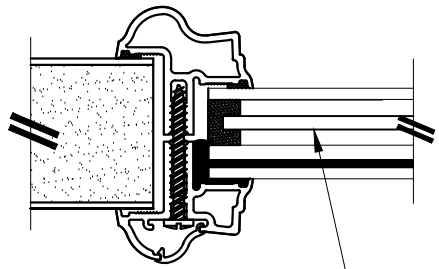


PRIVACY INSERT

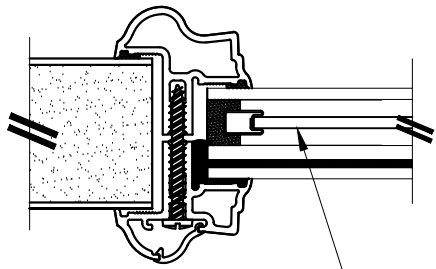


DECORATIVE INSERT

1" LAMINATED INSULATED IMPACT GLASS INSERT OPTIONS

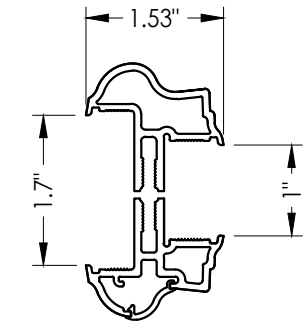

3A ALUMINUM FRAME
Aluminum Impact Lite Frame
Door Panels & Sidelites

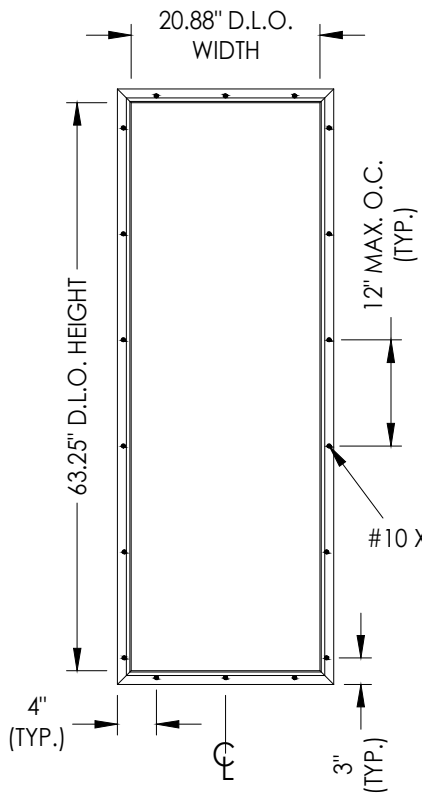

ALUMINUM LITE FRAME

#10 X 1-1/2" PPH SMS
(TYP.)

PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		GLAZING DETAILS	
NO.	DATE	REVISIONS	BY
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/15/20	UPDATE TO 7TH ED (2020) FBC	PO

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:


FL-21142.9

SHEET 12 OF 14


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

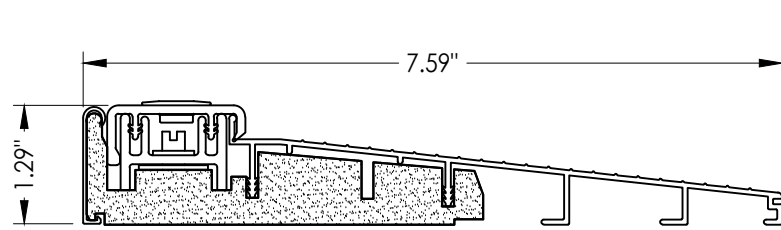


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

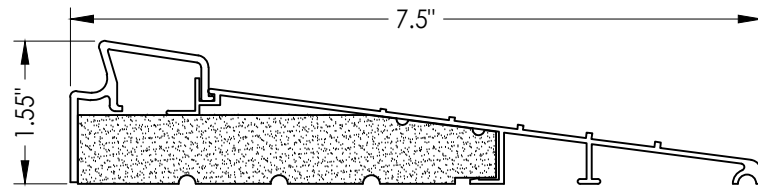


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

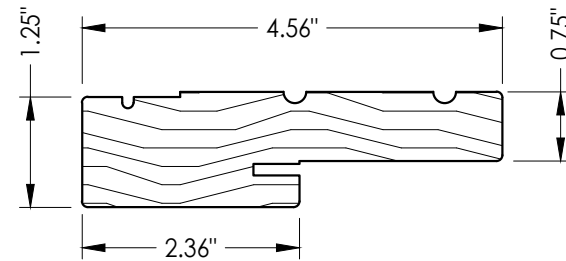


1 WOOD JAMB

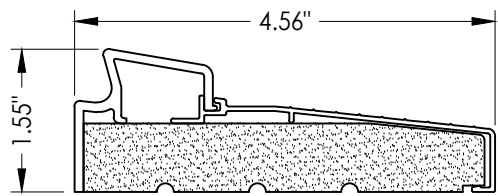


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

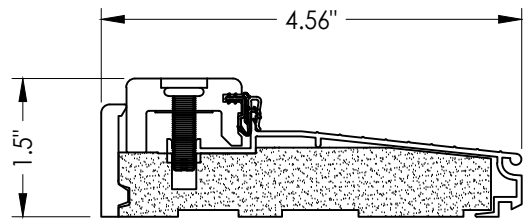


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

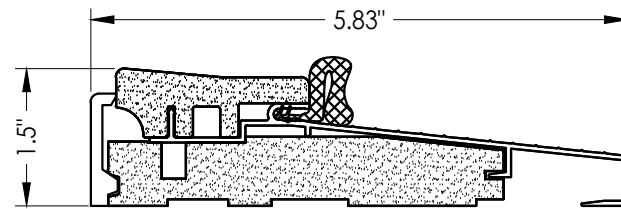


16 OUTSWING THRESHOLD
Composite Sill

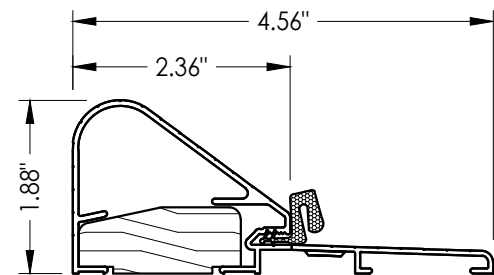


19 COASTAL OUTSWING THRESHOLD
Wood / Aluminum Sill

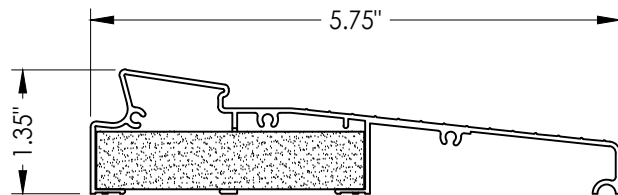


34 INSWING THRESHOLD
Inswing Moderate Climate Sill 1-3/8"

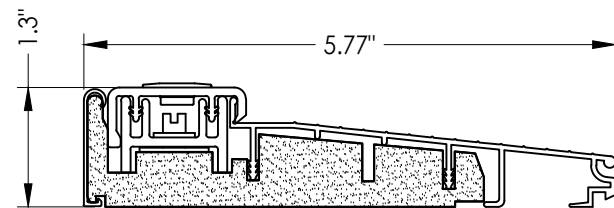


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

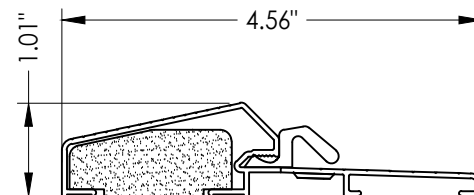


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

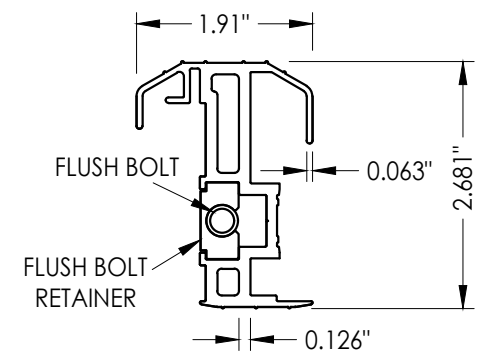


20 COASTAL ALUMINUM ASTRAGAL

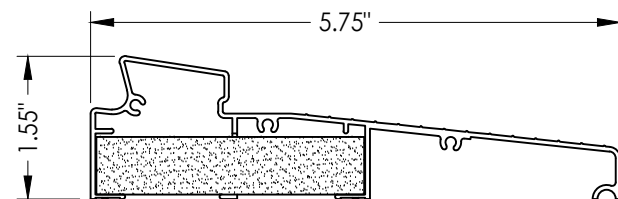


35 INSWING THRESHOLD
Inswing Moderate Climate Sill

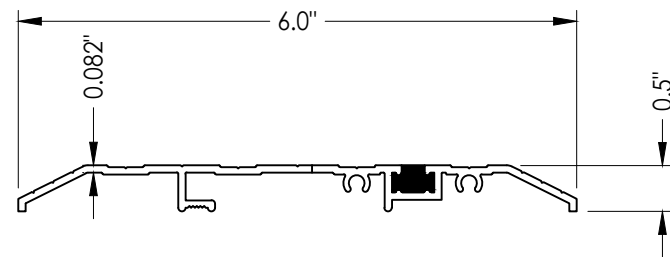


15 PUBLIC ACCESS THRESHOLD

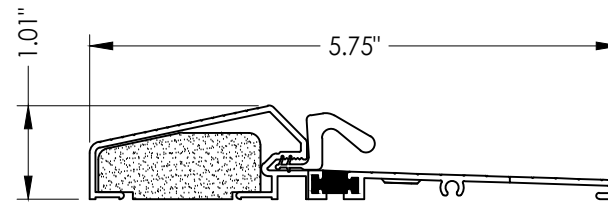


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

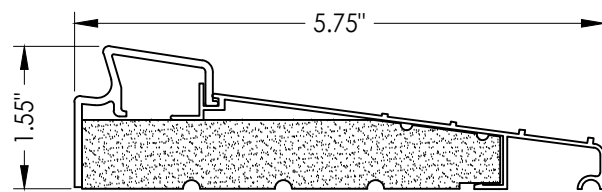


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

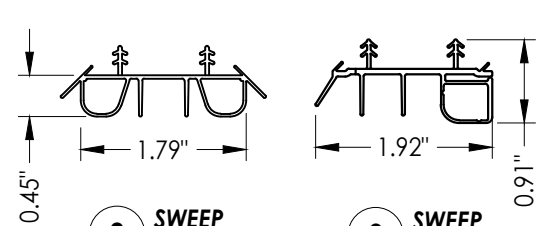


8 SWEEP




9 SWEEP




10 SWEEP

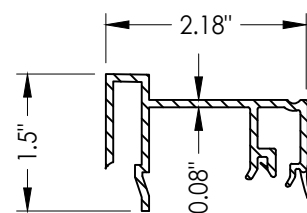

75 SIDELITE SPACER
Inswing



76 SIDELITE SPACER
Outswing

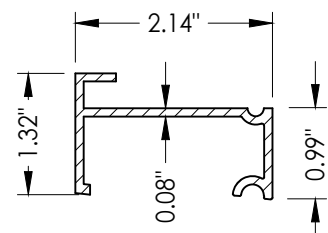

77 SIDELITE SPACER
Inswing
Moderate Climate Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS	BY
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
2	8/18/23	UPDATE TO 8TH ED. (2023) FBC	LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC	PO

DATE: 12/22/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-21142.9
SHEET 13 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-21142 R4\FL-21142.7-9.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
P	1/4" X 2-3/4" PFH DeWALT CONCRETE SCREW	STEEL
1	JAMB (FINGER JOINT PINE)	WOOD
6	WEATHERSTRIP (MEDIUM REACH)	FOAM
7	WEATHERSTRIP (LONG REACH)	FOAM
8	SWEEP	VINYL
9	SWEEP (USE W/ MODERATE CLIMATE THRESHOLD)	VINYL
10	SWEEP (USE W/ PUBLIC ACCESS THRESHOLD)	VINYL
11	#10 X 1-3/4" PFH WOOD SCREW	STEEL
15	PUBLIC ACCESS THRESHOLD	ALUM
16	OUTSWING THRESHOLD	ALUM/COMP
17	OUTSWING THRESHOLD	ALUM/COMP
18	OUTSWING THRESHOLD	ALUM/COMP
19	COASTAL OUTSWING THRESHOLD	ALUM/WOOD
20	COASTAL ALUMINUM ASTRAGAL	ALUM
23	#10 x 3/4" PFH WOOD SCREW	STEEL
24	#10 x 1" PFH WOOD SCREW	STEEL

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
26	#8 x 5/8" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE	STEEL
29	4" X 4" HINGE	STEEL
32	INSWING THRESHOLD	ALUM/COMP
33	INSWING THRESHOLD	ALUM/COMP
34	INSWING THRESHOLD	ALUM/COMP
35	INSWING THRESHOLD	ALUM/COMP
36	INSWING THRESHOLD	ALUM/COMP
37	INSWING THRESHOLD	ALUM/COMP
38	INSWING THRESHOLD	ALUM/COMP
39	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL (BOOK)	-
41	DOOR PANEL (HYBRID)	-
42	DOOR PANEL (U1)	-
50	SIDELITE	-
75	SIDELITE SPACER (INSWING)	PVC
76	SIDELITE SPACER (OUTSWING)	PVC
77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
78	MULTIPOINT LOCK STRIKE PLATE @ HEAD	STEEL
79	MULTIPOINT LOCK STRIKE PLATE @ SILL	STEEL
80	ASTRAGAL STRIKE PLATE	STEEL
88	2X MULLION (SG >= 0.55)	WOOD

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS

DATE: 12/22/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-21142.9

SHEET 14 OF 14

REVISIONS

3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/18/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/15/20	UPDATE TO 7th ED. (2020)	FBC	PO
	NO	DATE		BY

BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

© 2016 R.W. BUILDING CONSULTANTS INC.