



H3 2.0 Awning Operator 2-Wide 48 x 48
Overall Mull Unit Size 94 1/2" x 47 1/2"
Integral Nail Fin Installation

CCL Listing# 436-H-659.12,14

ELEMENT TEST REPORT NUMBER: **ESP023257P-1988**

H3 2.0 MULLED 2-WIDE Awning Operating Window
Integral Nail Fin Installation / WDMA Instructions / Non-Impact

SHEET: 1 OF 2


DRAWN BY: B.K.

TEST REPORT SUMMARY:


- MULLED UNIT, OVERALL BASIC UNIT FRAME SIZE:
94 1/2" (2400mm) x 47 1/2" (1207mm)
- SINGLE UNIT, MAX. BASIC UNIT FRAME SIZE:
47 1/4" (1200mm) x 47 1/2" (1207mm)
- OVERALL DESIGN PRESSURE: (STD) ± 35.09 psf
(HP) $+50.13$ / -60.15 psf
- STRUCTURAL TEST PRESSURE: (STD) ± 52.63 psf
(HP) $+75.19$ / -67.67 psf
- RATING: (STD) CW-PG35
(HP) CW-PG45

INSTALLATION NOTES:


1. USE 2" x _ PINE WOOD BUCK
 2. 1/4" MAXIMUM SHIM SPACE AT HEAD, SILL, JAMBS.
- PLACE WOOD SHIMS 6-10" ON CENTER
 3. APPLY A CONTINUOUS BEAD OF SEALANT BETWEEN THE NAIL IN AND THE BUCK, ON ALL FOUR SIDES
 4. INSTALL #8 X 1-1/4" PFH SCREWS SPACED APPROXIMATELY 1-4" FROM EACH CORNER AND 6-8" ON CENTER THEREAFTER INTO THE FRAMING MATERIAL AT HEAD, SILL & SIDE JAMBS. WITH 3/8" MINIMUM EDGE DISTANCE.
- SILICONE SEAL OVER NAIL/SCREW HEADS
 5. 1" MINIMUM FASTENER EMBEDMENT INTO FRAMING MATERIAL
 6. OVERALL MULLED WINDOW SIZE: B.U.S. (Basic Unit Size) =
94 1/2" (2400mm) x 47 1/2" (1207mm)
INDIVIDUAL MAX. WINDOW SIZE: B.U.S.=
47 1/4" (1200mm) x 47 1/2" (1207mm)
- Check rough opening for proper size, plumb, level and square.
 - Make all necessary adjustments to ensure rough opening is plumb, level and square.
 - Sill must be flat, level and capable of supporting the weight of the unit.
 - Opening should allow a maximum of 1/4" shim space at head, sill and jambs.
 - Consult full installation instructions found on the Sierra Pacific web site, www.hurd.com, for all recommended installation procedures.
 - Wood buck, framing, fasteners, sealant and all wall system materials are provided by others.

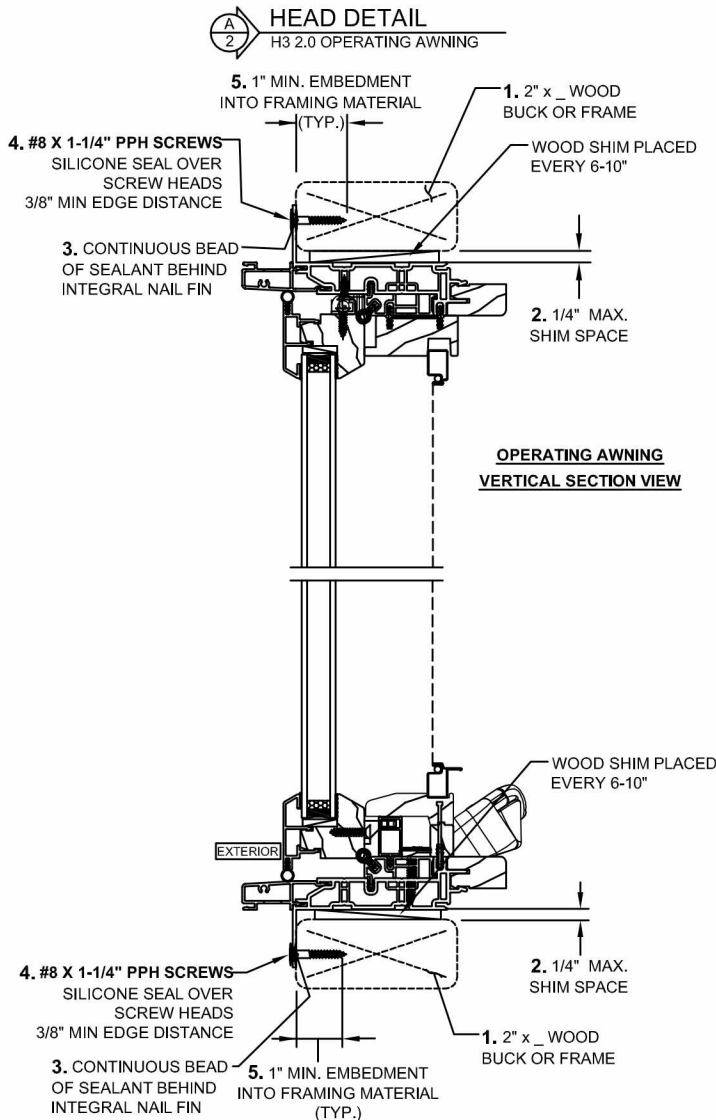

**OPERATING AWNING
HORIZONTAL SECTION VIEW**

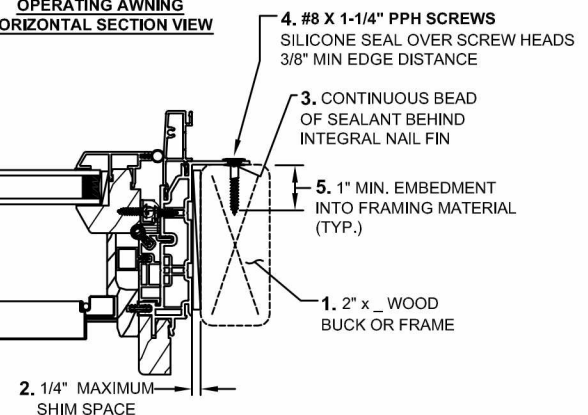

**SILL DETAIL
H3 2.0 OPERATING AWNING**

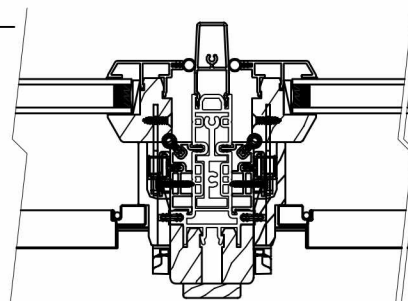

**MULL DETAIL
H3 2.0 OPERATING AWNING 2-WIDE**

(HP) UPGRADE REQUIRES ONE MASONRY CLIP AT THE HEAD
AND SILL OF EACH MULL POST FASTENED TO THE BUCK
WITH TWO #8 X 1-1/4" PPH SCREWS PER CLIP.



H3 2.0 Awning Operator 2-Wide 48 x 48
Overall Mull Unit Size 94 1/2" x 47 1/2"
Integral Nail Fin Installation

CCL Listing# 436-H-659.12,14

ELEMENT TEST REPORT NUMBER: **ESP023257P-1988**

H3 2.0 MULLED 2-WIDE Awning Operating Window
Integral Nail Fin Installation / WDMA Instructions / Non-Impact


SHEET: 2 OF 2

DRAWN BY: B.K.

TEST REPORT SUMMARY:

- **MULLED UNIT, OVERALL BASIC UNIT FRAME SIZE:**
94 1/2" (2400mm) x 47 1/2" (1207mm)
- **SINGLE UNIT, MAX. BASIC UNIT FRAME SIZE:**
47 1/4" (1200mm) x 47 1/2" (1207mm)
- **OVERALL DESIGN PRESSURE: (STD) ± 35.09 psf**
(HP) +50.13 / -60.15 psf
- **STRUCTURAL TEST PRESSURE: (STD) ± 52.63 psf**
(HP) +75.19 / -67.67 psf
- **RATING: (STD) CW-PG35**
(HP) CW-PG45

**ELEVATION SHOWING
FASTENER LOCATION & SPACING (TYP.)**

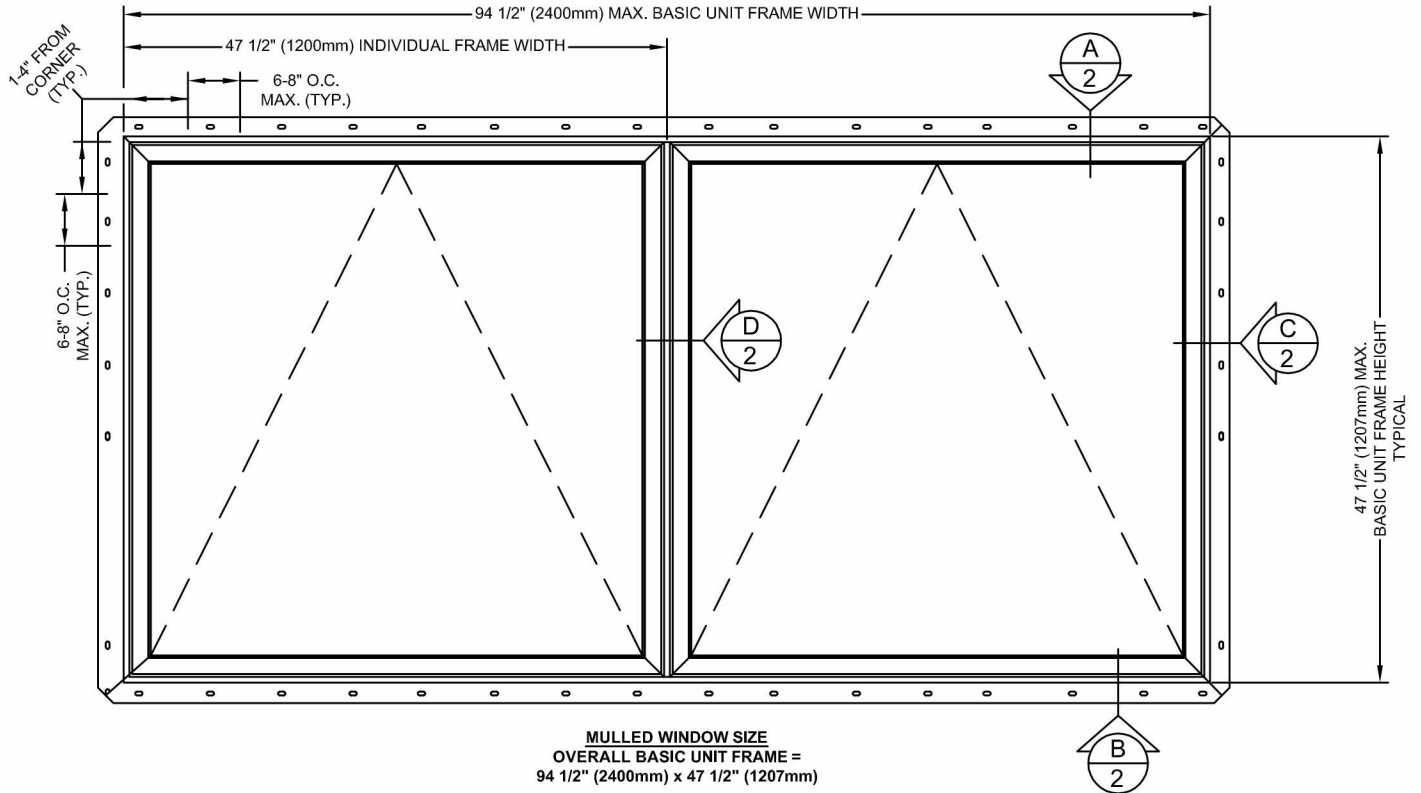

(HP) UPGRADE REQUIRES ONE MASONRY CLIP AT THE HEAD AND SILL
OF EACH MULL POST FASTENED TO THE BUCK WITH TWO #8 X 1-1/4" PPH
SCREWS PER CLIP.