



H3 2.0 3-Wide, MULL Casement Combination
Operating/Picture/Operating
118 1/2" X 71 1/2" Overall Basic Unit Size
Nail Fin / Non-Impact

CCL Listing# 436-H-660.46,47

Test Report #: **ESP022825P-1937**

H3 2.0 Aluminum Clad/Wood 3-Wide, MULL Casement Combination Nail Fin
WDMA Instructions / Non-Impact

FBC# - FL21154

PAGE 1 of 3

Updated: 10/23/2023

DRAWN BY: B.K.

TEST REPORT SUMMARY:

MULL OVERALL COMBINATION BASIC UNIT SIZE:

117 1/2" (2985mm) x 71 1/2" (1816mm)

- RATING: (STD)**LC-PG35**

(HP) **LC-PG50**

- OVERALL DESIGN PRESSURE: (STD)**±35.09 psf**

(HP)**±60.15 psf**

- STRUCTURAL TEST PRESSURE: (STD)**±52.63 psf**

(HP)**+90.23 / -82.71**

INSTALLATION NOTES:

1. USE 2" x _ WOOD BUCK

2. 1/4" MAXIMUM SHIM SPACE AT HEAD, SILL, JAMBS.
PLACE WOOD SHIMS 6-10".

3. APPLY A CONTINUOUS BEAD OF SEALANT BETWEEN THE NAIL FIN
AND THE BUCK AT SIDES AND HEAD, DISCONTINUOUS AT SILL.


4. INSTALL #8 X 1-1/4" PPH SCREWS SPACED 1-2" FROM EACH CORNER
AND 6-8" ON CENTER THEREAFTER THROUGH THE NAIL FIN AND INTO
THE FRAMING MATERIAL, WITH 3/8" MINIMUM EDGE DISTANCE,
SILICONE SEAL OVER SCREW HEADS.

5. 1" MINIMUM FASTENER EMBEDMENT INTO FRAMING
MATERIAL.

6. WINDOW SIZE: MULL/STACK COMBINATION UNIT OVERALL
BASIC UNIT FRAME SIZE: **117 1/2" (2985mm) x 71 1/2" (1816mm)**

- Check rough opening for proper size, plumb, level and square.
- Make all necessary adjustments to ensure rough opening is plumb, level & square.
- Sill must be flat, level and capable of supporting the weight of the unit.
- Opening should allow a maximum of 1/4" shim space at head, sill and jambs.
- Consult full installation instructions found on the Sierra Pacific web site for all recommended installation procedures.
- Wood buck, framing, fasteners, sealant and all wall system materials are provided by others.

**CASEMENT
VERTICAL SECTION VIEW**

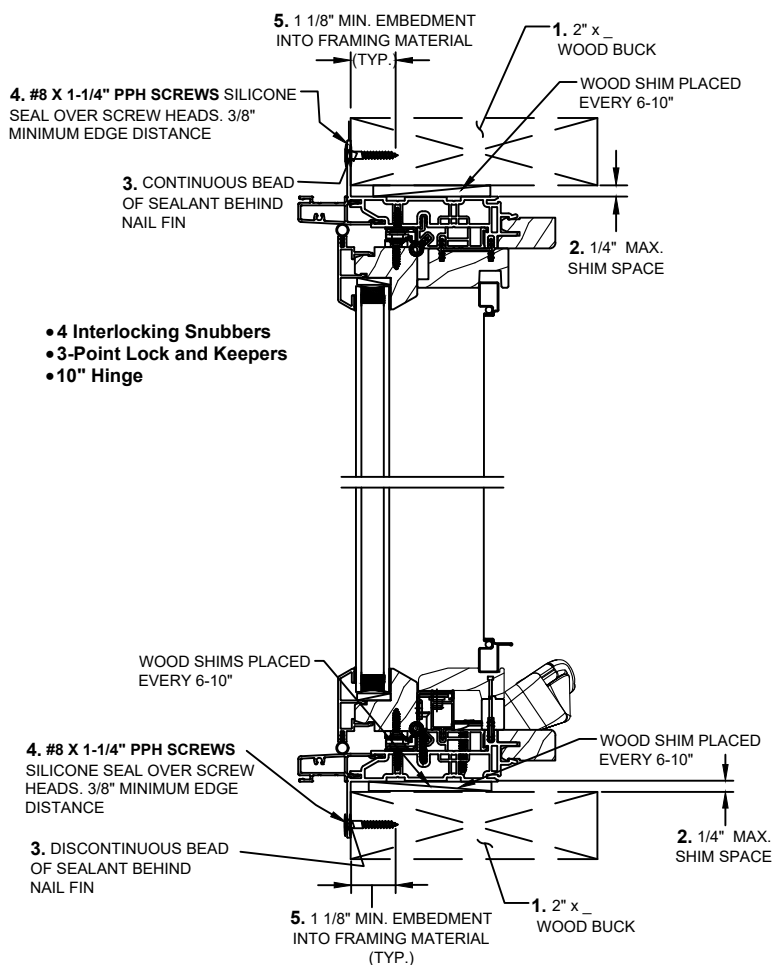

Installation requirements may vary in particular locations and in other types of construction. Proper installation is essential, and Sierra Pacific Windows, recommends consultation with an AAMA Certified Installer, or other qualified, registered building professional before installation of any Sierra Pacific product. Proper installation of Sierra Pacific products is the responsibility of the installer. Sierra Pacific is not responsible for proper installation. Sierra Pacific is not responsible for the design of, conditions in, or performance of building construction beyond the perimeters of the Sierra Pacific units. Sierra Pacific is not responsible for proper integration of the Sierra Pacific units with the weather-repellent systems of the building.



H3 2.0 3-Wide, MULL Casement Combination
Operating/Picture/Operating
118 1/2" X 71 1/2" Overall Basic Unit Size
Nail Fin / Non-Impact

TEST REPORT SUMMARY:


MULL OVERALL COMBINATION BASIC UNIT SIZE:

117 1/2" (2985mm) x 71 1/2" (1816mm)


- RATING: (STD) **LC-PG35**
(HP) **LC-PG50**
- OVERALL DESIGN PRESSURE: (STD) **±35.09 psf**
(HP) **±60.15 psf**
- STRUCTURAL TEST PRESSURE: (STD) **±52.63 psf**
(HP) **+90.23 / -82.71**

CCL Listing# 436-H-660.46,47	Test Report #: ESP022825P-1937
H3 2.0 Aluminum Clad/Wood 3-Wide, MULL Casement Combination Nail Fin WDMA Instructions / Non-Impact	
FBC# - FL21154	Updated: 10/23/2023
PAGE 2 of 3	DRAWN BY: B.K.

**FIXED PICTURE
VERTICAL SECTION VIEW**

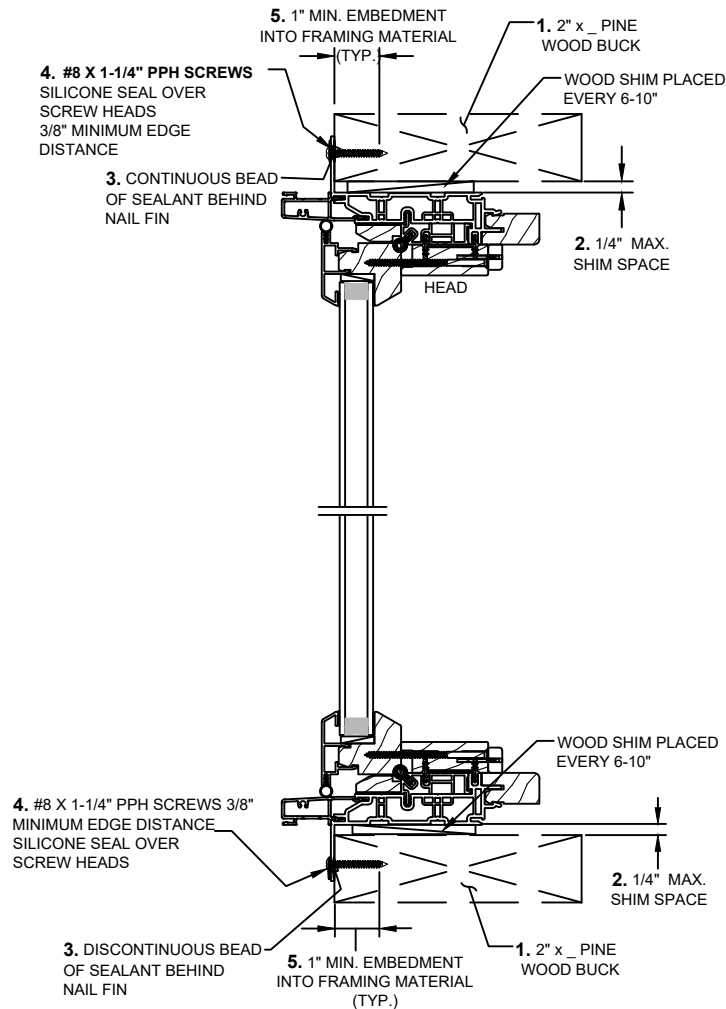

(HP) UPGRADE REQUIRES ONE MASONRY CLIP AT THE HEAD AND SILL OF EACH MULL POST FASTENED TO THE BUCK WITH TWO #8 X 1-1/4" PPH SCREWS PER CLIP.

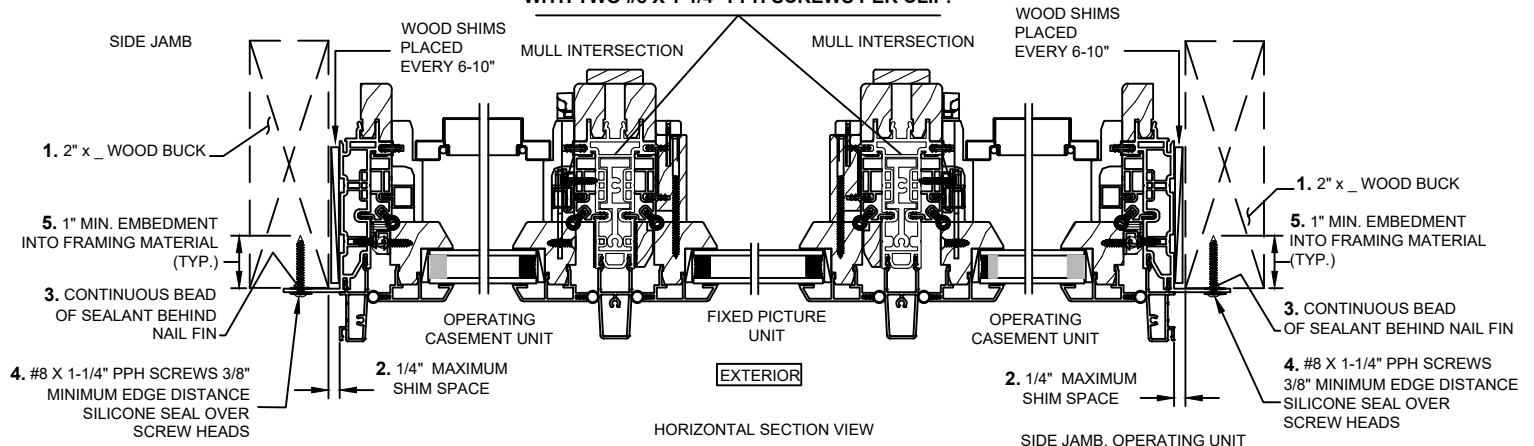



H3 2.0 3-Wide, MULL Casement Combination
Operating/Picture/Operating
118 1/2" X 71 1/2" Overall Basic Unit Size
Nail Fin / Non-Impact

CCL Listing# 436-H-660.46,47

Test Report #: **ESP022825P-1937**

H3 2.0 Aluminum Clad/Wood 3-Wide, MULL Casement Combination Nail Fin
WDMA Instructions / Non-Impact

FBC# - FL21154

PAGE 3 of 3

Updated: 10/23/2023

DRAWN BY: B.K.

TEST REPORT SUMMARY:


MULL OVERALL COMBINATION BASIC UNIT SIZE:

117 1/2" (2985mm) x 71 1/2" (1816mm)

- RATING: (STD)**LC-PG35**
(HP)**LC-PG50**
- OVERALL DESIGN PRESSURE: (STD)**±35.09 psf**
(HP)**±60.15 psf**
- STRUCTURAL TEST PRESSURE: (STD)**±52.63 psf**
(HP)**+90.23 / -82.71**

**ELEVATION SHOWING
FASTENER LOCATION & SPACING
(TYP.)**

**(HP) UPGRADE REQUIRES ONE MASONRY CLIP AT THE HEAD
AND SILL OF EACH MULL POST FASTENED TO THE BUCK
WITH TWO #8 X 1-1/4" PPH SCREWS PER CLIP.**

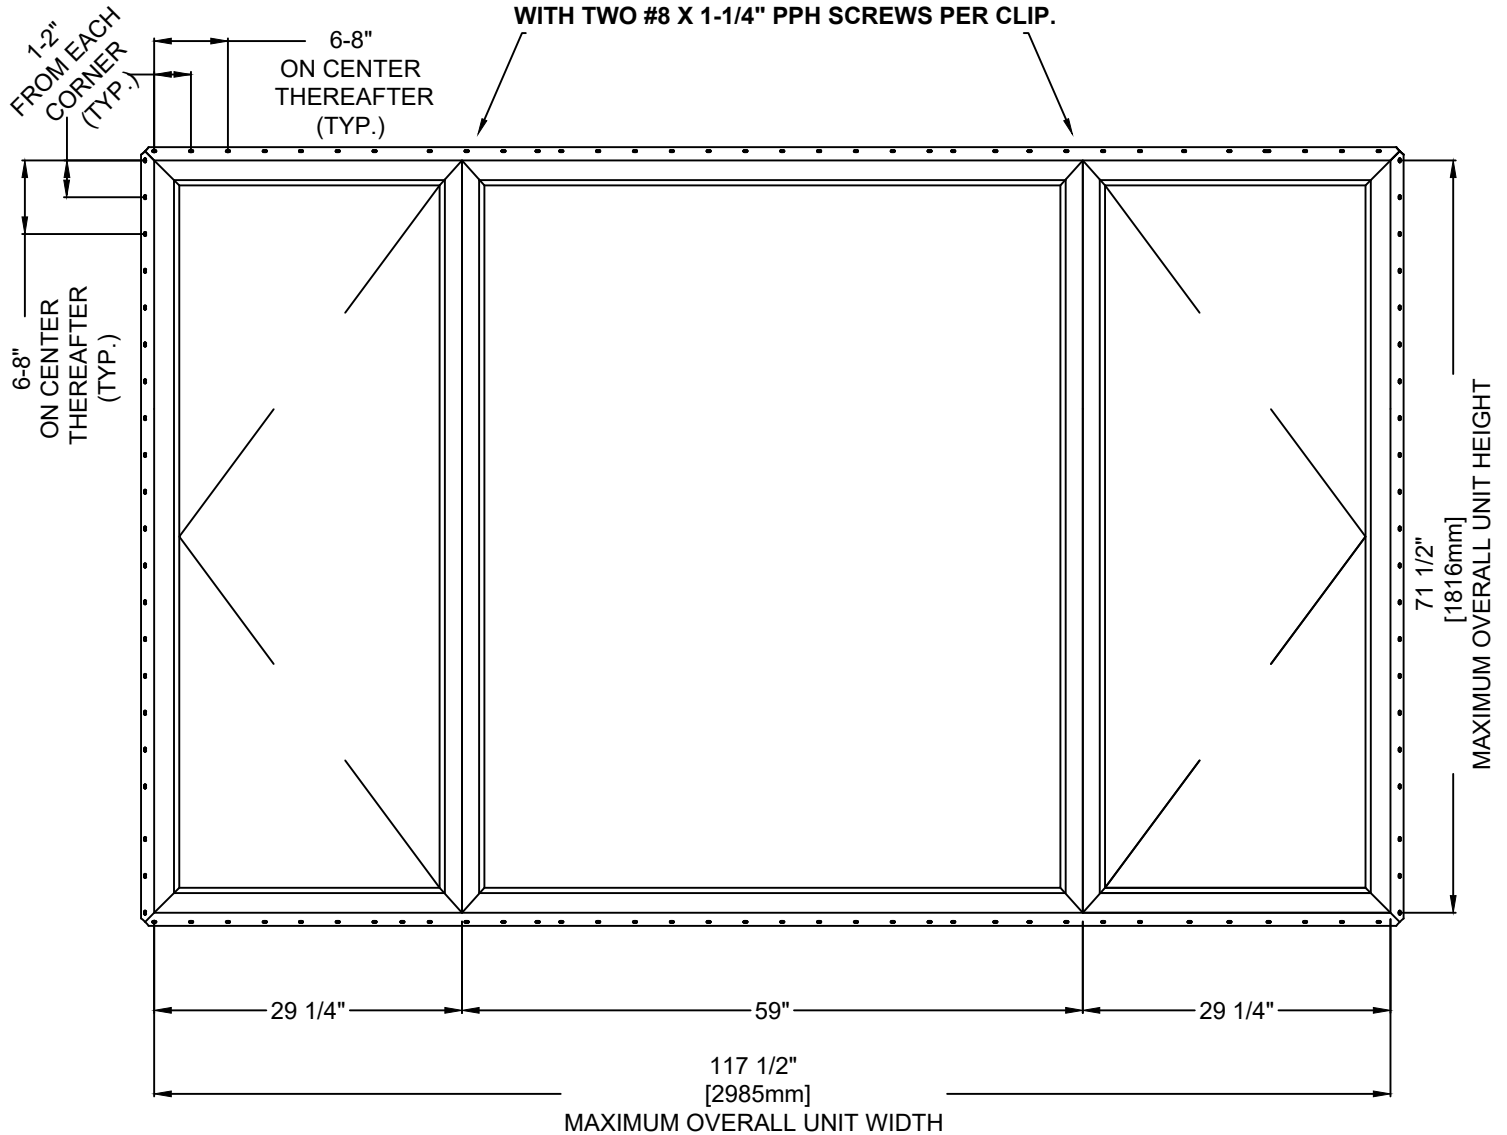

**WINDOW SIZE
- MULLED UNIT,
OVERALL BASIC UNIT FRAME SIZE:
117 1/2" (2985mm) x 71 1/2" (1816mm)**