

c:\users\sebastian\hereros\building drops, inc\building drops landing - common\projects\2026 code change projects\brombal italy\acc-26-0368.1 - 2026 code change - 17111.dwg\F121195-r3\brb008.dwg 8/4/2026 9:46 AM

INSTALLATION NOTES:

1. FOR TWO TRACK UNITS, TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT HEAD, SILL, AND JAMBS.
2. FOR THREE TRACK UNITS, TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT HEAD AND JAMBS. THREE (3) INSTALLATION ANCHORS ARE REQUIRED AT SILL.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/2 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. FOR INSTALLATION INTO WOOD FRAMING USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
7. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
8. FOR INSTALLATION THROUGH METAL STUD USE 1/4 INCH DIAMETER SELF-DRILLING SCREWS, GR. 5 OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE.
9. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- 10.INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

• FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 35, OR EQUIVALENT CORROSION RESISTANCE).

• CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1). NAIL-FIN, STRAPS, AND CLIPS LISTED WITHIN THIS APPROVAL ARE QUALIFIED TO BE STAINLESS STEEL AS SHOWN HERE-IN.
- 11.FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- 12.INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- 13.INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, STRENGTH OF 2000 PSI.

D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 16 GA. WALL THICKNESS.
- 14.INSTALLATION SHALL FOLLOW MANUFACTURERS RECOMMENDATIONS FOR SEALING DOORS AND ACCESSORY ITEMS.

BROMBAL ITALY

EBE 85 SERIES LIFT & SLIDE DOOR

(HVHZ) (IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

• TAS 201-94

• TAS 202-94

• TAS 203-94

• AAMA/WDMA/CSA 101/I.S.2/A440-11

• ASTM E1886-13

• ASTM E1996-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL:

BRASS (MIN. Fy = 29 KSI, MIN. Fu = 50 KSI)

STEEL/PAINTED STEEL (MIN. Fy = 31 KSI, MIN. Fu = 72 KSI)

COR-TEN STEEL (MIN. Fy = 51 KSI, MIN. Fu = 74 KSI)

STAINLESS STEEL (MIN. Fy = 31 KSI, MIN. Fu = 76 KSI)
7. DOOR HARDWARE: SAVIO SLIDEART LS HARDWARE KIT, SAVIO CREMONE KIT, ZENTI FLUSH BOLT, AND BRASS SAFETY DEVICE.
8. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
9. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 5 FOR GLAZING DETAIL.
- 10.GLAZING SELECTION SHALL MEET SAFETY GLAZING REQUIREMENTS PER CHAPTER 24 OF CURRENT FBC.
- 11.GLASS SHALL BE SET WITH THE USE OF SETTING BLOCKS IN ACCORDANCE WITH CHAPTER 24 OF THE CURRENT FLORIDA BUILDING CODE.
- 12.DESIGNATIONS "X", "O", AND "P" STAND FOR THE FOLLOWING:

X: OPERABLE PANEL

O: FIXED PANEL

P: POCKET

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	ELEVATIONS & ANCHOR LAYOUTS
4	ELEVATIONS & ANCHOR LAYOUTS
5	QUALIFIED CONFIGURATIONS & GLAZING DETAILS
6	VERTICAL SECTIONS
7	VERTICAL SECTIONS
8	HORIZONTAL SECTIONS
9	HORIZONTAL SECTIONS
10	HORIZONTAL SECTIONS
11	HORIZONTAL SECTIONS & HARDWARE OPTIONS

LIFT & SLIDE DOOR DESIGN PRESSURE TABLE			
MAX. PANEL SIZE	MAX. D.L.O SIZE	MAX. DP	IMPACT RATING
39.7" X 110.3"	32.3" X 102.9"	+/-75 PSF	LMI

- NOTE:
1. LMI - LARGE MISSILE IMPACT RATED
2. SEE SHEET 5 FOR QUALIFIED CONFIGURATIONS



BROMBAL ITALY
VIA VALLA, 24
CASELLE DI ALTIVOLE (TV), ITALY
PH: ++39 0423 566189
FX: ++39 0423 919168

TITLE:
BROMBAL ITALY EBE 85 SERIES LIFT &
SLIDE DOOR
(HVHZ) (IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.


1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.11 16:07:03'00'

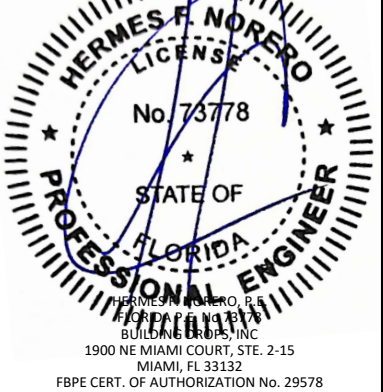

FL #:

FL21195

DATE: 10.12.16

DWG. BY:
LMS

CHK. BY:
HFN

SCALE: NTS

DWG. #: BRB008

SHEET:

1

REV.

B


OF 11

PREPARED BY:

 **BUILDING DROPS**

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE-215
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT OR SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

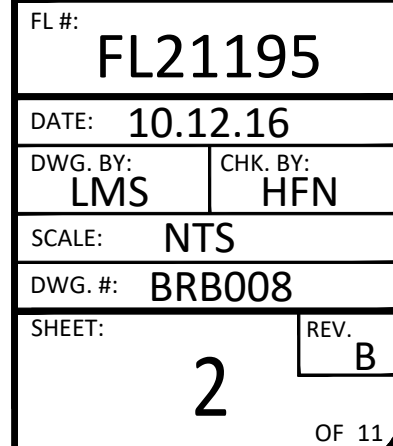


PREPARED BY:

 **BUILDING DROPS**

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

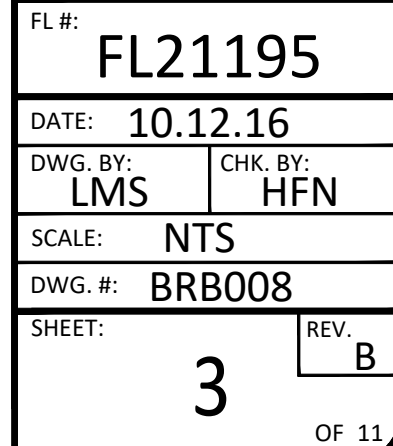

PREPARED BY:

 **BUILDING DROPS**

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




SHEET:	REV.
--------	------

4 OF 11



QUALIFIED CONFIGURATION

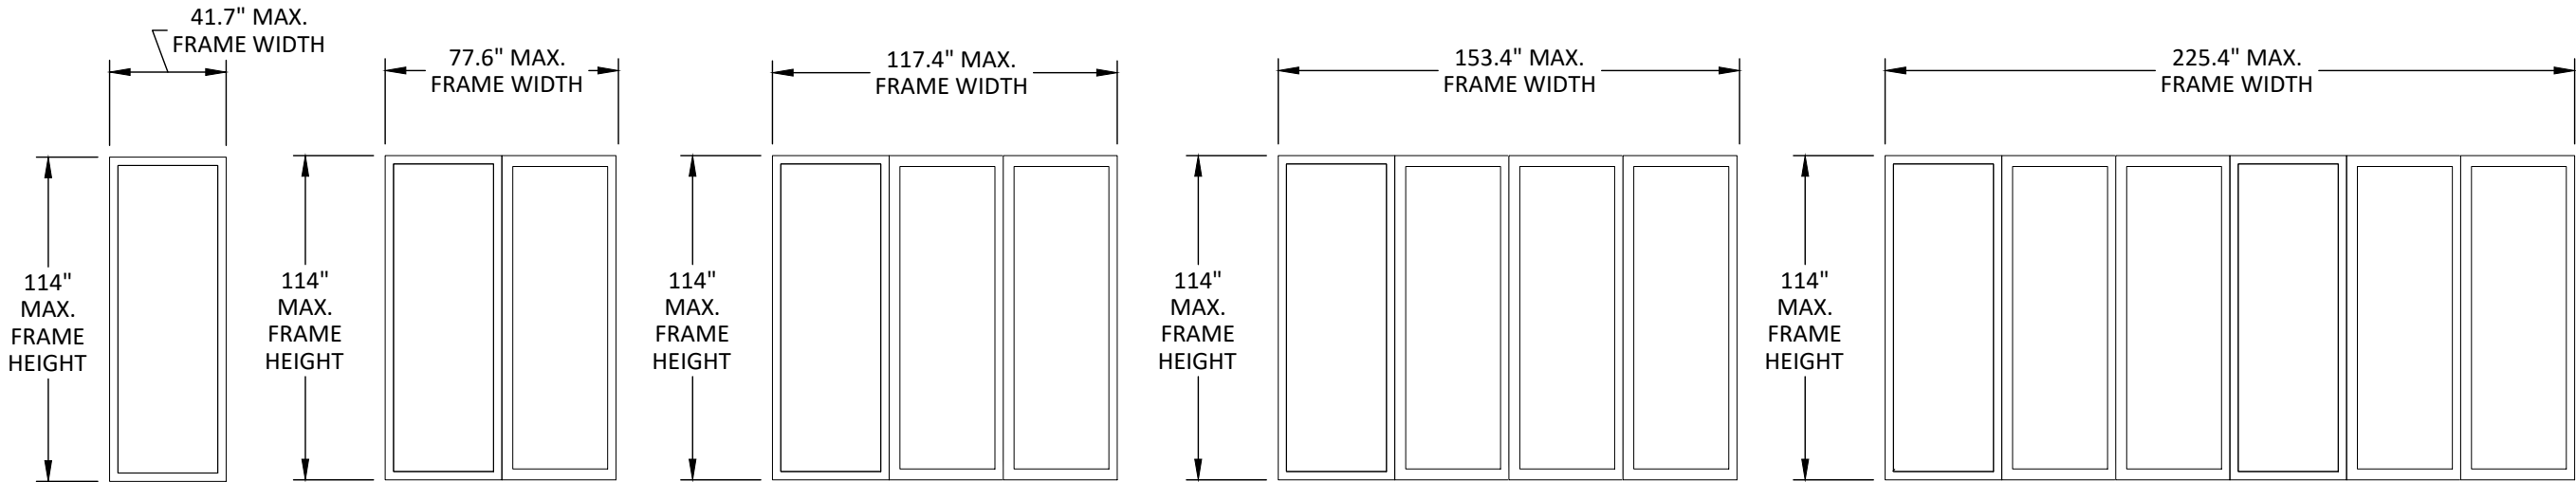

1 PANEL

XP
PX

2 PANEL

XX
OX
XO
XXP
PXX
PXXP

3 PANEL

OXO
OXX
XXO
OXXP
PXXO
XXX
PXXX
XXXXP
PXXXP


4 PANEL

OXXO
XXXO
OXXX
PXXXO
OXXXP
XXXX
XXXXP
PXXXX
PXXXXP


6 PANEL

OXXXXO
XXXXXX
XXXXXXP
PXXXXXX
PXXXXXXP


NOTE:
X = OPERABLE
O = FIXED
P = POCKET

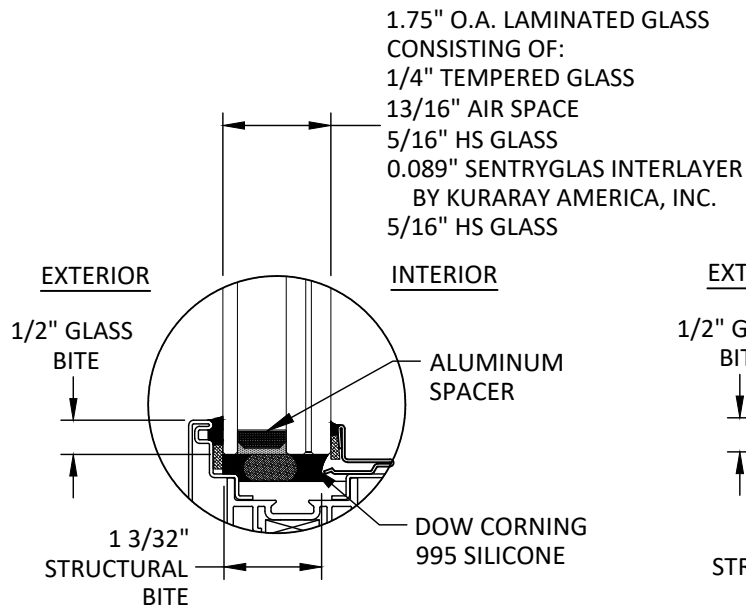


GLAZING DETAIL A

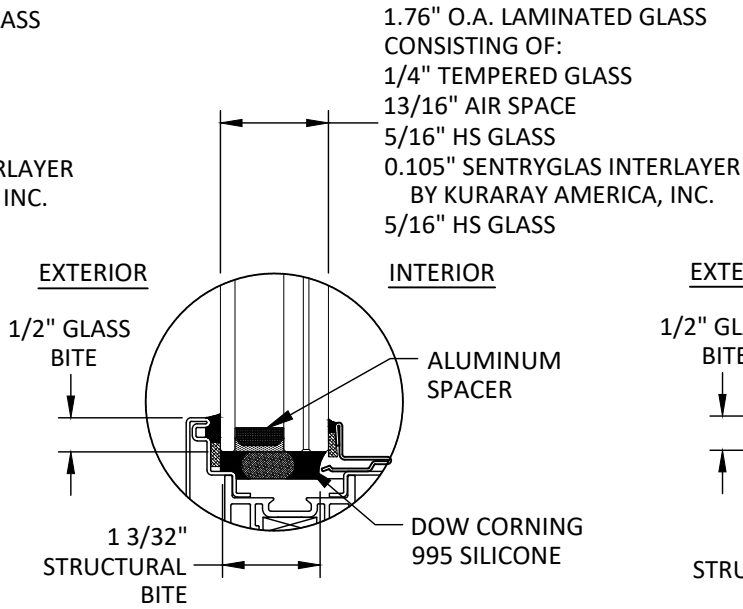

GLAZING DETAIL B

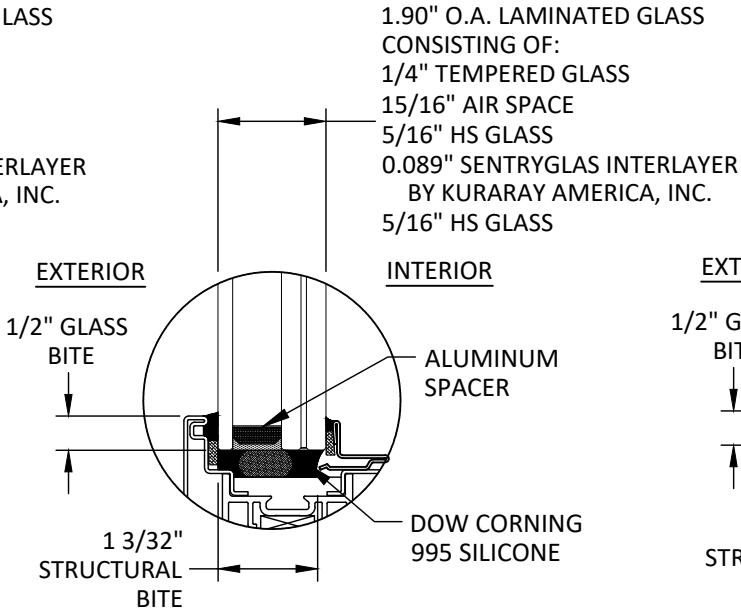

GLAZING DETAIL C

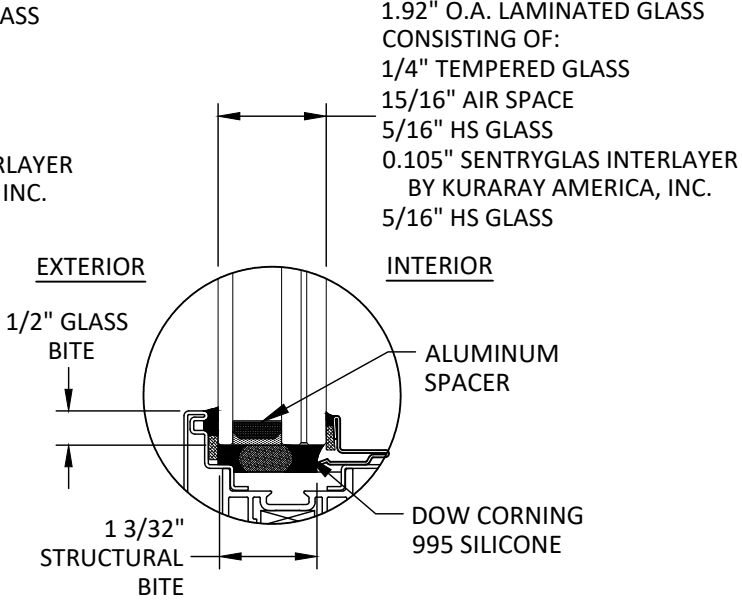

GLAZING DETAIL D

- GLAZING NOTES:
- GLASS THICKNESS AND TYPE COMPLY WITH ASTM E1300 GLASS CHART REQUIREMENTS.
 - GLASS TYPE COMPLIES WITH FBC SAFETY GLAZING REQUIREMENTS.
 - USE SETTING BLOCKS WITH 70 TO 90 SHORE A DUROMETER HARDNESS AT SILL FOR PANELS OVER 3 FEET IN WIDTH



BROMBAL ITALY
VIA VALLA, 24
CASELLE DI ALTIVOLE (TV), ITALY
PH: ++39 0423 566189
FX: ++39 0423 919168

TITLE:
BROMBAL ITALY EBE 85 SERIES LIFT &
SLIDE DOOR
(HVHZ) (IMPACT)
QUALIFIED CONFIGURATIONS
& GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL21195
DATE:	10.12.16
DWG. BY:	LMS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	BRB008
SHEET:	5
REV.	B
	OF 11


c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\brombal italy\17111dwgs\1711195-r3\brb008.dwg
8/4/2026 9:47 AM
c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\brombal italy\17111dwgs\1711195-r3\brb008.dwg

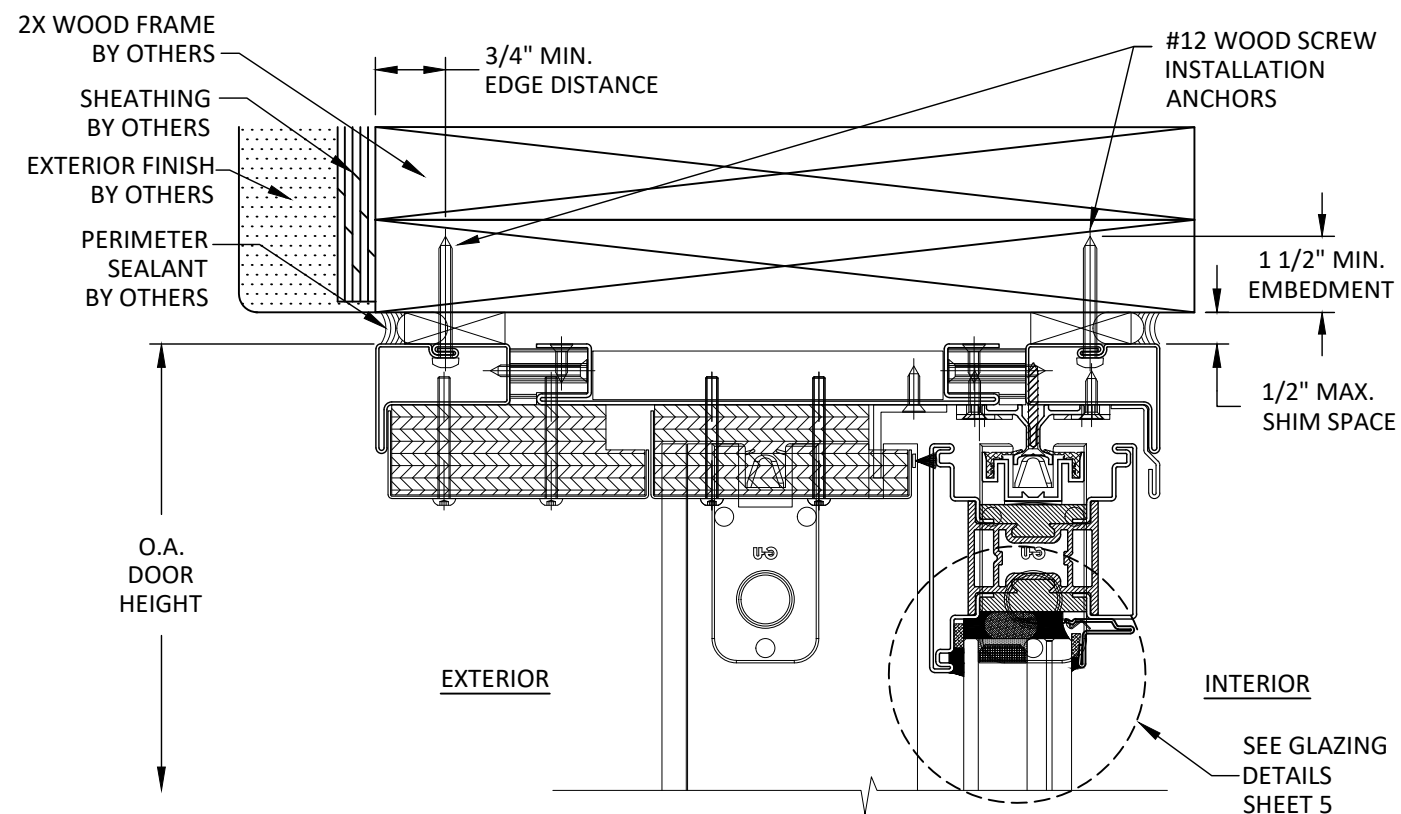


A
6 **VERTICAL SECTION**
HEAD - 2X WOOD FRAME
OPERABLE PANEL (3 TRACK)

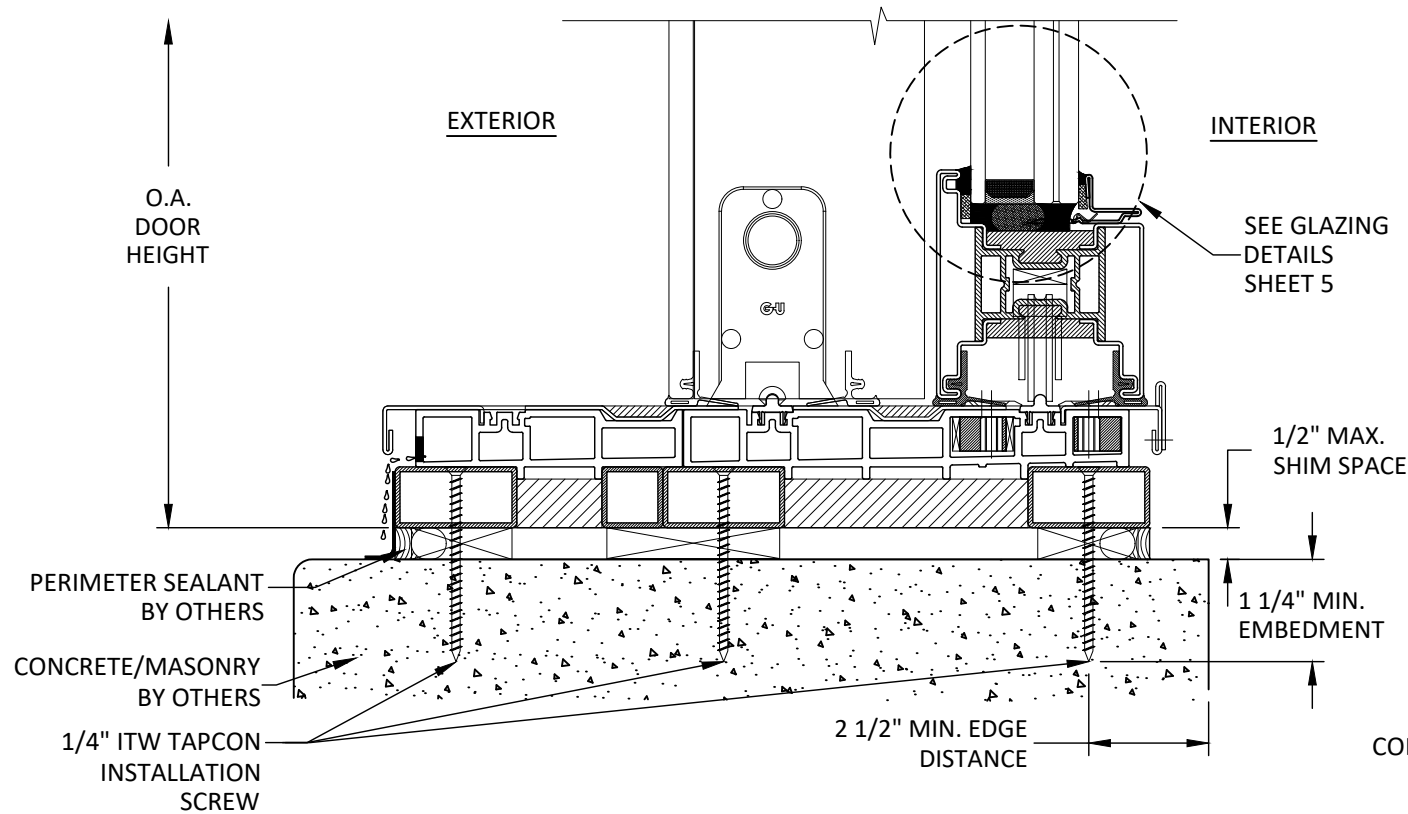

C
6 **VERTICAL SECTION**
SILL - CONCRETE/MASONRY
OPERABLE PANEL (3 TRACK)

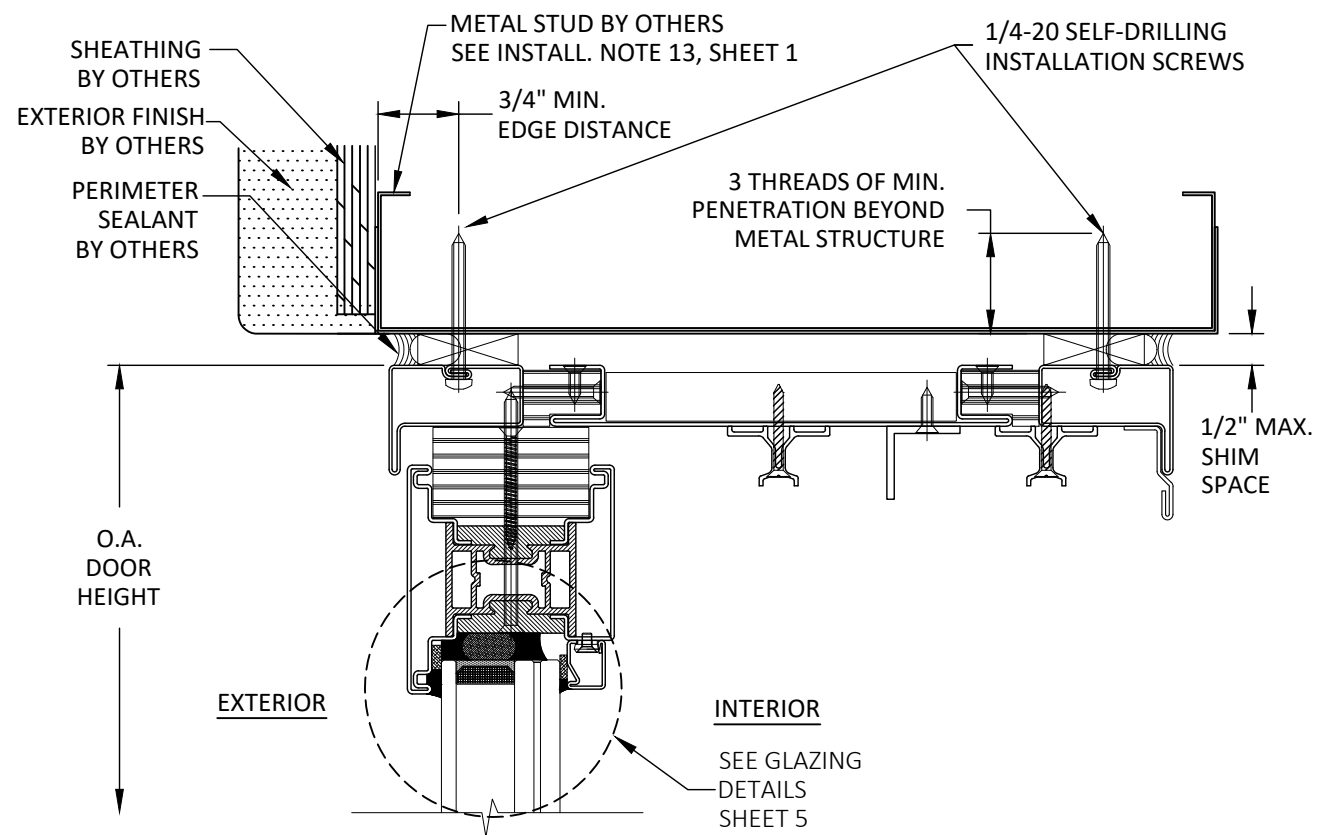

B
6 **VERTICAL SECTION**
HEAD - METAL STUD FRAME
FIXED PANEL (3 TRACK)

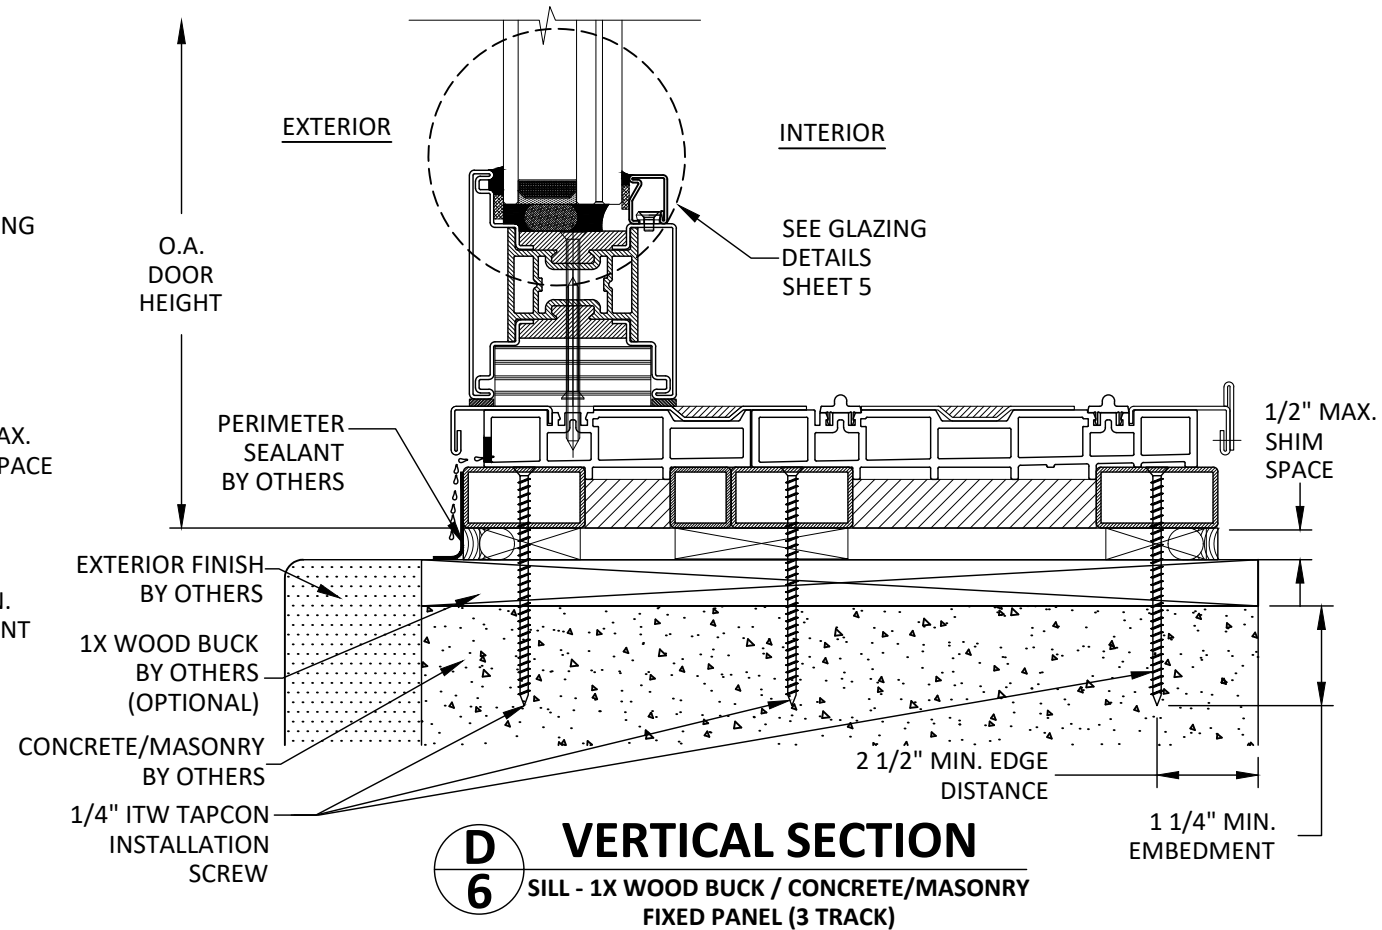

D
6 **VERTICAL SECTION**
SILL - 1X WOOD BUCK / CONCRETE/MASONRY
FIXED PANEL (3 TRACK)



BROMBAL ITALY
VIA VALLA, 24
CASELLE DI ALTIVOLE (TV), ITALY
PH: ++39 0423 566189
FX: ++39 0423 919168


TITLE:
BROMBAL ITALY EBE 85 SERIES LIFT &
SLIDE DOOR
(HVHZ) (IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

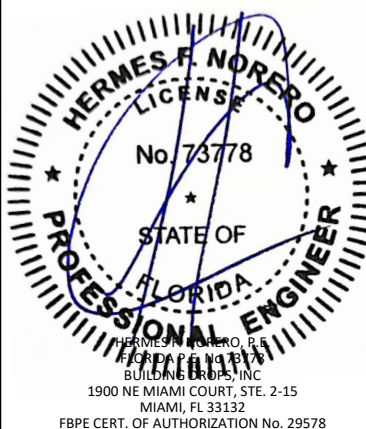


FL #:	FL21195
DATE:	10.12.16
DWG. BY:	LMS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	BRB008
SHEET:	6
REV.	B


c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\brombal italy\cc-26-0368.1 - 2026 code change - 1711.dwg
8/4/2026 9:47 AM
c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\brombal italy\cc-26-0368.1 - 2026 code change - 1711.dwg

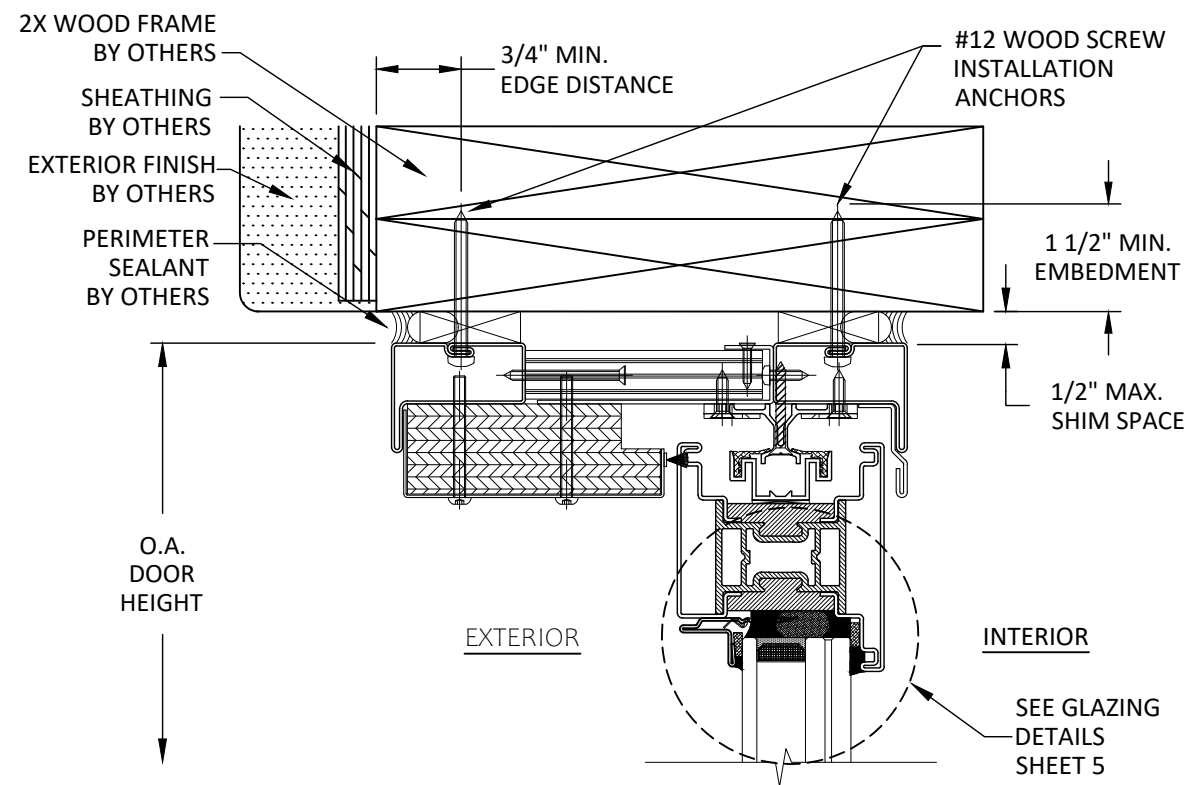


E
7 **VERTICAL SECTION**
HEAD - 2X WOOD FRAME
OPERABLE PANEL (2 TRACK)

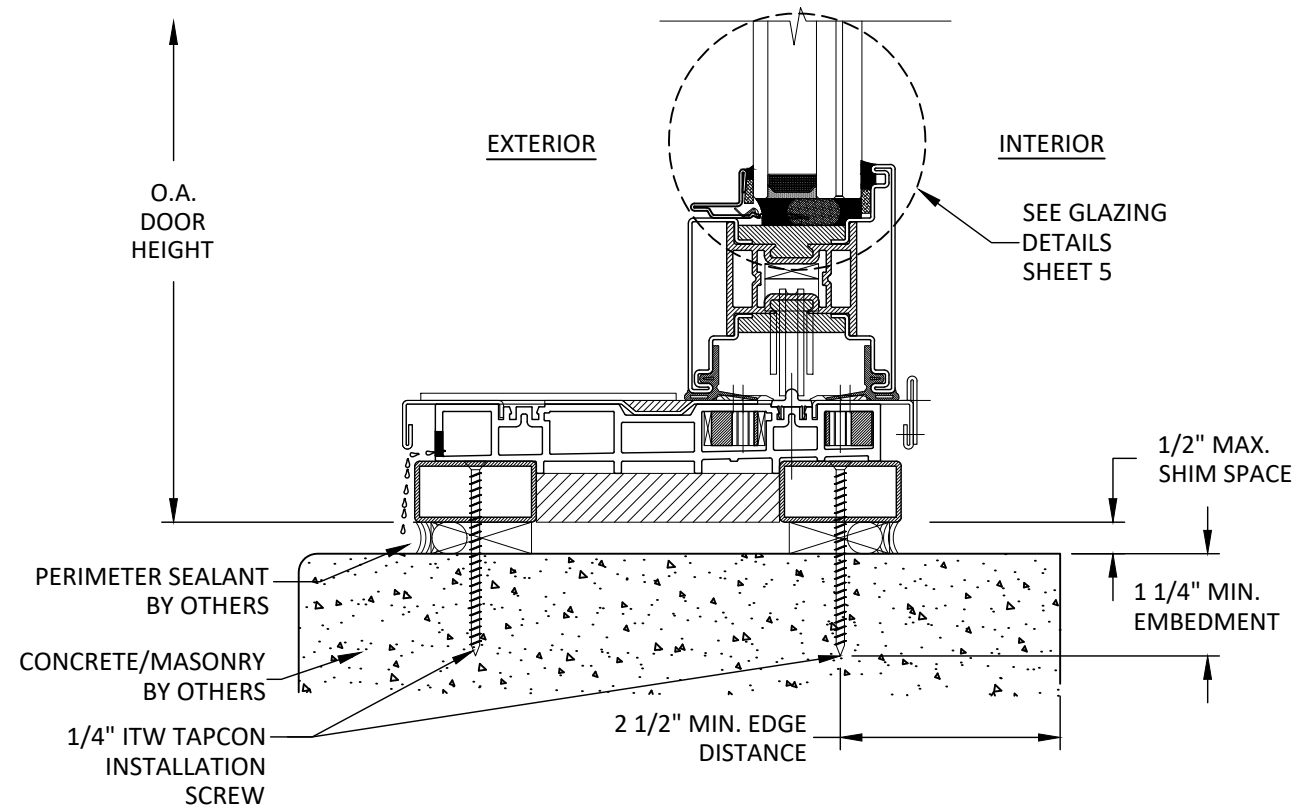

G
7 **VERTICAL SECTION**
SILL - CONCRETE/MASONRY
OPERABLE PANEL (2 TRACK)

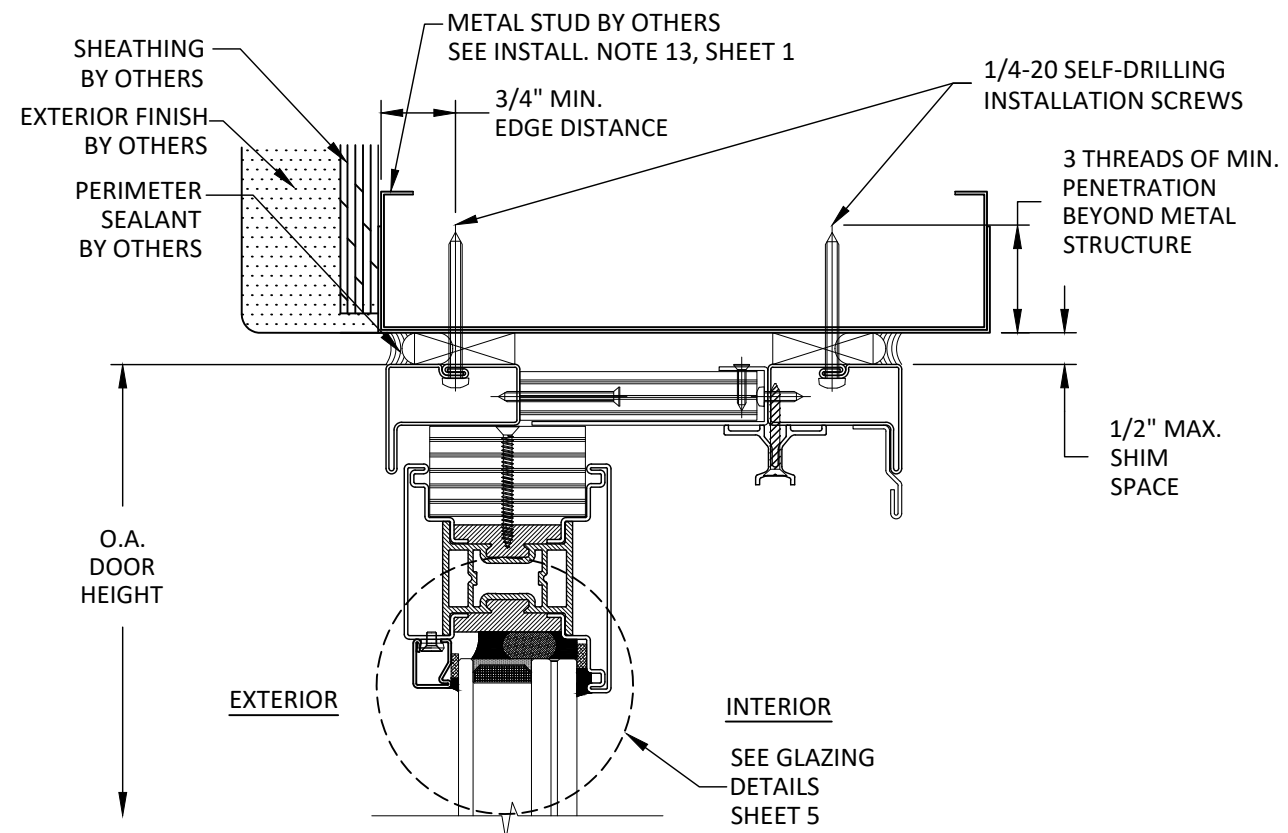

F
7 **VERTICAL SECTION**
HEAD - METAL STUD FRAME
FIXED PANEL (2 TRACK)

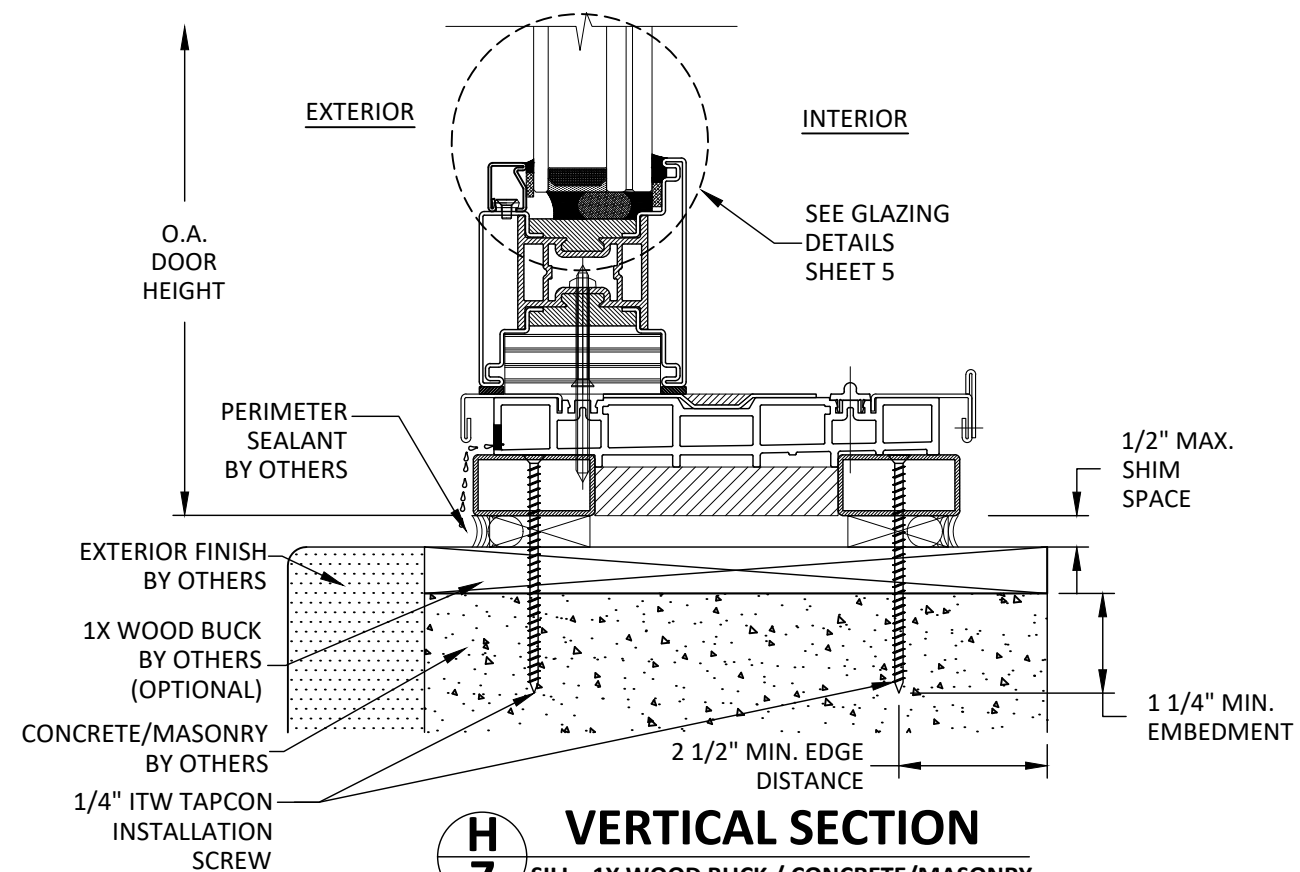

H
7 **VERTICAL SECTION**
SILL - 1X WOOD BUCK / CONCRETE/MASONRY
FIXED PANEL (2 TRACK)



BROMBAL ITALY
VIA VALLA, 24
CASELLE DI ALTIVOLE (TV), ITALY
PH: ++39 0423 566189
FX: ++39 0423 919168


TITLE:
BROMBAL ITALY EBE 85 SERIES LIFT &
SLIDE DOOR
(HVHZ) (IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

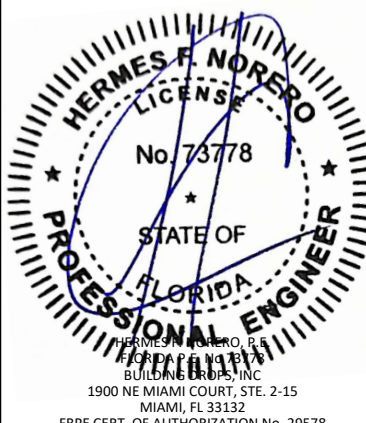


FL #:	FL21195	
DATE:	10.12.16	
DWG. BY:	LMS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	BRB008	
SHEET:	7	REV. B

c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change - 1711\dwgs\fl21195-r3\brb008.dwg
8/4/2026 9:47 AM
c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change - 1711\dwgs\fl21195-r3\brb008.dwg

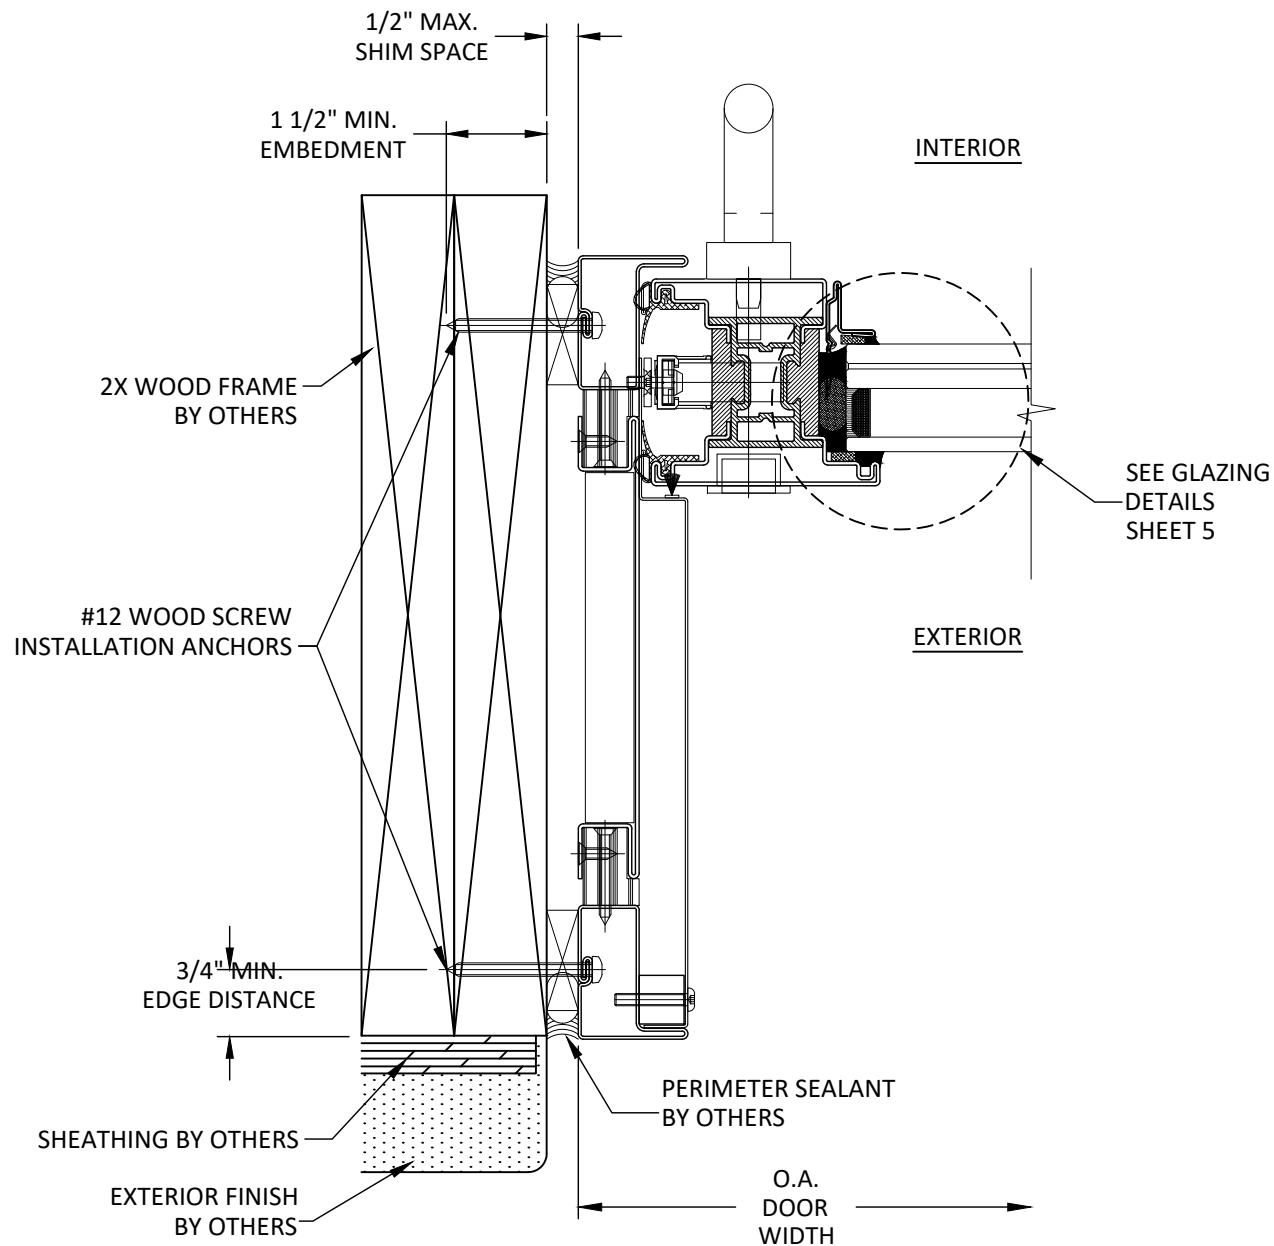

I
8 **HORIZONTAL SECTION**
JAMB - 2X WOOD FRAME
OPERABLE PANEL (3 TRACK)

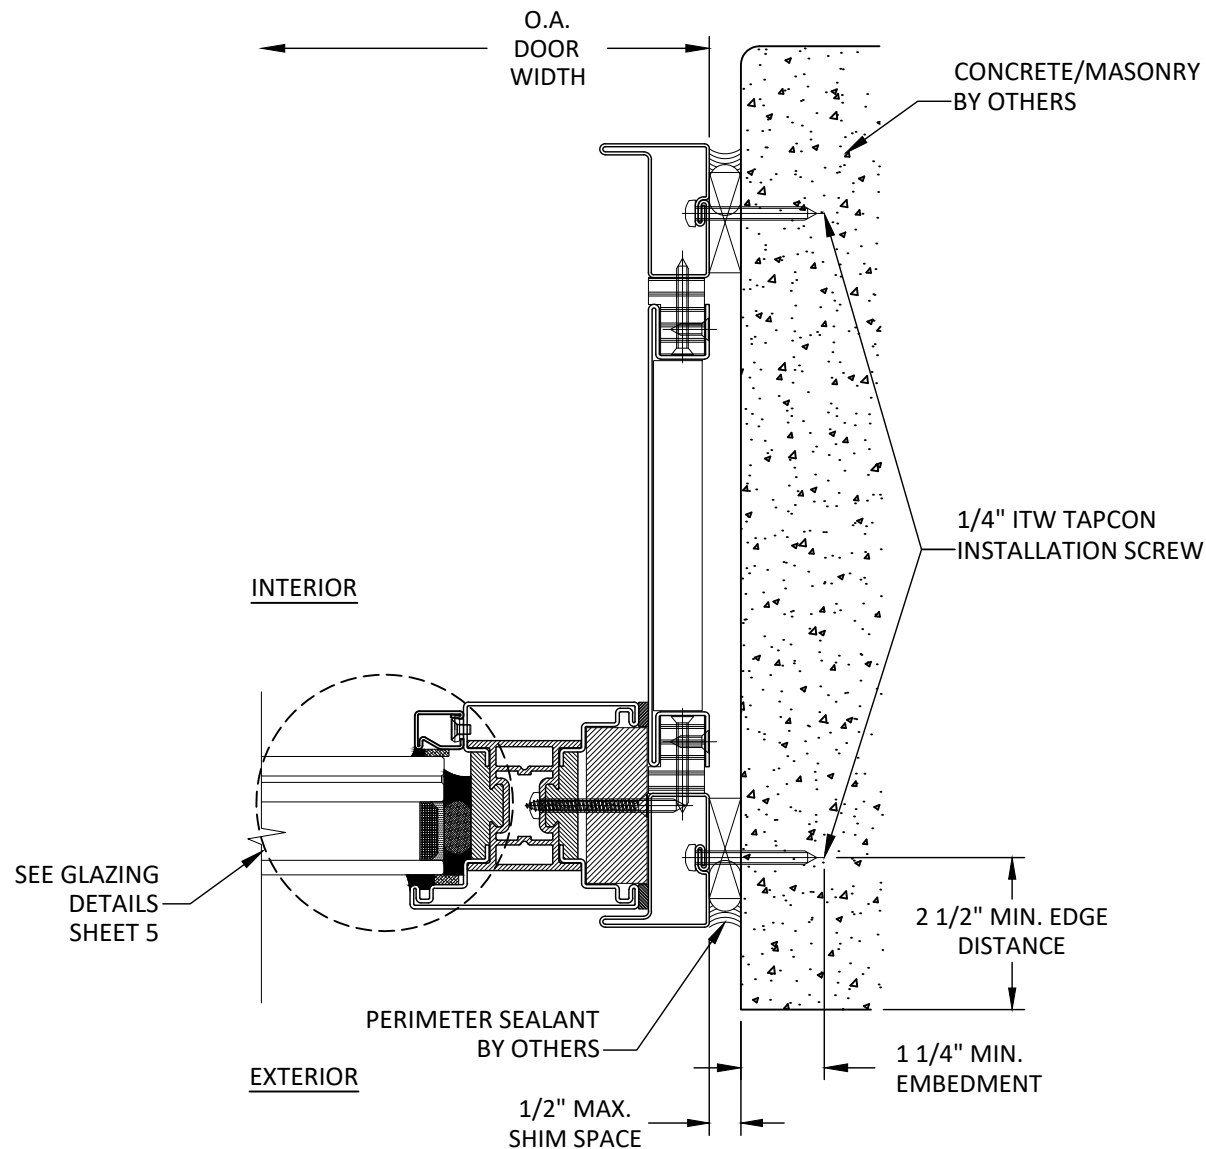

J
8 **HORIZONTAL SECTION**
JAMB - CONCRETE/MASONRY
FIXED PANEL (3 TRACK)



BROMBAL ITALY
VIA VALLA, 24
CASELLE DI ALTIVOLE (TV), ITALY
PH: ++39 0423 566189
FX: ++39 0423 919168

TITLE:
BROMBAL ITALY EBE 85 SERIES LIFT &
SLIDE DOOR
(HVHZ) (IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL21195	
DATE:	10.12.16	
DWG. BY:	LMS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	BRB008	
SHEET:	8	REV. B
OF 11		

PREPARED BY:



BD
BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE-215
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

OF 11





PREPARED BY:

 **BUILDING DROPS**



BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

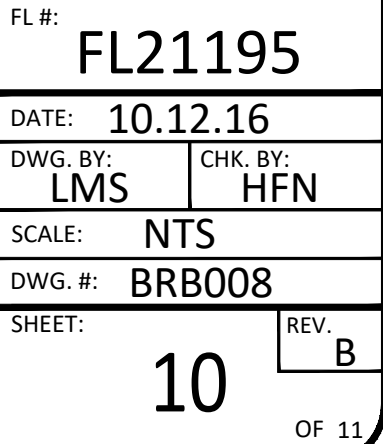

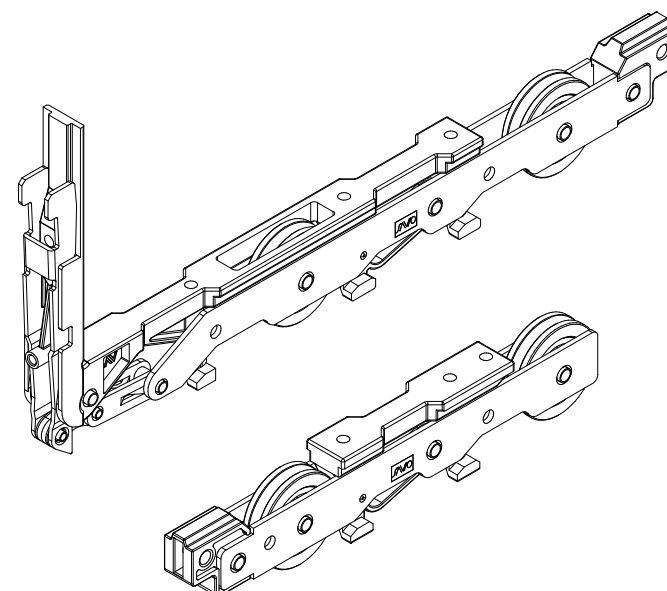

SAVIO SLIDEART LS
ART. 2451/300

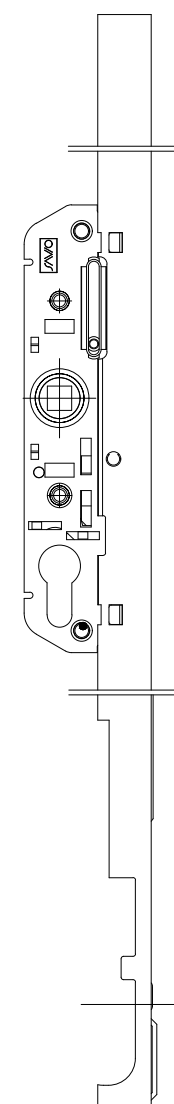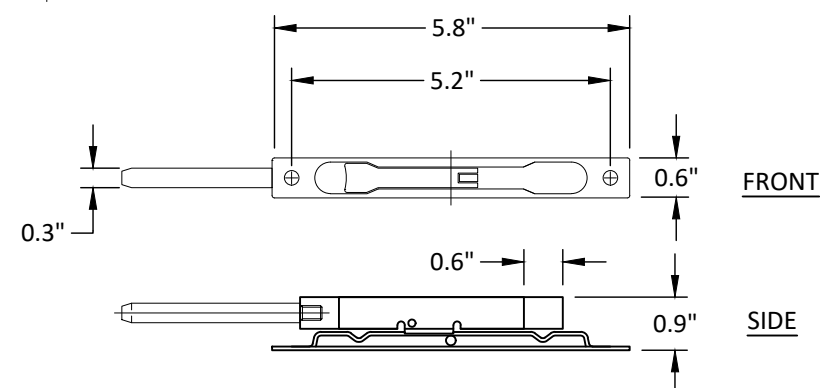

BROMBAL ITALY
VIA VALLA, 24
CASELLE DI ALTIVOLE (TV), ITALY
PH: ++39 0423 566189
FX: ++39 0423 919168

TITLE:
BROMBAL ITALY EBE 85 SERIES LIFT &
SLIDE DOOR
(HVHZ) (IMPACT)
HORIZONTAL SECTIONS
& HARDWARE OPTIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC UPDATES	SM	07/21
2026 CODE UPDATE	SH	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT OR SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

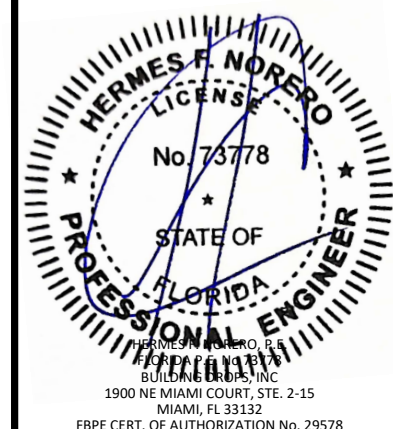

FL #: **FL21195**

DATE: 10.12.16

DWG. BY: LMS	CHK. BY: HFN
------------------------	------------------------

SCALE: NTS

DWG. #: **BRB008**

SHEET:

REV. B

11

OF 11