

AMERICAN CRAFTSMAN WINDOWS

SILVER LINE BUILDING PRODUCTS

V3 SERIES/70 SERIES CASEMENT WINDOWS (NON-IMPACT)


GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

PRODUCT MODEL	OVERALL SIZE		DESIGN PRESSURE	INSTALLATION METHOD	MISSILE IMPACT RATING	GLASS TYPE
	WIDTH	HEIGHT				
70NCW1	36"	72"	+30/-30 PSF	NAIL FIN	NON-IMPACT	G2
70RCW1	36"	72"	+30/-30 PSF	THROUGH FRAME	NON-IMPACT	G2
70NCW1	36"	72"	+50/-50 PSF	NAIL FIN	NON-IMPACT	G1
70RCW1	36"	72"	+50/-50 PSF	THROUGH FRAME	NON-IMPACT	G1
70NCW1	36"	72"	+60/-60 PSF	NAIL FIN	NON-IMPACT	G1
70RCW1	36"	72"	+60/-60 PSF	THROUGH FRAME	NON-IMPACT	G1
70NCW2	72"	72"	+30/-30 PSF	NAIL FIN	NON-IMPACT	G2
70RCW2	72"	72"	+30/-30 PSF	THROUGH FRAME	NON-IMPACT	G2
70NCW2	52"	50"	+50/-50 PSF	NAIL FIN	NON-IMPACT	G1
70RCW2	52"	50"	+50/-50 PSF	THROUGH FRAME	NON-IMPACT	G1
70NCW3	78"	50"	+50/-50 PSF	NAIL FIN	NON-IMPACT	G1
70RCW3	78"	50"	+50/-50 PSF	THROUGH FRAME	NON-IMPACT	G1
70NCW3	108"	72"	+30/-30 PSF	NAIL FIN	NON-IMPACT	G2
70RCW3	108"	72"	+30/-30 PSF	THROUGH FRAME	NON-IMPACT	G2
70NCW4	108"	72"	+30/-30 PSF	NAIL FIN	NON-IMPACT	G2*
70RCW4	108"	72"	+30/-30 PSF	THROUGH FRAME	NON-IMPACT	G2*
70NCWPW	84"	72"	+30/-30 PSF	NAIL FIN	NON-IMPACT	G1 & G2*
70RCWPW	84"	72"	+30/-30 PSF	THROUGH FRAME	NON-IMPACT	G1 & G2*
70NCPC3	108"	72"	+30/-30 PSF	NAIL FIN	NON-IMPACT	G1 & G2*
70RCPC3	108"	72"	+30/-30 PSF	THROUGH FRAME	NON-IMPACT	G1 & G2*

NOTE: FOR 70NCPC3 & 70RCPC3 USE G1 FOR FIXED LITE & G2 FOR OPERABLE SASH

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATION & ANCHOR LAYOUTS
3	ELEVATION & ANCHOR LAYOUTS
4	ELEVATION & ANCHOR LAYOUTS
5	ELEVATION & ANCHOR LAYOUTS
6	VERTICAL SECTIONS
7	HORIZONTAL SECTIONS
8	VERTICAL & HORIZONTAL DETAILS, INSTALLATION NOTES & REINFORCEMENT DETAILS

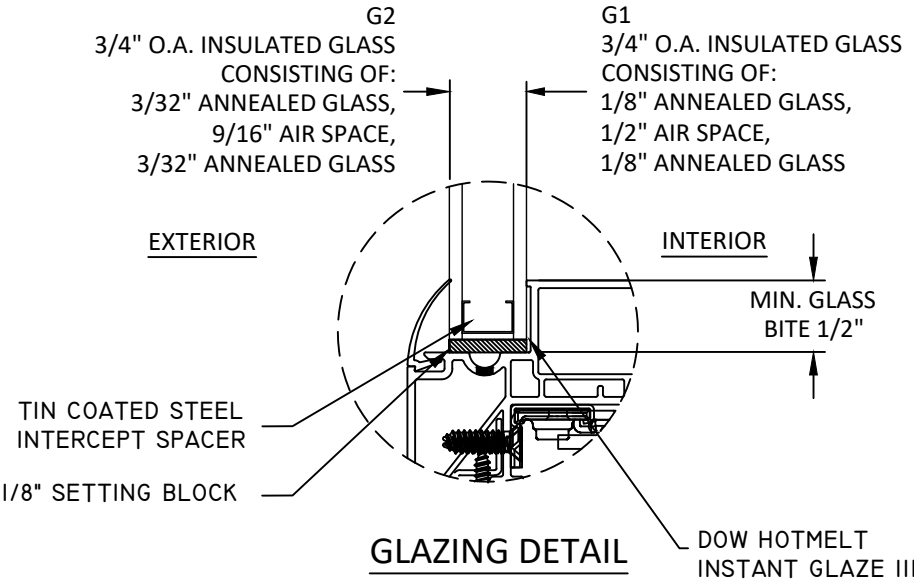

- NOTE:**
- ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC AND ASTM E 1300 GLASS LOAD RESISTANCE.
 - SETTING BLOCK SHOULD BE 70-90 DUROMETER AS PER CH 24 OF THE CURRENT FBC.
 - GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT 1/4 SPAN FROM CORNERS.


Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.04.16 18:22:50 -04'00'

AMERICAN CRAFTSMAN
WINDOWS
SILVER LINE WINDOWS AND
DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT) GENERAL NOTES & GLAZING DETAILS	REVISION DESCRIPTION		BY		DATE	
NO.						
A	6TH FBC EDITION		AR		10.16.17	
B	7TH EDITION 2020 FBC		LMH		12.04.20	
C	8TH EDITION 2023 FBC		LMH		12.09.23	
D	CURRENT FBC & EC24-100		LMH		02.26.25	

DATE:	10.16.17
DWN BY:	RV
CHK BY:	HFN
SCALE:	NTS

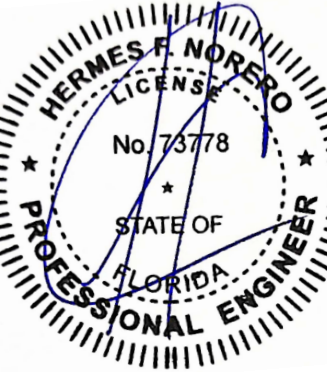


HERMES F. NORERO
FLORIDA P. E. NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478 FX: (954) 744-4738


FL#: **21335**

DWG #: **SWD047**


SHEET: **1 OF 8**

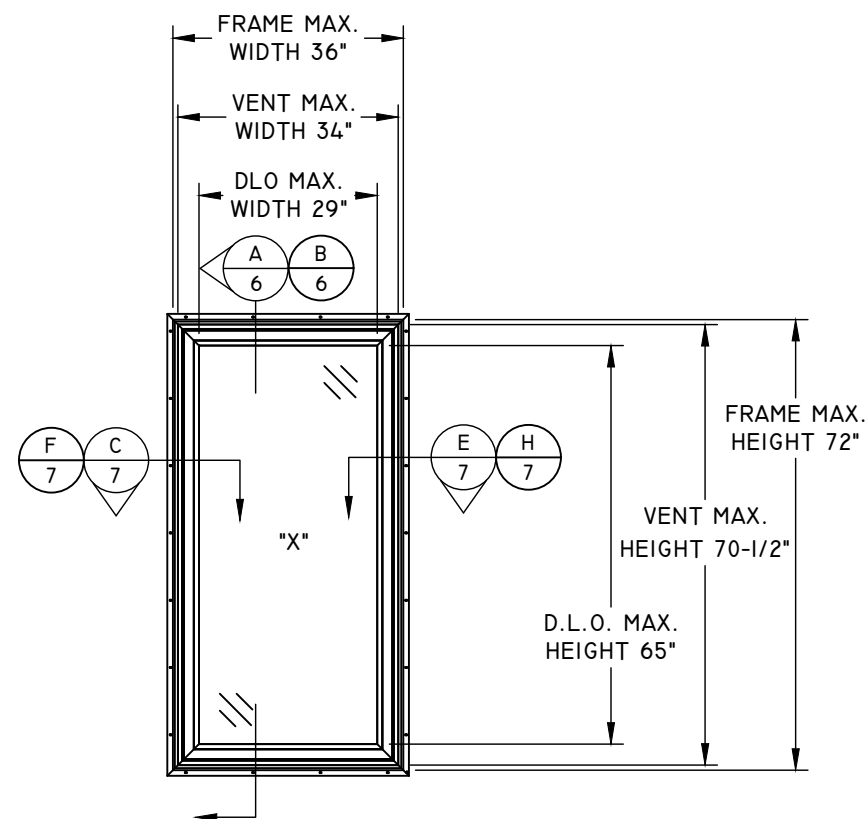


CASEMENT ELEVATION

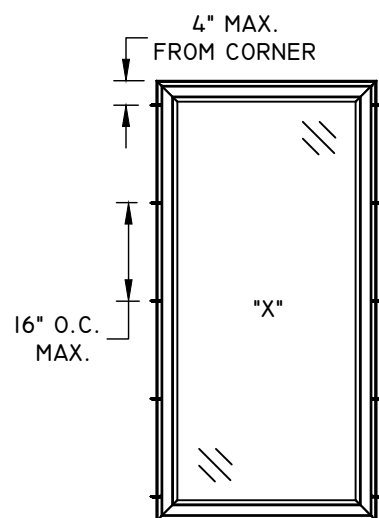


ANCHOR LAYOUT
FINLESS
DP +/- 30 PSF

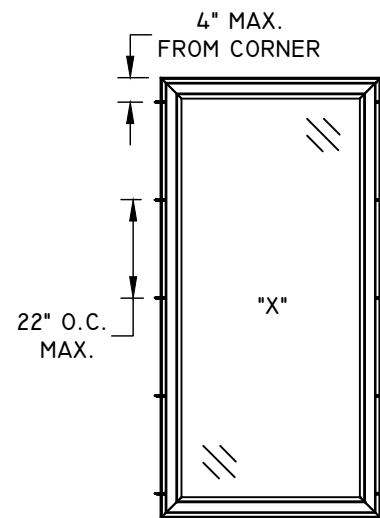

ANCHOR LAYOUT
FINLESS
DP +/- 60 PSF

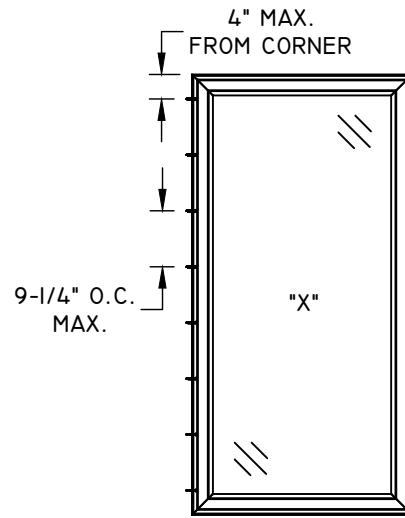

ANCHOR LAYOUT
FINLESS
DP +/- 50 PSF

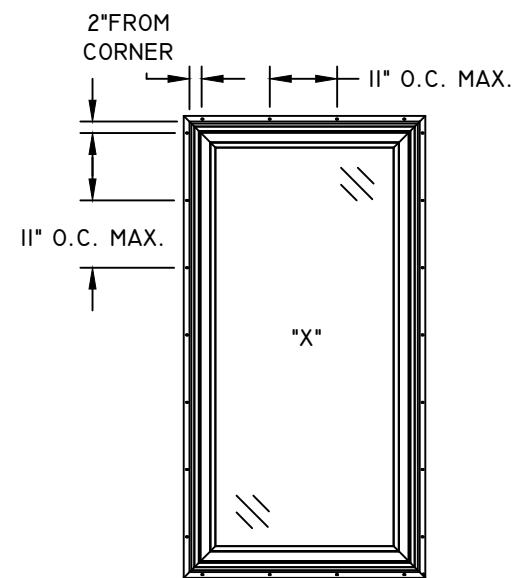


ANCHOR LAYOUT
FIN
(DP +/- 30 OR 50 PSF)

AMERICAN CRAFTSMAN
WINDOWS
SILVER LINE WINDOWS AND
DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT) ELEVATIONS & ANCHOR LAYOUTS				
NO.		REVISION DESCRIPTION		DATE
A		6TH FBC EDITION		10.16.17
B		7TH EDITION 2020 FBC		12.04.20
C		8TH EDITION 2023 FBC		12.09.23
D		CURRENT FBC & EC24-100		02.26.25
DATE: 10.16.17		DWN BY: RV		CHK BY: HFN
				SCALE: NTS

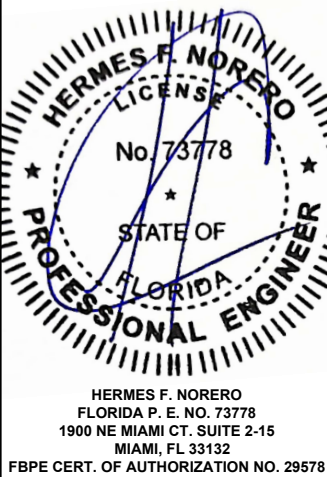


HERMES F. NORERO
FLORIDA P. E. NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478 FX: (954) 744-4738

FL #: 21335
DWG #: SWD047
SHEET: 2 OF 8

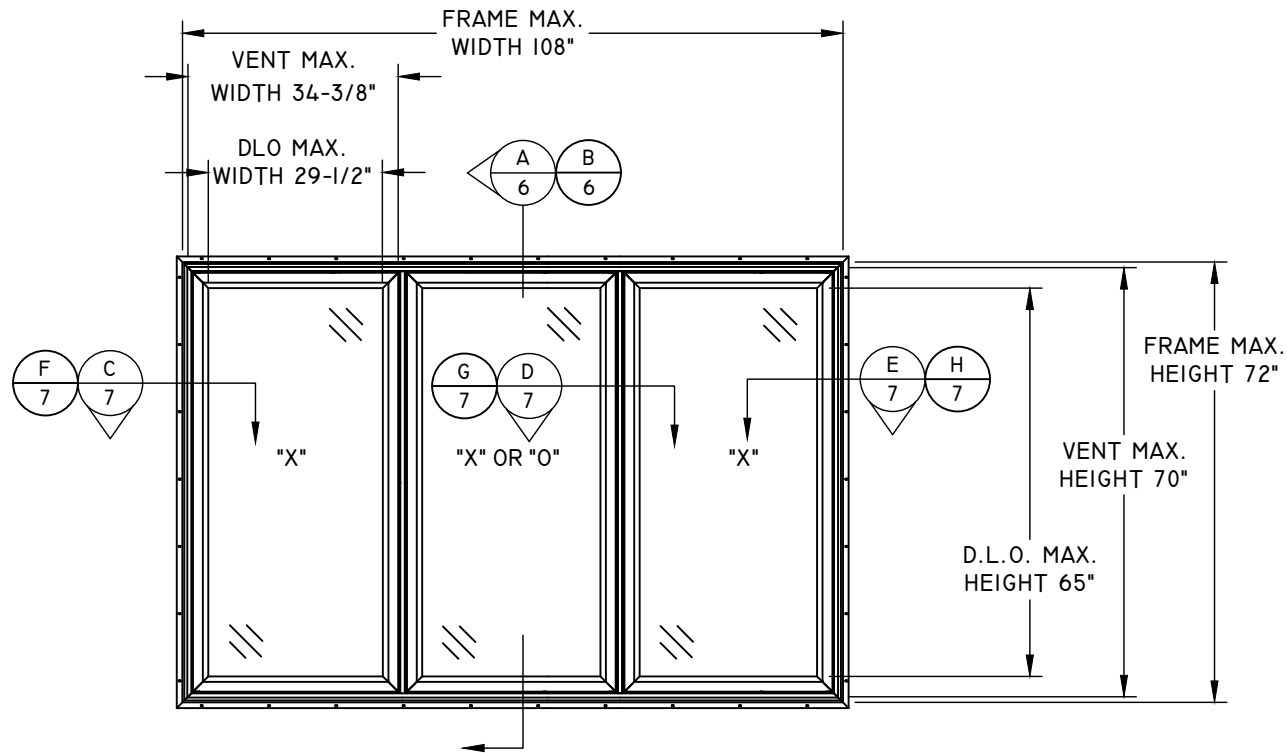


TRIPLE CASEMENT ELEVATION

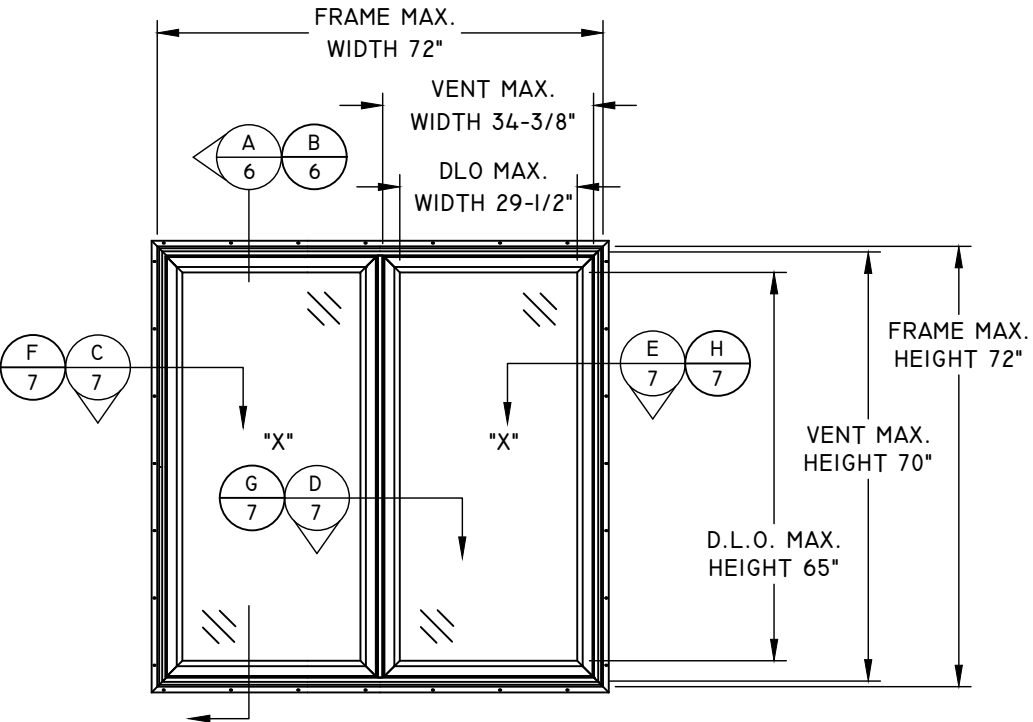


DOUBLE CASEMENT ELEVATION

NOTE: ANCHOR SPACING SPECIFICATIONS BELOW APPLY FOR THE DOUBLE AND TRIPLE CASEMENT CONFIGURATIONS

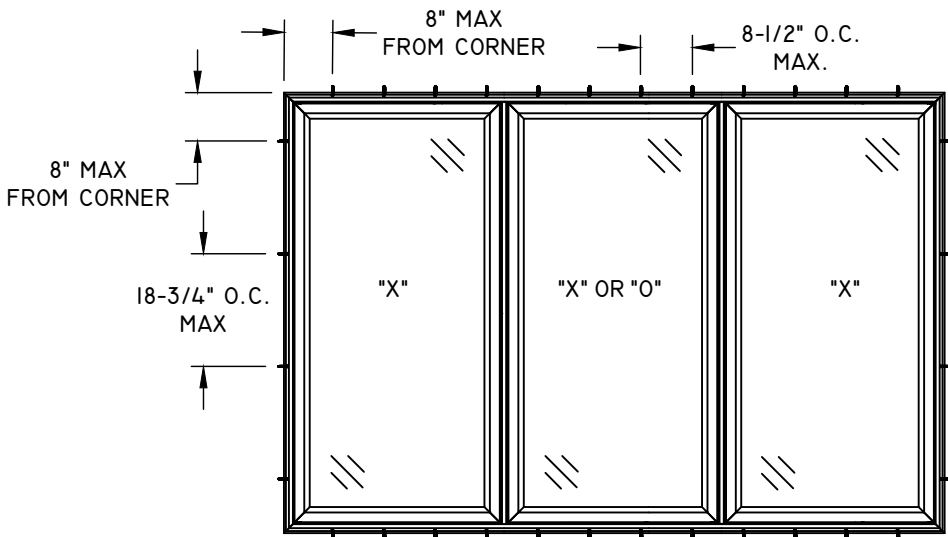


ANCHOR LAYOUT
FINLESS
DP +/- 30 PSF

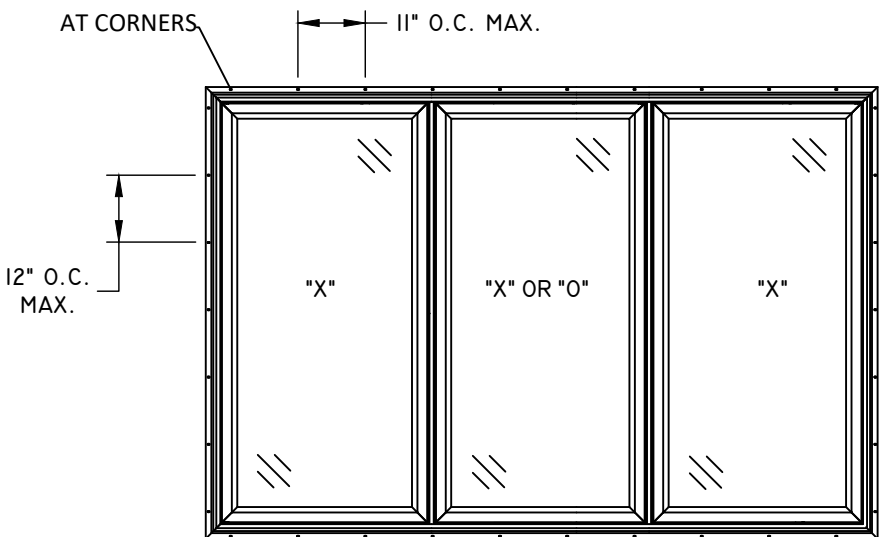


ANCHOR LAYOUT
FIN
DP +/- 30 PSF

TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT) ELEVATIONS & ANCHOR LAYOUTS				DATE	
REVISION DESCRIPTION		BY	DATE		
A 6TH FBC EDITION		AR	10.16.17		
B 7TH EDITION 2020 FBC		LMH	12.04.20		
C 8TH EDITION 2023 FBC		LMH	12.09.23		
D CURRENT FBC & EC24-100		LMH	02.26.25		
DATE:	10.16.17	DWN BY:	RV	CHK BY:	HFN
SCALE:	NTS				

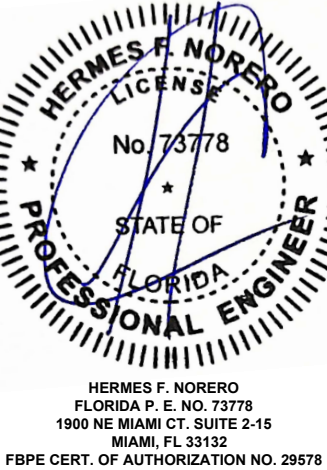

TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT)		ELEVATIONS & ANCHOR LAYOUTS	
NO.	REVISION DESCRIPTION	BY	DATE
A	6TH FBC EDITION	AR	10.16.17
B	7TH EDITION 2020 FBC	LMH	12.04.20
C	8TH EDITION 2023 FBC	LMH	12.09.23
D	CURRENT FBC & EC24-100	LMH	02.26.25

DATE: 10.16.17	DWN BY: RV	CHK BY: HFN	SCALE: NTS
-------------------	---------------	----------------	---------------

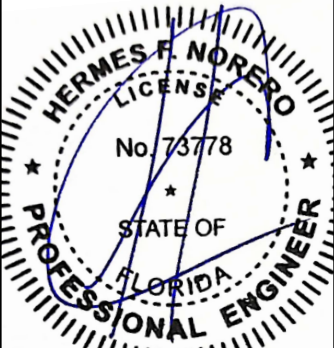


HERMES F. NORERO
FLORIDA P. E. NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478 FX: (954) 744-4738


FL #: 21335

DWG #: SWD047

SHEET: 4 OF 8

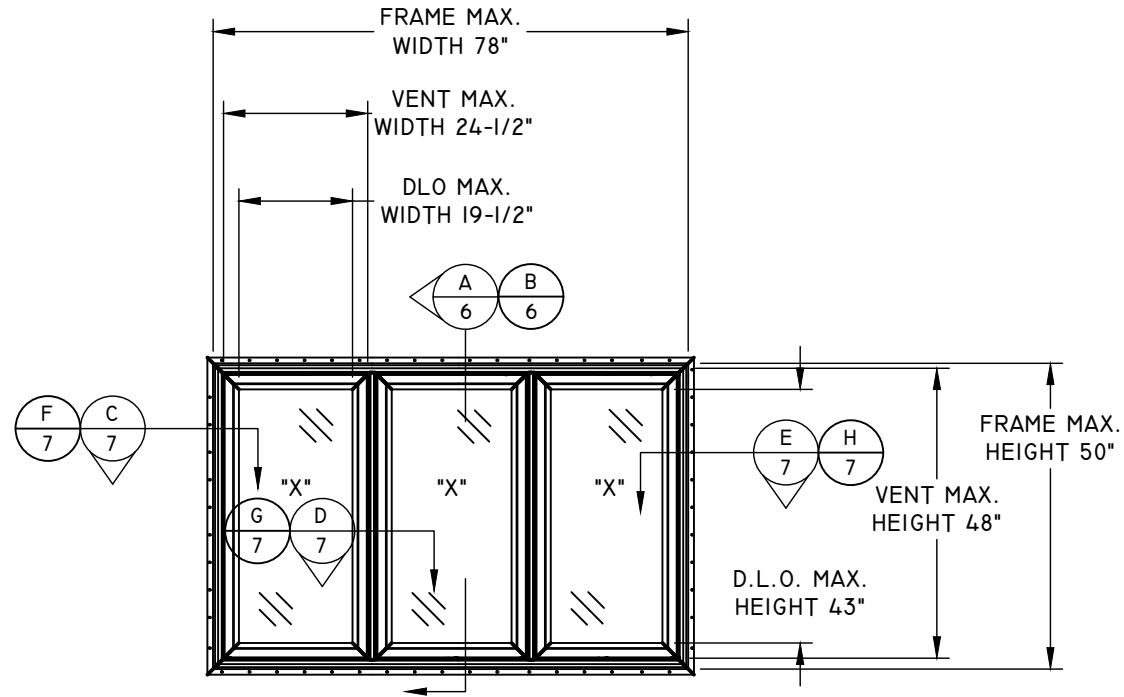


TRIPLE CASEMENT ELEVATION

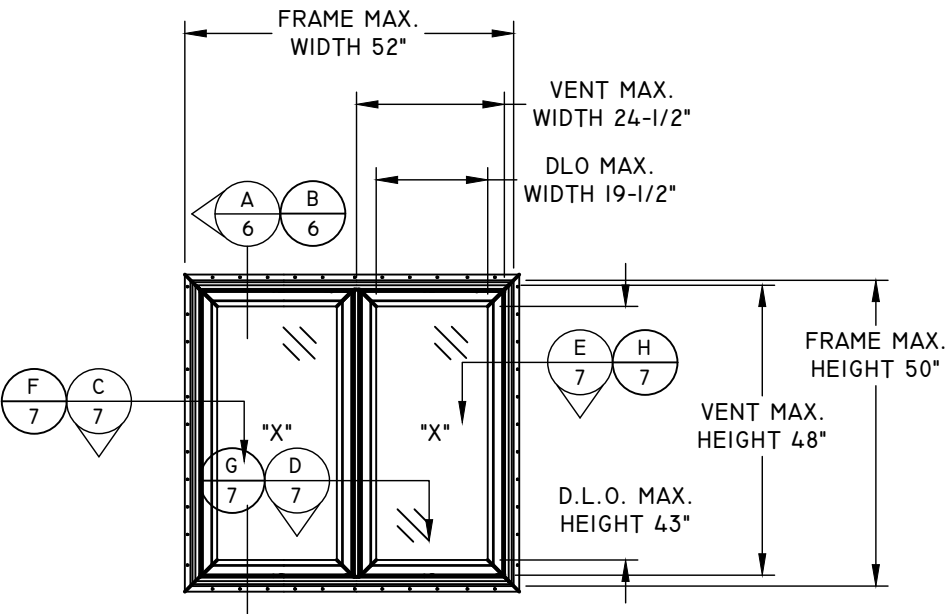


DOUBLE CASEMENT ELEVATION


NOTE: ANCHOR SPACING
SPECIFICATIONS BELOW APPLY FOR
THE DOUBLE AND TRIPLE
CASEMENT CONFIGURATIONS

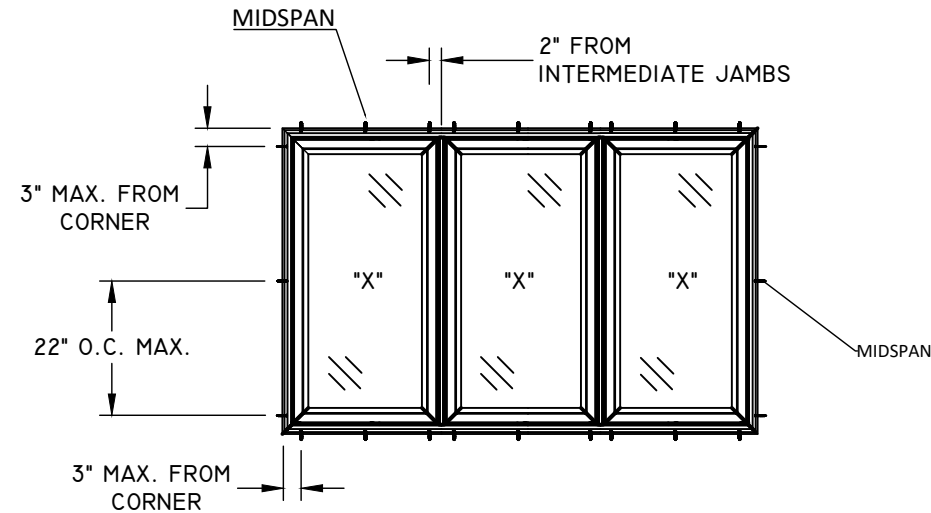

ANCHOR LAYOUT
FINLESS
DP +/- 50 PSF

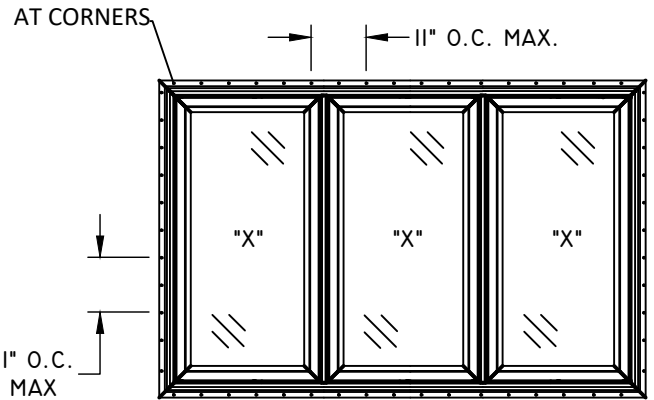


ANCHOR LAYOUT
FIN
DP +/- 50 PSF

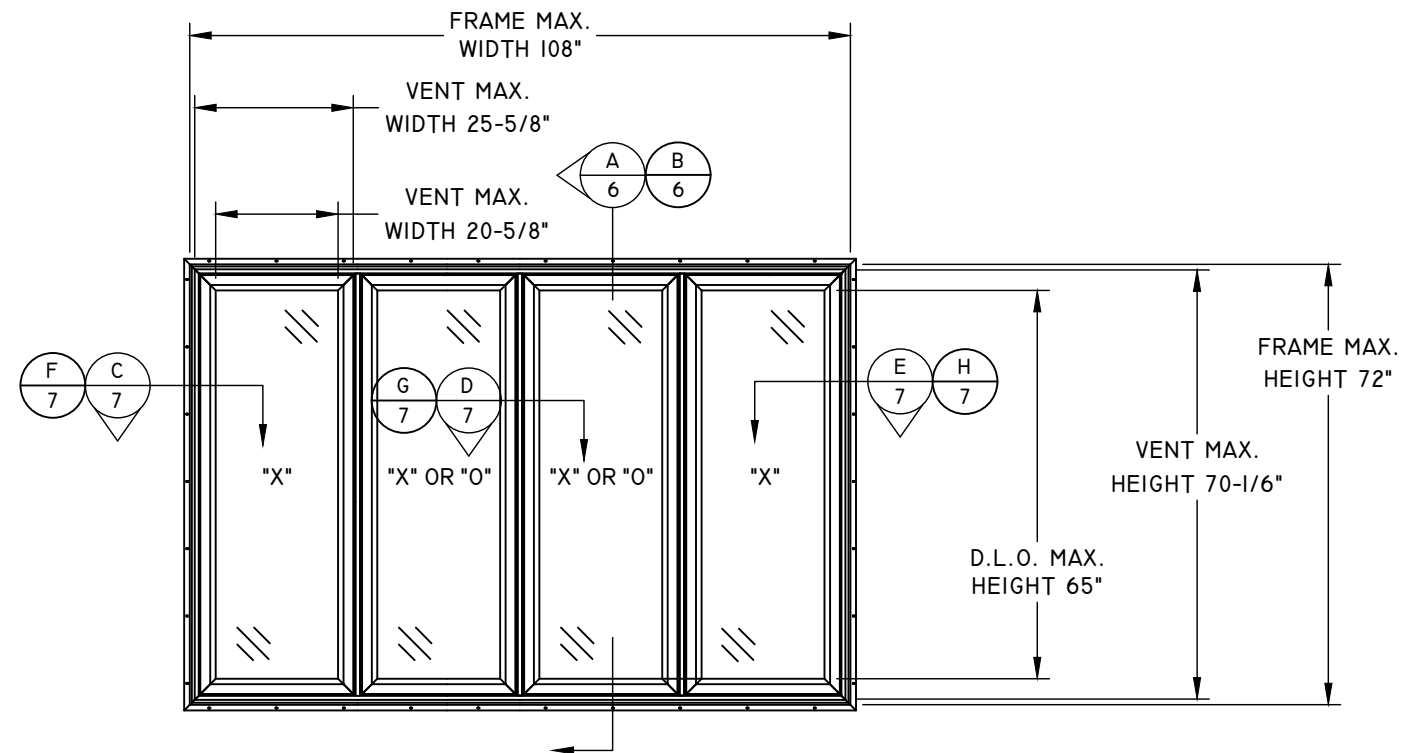


FOUR CASEMENT ELEVATION

NOTE: ANCHOR SPACING SPECIFICATIONS BELOW APPLY FOR THE DOUBLE AND TRIPLE CASEMENT CONFIGURATIONS

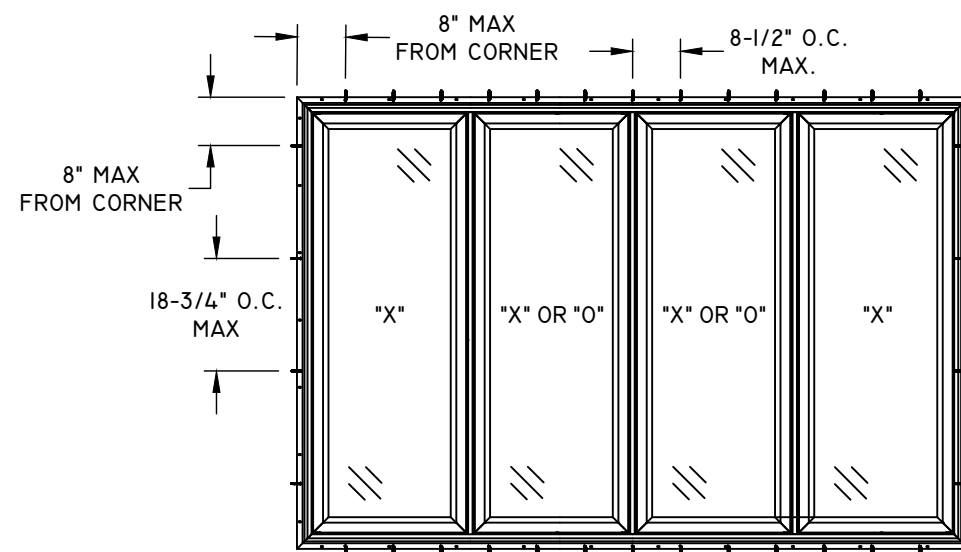

ANCHOR LAYOUT

FINLESS
DP +/- 30 PSF

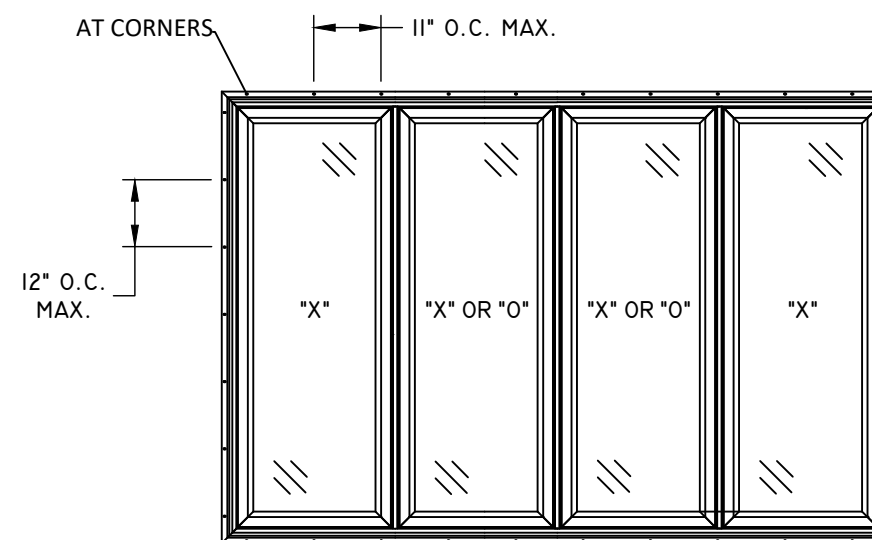

ANCHOR LAYOUT

FIN
DP +/- 30 PSF

AMERICAN CRAFTSMAN
WINDOWS
SILVER LINE WINDOWS AND
DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT)


NO.	REVISION DESCRIPTION	BY	DATE
A	6TH FBC EDITION	AR	10.16.17
B	7TH EDITION 2020 FBC	LMH	12.04.20
C	8TH EDITION 2023 FBC	LMH	12.09.23
D	CURRENT FBC & EC24-100	LMH	02.26.25

DATE:
10.16.17

DWN BY:
RV

CHK BY:
HFN

SCALE:
NTS

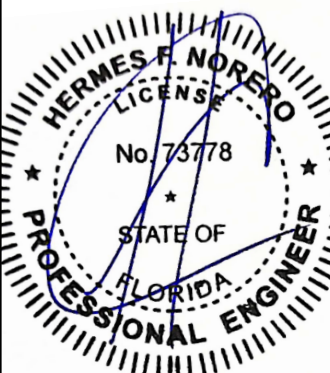


HERMES F. NORERO
FLORIDA P. E. NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478 FX: (954) 744-4738

FL#: 21335

DWG #: SWD047

SHEET: 5 OF 8

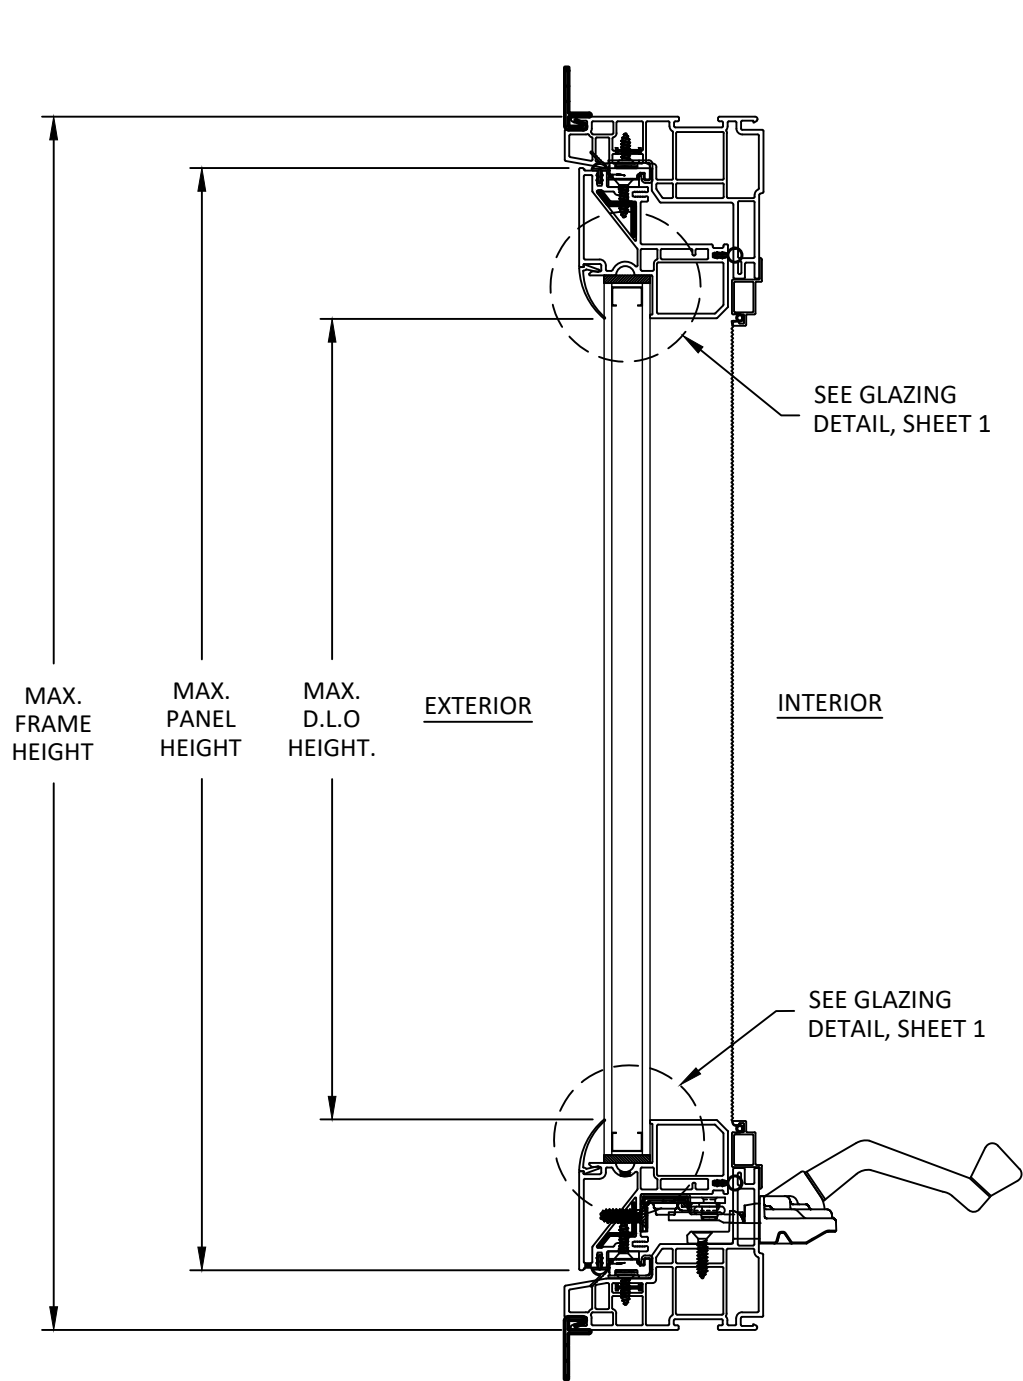


A
6

VERTICAL SECTION
THROUGH FRAME INSTALLATION

NOTE:
1. NAIL FIN INSTALLATION MAY USE
OPTIONAL J-CHANNEL SUCH
THAT TYPICAL INSTALLATION
METHODS AND ANCHOR
REQUIREMENTS ARE MET.
2. THROUGH FRAME INSTALLATION
MAY USE AN OPTIONAL SNAP ON
FLANGE SUCH THAT TYPICAL
INSTALLATION AND ANCHOR
REQUIREMENTS ARE MET.

NOTE: 1X WOOD BUCK
BY OTHERS IS OPTIONAL
FOR MASONRY APPLICATIONS.

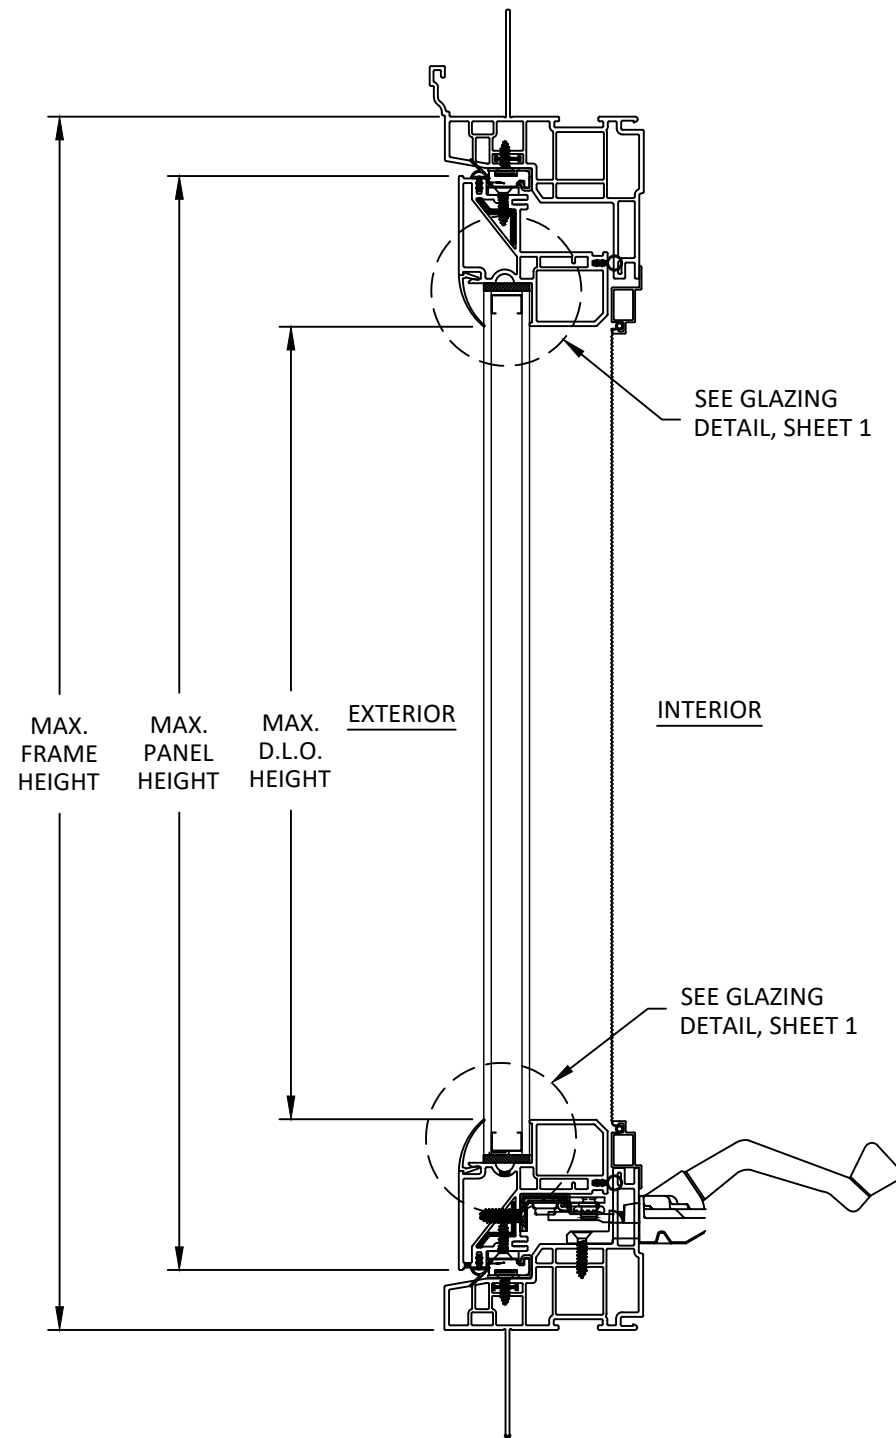


B
6

VERTICAL SECTION
NAIL FIN INSTALLATION

AMERICAN CRAFTSMAN
WINDOWS
SILVER LINE WINDOWS AND
DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT)				
DATE:		DWN BY:		CHK BY:
10.16.17		RV		HFN
NO.		REVISION DESCRIPTION		DATE
A		6TH FBC EDITION		10.16.17
B		7TH EDITION 2020 FBC		12.04.20
C		8TH EDITION 2023 FBC		12.09.23
D		CURRENT FBC & EC24-100		02.26.25

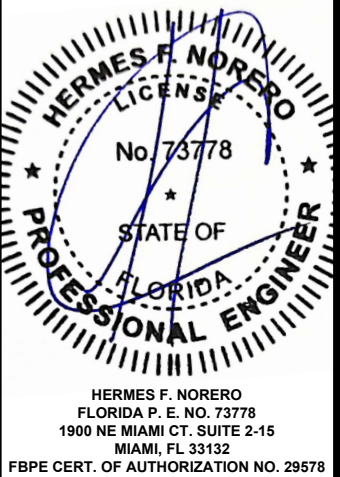


HERMES F. NORERO
FLORIDA P. E. NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478 FX: (954) 744-4738

FL #: 21335

DWG #: SWD047

SHEET: 6 OF 8

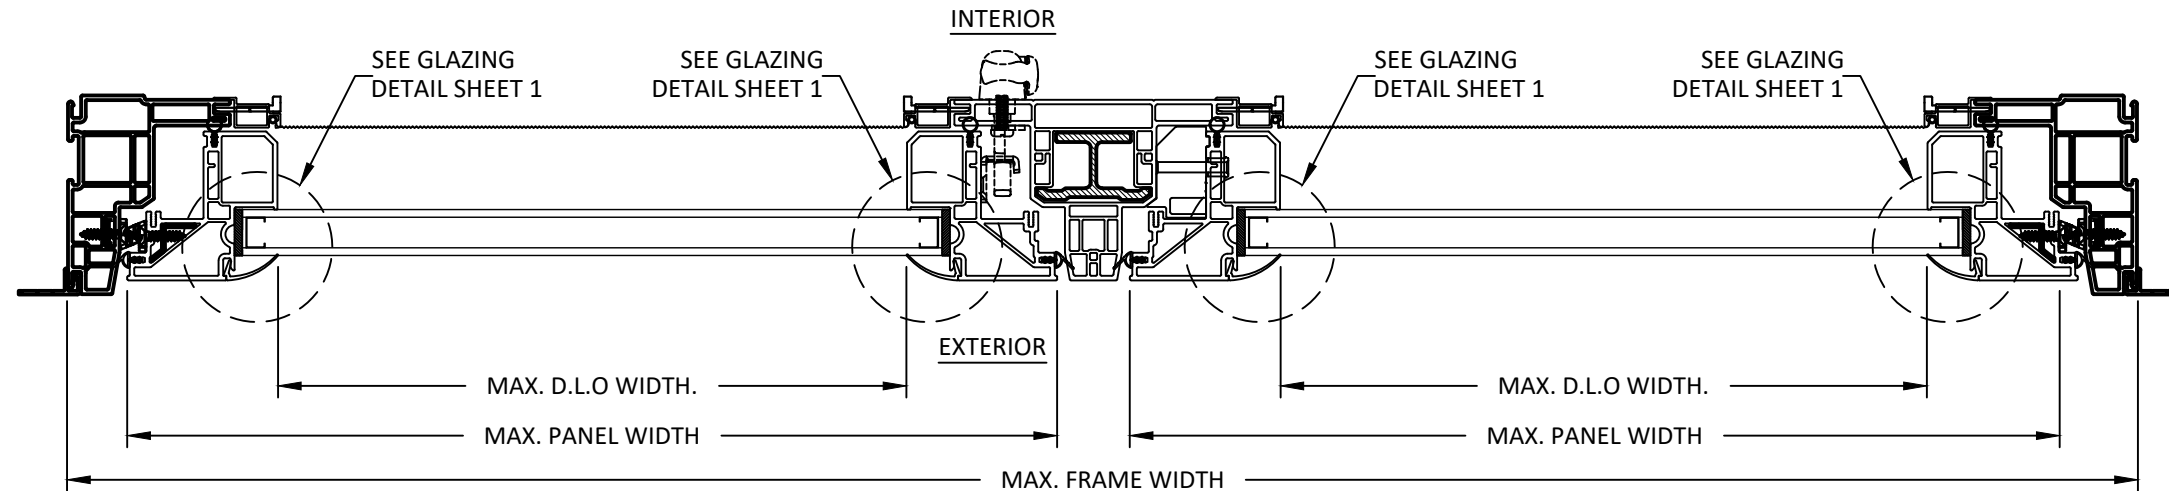


C
7
HORIZONTAL SECTION
THROUGH FRAME INSTALLATION

D
7
HORIZONTAL SECTION
INTERMEDIATE JAMB XOX

E
7
HORIZONTAL SECTION
THROUGH FRAME INSTALLATION

NOTE:
1. NAIL FIN INSTALLATION MAY USE
OPTIONAL J-CHANNEL SUCH
THAT TYPICAL INSTALLATION
METHODS AND ANCHOR
REQUIREMENTS ARE MET.
2. THROUGH FRAME INSTALLATION
MAY USE AN OPTIONAL SNAP ON
FLANGE SUCH THAT TYPICAL
INSTALLATION AND ANCHOR
REQUIREMENTS ARE MET.

NOTE: 1X WOOD BUCK
BY OTHERS IS OPTIONAL
FOR MASONRY APPLICATIONS.

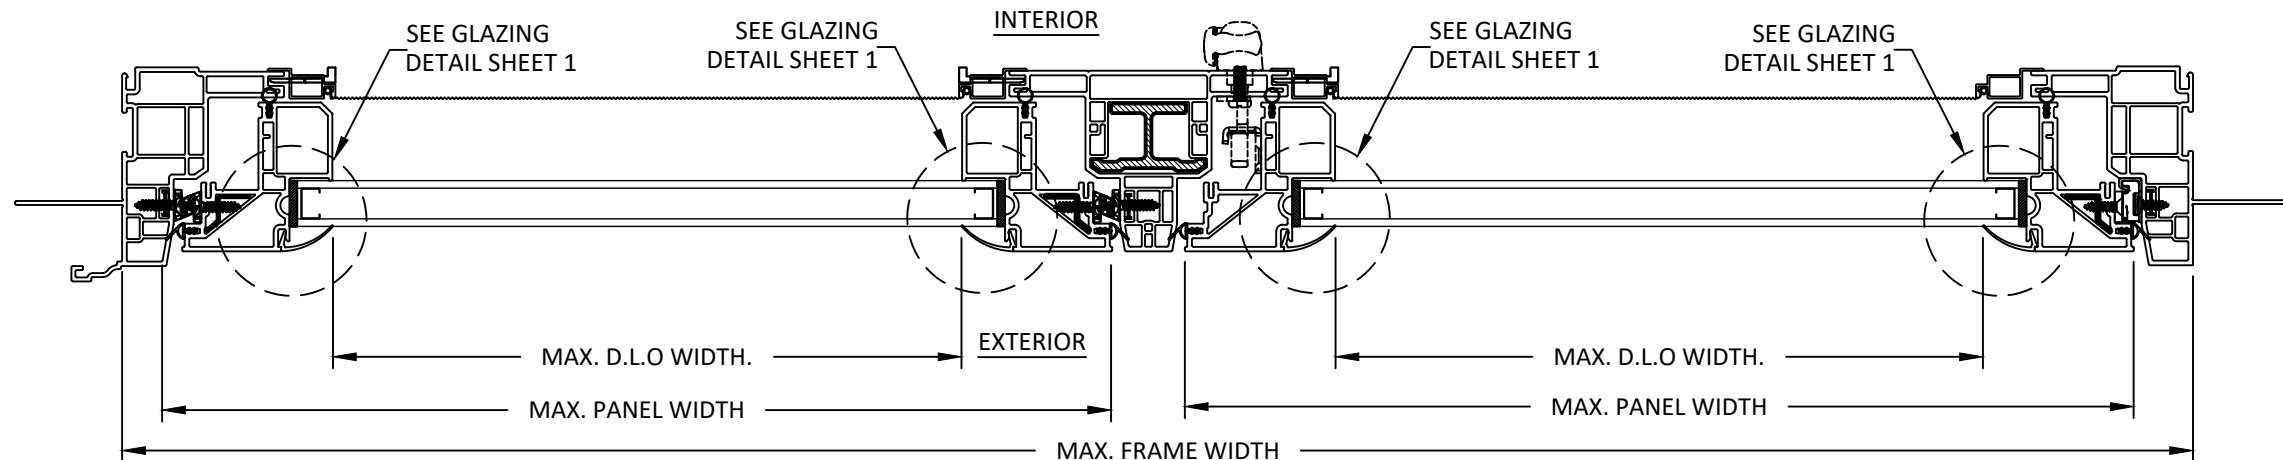


F
7
HORIZONTAL SECTION
NAIL FIN INSTALLATION


G
7
HORIZONTAL SECTION
INTERMEDIATE JAMB XXX

H
7
HORIZONTAL SECTION
NAIL FIN INSTALLATION


TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT)			
HORIZONTAL SECTIONS			
DATE: 10.16.17		NO.	REVISION DESCRIPTION
DWN BY: RV		BY	DATE
CHK BY: HFN		A	6TH FBC EDITION
SCALE: NTS		B	7TH EDITION 2020 FBC
		C	8TH EDITION 2023 FBC
		D	CURRENT FBC & EC24-100
			AR
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH
			LMH

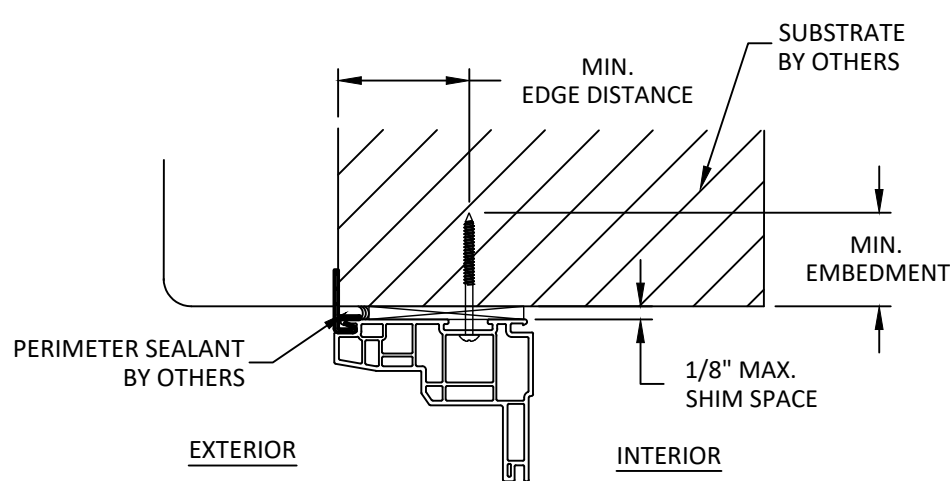

I
8 **VERTICAL SECTION**
THROUGH FRAME (HEAD, SILL & JAMB)

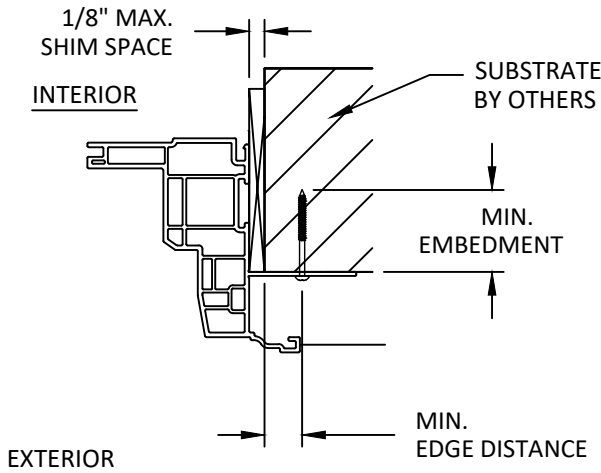


J
8 **HORIZONTAL SECTION**
NAIL FIN (HEAD, SILL & JAMB)

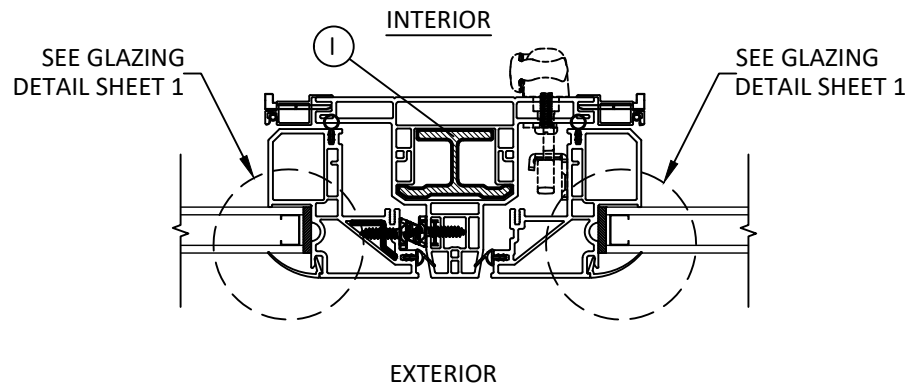

K
8 **HORIZONTAL SECTION**
REINFORCED MULLION

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.



1 **INTERMEDIATE JAMB REINFORCEMENT**


REINFORCEMENT DETAIL

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW PAN HEAD	1-1/2"	3/4"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#8 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
THROUGH FRAME	WOOD: MIN. SG = 0.55	#10 PAN HEAD WOOD SCREW	1-1/2"	3/4"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#10 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON FLAT HEAD	1-1/4"	1-3/4"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON FLAT HEAD	1-1/4"	1-3/4"

AMERICAN CRAFTSMAN
WINDOWS
SILVER LINE WINDOWS AND
DOORS

ONE SILVERLINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE: V3 SERIES/70 SERIES CASEMENT (NON-IMPACT) VERTICAL & HORIZONTAL DETAILS; INSTALLATION NOTES & REINFORCEMENT DETAILS				
DATE:	DWN BY:	CHK BY:	SCALE:	NTS
10.16.17	RV	HFN		
REVISION DESCRIPTION		NO.	BY	DATE
6TH FBC EDITION		A	AR	10.16.17
7TH EDITION 2020 FBC		B	LMH	12.04.20
8TH EDITION 2023 FBC		C	LMH	12.09.23
CURRENT FBC & EC24-100		D	LMH	02.26.25

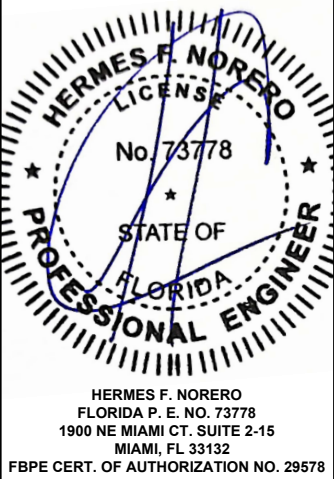

HERMES F. NORERO
FLORIDA P. E. NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478 FX: (954) 744-4738

FL #: **21335**

DWG #: **SWD047**

SHEET: **8 OF 8**