



H3 2.0 Awning Operator 2-Wide 48 x 36
Overall Mulled Unit Size 94 1/2" x 35 1/2"
Integral Nail Fin Installation

CCL Listing# 436-H-659.22

ELEMENT TEST REPORT NUMBER: **ESP023331P-1999**

H3 2.0 MULLED 2-WIDE Awning Operating Window
Integral Nail Fin Installation / WDMA Instructions / Non-Impact

SHEET: 1 OF 3

DRAWN BY: B.K.


TEST REPORT SUMMARY:

- MULLED UNIT, OVERALL BASIC UNIT FRAME SIZE:
94 1/2" (2400mm) x 35 1/2" (902mm)
- SINGLE UNIT, MAX. BASIC UNIT FRAME SIZE:
47 1/4" (1200mm) x 35 1/2" (902mm)
- OVERALL DESIGN PRESSURE: ± 90.2 psf
- STRUCTURAL TEST PRESSURE: ± 97.7 psf
- RATING: **CW-PG50**


INSTALLATION NOTES:

1. USE 2" x _ PINE WOOD BUCK
2. 1/4" MAXIMUM SHIM SPACE AT HEAD, SILL, JAMBS.
- PLACE WOOD SHIMS 6-10" ON CENTER
3. APPLY A CONTINUOUS BEAD OF SEALANT BETWEEN THE NAIL IN AND THE BUCK, ON ALL FOUR SIDES
4. INSTALL #8 X 1-1/4" PFH SCREWS SPACED APPROXIMATELY 1-4" FROM EACH CORNER AND 6-8" ON CENTER THEREAFTER INTO THE FRAMING MATERIAL AT HEAD, SILL & SIDE JAMBS. WITH 3/8" MINIMUM EDGE DISTANCE.
- SILICONE SEAL OVER NAIL/SCREW HEADS
5. 1" MINIMUM FASTENER EMBEDMENT INTO FRAMING MATERIAL
6. OVERALL MULLED WINDOW SIZE: B.U.S. (Basic Unit Size) =
94 1/2" (2400mm) x 35 1/2" (902mm)
INDIVIDUAL MAX. WINDOW SIZE: B.U.S.=
47 1/4" (1200mm) x 35 1/2" (902mm)

- Check rough opening for proper size, plumb, level and square.
- Make all necessary adjustments to ensure rough opening is plumb, level and square.
- Sill must be flat, level and capable of supporting the weight of the unit.
- Opening should allow a maximum of 1/4" shim space at head, sill and jambs.
- Consult full installation instructions found on the Sierra Pacific web site, www.hurd.com, for all recommended installation procedures.
- Wood buck, framing, fasteners, sealant and all wall system materials are provided by others.

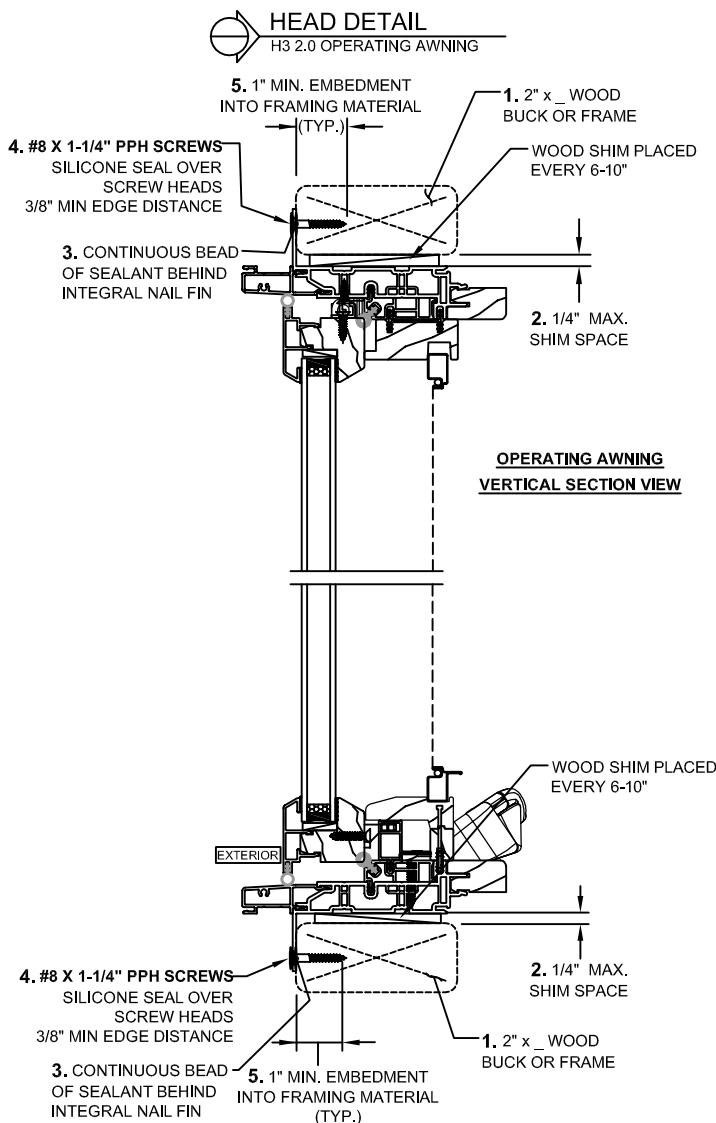

SILL DETAIL
H3 2.0 OPERATING AWNING

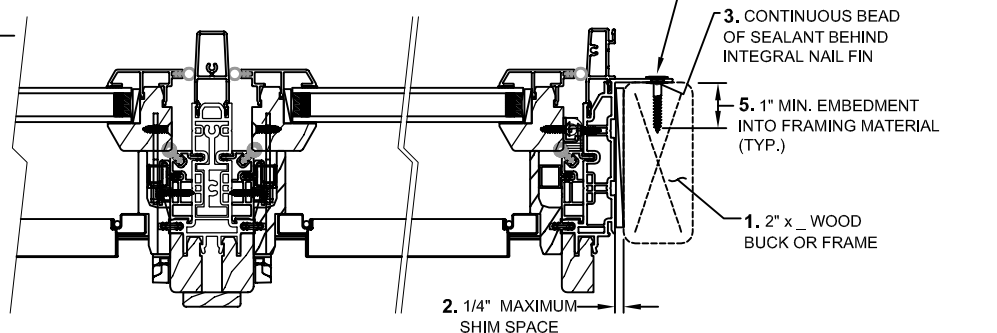

MULL DETAIL
H3 2.0 OPERATING AWNING 2-WIDE

JAMB DETAIL
H3 2.0 OPERATING AWNING

REQUIRES ONE MASONRY CLIP AT THE HEAD AND SILL OF EACH MULL POST FASTENED TO THE BUCK WITH TWO #8 X 1-1/4" PFH SCREWS PER CLIP.

Installation requirements may vary in particular locations and in other types of construction. Proper installation is essential, and Sierra Pacific Windows, recommends consultation with an AAMA Certified Installer, or other qualified, registered building professional before installation of any Sierra Pacific product. Proper installation of Sierra Pacific products is the responsibility of the installer. Sierra Pacific is not responsible for proper installation. Sierra Pacific is not responsible for the design of, conditions in, or performance of building construction beyond the perimeters of the Sierra Pacific units. Sierra Pacific is not responsible for proper integration of the Sierra Pacific units with the weather-repellent systems of the building.



H3 2.0 Awning Operator 2-Wide 48 x 36
Overall Mull Unit Size 94 1/2" x 35 1/2"
Integral Nail Fin Installation

TEST REPORT SUMMARY:

- MULLED UNIT, OVERALL BASIC UNIT FRAME SIZE:
94 1/2" (2400mm) x 35 1/2" (902mm)
- SINGLE UNIT, MAX. BASIC UNIT FRAME SIZE:
47 1/4" (1200mm) x 35 1/2" (902mm)
- OVERALL DESIGN PRESSURE: ± 90.2 psf
- STRUCTURAL TEST PRESSURE: ± 97.7 psf
- RATING: CW-PG50

CCL Listing# 436-H-659.22

ELEMENT TEST REPORT NUMBER: **ESP023331P-1999**


H3 2.0 MULLED 2-WIDE Awning Operating Window
Integral Nail Fin Installation / WDMA Instructions / Non-Impact

SHEET: 3 OF 3

DRAWN BY: B.K.

**ELEVATION SHOWING
FASTENER LOCATION & SPACING (TYP.)**

**REQUIRES ONE MASONRY CLIP AT THE HEAD AND SILL OF EACH
MULL POST FASTENED TO THE BUCK WITH TWO #8 X 1-1/4" PPH
SCREWS PER CLIP.**

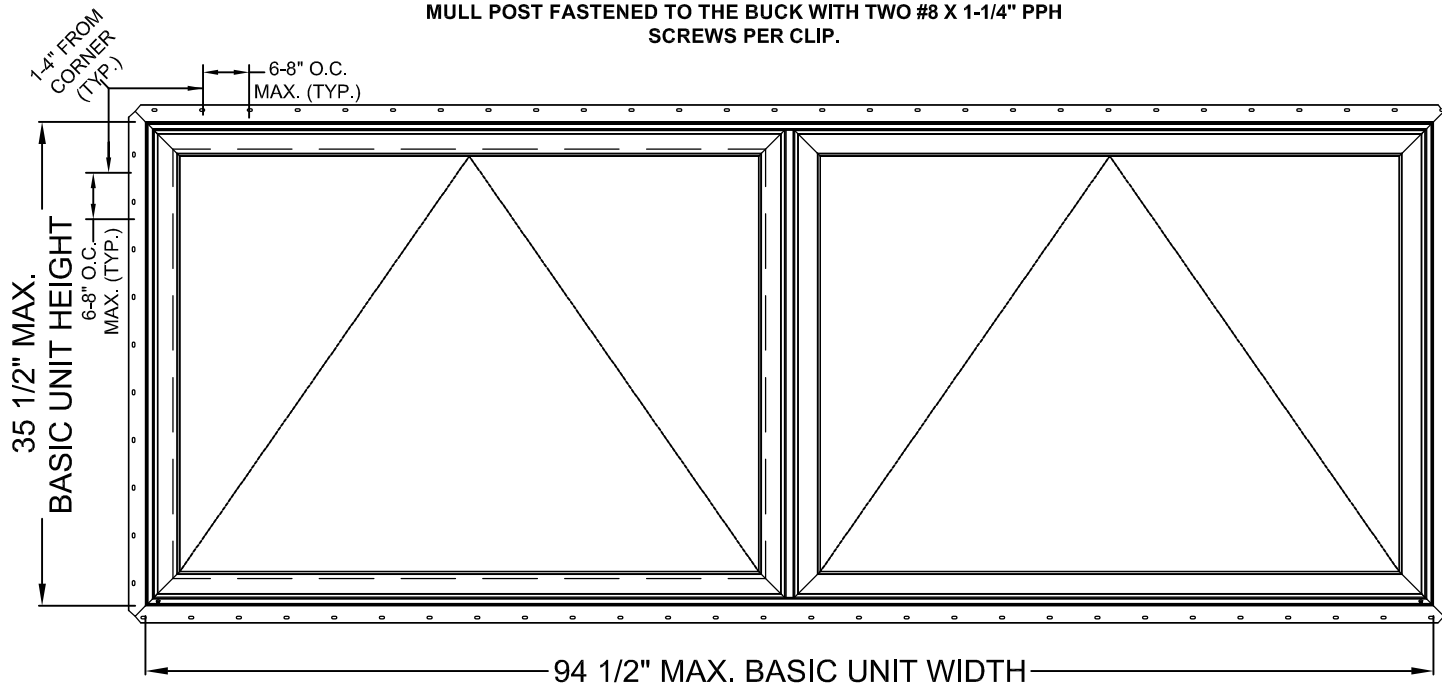

**MULLED WINDOW SIZE
OVERALL BASIC UNIT FRAME =
94 1/2" (2400mm) x 35 1/2" (902mm)**