


AIR MASTER AWNING

325 SINGLE HUNG WINDOW

(HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. WINDOW FRAME MATERIAL: 6063-T5 ALUMINUM
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.
9. CUSTOM SIZES AVAILABLE UPON REQUEST. CUSTOM DESIGN PRESSURE WILL BE ASSIGNED EQUAL TO NEXT LARGER STANDARD SIZE.

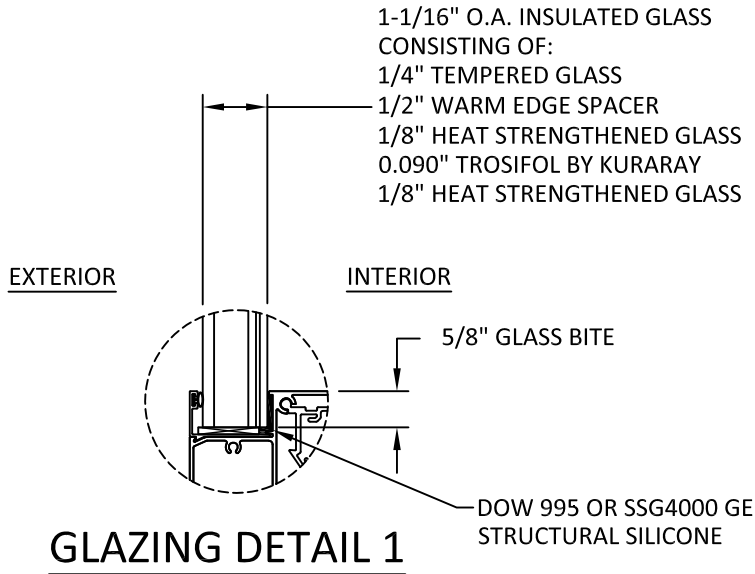

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION
3	ANCHOR LAYOUT
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	ANCHOR DETAILS AND INSTALLATION NOTES
7	ANCHOR DETAILS
8	BILL OF MATERIALS AND COMPONENTS

DESIGN PRESSURE RATING			
WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
53-1/8"	76"	+/- 73.7 PSF	LARGE & SMALL MISSILE IMPACT



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085

TITLE:
325 SINGLE HUNG WINDOW
(HVHZ) (IMPACT)
GENERAL NOTES &
GLAZING DETAIL


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)999-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.10 04:17:29 -0200'

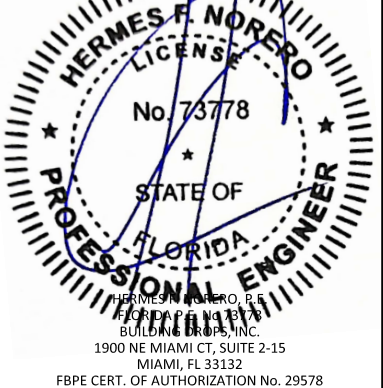

FL #:
FL21457

DATE: 08.23.17


DWG. BY: CL CHK. BY: HFN

SCALE: NTS

DWG. #: AIR015

SHEET: 1 REV. C

c:\users\dylanwata\building drops, inc\building drops landing - common\projects\air master windows & doors\fbc-25-1014 - submittal - f21457 250_325 sh windows - nail fin addition\dwgs\air015 - c.dwg 8/6/2026 12:01 PM

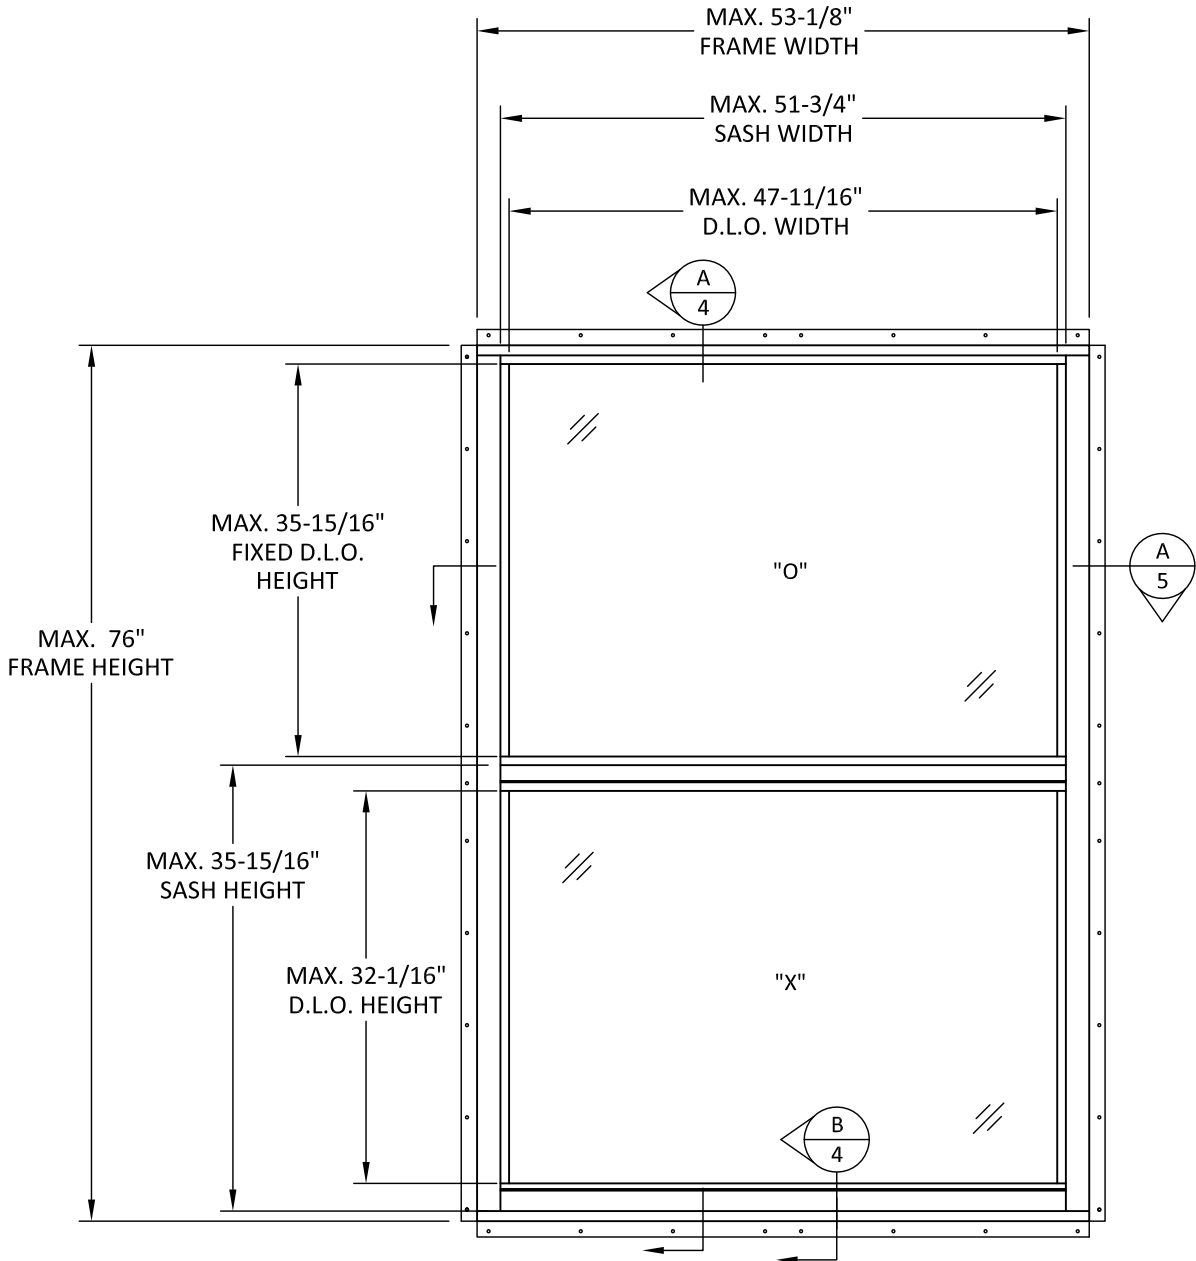

ELEVATION



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085


TITLE: 325 SINGLE HUNG WINDOW
(HVHZ) (IMPACT)
ELEVATION

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)999-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

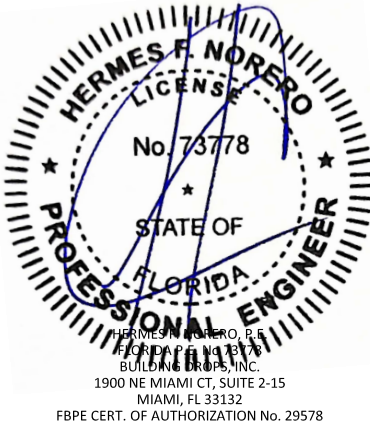

FL #: FL21457

DATE: 08.23.17


DWG. BY: CL
CHK. BY: HFN

SCALE: NTS


DWG. #: AIR015

SHEET: 2
REV. C

c:\users\dylanwata\building drops, inc\building drops landing - common\projects\air master windows & doors\fbc-25-1014 - submittal - f21457 250_325 sh windows - nail fin addition\dwgs\air015 - c.dwg
8/6/2026 12:01 PM

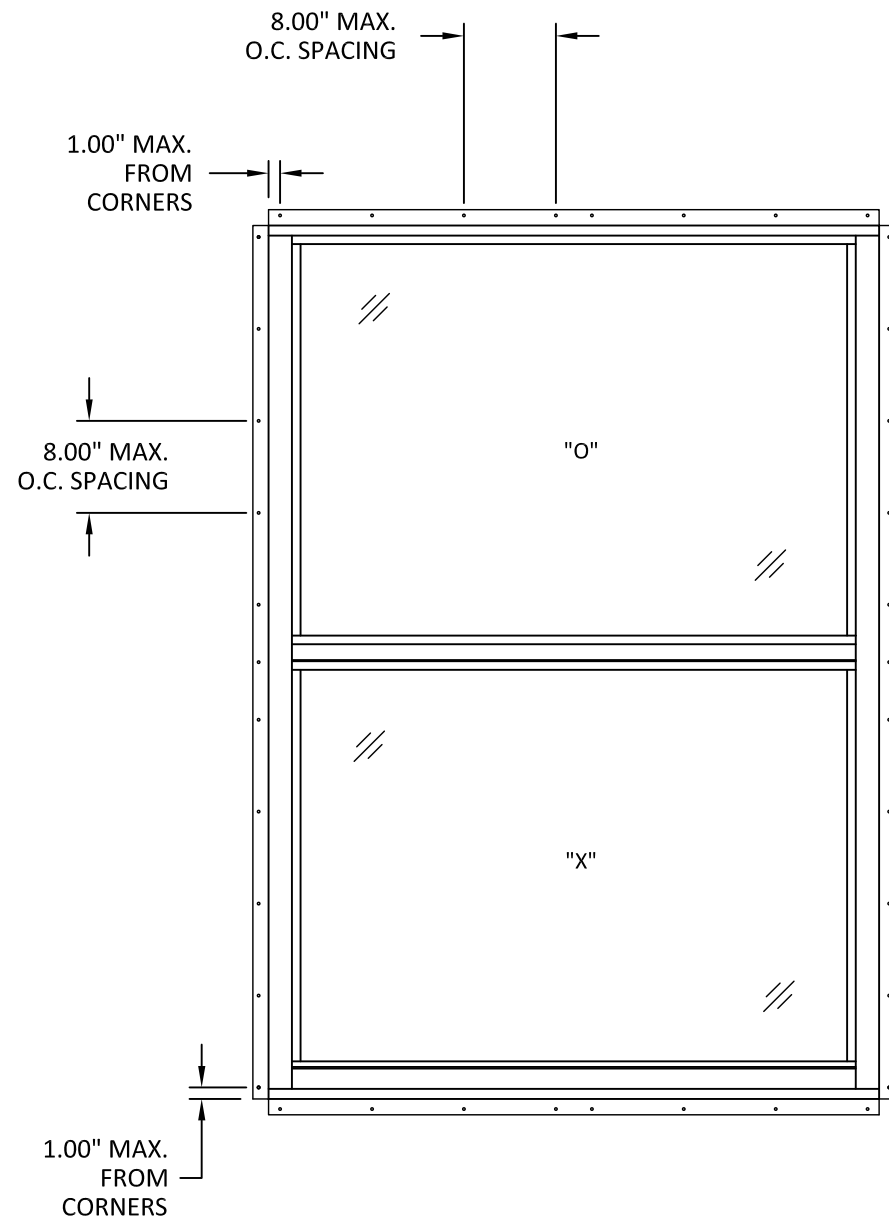

ANCHOR LAYOUT
NAIL FIN INSTALLATION

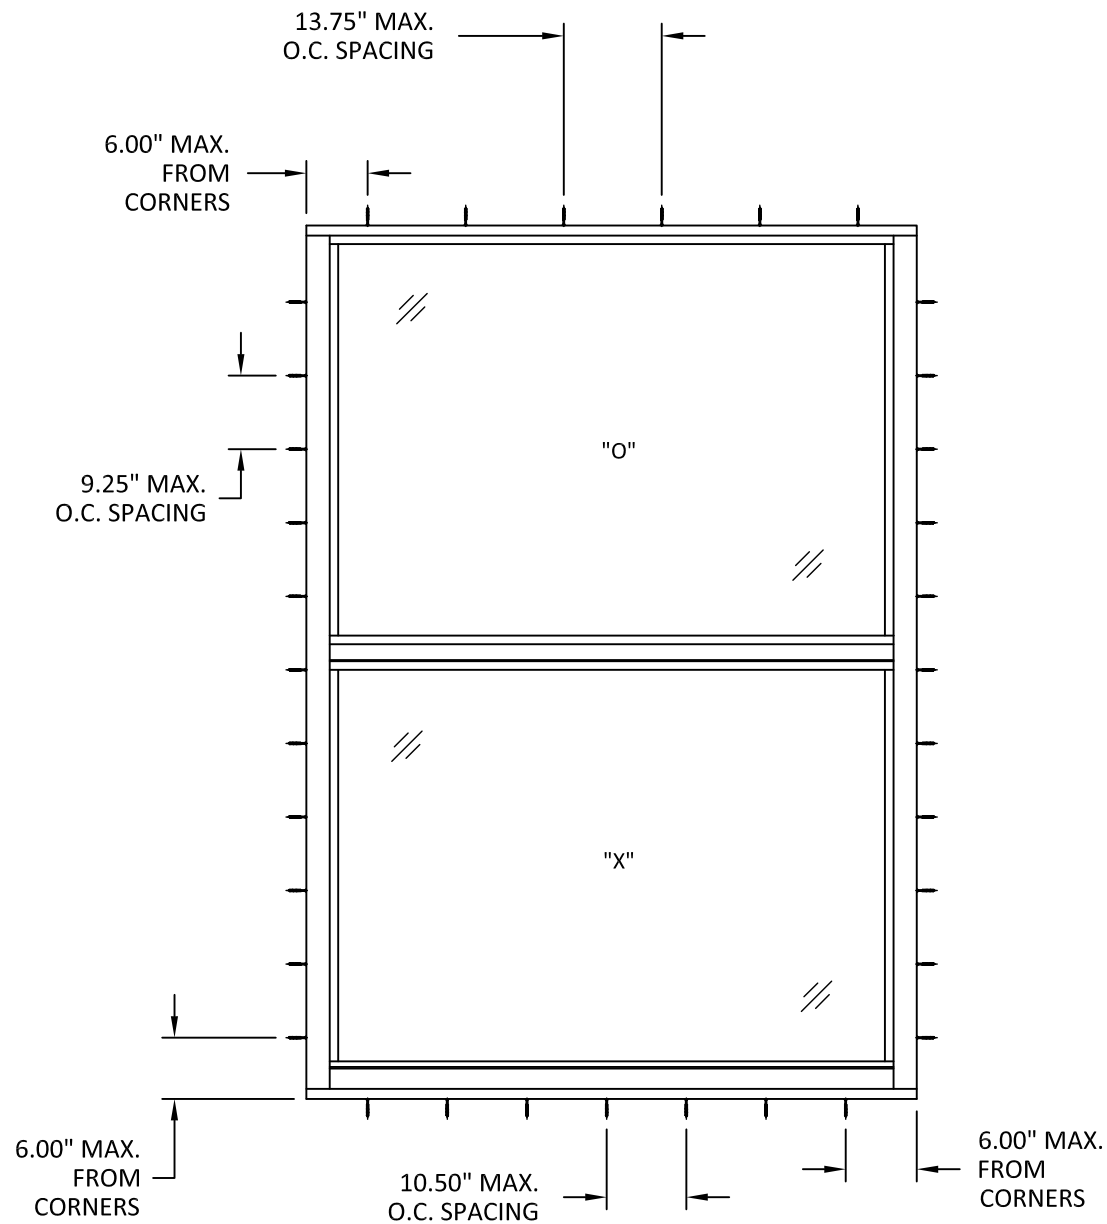

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085


TITLE: 325 SINGLE HUNG WINDOW
(HVBZ) (IMPACT)
ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)999-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

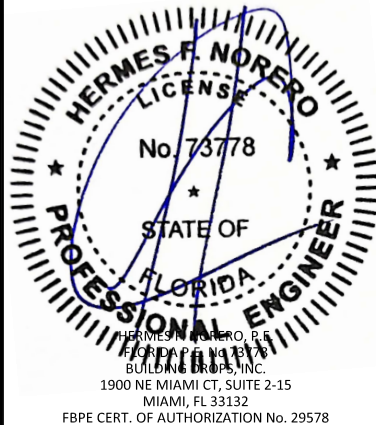

FL #: FL21457

DATE: 08.23.17


DWG. BY: CL
CHK. BY: HFN

SCALE: NTS


DWG. #: AIR015

SHEET: 3 OF 8
REV. C

c:\users\dylanwata\building drops, inc\building drops landing - common\projects\air master windows & doors\fbc-25-1014 - submittal - f21457 250_325 sh windows - nail fin addition\dwgs\air015 - c.dwg
8/6/2026 12:01 PM

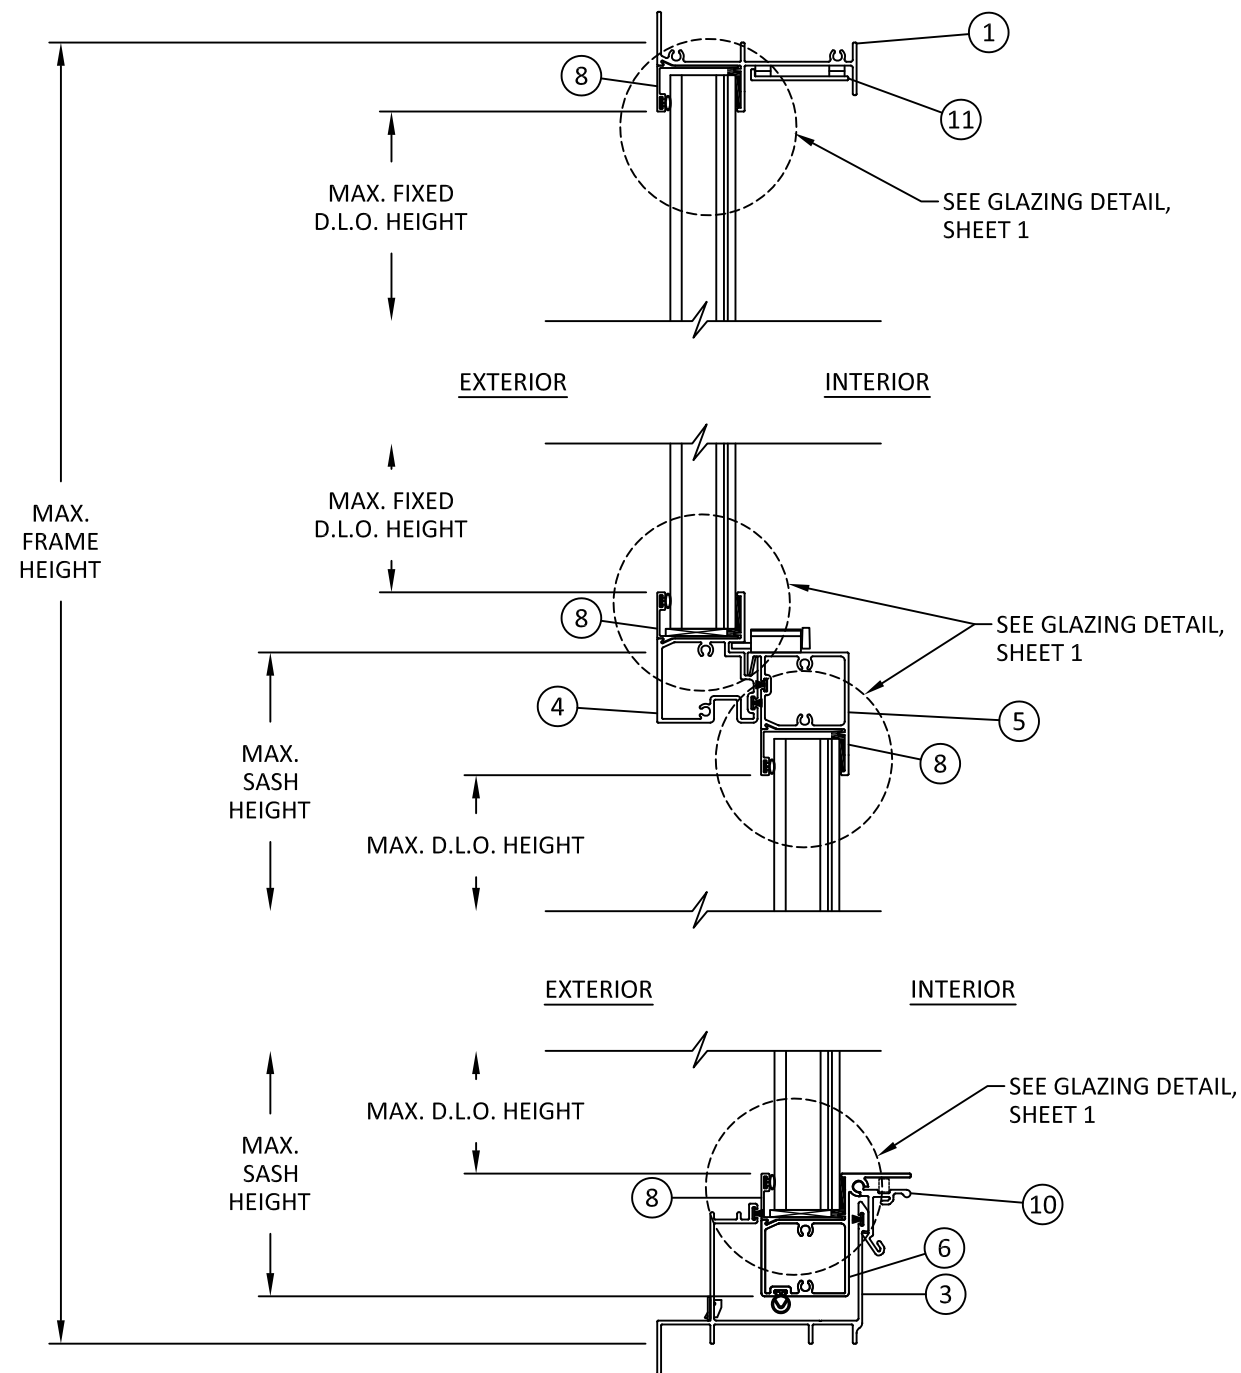

A
4 VERTICAL SECTION
TYP. HEAD AND SILL DETAIL

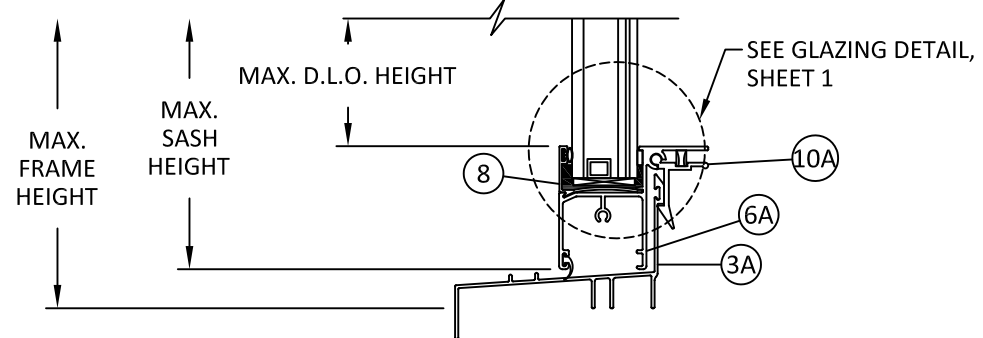

B
4 VERTICAL SECTION
ALTERNATE SILL AND SILL LOCK



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085


TITLE: 325 SINGLE HUNG WINDOW (HVHZ) (IMPACT)
VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)999-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

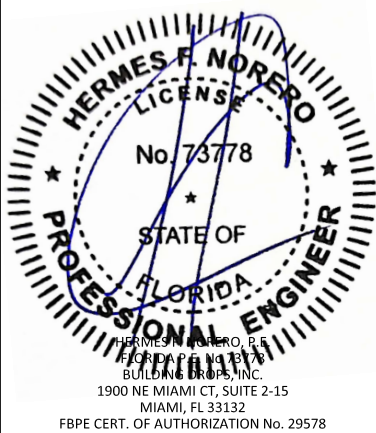

FL #:	FL21457	
DATE:	08.23.17	
DWG. BY:	CL	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	AIR015	
SHEET:	4	REV. C
OF 8		

c:\users\dylanwata\building drops, inc\building drops landing - common\projects\air master windows & doors\fbc-25-1014 - submittal - f21457 250_325 sh windows - nail fin addition\dwgs\air015 - c.dwg
8/6/2026 12:01 PM

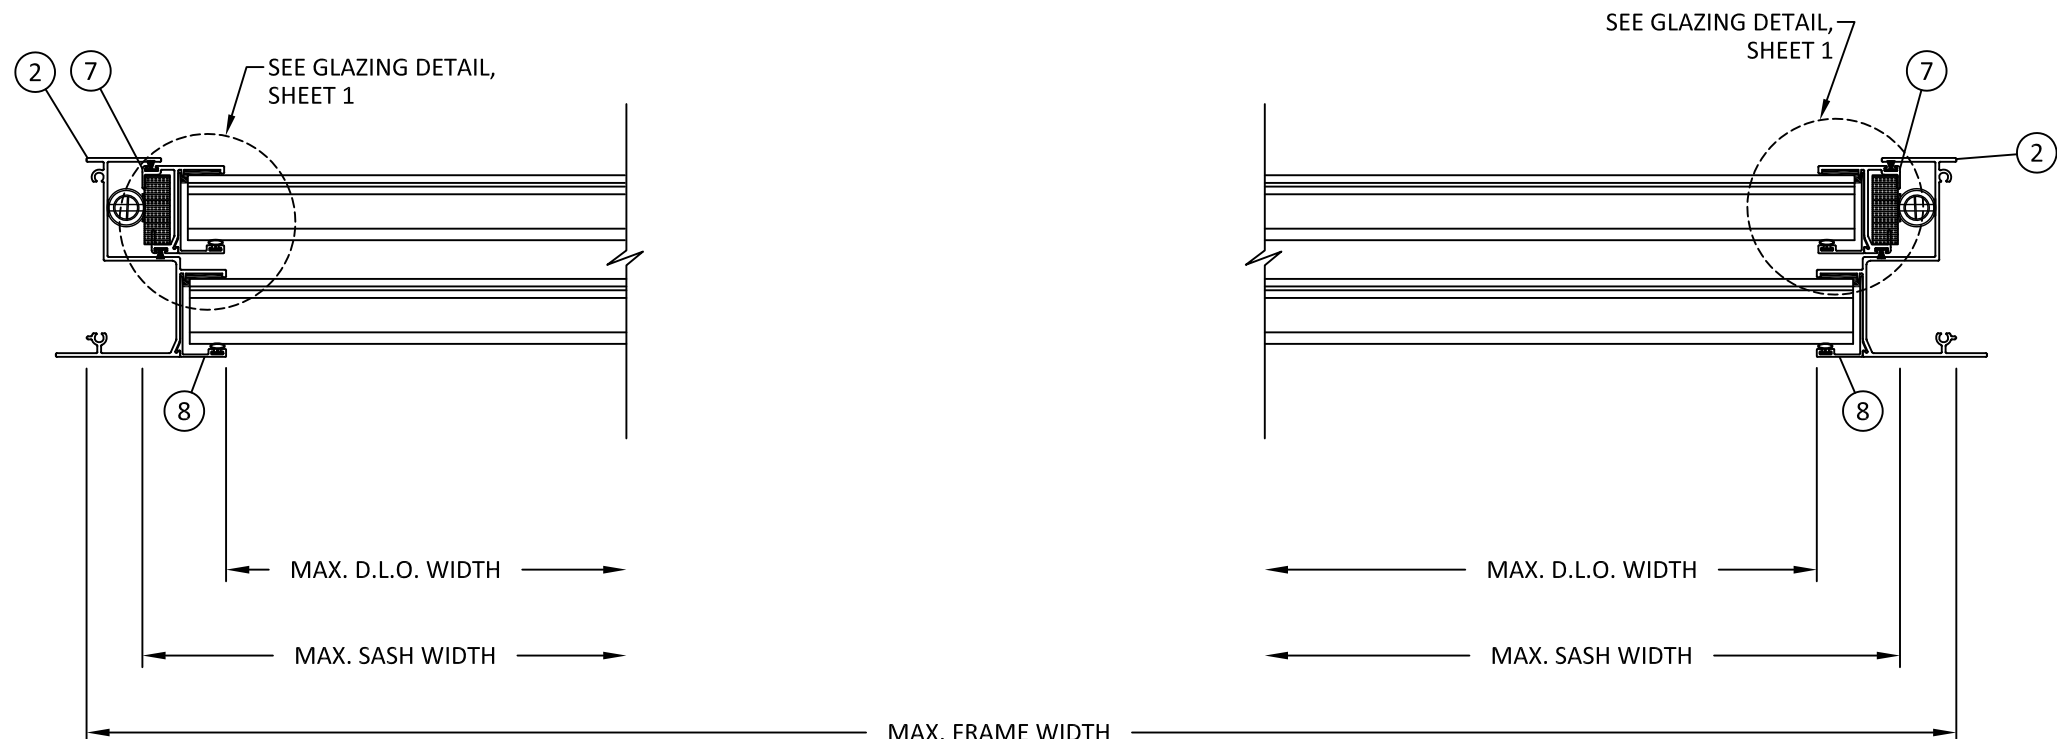

A 5 HORIZONTAL SECTION
TYP. JAMB AND MULLION DETAIL



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM
PH: (603) 627-3861 FAX: (787)623-0085


TITLE:
325 SINGLE HUNG WINDOW
(HVHZ) (IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
B.D.
BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)999-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com





REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

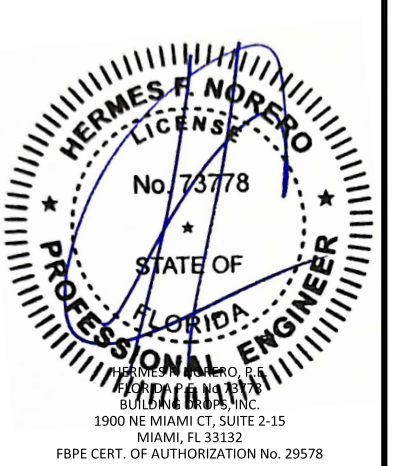

FL #:		FL21457	
DATE:		08.23.17	
DWG. BY:	CL	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		AIR015	
SHEET:		REV. C	
5		OF 8	

c:\users\dylanwata\building_drops\inc\building_drops_landing_common\projects\air master windows & doors\fbc-25-1014 - submittal - f121457 250_325 sh windows - nail fin addition\dwgs\air015 - c.dwg
8/6/2026 12:02 PM

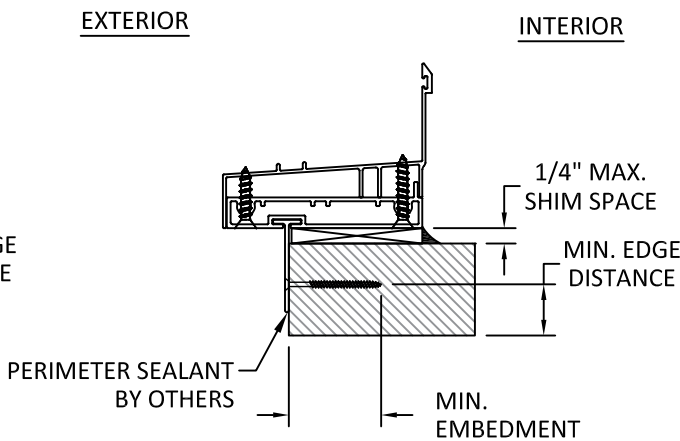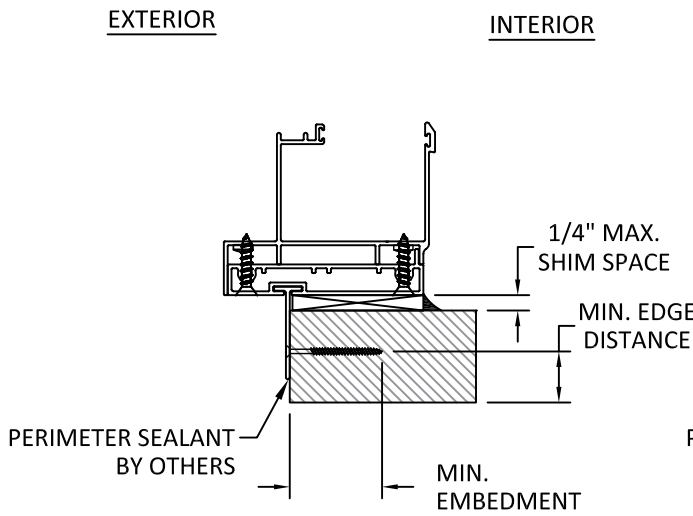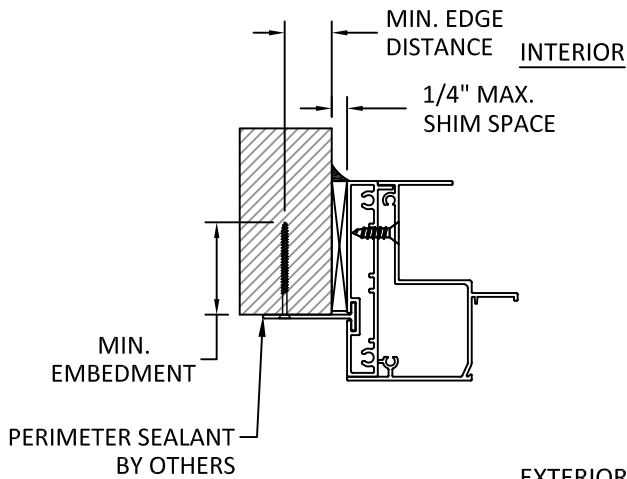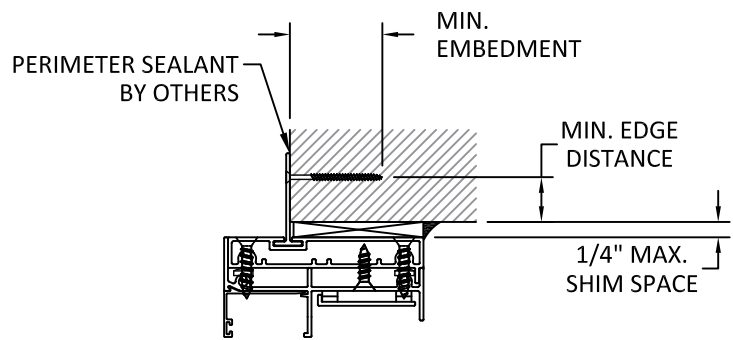

A
6 VERTICAL SECTION
HEAD
NAIL FIN

B
6 VERTICAL SECTION
HEAD
NAIL FIN

C
6 VERTICAL SECTION
HEAD
NAIL FIN

D
6 VERTICAL SECTION
HEAD
NAIL FIN

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ± 1.000 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.50"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON	1.25"	2.00"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.50"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085


TITLE: 325 SINGLE HUNG WINDOW (HVHZ) (IMPACT) ANCHOR DETAILS & INSTALLATION NOTES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

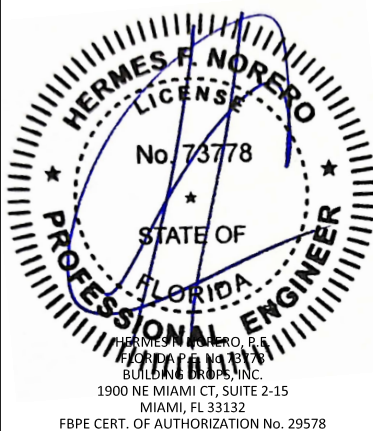

FL #: **FL21457**

DATE: **08.23.17**

DWG. BY: **CL** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **AIR015**


SHEET: **6** REV. **C**

OF 8


c:\users\dylanwata\building drops, inc\building drops landing - common\projects\air master windows & doors\fbc-25-1014 - submittal - f21457 250_325 sh windows - nail fin addition\dwgs\air015 - c.dwg
8/6/2026 12:02 PM

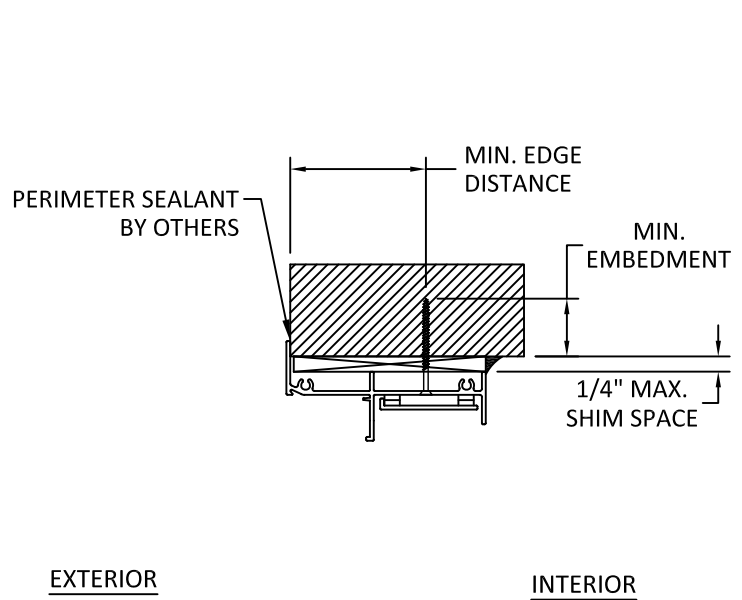


A
7 VERTICAL SECTION
HEAD
THROUGH FRAME

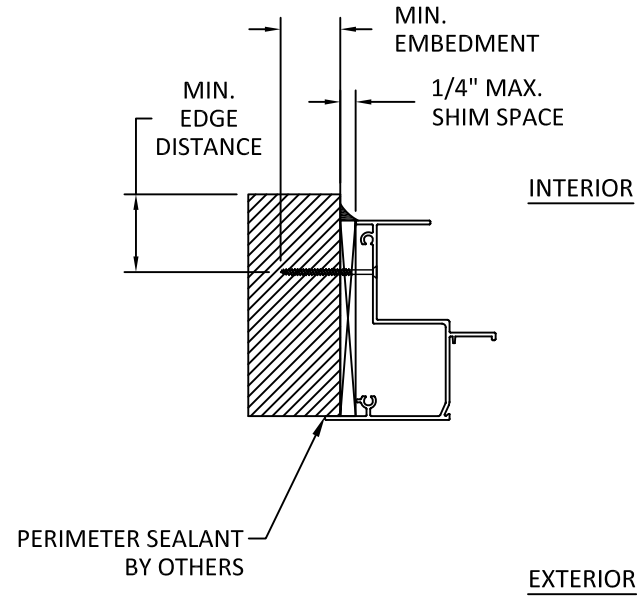

B
7 VERTICAL SECTION
HEAD
THROUGH FRAME

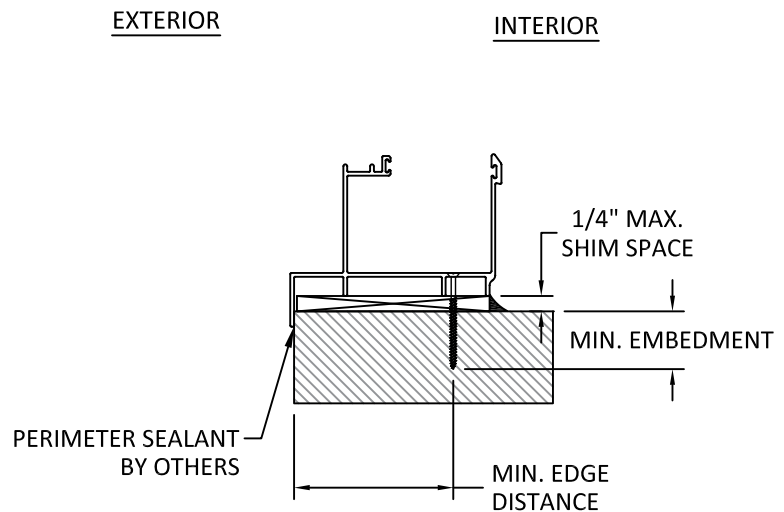

C
7 VERTICAL SECTION
HEAD
THROUGH FRAME

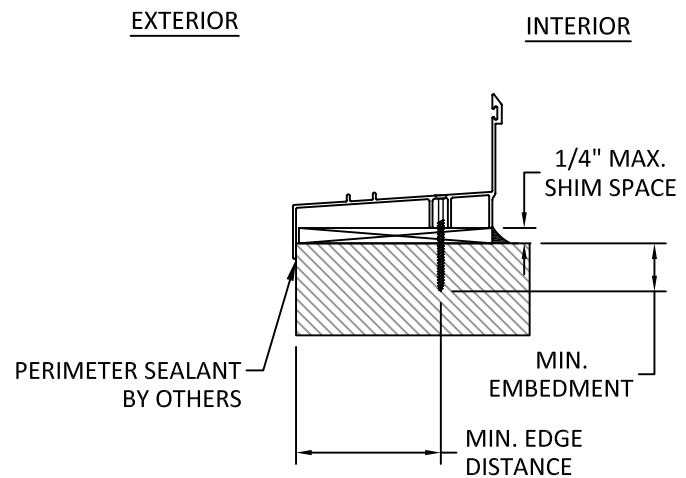

D
7 VERTICAL SECTION
HEAD
THROUGH FRAME



P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085

TITLE:
325 SINGLE HUNG WINDOW
(HVVZ) (IMPACT)


ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)999-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26


THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

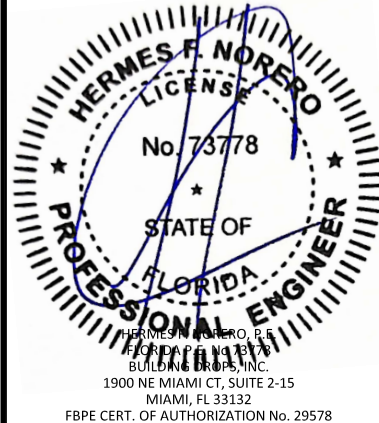


FL #:	FL21457	
DATE:	08.23.17	
DWG. BY:	CL	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	AIR015	
SHEET:	7	REV. C

ITEM #	PART #	DESCRIPTION	NOTES
EXTRUSIONS			
1	22559	FRAME HEAD	6063-T5
2	22560	FRAME JAMB WITH FLANGE	6063-T5
3	22561	FRAME SILL	6063-T5
3A	22552	FRAME SILL	6063-T5
4	22551	FIXED MEETING	6063-T5
5	22554	VENT TOP	6063-T5
6	22555	VENT BOTTOM	6063-T5
6A	22555	VENT BOTTOM	6063-T5
7	22556	VENT JAMB	6063-T5
8	22558	GLASS STOP IG	6063-T5
9	22562	VENT STOP	6063-T5
10	22557	SILL LOCK (OPTIONAL)	6063-T5
10A	22557	SILL LOCK (OPTIONAL)	6063-T5
11	80635	SCREW CAP	6063-T5
12	22088	NAIL FIN SUBFRAME 325	6063-T5
13	22083	NAIL FIN TAB	6063-T5
14	-		-
GLASS			
15		1 1/16" Glass Composed: 3/4" Ann, 1/4" Spacer, 3/8" HS, 0.090"PVB Trosifol, 3/8" HS	
SEALS & SEALANTS			
16	96936	RUBBER SEAL	
17	53580	DC-995 OR SSG4000 GE STRUCTURAL SILICONE	
18	96900	SETTING BLOCK	
19	22438	WEATHERSTRIP	
20	32010	VINYL SEAL	
21	96817	WEATHERSTRIP	
22	96707	TAPE 3M 1/4" X 36 YD VHB 4991B	
FASTENERS			
23	95499	SCR 8*3/4" PHI P/H SS T-A	
24	95543	SCR #10 X 1" T-A SS P/H	
25	XXXXX	SCR 8 x 1 1/2" SMS	
26	95544	SCR 10 x 3/4" PHI F/H SS T-A	
27	95529	SCR 10 X 1 PHI F/H S/S T-A	
28	95708	SCR 8 * 1" F/H SS - SELF DRILL (FOR OPTIONAL SASH LOCK)	
HARDWARE			
29	10751	CAM SASH BUSHING	
30	10699	SASH LOCK	
31	XXXX	SPIRAL BALANCE	
32	XXXX	(OPTIONAL)BLOCK & TACKLE BALANCE	
33	XXXX	WEEP HOLE COVER	


1 FRAME HEAD W/ FLANGE

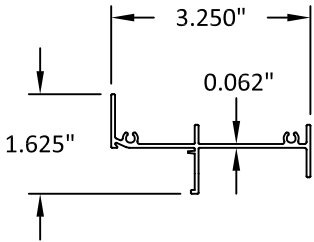


2 FRAME JAMB W/ FLANGE

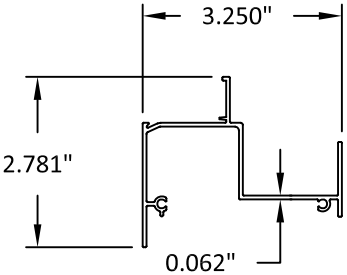


3A FRAME SILL

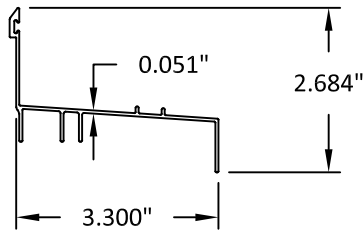


4 FIXED MEETING RAIL

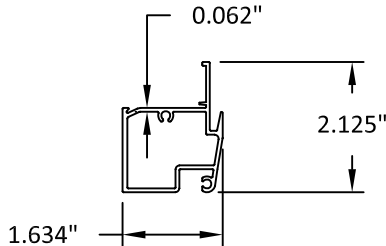


5 VENT TOP

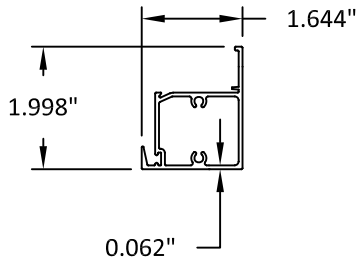


6 VENT BOTTOM

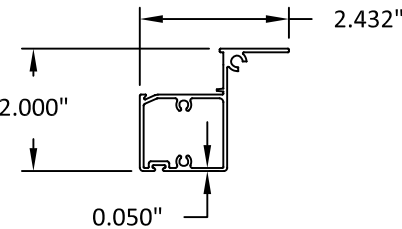


7 VENT JAMB

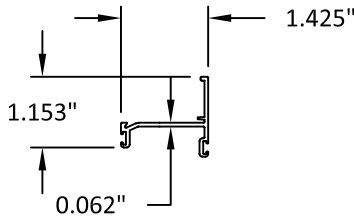


8 GLASS STOP

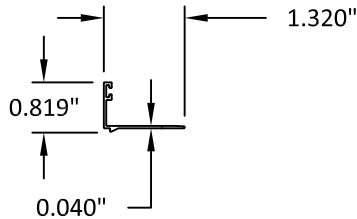


9 VENT STOP

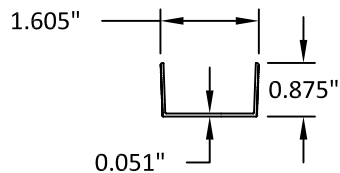


10 SILL LOCK (OPTIONAL)

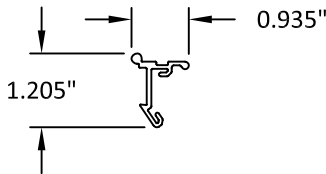


10A SILL LOCK (OPTIONAL)

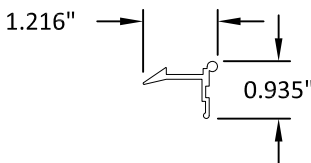


3 FRAME SILL

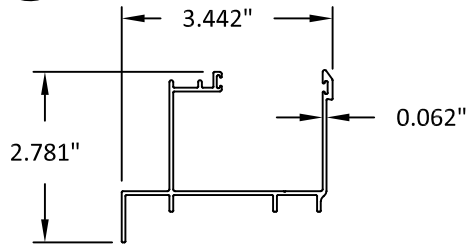


11 SCREW CAP




12 NAIL FIN SUBFRAME 325



13 NAIL FIN

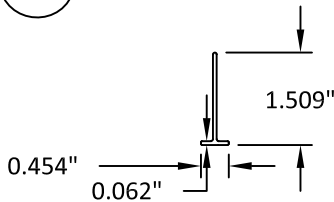

6A VENT BOTTOM

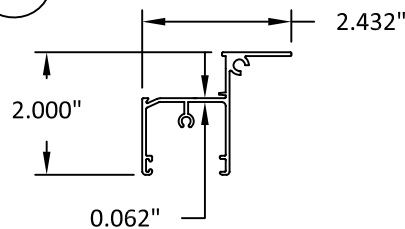

P.O. BOX 2097
BARCELONETA, PR 00617
WWW.AIRMASTERPR.COM

PH: (603) 627-3861 FAX: (787)623-0085

TITLE:
325 SINGLE HUNG WINDOW
(HVHZ) (IMPACT)
BILL OF MATERIALS
& COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC CC	CL	8.23.17
NEW SILL	LS	6.01.26
NAIL FIN ADDITON	DI	8.04.26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL21457
DATE:	08.23.17
DWG. BY:	CL
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AIR015
SHEET:	8
REV.	C
OF 8	