




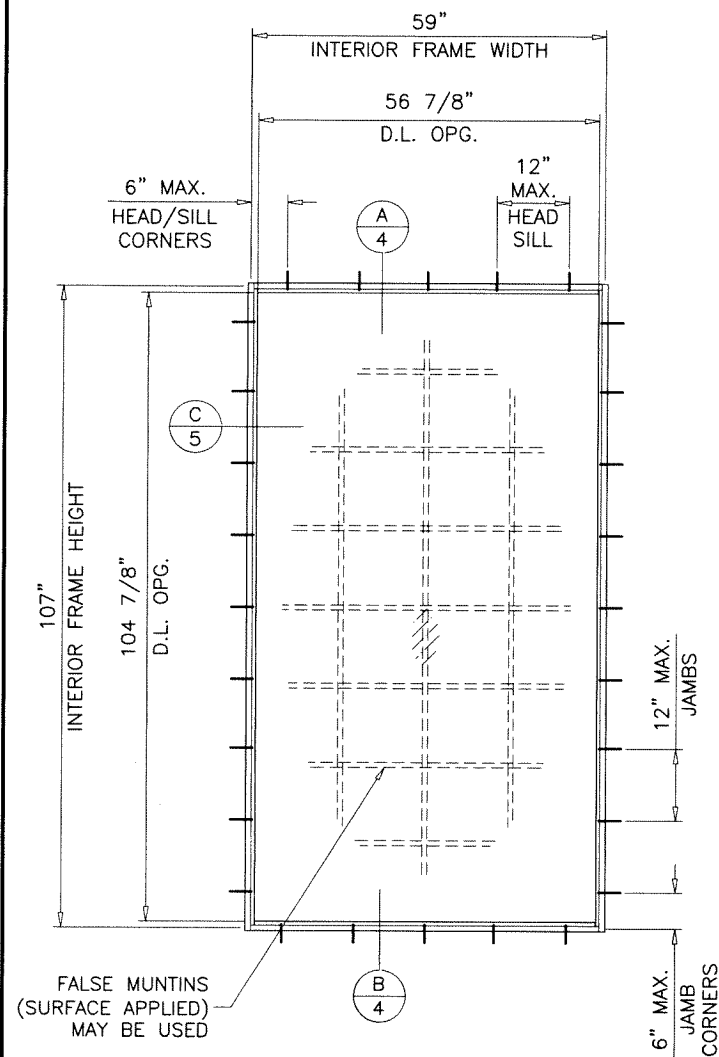


TYPICAL ELEVATION
FLANGE FRAMES

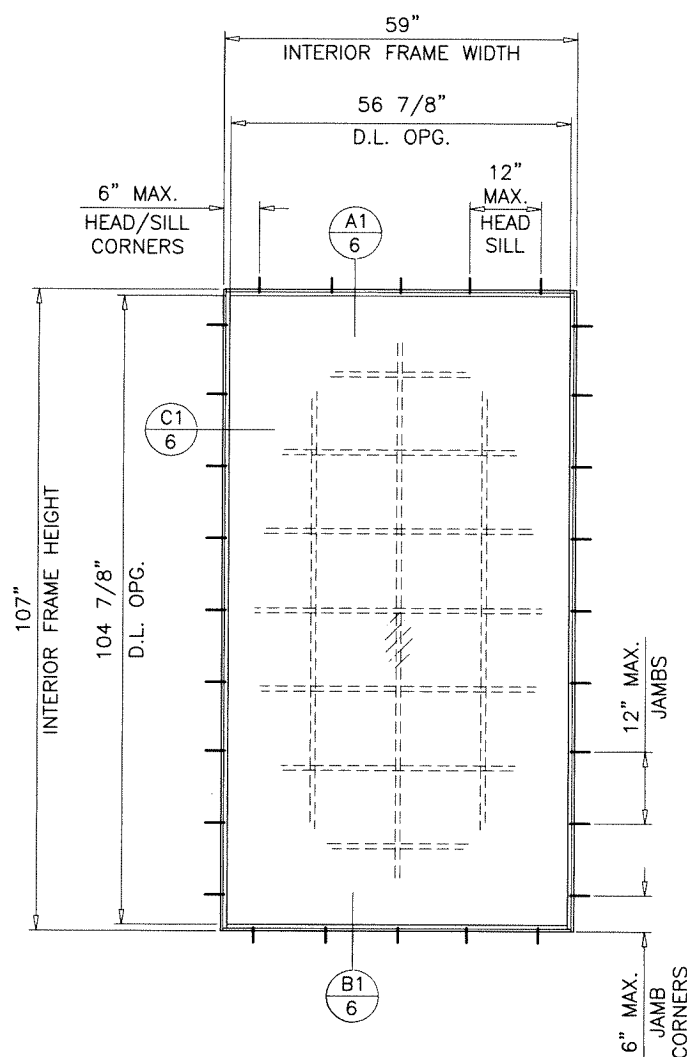

TYPICAL ELEVATION
FLUSH FRAMES

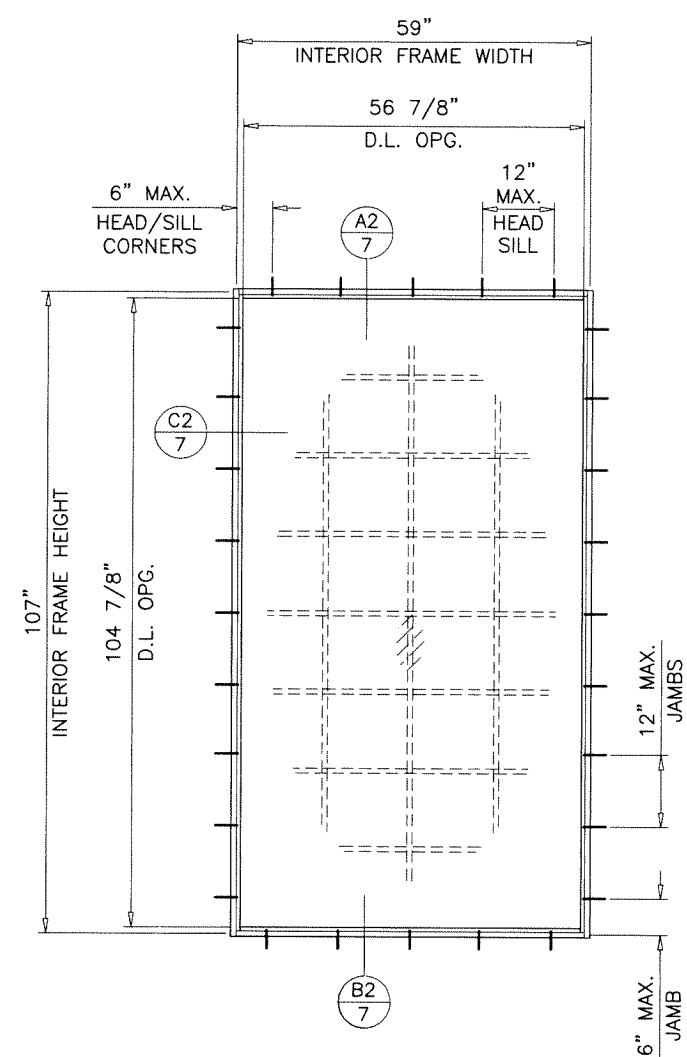

TYPICAL ELEVATION
FLANGE FRAMES WITH FLUSH ADAPTER

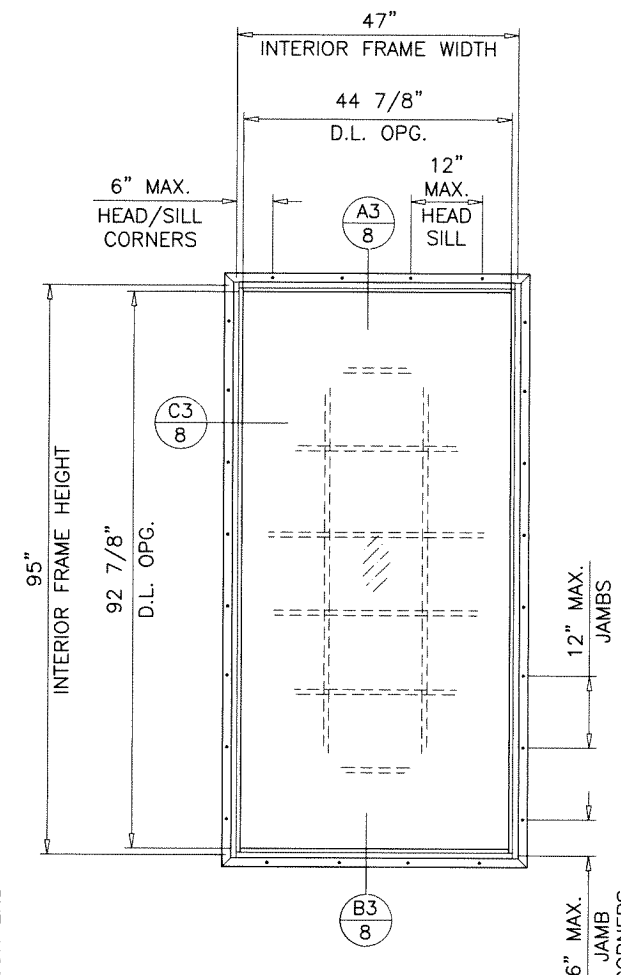

TYPICAL ELEVATION
FLANGE FRAMES WITH FIN ADAPTER
WINDOWS WITH FIN FRAME ADAPTERS LIMITED TO DESIGN LOAD ± 80.0 PSF MAX.

ES-EL150HP FIXED ALUMINUM WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 3.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIX./FIX. OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING F.B.C. APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

DAYLITE OPENINGS:
D.L.O. HEIGHT = WINDOW HEIGHT - 3.125"
D.L.O. WIDTH = WINDOW WIDTH - 3.125"


WINDOWS COMPLY WITH REQUIREMENTS OF ANSI Z97.1.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Sealed: 10/23/2023

FL #21461

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

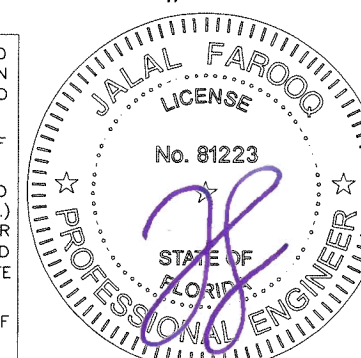




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no date by description	
date:	10-10-23	no	date
scale:	3/8"=1'-0"	by	description
dr.	by: TARIQ		
chk.	by:		
drawing no.		23-53F	
sheet		1 of 10	

COMP-ANL\23-53F-ES

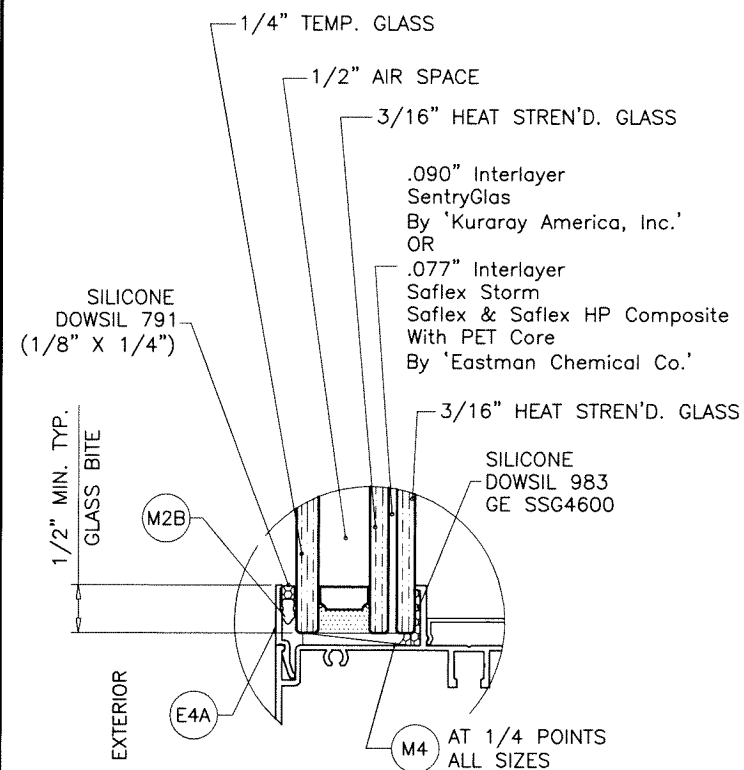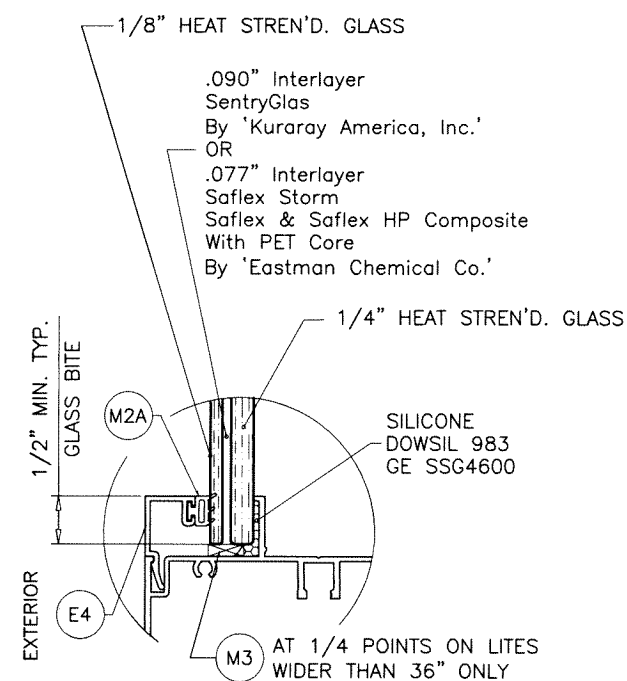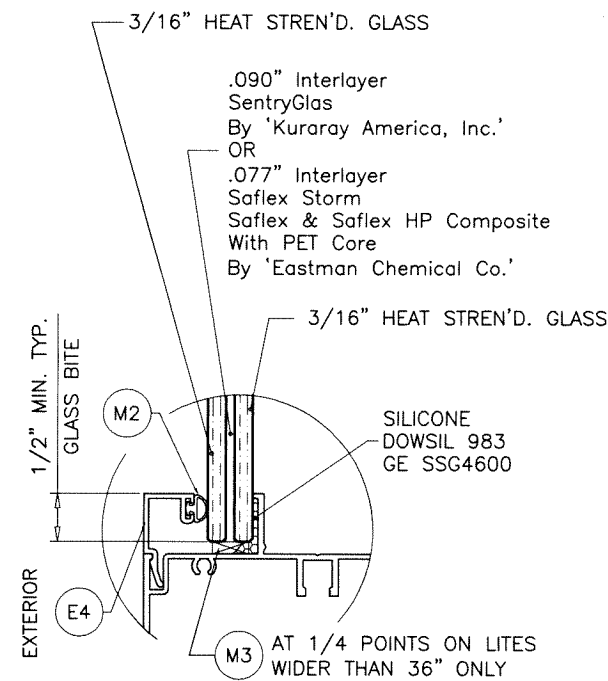

1/2" AIR SPACE CONSISTING OF:
SPACER:
 'HELIMA' LOW PROFILE ALUMINUM SPACER
 BY 'LINGERMANN GMBH'
 AROUND THE PERIMETER OF THE GLASS.
PERIMETER SEALANT:
 SILICONE
 DOW CORNING 791
 GE 2000

Sealed: 10/23/2023

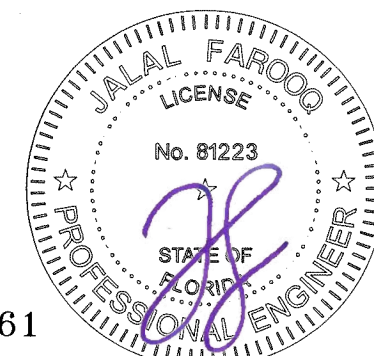


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
(C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


date:	10-10-23				
scale:	$1/2'' = 1''$				
dr. by:	TARIQ				
chk. by:					
drawing no.		23-53F			
sheet		2 of 10			

DESIGN LOAD CAPACITY - PSF			
INTERIOR FRAME DIMS.		GLASS TYPES 'A', 'B', 'Ai'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)
29"	53"	100.0	140.0
35"		100.0	133.3
41"		100.0	114.3
47"		100.0	100.0
53"		88.9	88.9
59"		80.0	80.0
29"	59"	100.0	140.0
35"		100.0	133.3
41"		100.0	114.3
47"		100.0	100.0
53"		80.0	80.0
59"		80.0	80.0
29"	65"	100.0	140.0
35"		100.0	132.4
41"		100.0	114.3
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	71"	100.0	140.0
35"		100.0	128.4
41"		100.0	114.3
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	77"	100.0	140.0
35"		100.0	125.2
41"		80.0	80.0
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	83"	100.0	140.0
35"		100.0	122.6
41"		80.0	80.0
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	89"	100.0	138.7
35"		80.0	80.0
41"		80.0	80.0
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	95"	100.0	137.0
35"		80.0	80.0
41"		80.0	80.0
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	107"	80.0	80.0
35"		80.0	80.0
41"		80.0	80.0
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0


DESIGN LOAD CAPACITY - PSF			
INTERIOR FRAME DIMS.		GLASS TYPES 'A', 'B', 'Ai'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)
29"	119"	80.0	80.0
35"		80.0	80.0
41"		80.0	80.0
47"		80.0	80.0
53"		80.0	80.0
59"		80.0	80.0
29"	131"	80.0	80.0
35"		80.0	80.0
41"		80.0	80.0
47"		80.0	80.0
29"	143"	80.0	80.0
35"		80.0	80.0
41"		80.0	80.0

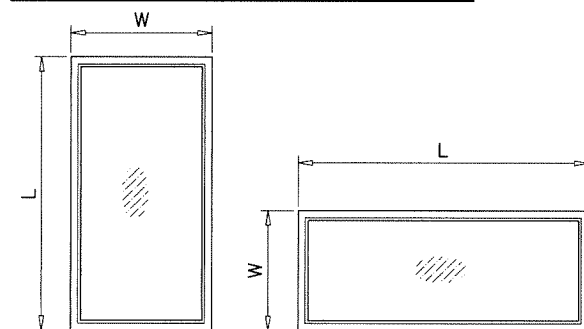

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

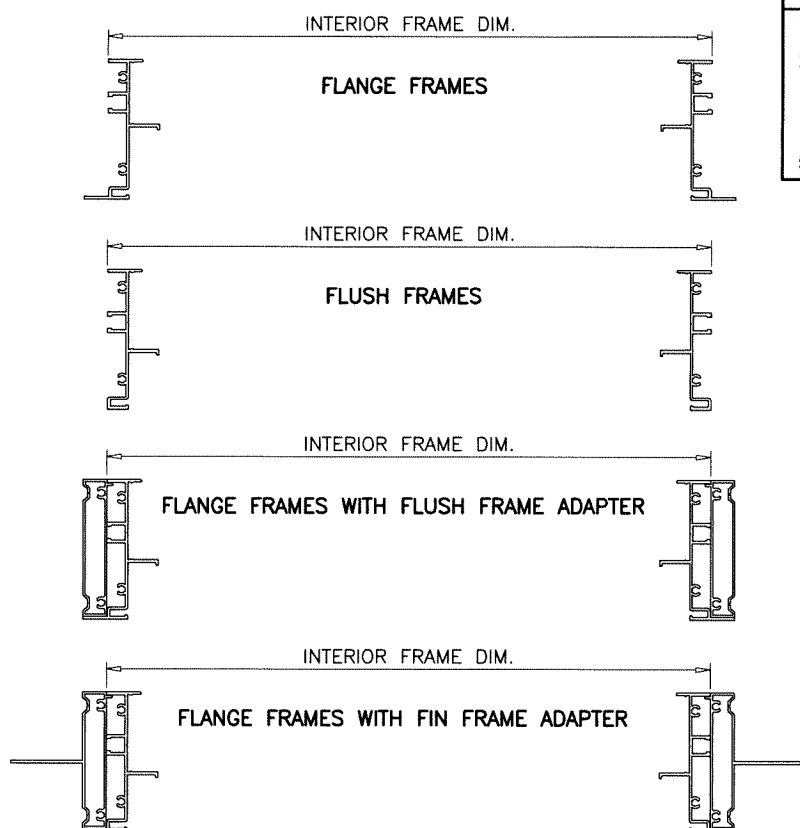

DESIGN LOAD CAPACITY - PSF			
INTERIOR FRAME DIMS.		GLASS TYPES 'A', 'B', 'Ai'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)
18-1/8"	25"	100.0	140.0
25-1/2"		100.0	140.0
36"		100.0	140.0
47"		100.0	140.0
52-1/8"		100.0	140.0
59"		100.0	140.0
18-1/8"	37-3/8"	100.0	140.0
25-1/2"		100.0	140.0
36"		100.0	129.7
47"		100.0	125.1
52-1/8"	49-5/8"	100.0	125.1
59"		100.0	125.1
18-1/8"	55"	100.0	140.0
25-1/2"		100.0	140.0
36"		100.0	129.7
47"		100.0	100.0
52-1/8"	57"	94.8	94.8
59"		94.8	94.8
18-1/8"	62"	100.0	140.0
25-1/2"		100.0	140.0
36"		100.0	129.7
47"		100.0	100.0
52-1/8"	75"	80.0	80.0
59"		80.0	80.0
18-1/8"	75"	100.0	140.0
25-1/2"		100.0	140.0
36"		100.0	123.8
47"		80.0	80.0
52-1/8"	75"	80.0	80.0
59"		80.0	80.0

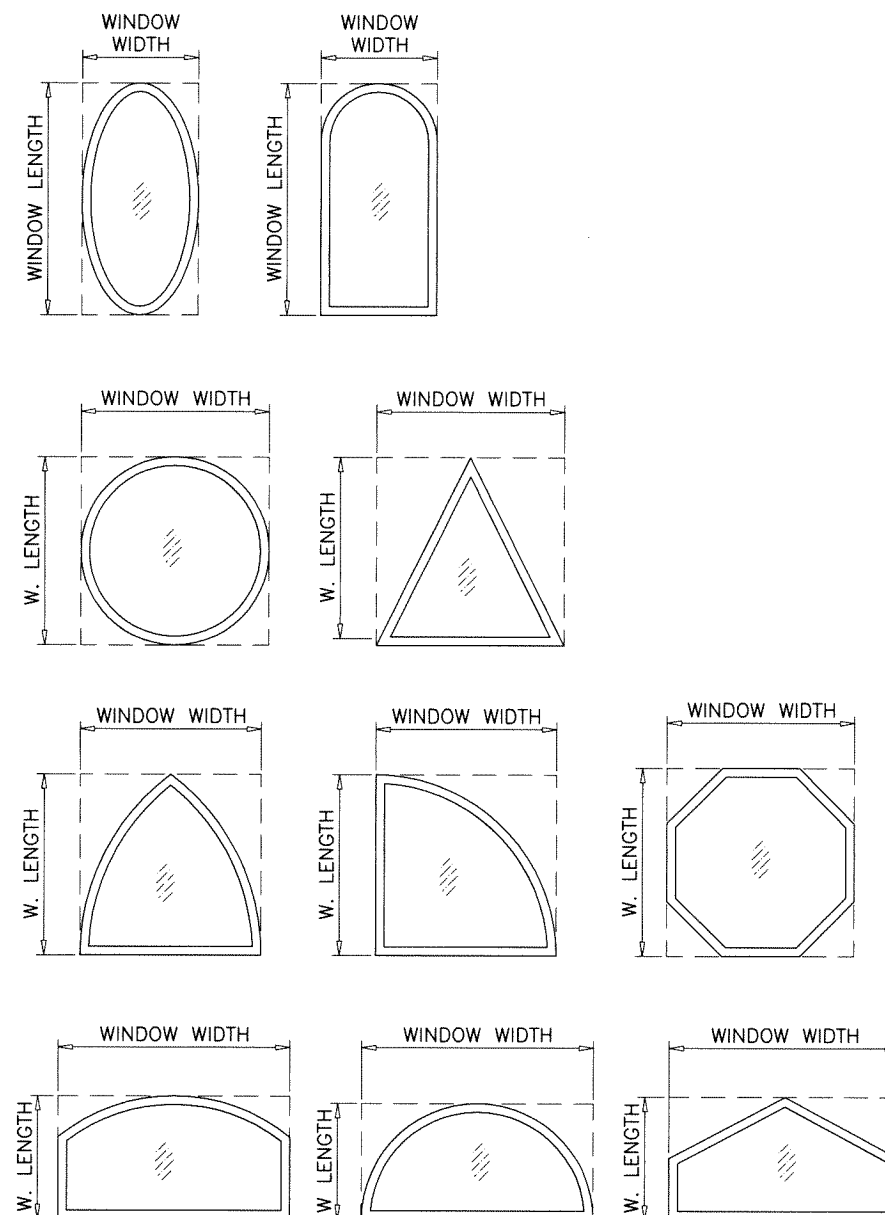


ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

LIMIT MAX. DESIGN LOADS FOR ALTERNATE SHAPES AS FOLLOWS
+80.0, -100.0 PSF FOR WDW. AREA UPTO 32.0 SQ. FT.
+80.0, -80.0 PSF FOR WDW. AREA ABOVE 32.0 SQ. FT.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

Sealed: 10/23/2023

FL #21461

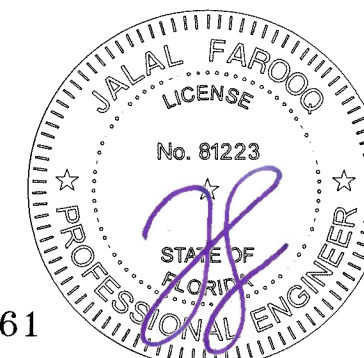

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description

date: 10-10-23

scale: 1/2" = 1"





dr. by: TARIQ

chk. by:

drawing no. 23-53F

sheet 3 of 10

COMP-ANL\23-53F-ES

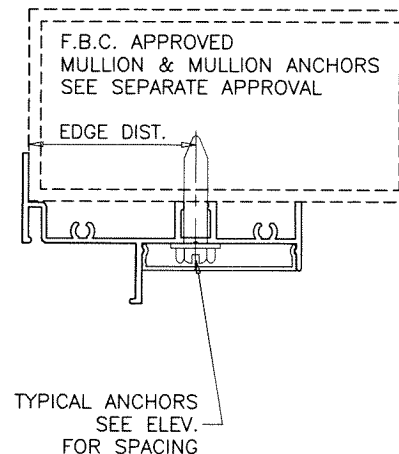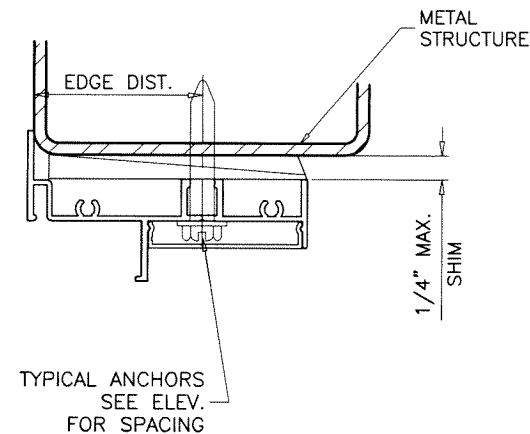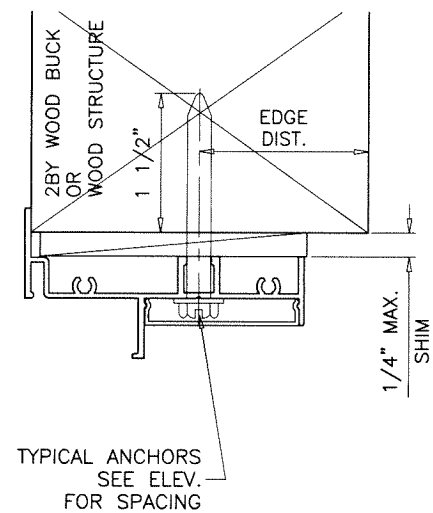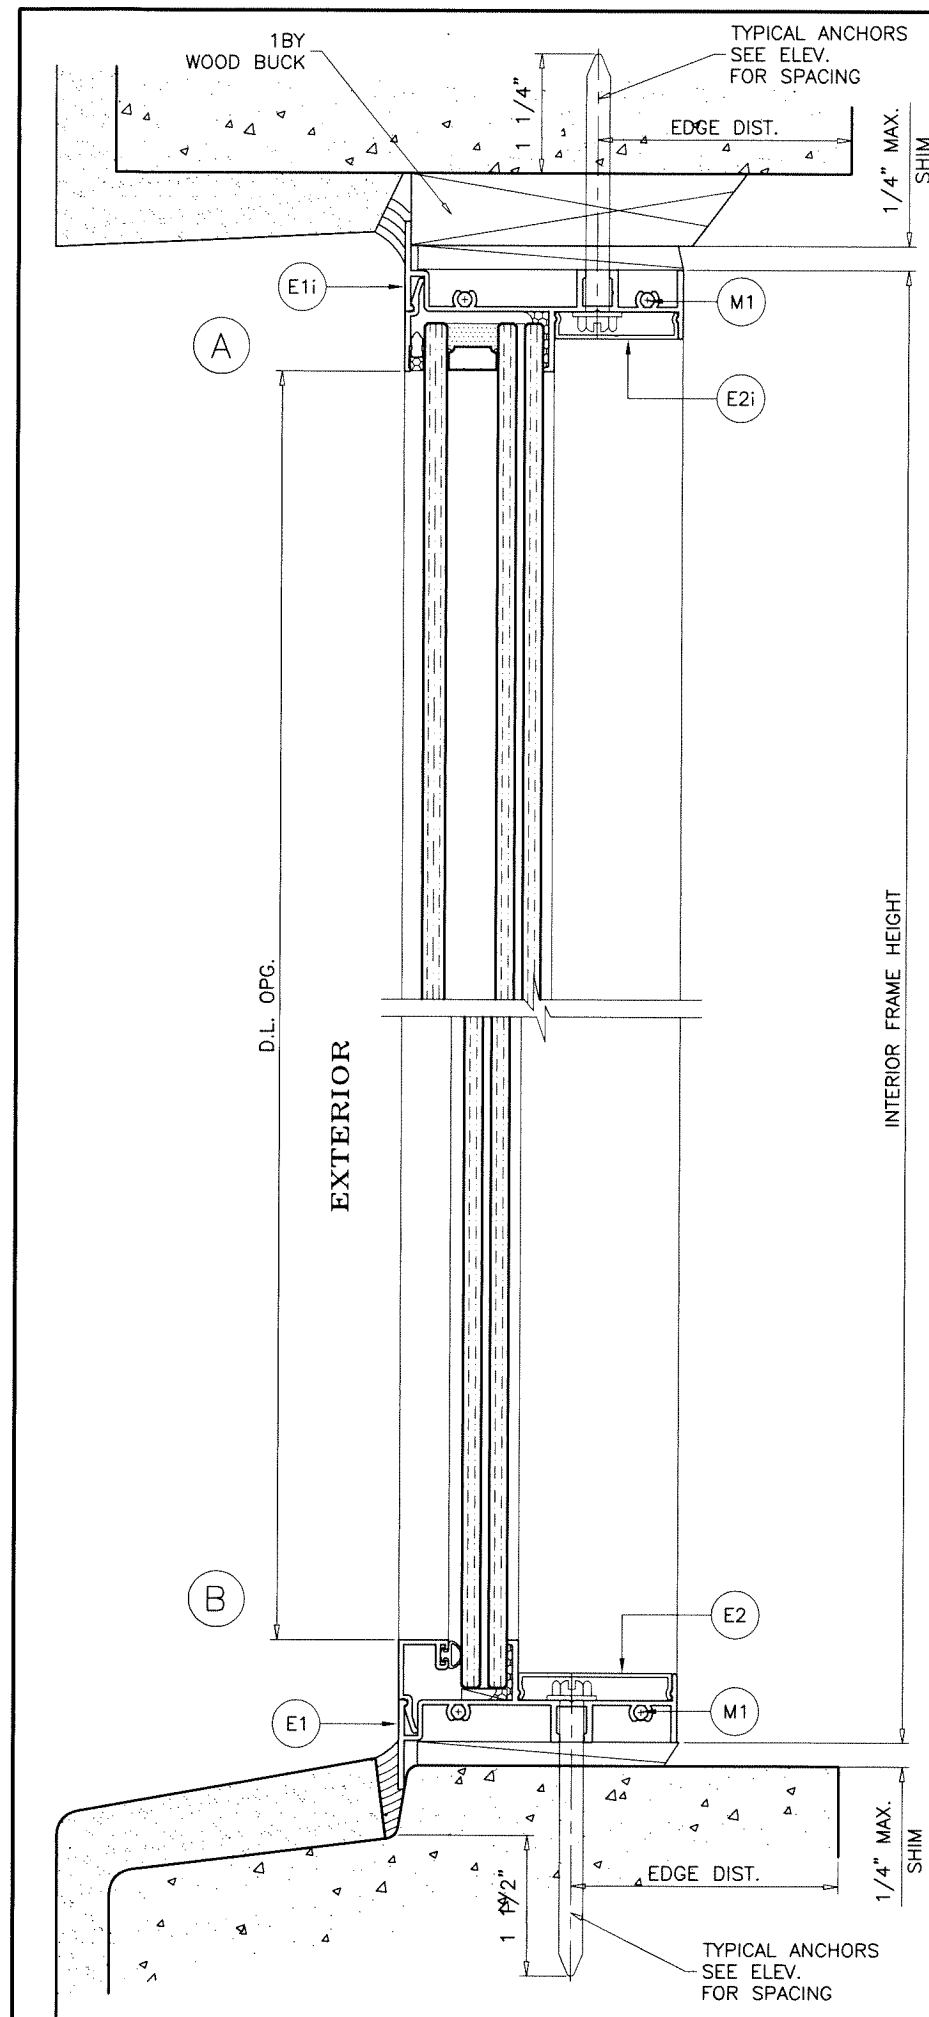

WOOD BUCKS AND METAL STRUCTURE NOT BY 'E.S. WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4\" DIA. TAPCON BY 'ITW' (Fu=125 KSI, Fy=100 KSI)

1/4\" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES

1-1/2\" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY BUCKS INTO CONC. OR MASONRY

1-1/4\" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-1/4\" MIN. EMBED INTO MASONRY (JAMBS)

DIRECTLY INTO CONCRETE OR MASONRY

1-1/2\" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-1/4\" MIN. EMBED INTO MASONRY (JAMBS)

1/4\" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)

INTO F.B.C. APPROVED MULLIONS

OR

INTO METAL STRUCTURES (HEAD/SILL/JAMBS)

(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS

ALUMINUM: 1/8\" THK. MIN. (6063-T5 MIN.)

STEEL: 1/8\" THK. MIN. (Fy = 36 KSI MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2\" MIN.


INTO WOOD STRUCTURE = 1\" MIN.

INTO METAL STRUCTURE = 3/4\" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.


C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

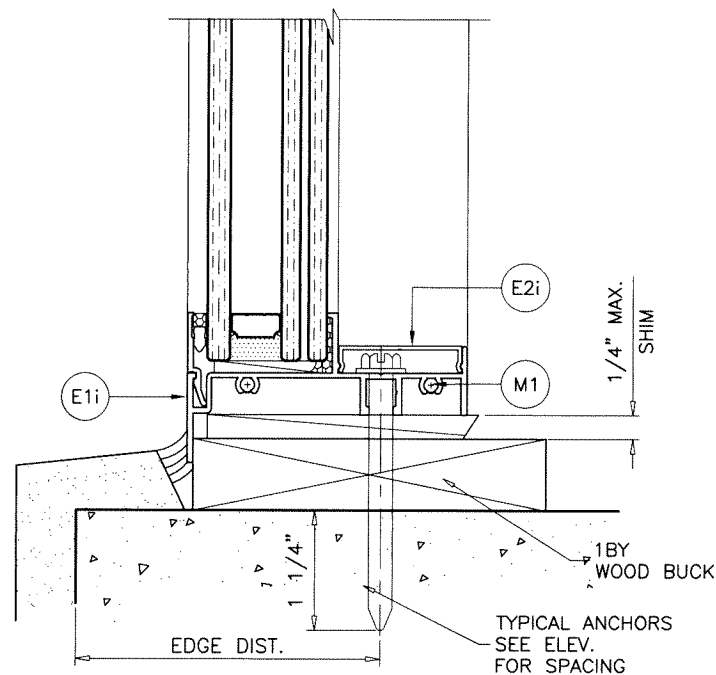

Sealed: 10/23/2023

FLANGE FRAMES

FL #21461

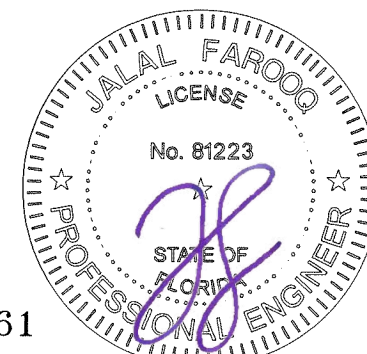

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)





E.S. WINDOWS, LLC

3550 N.W. 49 STREET

MIAMI, FL. 33142

TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no date by description	
date:	10-10-23	scale:	1/2" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.	23-53F	sheet	4 of 10

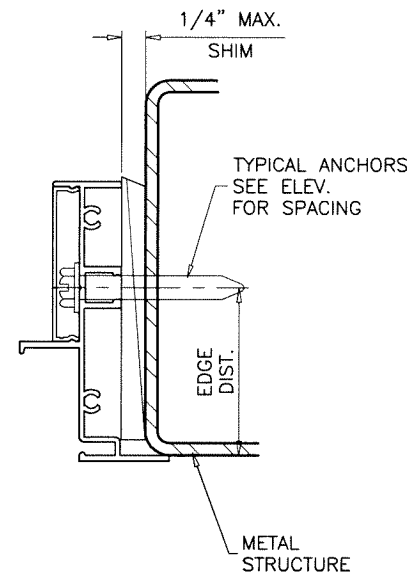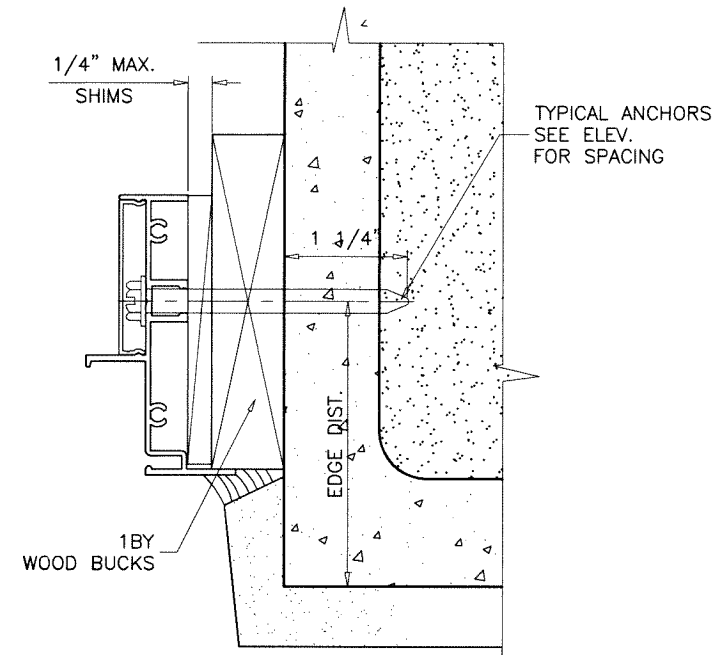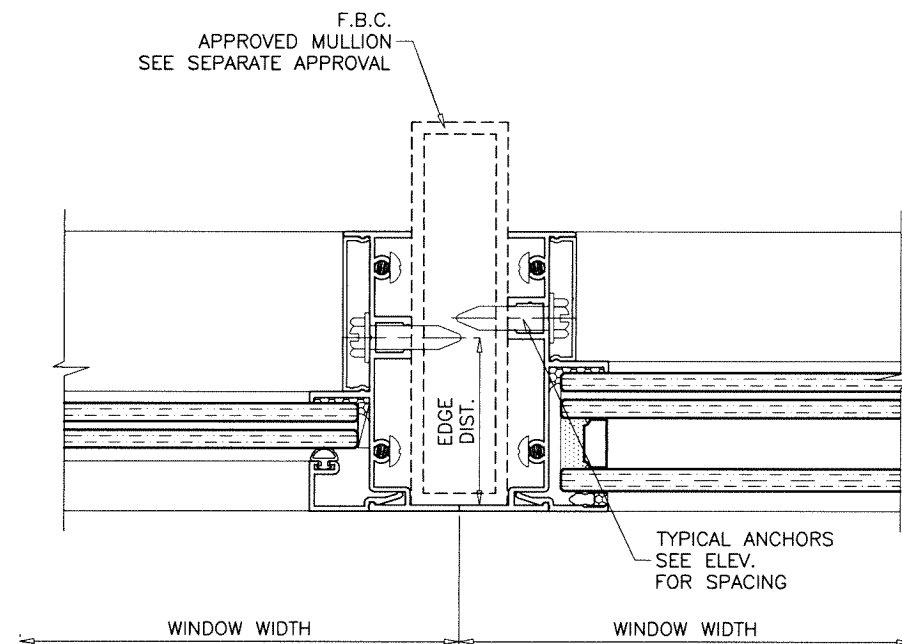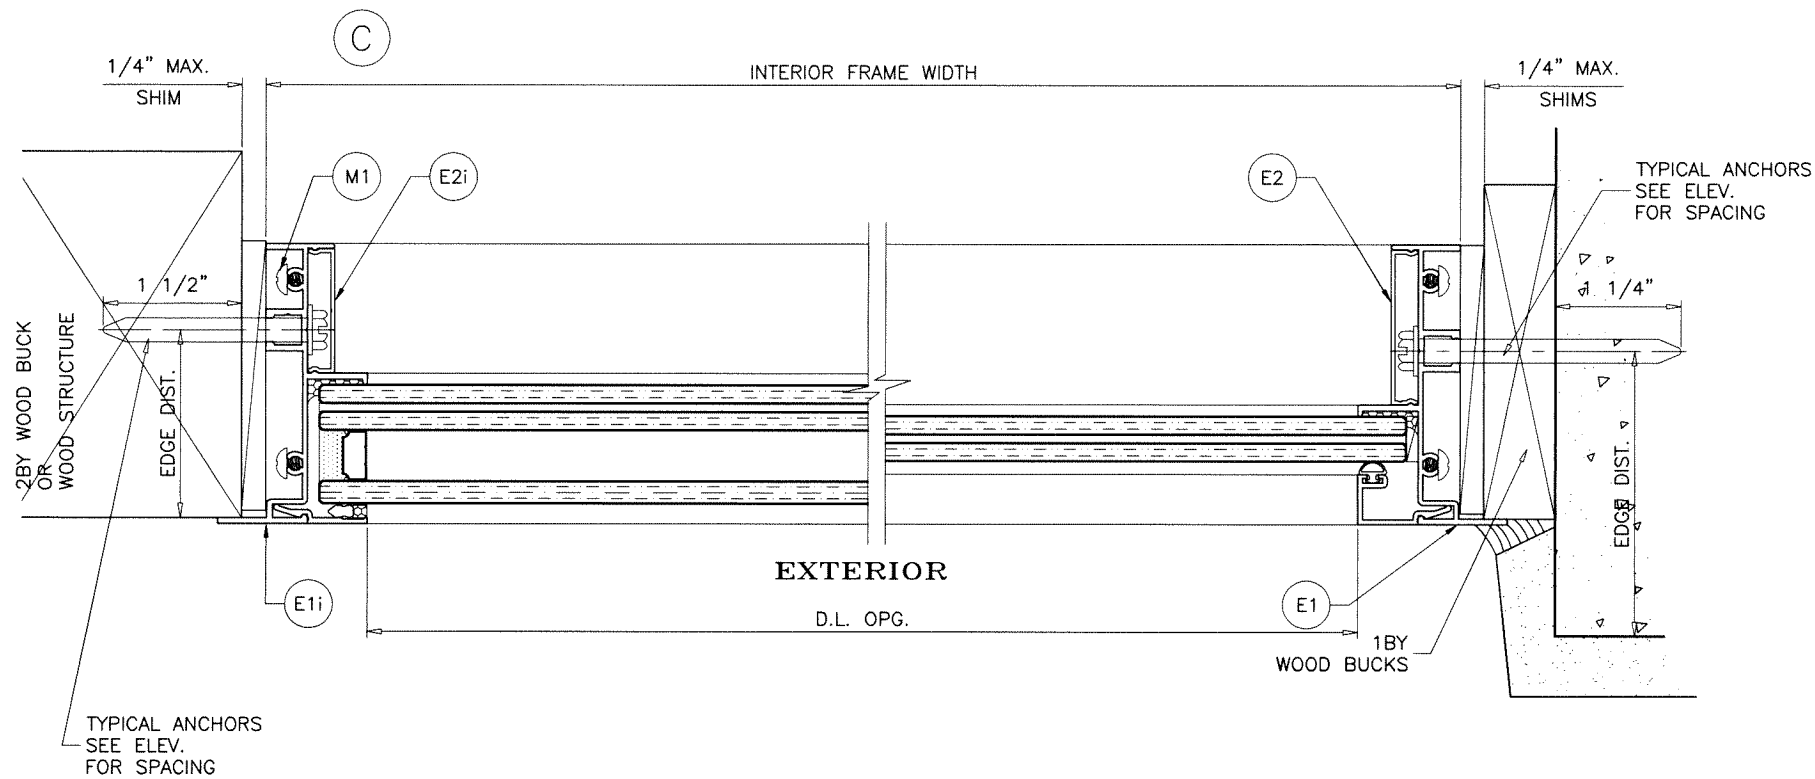

Sealed: 10/23/2023

FLANGE FRAMES

FL #21461

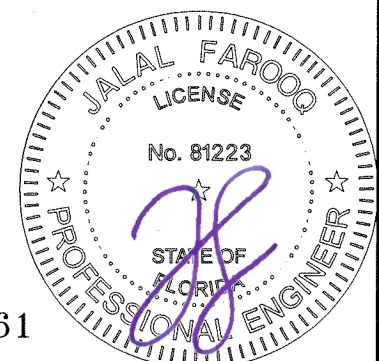

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL\23-53F-ES

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no		date		by		description	

date: 10-10-23

scale: 1/2" = 1"

dr. by: TARIQ

chk. by:


drawing no.
23-53F

sheet 5 of 10

Technical drawings of window frame cross-sections A1 and B1.

Section A1: Shows a cross-section of a window frame. The exterior side is on the left, and the interior side is on the right. The frame is labeled "A1". The exterior side is labeled "EXTERIOR". The interior side is labeled "INTERIOR FRAME HEIGHT". The frame is shown with "TYPICAL ANCHORS SEE ELEV. FOR SPACING". The frame is labeled "E1A" and "E1Ai". The frame is shown with "SHIMS" and "1/4\" MAX.".


Section B1: Shows a cross-section of a window frame. The exterior side is on the left, and the interior side is on the right. The frame is labeled "B1". The exterior side is labeled "EXTERIOR". The interior side is labeled "INTERIOR FRAME HEIGHT". The frame is shown with "TYPICAL ANCHORS SEE ELEV. FOR SPACING". The frame is labeled "E1A" and "E1Ai". The frame is shown with "SHIMS" and "1/4\" MAX.".

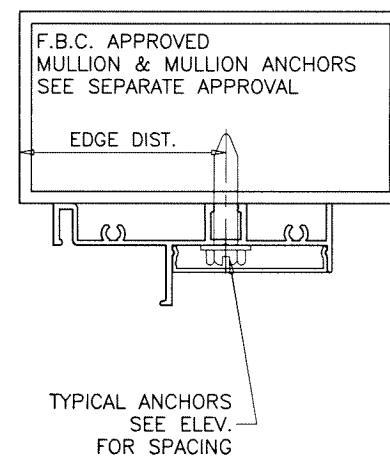

SEE SHEETS 4 & 5 FOR WINDOW DETAILS

Sealed: 10/23/2023

FL #21461

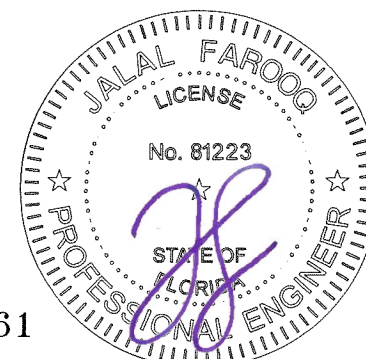


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


[illegible]

EXTERIOR

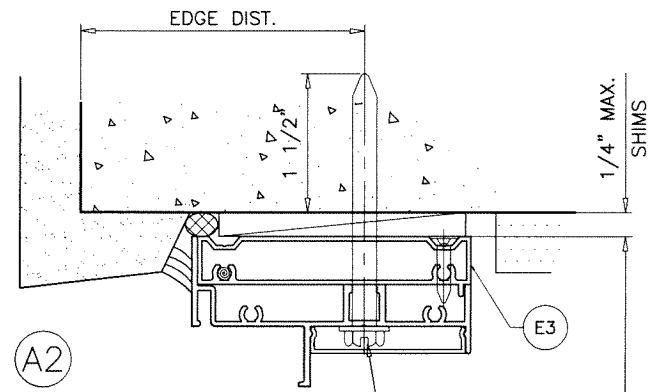


TYPICAL ANCHORS
SEE ELEV.
FOR SPACING


INTERIOR FRAME HEIGHT

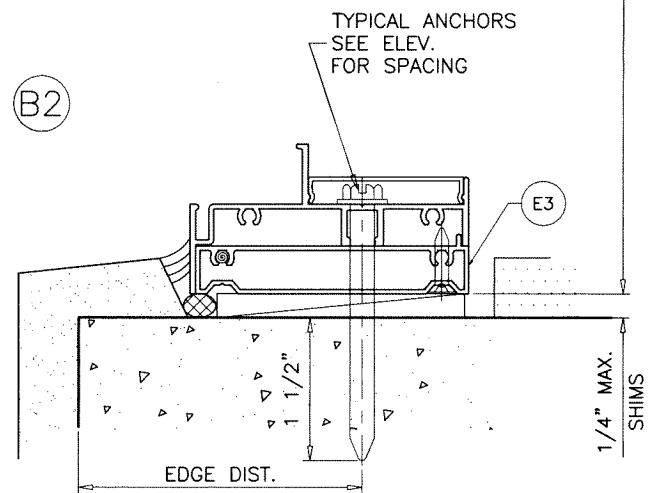


TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

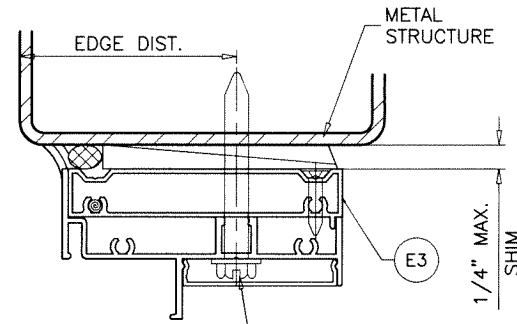

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

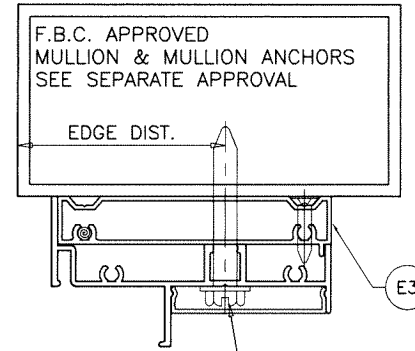

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

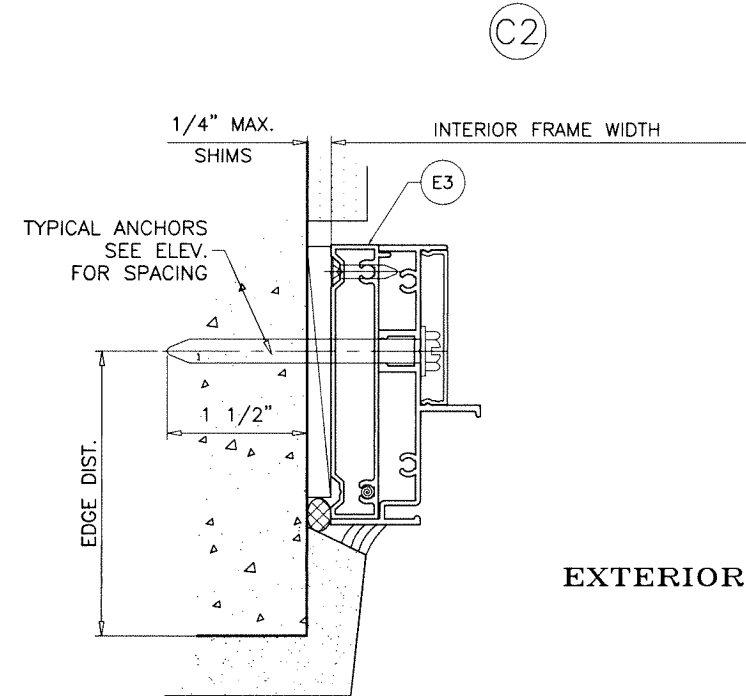


EXTERIOR

FLANGE FRAMES WITH FLUSH FRAME ADAPTERS
SEE SHEETS 4 & 5 FOR WINDOW DETAILS

Sealed: 10/23/2023

FL #21461

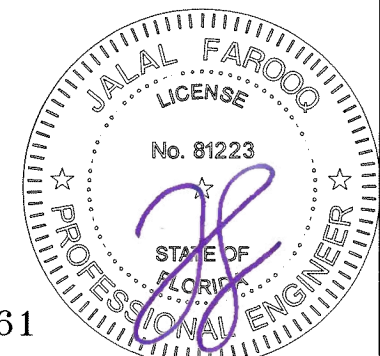


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\23-53F-ES

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no.		date		by		description	
10-10-23									
scale: 1/2" = 1"									
dr. by: TARIQ									
chk. by:									
drawing no.									
23-53F									
sheet 7 of 10									

EXTERIOR


A3

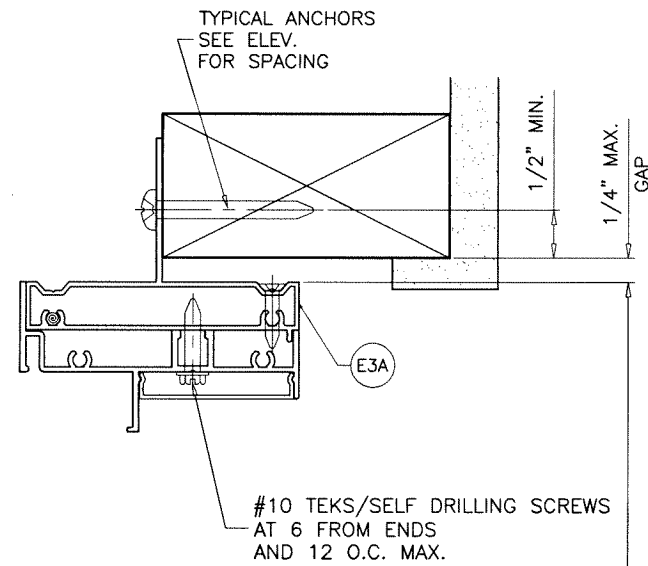

B3

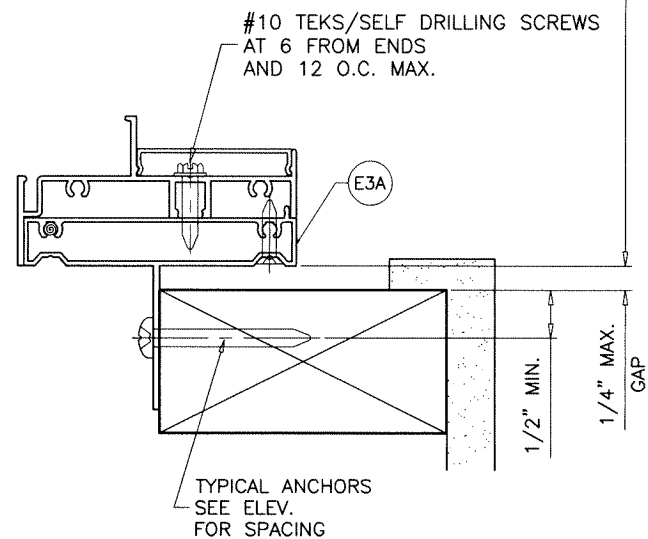

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
#10 WOOD SCREWS (GRADE 2 CRS)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD

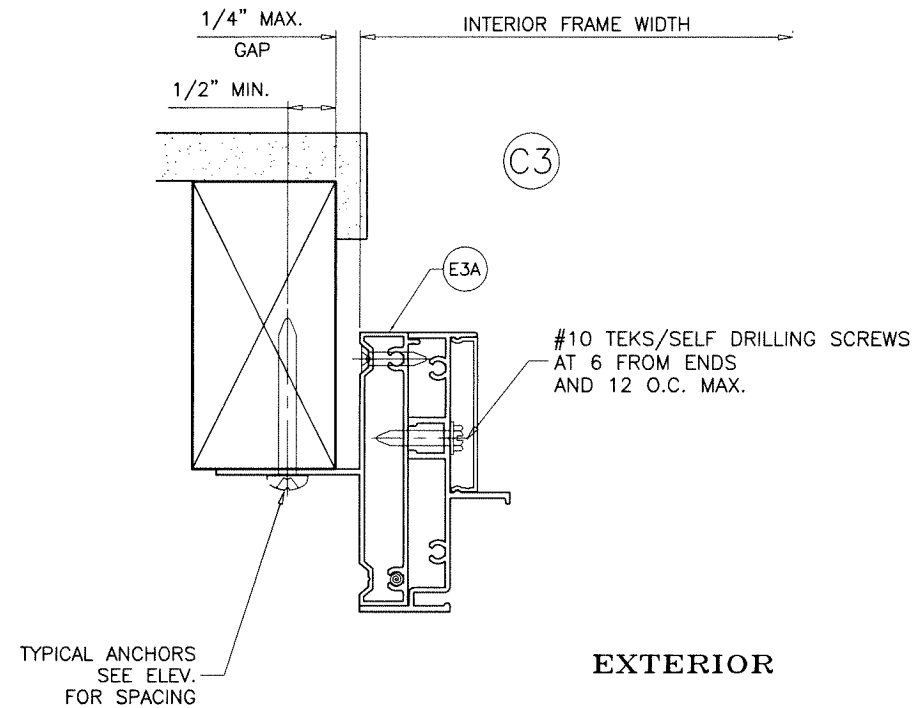


EXTERIOR

FLANGE FRAMES WITH FIN FRAME ADAPTERS
SEE SHEETS 4 & 5 FOR WINDOW DETAILS

Sealed: 10/23/2023


FL #21461

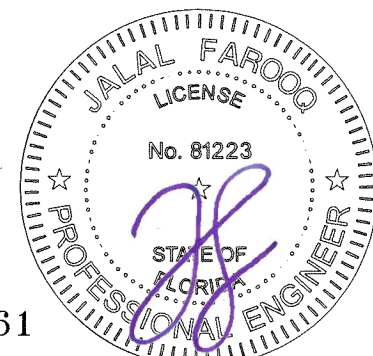

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\23-53F-ES

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no date by description	
date:	10-10-23	scale:	1/2" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.		23-53F	
sheet		8 of 10	

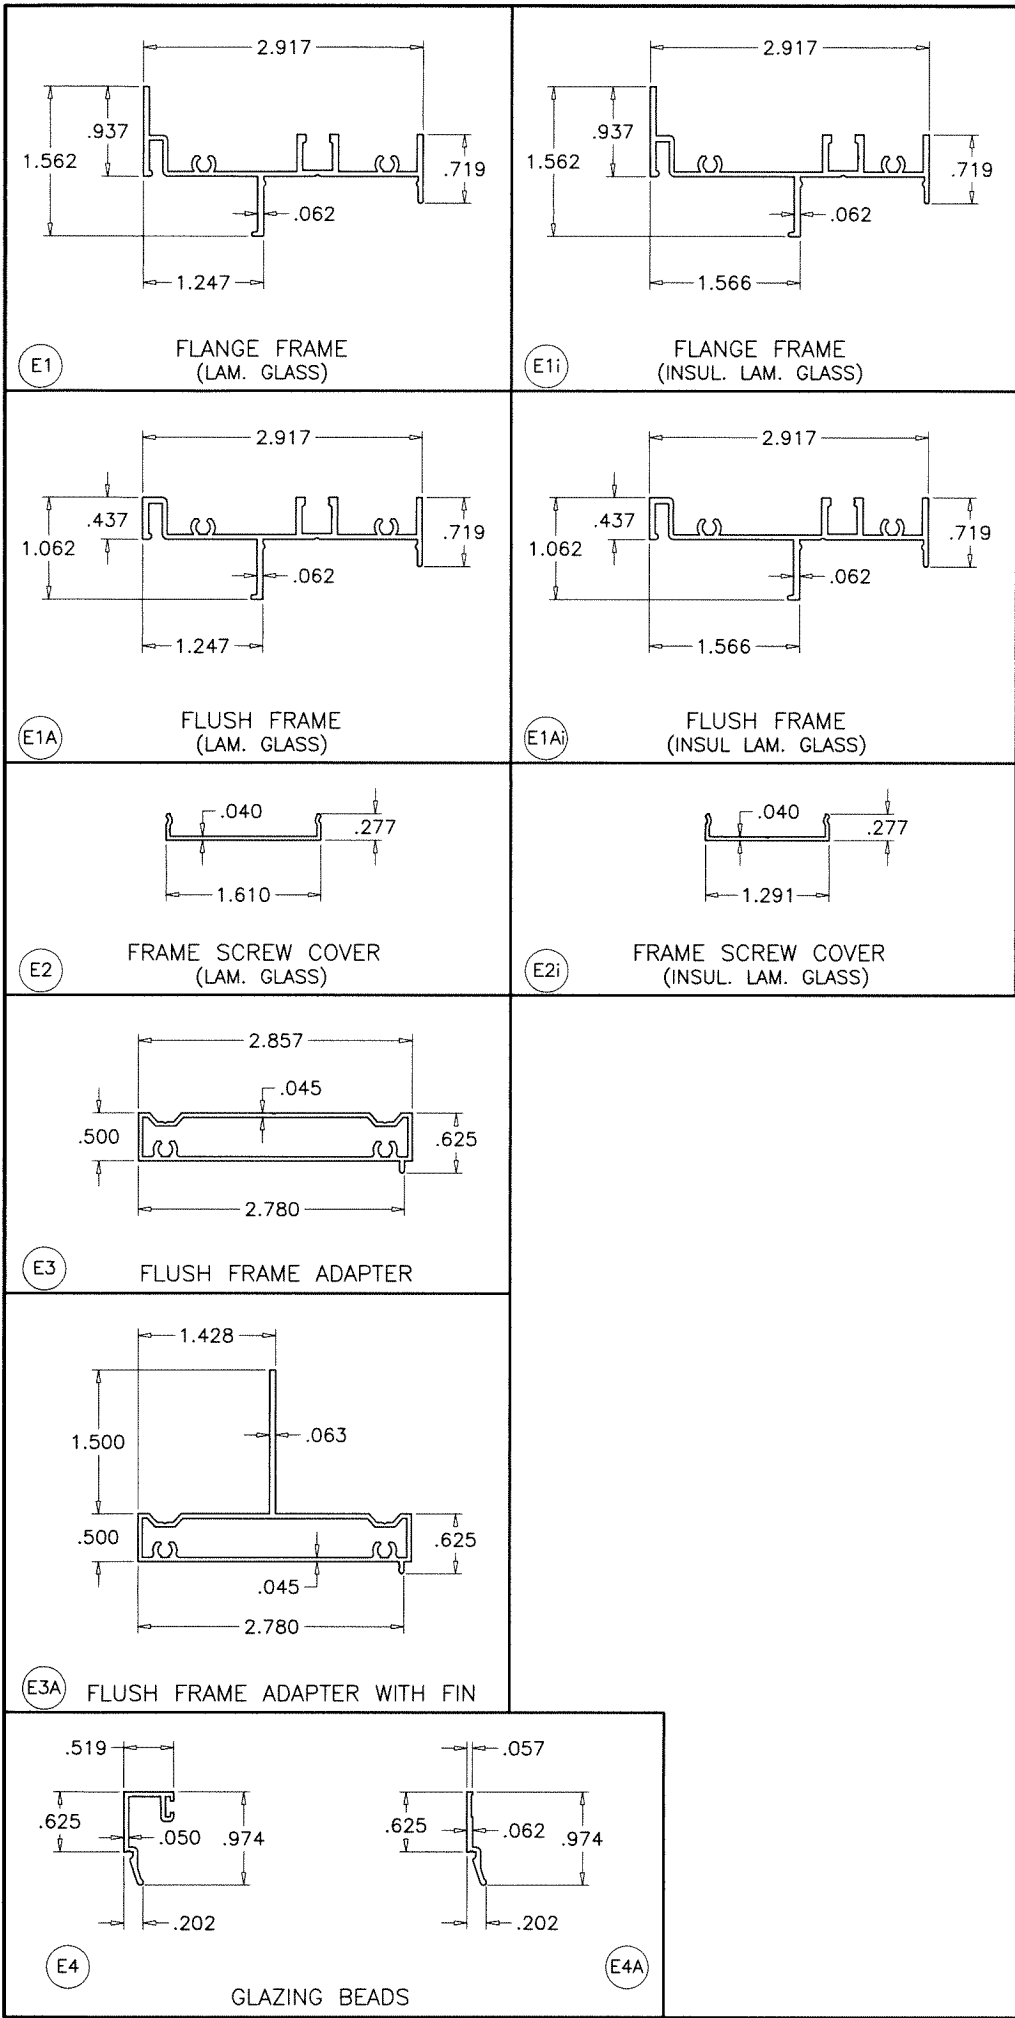

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	ES-EL155	4	FLANGE FRAME (LAM. GLASS)	6063-T6	-
E1i	ES-EL157	4	FLANGE FRAME (INSUL. LAM. GLASS)	6063-T6	-
E1A	ES-EL150-402	4	FLUSH FRAME (LAM. GLASS)	6063-T6	-
E1Ai	-	4	FLUSH FRAME (INSUL. LAM. GLASS)	6063-T6	-
E2	ES-EL156	AS REQD.	FRAME SCREW COVER (LAM. GLASS)	6063-T6	-
E2i	ES-EL158	AS REQD.	FRAME SCREW COVER (INSUL. LAM. GLASS)	6063-T6	-
E3	ES-EL112	AS REQD.	FLUSH FRAME ADAPTER	6063-T6	-
E3A	ES-EL115	AS REQD.	FLUSH FRAME ADAPTER WITH FIN	6063-T6	-
E4	ES-EL110	AS RQD.	GLAZING BEAD (7/16" LAM. GLASS)	6063-T6	-
E4A	ES-EL116	AS RQD.	GLAZING BEAD (INSUL. LAM. GLASS)	6063-T6	-
M1	#8 X 1"	-	FRAME ASSEMBLY FASTENERS	ST. STEEL	PH SMS
M2	ES-7530-G10B	AS REQD.	EXTERIOR BULB GASKET	SILICONE	DUROMETER 60±5 SHORE A
M2A	ES-EL150-G01A S	AS REQD.	EXTERIOR LEAF GASKET	SILICONE	DUROMETER 60±5 SHORE A
M2B	ES-H-340-G05 S	AS REQD.	EXTERIOR WEDGE GASKET	SILICONE	DUROMETER 65±5 SHORE A
M3	80-372A	2/ LITE	SETTING BLOCK AT 1/4 POINTS (LAM. GLASS)	SILICONE	DUROMETER 80±5 SHORE A
M4	ES-U7530-B01A S	2/ LITE	SETTING BLOCK AT 1/4 POINTS (INSUL. LAM. GLASS)	SILICONE	DUROMETER 80±5 SHORE A
M5	#8 X 1"	-	FLUSH/FIN FRAME ADAPTER ASSEMBLY FASTENERS	ST. STEEL	FH SMS

Sealed: 10/23/2023

FL #21461

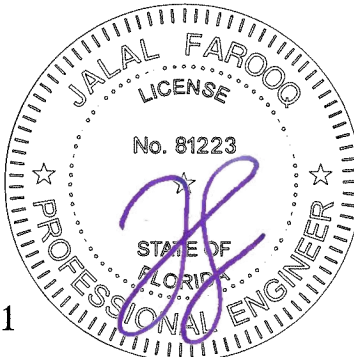

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\23-53F-ES


ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:
no date by description

date: 10-10-23
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no.
23-53F
sheet 9 of 10

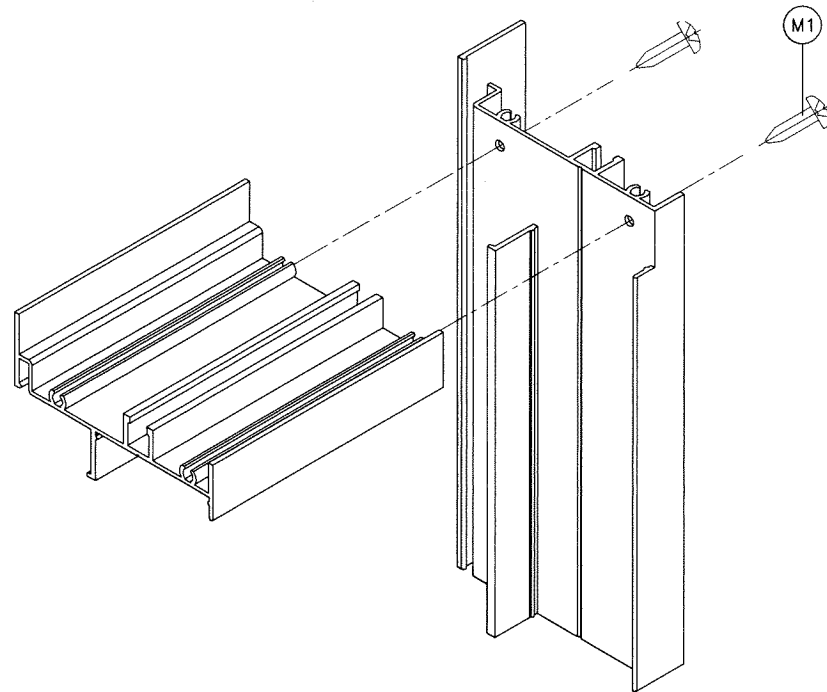


RECT. OR SQUARE WINDOWS

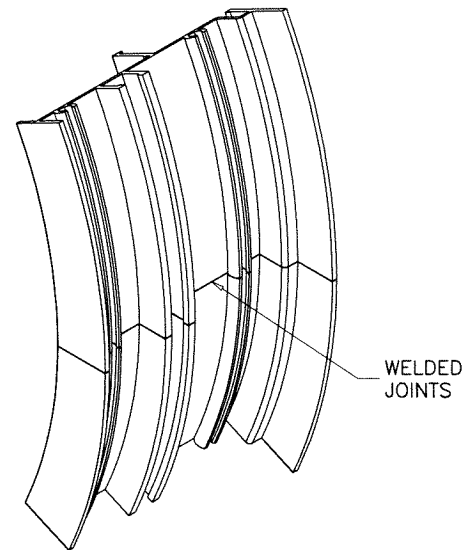

CIRCULAR WINDOWS

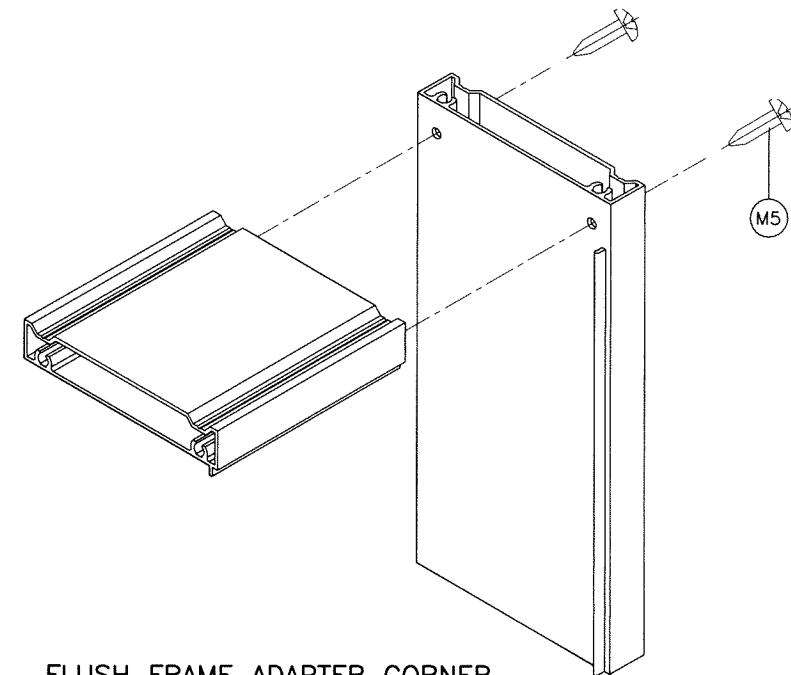


FLUSH FRAME ADAPTER CORNER

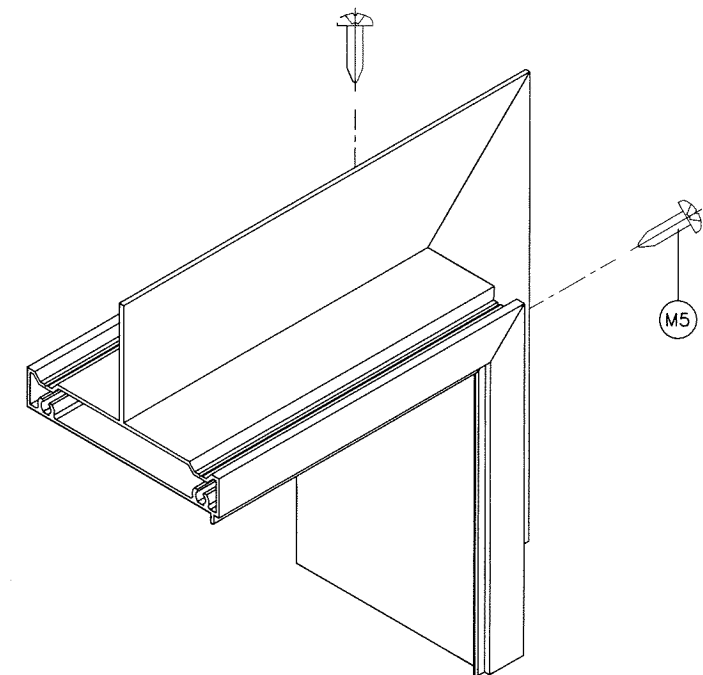

FIN FRAME ADAPTER CORNER

Sealed: 10/23/2023

FL #21461

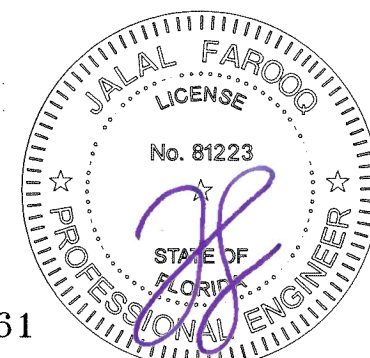

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\23-53F-ES

ES-EL150HP FIXED ALUMINUM WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	by description

date: 10-10-23
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
23-53F
sheet 10 of 10