

| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. WOOD FRAMING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. ALLOWABLE STRESS INCREASE OF 7/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
4. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS UP TO WIND ZONE 3.
5. DESIGN PRESSURE AND INSTALLATION DETAILS SHOWN IN THIS DOCUMENT APPLY ONLY TO MULLION. WINDOWS MUST BE APPROVED UNDER SEPARATE APPROVAL.
6. SINGLE WINDOWS TO BE MULLED ARE NOT LIMITED TO THOSE SHOWN IN THIS DRAWING. WINDOWS ATTACHED TO MULLION MUST HAVE SEPARATE APPROVAL.
7. DESIGN PRESSURE OF MULLED UNIT SHALL BE CONTROLLED BY THE LESSER DESIGN PRESSURE OF THE MULLION OR THE INDIVIDUAL WINDOW OR DOOR UNIT.
8. UNITS MAY BE MULLED TOGETHER INDEFINITELY AS LONG AS SINGLE UNIT WIDTH AND HEIGHT ARE NOT EXCEEDED AND MULLION IS ANCHORED AS SHOWN HEREIN.
9. MULLION VERTICAL INSTALLATION IS SHOWN, MULLION MAY BE USED IN HORIZONTAL APPLICATIONS AS LONG AS DIMENSIONS INDICATED HEREIN ARE NOT EXCEEDED AND MULLION IS ANCHORED ACCORDING TO THIS DOCUMENT.

ANCHORING NOTES:

1. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREW WITH SUFFICIENT LENGTH TO ACHIEVE A 1-3/8" MINIMUM EMBEDMENT. LOCATE ANCHORS AS SHOWN IN INSTALLATION DETAILS.
2. FOR ANCHORING INTO CONCRETE USE 3/16" TAPCON WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT WITH 2-1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN INSTALLATION DETAILS.
3. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN INSTALLATION DETAILS.
4. FOR ATTACHING WINDOW UNITS TO MULLION USE #10 SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A MINIMUM EMBEDMENT OF THREE THREADS PAST THE MULLION WALL. LOCATE SCREWS IN ACCORDANCE WITH WINDOW ANCHORING SCHEDULE AS SHOWN IN WINDOW SEPARATE APPROVAL.
5. ALL FASTENERS TO BE CORROSION RESISTANT.
6. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:  
A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42  
B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,200 PSI.  
C. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
7. D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM
7. TO ATTACH MULLION TO CLIP USE (4) #10 x 1-1/4" SELF DRILLING SCREWS PER CLIP. SCREWS MUST BE FIELD INSTALLED. HOLES FOR SCREWS ARE NOT PRE-DRILLED BY MANUFACTURER.

FL 21648

| TABLE OF CONTENTS |                                   |
|-------------------|-----------------------------------|
| SHEET NO.         | DESCRIPTION                       |
| 1                 | NOTES                             |
| 2                 | APPROVED CONFIGURATIONS AND CHART |
| 3 – 6             | INSTALLATION DETAILS              |
| 7                 | COMPONENTS                        |



EASTERN ARCHITECTURAL SYSTEMS  
A DIVISION OF  
CORNERSTONE BUILDING BRANDS

16341 DOMESTIC AVE  
FORT MYERS, FL 33912  
800-432-2204

176 HVHZ T-MULLION  
LARGE AND SMALL MISSILE IMPACT  
NOTES

DRAWN:  
V.L.

DWG NO.  
08-02950

REV  
B


SCALE NTS

DATE 09/16/16

SHEET 1 OF 7

L. ROBERTO LOMAS P.E.  
400 S. PALM AVE, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 06/01/2026

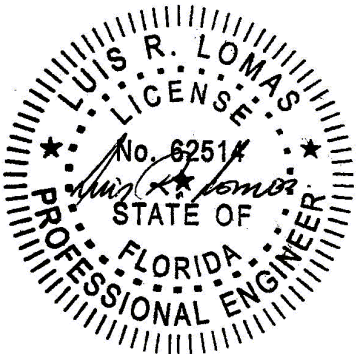

Luis R. Lomas P.E.  
FL No.: 62514

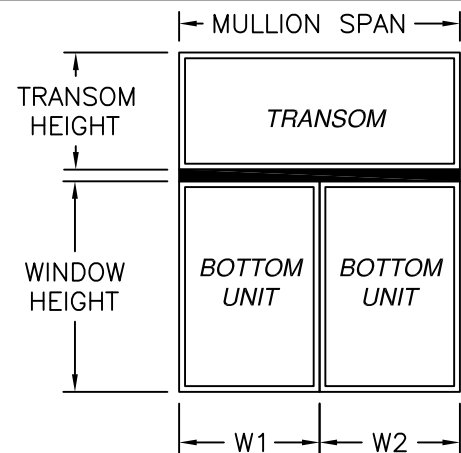


CHART 1  
18" TRANSOM

**Maximum design pressure capacity chart (psf)**  
Units with transom height of: 18 in  
Design pressures are positive and negative

| Height (in) |         | Span and Tributary width (in) |       |       |       |       |       |        |
|-------------|---------|-------------------------------|-------|-------|-------|-------|-------|--------|
|             |         | 36.00                         | 48.00 | 60.00 | 72.00 | 84.00 | 96.00 | 108.00 |
| Window      | Transom | 18.00                         | 24.00 | 30.00 | 36.00 | 42.00 | 48.00 | 54.00  |
| 36.00       | 18.00   | 150.0                         | 150.0 | 150.0 | 149.1 | 92.3  | 61.1  | 42.5   |
| 42.00       | 18.00   | 150.0                         | 150.0 | 150.0 | 136.5 | 84.4  | 55.7  | 38.7   |
| 48.00       | 18.00   | 150.0                         | 150.0 | 150.0 | 125.8 | 77.9  | 51.4  | 35.6   |
| 54.00       | 18.00   | 150.0                         | 150.0 | 150.0 | 116.7 | 72.4  | 47.8  | 33.1   |
| 60.00       | 18.00   | 150.0                         | 150.0 | 147.3 | 108.0 | 67.5  | 44.6  | 30.9   |
| 66.00       | 18.00   | 150.0                         | 150.0 | 139.4 | 100.2 | 63.3  | 41.9  | 29.1   |
| 72.00       | 18.00   | 150.0                         | 150.0 | 132.2 | 93.5  | 59.6  | 39.4  | 27.4   |
| 78.00       | 18.00   | 150.0                         | 150.0 | 125.8 | 87.6  | 56.3  | 37.3  | 25.9   |
| 84.00       | 18.00   | 150.0                         | 150.0 | 118.9 | 82.5  | 53.3  | 35.3  | 24.6   |
| 90.00       | 18.00   | 150.0                         | 148.1 | 112.3 | 77.9  | 50.6  | 33.6  | 23.4   |
| 96.00       | 18.00   | 150.0                         | 141.6 | 106.4 | 73.7  | 48.2  | 32.0  | 22.3   |

LARGE AND SMALL MISSILE IMPACT RATED INCLUDING HVHZ

CHART 2  
24" TRANSOM

**Maximum design pressure capacity chart (psf)**  
Units with transom height of: 24 in  
Design pressures are positive and negative

| Height (in) |         | Span and Tributary width (in) |       |       |       |       |       |        |
|-------------|---------|-------------------------------|-------|-------|-------|-------|-------|--------|
|             |         | 36.00                         | 48.00 | 60.00 | 72.00 | 84.00 | 96.00 | 108.00 |
| Window      | Transom | 18.00                         | 24.00 | 30.00 | 36.00 | 42.00 | 48.00 | 54.00  |
| 36.00       | 24.00   | 150.0                         | 150.0 | 150.0 | 135.0 | 83.5  | 55.2  | 38.4   |
| 42.00       | 24.00   | 150.0                         | 150.0 | 150.0 | 124.6 | 77.0  | 50.8  | 35.3   |
| 48.00       | 24.00   | 150.0                         | 150.0 | 150.0 | 115.6 | 71.6  | 47.2  | 32.7   |
| 54.00       | 24.00   | 150.0                         | 150.0 | 144.8 | 107.9 | 66.8  | 44.1  | 30.6   |
| 60.00       | 24.00   | 150.0                         | 150.0 | 137.1 | 100.8 | 62.7  | 41.4  | 28.7   |
| 66.00       | 24.00   | 150.0                         | 150.0 | 130.3 | 94.0  | 59.0  | 39.0  | 27.1   |
| 72.00       | 24.00   | 150.0                         | 150.0 | 124.0 | 88.1  | 55.8  | 36.9  | 25.6   |
| 78.00       | 24.00   | 150.0                         | 150.0 | 118.4 | 82.9  | 52.9  | 35.0  | 24.3   |
| 84.00       | 24.00   | 150.0                         | 147.3 | 113.1 | 78.2  | 50.2  | 33.3  | 23.1   |
| 90.00       | 24.00   | 150.0                         | 140.9 | 107.1 | 74.1  | 47.9  | 31.7  | 22.1   |
| 96.00       | 24.00   | 150.0                         | 135.0 | 101.6 | 70.4  | 45.7  | 30.3  | 21.1   |

LARGE AND SMALL MISSILE IMPACT RATED INCLUDING HVHZ

CHART 3  
30" TRANSOM

**Maximum design pressure capacity chart (psf)**  
Units with transom height of: 30 in  
Design pressures are positive and negative

| Height (in) |         | Span and Tributary width (in) |       |       |       |       |       |        |
|-------------|---------|-------------------------------|-------|-------|-------|-------|-------|--------|
|             |         | 36.00                         | 48.00 | 60.00 | 72.00 | 84.00 | 96.00 | 108.00 |
| Window      | Transom | 18.00                         | 24.00 | 30.00 | 36.00 | 42.00 | 48.00 | 54.00  |
| 36.00       | 30.00   | 150.0                         | 150.0 | 150.0 | 124.2 | 76.6  | 50.6  | 35.1   |
| 42.00       | 30.00   | 150.0                         | 150.0 | 150.0 | 115.3 | 71.1  | 46.8  | 32.5   |
| 48.00       | 30.00   | 150.0                         | 150.0 | 144.0 | 107.6 | 66.4  | 43.7  | 30.3   |
| 54.00       | 30.00   | 150.0                         | 150.0 | 136.4 | 100.8 | 62.3  | 41.1  | 28.4   |
| 60.00       | 30.00   | 150.0                         | 150.0 | 129.6 | 94.9  | 58.7  | 38.7  | 26.8   |
| 66.00       | 30.00   | 150.0                         | 150.0 | 123.4 | 88.9  | 55.5  | 36.6  | 25.4   |
| 72.00       | 30.00   | 150.0                         | 150.0 | 117.8 | 83.6  | 52.6  | 34.8  | 24.1   |
| 78.00       | 30.00   | 150.0                         | 148.1 | 112.7 | 78.9  | 50.0  | 33.1  | 23.0   |
| 84.00       | 30.00   | 150.0                         | 141.6 | 108.0 | 74.6  | 47.7  | 31.5  | 21.9   |
| 90.00       | 30.00   | 150.0                         | 135.7 | 102.7 | 70.9  | 45.5  | 30.1  | 20.9   |
| 96.00       | 30.00   | 150.0                         | 130.3 | 97.7  | 67.4  | 43.6  | 28.9  | 20.1   |

LARGE AND SMALL MISSILE IMPACT RATED INCLUDING HVHZ

CHART 4  
36" TRANSOM

**Maximum design pressure capacity chart (psf)**  
Units with transom height of: 36 in  
Design pressures are positive and negative

| Height (in) |         | Span and Tributary width (in) |       |       |       |       |       |        |
|-------------|---------|-------------------------------|-------|-------|-------|-------|-------|--------|
|             |         | 36.00                         | 48.00 | 60.00 | 72.00 | 84.00 | 96.00 | 108.00 |
| Window      | Transom | 18.00                         | 24.00 | 30.00 | 36.00 | 42.00 | 48.00 | 54.00  |
| 36.00       | 36.00   | 150.0                         | 150.0 | 150.0 | 115.7 | 71.1  | 46.8  | 32.5   |
| 42.00       | 36.00   | 150.0                         | 150.0 | 144.8 | 108.0 | 66.3  | 43.6  | 30.2   |
| 48.00       | 36.00   | 150.0                         | 150.0 | 137.1 | 101.2 | 62.2  | 40.9  | 28.3   |
| 54.00       | 36.00   | 150.0                         | 150.0 | 130.3 | 95.2  | 58.6  | 38.6  | 26.7   |
| 60.00       | 36.00   | 150.0                         | 150.0 | 124.0 | 89.9  | 55.4  | 36.5  | 25.3   |
| 66.00       | 36.00   | 150.0                         | 150.0 | 118.4 | 84.6  | 52.5  | 34.6  | 24.0   |
| 72.00       | 36.00   | 150.0                         | 150.0 | 113.2 | 79.8  | 49.9  | 33.0  | 22.8   |
| 78.00       | 36.00   | 150.0                         | 144.0 | 108.5 | 75.5  | 47.6  | 31.4  | 21.8   |
| 84.00       | 36.00   | 150.0                         | 137.9 | 104.1 | 71.6  | 45.5  | 30.0  | 20.8   |
| 90.00       | 36.00   | 150.0                         | 132.2 | 99.2  | 68.1  | 43.5  | 28.8  | 20.0   |
| 96.00       | 36.00   | 150.0                         | 127.1 | 94.5  | 65.0  | 41.7  | 27.6  | 19.2   |

LARGE AND SMALL MISSILE IMPACT RATED INCLUDING HVHZ


| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

- DESIGN PRESSURE TABLE INSTRUCTIONS:
1. DEFINE REQUIRED DESIGN LOAD PER FLORIDA BUILDING CODE CHAPTER 16.
  2. DETERMINE MULLION SPAN AND TRIBUTARY WIDTH OF PRODUCT TO BE INSTALLED BASED ON FORMULA FOR TRIBUTARY WIDTH BELOW.
  3. TO DETERMINE MULLION RATING LOCATE COLUMN FOR MULLION SPAN AND TRIBUTARY WIDTH THEN LOCATE CORRESPONDING ROW FOR BOTTOM AND TRANSOM HEIGHTS. FIND THE INTERSECTION OF THIS COLUMN AND ROW. MULLION RATING IS LOCATED AT THIS INTERSECTION.
  4. MULLION RATING MUST BE EQUAL OR GREATER THAN REQUIRED DESIGN PRESSURE OBTAINED IN STEP 1.
  5. IF TRANSOM TO BE INSTALLED IS NOT LISTED IN THESE CHARTS GO TO NEXT HIGHER TRANSOM CHART. FOR EXAMPLE IF TRANSOM TO BE INSTALLED IS 20" HIGH THEN USE CHART FOR 24" TRANSOM.
  6. WINDOW/DOOR AND TRANSOMS TO BE ANCHORED ON ALL FOUR SIDES.

$$\text{TRIBUTARY WIDTH} = \frac{W1 + W2}{2}$$

SIGNED: 06/01/2026


|                                                                                                       |  |                                                                                                                                             |  |
|-------------------------------------------------------------------------------------------------------|--|---------------------------------------------------------------------------------------------------------------------------------------------|--|
|                  |  | EASTERN ARCHITECTURAL SYSTEMS<br>A DIVISION OF<br>CORNERSTONE BUILDING BRANDS<br>16341 DOMESTIC AVE<br>FORT MYERS, FL 33912<br>800-432-2204 |  |
| 176 HVHZ T-MULLION<br>LARGE AND SMALL MISSILE IMPACT<br>ELEVATION AND D.P. CHARTS                     |  |                                                                                                                                             |  |
| DRAWN:<br>V.L.                                                                                        |  | DWG NO.<br>08-02950                                                                                                                         |  |
| SCALE NTS                                                                                             |  | REV B                                                                                                                                       |  |
| DATE 09/16/16                                                                                         |  | SHEET 2 OF 7                                                                                                                                |  |
| L. ROBERTO LOMAS P.E.<br>400 S. PALM AVE, INDIALANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com |  |                                                                                                                                             |  |

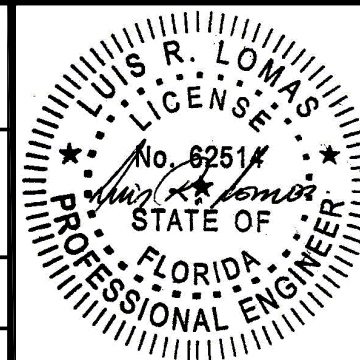


Luis R. Lomas P.E.  
FL No.: 62514



| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

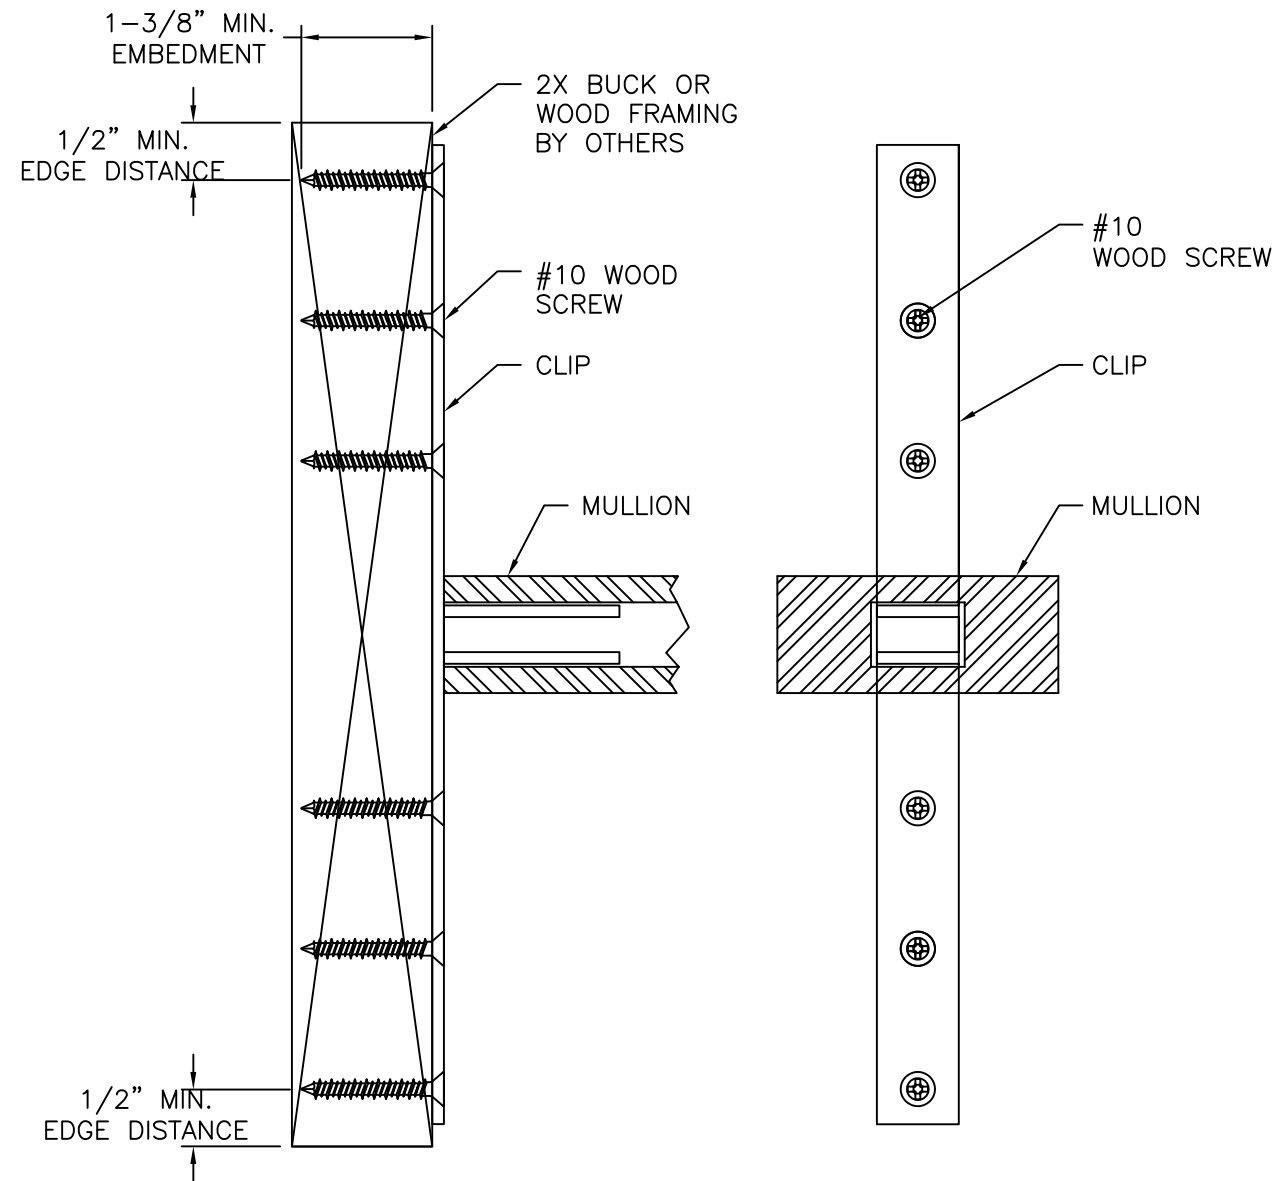

**HORIZONTAL MULLION WITH CLIP DETAIL**  
WOOD FRAMING OR 2X BUCK INSTALLATION  
VERTICAL MULLION SILL SIMILAR

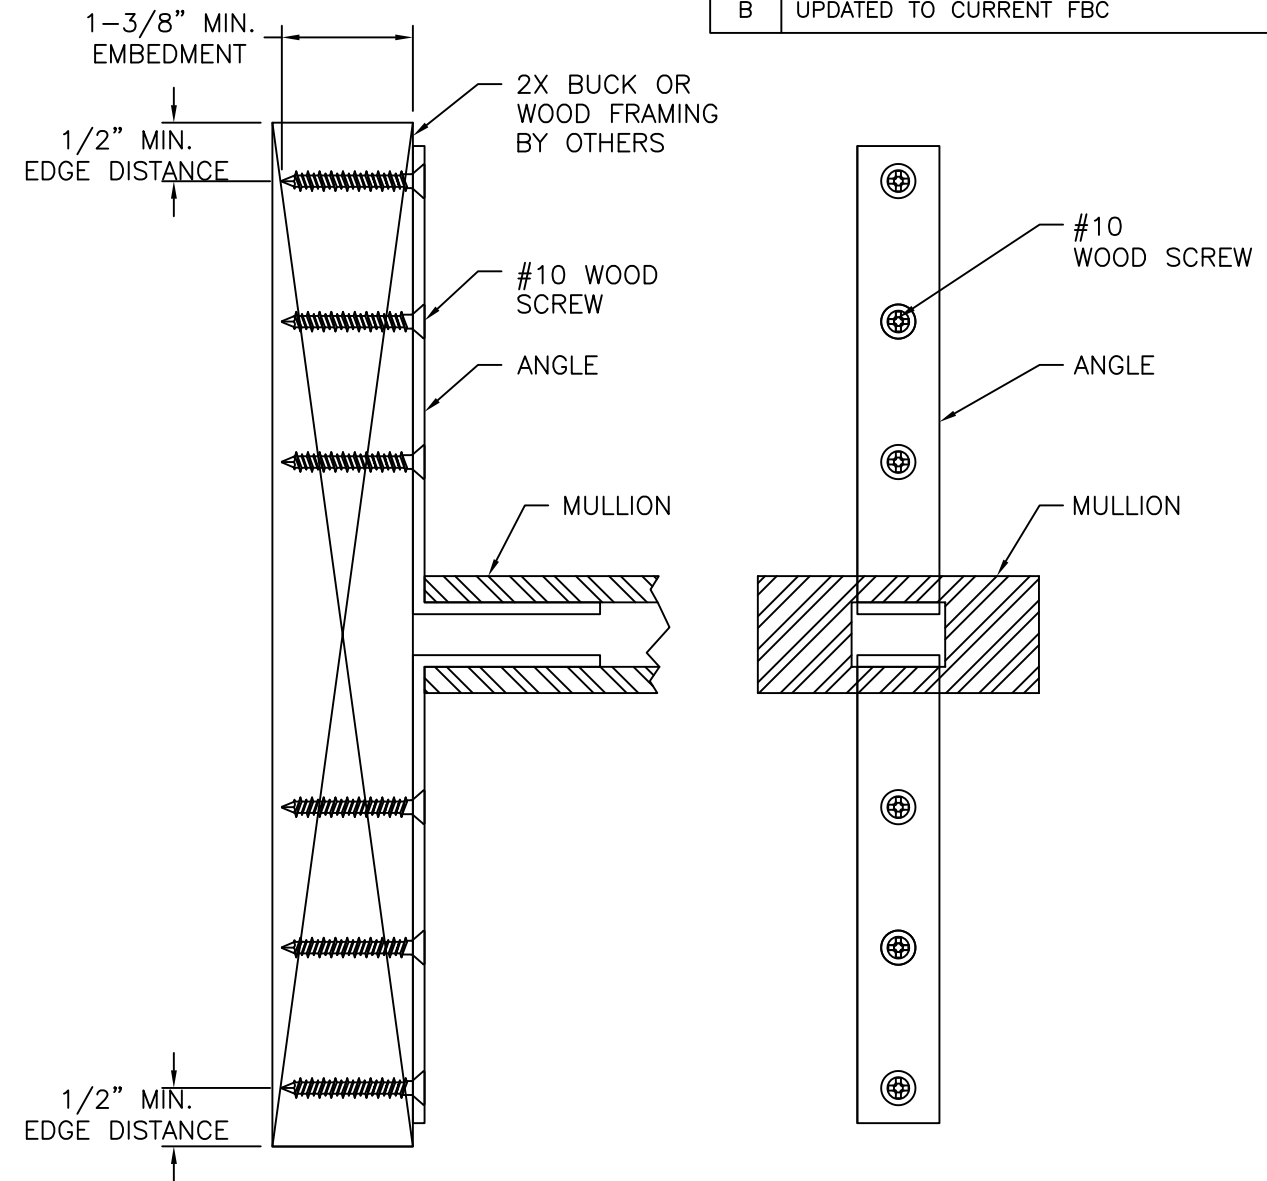


**HORIZONTAL MULLION WITH ANGLE DETAIL**  
WOOD FRAMING OR 2X BUCK INSTALLATION  
VERTICAL MULLION SILL SIMILAR

SIGNED: 06/01/2026

FL 21648


|                                                                                                                                                                                 |                  |                                                                                                                                             |          |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|---------------------------------------------------------------------------------------------------------------------------------------------|----------|
|  <b>Eastern</b><br>ARCHITECTURAL SYSTEMS<br>ALUMINUM AND VINYL<br>IMPACT WINDOWS AND DOORS |                  | EASTERN ARCHITECTURAL SYSTEMS<br>A DIVISION OF<br>CORNERSTONE BUILDING BRANDS<br>16341 DOMESTIC AVE<br>FORT MYERS, FL 33912<br>800-432-2204 |          |
| 176 HVHZ T-MULLION<br>LARGE AND SMALL MISSILE IMPACT<br>INSTALLATION DETAILS                                                                                                    |                  |                                                                                                                                             |          |
| DRAWN:<br>V.L.                                                                                                                                                                  |                  | DWG NO.<br>08-02950                                                                                                                         | REV<br>B |
| SCALE<br>NTS                                                                                                                                                                    | DATE<br>09/16/16 | SHEET 3 OF 7                                                                                                                                |          |
| L. ROBERTO LOMAS P.E.<br>400 S. PALM AVE, INDIANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com                                                                             |                  |                                                                                                                                             |          |

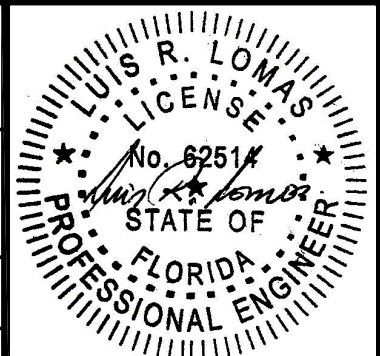


Luis R. Lomas P.E.  
FL No.: 62514



| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

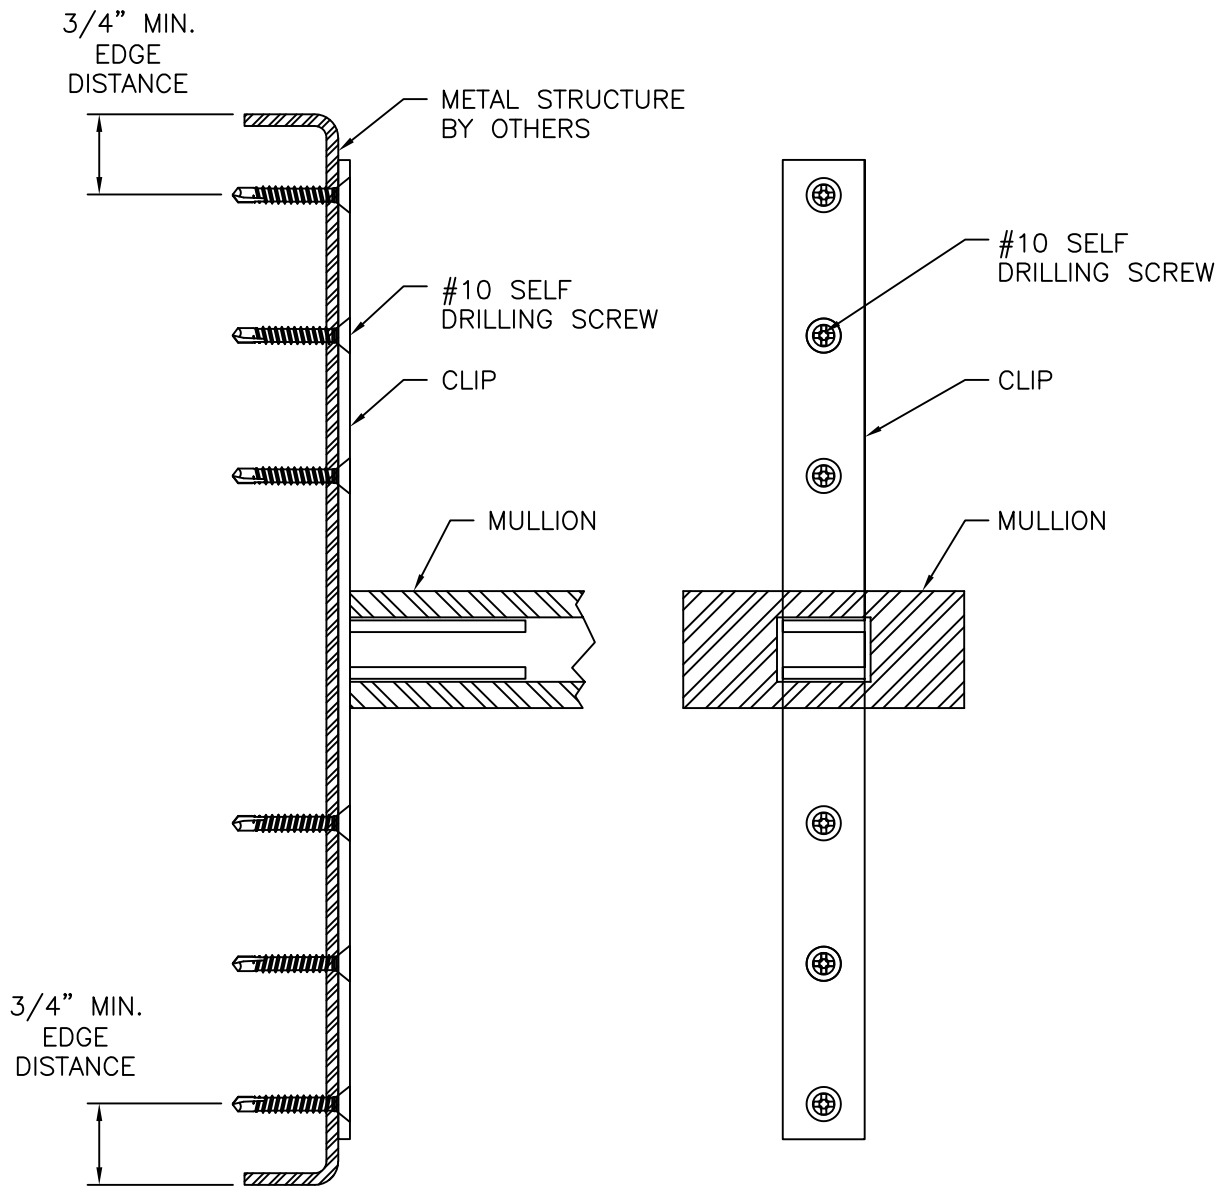

**HORIZONTAL MULLION WITH CLIP DETAIL**  
METAL STRUCTURE INSTALLATION  
VERTICAL MULLION SILL SIMILAR

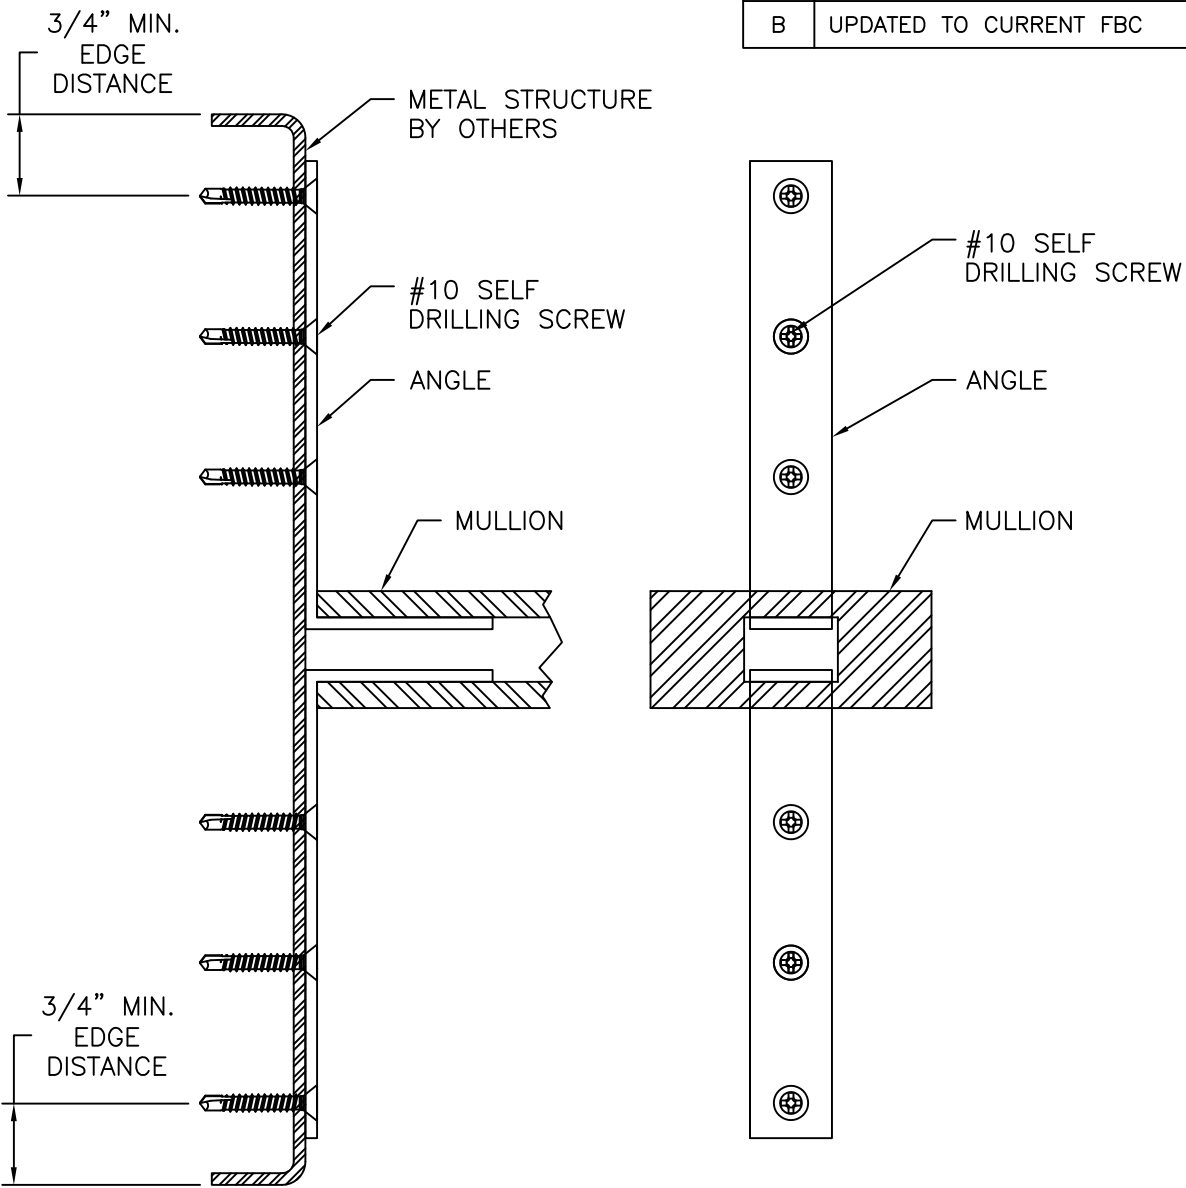

**HORIZONTAL MULLION WITH ANGLE DETAIL**  
METAL STRUCTURE INSTALLATION  
VERTICAL MULLION SILL SIMILAR

SIGNED: 06/01/2026



EASTERN ARCHITECTURAL SYSTEMS

A DIVISION OF

CORNERSTONE BUILDING BRANDS

16341 DOMESTIC AVE

FORT MYERS, FL 33912

800-432-2204

176 HVHZ T-MULLION

LARGE AND SMALL MISSILE IMPACT

INSTALLATION DETAILS

DRAWN: V.L.

DWG NO. 08-02950

REV B

SCALE NTS


DATE 09/16/16

SHEET 4 OF 7


L. ROBERTO LOMAS P.E.

400 S. PALM AVE, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

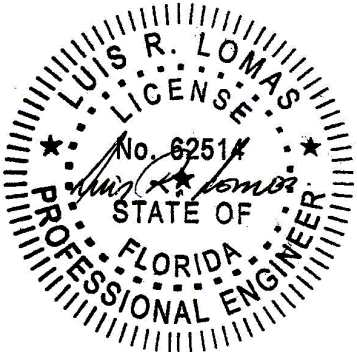

Luis R. Lomas P.E.  
FL No.: 62514

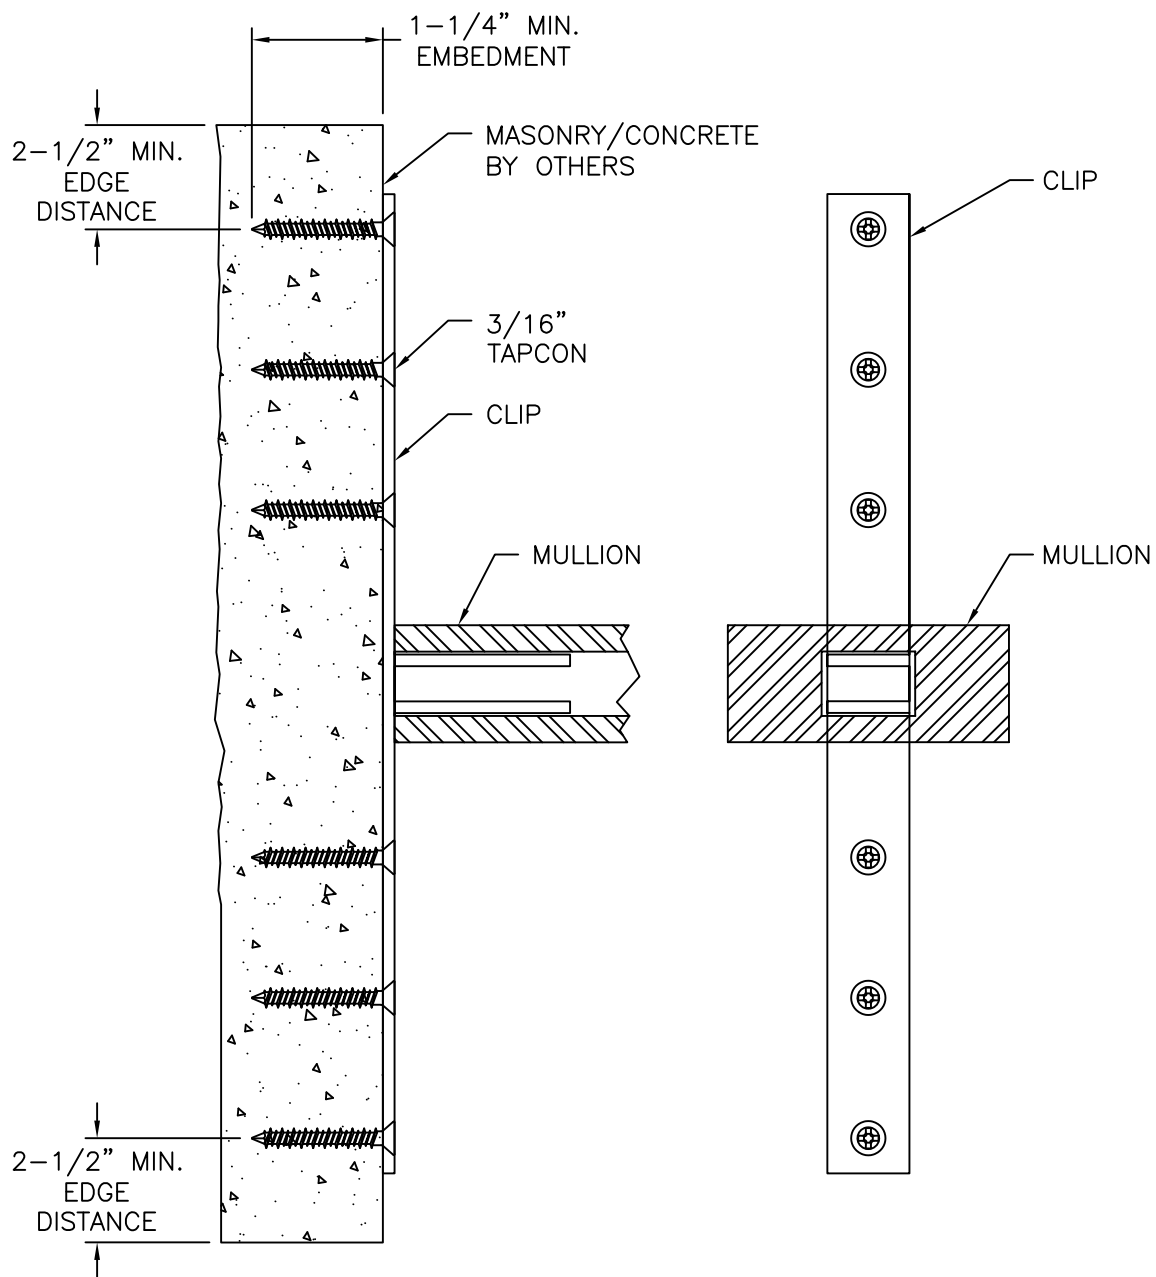

**HORIZONTAL MULLION WITH CLIP DETAIL**  
MASONRY/CONCRETE INSTALLATION  
VERTICAL MULLION SIMILAR

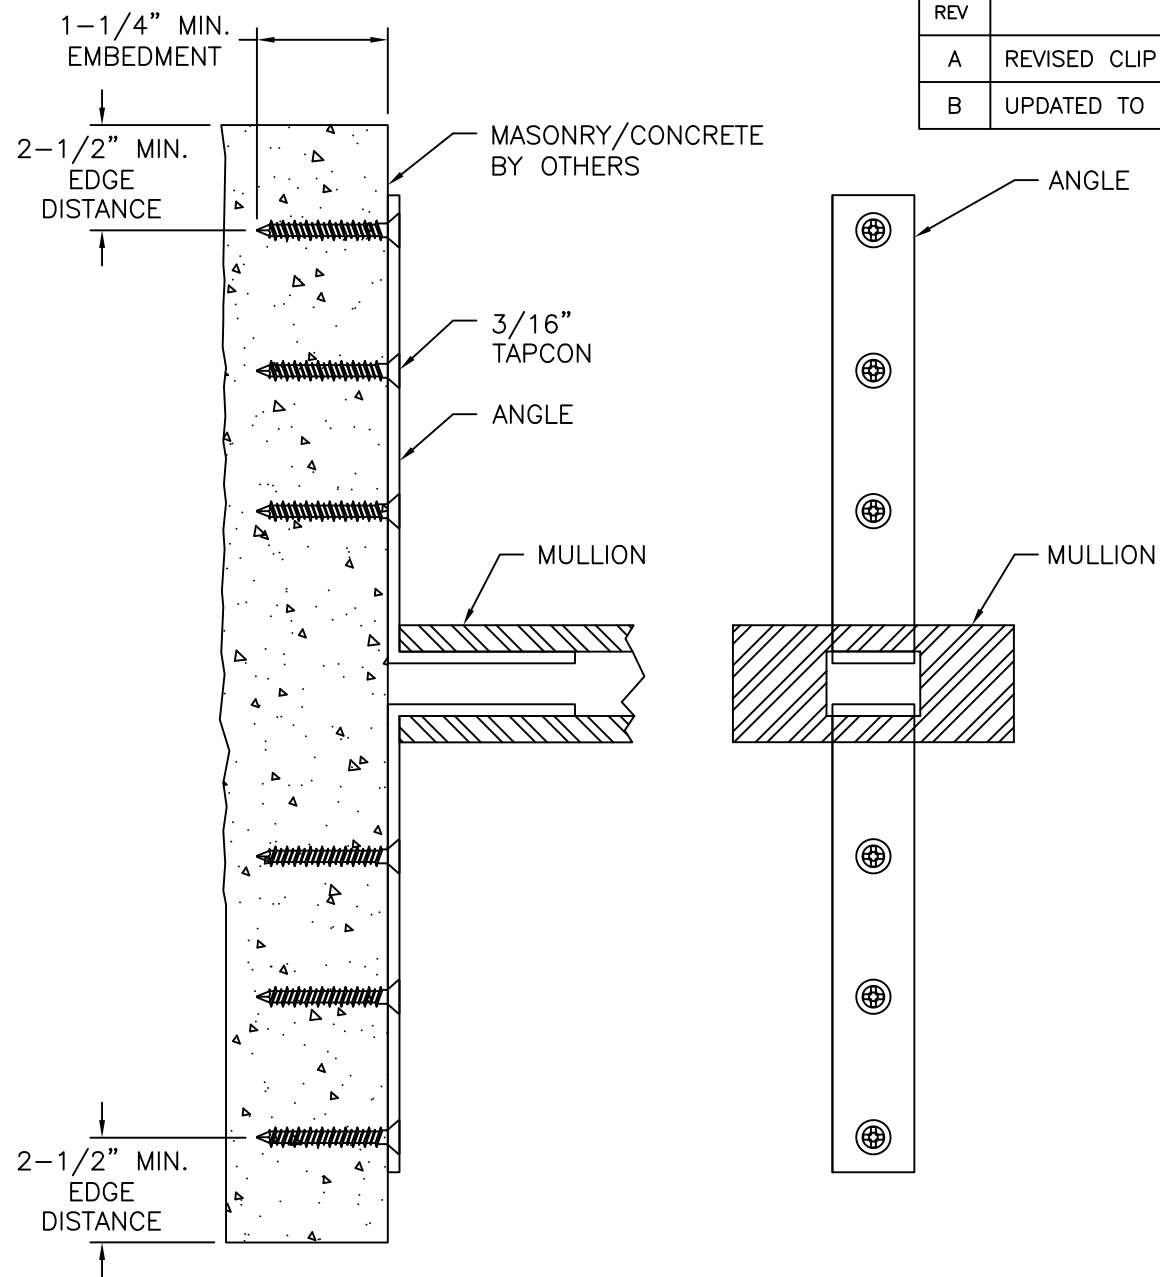

**HORIZONTAL MULLION WITH ANGLE DETAIL**  
MASONRY/CONCRETE INSTALLATION  
VERTICAL MULLION SIMILAR

| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

SIGNED: 06/01/2026




EASTERN ARCHITECTURAL SYSTEMS  
A DIVISION OF  
CORNERSTONE BUILDING BRANDS  
16341 DOMESTIC AVE  
FORT MYERS, FL 33912  
800-432-2204


**176 HVHZ T-MULLION**  
**LARGE AND SMALL MISSILE IMPACT**  
**INSTALLATION DETAILS**

|                |                     |                 |
|----------------|---------------------|-----------------|
| DRAWN:<br>V.L. | DWG NO.<br>08-02950 | REV<br>B        |
| SCALE<br>NTS   | DATE<br>09/16/16    | SHEET<br>5 OF 7 |



L. ROBERTO LOMAS P.E.  
400 S. PALM AVE, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

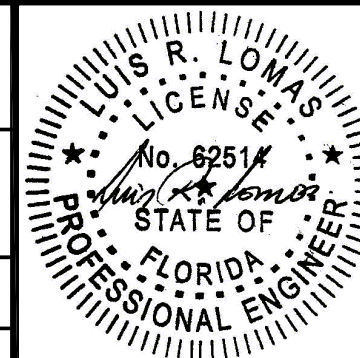


Luis R. Lomas P.E.  
FL No.: 62514

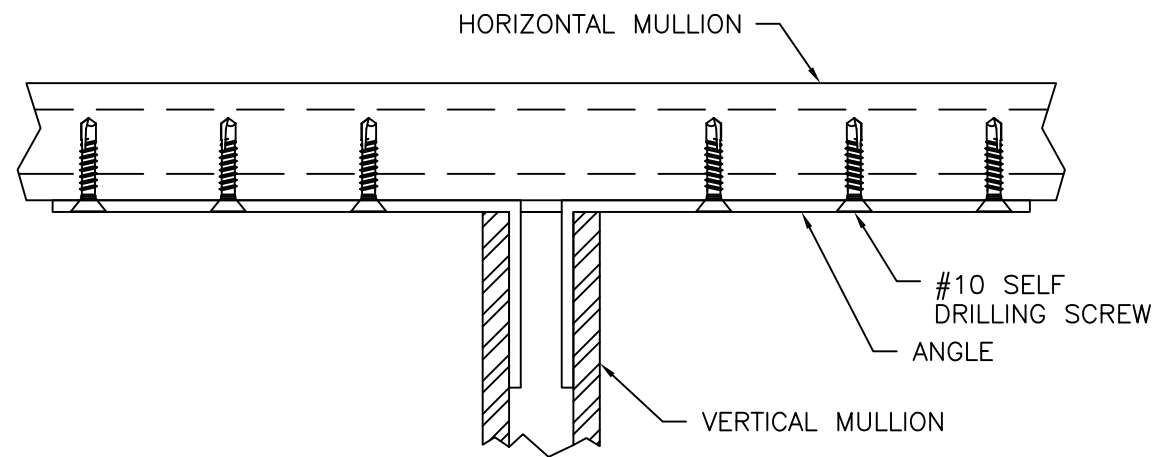

VERTICAL TO HORIZONTAL MULLION CONNECTION  
WITH ANGLE

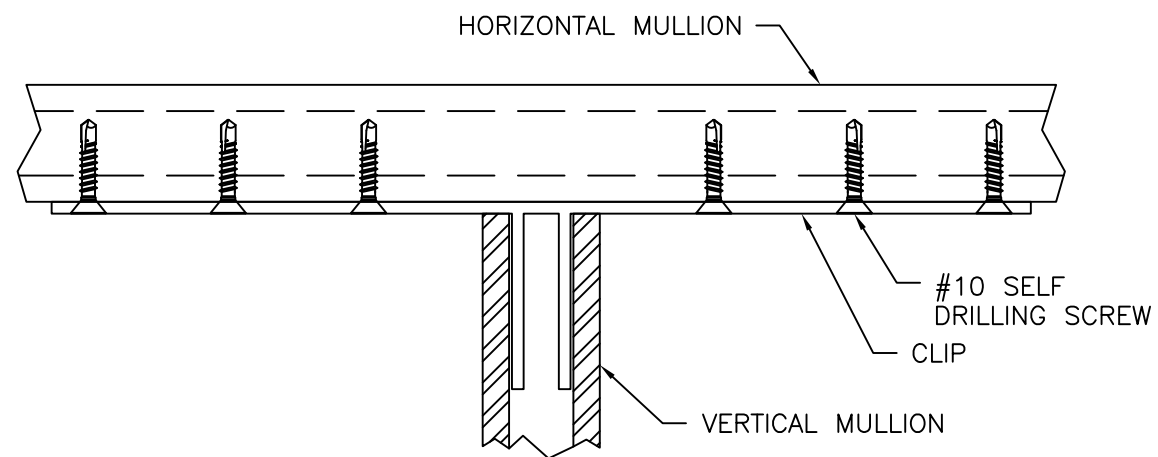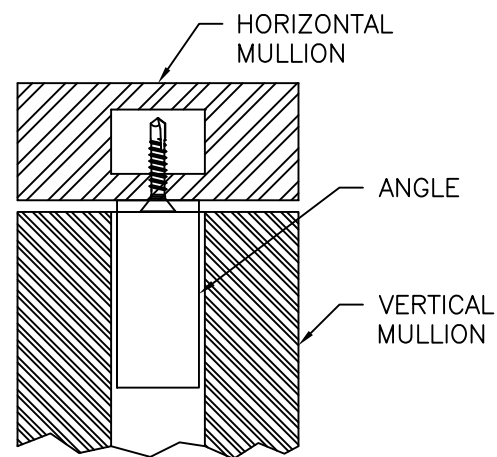


VERTICAL TO HORIZONTAL MULLION CONNECTION  
WITH ANGLE

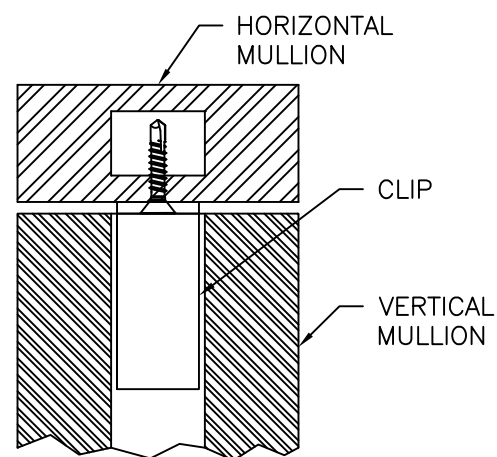

| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

SIGNED: 06/01/2026


|                                                                                                                                                                                                                                         |                  |                     |                                                                                                                                                                 |          |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------|---------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|
|  <div> <b>Eastern</b><br/> <small>ARCHITECTURAL SYSTEMS</small><br/> <b>ALUMINUM AND VINYL</b><br/> <small>IMPACT WINDOWS AND DOORS</small> </div> |                  |                     | <small>EASTERN ARCHITECTURAL SYSTEMS<br/>A DIVISION OF<br/>CORNERSTONE BUILDING BRANDS<br/>16341 DOMESTIC AVE<br/>FORT MYERS, FL 33912<br/>800-432-2204</small> |          |  |
| <p align="center"><b>176 HVHZ T-MULLION<br/>LARGE AND SMALL MISSILE IMPACT<br/>INSTALLATION DETAILS</b></p>                                                                                                                             |                  |                     |                                                                                                                                                                 |          |  |
| DRAWN:<br>V.L.                                                                                                                                                                                                                          |                  | DWG NO.<br>08-02950 |                                                                                                                                                                 | REV<br>B |  |
| SCALE<br>NTS                                                                                                                                                                                                                            | DATE<br>09/16/16 | SHEET 6 OF 7        |                                                                                                                                                                 |          |  |
| <p align="center"> <small>L. ROBERTO LOMAS P.E.<br/>400 S. PALM AVE, INDIALANTIC, FL 32903<br/>434-688-0609    rllomas@lrlomaspe.com</small> </p>                                                                                       |                  |                     |                                                                                                                                                                 |          |  |

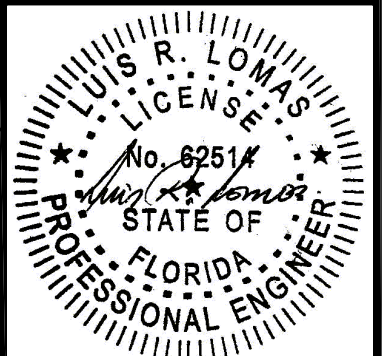


Luis R. Lomas P.E.  
FL No.: 62514

| BILL OF MATERIALS |             |                          |              |                  |
|-------------------|-------------|--------------------------|--------------|------------------|
| ITEM NO.:         | PART NUMBER | DESCRIPTION              | MANUFACTURER | MATERIAL         |
| 1                 | 56372       | H-CLIP                   | SAPA         | ALUMINUM 6063-T6 |
| 2                 |             | ANGLE                    |              | ALUMINUM 6063-T6 |
| 3                 | 56371       | 1 1/4" X 3" TUBE MULLION | SAPA         | ALUMINUM 6063-T6 |


| REVISIONS |                        |          |          |
|-----------|------------------------|----------|----------|
| REV       | DESCRIPTION            | DATE     | APPROVED |
| A         | REVISED CLIP           | 08/20/19 | R.L.     |
| B         | UPDATED TO CURRENT FBC | 05/26/26 | LMH      |

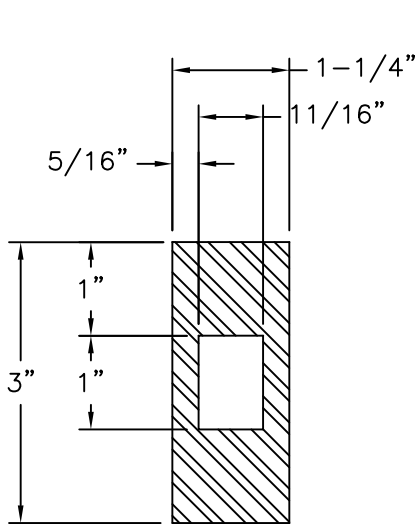


1 1/4"X3" TUBE MULLION  
ALUMINUM 6063-T6 .125" THICK  
MOMENT OF INERTIA: 2.755 IN^4  
SECTION MODULUS: 1.864 IN^3

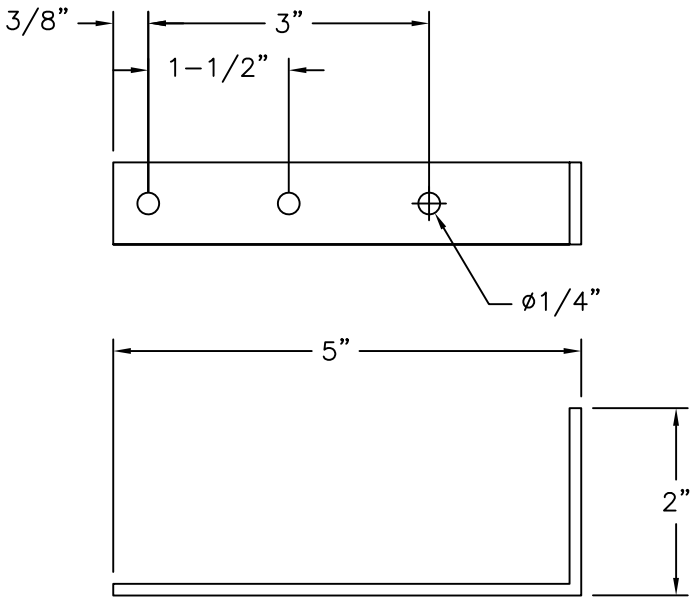

ANGLE  
ALUMINUM 6063-T6 .125" THICK

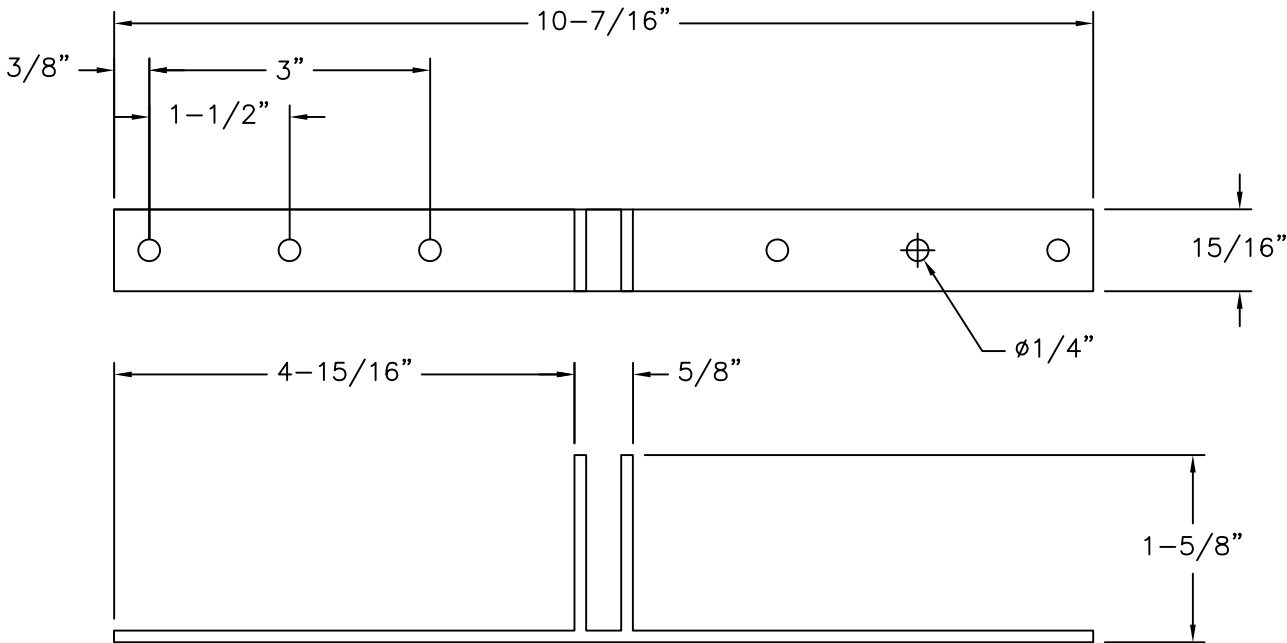

CLIP  
ALUMINUM 6063-T6 .125" THICK

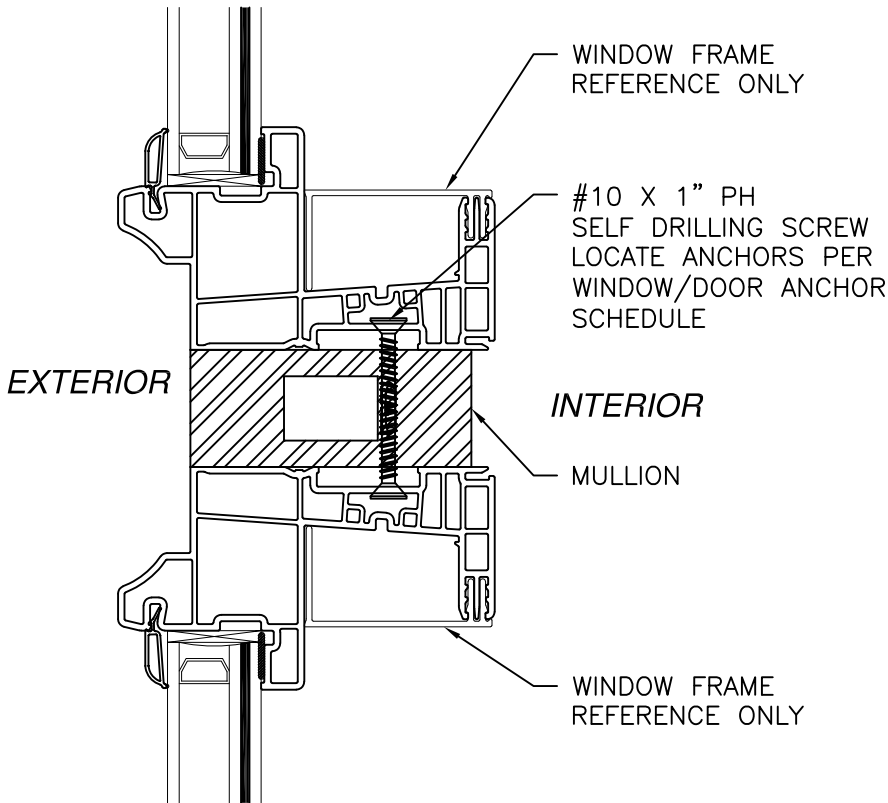

WINDOW TO MULLION CONNECTION  
WINDOW FRAME SHOWN FOR DETAIL PURPOSES ONLY  
MULLION IS NOT LIMITED TO THIS PRODUCT

SIGNED: 06/01/2026



**Eastern**  
ARCHITECTURAL SYSTEMS  
ALUMINUM AND VINYL  
IMPACT WINDOWS AND DOORS

EASTERN ARCHITECTURAL SYSTEMS  
A DIVISION OF  
CORNERSTONE BUILDING BRANDS  
16341 DOMESTIC AVE  
FORT MYERS, FL 33912  
800-432-2204

176 HVHZ T-MULLION  
LARGE AND SMALL MISSILE IMPACT  
INSTALLATION DETAILS

DRAWN:  
V.L.

DWG NO.  
08-02950


REV  
B

SCALE NTS

DATE 09/16/16

SHEET 7 OF 7

L. ROBERTO LOMAS P.E.  
400 S. PALM AVE, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

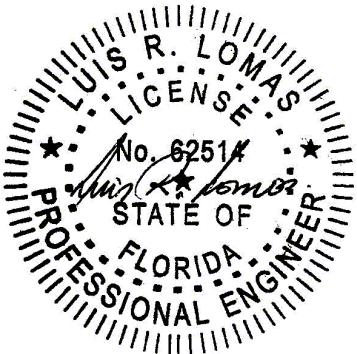

Luis R. Lomas P.E.  
FL No.: 62514