




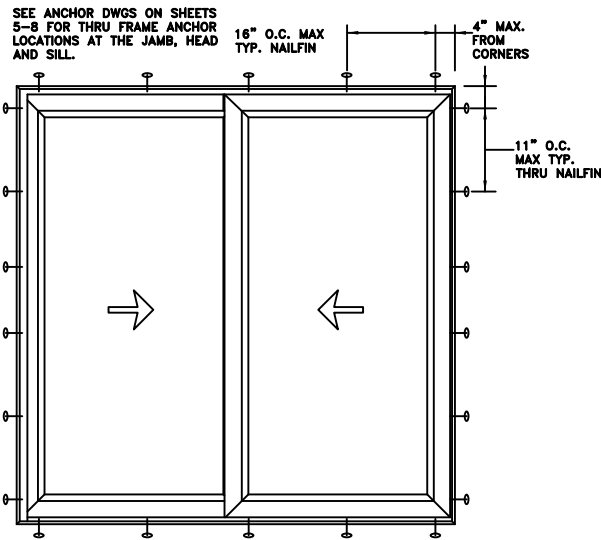

TYPICAL ELEVATION WITH FASTENER SPACING

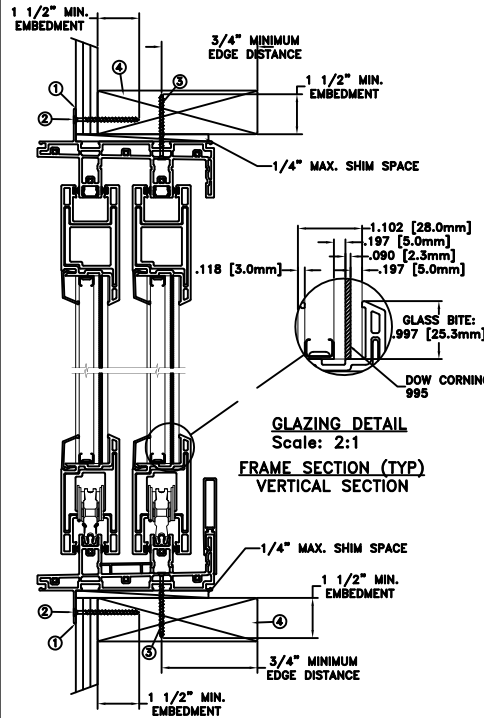

GLAZING DETAIL
Scale: 2:1
FRAME SECTION (TYP)
VERTICAL SECTION

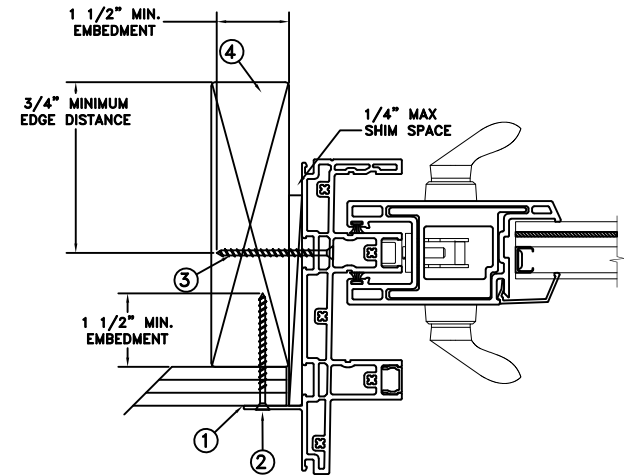

FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION

NAILFIN / THRU JAMB INSTALLATION

Max Frame	DP	IMPACT
71 3/4 x 79 13/16	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 PH or greater fastener through the nailfin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
3. Use #10 PH or greater fastener through the pre-drilled holes in the head/sill tracks at the interior tower with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. See additional details for location and spacing.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 3.0mm tempered - 12.7mm airspace - 5.0mm annealed - 2.3mm SGP Interlayer by Dupont - 5.0mm annealed insulating glass.
4. Use structural or composite shims where required.

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

Micah Swartz




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075


01/07/25

DATE: 12/12/2024		3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM		SCALE: NTS	
CHECKED BY: J.GOOSEN		TITLE: Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel XX	
APPROVED BY: J.GOOSEN			
RECORD No.: D014758			
IDENTIFIER No. NCTL-210-4150-02		CAD DWG. No.: —	REV: C
		SHEET 1 of 4	


SEE ANCHOR DWGS ON SHEETS
5-8 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD
AND SILL.

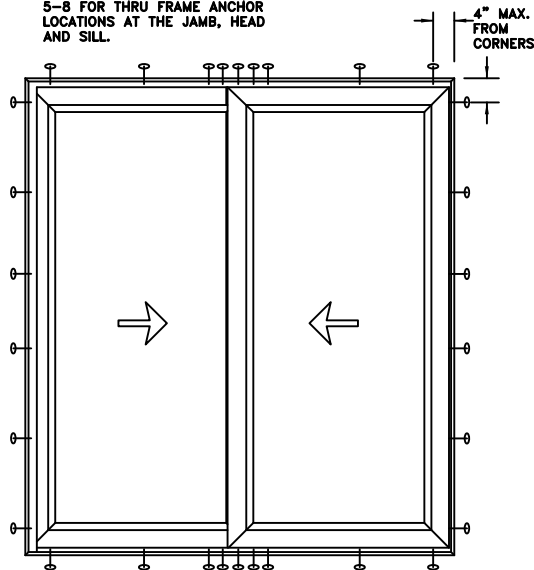

TYPICAL ELEVATION WITH FASTENER SPACING

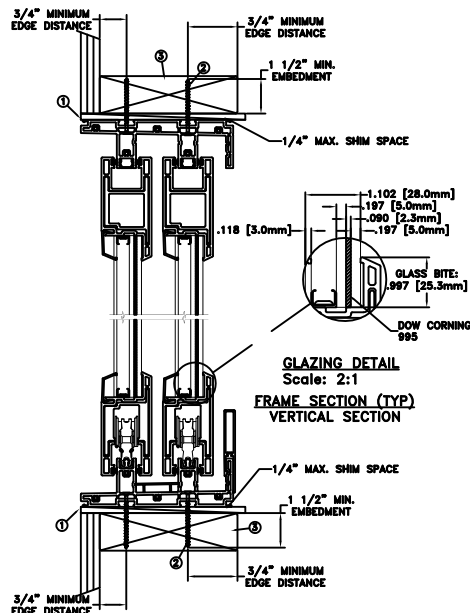

THROUGH FRAME INSTALLATION

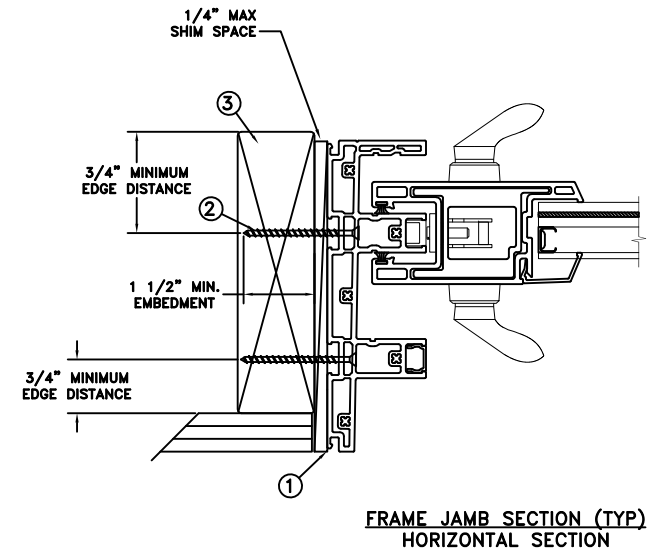

Max Frame	DP	IMPACT
71 3/4 x 79 13/16	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 PH or greater fastener through the pre-drilled holes in the head/sill tracks at both towers with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. See additional details for location and spacing. For 2X wood frame substrate (min. SG = 0.42)
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 3.0mm tempered - 12.7mm airspace - 5.0mm annealed - 2.3mm SGP Interlayer by Dupont - 5.0mm annealed insulating glass.
4. Use structural or composite shims where required.


This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
01/07/25



DATE: 12/12/2024	3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936
DRAWN BY: M.HAM	SCALE: NTS
CHECKED BY: J.GOOSEN	TITLE: Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel XX
APPROVED BY: J.GOOSEN	
RECORD No.: D014758	
IDENTIFIER No. NCTL-210-4150-02	CAD DWG, No.: —
REV: C	SHEET 2 of 4

CONCRETE/MASONRY
INSTALLATION

SEE ANCHOR DWGS ON SHEETS
5-8 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD
AND SILL.

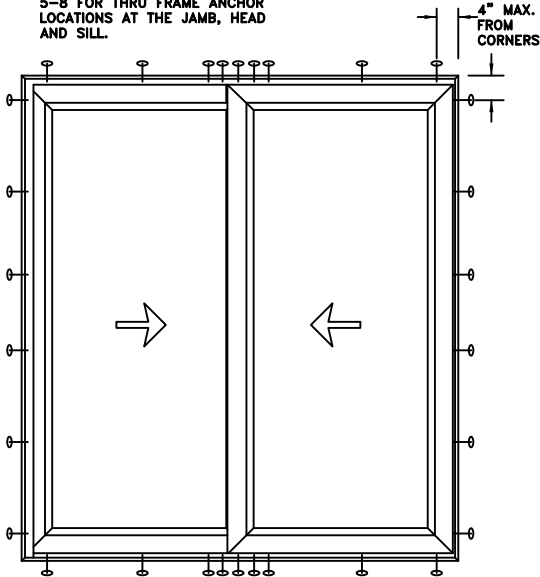

TYPICAL ELEVATION WITH FASTENER SPACING

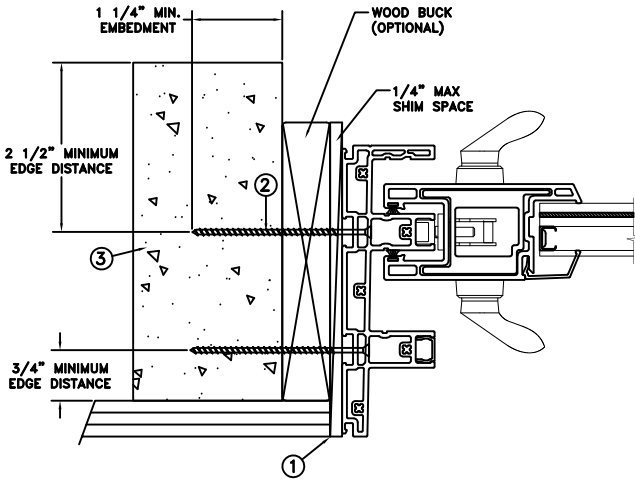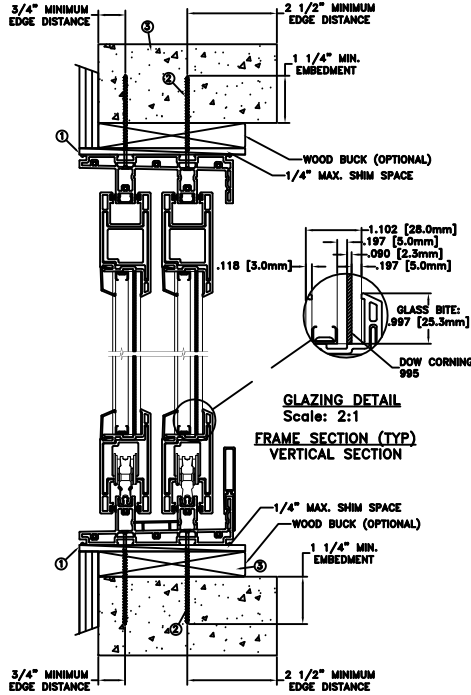

FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION

Max Frame	DP	IMPACT
71 3/4 x 79 13/16	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 1/4" tapcon or equivalent fasteners through the pre-drilled holes in the head/sill tracks at both towers with sufficient length to penetrate a minimum of 1 1/4" into concrete or masonry at each location with a 2 1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 3.0mm tempered - 12.7mm airspace - 5.0mm annealed - 2.3mm SGP Interlayer by Dupont - 5.0mm annealed insulating glass.
4. Use structural or composite shims where required.

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

MICAH SWARTZ, P.E.
No 933573
STATE OF FLORIDA
PROFESSIONAL ENGINEER
01/07/25
PE No. 933573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075



DATE: 12/12/2024	3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936
DRAWN BY: M.HAM	SCALE: NTS
CHECKED BY: J.GOOSEN	TITLE: Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel XX
APPROVED BY: J.GOOSEN	
RECORD No.: D014758	
IDENTIFIER No. NCTL-210-4150-02	CAD DWG, No.: —
	REV: C
	SHEET 3 of 4

STEEL INSTALLATION

SEE ANCHOR DWGS ON SHEETS
5-8 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD
AND SILL.

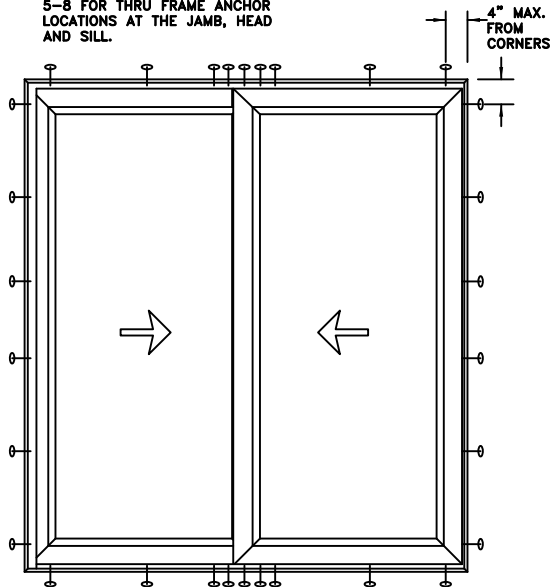

TYPICAL ELEVATION WITH FASTENER SPACING

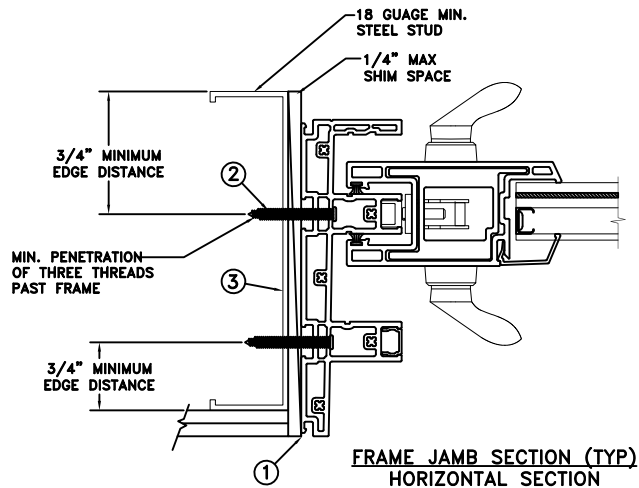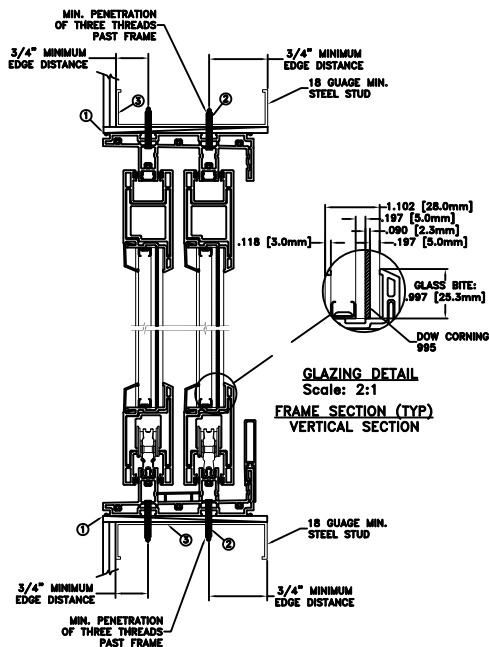

Max Frame	DP	IMPACT
71 3/4 x 79 13/16	+65/-70	YES

Installation Notes:

- Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
- For anchoring into metal framing use #10 TEK Self-Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness at head/sill through both towers. Steel substrate min. 18ga., fy = 33 ksi.
- Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
- All glazing shall conform to ASTM E1300.
- At minimum, glazing is 3.0mm tempered - 12.7mm airspace - 5.0mm annealed - 2.3mm SGP Interlayer by Dupont - 5.0mm annealed insulating glass.
- Use structural or composite shims where required.


This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.



DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

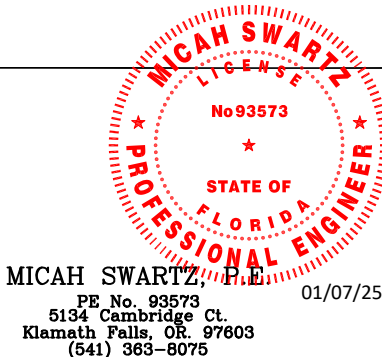


DATE:	12/12/2024	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936
DRAWN BY:	M.HAM	
CHECKED BY:	J.GOOSEN	Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel XX
APPROVED BY:	J.GOOSEN	
RECORD No.:	D014758	
IDENTIFIER No.	NCTL-210-4150-02	CAD DWG, No.:
		REV: C
		SHEET 4 of 4

- NOTES:
- 1. ANCHOR PATTERN LOCATED IN TRACK 1 SHIFT AS DETAILED
 - 1. HOLES TO BE OMITTED IF ON CENTER CALCUATIONS FALL WITHIN 2" OF KEEPER LOCATION
 - 2. ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS IN JAMB
 - 3. NAIL FIN INSTALLATION

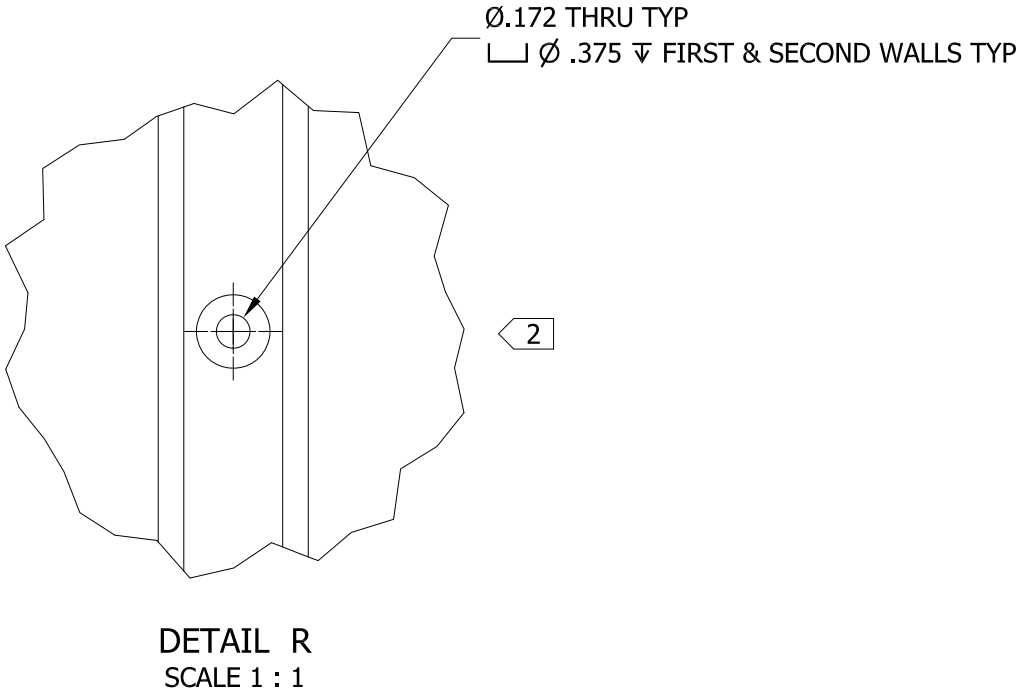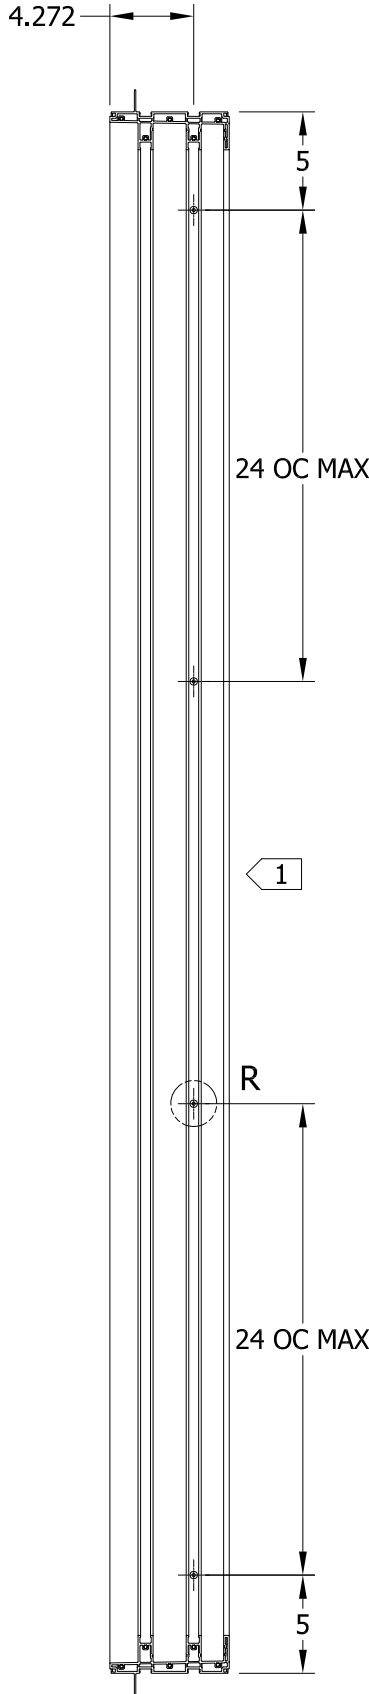

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR 97603
(541) 363-8075

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS		PROJECT ENGINEER: N HERTZOG	DATE: 9/11/2015	 3737 Lakeport Blvd. Klamath Falls, OR 97601 Phone: (541) 882-3451	
TOLERANCES (UNLESS SPECIFIED OTHERWISE) COMPONENT / PART TOLERANCES		DRAWN BY: A BURWELL	SCALE: 1 : 10		
UNDER 10'-0" ± 1/32 .X ± .1 OVER 10'-0" ± 1/16 .XX ± .02 ANGULAR ± 1° .XXX ± .006		CHECKED BY: J JONES	TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR JAMB ANCHOR HOLES DETAIL		
		APPROVED BY: J JONES			
UNIT ASSEMBLY TOLERANCES HEIGHT ± 1/16 WIDTH ± 1/16 MULLION ± 1/16 FRACTION ± 1/32		IDENTIFIER No.	MODEL No.: P012967-198.ipt	DRAWING No.: P012967	
© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED.NO DUPLICATION OR DISTRIBUTION PERMITTED.JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.				REV: B	SHEET


- NOTES:
- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
 - 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
 - 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER AT EACH INTERLOCK AREA
 - 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
 - 5 TYP 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
 - 6 CONFIGURATION FOR PG35/50 DOORS WITH NAIL FIN INSTALL

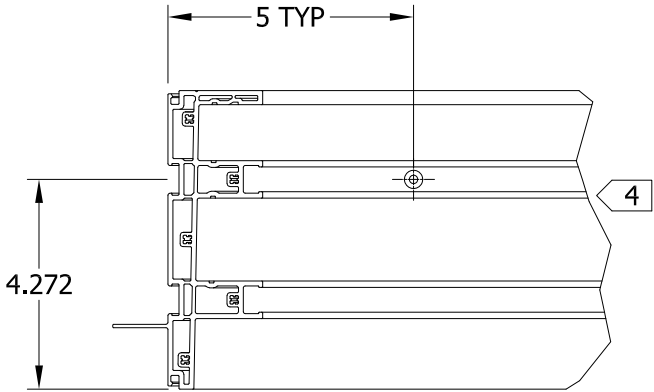


EXT ↓
DETAIL W
SCALE 1 / 4

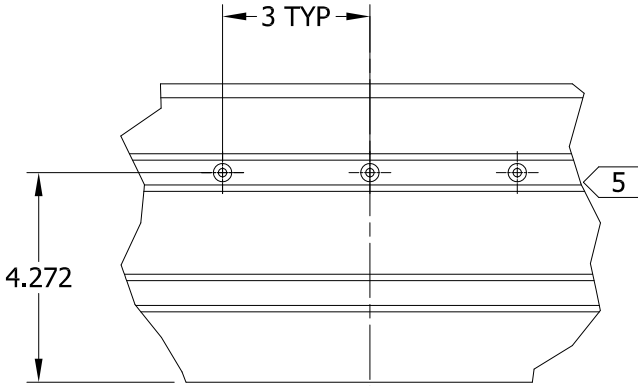


EXT ↓
DETAIL X
SCALE 1 / 4
PATTERN, SYM

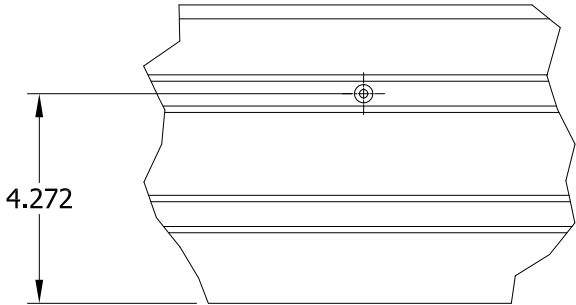

EXT ↓
DETAIL Y
SCALE 1 / 4

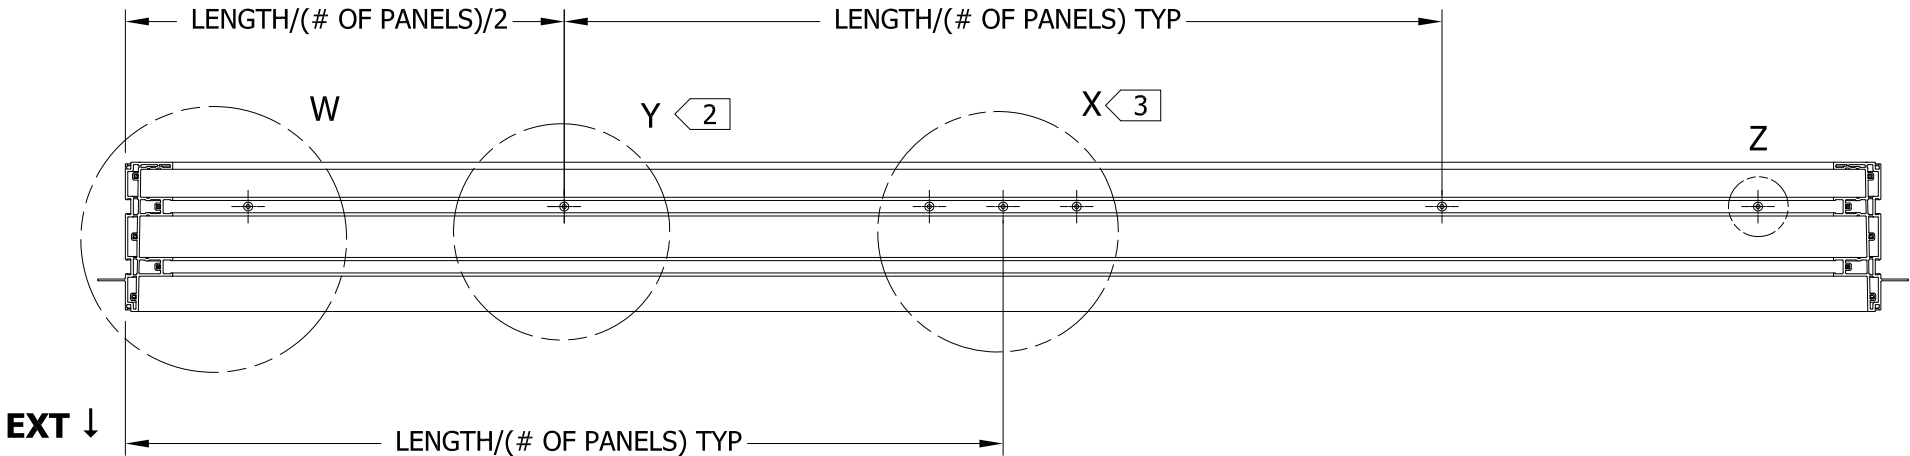

EXT ↓

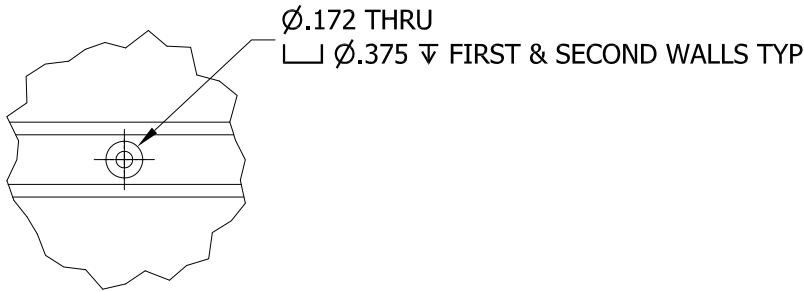


DETAIL Z TYPICAL HOLE
SCALE 1 / 2

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

MICAH SWARTZ, P.E.
01/07/25
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS		PROJECT ENGINEER: N HERTZOG	DATE: 9/11/2015	JELD-WEN WINDOWS & DOORS 3737 Lakeport Blvd. Klamath Falls, OR 97601 Phone: (541) 882-3451	
TOLERANCES (UNLESS SPECIFIED OTHERWISE) COMPONENT / PART TOLERANCES UNDER 10'-0" ± 1/32 .X ± .1 OVER 10'-0" ± 1/16 .XX ± .02 ANGULAR ± 1° .XXX ± .006		DRAWN BY: A BURWELL	SCALE: AS SHOWN		
UNIT ASSEMBLY TOLERANCES HEIGHT ± 1/16 WIDTH ± 1/16 MULLION ± 1/16 FRACTION ± 1/32		CHECKED BY: J JONES	TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR SILL AND HEAD ANCHOR HOLES DETAIL	MODEL No.: P012967-394.ipt	DRAWING No.: P012967
		APPROVED BY: J JONES	IDENTIFIER No.	© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED.NO DUPLICATION OR DISTRIBUTION PERMITTED.JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.	REV: B SHEET

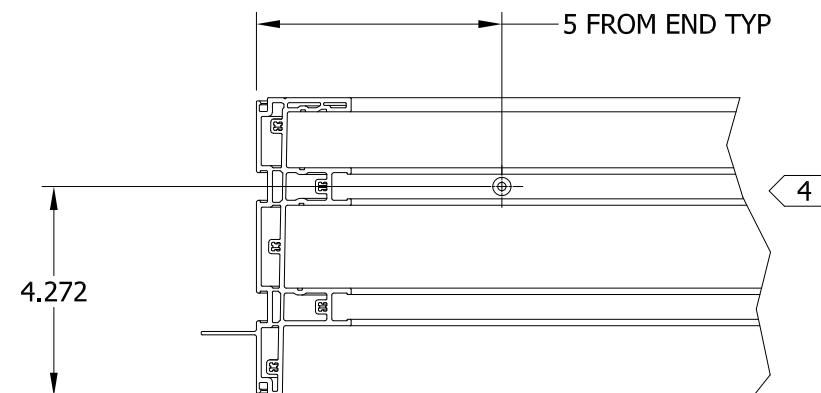


EXT ↓ **DETAIL AA**
SCALE 1 / 4

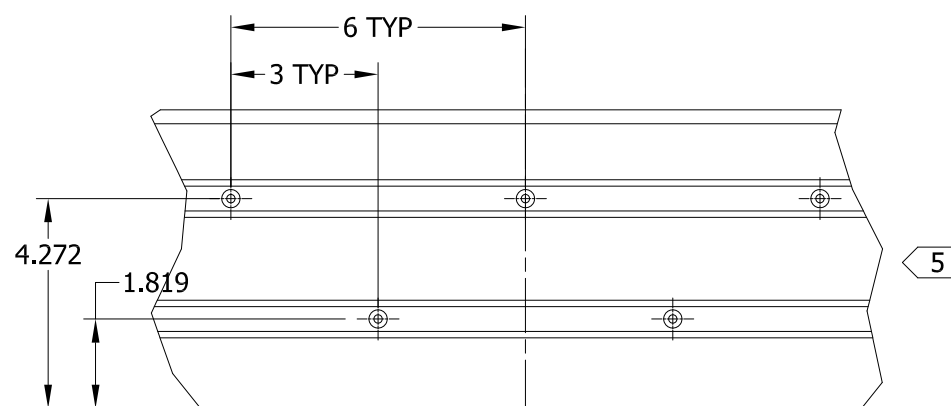


¢ PATTERN, SYM

EXT ↓ **DETAIL AB**
SCALE 1 / 4

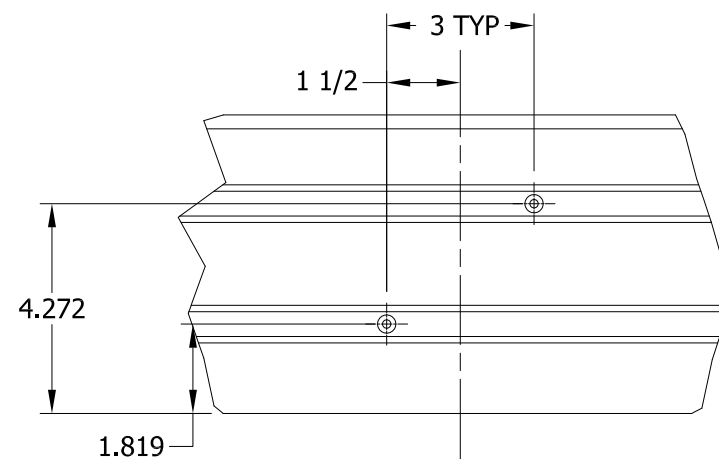


⌘ PATTERN

EXT ↓ DETAIL AC
SCALE 1 / 4

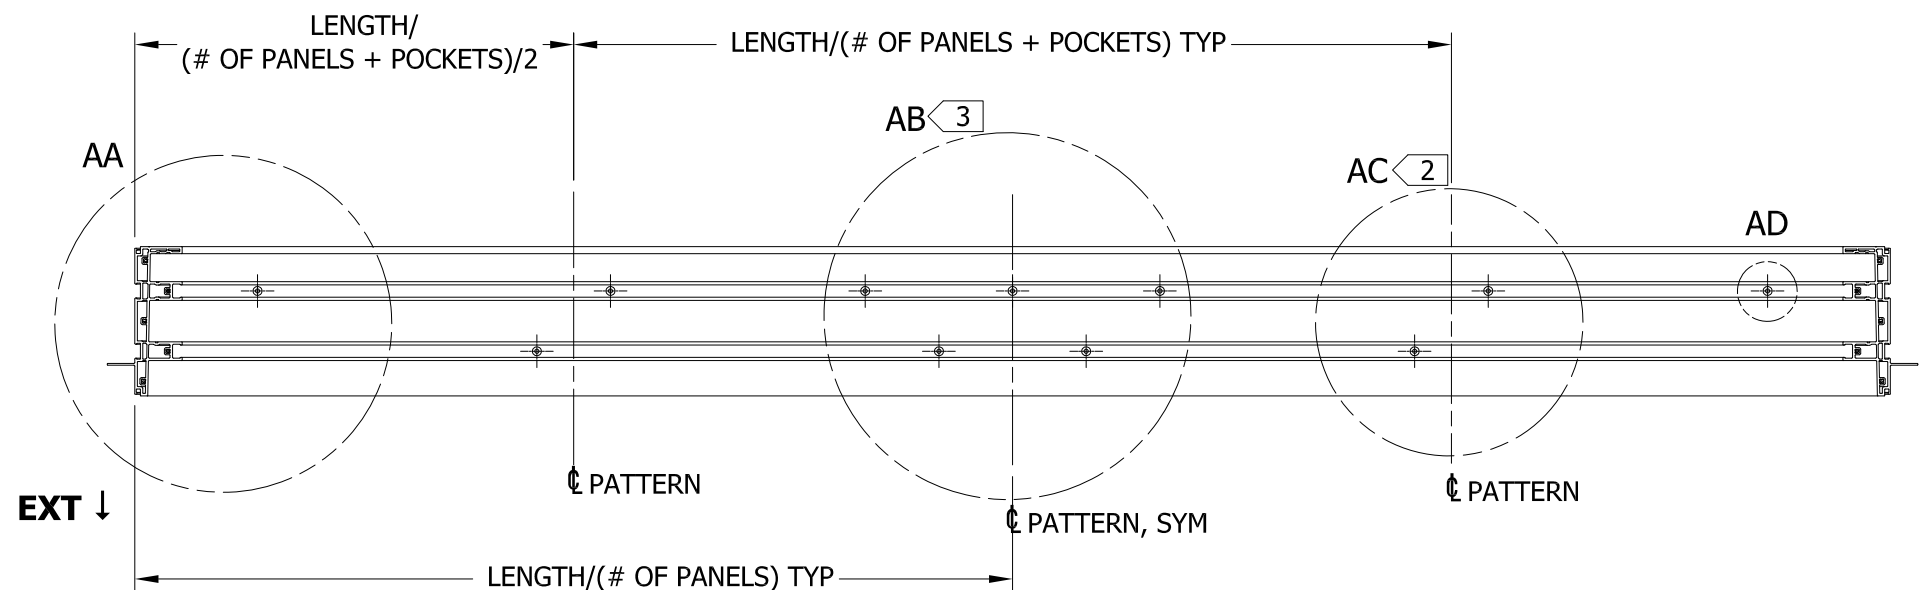


Ø.172 THRU TYP
 □ Ø.375 ▽ FIRST & SECOND WALLS TYP

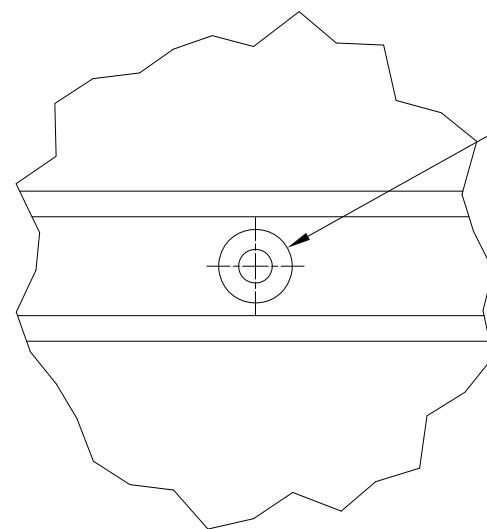

DETAIL AD TYPICAL HOLE
SCALE 1 / 1

This item has been digitally signed
and sealed by Micah Swartz, P.E.
on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies



MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075

NOTES:

- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 5 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG65 DOORS WITH THRU FRAME INSTALL

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS		PROJECT ENGINEER: N HERTZOG		DATE: 9/11/2015				3737 Lakeport Blvd. Klamath Falls, OR 97601 Phone: (541) 882-3451			
TOLERANCES (UNLESS SPECIFIED OTHERWISE) COMPONENT / PART TOLERANCES		DRAWN BY: A BURWELL		SCALE: AS SHOWN							
UNDER 10'-0" ± 1/32 .X ± .1 OVER 10'-0" ± 1/16 .XX ± .02 ANGULAR ± 1° .XXX ± .006		CHECKED BY: J JONES		TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR  SILL AND HEAD ANCHOR HOLES DETAIL							
		APPROVED BY: J JONES									
UNIT ASSEMBLY TOLERANCES HEIGHT ± 1/16 WIDTH ± 1/16 MULLION ± 1/16 FRACTION ± 1/32		IDENTIFIER No.		MODEL No.: P012967-397.ipt		DRAWING No.: P012967					
				© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED.NO DUPLICATION OR DISTRIBUTION PERMITTED.JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.				REV: B		SHEET	