

GENERAL NOTES:

- 1- CODE: THIS PRODUCT HAS BEEN TESTED AND DESIGNED IN ACCORDANCE WITH THE 7TH EDITION FBC (2020)/ 8TH EDITION FBC (2023) INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2- DEFINITION: THIS PRODUCT IS A FIXED TYPE WINDOW DESIGNED, CONSTRUCTED AND TESTED TO PROVIDE PROTECTION FROM HURRICANE FORCE WINDS AND WIND BORNE DEBRIS (SMALL MISSILE) WITHIN THE ALLOWABLE DESIGNED PRESSURES AND LIMITATIONS STATED IN THIS APPROVAL. INSTALLATION BELOW 30 FEET ELEVATION IT WILL REQUIRE APPROVED HURRICANE PROTECTION DEVICES.
- 3- DESIGN LOADS: THE DESIGNED LOADS MUST BE CALCULATED BY A PROFESSIONAL ARCHITECT OR ENGINEER FOR EACH SPECIFIC PROJECT. THE CALCULATED DESIGNED PRESSURE MUST NOT EXCEED THE ALLOWABLE WINDOW PRESSURE.
- 4- MATERIAL: GLAZING TO BE IMPACT LAMINATED GLASS AS SPECIFIED ON THIS APPROVAL.
- 5- FASTENERS: ASSEMBLY SCREWS AND ANCHORS SHALL BE AS SPECIFIED IN THE CURRENT SET OF DRAWINGS. INSTALLATION AND LOADS AS PER THIS APPROVAL. ANCHOR QUANTITY & SPACING MUST NOT EXCEED THE MAXIMUM LIMITS SPECIFIED BY THIS APPROVAL.
- 6- USE: IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, ARCHITECT OR ENGINEER OF RECORD TO VERIFY THE FOLLOWING:
- 6.1- THE STABILITY OF THE STRUCTURE WHERE THE PRODUCT IS TO BE ATTACHED INSURING PROPER ANCHORAGE.
- 6.2- THE SITE SPECIFIC PROJECT CRITERIA, SUCH AS BUT NOT LIMITED TO, LOCAL CODE REQUIREMENTS, DESIGNED PRESSURES ETC.
- 6.3- THAT THIS APPROVAL IS ADEQUATE TO THE SPECIFIC PROJECT.
- 7- 33 1/3% INCREASE IN ALLOWABLE LOADS HAVE NOT BEEN USED IN THE DESIGN OF THE ANCHORS FOR THIS PRODUCT APPROVAL, HOWEVER, WOOD SCREWS WITH 1.6 INCREASE FOR WIND LOAD DURATION HAVE BEEN USED.
- 8- DISSIMILAR MATERIALS: MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL, THAT COME IN CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 7TH EDITION FBC (2020)/ 8TH EDITION FBC (2023).
- 9-MANUFACTURER’S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE LABELING TO COMPLY WITH SECTION 1709.9.2.

FOR ALLOWABLE SIZES AND PRESSURES REFER TO:
SHEET 2

PRODUCT NOT TO BE INSTALLED BELOW 30 FEET ELEVATION
WITHOUT HURRICANE PROTECTION DEVICES


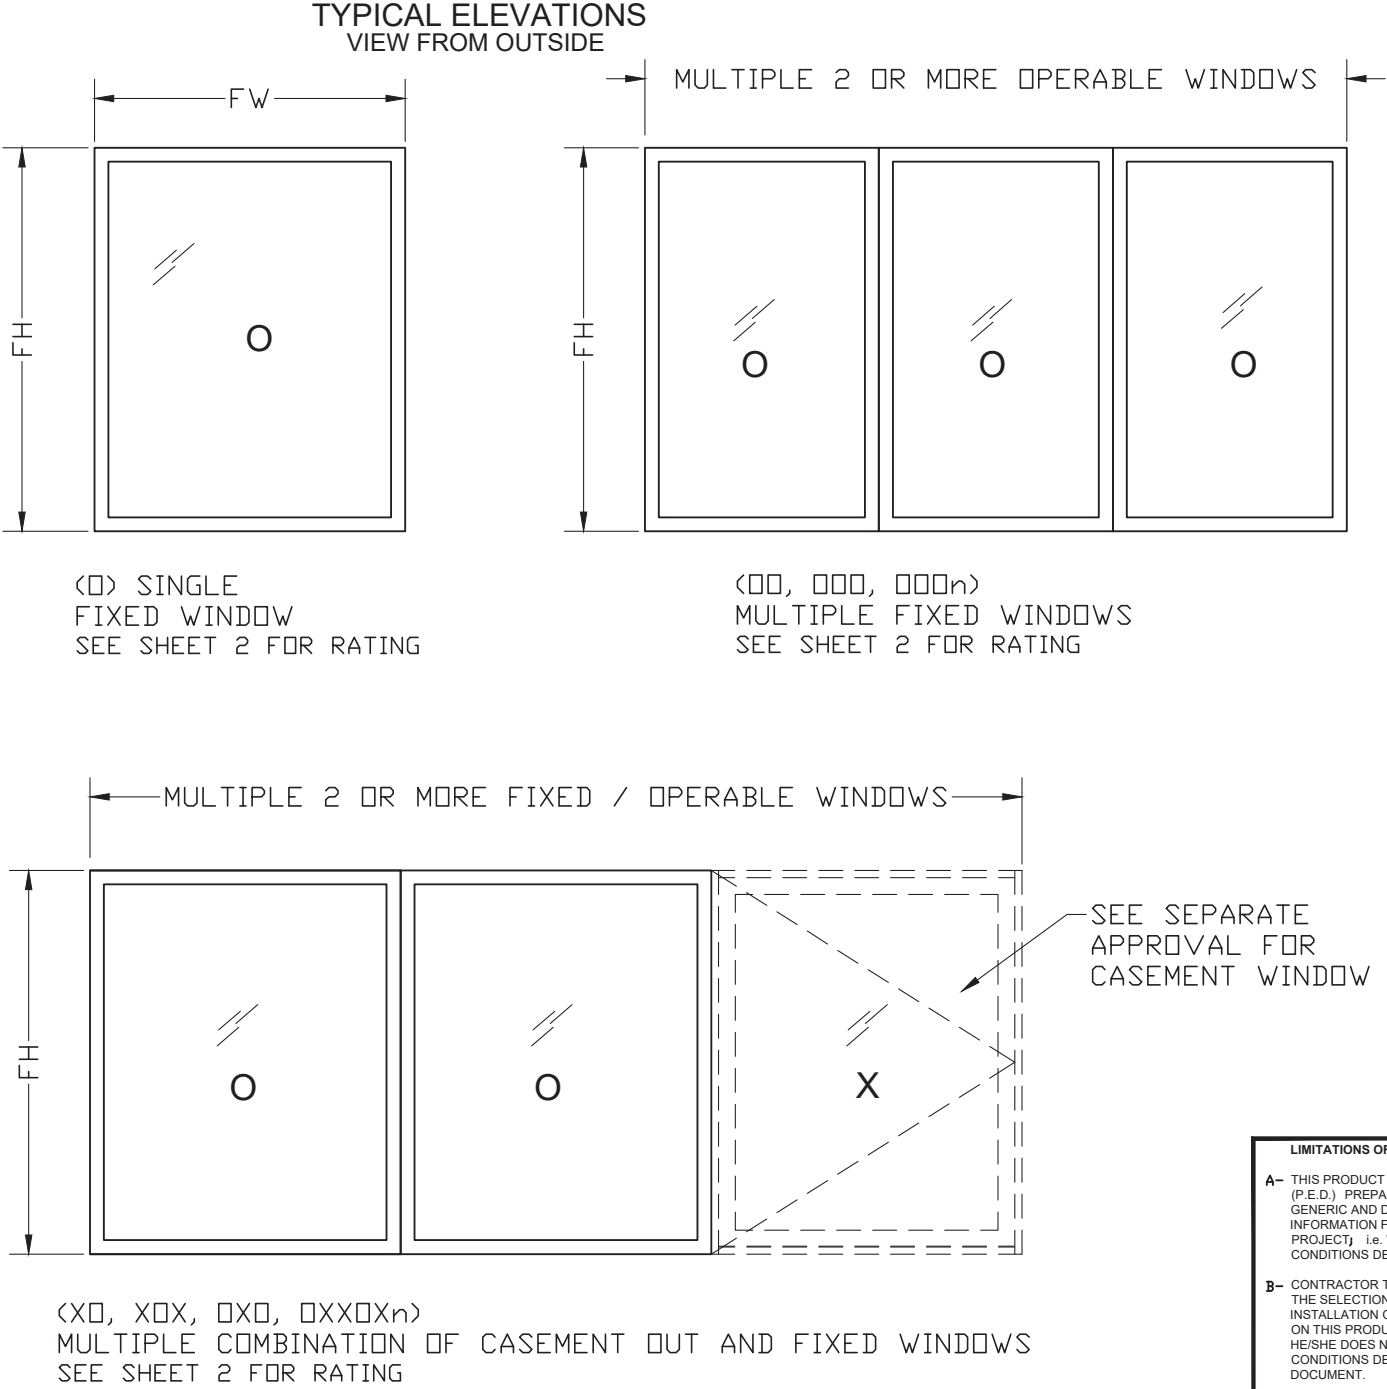


TABLE OF CONTENTS:

SHEET	DESCRIPTION
1 of 7	GENERAL NOTES, INDEX AND TYPICAL ELEVATIONS
2 of 7	TABLE 1 & 2 DESIGN RATING FOR SINGLE AND MULTIPLES UNITS
3 of 7	TYPICAL DETAILS
4 of 7	ANCHORAGE LAY-OUT WITH STRAPS
5 of 7	ANCHORAGE LAY-OUT WITH SHEAR CLIP
6 of 7	WINDOW COMPONENTS AND BILL OF MATERIAL
7 of 7	GLAZING DETAILS & CORNER ASSEMBLY

LIMITATIONS OF USE			
A-	THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT) i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.		
B-	CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.		
C-	THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.		
D-	SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D.		
E-	THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.		

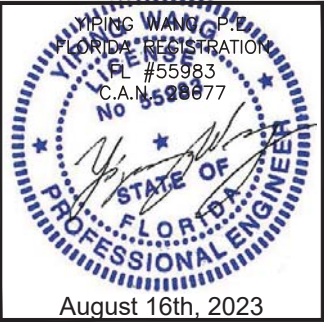

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 Miramar Pkwy. Ste. 301
Miramar, FL 33027
P: 305.271.0117
www.MCYEngineering.com mcy@mcyengineering.com


NRAP SERIES 2500 FIXED WINDOW (S.M.I.)
NR ARCHITECTURAL PRODUCTS
4348 WESTROADS DRIVE
WEST PALM BEACH, FL 33407
TEL: (561) 844-1121 FAX: (561) 844-6131

Drawn Date	08.11.2023	Scale	AS NOTED
Drawn By	James	Date	08.11.2023
Rev. No.	R2	Description	FBC 2023
DRAFTING NO. AD17-11			
FLORIDA APPROVAL FL #22026.2			
Sheet No. 01 OF 07			

TABLE 1
DESIGNED RATING FOR
SINGLE FIXED UNITS (PSF)

MAX. FRAME		PRESSURES	
WIDTH (FW)	HEIGHT (FH)	EXT (+)	INT (-)
24	96	120	
32	72	120	
38.75	60	120	
44	52	120	
48	48	120	
52	44	120	
60	38.75	120	
72	32	120	
96	24	120	

* FRAME WIDTH AND HEIGHT
IN INCHES
* PRESSURES IN PSF
* WINDOW AREA MUST NOT
EXCEED 16.15 SQFT
DL0=FW-4.375 OR FH-4.375

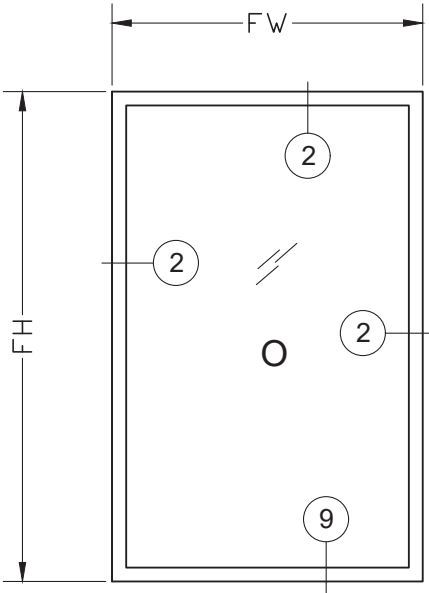


(O) SINGLE
FIXED WINDOW

TABLE 2
DESIGNED RATING FOR MULLIONS
ON MULTIPLE FIXED OR/AND
FIXED/CASEMENT UNITS (PSF)


TM	FH	MULL TYPE 6/ 8/ 10/ 10A EXT(+) INT(-)
24	60	120
32	60	120
38.75	60	120
44	52	120
48	48	120
54	43	120
60	39	120
66	35	120
72	32	120

TM- MAXIMUM TRIBUTARY
MODULE WIDTH IN INCHES
FH- MAXIMUM FINISHED HEIGHT
IN INCHES
PRESSURES IN PSF
DL0=FW-4.375 OR FH-4.375

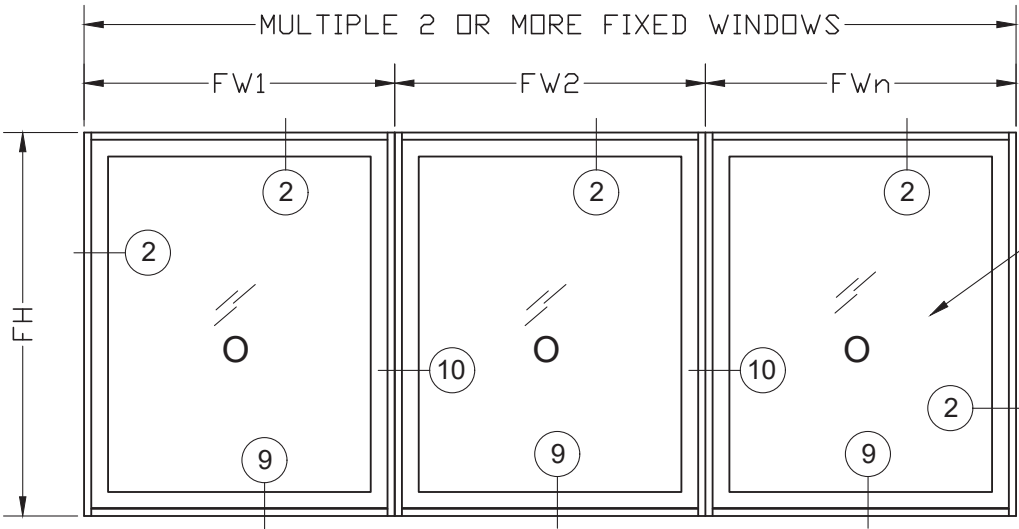






$TM = (FW1 + FW2) / 2$

ALLOWABLE PRESSURE
BASED ON THE MIN.
PRESSURE FROM
TABLE 1 & 2





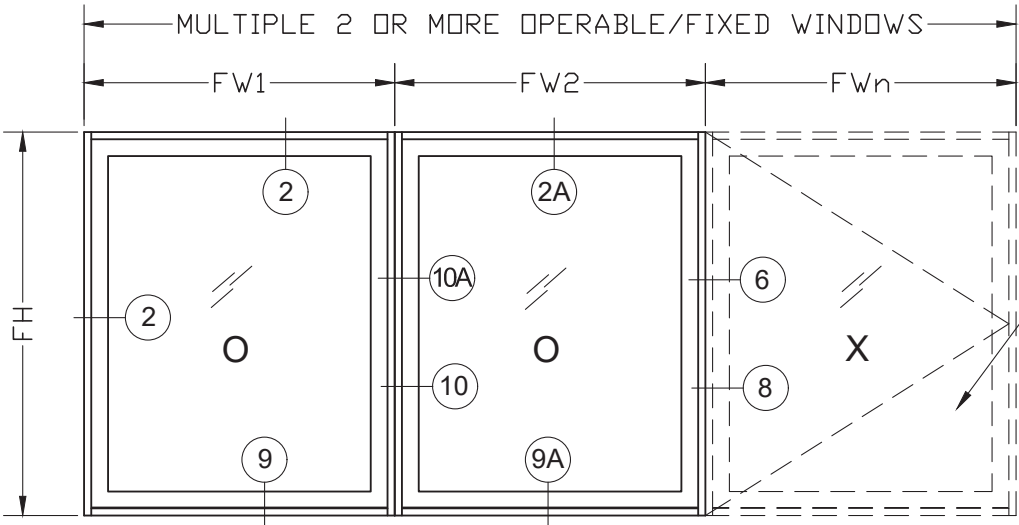


$TM = (FW1 + FW2) / 2$

ALLOWABLE PRESSURE
BASED ON THE MIN.
PRESSURE FROM
TABLE 1, 2 AND
CASEMENT WINDOW
APPROVAL.

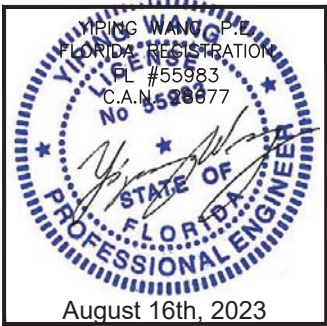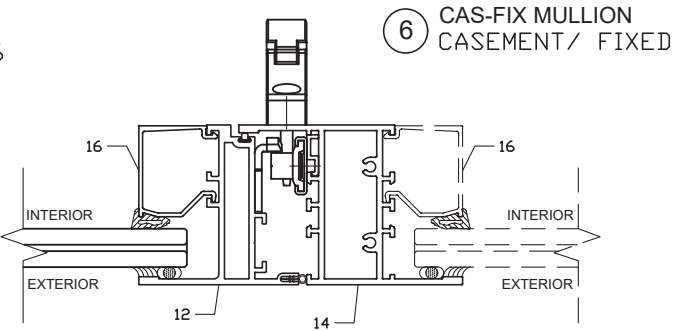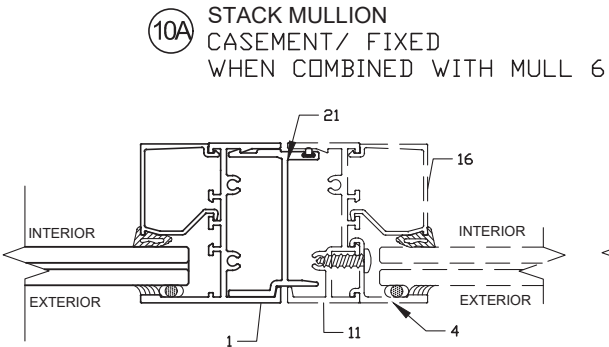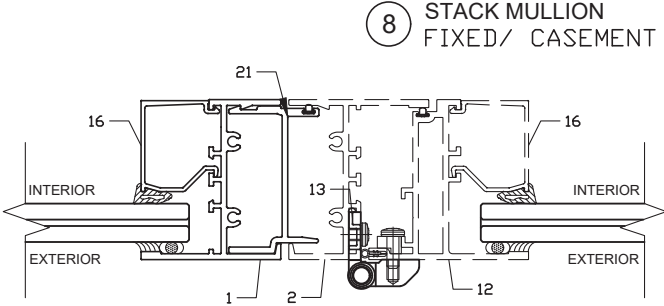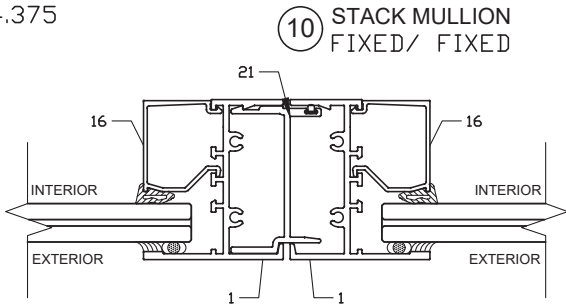

TYPICAL DETAILS

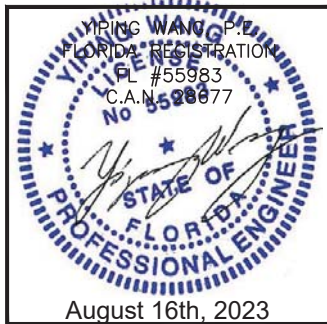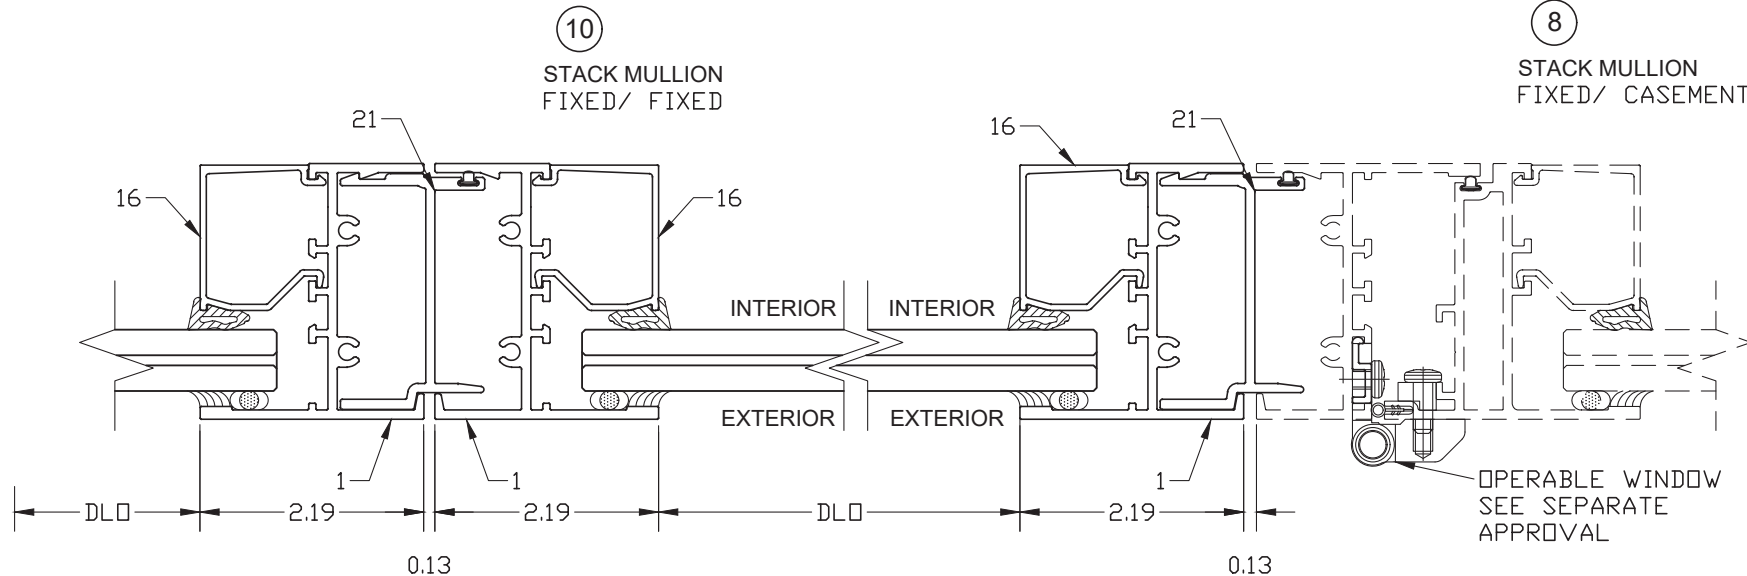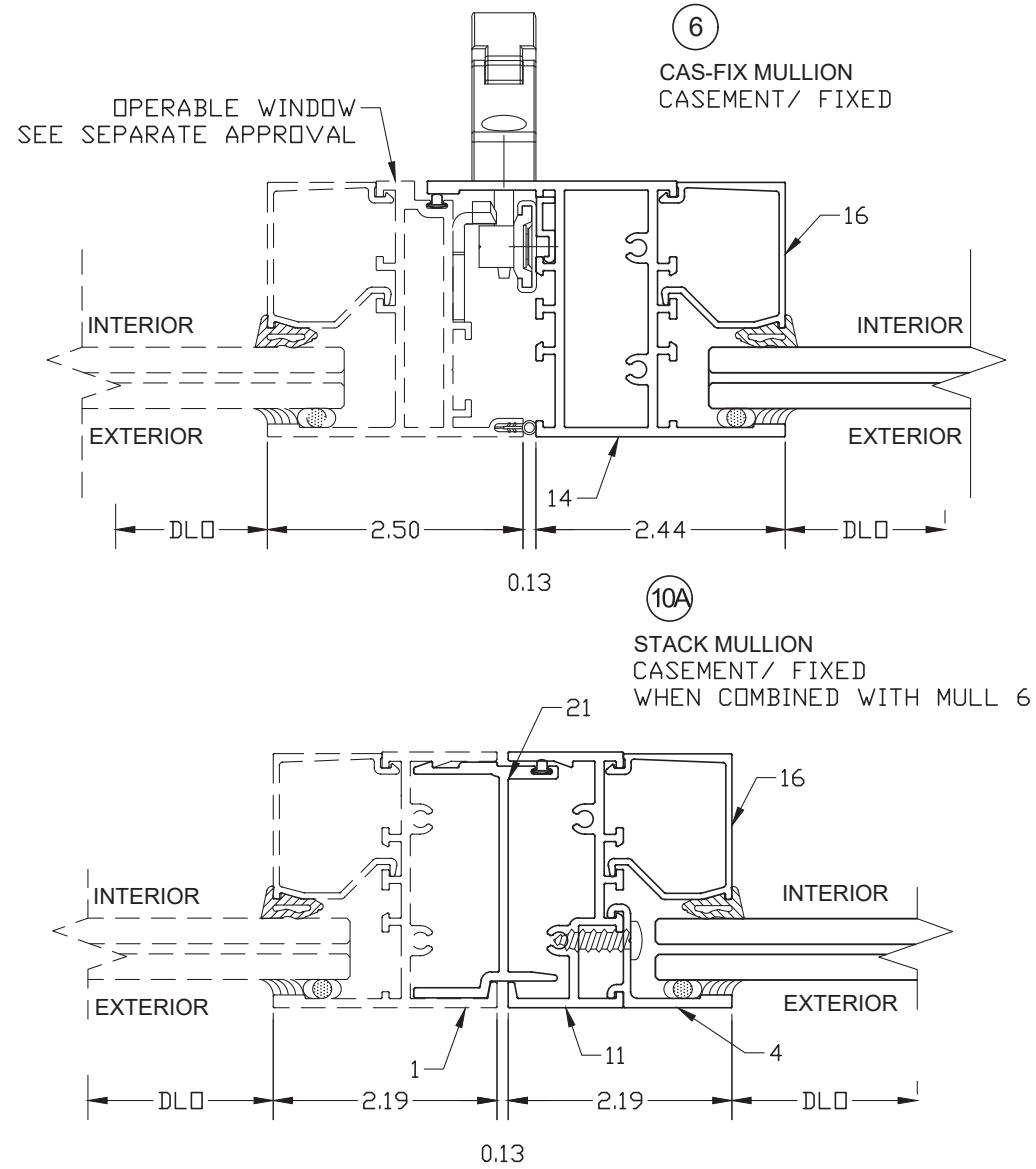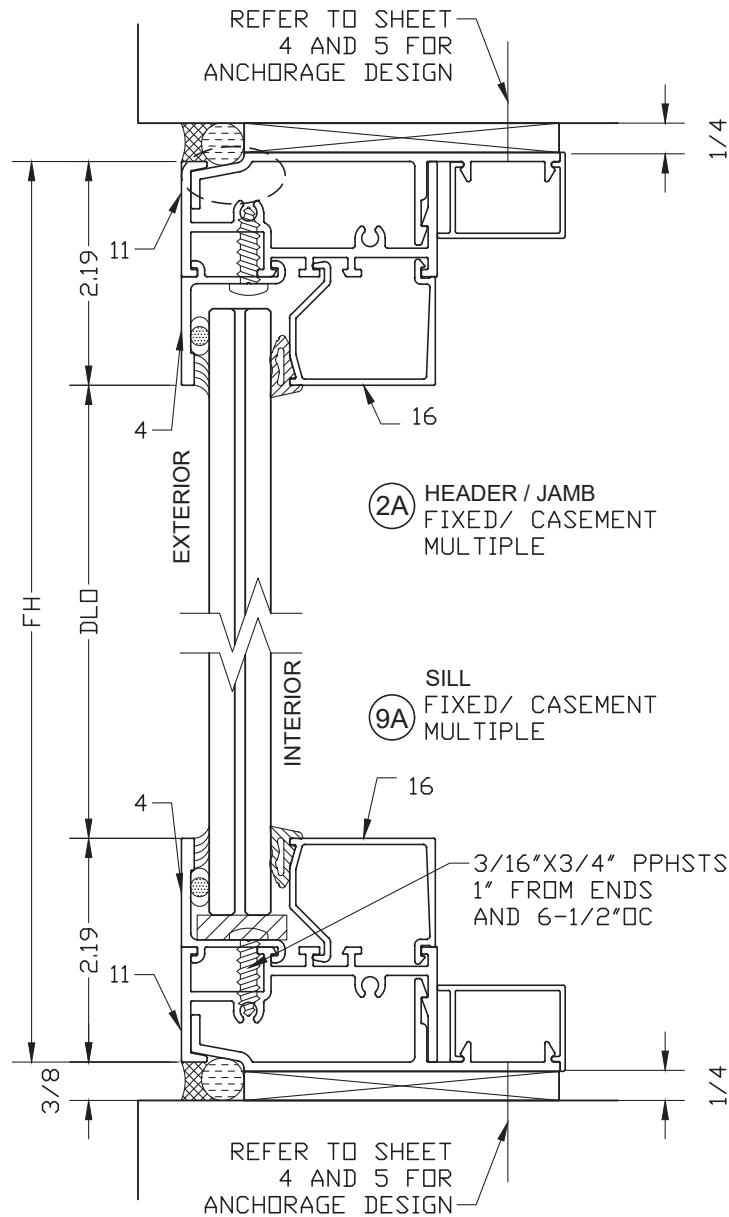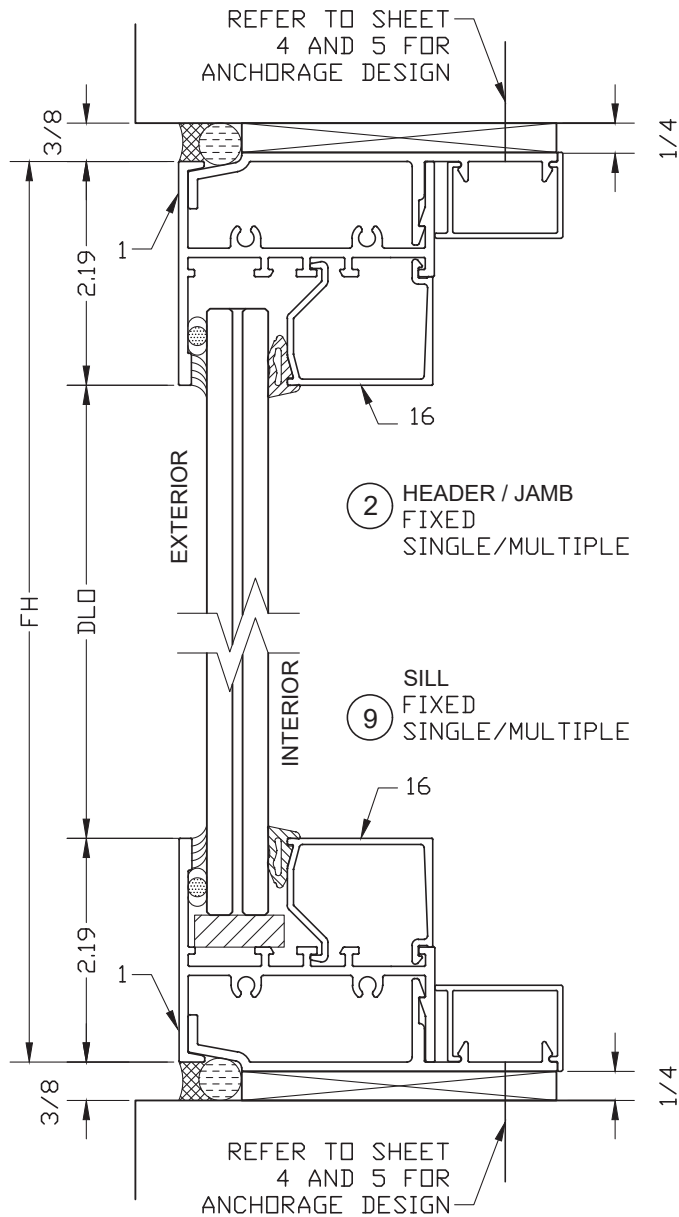

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

12781 Miramar Pkwy. Ste. 301

Miramar, FL 33027

www.MCYEngineering.com mcy@mcengineering.com

NRAP SERIES 2500 FIXED WINDOW (S.M.I.)

NR ARCHITECTURAL PRODUCTS

4348 WESTROADS DRIVE

WEST PALM BEACH, FL 33407

TEL: (561) 844-1121 FAX: (561) 844-6131


R2	08.11.2023	James	FBC 2023
Rev. No.	Date	Drawn By	Description

Drawn Date 08.11.2023	Scale AS NOTED
--------------------------	-------------------

DRAWING NO.
AD17-11

FLORIDA APPROVAL
FL #22026.2

Sheet No.
03 OF 07

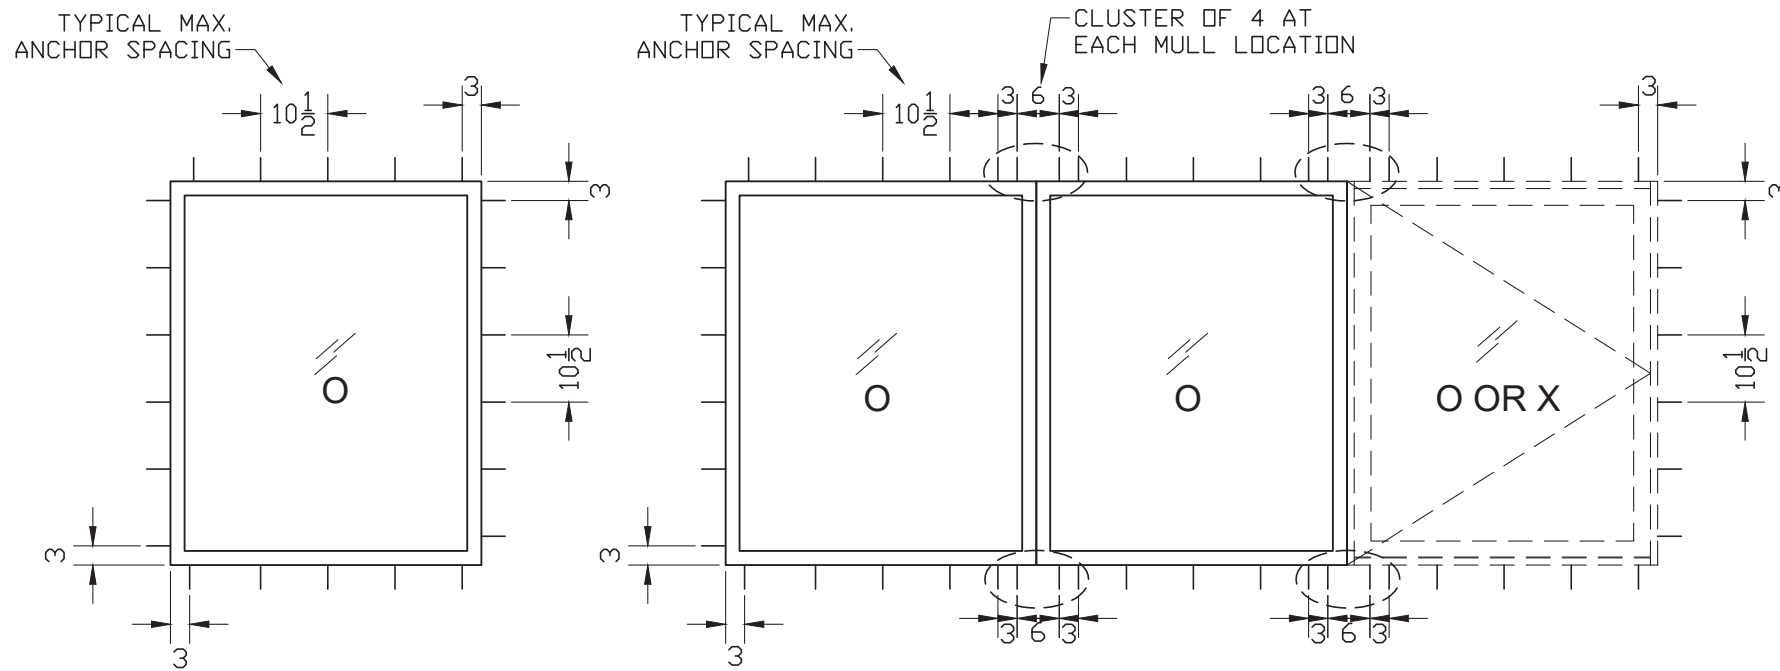


TYPICAL ANCHORS: (SEE ELEVATION FOR SPACING)


TYPE "A": 1/4" TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
 1/4" ULTRACON BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 1-1/2" MIN. EMBED INTO WOOD STRUCTURES (SG=0.55 MIN.)
 OR THRU WOOD BUCK WITH 1-1/4" EMBED INTO
 MASONRY/CONCRETE

1/4" TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
 1/4" ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 1-1/4" EMBED INTO MASONRY/CONCRETE

TYPE "B": 1/4" DIA. TEKS/SELF-DRILLING SCREW, GRADE 5
 (Fu=100 KSI, Fy=65 KSI)
 INTO METAL STRUCTURES
 STEEL: 1/8" THK. MIN. (Fy=36 KSI)
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)




MIN. EDGE DISTANCE:
 INTO CONCRETE = 2-1/2" MIN.
 INTO WOOD = 1" MIN.
 INTO METAL = 3/4" MIN.

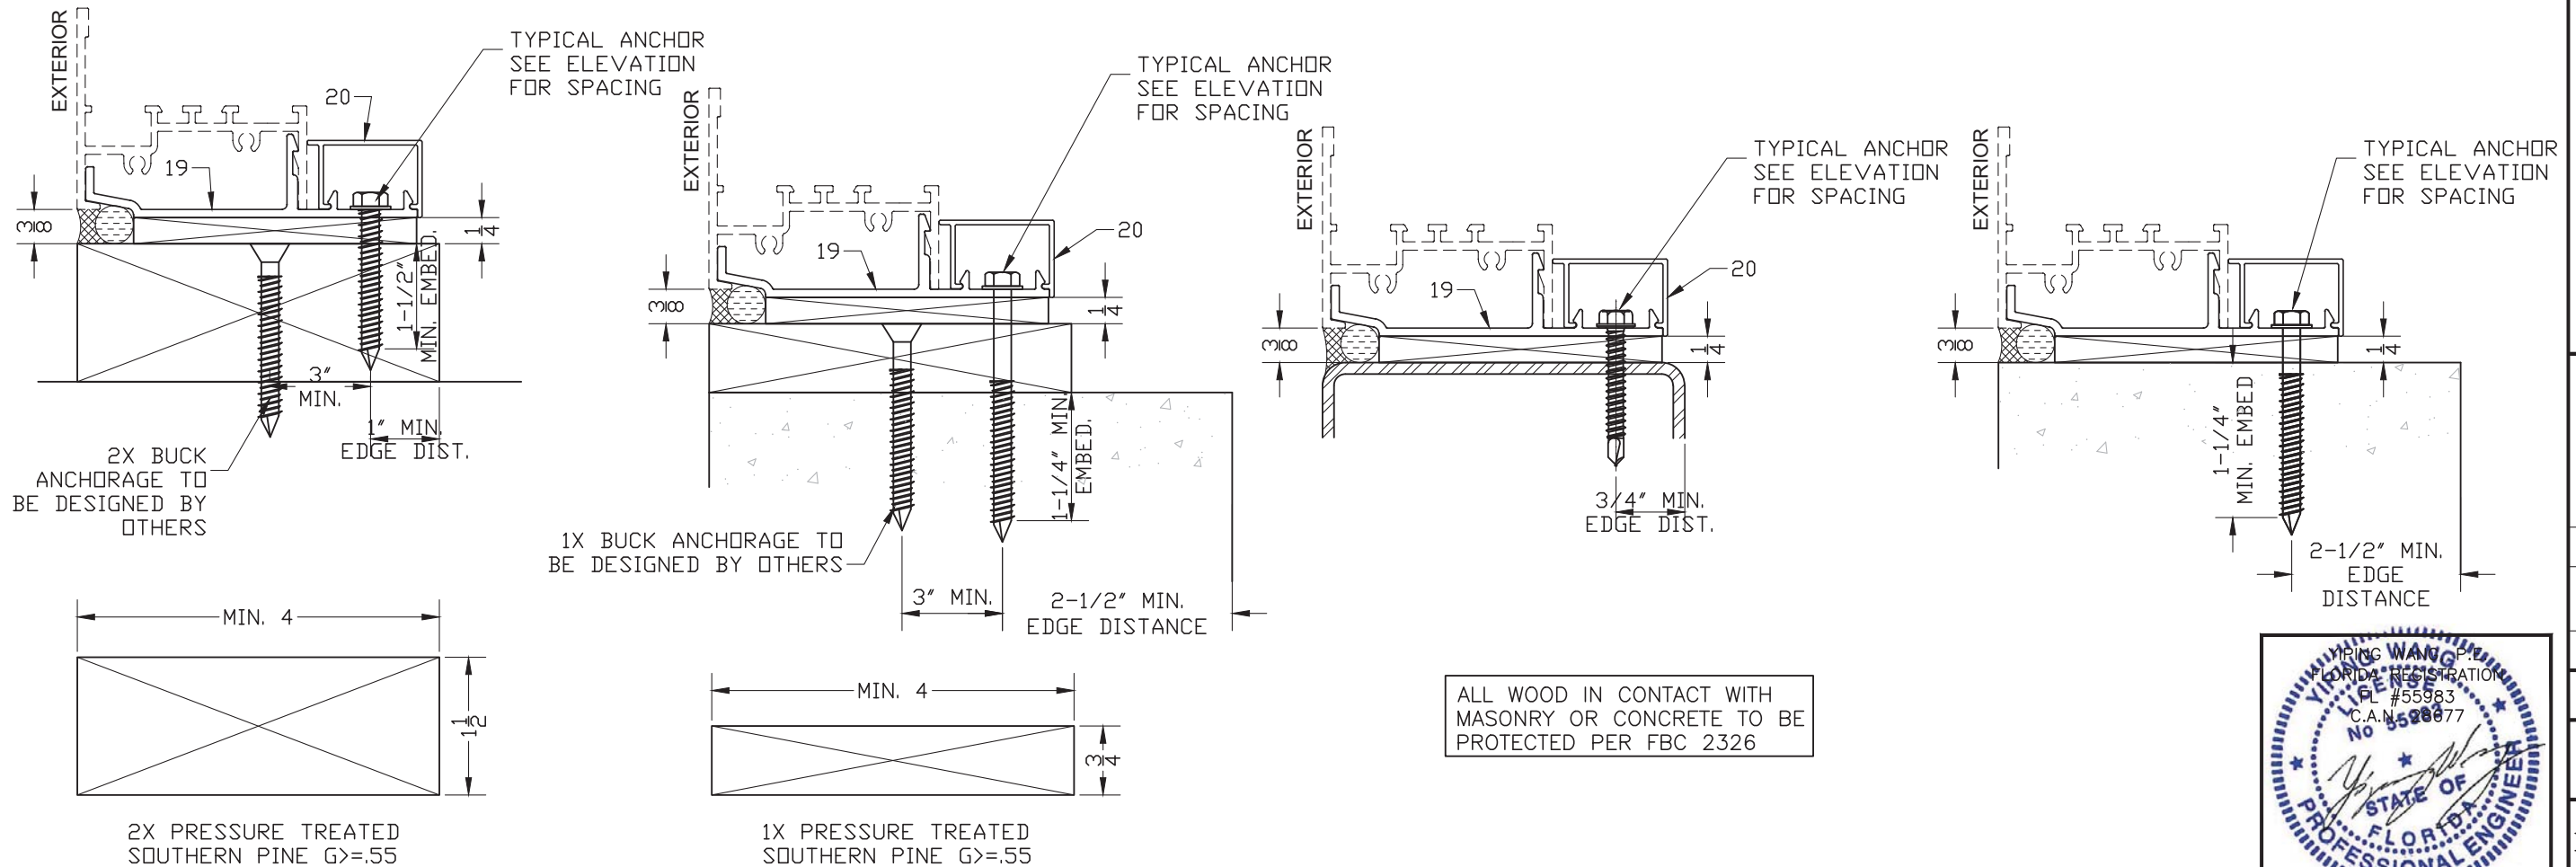

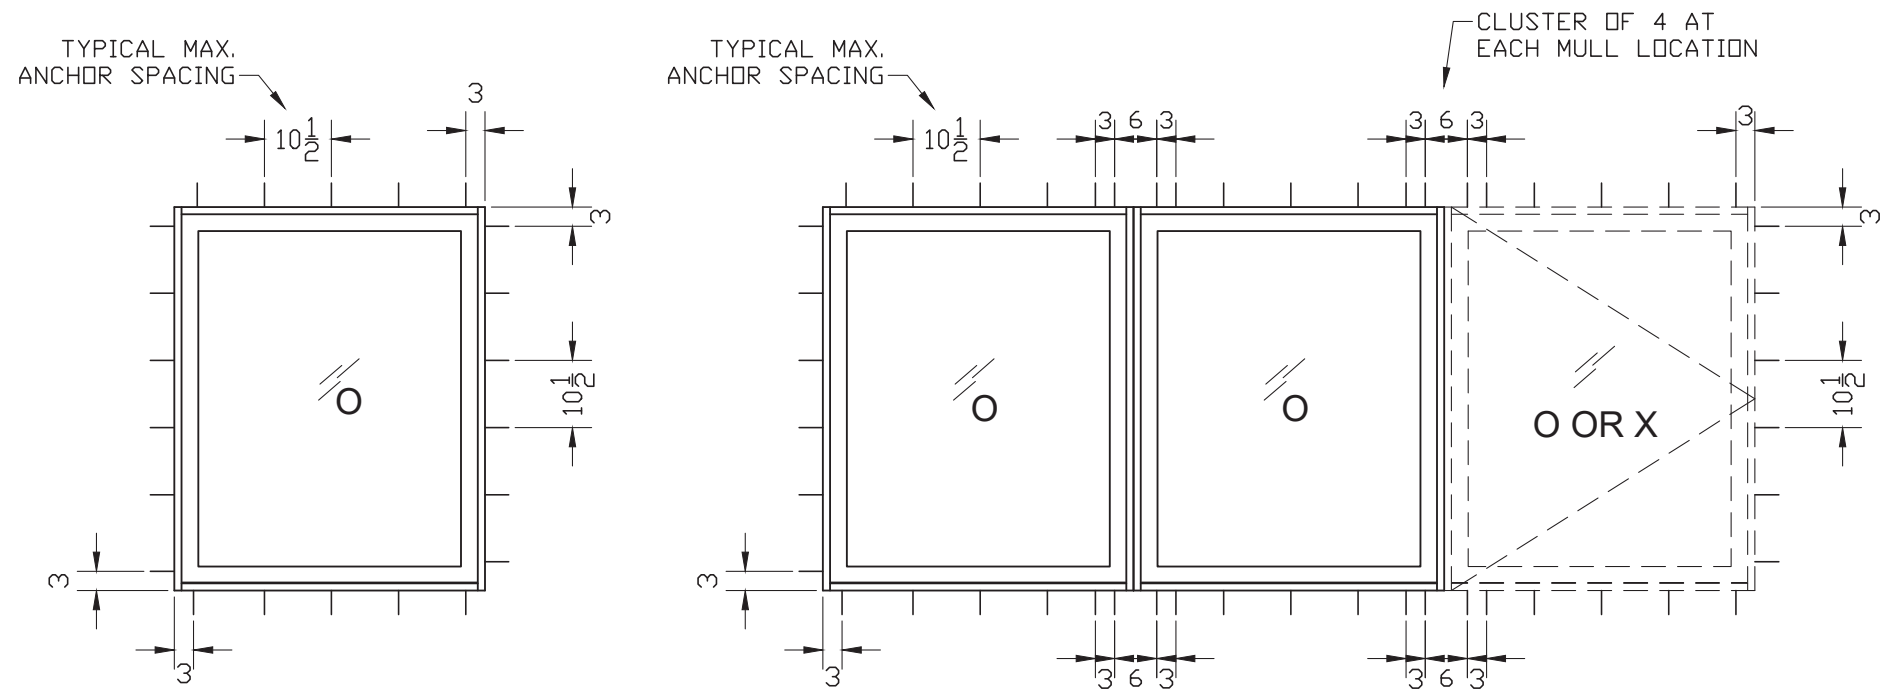


ANCHORAGE LAY-OUT WITH SHEAR CLIP

FOR ANCHOR TYPES, SEE SHEET 4

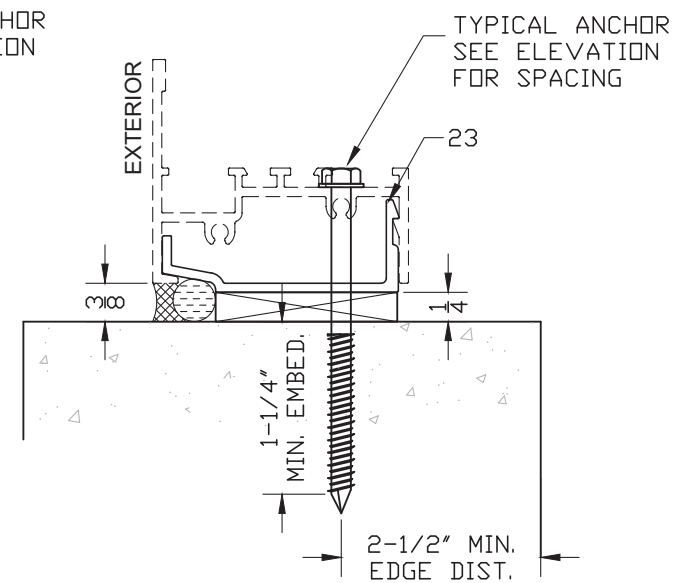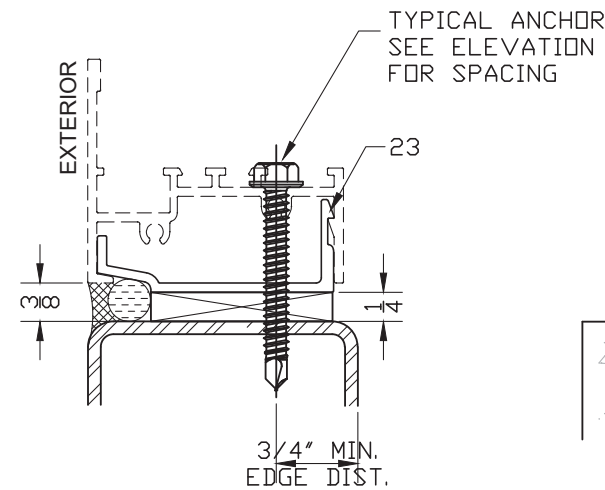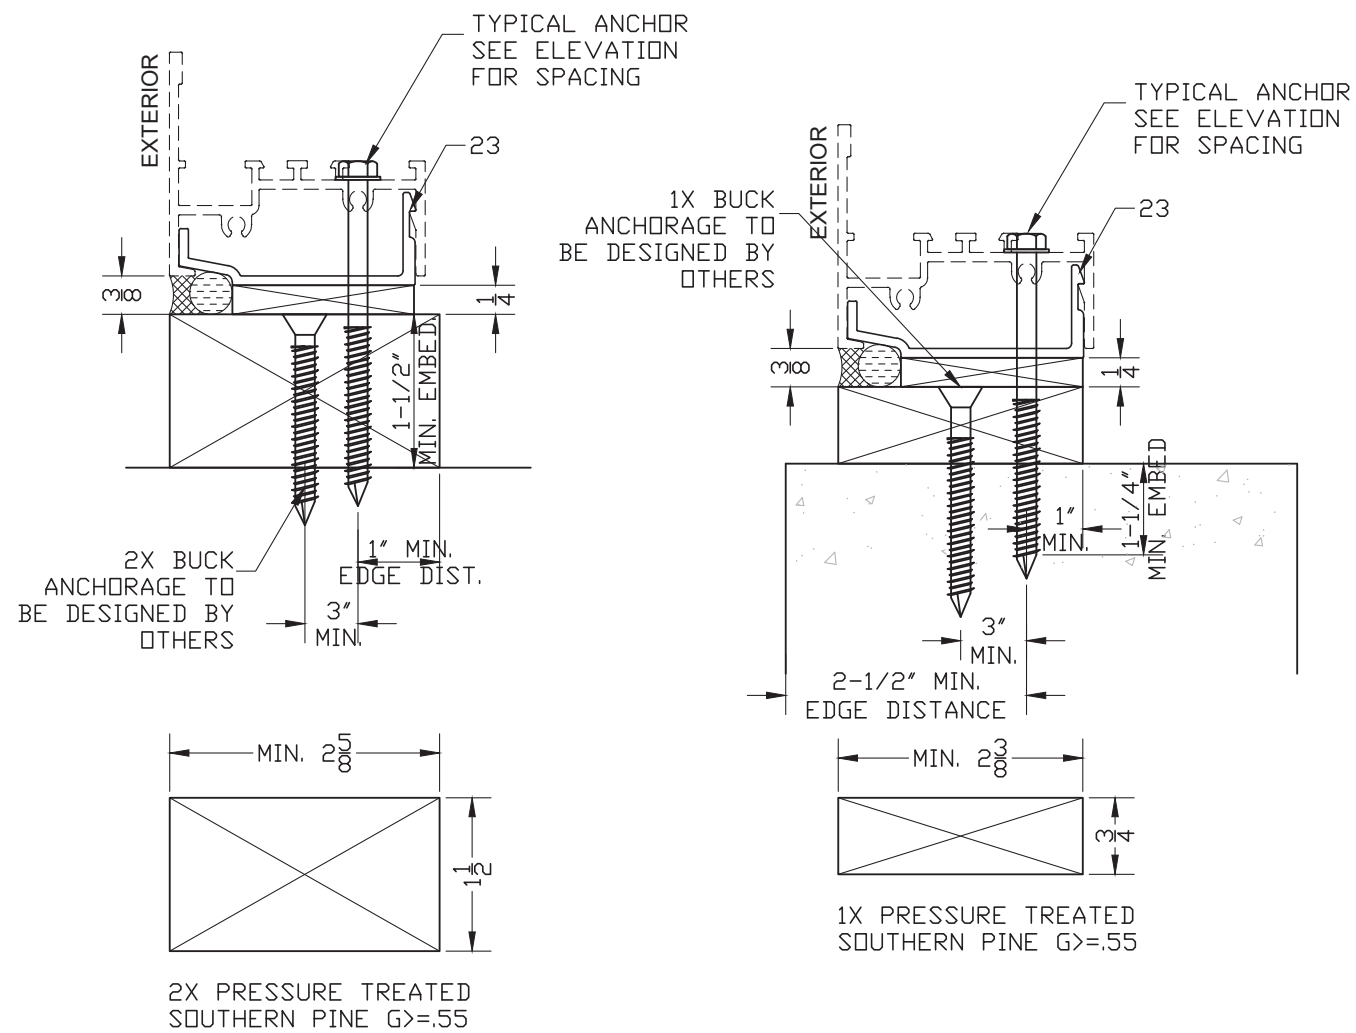

ALL WOOD IN CONTACT WITH MASONRY OR CONCRETE TO BE PROTECTED PER FBC 2326












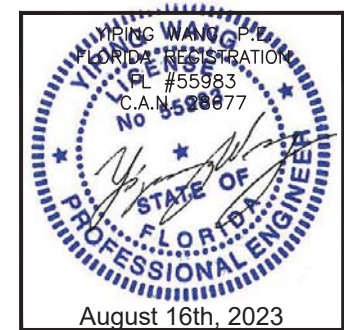


Rev. No.	Date	Drawn By	Description
R2	08.11.2023	James	FBC 2023
Drawn Date	08.11.2023	Scale	AS NOTED
DRAWING NO.			
AD17-11			
FLORIDA APPROVAL			
FL #22026.2			
Sheet No.			
05 OF 07			

WINDOW COMPONENTS

COMPONENTS LIST

ITEM	PART#	DESCRIPTION	MATERIAL	SUPPLIER
1	PC-001	HEAD BASE FRAME (FIXED)	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
4	PC-004	BASE FRAME ADAPTOR	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
11	PC-011	SILL BASE FRAME (FIXED/OPERABLE)	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
14	PC-014	VERTICAL BASE FRAME (OPERABLE)	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
16	PC-016	GLASS STOP	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
18	PC-018	ALTERNATE STRAP ANCHOR	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
19	PC-019	STRAP ANCHOR	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
20	PC-020	STRAP ANCHOR COVER	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
21	PC-021	CONCEALED MULLION	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
22	PC-022	REINFORCEMENT CLIP	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
23	PC-023	CONCEALED STRAP ANCHOR	ALUMINUM 6063-T6	NR ARCHITECTURAL PRODUCTS
34	--	9/16" LAMINATED IMPACT GLASS	GLASS	VARIES
36	NR-A24	VK2526 1/4" PVC SPACER	PVC	CAPITAL TAPE
37	--	GLAZING SEALANT DOW 983 II PART	SILICONE	DOWSIL
38	--	GLAZING SEALANT DOW 995	SILICONE	DOWSIL
39	NR-G20	PS 1126E POLY-WEDGE GASKET	70 DURO EPDM	TREMCO
40	NR-G21	EXT. WEATHERSEAL AP 150	EXTRUDED TAPE	SCHLEGEL
41	NR-G22	INT. WEATHERSEAL TLOK 150	POLYETHELENE	SCHLEGEL
43	NR-G25	GLASS SETTING BLOCK TR-1365E	70 DURO EPDM	TREMCO
44	--	PERIMETER SEALANT DOW 795	SILICONE	DOWSIL
45	--	FRAME JOINT SEALANT	SILICONE	CRL BUILDING PRODUCTS
46	NR-F12	BASE FRAME FIXING SCREWS	STAINLESS STEEL	#10X1 PPH TSEK SCREW
47	NR-F13	ADAPTOR FIXING SCREW	STAINLESS STEEL	#12 X 3/4" PP TEK SREW
48	NR-EP1	1/16"-2-1/2"X5/16" END PLATE	6063-T6 ALUMINUM	NR ARCHITECTURAL PRODUCTS

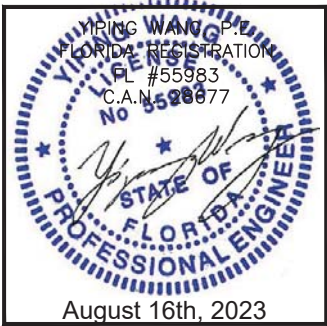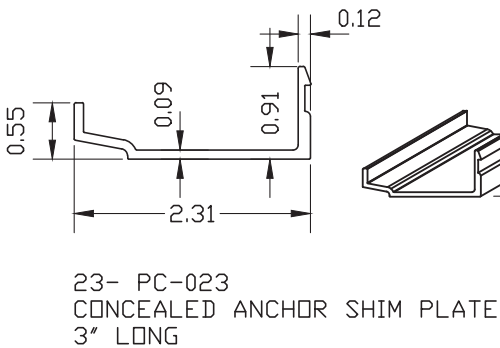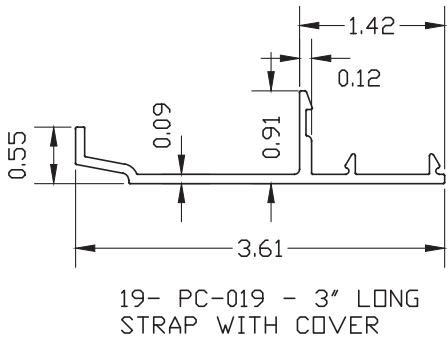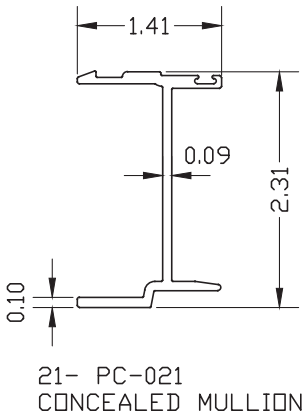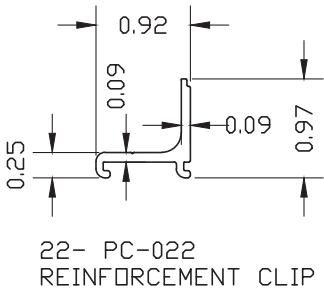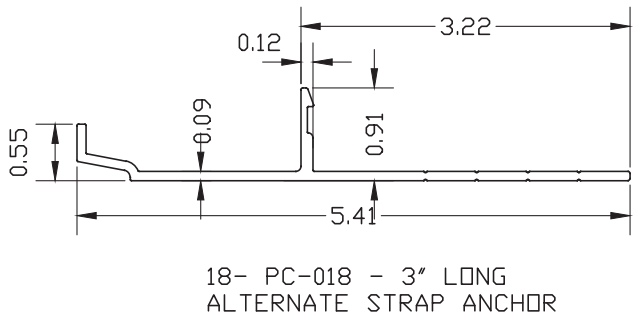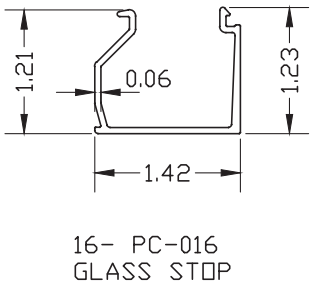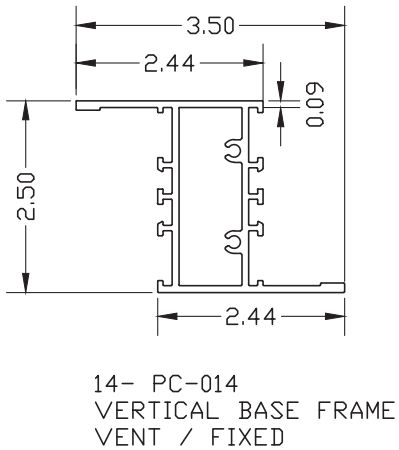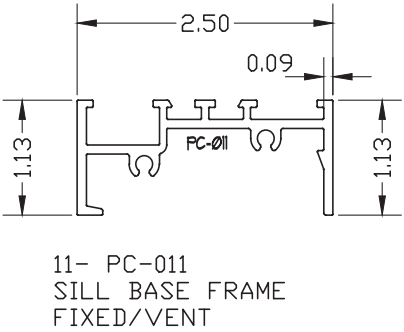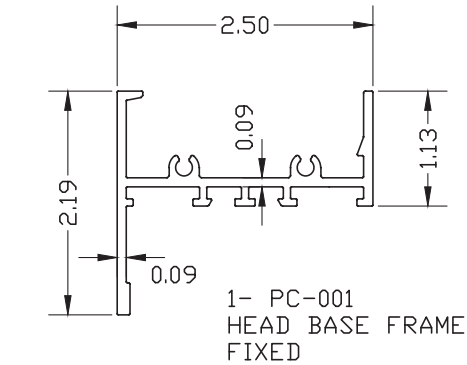

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

M

C

Y

12781 Miramar Pkwy. Ste. 301

Miramar, FL 33027

P: 305.271.0117

www.MCYEngineering.com

mcy@mcyengineering.com

NRAP SERIES 2500 FIXED WINDOW (S.M.I.)

NR ARCHITECTURAL PRODUCTS

4348 WESTROADS DRIVE

WEST PALM BEACH, FL 33407

TEL: (561) 844-1121 FAX: (561) 844-6131

Rev. No.	Date	Drawn By	Description
R2	08.11.2023	James	FBC 2023

Drawn Date: 08.11.2023


Scale: AS NOTED

DRAWING NO. AD17-11


FLORIDA APPROVAL

FL #22026.2



Sheet No. 06 OF 07

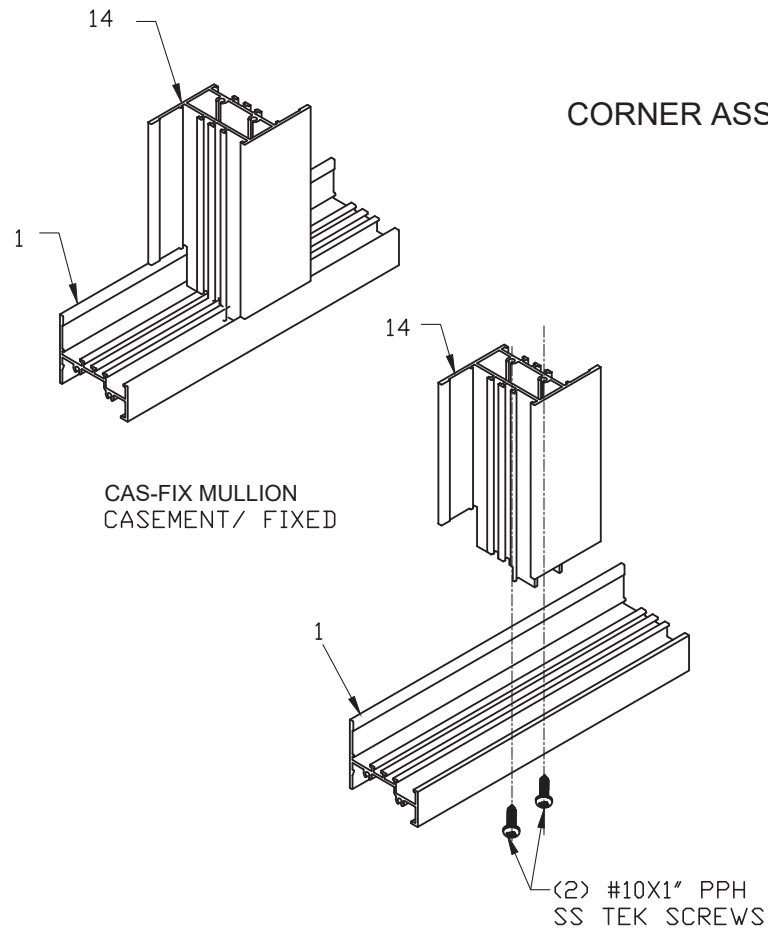

CORNER ASSEMBLY

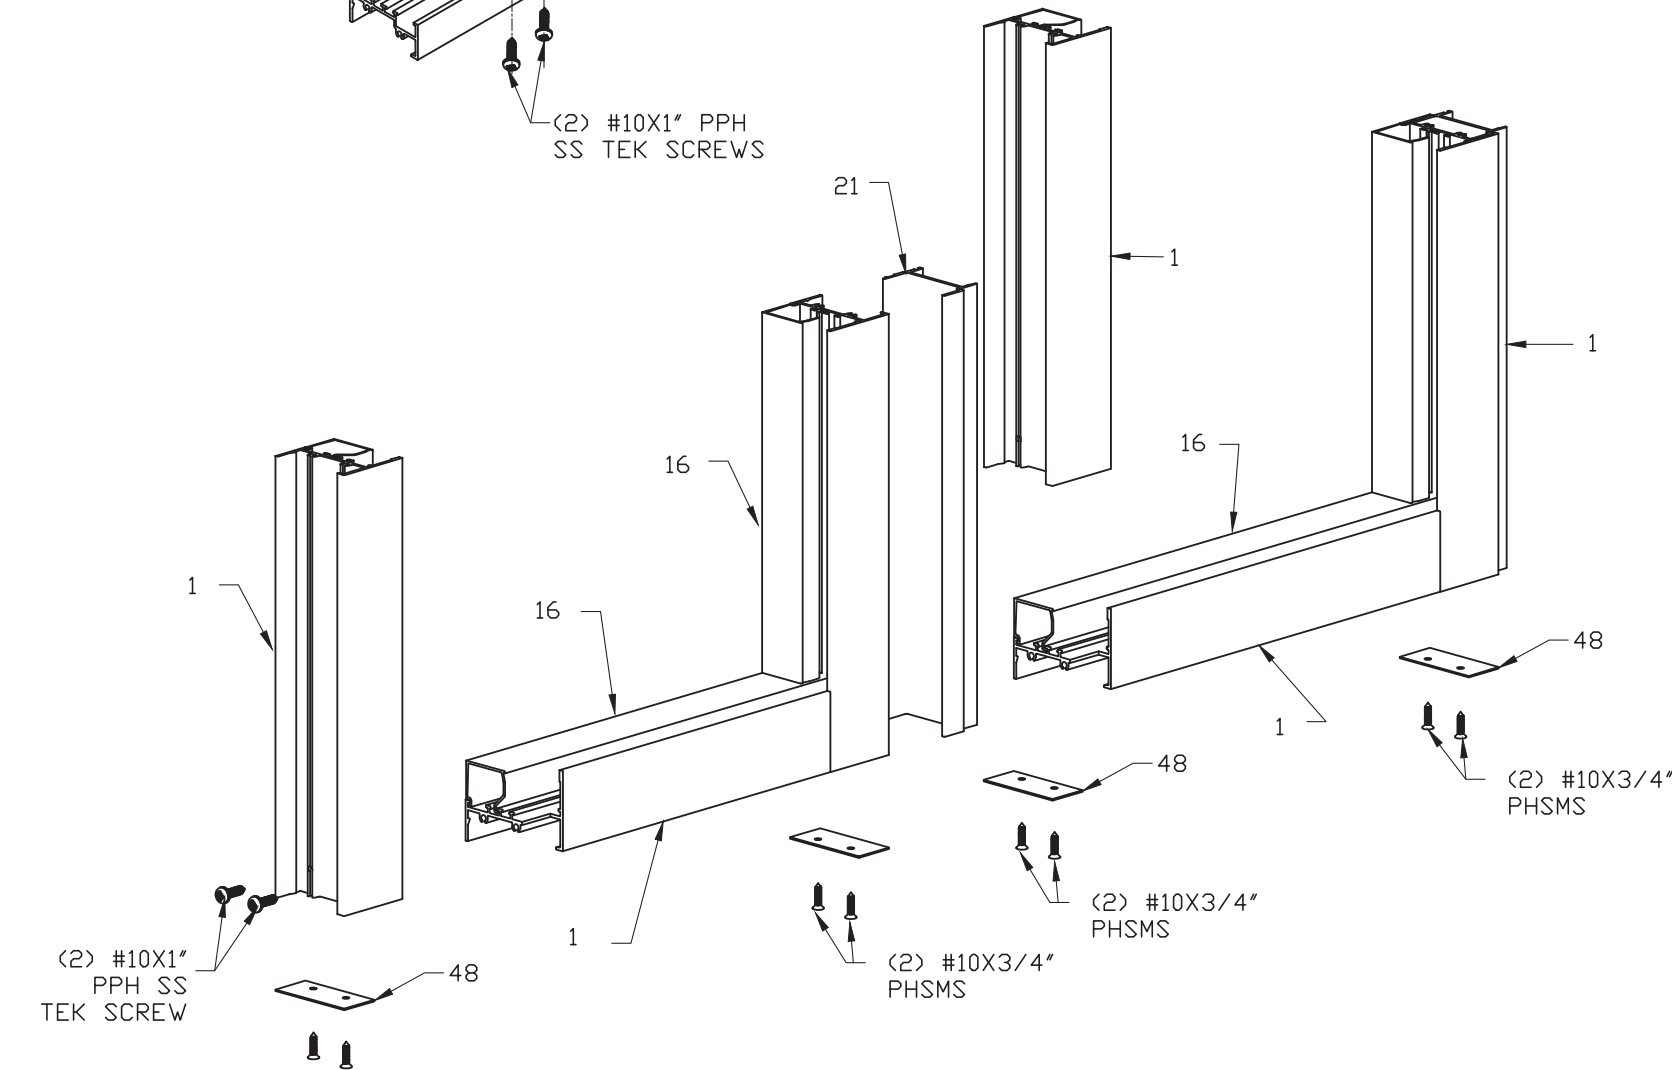

GLAZING DETAIL

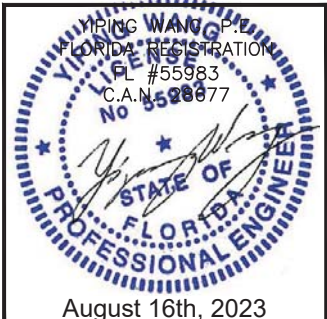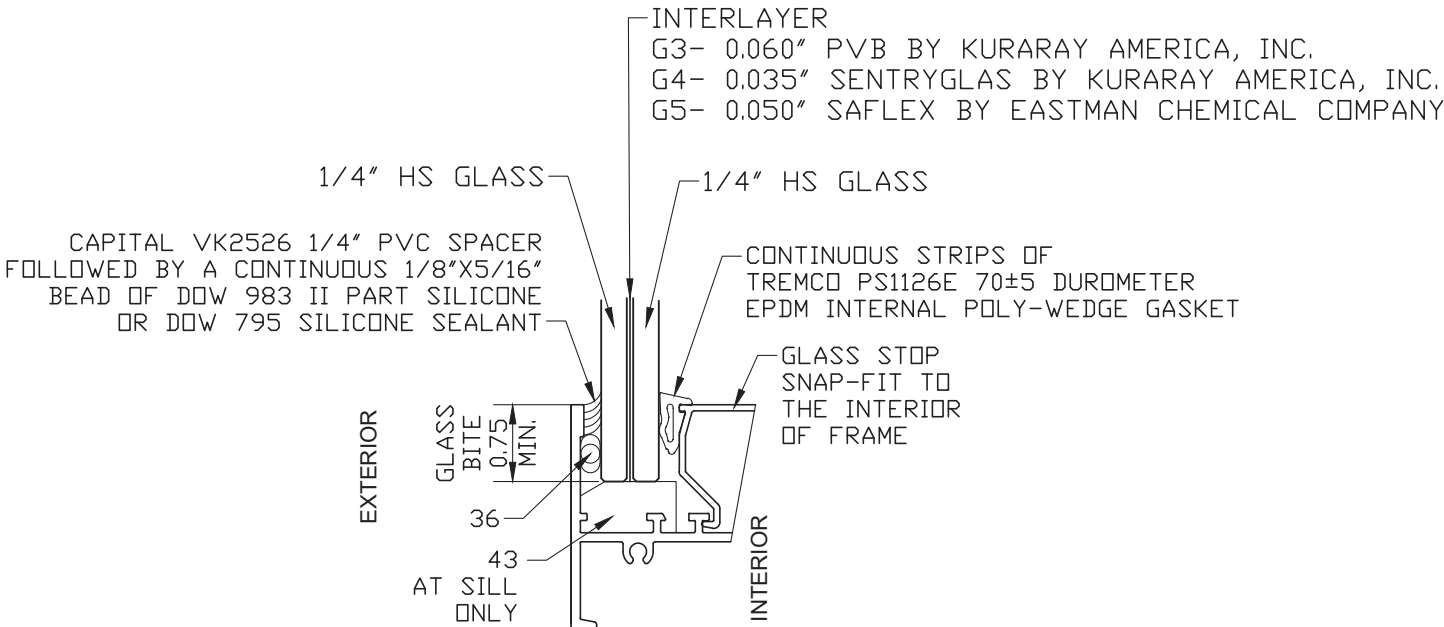

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 Miramar Pkwy. Ste. 301
Miramar, FL 33027 P: 305.271.0117
www.MCYEngineering.com mcy@mcyengineering.com

NRAP SERIES 2500 FIXED WINDOW (S.M.I.)
NR ARCHITECTURAL PRODUCTS
4348 WESTROADS DRIVE
WEST PALM BEACH, FL 33407
TEL: (561) 844-1121 FAX: (561) 844-6131

Drawn Date	08.11.2023	Scale	AS NOTED
Drawn By	James	Date	08.11.2023
Rev. No.	R2	Description	FEC 2023
DRAWING NO. AD17-11			
FLORIDA APPROVAL FL #22026.2			
Sheet No. 07 OF 07			