



Monument Clad Triple Sliding X0X

Operating Window

119 1/4" x 59 3/8"

Aluminum Nail Fin Installation / Non-Impact

TEST REPORT SUMMARY:

- SINGLE UNIT, MAXIMUM BASIC UNIT FRAME SIZE:
119 1/4" (3029mm) x 59 3/8" (1508mm)
- OVERALL DESIGN PRESSURE: +50 / -50 psf
- STRUCTURAL TEST PRESSURE: +75.19 / -75.19 psf
- RATING: CW-PG50

CCL Listing# 436-H-666.17

Intertek/ATI TEST REPORT NUMBER: D6284.01-602-44r1

Monument XOX Clad Sliding Operating Window

Aluminum Nail Fin Installation / WDMA Instructions / Non-Impact

SHEET: 1 OF 2

UPDATED: 4/18/2017

DRAWN BY: B.K.

INSTALLATION NOTES:

1. USE 2" x _ WOOD BUCK.

2. 1/4" MAXIMUM SHIM SPACE AT HEAD, SILL, JAMB
- PLACE WOOD SHIMS EVERY 6-10" AS NEEDED AND
BEHIND EACH SCREW LOCATION.

3. APPLY A CONTINUOUS BEAD OF SEALANT
BETWEEN THE ALUMINUM NAIL FIN AND THE BUCK
AT THE HEAD, SILL AND SIDE JAMBS

4. INSTALL #8 X 1-1/4" PPH SCREWS SPACED
APPROXIMATELY 1-4" FROM EACH CORNER AND 8"
ON CENTER THEREAFTER INTO THE FRAMING
MATERIAL. 1/4" MINIMUM EDGE DISTANCE, SILICONE
SEAL OVER SCREW HEADS.

5. 1" MINIMUM FASTENER EMBEDMENT INTO
FRAMING MATERIAL.


6. MAXIMUM BASIC UNIT FRAME WINDOW SIZE:
119.25" (3029mm) x 59.375" (1508mm)

7. THIS INFORMATION APPLIES TO XOX SLIDER (3
SASH, 2 OPERATING)

- Check rough opening for proper size, plumb, level and square.
- Make all necessary adjustments to ensure rough opening is plumb, level & square.
- Sill must be flat, level and capable of supporting the weight of the unit.
- Opening should allow a maximum of 1/4" shim space, sill and jambs.
- Wood buck, framing, fasteners, sealant and all wall system materials are provided by others


HEAD DETAIL

MONUMENT CLAD SLIDING WINDOW,
MEETING RAIL

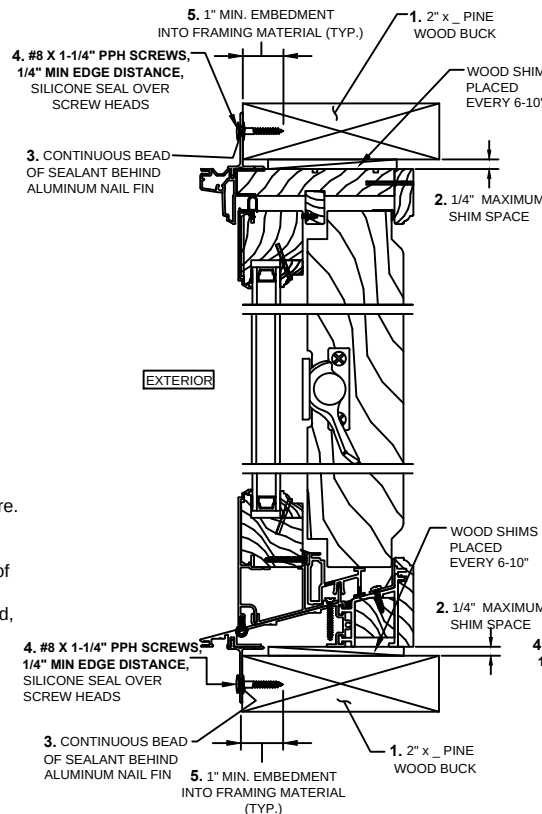

SILL DETAIL

MONUMENT CLAD SLIDING WINDOW,
MEETING RAIL

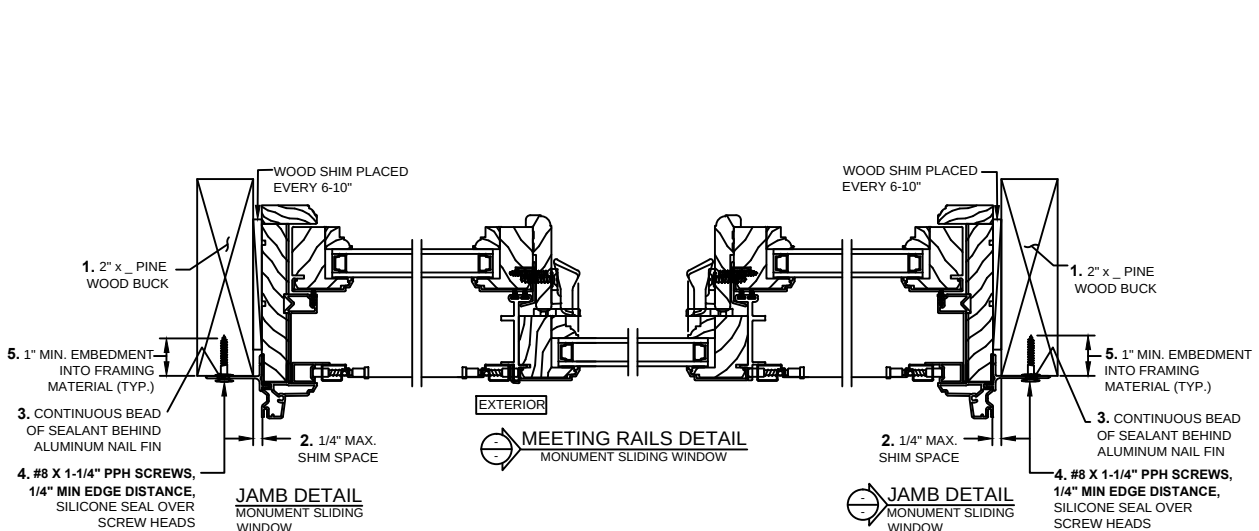

MEETING RAILS DETAIL

MONUMENT SLIDING WINDOW





Monument Clad Triple Sliding X0X

Operating Window

119 1/4" x 59 3/8"

Aluminum Nail Fin Installation / Non-Impact

TEST REPORT SUMMARY:

- SINGLE UNIT, MAXIMUM BASIC UNIT FRAME SIZE:
119 1/4" (3029mm) x 59 3/8" (1508mm)
- OVERALL DESIGN PRESSURE: +50 / -50 psf
- STRUCTURAL TEST PRESSURE: +75.19 / -75.19 psf
- RATING: CW-PG50

CCL Listing# 436-H-666.17

Intertek/ATI TEST REPORT NUMBER: D6284.01-602-44r1

Monument X0X Clad Sliding Operating Window

Aluminum Nail Fin Installation / WDMA Instructions / Non-Impact

SHEET: 2 OF 2

UPDATED: 4/18/2017

DRAWN BY: B.K.

NAIL FIN ANCHOR REQUIREMENTS TABLE			
THROUGH ALUMINUM NAIL FIN WITH SCREWS			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE, FASTENER SPACING	MINIMUM EMBED	MINIMUM EDGE DIST.
2X WOOD FRAME OR BUCK	#8 X 1-1/4" PPH SCREWS, SPACED 1-4" FROM EACH CORNER & 8" ON CENTER THEREAFTER.	1"	3/4"
ANCHORS MUST BE INTO A MIN. 2X WOOD MEMBER. IF SPACE BETWEEN WALL FRAME & WINDOW FRAME IS GREATER THAN THAT REQUIRED FOR A 2X WOOD MEMBER AND A SPACE EXISTS, THE SPACE MUST BE FILLED WITH A WOOD MEMBER OF EQUAL DEPTH TO THE WINDOW FRAME MEMBER OR BUCK AND OF LENGTH = MIN. 20". THE FRAME ANCHOR MUST THEN BE RUN THROUGH THE FRAME & WOOD SHIM AND INTO THE OPENING.			

