

c:\users\msun\building drops, inc\building drops landing - common\projects\weiland sliding doors\fbc-25-0534 - fbc submittal - fl22224 pivot door - sill anchor revision\dwgs\wsd011.dwg 6/23/2025 11:36 AM

WEILAND SLIDING DOORS AND WINDOWS, INC.

AWPD/APD-T/APD PIVOT DOOR (NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INSTALLATION ANCHORS AT ALL JACKING SCREW LOCATIONS.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- FOR INSTALLATION INTO WOOD FRAMING, USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT. ANCHORS SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION INTO METAL STUD FRAMING, USE #10 GRADE 5 SELF-DRILLING OR SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE MINIMUM OF THREE THREADS PENETRATION BEYOND METAL WALL. ANCHORS SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 14 GA. (0.0747") WALL THICKNESS.
 - ALUMINUM - 1/8" MINIMUM THICKNESS (6063-T5).

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE, EXCLUDING HVHZ. THIS PRODUCT HAS BEEN TESTED IN ACCORDANCE WITH THE FOLLOWING STANDARDS:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT, IN NON HVHZ AND TO BE REVIEWED BY BUILDING OFFICIAL.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: DOUGLAS FIR WOOD AND ALUMINUM 6063-T5.
- GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAILS.
- DESIGNATIONS "X" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUT
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	DESIGN PRESSURE TABLE
6	HARDWARE, CLADDING & GLAZING DETAILS
7	LOCKRAIL DETAILS
8	BOM & COMPONENTS

DESIGN PRESSURE RATING			
OVERALL SIZE	CONFIGURATION	DESIGN PRESSURE	MISSILE IMPACT RATING
SEE SHEET 5	"X" INSWING OR OUTSWING	SEE SHEET 5	NON-IMPACT

NOTE:

- DOORS WHICH UTILIZE HP THRESHOLD (ITEMS #22-24) MEET THE WATER INFILTRATION REQUIREMENTS.
- DOORS WHICH DO NOT UTILIZE HP THRESHOLD OR DON'T USE A SILL AT ALL DO NOT MEET THE WATER INFILTRATION REQUIREMENTS AND SHALL BE INSTALLED IN NON-HABITABLE AREAS OR HABITABLE AREAS PROTECTED BY AN OVERHANG OR CANOPY SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES.



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)


INSTALLATION & GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.06.23 16:04:02 -04'

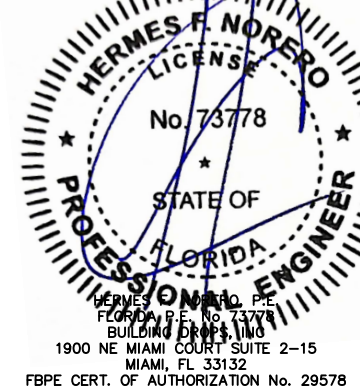

FL #:
FL22224



DATE: **03.08.17**

DWG. BY: **LS** CHK. BY: **HFN**



SCALE: **NTS**

DWG. #: **WSD011**

SHEET:
1
OF 8

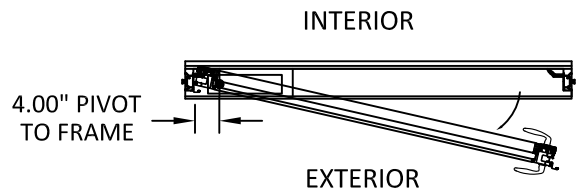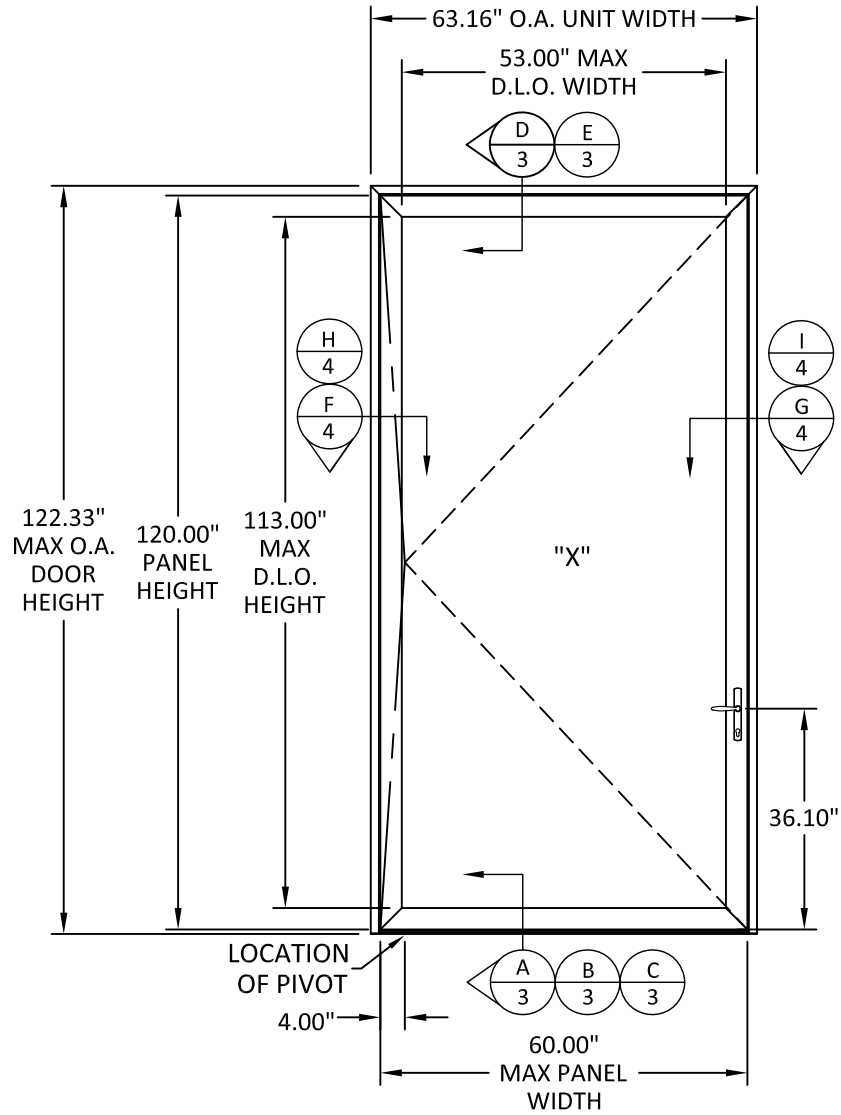


TYPICAL ELEVATION
PIVOT DOOR - 4" PIVOT POINT

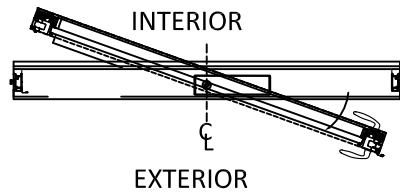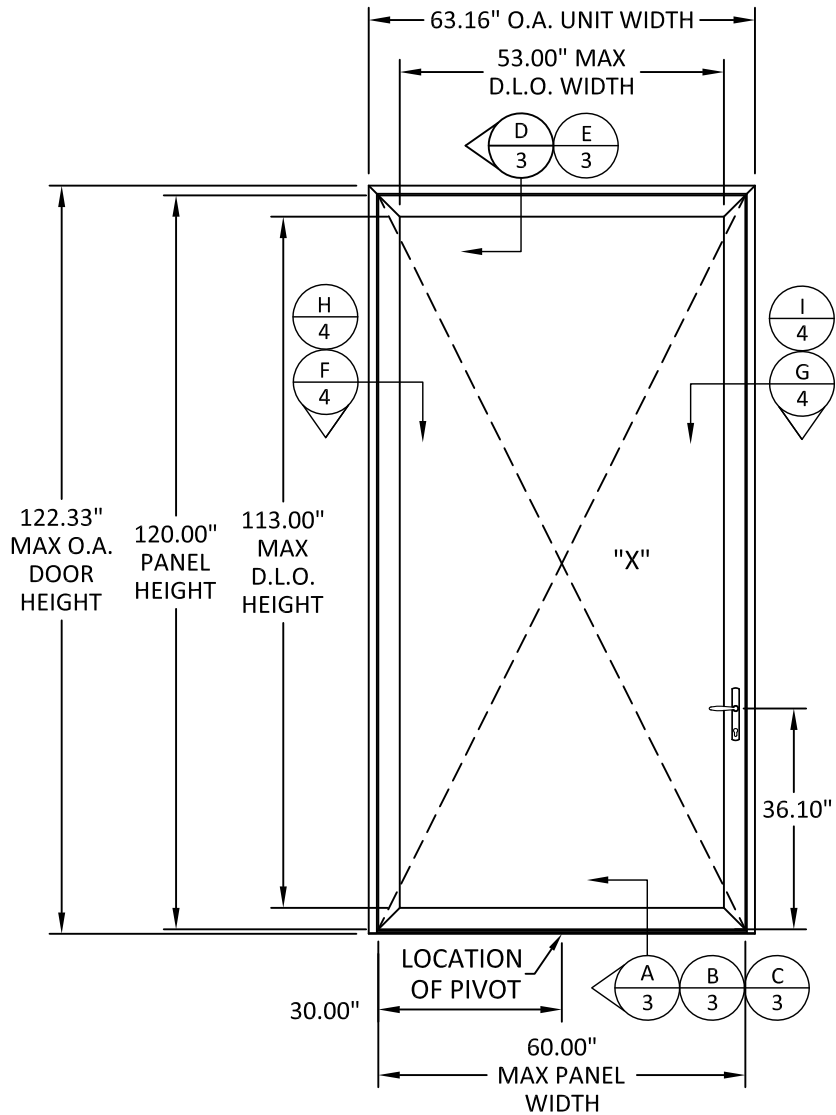

TYPICAL ELEVATION
PIVOT DOOR - CENTER PIVOT POINT

NOTES:

1. WHEN USING MULTIPOINT LOCKING SYSTEM PIVOT POINT IS APPROVED FOR ANY DISTANCE BETWEEN 4" FROM THE FRAME AND AT THE CENTER OF FRAME.
2. WHEN USING SINGLE LOCKING POINT PIVOT POINT IS APPROVED FOR ANY DISTANCE BETWEEN 4" AND 12" FROM THE FRAME.
3. CONFIGURATION APPROVED FOR EITHER INSWING OR OUTSWING
4. TYPICAL ELEVATION SHOWN, SEE SHEET 5 FOR ALTERNATE QUALIFIED SIZES

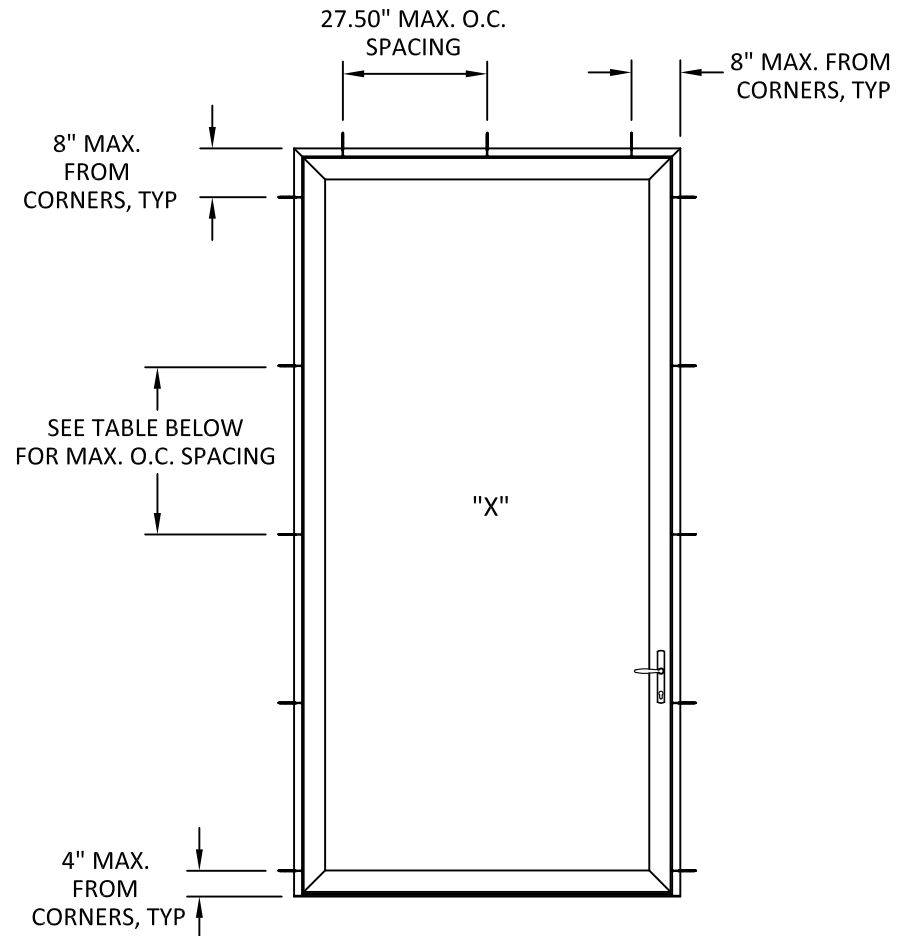

ANCHOR LAYOUT

ANCHOR TYPE	SUBSTRATE	MAX. O.C. SPACING @ JAMBS
#10 WOOD SCREW	WOOD, MIN. SG = 0.55	16"
#10 GR. 5 SMS	STEEL, MIN. 14 GA. MIN. Fy = 33 ksi	21"
	ALUMINUM, MIN. 1/8", MIN. 6063-T5	18 3/4"
3/16" ITW TAPCON	CONCRETE, MIN. f'c = 3000 psi	14"
	MASONRY, MIN. 2000 psi	11 1/4"



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)

ELEVATIONS & ANCHOR LAYOUT


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

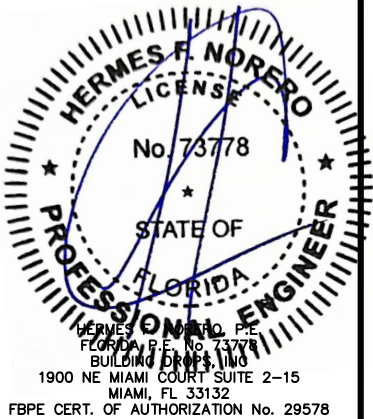

FL #:
FL22224

DATE: **03.08.17**

DWG. BY:
LS

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **WSD011**

SHEET:


2

OF 8


c:\users\msun\building drops, inc\building drops, inc\projects\weiland\sliding doors\weiland\sliding doors - sill anchor revision\dwgs\wso011.dwg 6/23/2025 11:36 AM

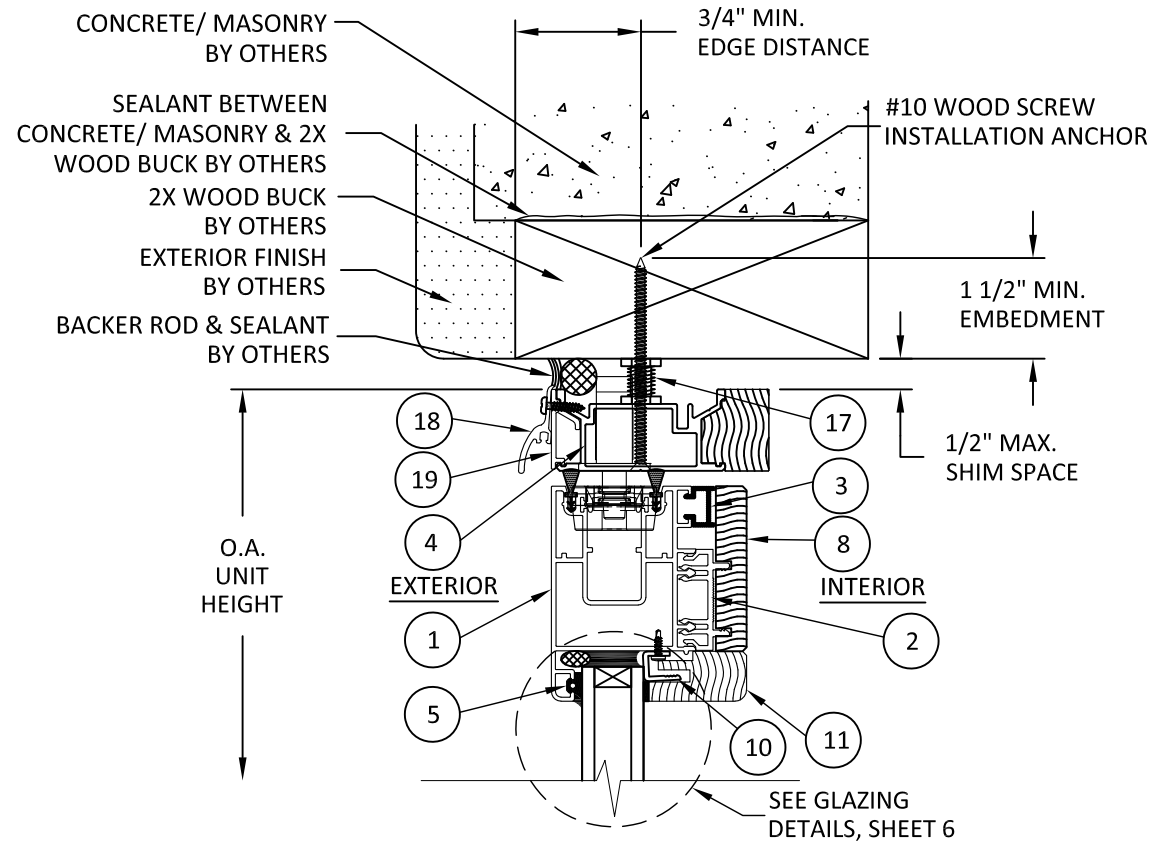


D
3 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK

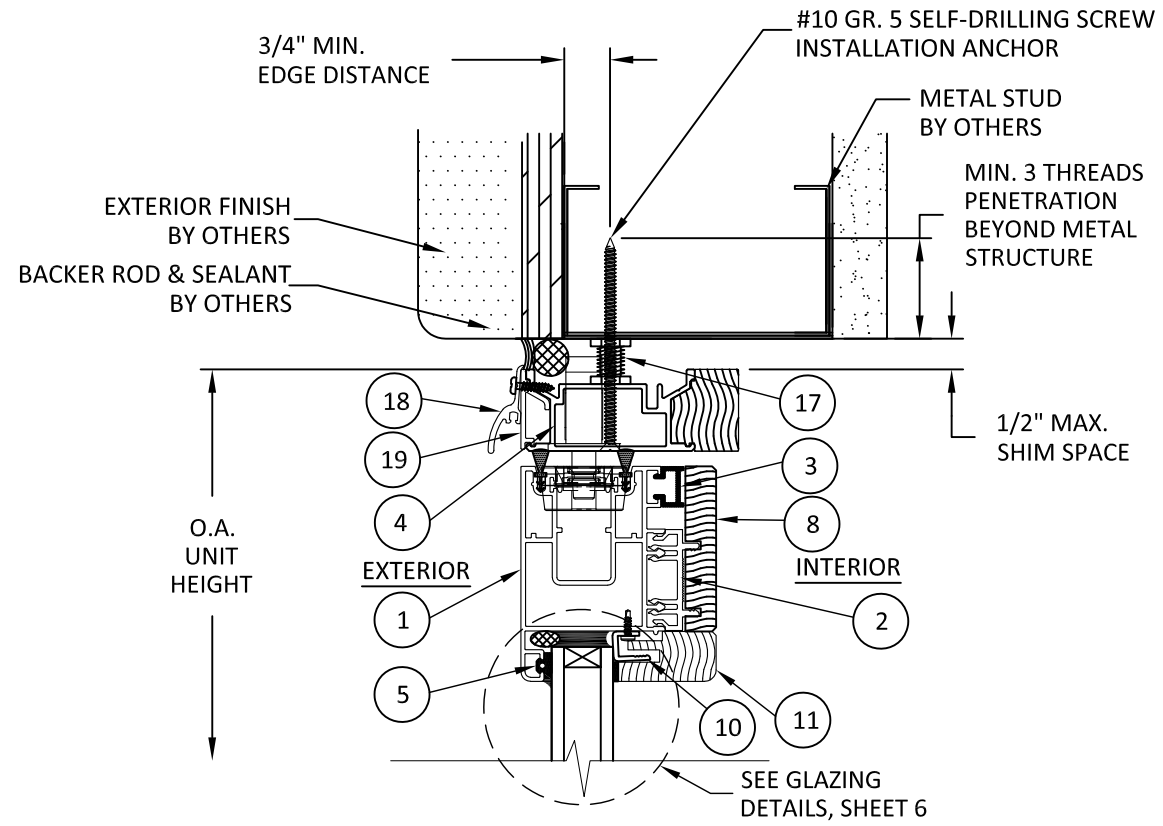


E
3 **VERTICAL SECTION**
HEAD - METAL STUD

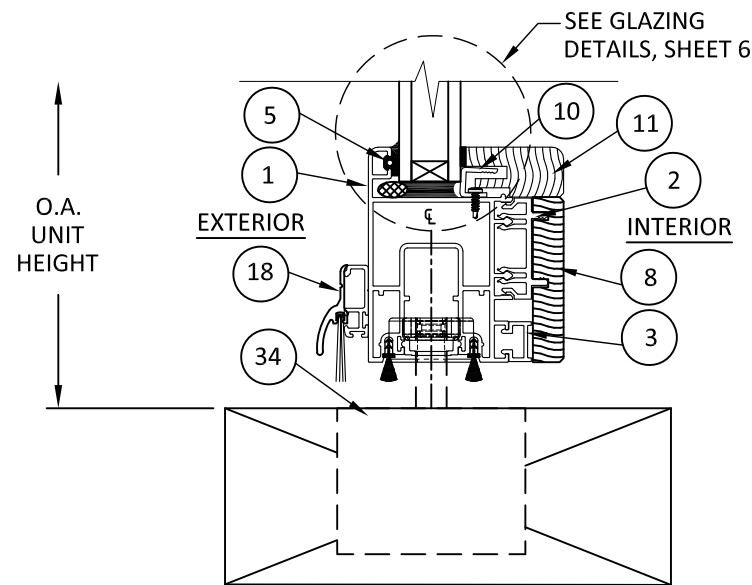

A
3 **VERTICAL SECTION**
SILL - 2X WOOD BUCK
NO SILL THRESHOLD OPTION
NON-WATER RATED

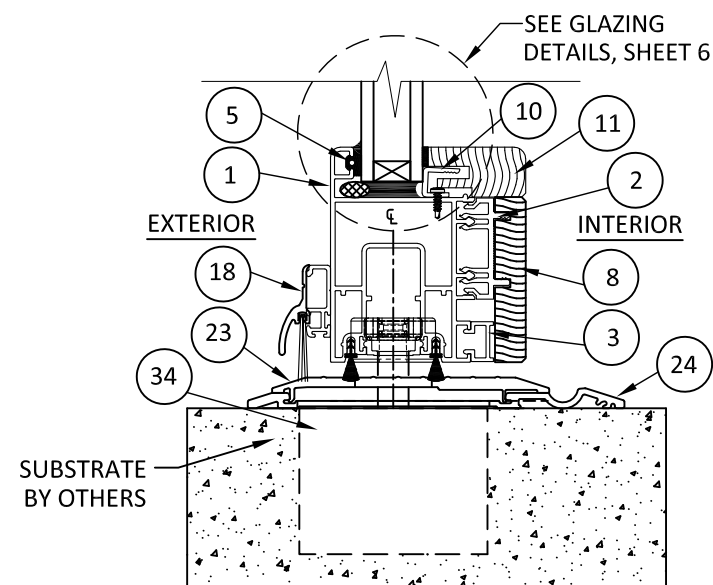

B
3 **VERTICAL SECTION**
SILL - MASONRY/CONCRETE
NON-WATER RATED THRESHOLD

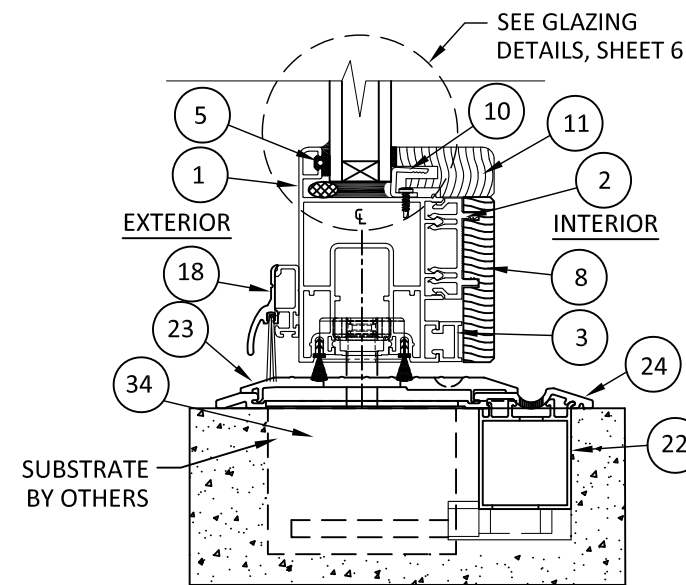

C
3 **VERTICAL SECTION**
SILL - MASONRY/CONCRETE
WATER RATED THRESHOLD



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL22224
DATE:	03.08.17
DWG. BY:	LS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD011
SHEET:	3

6/23/2025 11:36 AM


c:\users\msun\building drops, inc\building drops, inc\projects\weiland\sliding doors\lbc-25-0534 - fbc submittal - fl22224 pivot door - sill anchor revision\dwgs\wso011.dwg

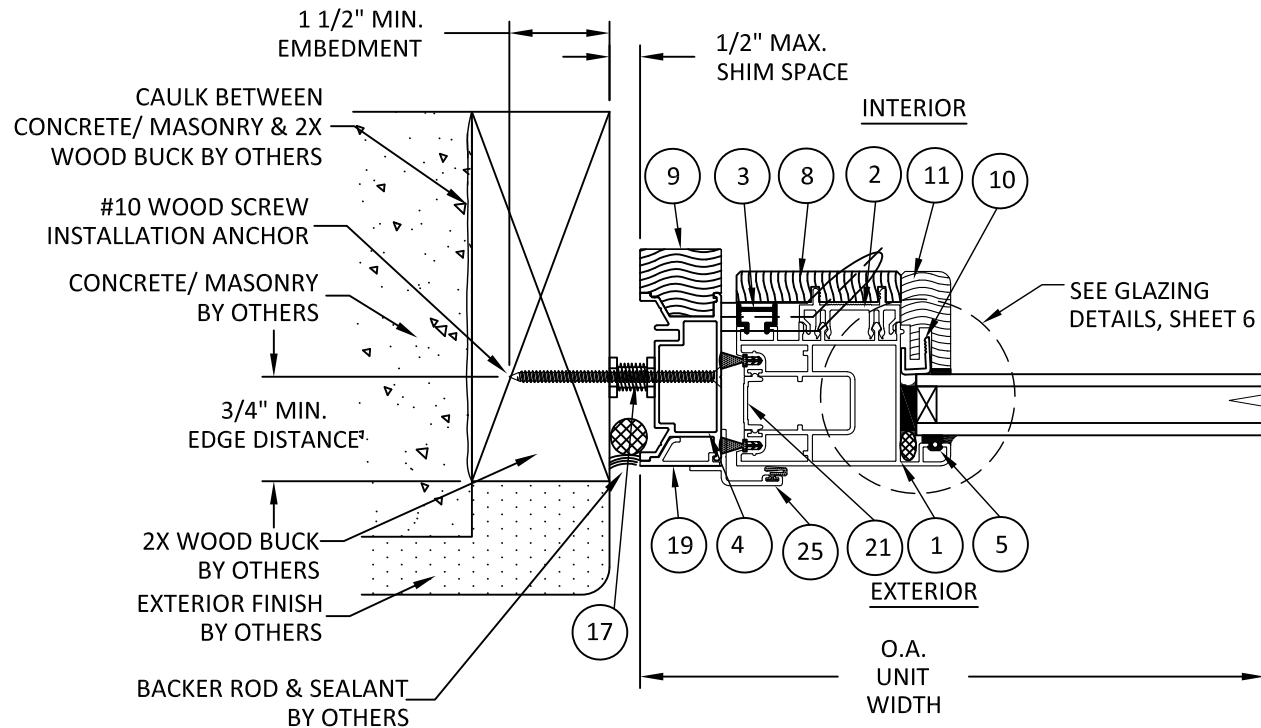


H
4 **HORIZONTAL SECTION**
JAMB - 2X WOOD BUCK
OUTSWING CONFIG.

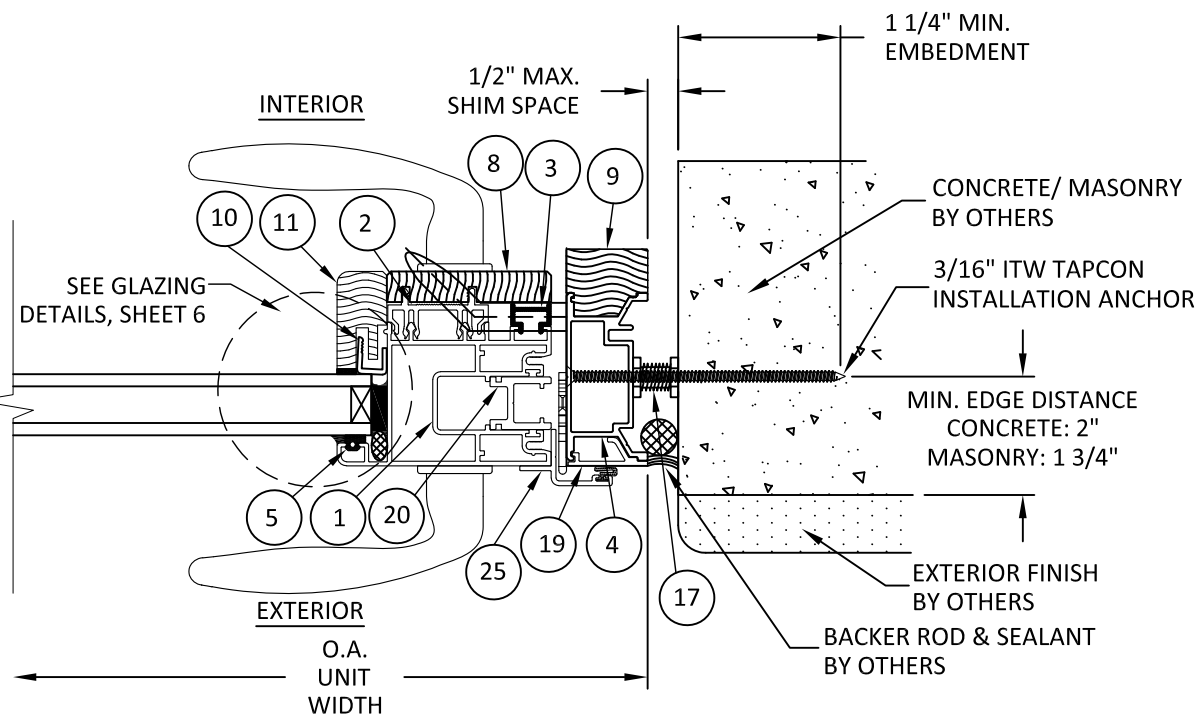

I
4 **HORIZONTAL SECTION**
JAMB - MASONRY/CONCRETE
OUTSWING CONFIG.

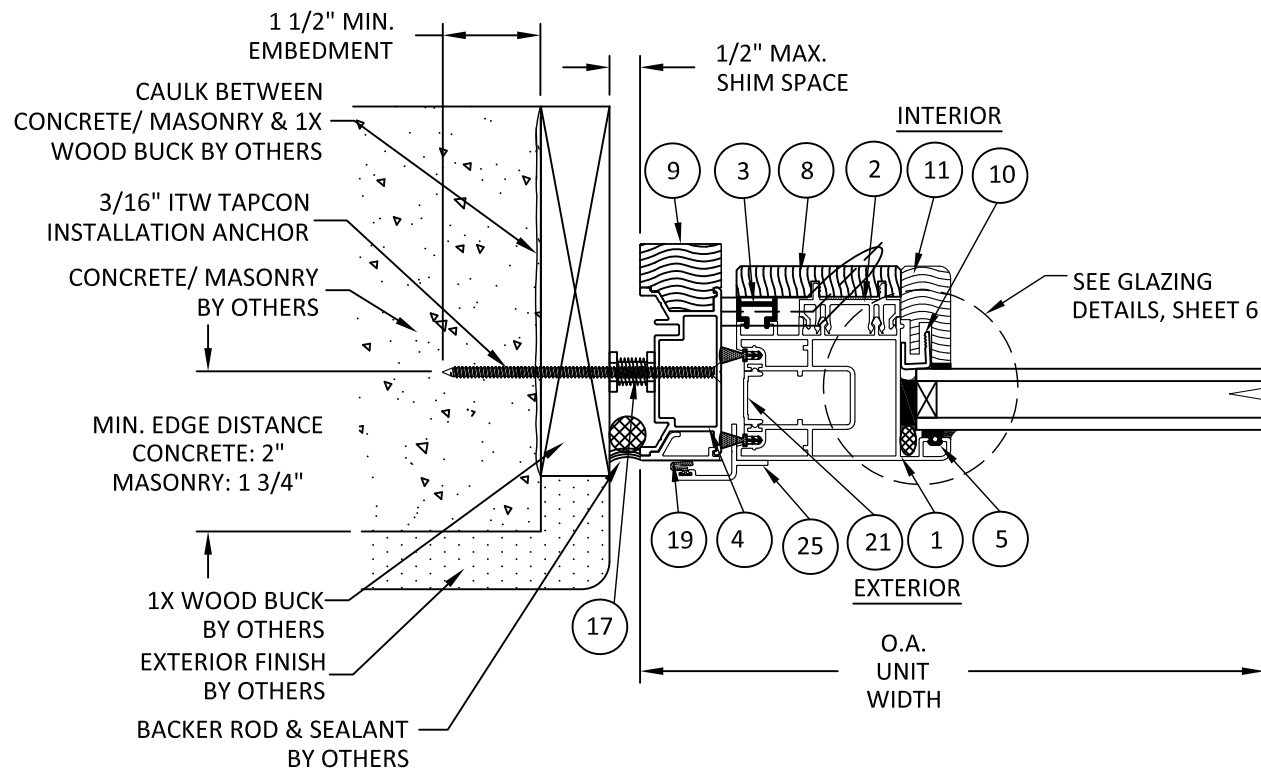

F
4 **HORIZONTAL SECTION**
JAMB - 1X WOOD BUCK - MASONRY/CONCRETE
INSWING CONFIG.

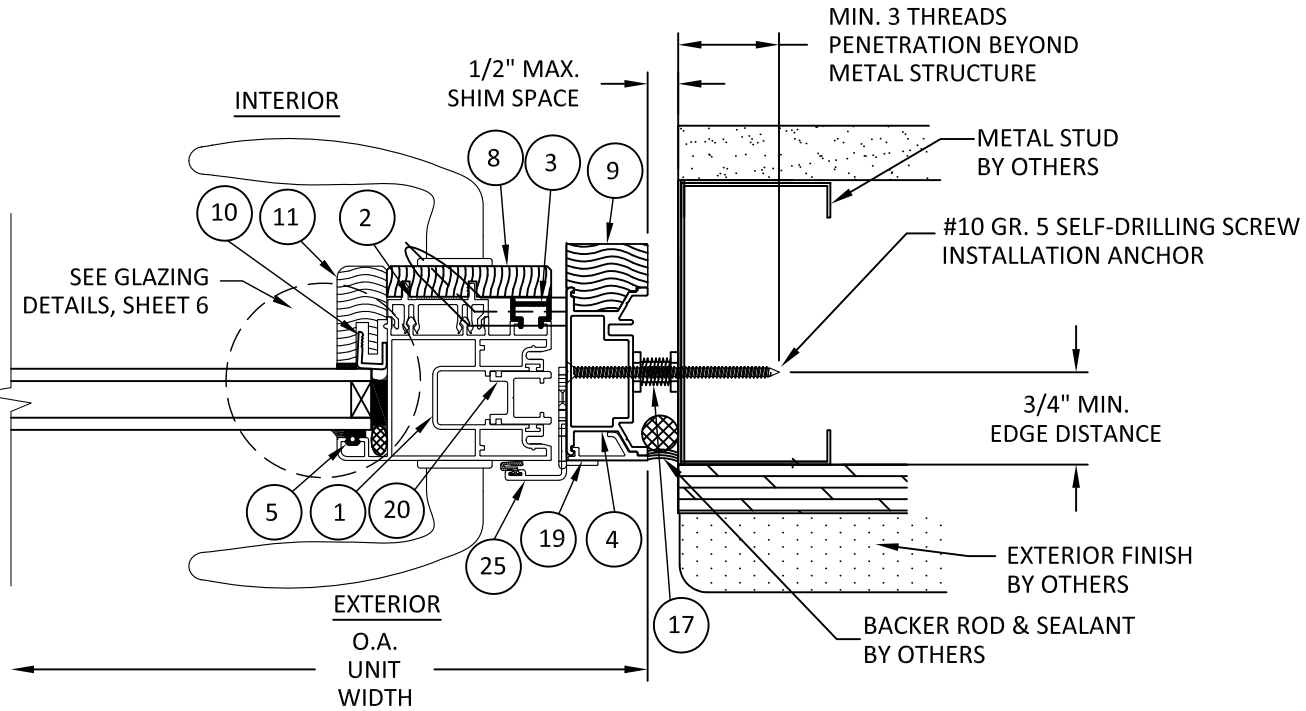

G
4 **HORIZONTAL SECTION**
JAMB - METAL STUD
INSWING CONFIG.



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE: AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL22224
DATE:	03.08.17
DWG. BY:	LS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD011
SHEET:	4

SINGLE LOCKING POINT ALLOWABLE PANEL SIZES				
PANEL WIDTH	PANEL HEIGHT	MINIMUM PIVOT OFFSET FROM JAMB	POSITIVE ALLOWABLE DESIGN PRESSURE	NEGATIVE ALLOWABLE DESIGN PRESSURE
48	96	4.00	30	30
51		4.00	30	30
54		4.00	30	30
57		4.00	30	30
60		4.00	30	30
63		6.74	24	24
66		9.36	20	20
69	108	11.89	17	17
72		14.33	14	14
48		4.00	30	30
51		4.00	30	30
54		4.00	30	30
57		4.00	30	30
60		4.00	29	29
63		6.74	24	24
66	120	9.36	20	20
45		4.00	30	30
48		4.00	30	30
51		4.00	30	30
54		4.00	28	28
57		4.00	27	27
60		4.00	26	26
48	132	4.00	27	27
51		4.00	25	25
54	144	4.00	24	24
48		4.00	20	20

DESIGN PRESSURE NOTES:


- DESIGN PRESSURE SHALL BE LIMITED TO VALUES LISTED IN ABOVE TABLE BASED ON PANEL SIZE.
- MULTIPOINT LOCKING LOCATIONS SHALL NOT EXCEED THE SPACING ALONG THE JAMBS AS SHOWN ON SHEET 6. ADDITIONAL LOCKING POINTS SHALL BE USED AS REQUIRED TO MAINTAIN TESTED SPACING.

MULTIPOINT LOCKING SYSTEM ALLOWABLE PANEL SIZES				
PANEL WIDTH	PANEL HEIGHT	MINIMUM PIVOT OFFSET FROM JAMB	POSITIVE ALLOWABLE DESIGN PRESSURE	NEGATIVE ALLOWABLE DESIGN PRESSURE
48	96	4.00	60	60
51		4.00	60	60
54		4.00	60	60
57		4.00	60	60
60		4.00	60	60
63		6.74	49	49
66		9.36	40	40
69	108	11.89	33	33
72		14.33	28	28
48		4.00	60	60
51		4.00	60	60
54		4.00	60	60
57		4.00	60	60
60		4.00	60	60
63		6.74	49	49
66	120	9.36	40	40
45		4.00	60	60
48		4.00	60	60
51		4.00	60	60
54		4.00	60	60
57		4.00	60	60
60		4.00	60	60
48	132	4.00	60	60
51		4.00	60	60
54	144	4.00	60	60
48		4.00	60	60

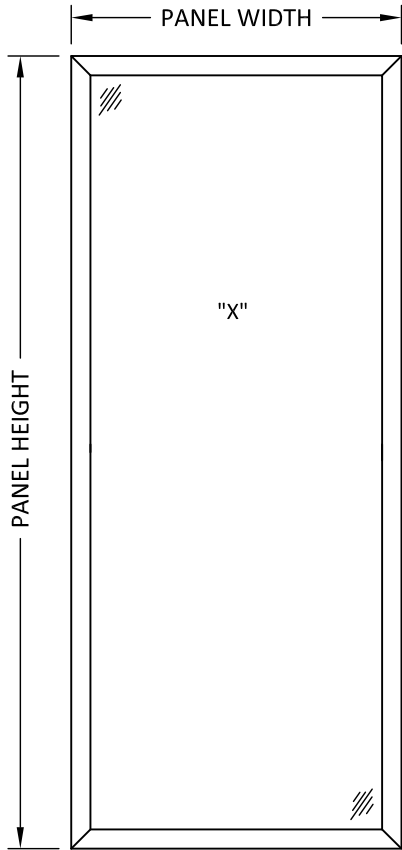

SIZE NOTES:
PANEL SIZES SHOWN IN TABLE.
FRAME SIZES ARE AS FOLLOWS:
FRAME WIDTH = PANEL WIDTH + 3 3/16"
FRAME HEIGHT = PANEL HEIGHT + 2 7/16"
DLO SIZES ARE AS FOLLOWS:
DLO WIDTH = PANEL WIDTH - 7"
DLO HEIGHT = PANEL HEIGHT - 7"

ALLOWED LOCKRAIL CONFIGURATIONS:

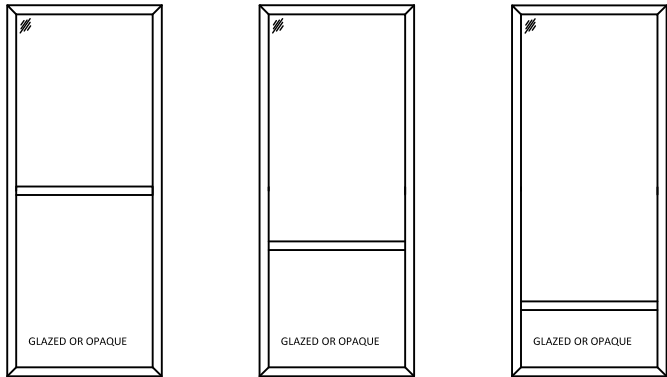

LOCKRAIL NOTES:

- LOCKRAIL MAY BE USED AT ANY LOCATION ON THE PANEL SUCH THAT THE TESTED SQUARE FOOTAGE OF THE OPAQUE INFILL PANEL IS NOT EXCEEDED.
 - TESTED INFILL PANEL DLO SIZE (W x H):
53" x 55" = 20.24 SQ. FT.
- LOCKRAIL QUALIFIED FOR USE FOR "GLAZED OVER GLAZED" OR "GLAZED OVER OPAQUE" PANELS, SEE DETAILS ON SHEET 7.



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725


TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)

DESIGN PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

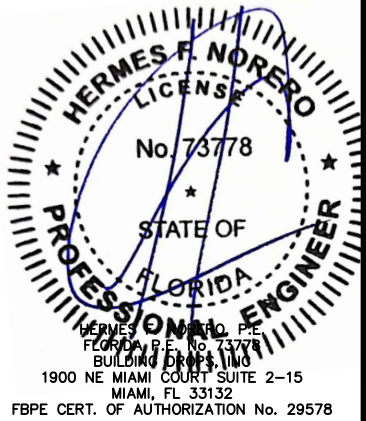

FL #:
FL22224

DATE: **03.08.17**

DWG. BY: **LS**CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WSD011**

SHEET:
5
OF 8


6/23/2025 11:36 AM

c:\users\msun\building drops - common\projects\weiland sliding doors\fbic-25-0534 - fbc submittal - fl22224 pivot door - sill anchor revision\dwgs\wso011.dwg

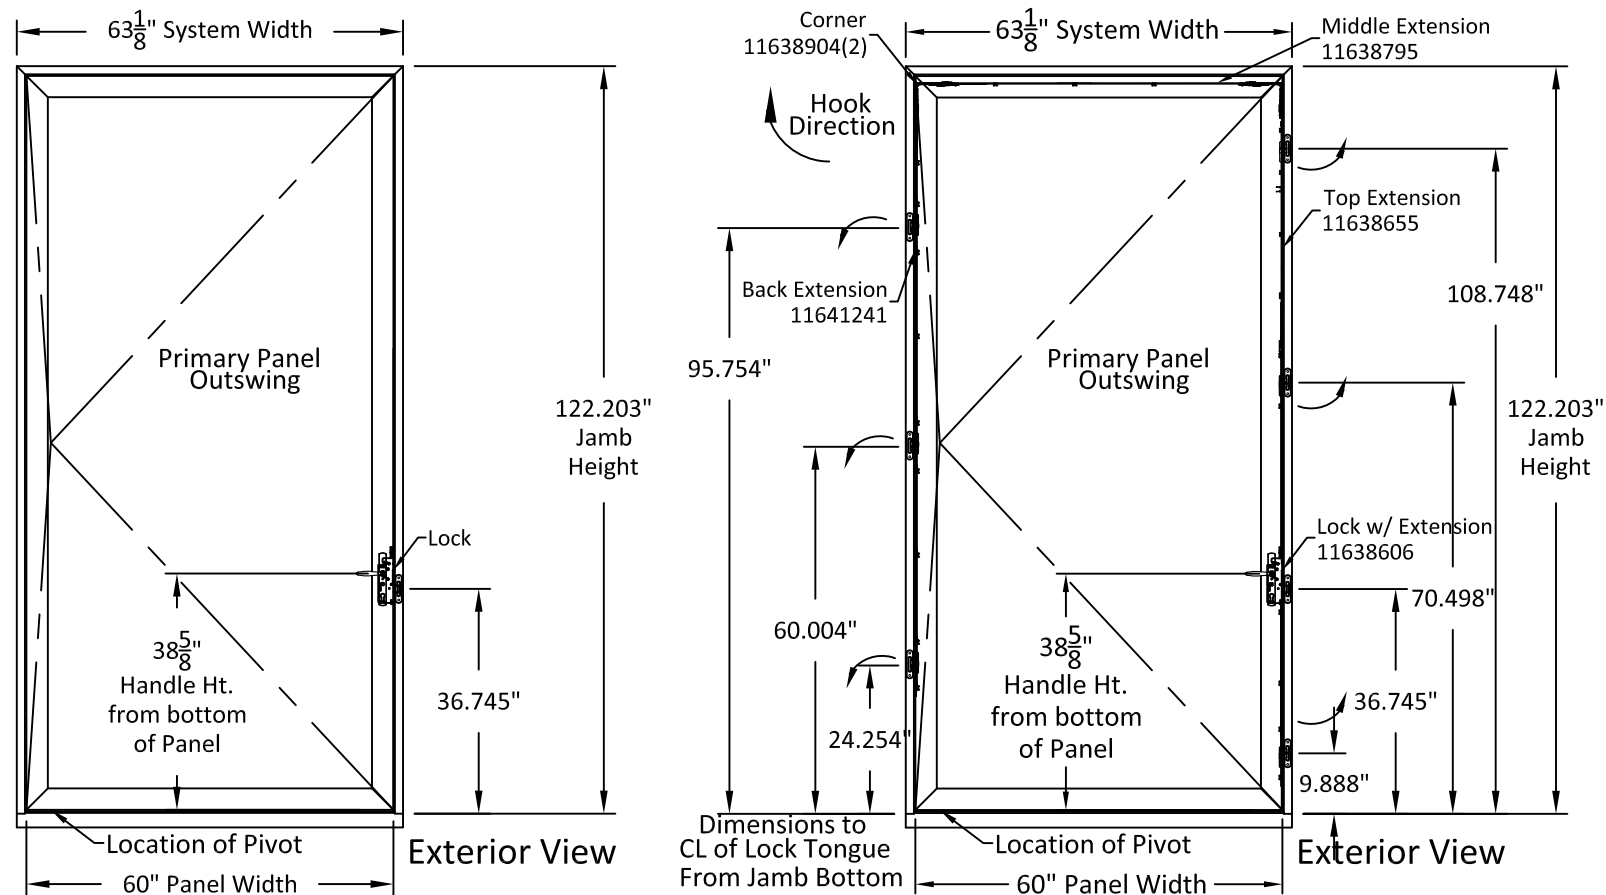


SINGLE LOCKING POINT HARDWARE

TYPICAL MULTIPOINT HARDWARE

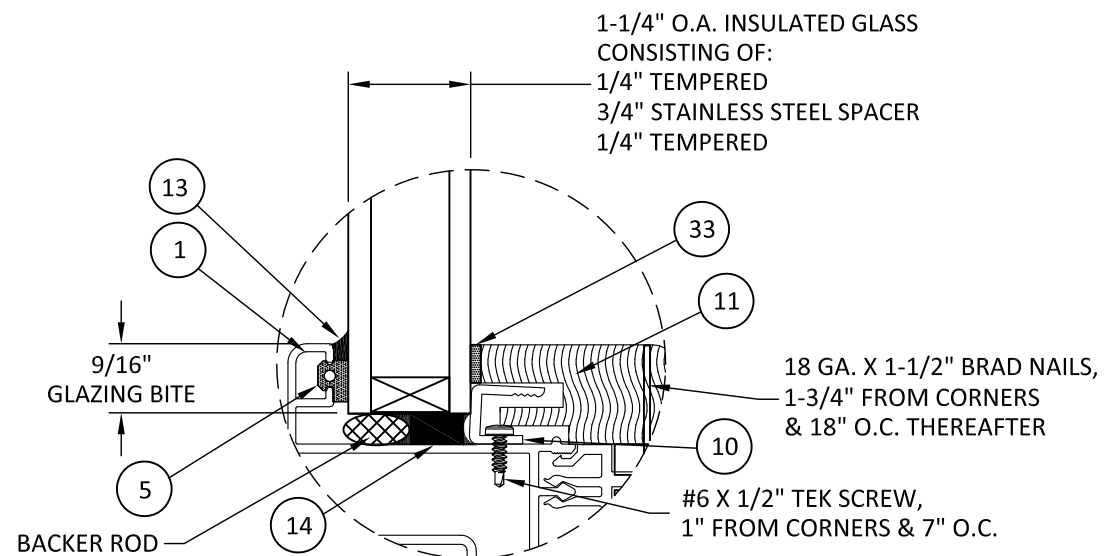


GLAZING DETAIL G1

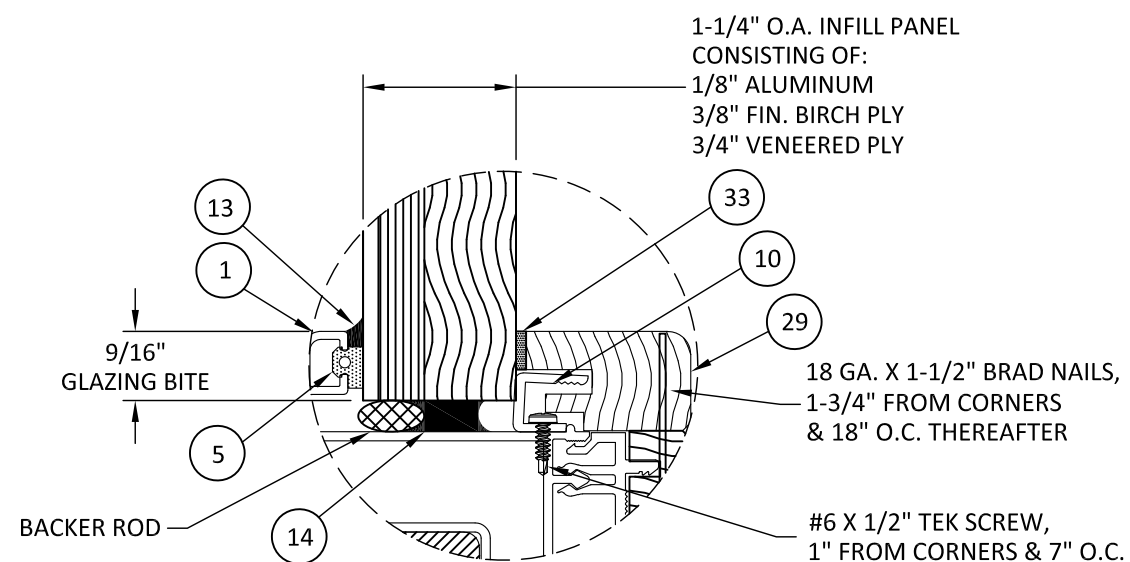

GLAZING DETAIL G2

MAX. SIZE LIMITED TO 'HALF PANEL' OR LESS
CONFIGURATIONS, SEE DIAGRAM ON SHEET 5

OPTIONAL ALUM. CLADDING

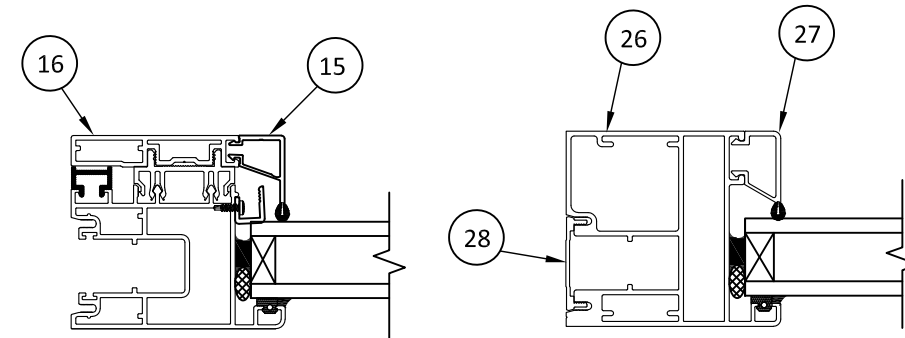

APD-T DETAIL

APD DETAIL

NOTES:

- 1) DETAIL SHOWN IS REPRESENTATIVE OF THE COMPONENTS USED AT ALL MEMBERS OF THE PIVOT DOOR.
- 2) ALUMINUM CLADDING FRAME PROFILES MAY BE USED AS AN ALTERNATIVE TO ANY WOOD CLADDING FRAME IN THE CONFIGURATIONS APPROVED WITHIN THIS DOCUMENT.



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)

HARDWARE & CLADDING DETAIL


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

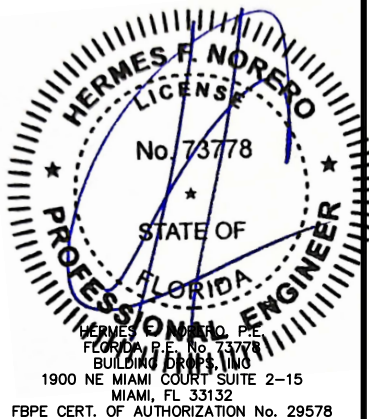

FL #:

FL22224

DATE: **03.08.17**

DWG. BY:
LS

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **WSD011**


SHEET:

6

OF 8

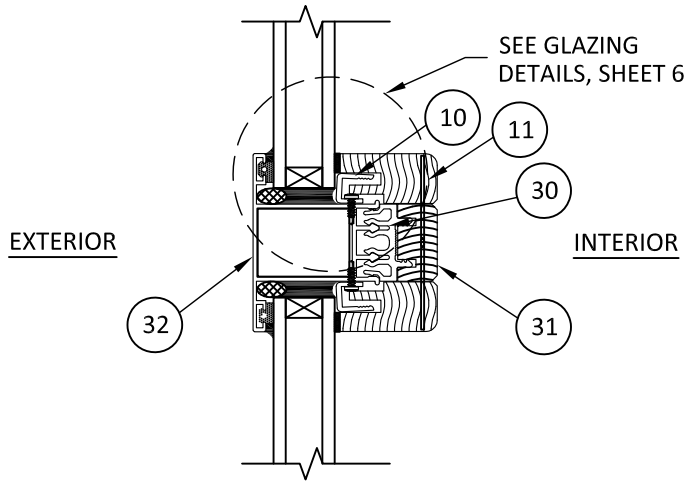


J
7 **VERTICAL SECTION**
MIDRAIL - GLASS OVER GLASS

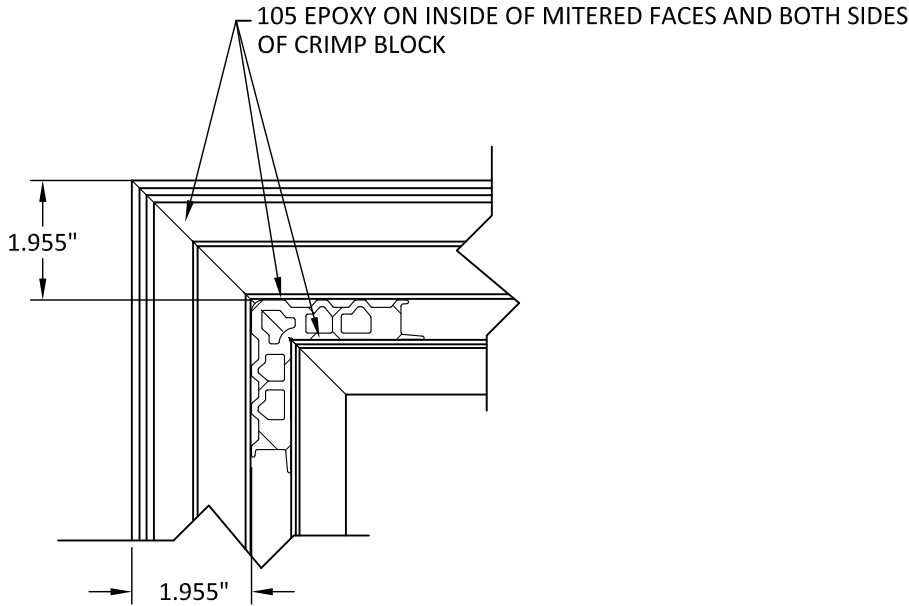


PANEL CORNER ASSEMBLY

NOTE: THIS JOINT IS TYPICAL FOR ALL FOUR CORNERS OF PANEL.

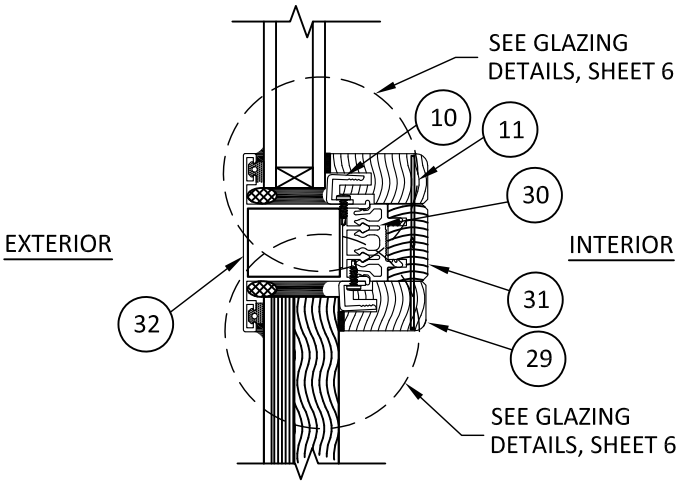

K
7 **VERTICAL SECTION**
MIDRAIL - GLASS OVER INFILL PANEL

NOTE: SECTION VIEW OF OPAQUE PANEL IS TYPICAL, SILL AND JAMBS SIMILAR.

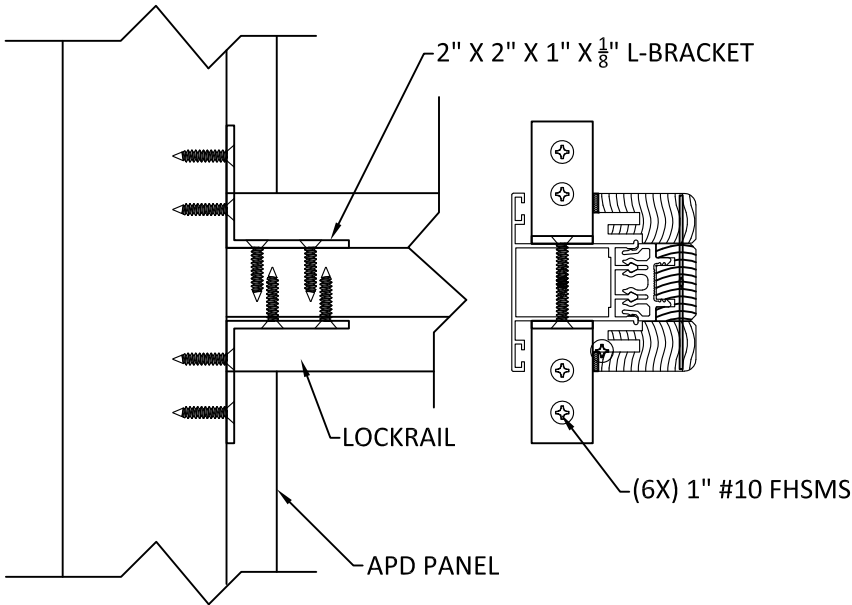

LOCKRAIL ATTACHMENT DETAIL



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725


TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)

MIDRAIL DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com






























REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

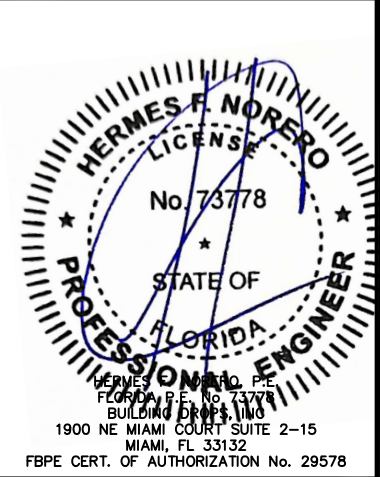

FL #:	FL22224
DATE:	03.08.17
DWG. BY: LS	CHK. BY: HFN
SCALE:	NTS
DWG. #:	WSD011
SHEET:	7

BILL OF MATERIALS			
ITEM No.	DESCRIPTION	MATERIAL	PART No.
1	STILE/RAIL	6063-T5	1020
2	LARGE CLIP	PVC	40126
3	H-BAR	PVC	40146
4	TOP GUIDE	6063-T5	1017
5	GLAZING GASKET	SANTOPRENE	40106
6	SETTING BLOCKS $\frac{1}{4}$ " X $1\frac{5}{8}$ " X 2"	NEOPRENE	NSB 85D
7	PVC SPACER	PVC	40244
8	WOOD CLADDING	WOOD	5001
9	INTERIOR WOOD FASCIA	WOOD	5006
10	J-CLIP	PVC	40201
11	I.G. WOOD GLAZING BEAD	WOOD	5003a-e
12	NOT USED	-	-
13	DOW 995 OR DOW 983 CAP BEAD	SILICONE	-
14	DOW 983	SILICONE	-
15	ALS-T GLASS STOP	6063-T5	1242
16	ALUMINUM CLADDING	6063-T5	1241
17	JACKING SCREW	ZAMAK & PLASTIC	20228
18	DRIP EDGE	6063-T5	1183
19	FASCIA EXT. SIDE JAMB	6063-T5	1076
20	MULTI POINT ADAPTER	6063-T5	1239
21	COVER PLATE	PVC	1236
22	HP. THRESHOLD COLLECTION RAIL	6063-T5	1286
23	HP THRESHOLD, TOP	6063-T5	1285
24	HP THRESHOLD, BOTTOM	6063-T5	1284
25	ASTRAGAL	6063-T5	1226
26	APD STILE/RAIL	6063-T5	-
27	APD GLASS STOP	6063-T5	-
28	APD RAIL/ STILE COVER	6063-T5	-
29	INFILL PANEL GLAZING BEAD	WOOD	-
30	SMALL CLIP	PVC	40150
31	LOCKRAIL INTERIOR CLADDING	WOOD	5007
32	LOCKRAIL	6063-T5	1034
33	ADHESIVE FOAM GASKET	FOAM	-
34	FLOOR CLOSER PIVOT	-	J990NH0D
35	ADJUSTABLE TOP PIVOT	-	J580DU

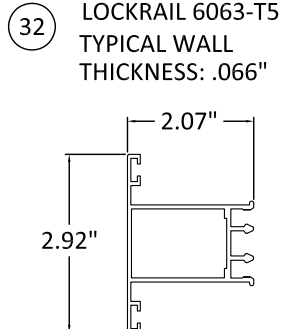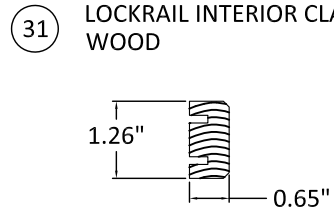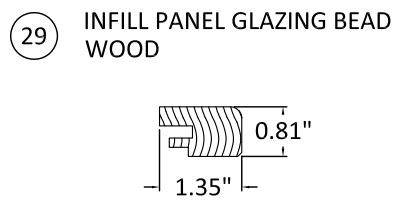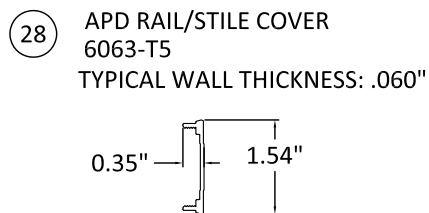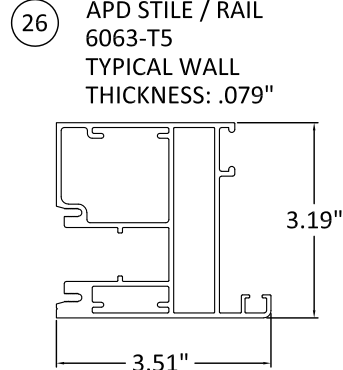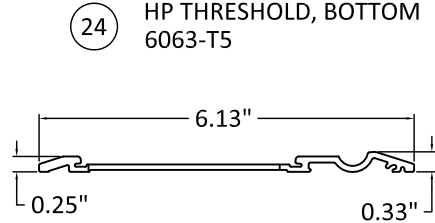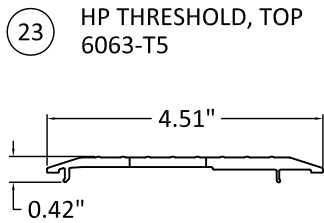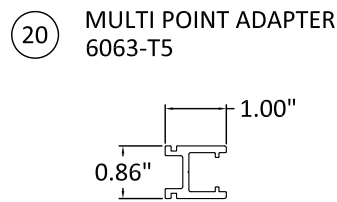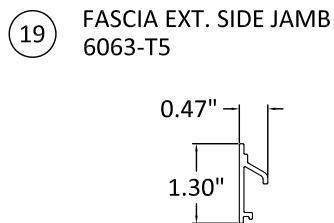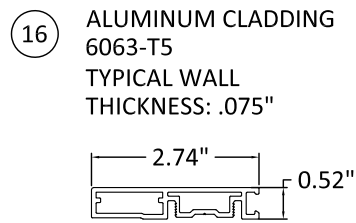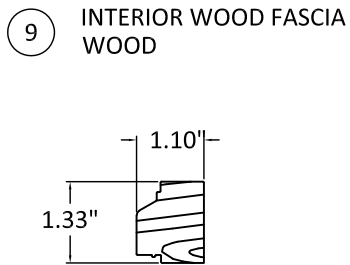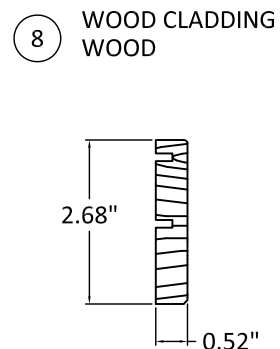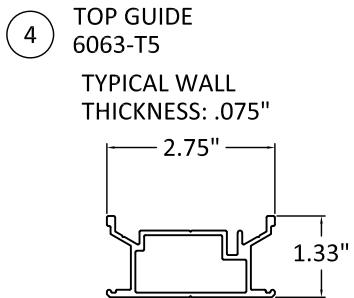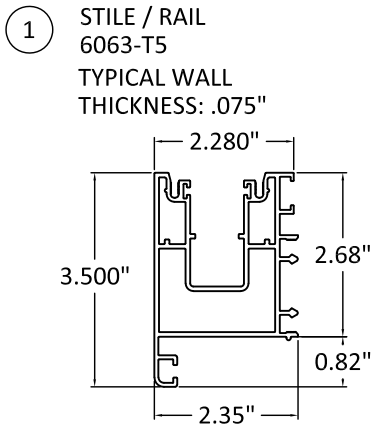

1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE:
AWPD/APD-T/APD PIVOT DOOR
(NON-HVHZ) (NON-IMPACT)


BOM & COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

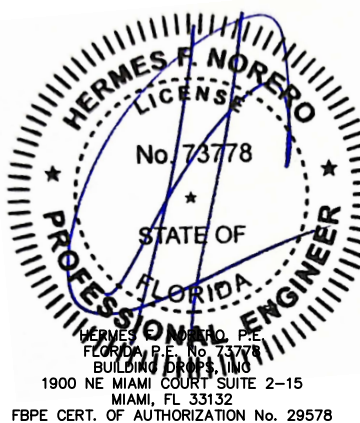

FL #:	FL22224
DATE:	03.08.17
DWG. BY:	LS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD011
SHEET:	8
OF 8	