

*AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)*

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE, INCLUDING HVHZ. THIS PRODUCT HAS BEEN TESTED IN ACCORDANCE WITH THE FOLLOWING STANDARDS:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - ASTM E1886-19
 - ASTM E1996-20
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT, IN NON HVHZ AND TO BE REVIEWED BY BUILDING OFFICIAL. DEVIATION FROM APPROVAL IN THE HVHZ REQUIRES APPROVAL FROM MIAMI-DADE COUNTY RER.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL: DOUGLAS FIR WOOD AND ALUMINUM 6063-T5.
7. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAILS.
8. DESIGNATIONS "X" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUT
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	DESIGN PRESSURE TABLE & LOCKRAIL OPTIONS
6	HARDWARE, CLADDING & GLAZING DETAILS
7	LOCKRAIL DETAILS
8	BOM & COMPONENTS

DESIGN PRESSURE RATING			
OVERALL SIZE	CONFIGURATION	DESIGN PRESSURE	MISSILE IMPACT RATING
SEE SHEET 5	"X" IN SWING OR OUT SWING	SEE SHEET 5	LARGE & SMALL MISSILE - IMPACT

1. DOORS WHICH UTILIZE HP THRESHOLD (ITEMS #22-24) MEET THE WATER INFILTRATION REQUIREMENTS.
2. DOORS WHICH DO NOT UTILIZE HP THRESHOLD OR DON'T USE A SILL AT ALL DO NOT MEET THE WATER INFILTRATION REQUIREMENTS AND SHALL BE INSTALLED IN NON-HABITABLE AREAS OR HABITABLE AREAS PROTECTED BY AN OVERHANG OR CANOPY SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES.


INSTALLATION & GENERAL NOTES

BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.06.23 16:05:25 -04'00'

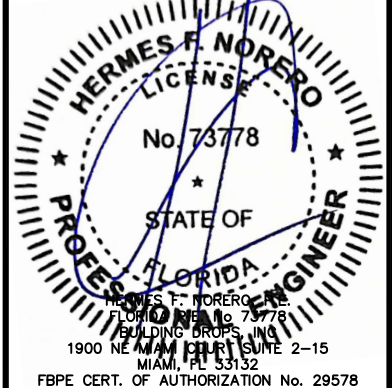

FL #: FL22224

DATE: 06.21.17



DWG. BY: SM/AR	CHK. BY: HFN
--------------------------	------------------------

SCALE: NTS



DWG. #: WSD012

SECTION: 1

c:\users\msun\building drops, inc\building drops landing - common\projects\weiland sliding doors\lbc-25-0534 - fbc submittal - fl22224 pivot door - sill anchor revision\dwgs\wso12.dwg 6/23/2025 11:38 AM

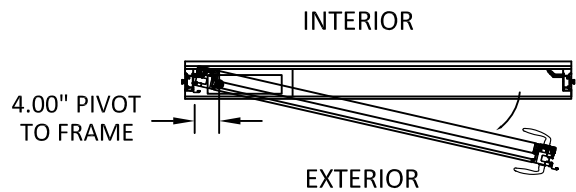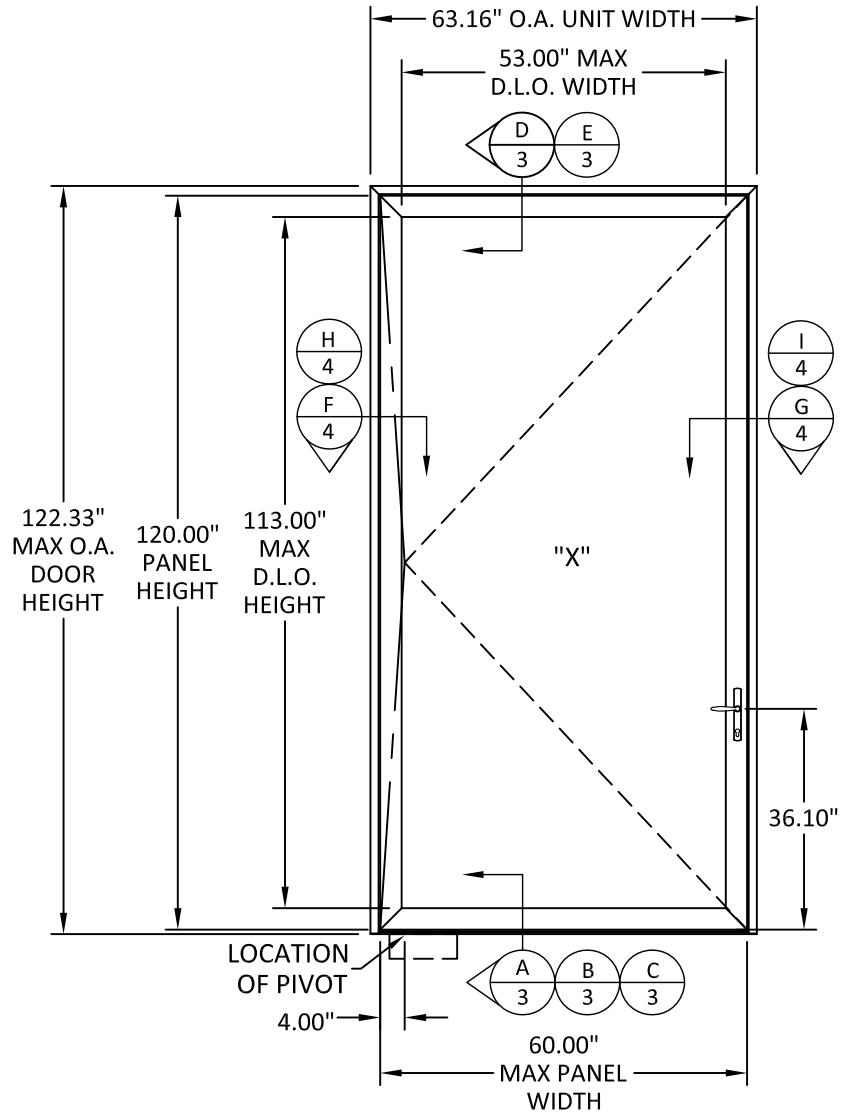


TYPICAL ELEVATION
PIVOT DOOR - 4" PIVOT POINT

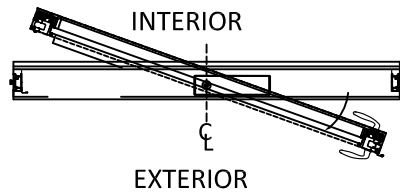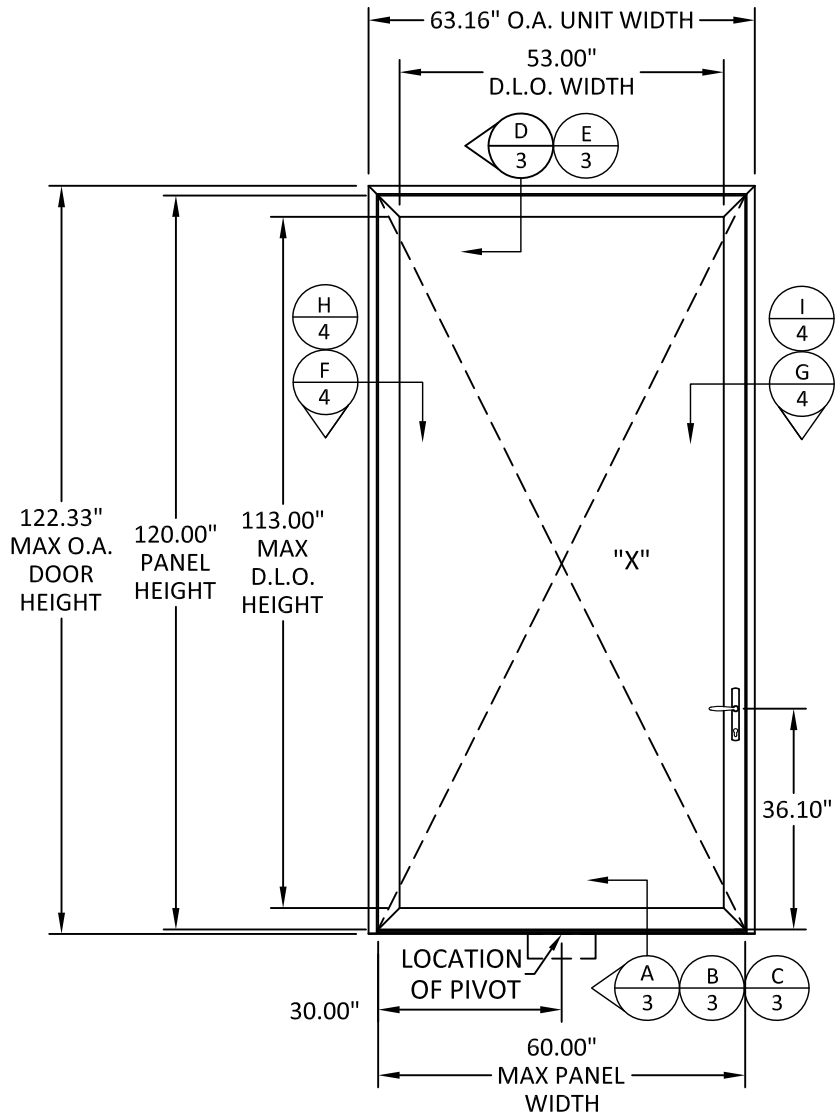

TYPICAL ELEVATION
PIVOT DOOR - CENTER PIVOT POINT

- NOTES:
- 1) PIVOT POINT APPROVED FOR ANY DISTANCE BETWEEN 4" FROM THE FRAME AND AT THE CENTER OF FRAME.
 - 2) CONFIGURATION APPROVED FOR EITHER INSWING OR OUTSWING
 - 3) TYPICAL ELEVATION SHOWN, SEE SHEET 5 FOR ALTERNATE QUALIFIED SIZES

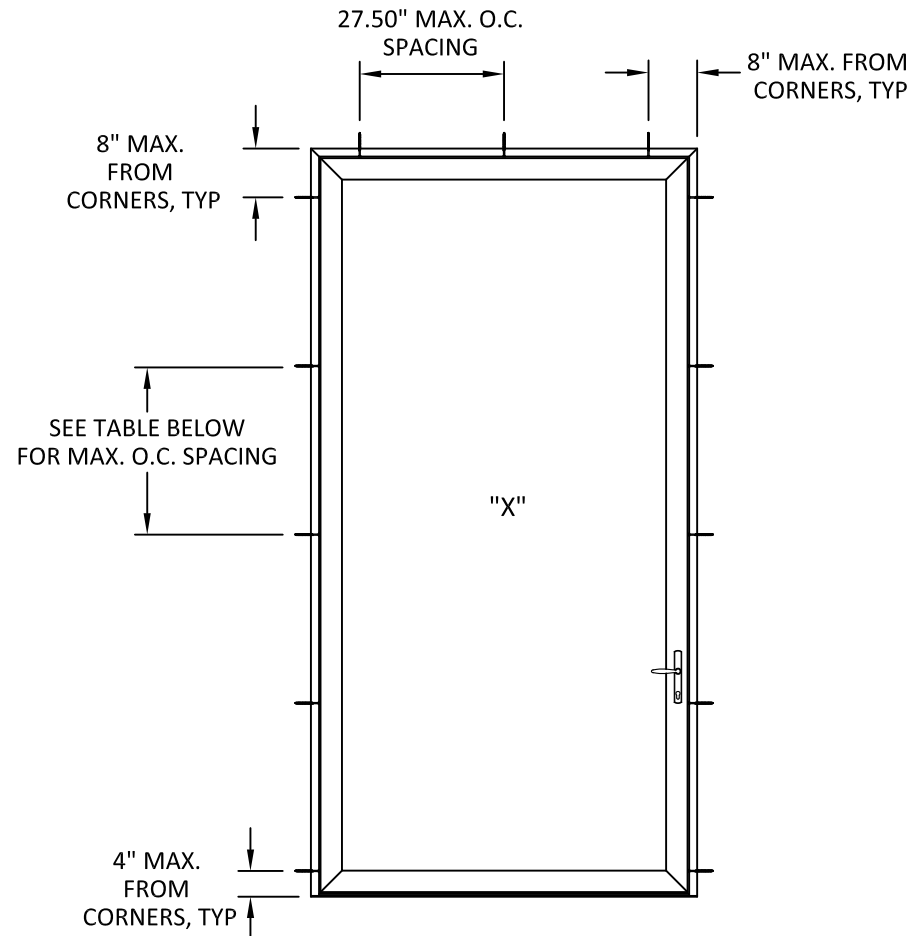

ANCHOR LAYOUT

ANCHOR TYPE	SUBSTRATE	MAX. O.C. SPACING @ JAMBS
#10 WOOD SCREW	WOOD, MIN. SG = 0.55	16"
#10 GR. 5 SMS	STEEL, MIN. 14 GA. MIN. Fy = 33 ksi	21"
	ALUMINUM, MIN. 1/8", MIN. 6063-T5	18 3/4"
3/16" ITW TAPCON	CONCRETE, MIN. f'c = 3000 psi	14"
	MASONRY, MIN. 2000 psi	11 1/4"



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE: AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)

ELEVATIONS & ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

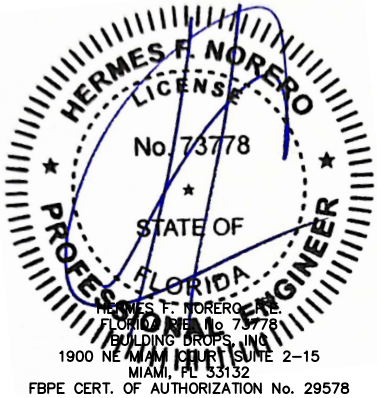

FL #:

FL22224

DATE: 06.21.17

DWG. BY:

SM/AR

CHK. BY:

HFN

SCALE:

NTS

DWG. #:


WSD012

SECTION:


2

OF 8


c:\users\msun\building drops, inc\building drops landing - common\projects\weiland sliding doors\lbc-25-0534 - fbc submittal - fl22224 pivot door - sill anchor revision\dwgs\wso012.dwg 6/23/2025 11:38 AM

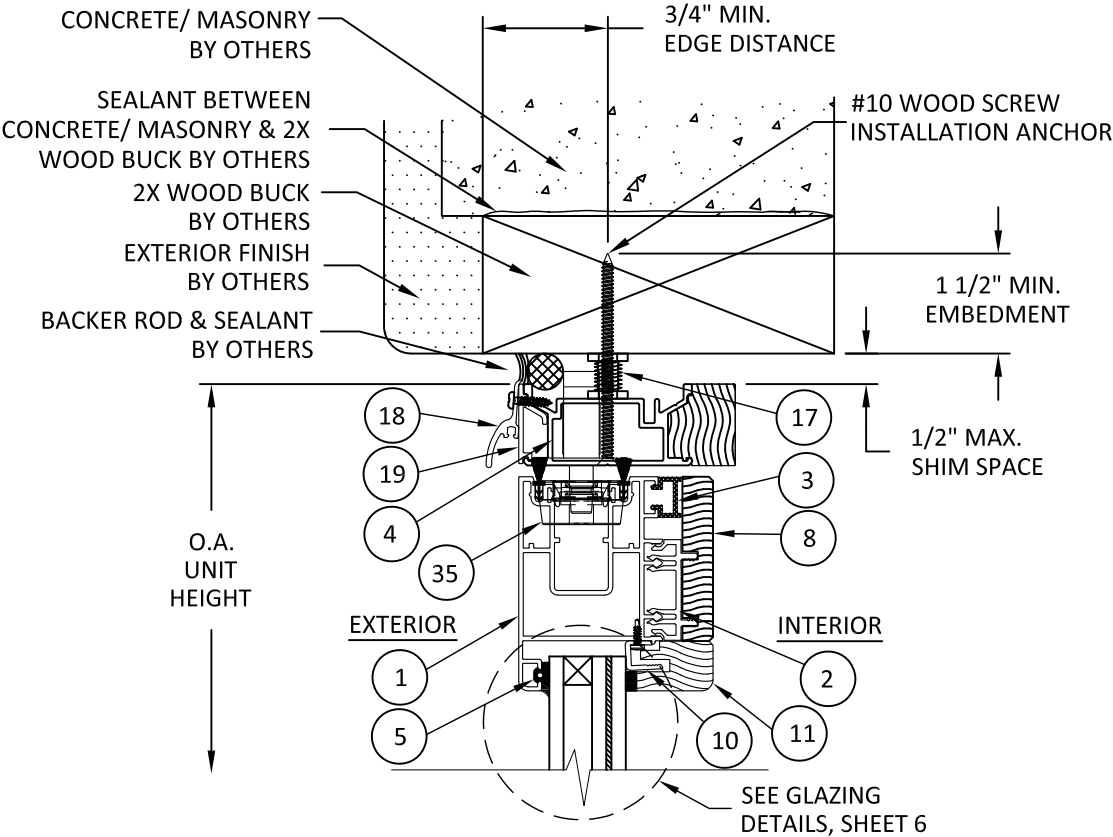


D
3 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK

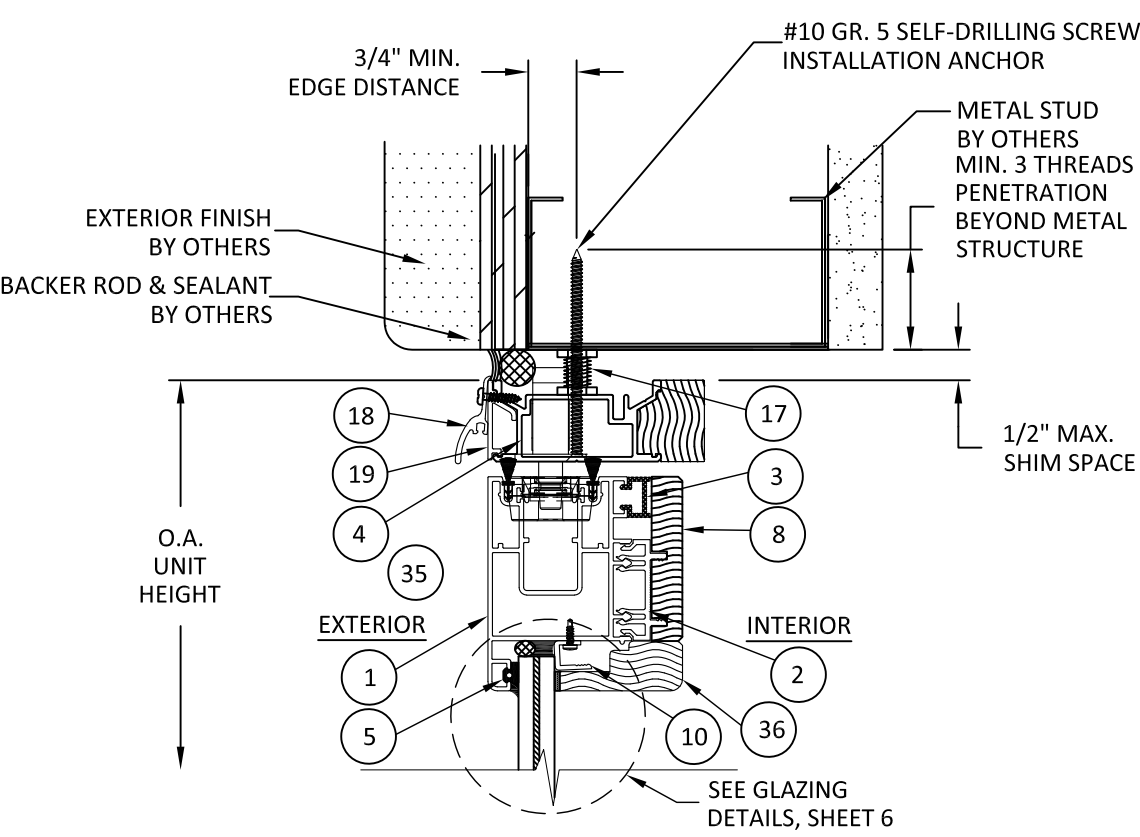


E
3 **VERTICAL SECTION**
HEAD - METAL STUD

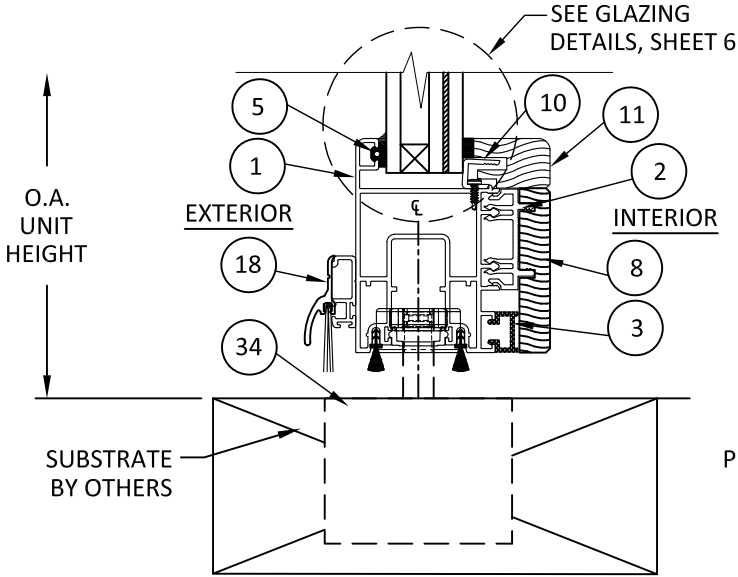

A
3 **VERTICAL SECTION**
SILL - 2X WOOD BUCK
NO SILL THRESHOLD OPTION
NON-WATER RATED

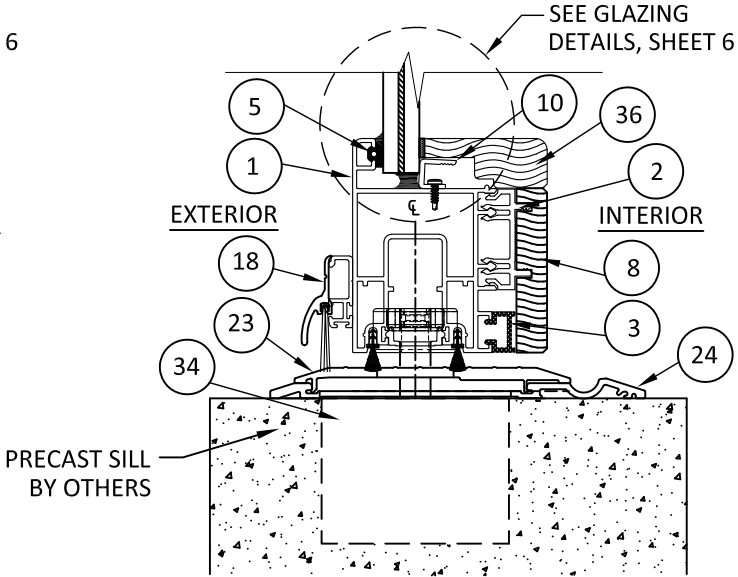

B
3 **VERTICAL SECTION**
SILL - MASONRY/CONCRETE
NON-WATER RATED THRESHOLD

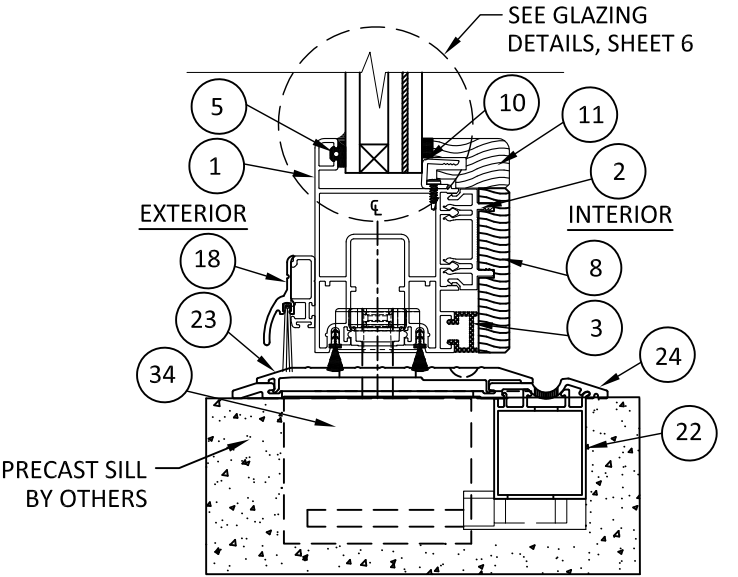

C
3 **VERTICAL SECTION**
SILL - MASONRY/CONCRETE
WATER RATED THRESHOLD




1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE: AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)
VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

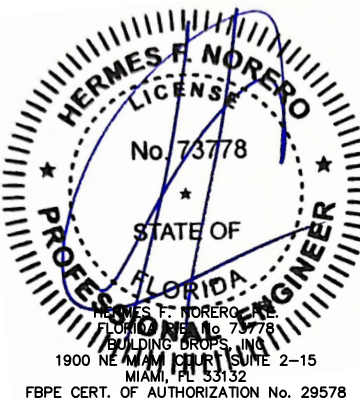


FL #:	FL22224
DATE:	06.21.17
DWG. BY:	SM/AR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD012
SECTION:	3
	OF 8

6/23/2025 11:38 AM


c:\users\msun\building drops, inc\building drops landing - common\projects\weiland sliding doors\lbc-25-0534 - fbc submittal - fl22224 pivot door - sill anchor revision\dwgs\wso12.dwg

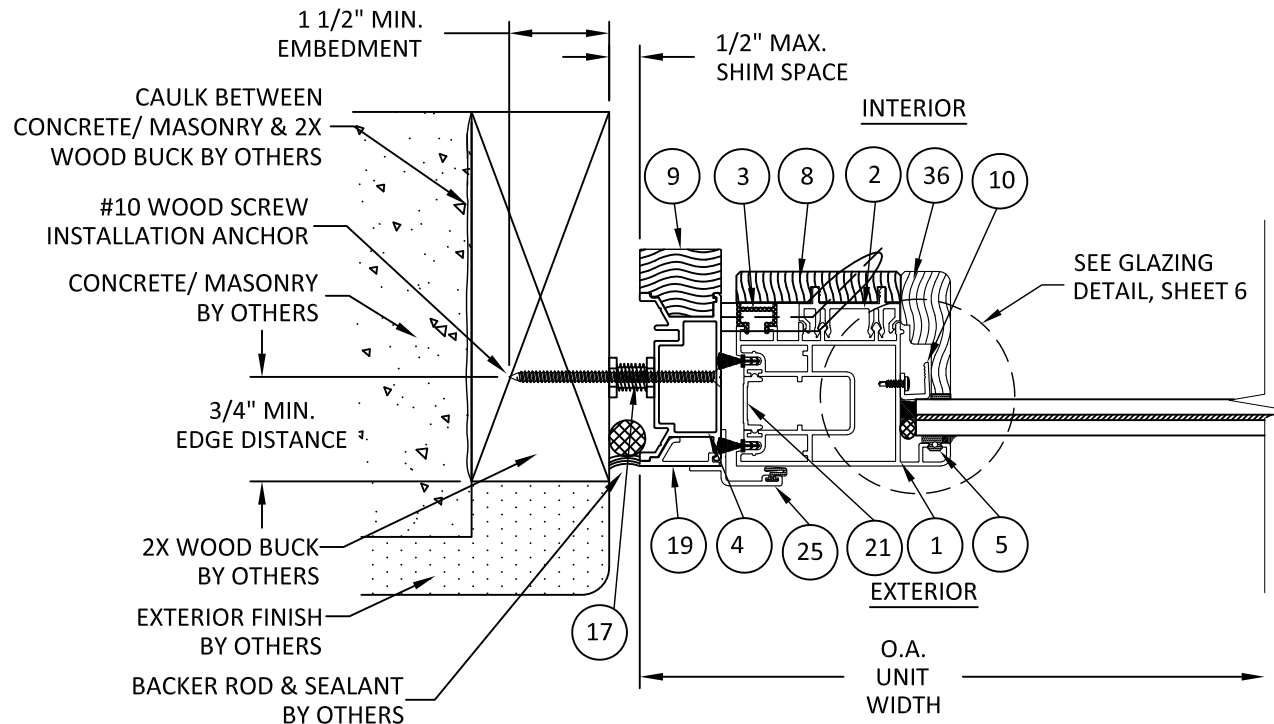


H
4 **HORIZONTAL SECTION**
JAMB - 2X WOOD BUCK
OUTSWING CONFIG.

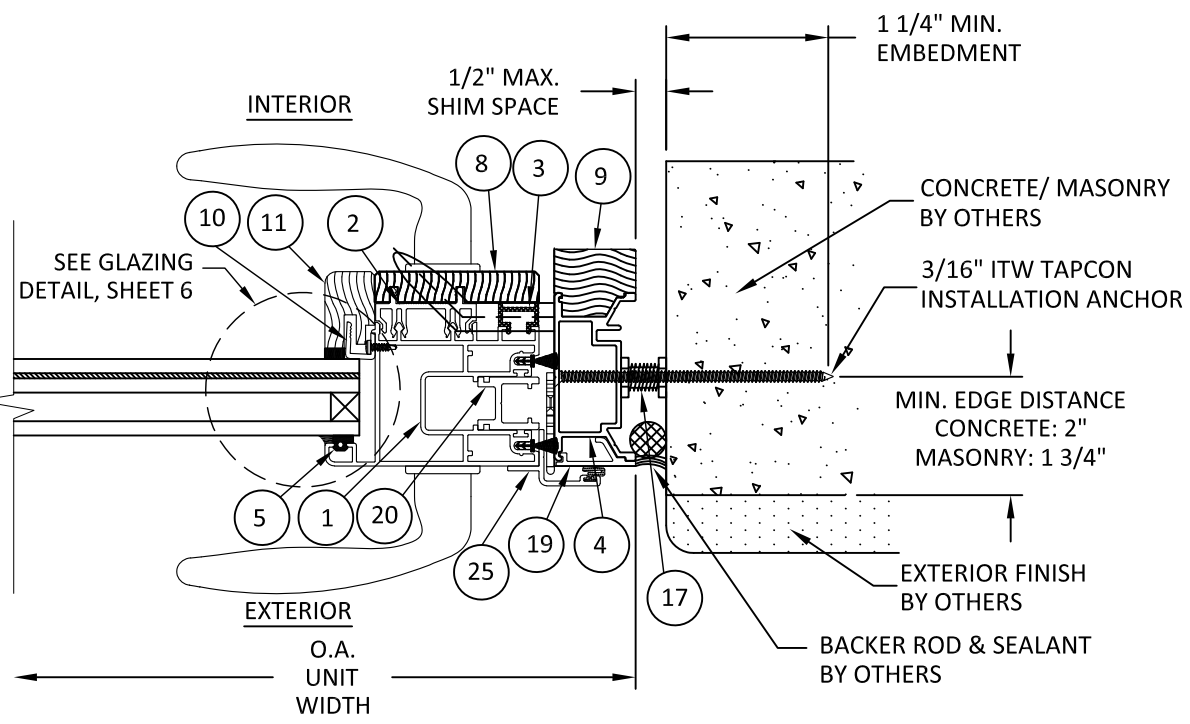

I
4 **HORIZONTAL SECTION**
JAMB - MASONRY/CONCRETE
OUTSWING CONFIG.

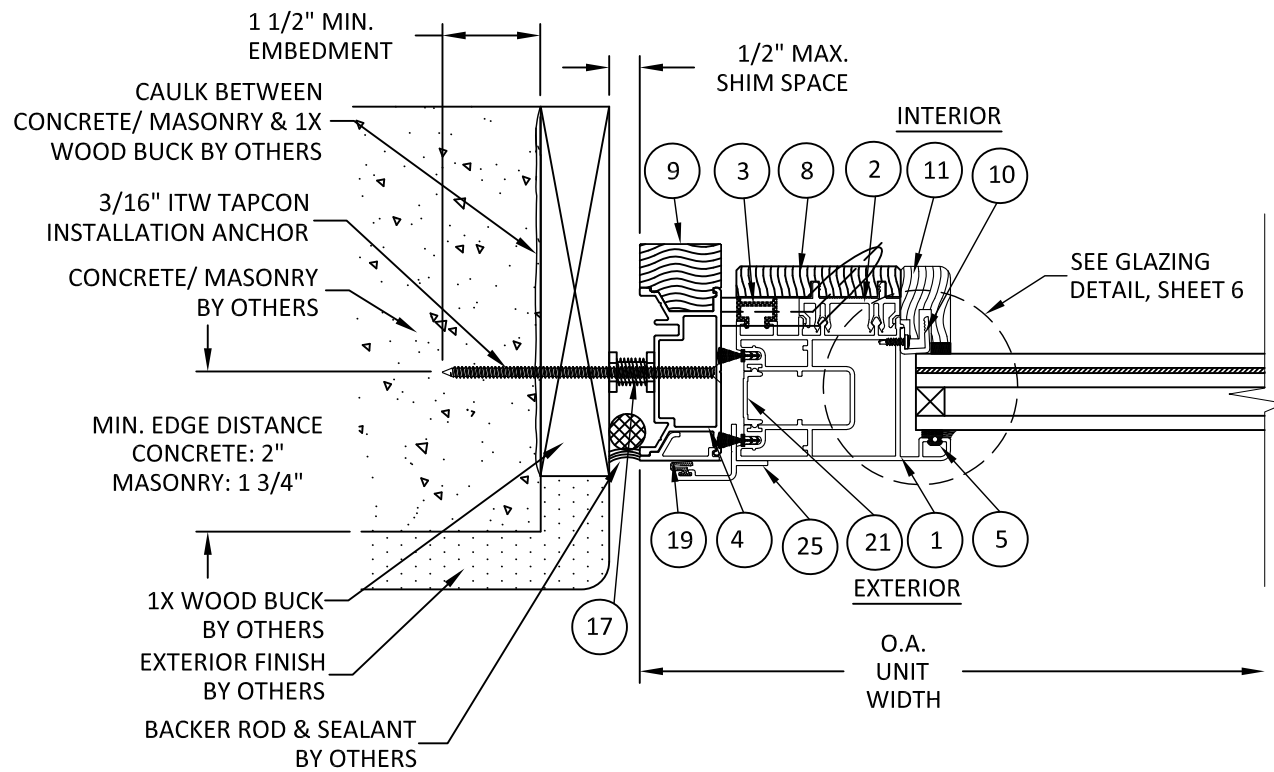

F
4 **HORIZONTAL SECTION**
JAMB - 1X WOOD BUCK - MASONRY/CONCRETE
INSWING CONFIG.

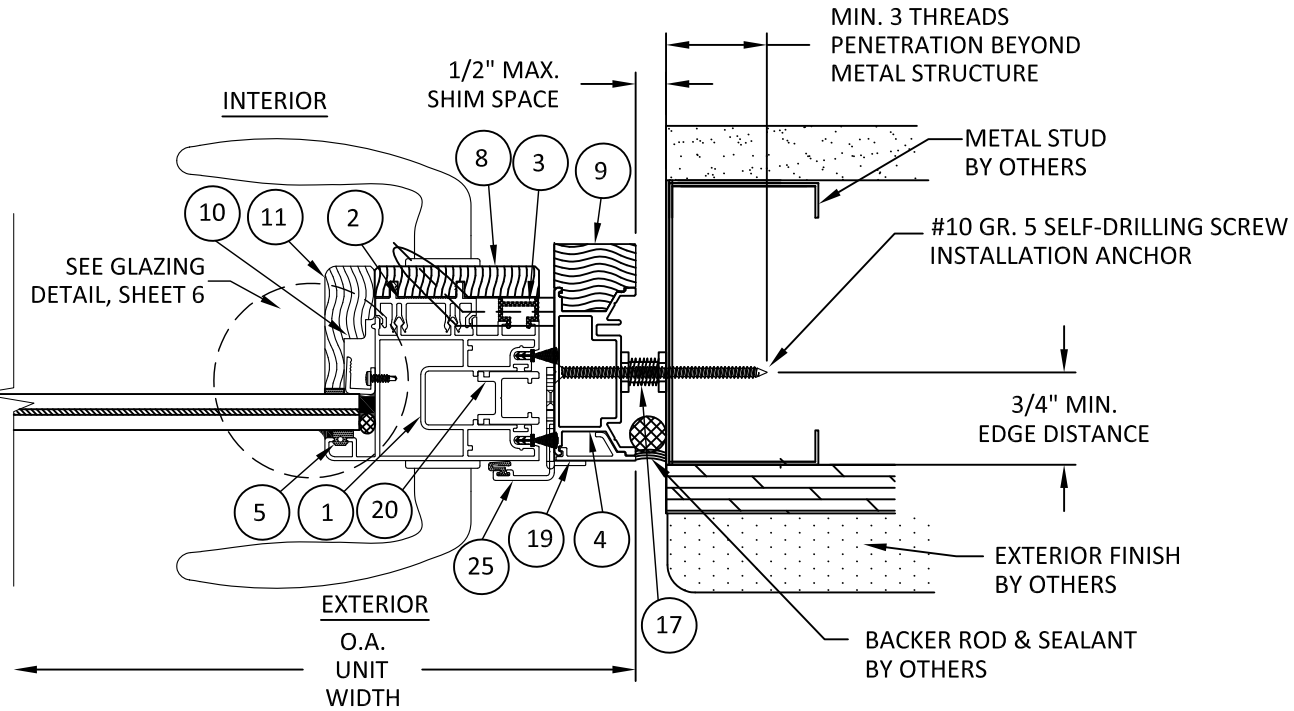

G
4 **HORIZONTAL SECTION**
JAMB - METAL STUD
INSWING CONFIG.



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE: AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

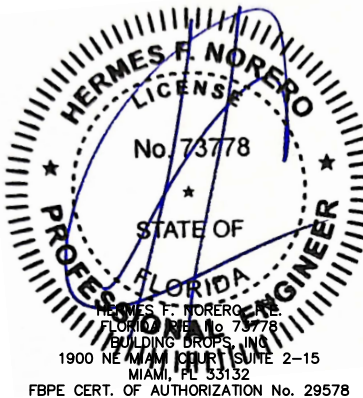

FL #:
FL22224

DATE: **06.21.17**

DWG. BY: **SM/AR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WSD012**

SECTION:

4


OF 8

MULTIPOINT LOCKING SYSTEM ALLOWABLE PANEL SIZES

PANEL WIDTH	PANEL HEIGHT	MINIMUM PIVOT OFFSET FROM JAMB	POSITIVE ALLOWABLE DESIGN PRESSURE	NEGATIVE ALLOWABLE DESIGN PRESSURE
48	96	4.00	60	60
51		4.00	60	60
54		4.00	60	60
57		4.00	60	60
60		4.00	60	60
63		6.74	49	49
66		9.36	40	40
69		11.89	33	33
72		14.33	28	28
48	108	4.00	60	60
51		4.00	60	60
54		4.00	60	60
57		4.00	60	60
60		4.00	60	60
63		6.74	49	49
66		9.36	40	40
45		4.00	60	60
48	120	4.00	60	60
51		4.00	60	60
54		4.00	60	60
57		4.00	60	60
60		4.00	60	60
48		4.00	60	60
51		4.00	60	60
54		4.00	60	60
48	132	4.00	60	60
51		4.00	60	60
54		4.00	60	60
48	144	4.00	60	60


DESIGN PRESSURE NOTES:

- DESIGN PRESSURE SHALL BE LIMITED TO VALUES LISTED IN ABOVE TABLE BASED ON PANEL SIZE.
- MULTIPOINT LOCKING LOCATIONS SHALL NOT EXCEED THE SPACING ALONG THE JAMBS AS SHOWN ON SHEET 6. ADDITIONAL LOCKING POINTS SHALL BE USED AS REQUIRED TO MAINTAIN TESTED SPACING.

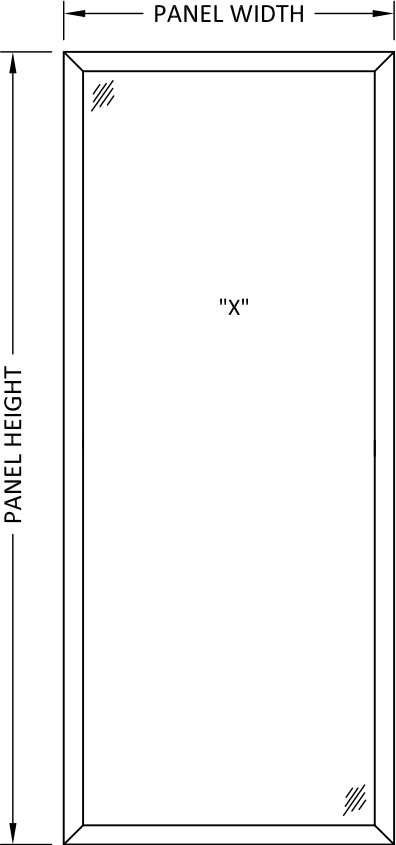

SIZE NOTES:
PANEL SIZES SHOWN IN TABLE.
FRAME SIZES ARE AS FOLLOWS:
FRAME WIDTH = PANEL WIDTH + 3 3/16"
FRAME HEIGHT = PANEL HEIGHT + 2 7/16"
DLO SIZES ARE AS FOLLOWS:
DLO WIDTH = PANEL WIDTH - 7"
DLO HEIGHT = PANEL HEIGHT - 7"

ALLOWED LOCKRAIL CONFIGURATIONS:

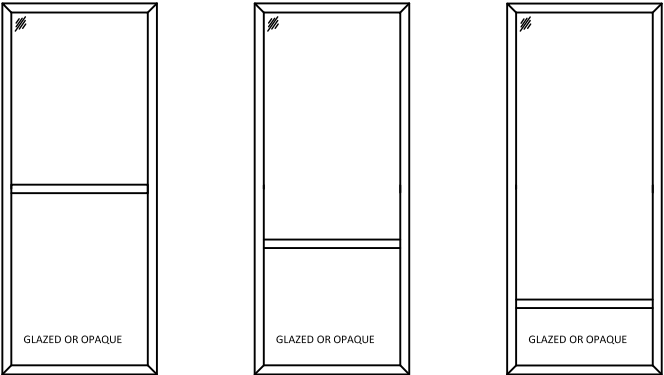

LOCKRAIL NOTES:

- LOCKRAIL MAY BE USED AT ANY LOCATION ON THE PANEL SUCH THAT THE TESTED SQUARE FOOTAGE OF THE OPAQUE INFILL PANEL IS NOT EXCEEDED.
 - TESTED INFILL PANEL DLO SIZE (W x H):
53" x 55" = 20.24 SQ. FT.
- LOCK RAIL USE SHALL BE LIMITED TO PANELS 60" WIDE OR LESS.
- LOCKRAIL QUALIFIED FOR USE FOR "GLAZED OVER GLAZED" OR "GLAZED OVER OPAQUE" PANELS, SEE DETAILS ON SHEET 7.




1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE:
AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)
DESIGN PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

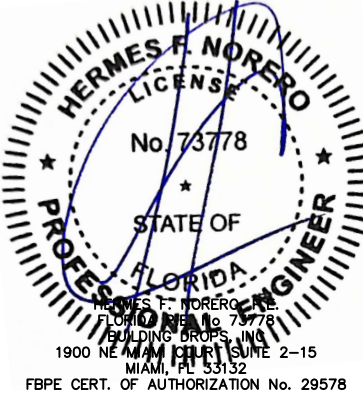

FL #:
FL22224

DATE: **06.21.17**

DWG. BY: **SM/AR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WSD012**

SECTION:
5
OF 8


6/23/2025 11:38 AM

c:\users\msun\building drops, inc\building drops landing - common\projects\weiland\sliding doors\flc-25-0534 - flc submittal - fl22224 pivot door - sill anchor revision\dwgs\wso12.dwg

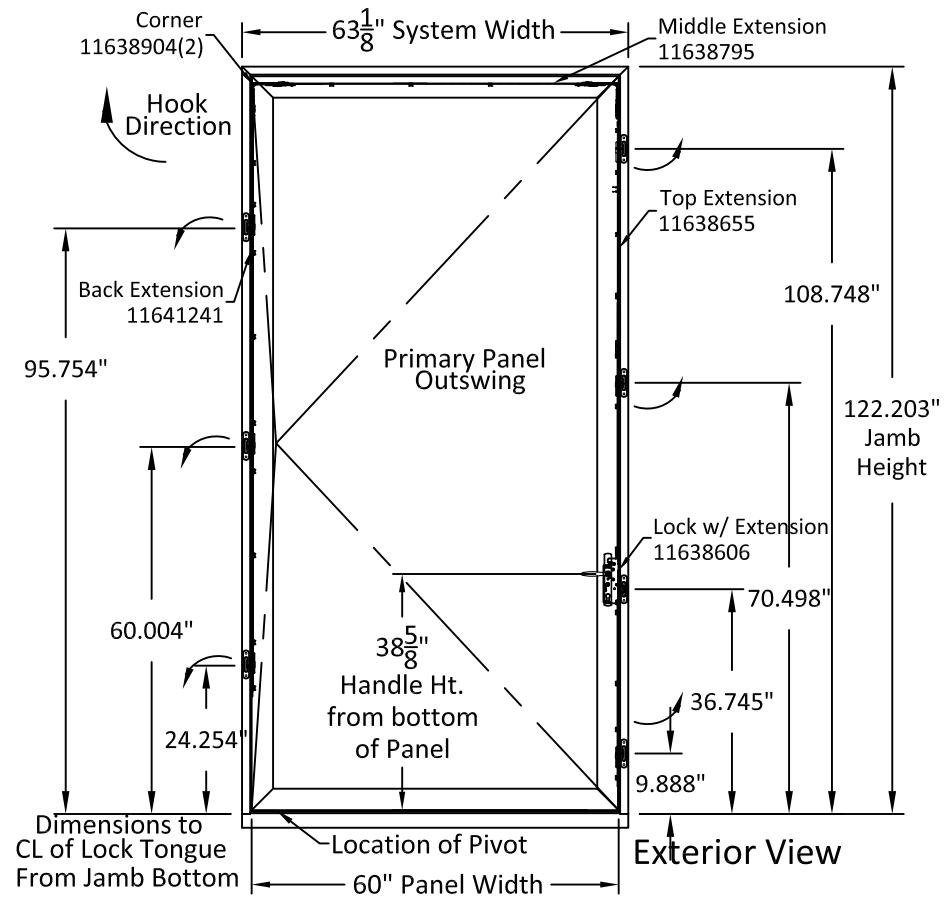

TYPICAL MULTIPOINT HARDWARE

OPTIONAL ALUM. CLADDING

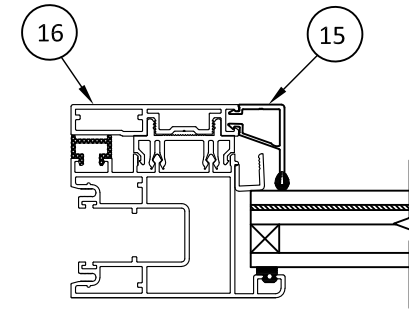


APD-T DETAIL

NOTES:


- 1) DETAIL SHOWN IS REPRESENTATIVE OF THE COMPONENTS USED AT ALL MEMBERS OF THE PIVOT DOOR.
- 2) ALUMINUM CLADDING FRAME PROFILES MAY BE USED AS AN ALTERNATIVE TO ANY WOOD CLADDING FRAME IN THE CONFIGURATIONS APPROVED WITHIN THIS DOCUMENT.

1-1/4" O.A. LAMINATED INSULATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS
ALUMINUM SPACER (A1-D)
1/4" HEAT STRENGTHENED GLASS
0.090" KURARAY SENTRYGLAS INTERLAYER
1/4" HEAT STRENGTHENED GLASS

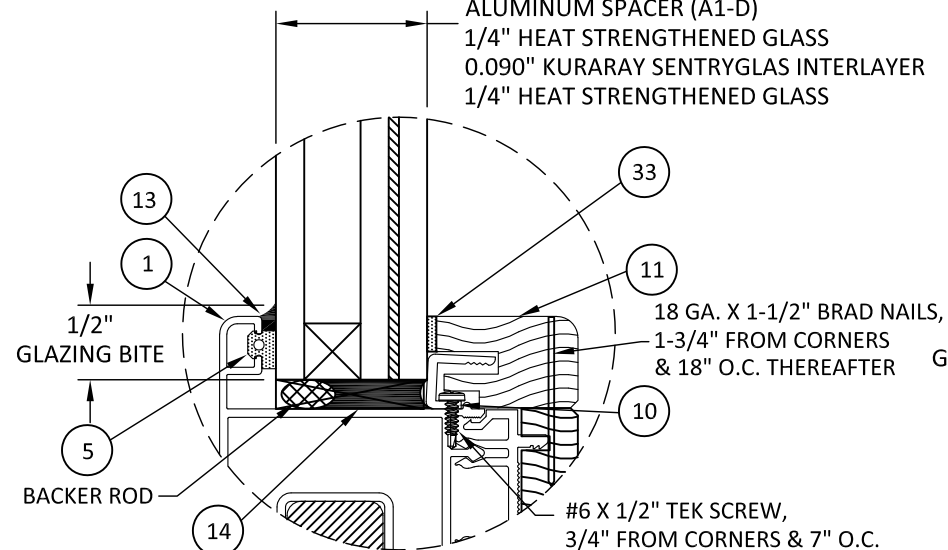


GLAZING DETAIL G1

9/16" O.A. LAMINATED GLASS CONSISTING OF:
1/4" HEAT STRENGTHENED GLASS
0.090" KURARAY SENTRYGLAS INTERLAYER
1/4" HEAT STRENGTHENED GLASS

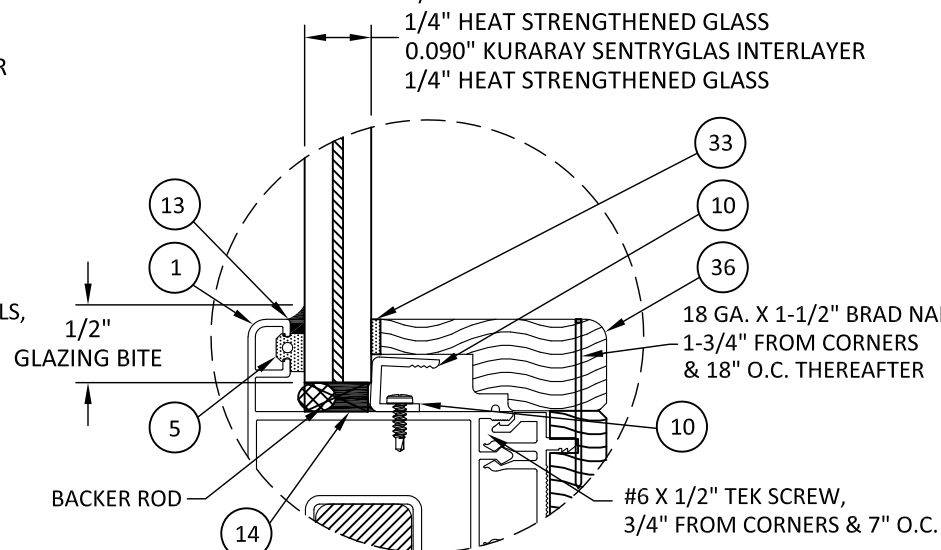

GLAZING DETAIL G2

1-1/4" O.A. INFILL PANEL
CONSISTING OF:
1/8" ALUMINUM
3/8" FIN. BIRCH PLY
3/4" VENEERED PLY

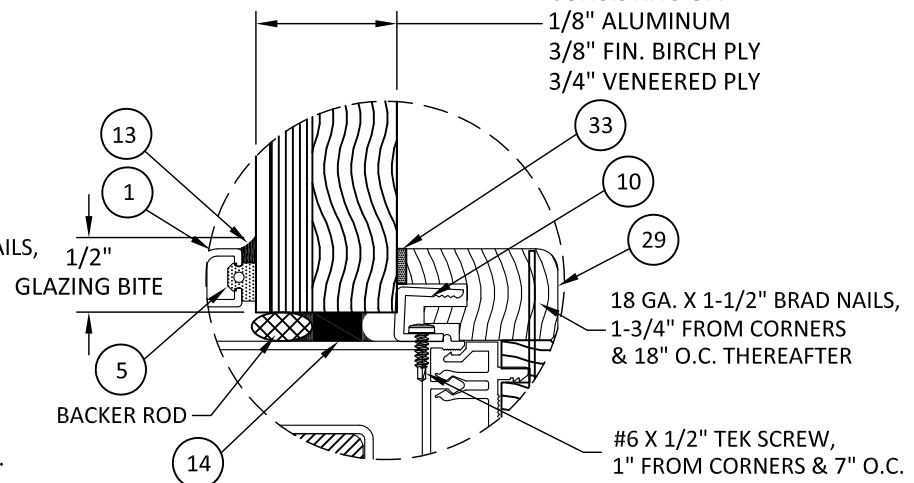

GLAZING DETAIL G3

MAX. SIZE LIMITED TO 'HALF PANEL' OR LESS
CONFIGURATIONS, SEE DIAGRAM ON SHEET 5



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE: AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)

HARDWARE & CLADDING DETAIL


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

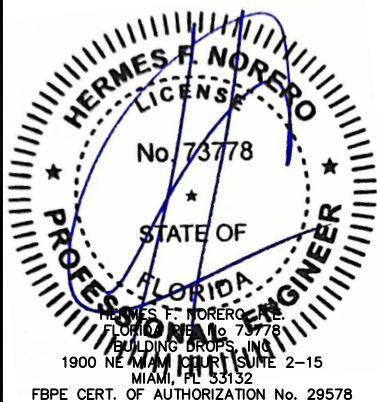

FL #:	FL22224
DATE:	06.21.17
DWG. BY:	SM/AR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD012
SECTION:	6

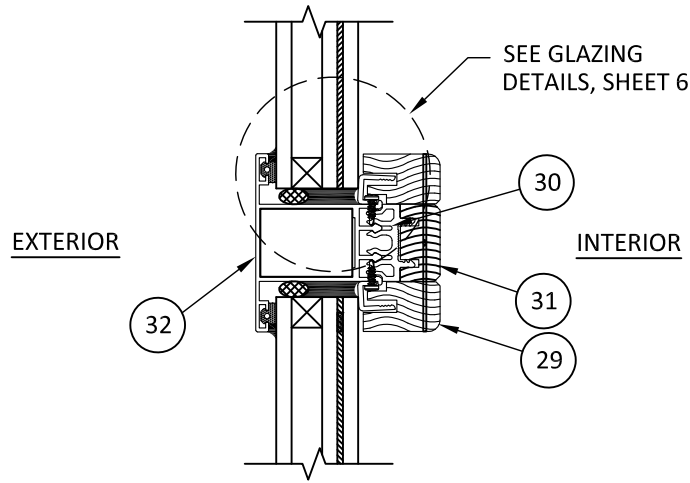


J
7 **VERTICAL SECTION**
MIDRAIL - GLASS OVER GLASS

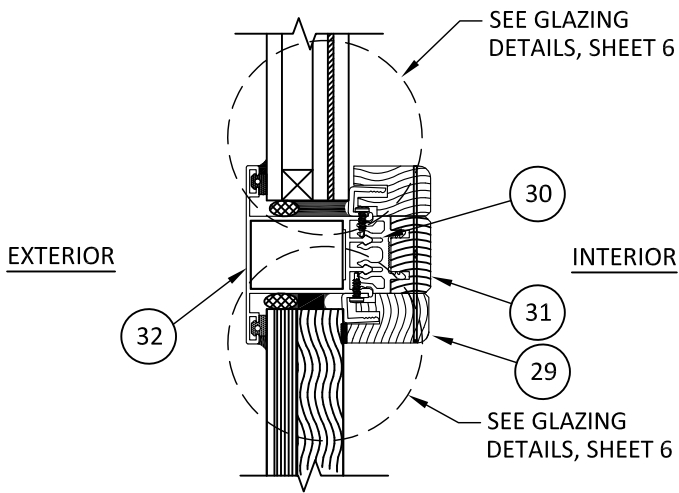


K
7 **VERTICAL SECTION**
MIDRAIL - GLASS OVER INFILL PANEL

NOTE: SECTION VIEW OF OPAQUE
PANEL IS TYPICAL, SILL AND
JAMBS SIMILAR.

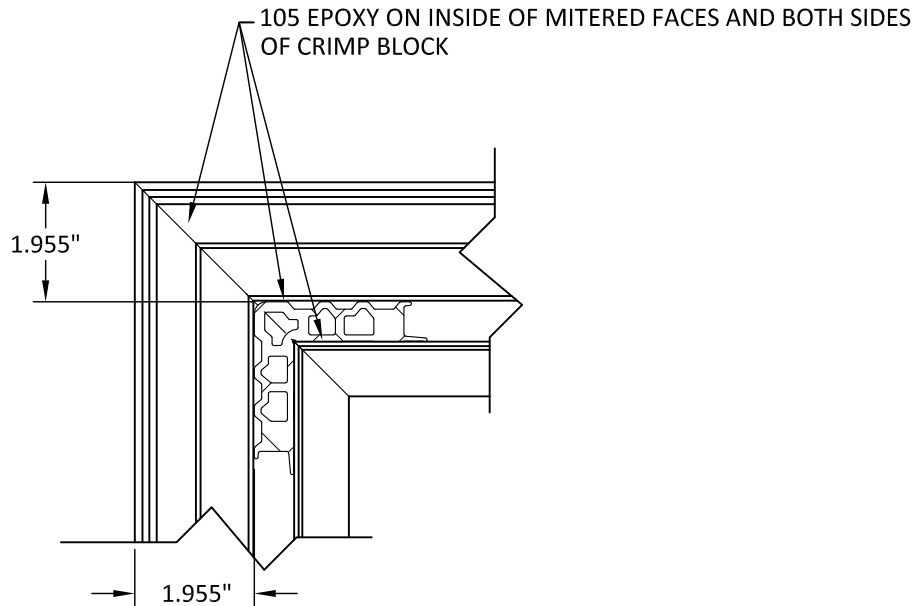

PANEL CORNER ASSEMBLY

NOTE: THIS JOINT IS TYPICAL FOR
ALL FOUR CORNERS OF PANEL.

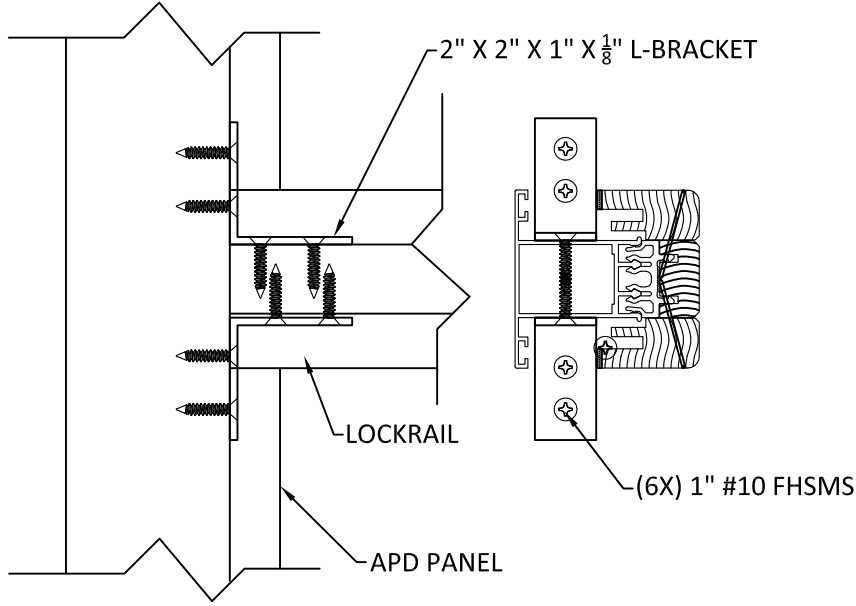

LOCKRAIL ATTACHMENT DETAIL



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725


TITLE:
AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)
MIDRAIL DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

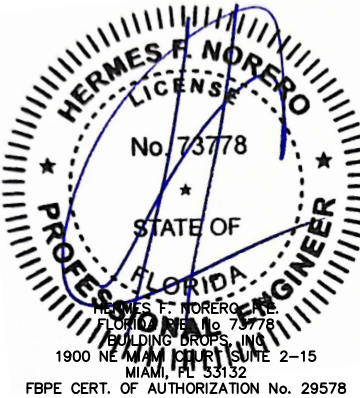

FL #:
FL22224

DATE: **06.21.17**

DWG. BY: **SM/AR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WSD012**


SECTION:

7


OF 8

BILL OF MATERIALS			
ITEM No.	DESCRIPTION	MATERIAL	PART No.
1	STILE/RAIL	6063-T5	1020
2	LARGE CLIP	PVC	40126
3	H-BAR	PVC	40146
4	TOP GUIDE	6063-T5	1017
5	GLAZING GASKET	SANTOPRENE	40106
6	SETTING BLOCKS $\frac{1}{4}$ " X $1\frac{5}{8}$ " X 2"	NEOPRENE	NSB 85D
7	PVC SPACER	PVC	40244
8	WOOD CLADDING	WOOD	5001
9	INTERIOR WOOD FASCIA	WOOD	5006
10	J-CLIP	PVC	40201
11	I.G. WOOD GLAZING BEAD	WOOD	5003a-e
12	NOT USED	-	-
13	DOW 995 OR DOW 983 CAP BEAD	SILICONE	-
14	DOW 983	SILICONE	-
15	ALS-T GLASS STOP	6063-T5	1242
16	ALUMINUM CLADDING	6063-T5	1241
17	JACKING SCREW	ZAMAK & PLASTIC	20228
18	DRIP EDGE	6063-T5	1183
19	FASCIA EXT. SIDE JAMB	6063-T5	1076
20	MULTI POINT ADAPTER	6063-T5	1239
21	COVER PLATE	PVC	1236
22	HP. THRESHOLD COLLECTION RAIL	6063-T5	1286
23	HP THRESHOLD, TOP	6063-T5	1285
24	HP THRESHOLD, BOTTOM	6063-T5	1284
25	ASTRAGAL	6063-T5	1226
26	-	-	-
27	-	-	-
28	-	-	-
29	INFILL PANEL GLAZING BEAD	WOOD	-
30	SMALL CLIP	PVC	40150
31	LOCKRAIL INTERIOR CLADDING	WOOD	5007
32	LOCKRAIL	6063-T5	1034
33	ADHESIVE FOAM GASKET	FOAM	-
34	FLOOR CLOSER PIVOT	-	J990NH0D
35	ADJUSTABLE TOP PIVOT	-	J580DU
36	MONO GLAZING BEAD	WOOD	-


20 MULTI POINT ADAPTER
6063-T5




21 COVER PLATE
6063-T5




22 HP THRESHOLD
COLLECTION RAIL
6063-T5




29 INFILL PANEL GLAZING BEAD
WOOD




30 SMALL CLIP
PVC




31 LOCKRAIL INTERIOR CLADDING
WOOD




32 LOCKRAIL 6063-T5
TYPICAL WALL
THICKNESS: .066"




23 HP THRESHOLD, TOP
6063-T5




24 HP THRESHOLD, BOTTOM
6063-T5




25 ASTRAGAL
6063-T5




1 STILE / RAIL
6063-T5
TYPICAL WALL
THICKNESS: .075"

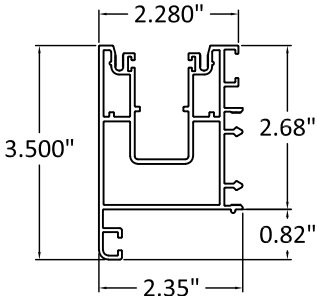


2 LARGE CLIP
PVC




3 H-BAR
PVC




4 TOP GUIDE
6063-T5
TYPICAL WALL
THICKNESS: .075"




5 GLAZING GASKET
SANTOPRENE




6 SETTING BLOCK
NEOPRENE




7 PVC SPACER
PVC




8 WOOD CLADDING
WOOD




9 INTERIOR WOOD FASCIA
WOOD




10 J-CLIP
PVC




11 I.G. GLAZING BEAD
WOOD




15 I.G. GLASS STOP
6063-T5
TYPICAL WALL
THICKNESS: .079"




17 JACKING SCREW



18 DRIP EDGE
6063-T5



19 FASCIA EXT. SIDE JAMB
6063-T5



1319 ROCKY POINT DRIVE #100
OCEANSIDE, CA 92056
PH: (715) 933-2725

TITLE: AWPD/APD-T PIVOT DOOR
(HVHZ) (IMPACT)
BOM & COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
SILL ANCHOR REVISION	MS	06/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

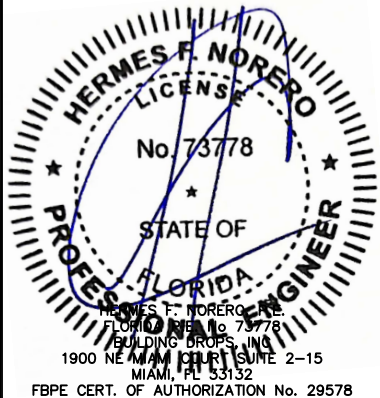

FL #:

FL22224

DATE: 06.21.17

DWG. BY:

SM/AR

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

WSD012

SECTION:

8

OF 8