


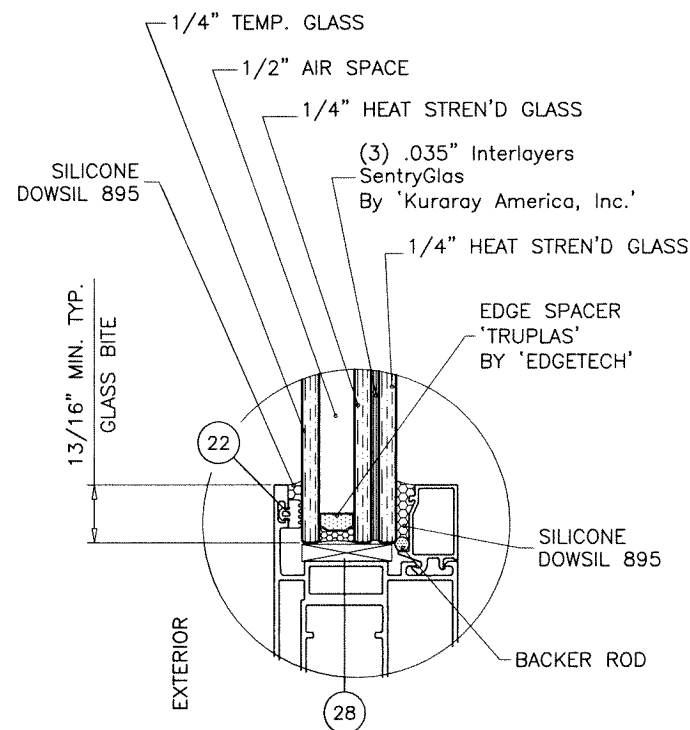

GLAZING DETAIL
1-5/16" OVERALL INSUL. LAM. GLASS

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

ES-LS7035
LIFT & SLIDE ALUMINUM GLASS DOOR (L.M.I.)

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

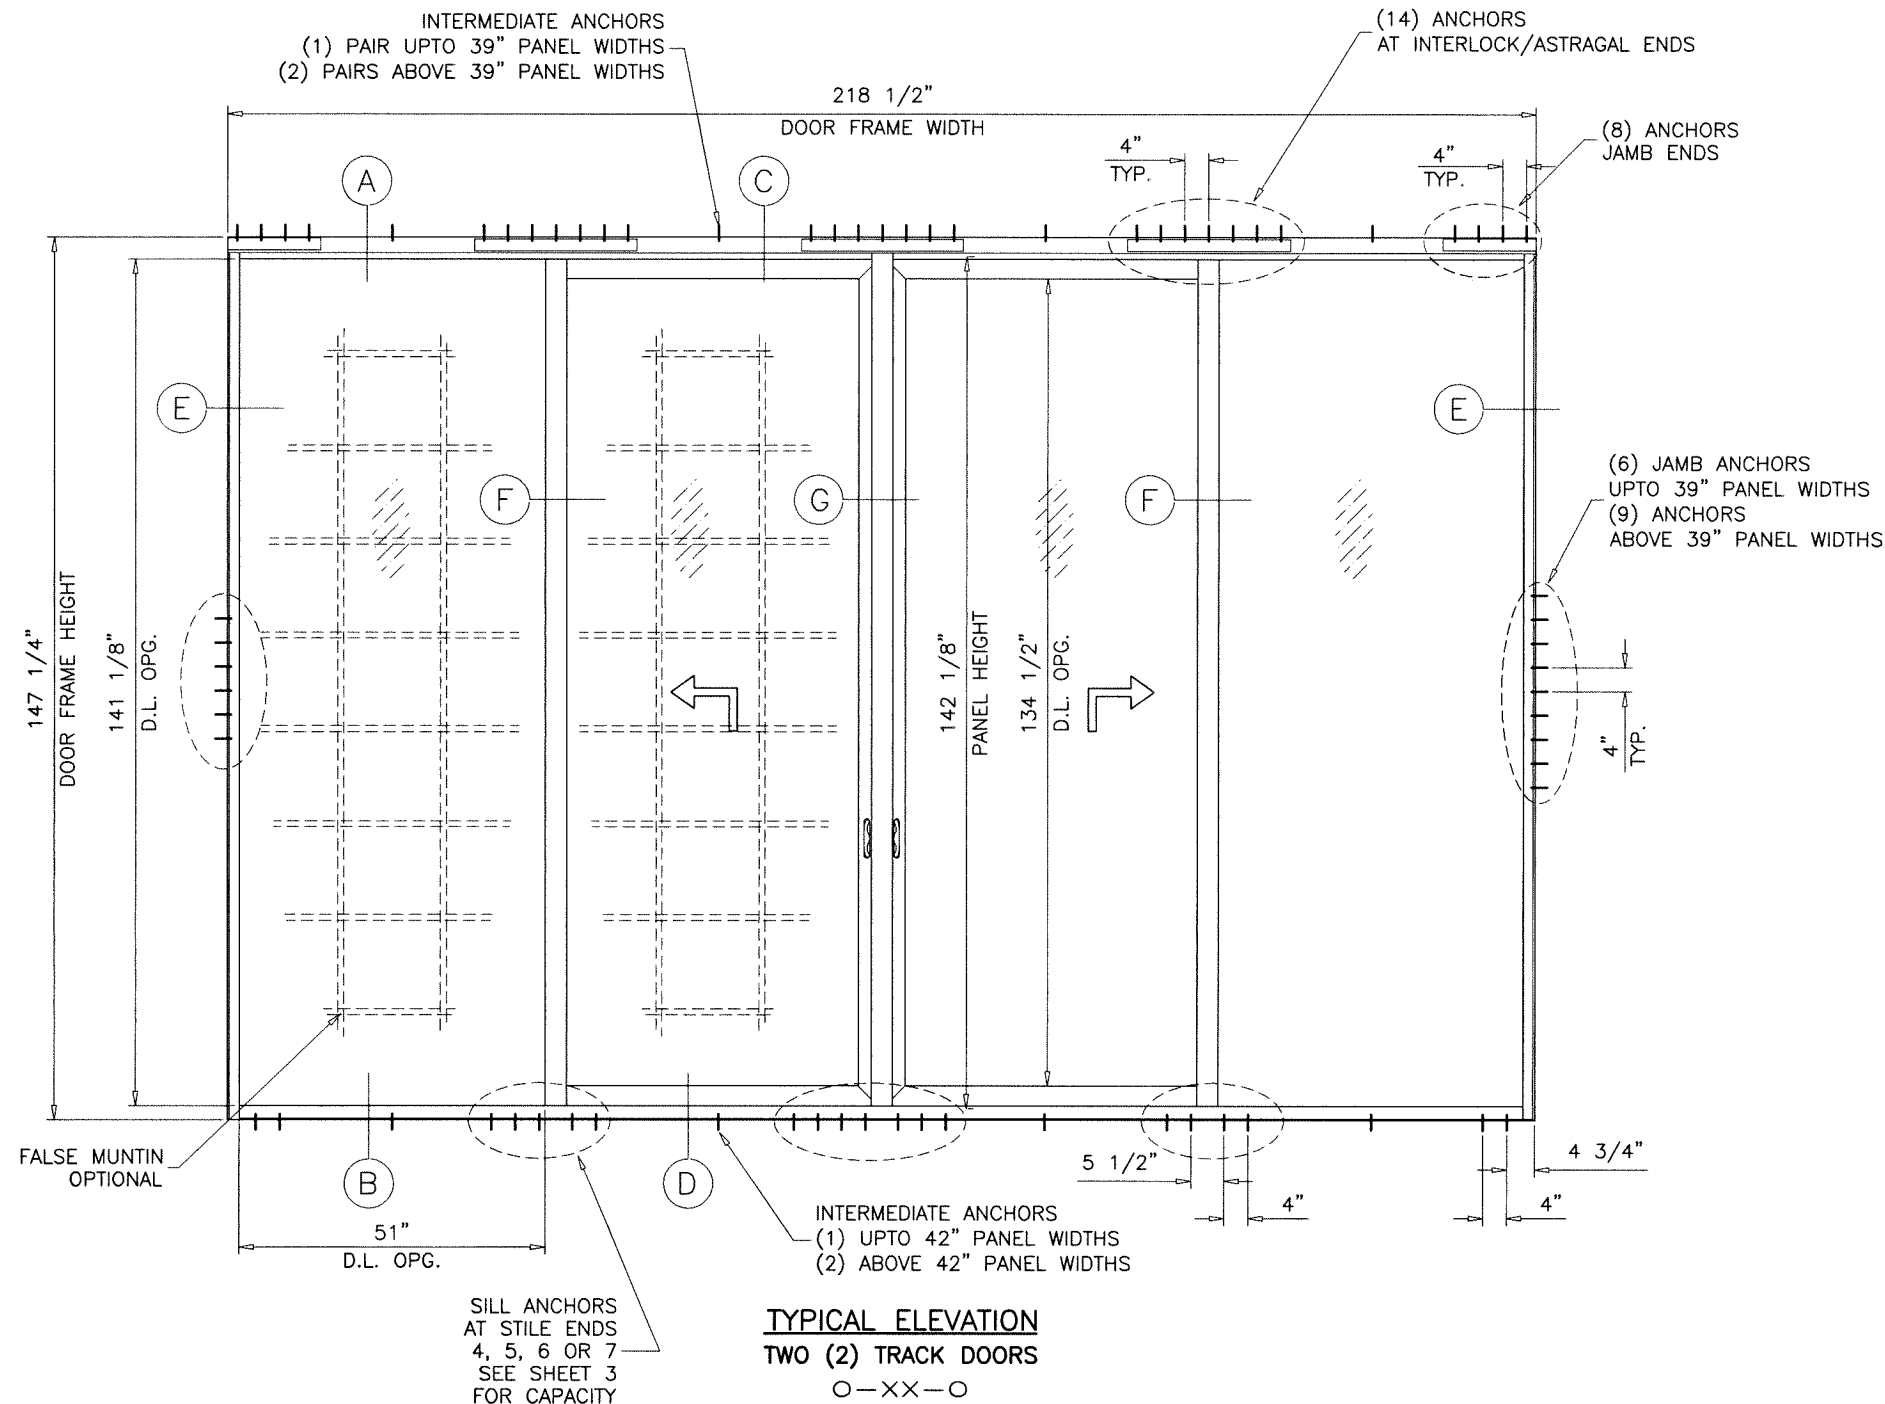

TYPICAL ELEVATION
TWO (2) TRACK DOORS
O-XX-O

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.

- STEP 1** DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2** DETERMINE DOOR CAPACITY FROM TABLE ON SHEET 4 FOT TWO TRACK AND THREE TRACK DOORS.
- STEP 3** USING CHARTS ON SHEET 4 SELECT SILL ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE FOR TWO TRACKS DOORS ONLY.
- STEP 4** THE LOWEST VALUE RESULTING FROM STEPS 2 AND 3 SHALL APPLY TO TWO TRACK DOOR SYSTEM. THE VALUE FROM STEP 2 SHALL APPLY TO THREE TRACK DOOR SYSTEM.

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

Sealed: 9/24/2026


FL #22232

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

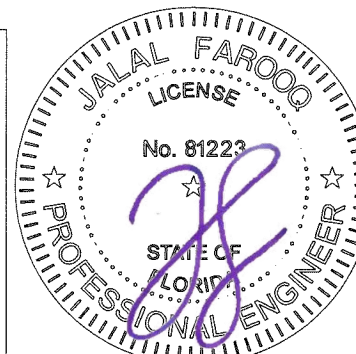

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no.	date	description	by
	C	09.27.23	UPDATED TO 2023 FBC	
	D	02.18.25	PRODUCT SERIES REVISED	
	E	06.19.25	ALT. JAMB ADDED	
	F	09.24.26	UPDATED TO 2026 FBC	


date: 12-05-16
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.

W16-77

sheet 1 of 12

COMP-ANL\W16-77ES

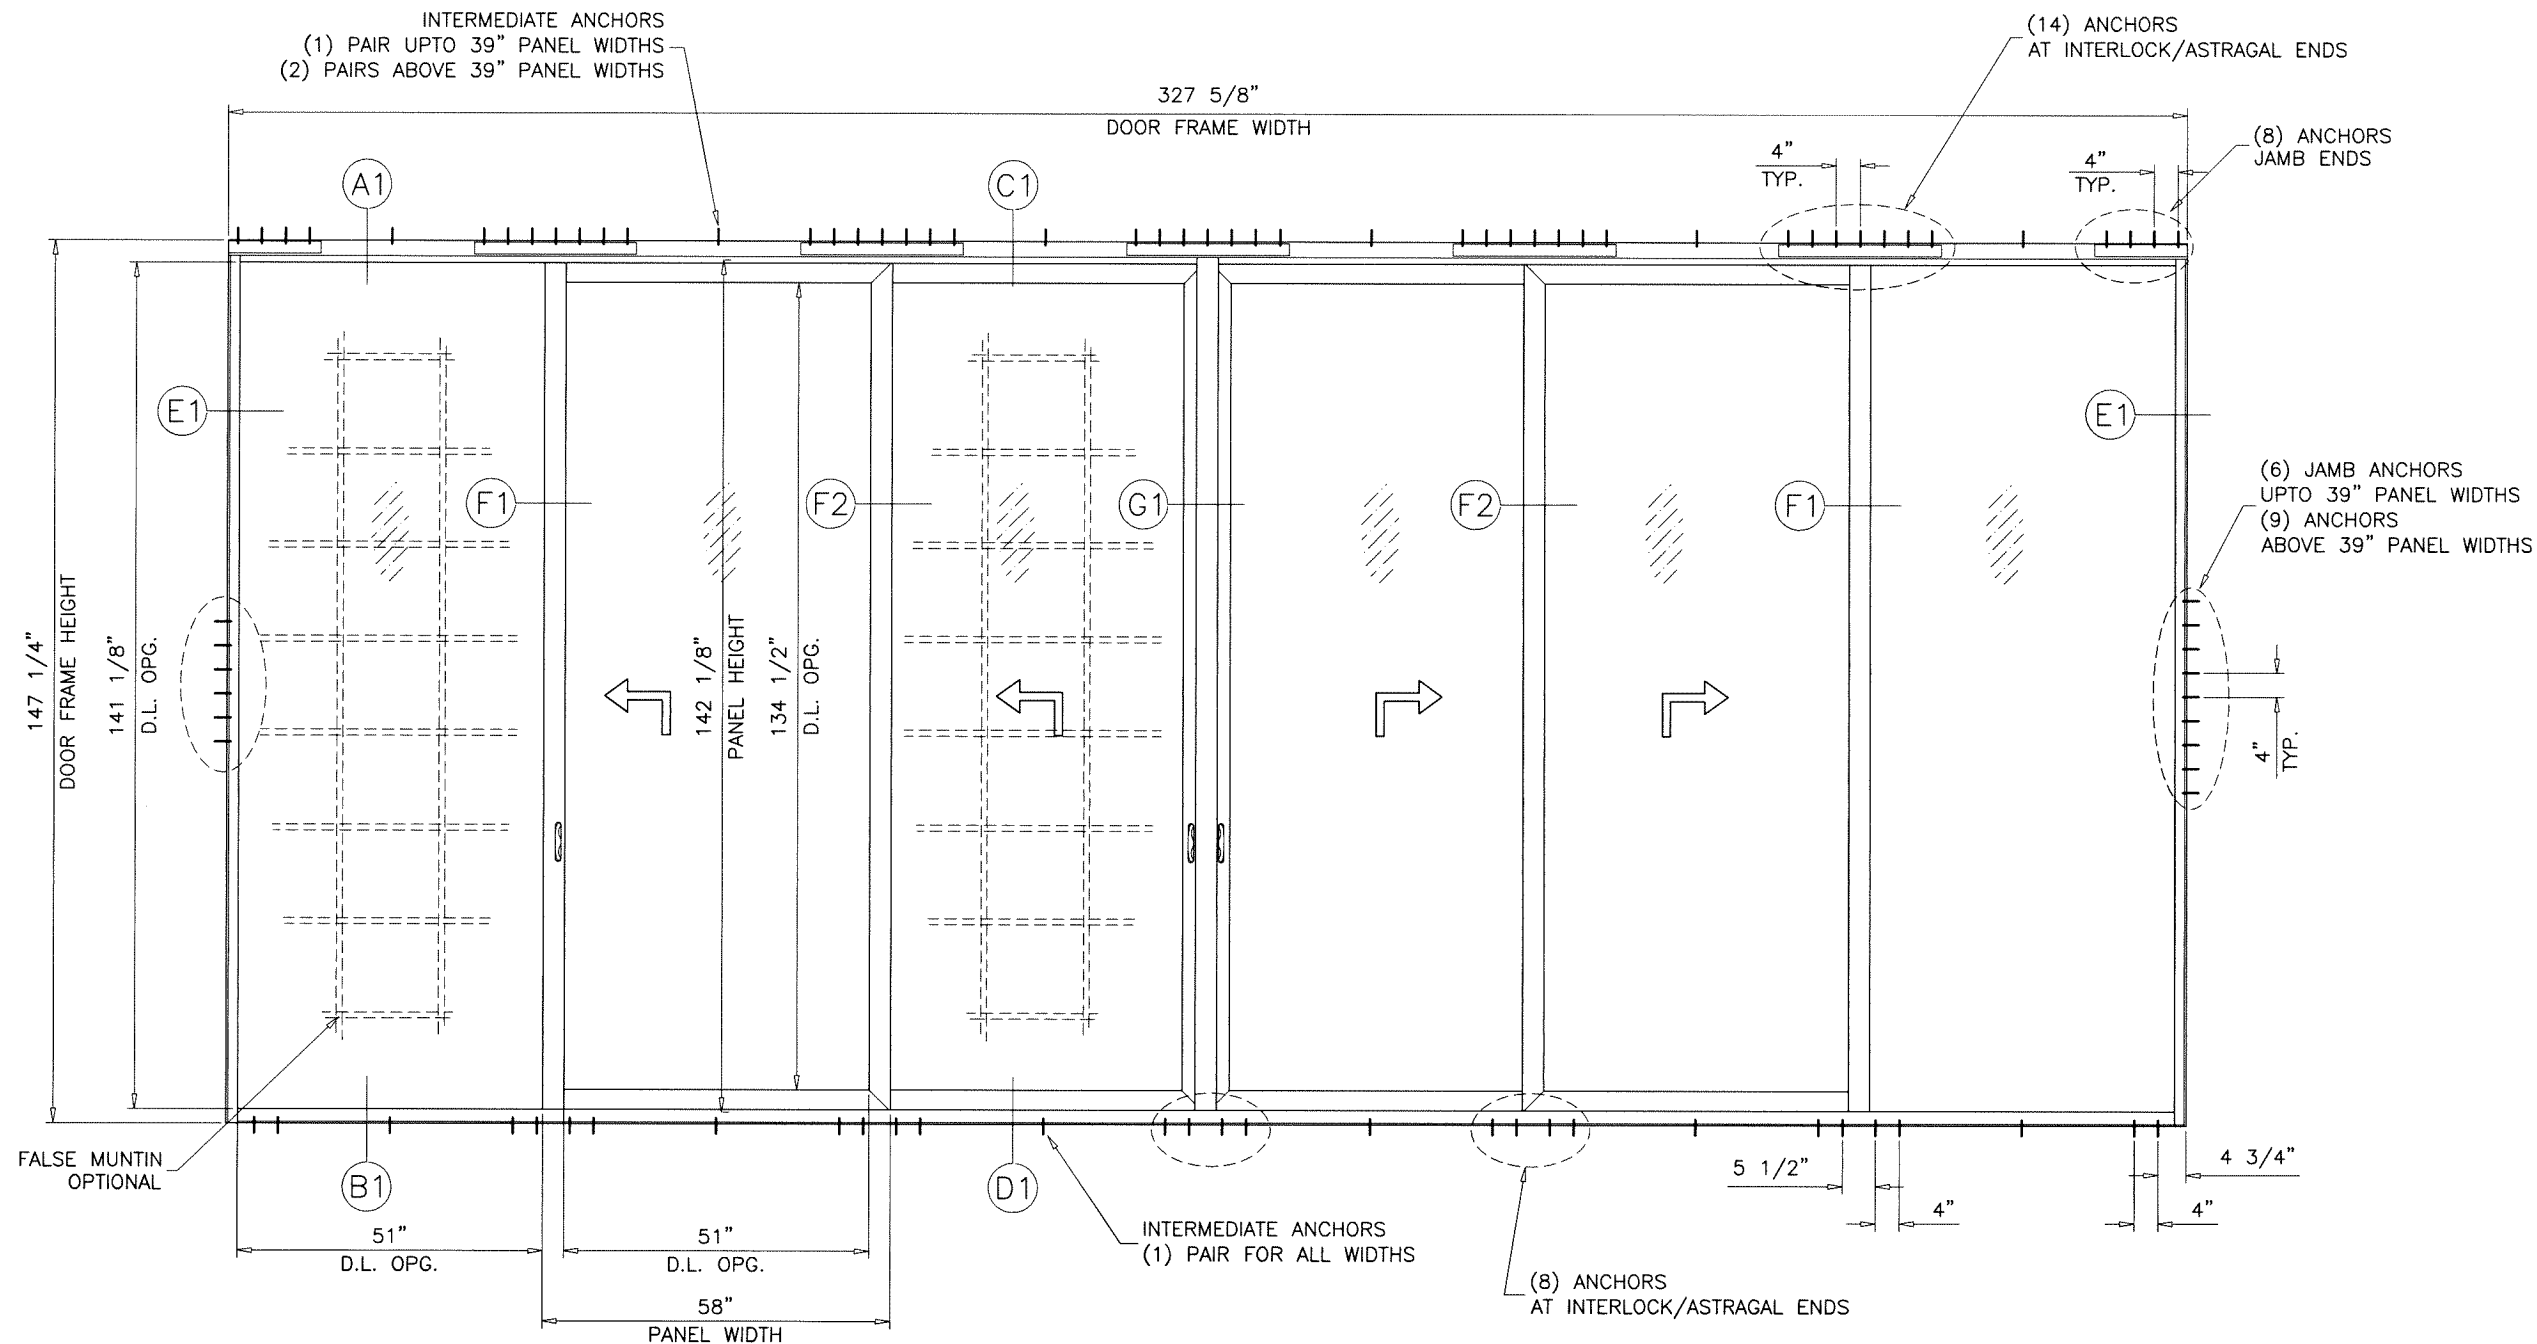

TYPICAL ELEVATION
THREE (3) TRACK DOORS
O-XXXX-O

Sealed: 9/24/2026

FL #22232




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W16-77ES

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	by description

date: 12-05-16
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
W16-77
sheet 2 of 12

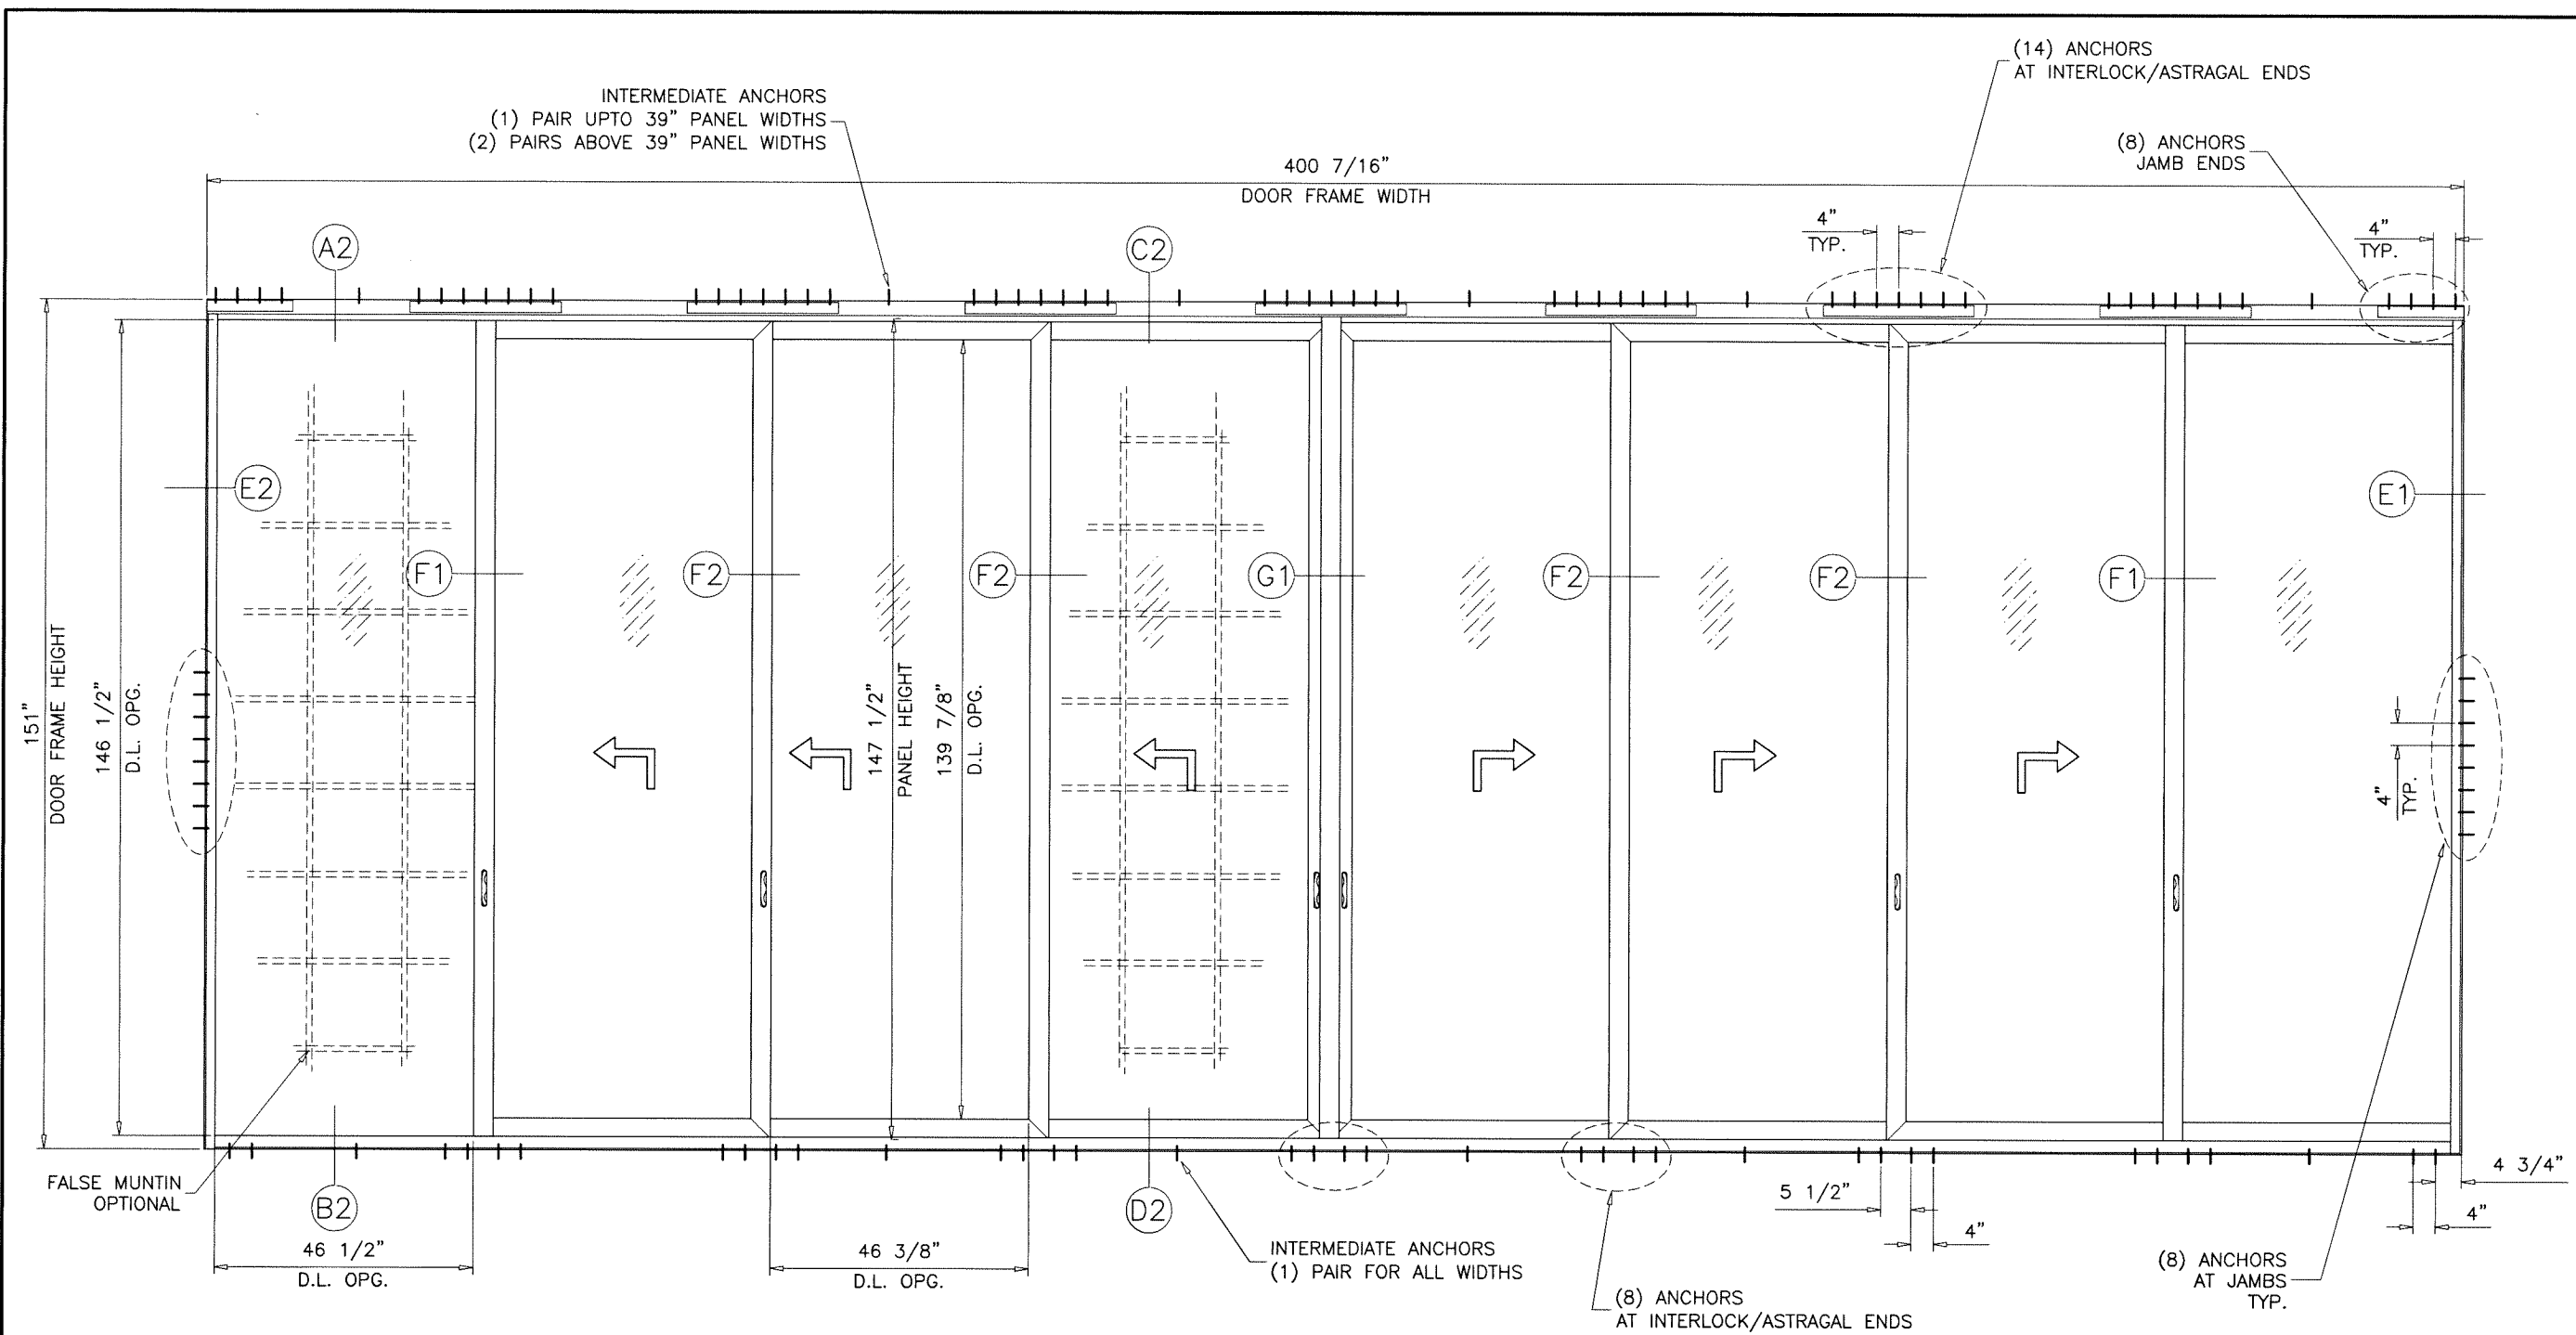

TYPICAL ELEVATION
FOUR (4) TRACK DOORS
 ○-XXXXXX-○

Sealed: 9/24/2026

FL #22232



AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W16-77ES

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		by description	
no	date		

date: 12-05-16

scale: 3/8"=1'-0"

dr. by: TARIQ

chk. by:

drawing no.

W16-77

sheet 3 of 12


GLASS LOAD CAPACITY – PSF (2 TRACK & 3 TRACK DOORS)				GLASS LOAD CAPACITY – PSF (4 TRACK DOORS)			
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	1-5/16" OVERALL INSUL. LAM. GLASS		AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	1-5/16" OVERALL INSUL. LAM. GLASS	
		EXT.(+)	INT.(–)			EXT.(+)	INT.(–)
30	96	77.0	122.0	30	96	122.0	122.0
36		77.0	122.0	36		122.0	122.0
42		77.0	122.0	42		122.0	122.0
48		77.0	122.0	48		122.0	122.0
54		77.0	122.0	54		113.1	113.1
60		70.1	111.1	60		101.8	101.8
30	108	77.0	122.0	30	108	122.0	122.0
36		77.0	122.0	36		122.0	122.0
42		77.0	122.0	42		122.0	122.0
48		77.0	122.0	48		122.0	122.0
54		77.0	122.0	54		113.1	113.1
60		70.1	111.1	60		101.8	101.8
30	120	77.0	122.0	30	120	122.0	122.0
36		77.0	122.0	36		122.0	122.0
42		77.0	122.0	42		122.0	122.0
48		77.0	122.0	48		122.0	122.0
54		77.0	122.0	54		113.1	113.1
60		70.1	111.1	60		101.8	101.8
30	132	77.0	122.0	30	132	122.0	122.0
36		77.0	122.0	36		122.0	122.0
42		77.0	122.0	42		122.0	122.0
48		77.0	122.0	48		122.0	122.0
54		77.0	122.0	54		113.1	113.1
60		70.1	111.1				
30	144	77.0	122.0	30	144	122.0	122.0
36		77.0	122.0	36		122.0	122.0
42		77.0	122.0	42		122.0	122.0
48		77.0	122.0	48		122.0	122.0
54		77.0	122.0	50		122.0	122.0
30	147–1/4	77.0	122.0	30	147–1/4	122.0	122.0
36		77.0	122.0	36		122.0	122.0
42		77.0	122.0	42		122.0	122.0
48		77.0	122.0	48		122.0	122.0
54		77.0	122.0	50		122.0	122.0
				30	151	122.0	122.0
				36		122.0	122.0
				42		122.0	122.0
				48		122.0	122.0
				50		122.0	122.0

AVERAGE PANEL WIDTH = $\frac{\text{DOOR FRAME WIDTH}}{\text{NUMBER OF PANELS}}$

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300–16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05–DEC–219

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
EGRESS REQUIREMENTS PER FBC AS REQUIRED.

Sealed: 9/24/2026

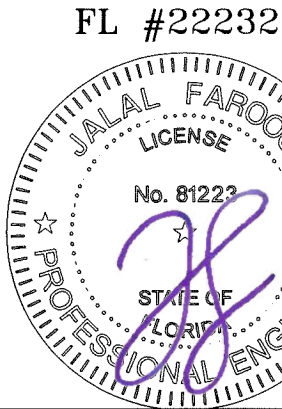

HEAD ANCHORS:
14 ANCHORS REQD. AT FRAME HEAD MTG. STILE LOCATIONS
MAX. LOAD CAPACITY = 122 PSF

SILL ANCHOR LOAD CAPACITY – PSF (2 TRACK DOORS ONLY)					
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	4 ANCHORS AT MTG. STILE ENDS	5 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS	7 ANCHORS AT MTG. STILE ENDS
		EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)
30	96	122.0	122.0	122.0	122.0
36		122.0	122.0	122.0	122.0
42		122.0	122.0	122.0	122.0
48		122.0	122.0	122.0	122.0
54		122.0	122.0	122.0	122.0
60		121.2	122.0	122.0	122.0
30	108	122.0	122.0	122.0	122.0
36		122.0	122.0	122.0	122.0
42		122.0	122.0	122.0	122.0
48		119.0	122.0	122.0	122.0
54		109.7	122.0	122.0	122.0
60		102.5	122.0	122.0	122.0
30	120	122.0	122.0	122.0	122.0
36		122.0	122.0	122.0	122.0
42		115.4	122.0	122.0	122.0
48		104.2	122.0	122.0	122.0
54		95.6	119.5	122.0	122.0
60		88.9	111.1	122.0	122.0
30	132	122.0	122.0	122.0	122.0
36		116.9	122.0	122.0	122.0
42		102.9	122.0	122.0	122.0
48		92.6	115.7	122.0	122.0
54		84.6	105.8	122.0	122.0
60		78.4	98.0	117.6	122.0
30	144	122.0	122.0	122.0	122.0
36		105.8	122.0	122.0	122.0
42		92.9	116.1	122.0	122.0
48		83.3	104.2	122.0	122.0
54		76.0	95.0	113.9	122.0
30	147–1/4	121.0	122.0	122.0	122.0
36		103.1	122.0	122.0	122.0
42		90.5	113.1	122.0	122.0
48		81.1	101.4	121.7	122.0
54		73.9	92.4	110.9	122.0

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978




ES–LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638–5151 FAX. (305) 638–5158

revisions:
no. date by description

date: 12–05–16
scale: –
dr. by: TARIQ
chk. by:

drawing no.
W16–77

sheet **4** of **12**

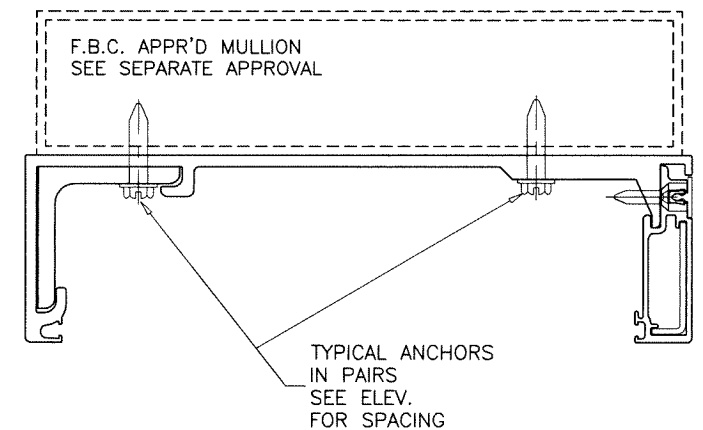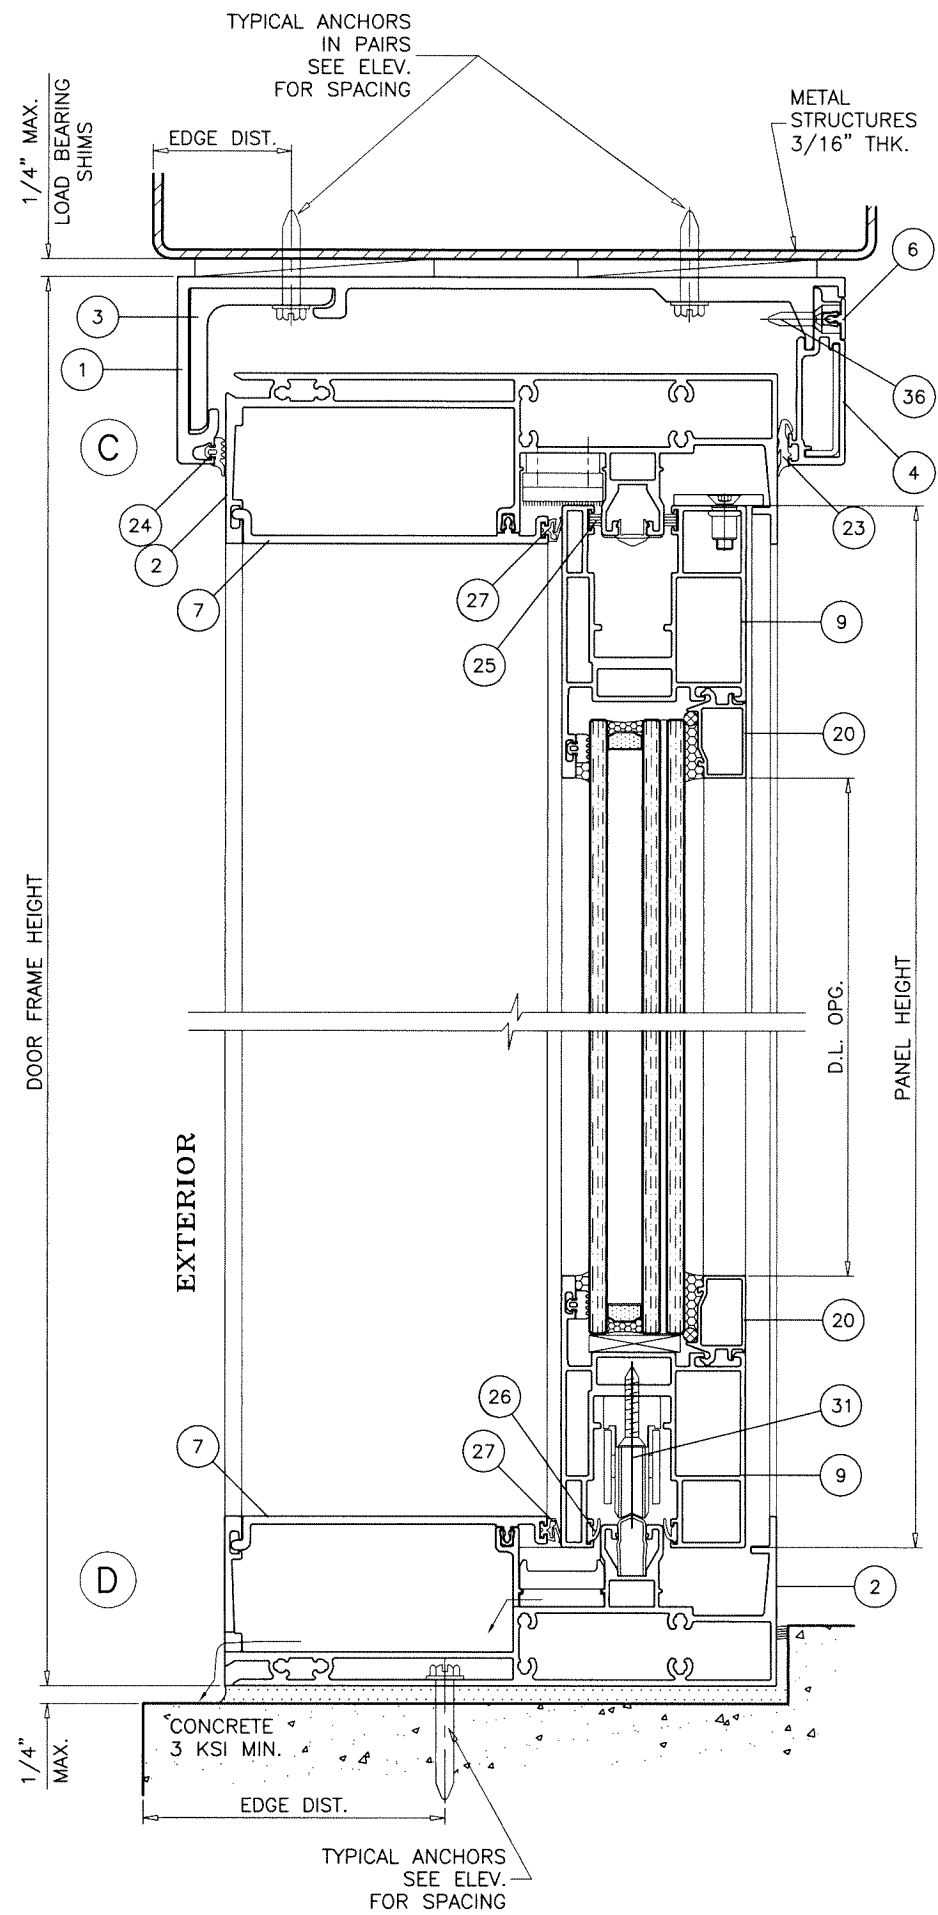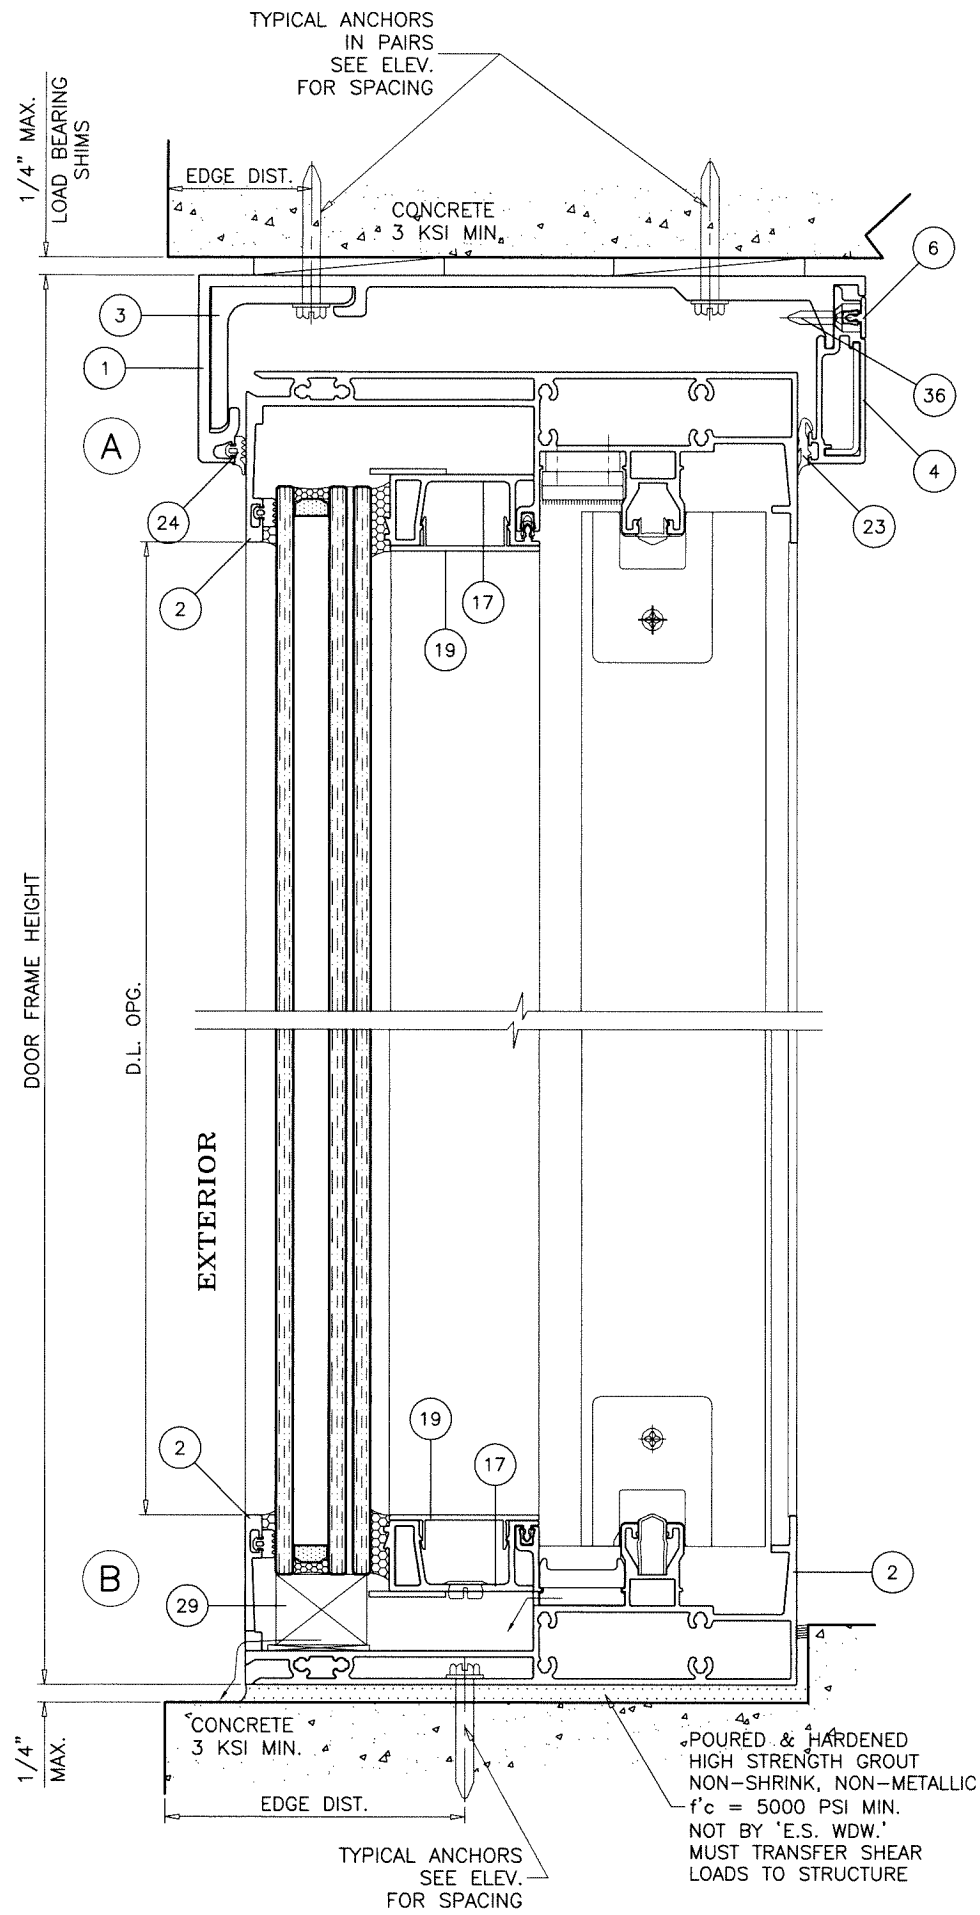

DOOR OPENINGS AND METAL STRUCTURE NOT BY 'E.S. WDW.' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING AT TWO (2) AND THREE (3) TRACK DOORS

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI) DIRECTLY INTO CONCRETE OR BLOCKS
 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-3/4" MIN. EMBED INTO BLOCKS (JAMBS)


1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS) INTO F.B.C. APPROVED MULLIONS OR INTO METAL STRUCTURES (HEAD)
 ALUMINUM: 3/16" THK. MIN. (6063-T5 MIN.)
 STEEL: 3/16" THK. MIN. (Fy = 36 KSI MIN.)
 INTO METAL STRUCTURES (JAMBS)
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE = 1-1/2" MIN. (HEAD)
 INTO CONCRETE = 2-1/2" MIN. (SILL)
 INTO CONCRETE AND BLOCKS = 2-1/2" MIN. (JAMBS)
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

WEEPHOLES:
 W1 = 1/4" X 1" LONG WEEP HOLES AT 6" FROM EACH END AND 12" O.C.
 W2 = 1-1/2" LONG WEEP NOTCH AT 6" FROM EACH END AND 12" O.C.

Sealed: 9/24/2026

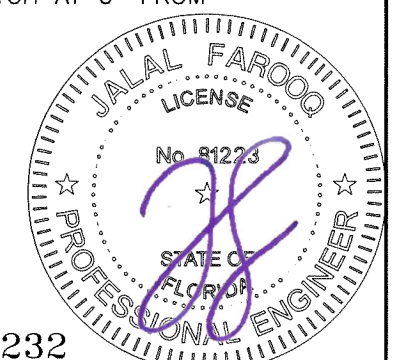

TWO (2) TRACK DOOR DETAILS

FL #22232

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL W16-77ES



ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no	date	by	description


date: 12-05-16
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
W16-77
 sheet 5 of 12

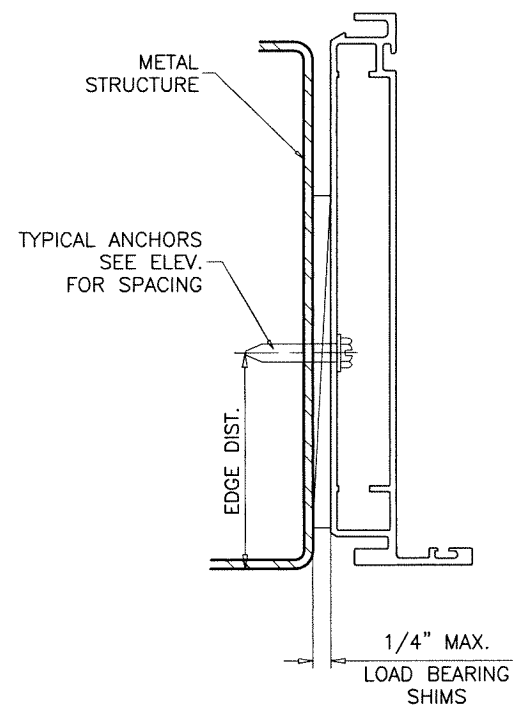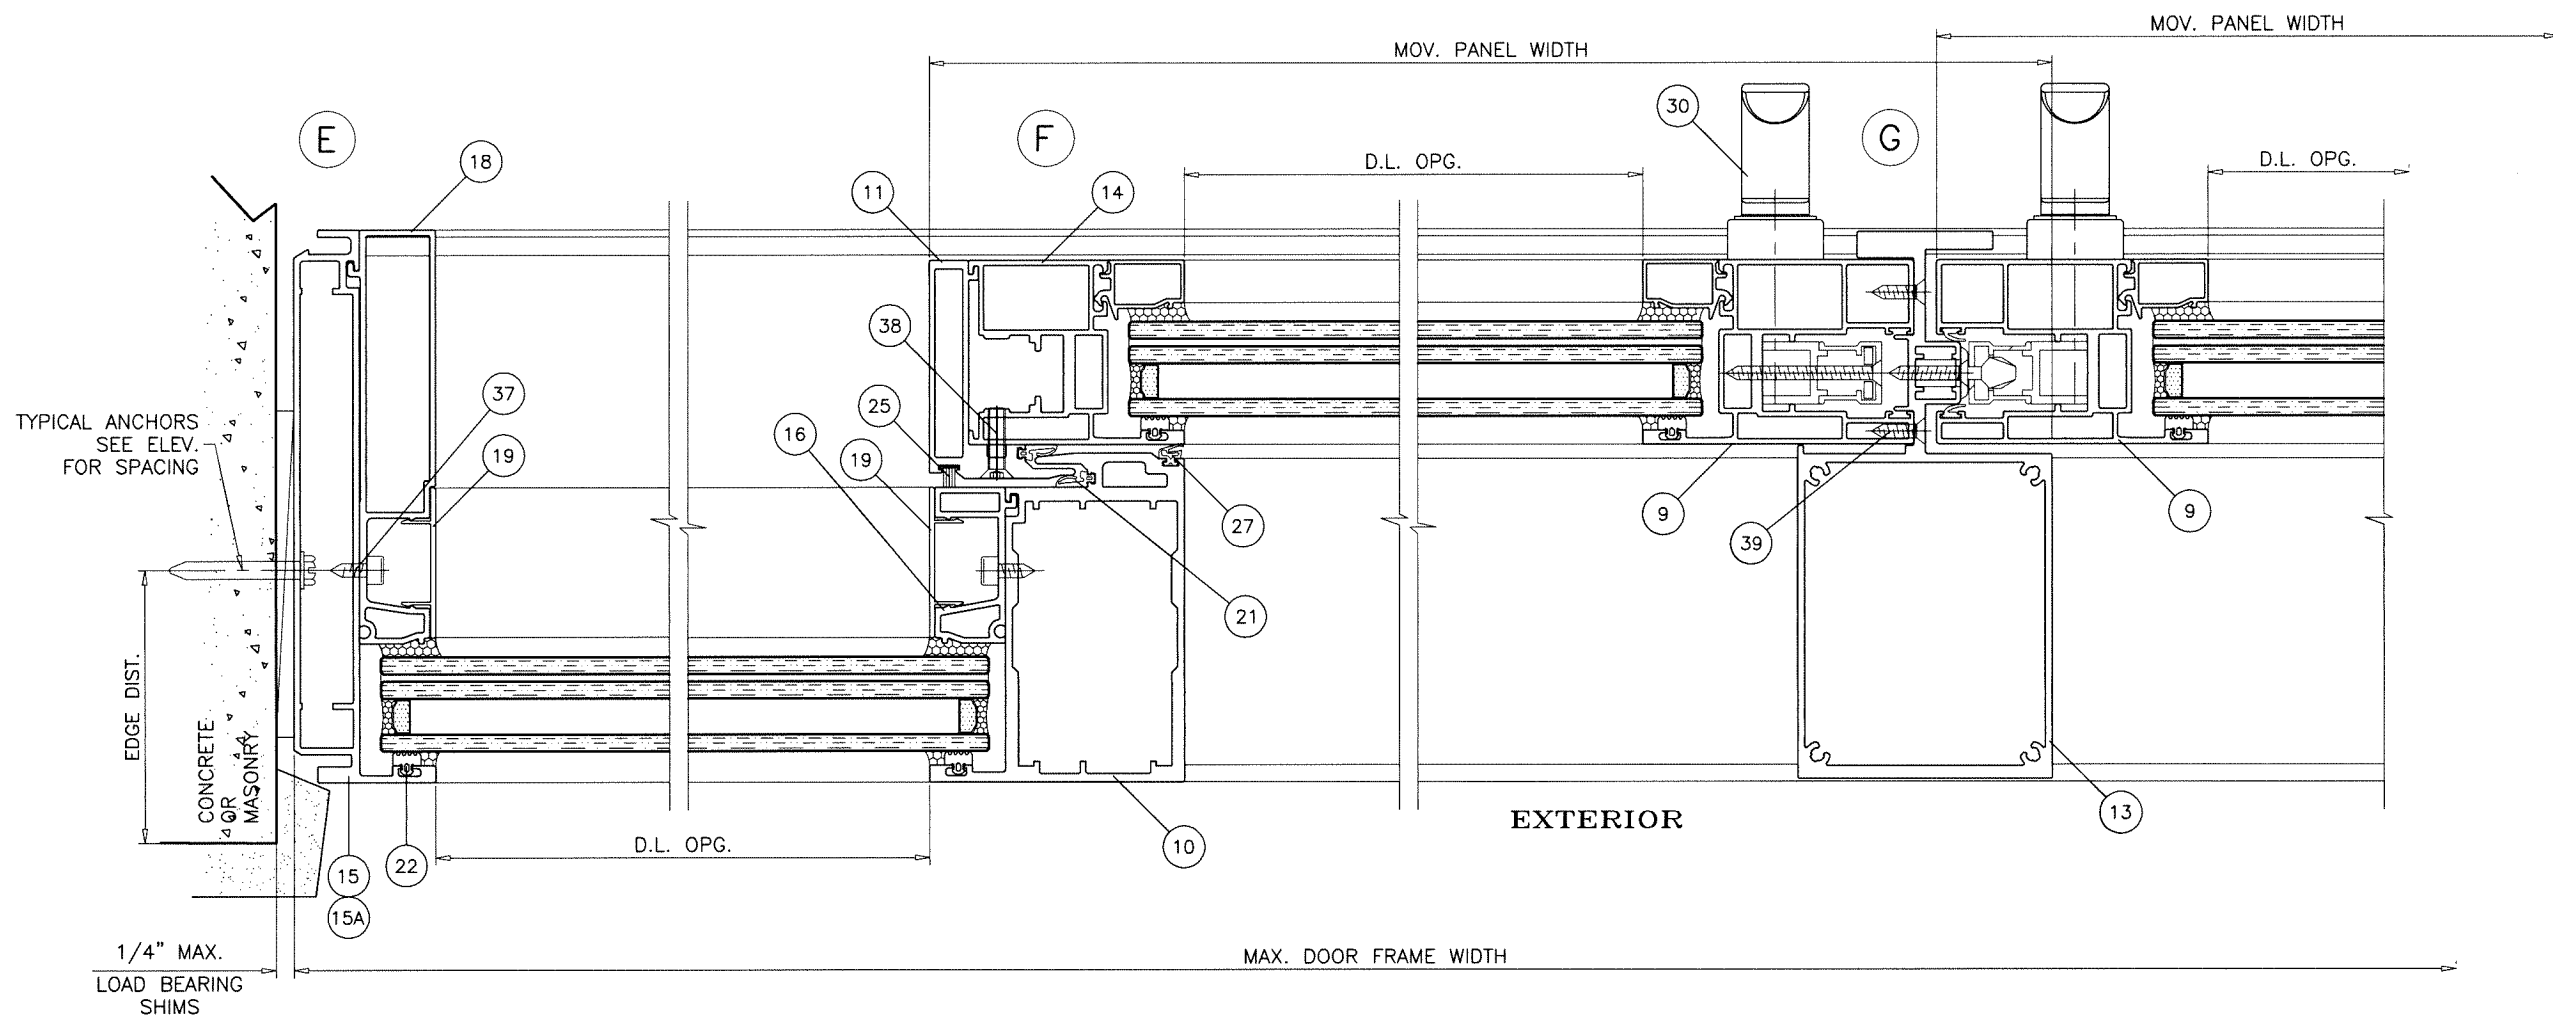

Sealed: 9/24/2026

FL #22232

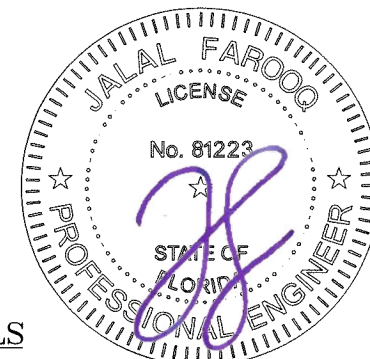

TWO (2) TRACK DOOR DETAILS

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c

COMP-ANL\W16-77ES

ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description

date: 12-05-16

scale: 3/8" = 1"



dr. by: TARIQ

chk. by:


drawing no.

W16-77

sheet 6 of 12

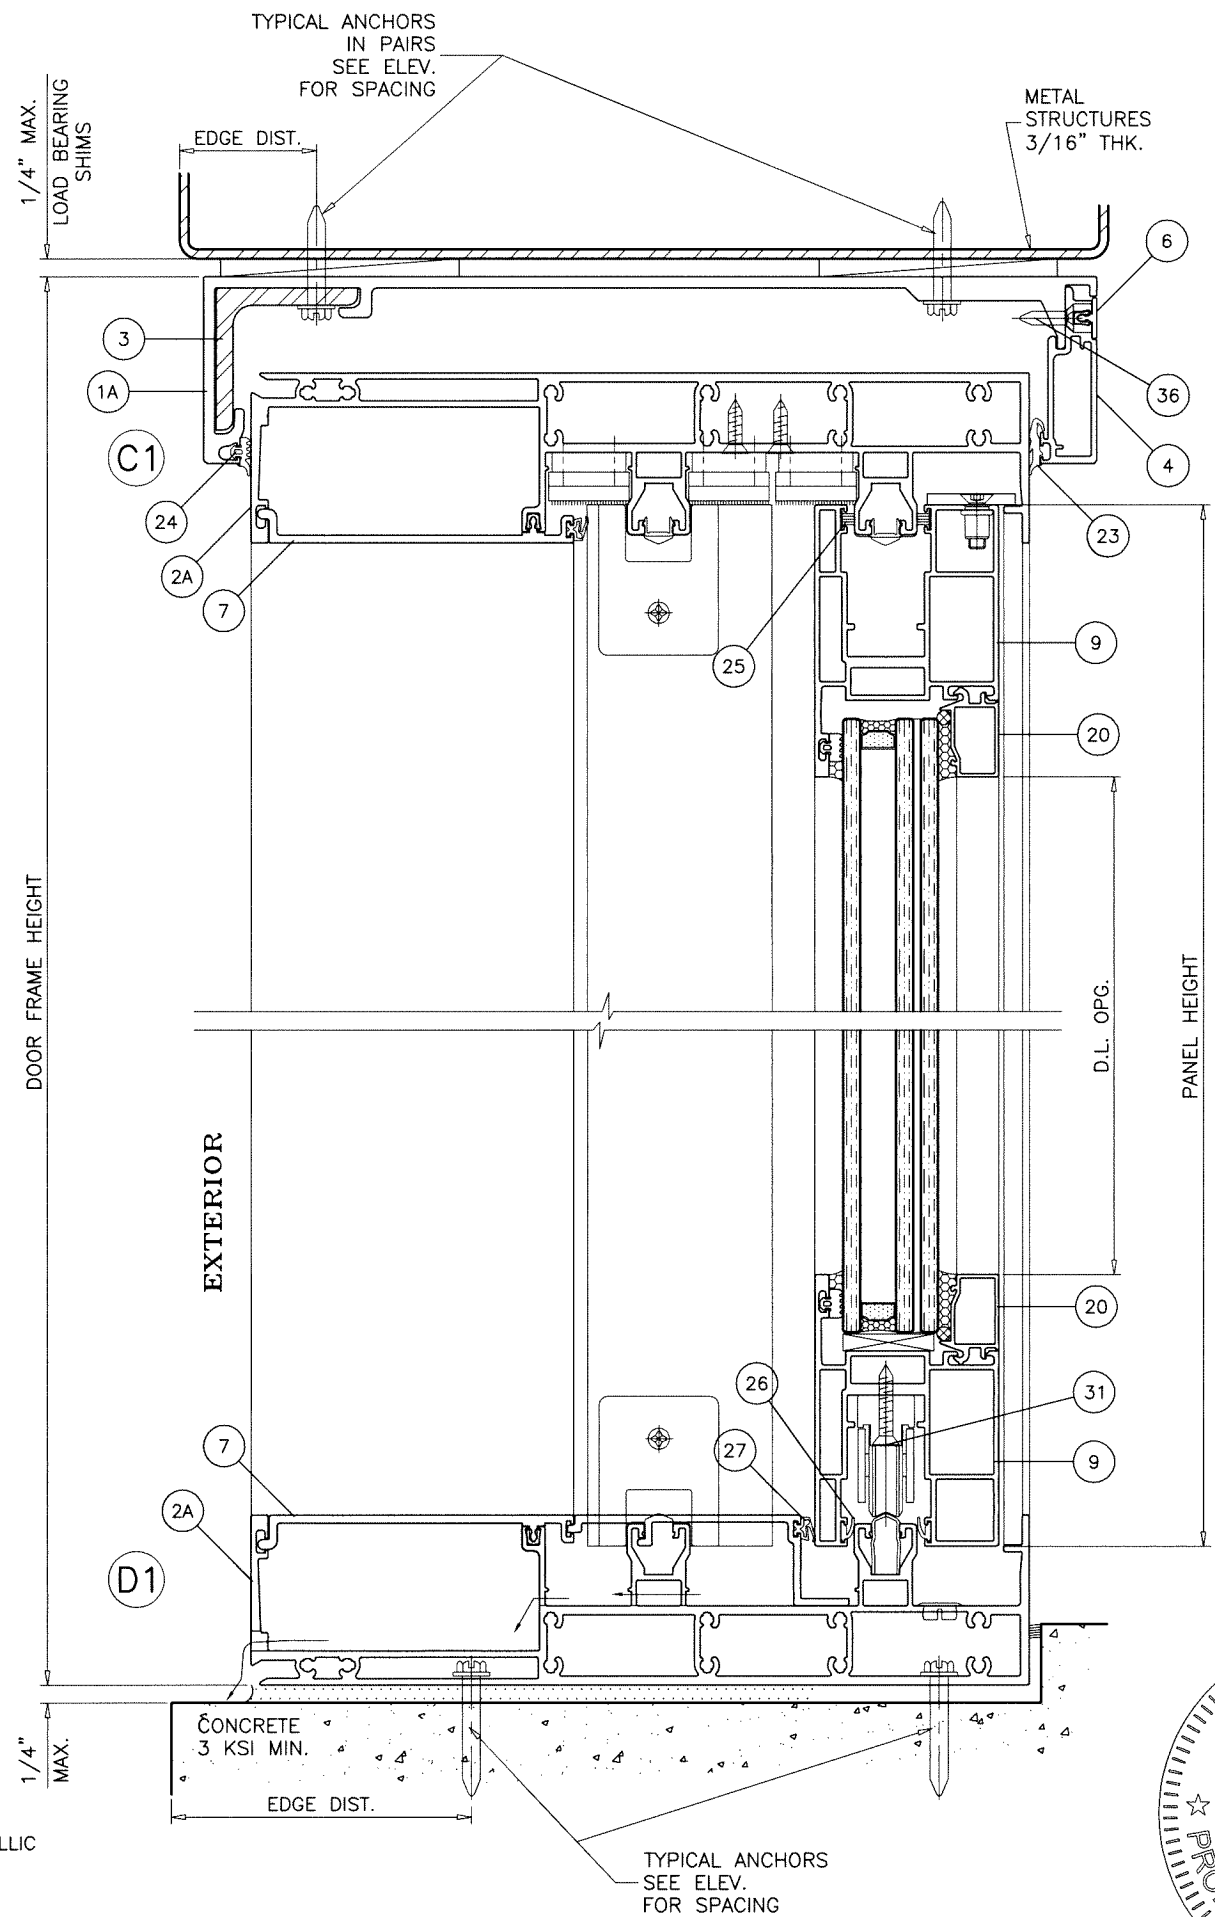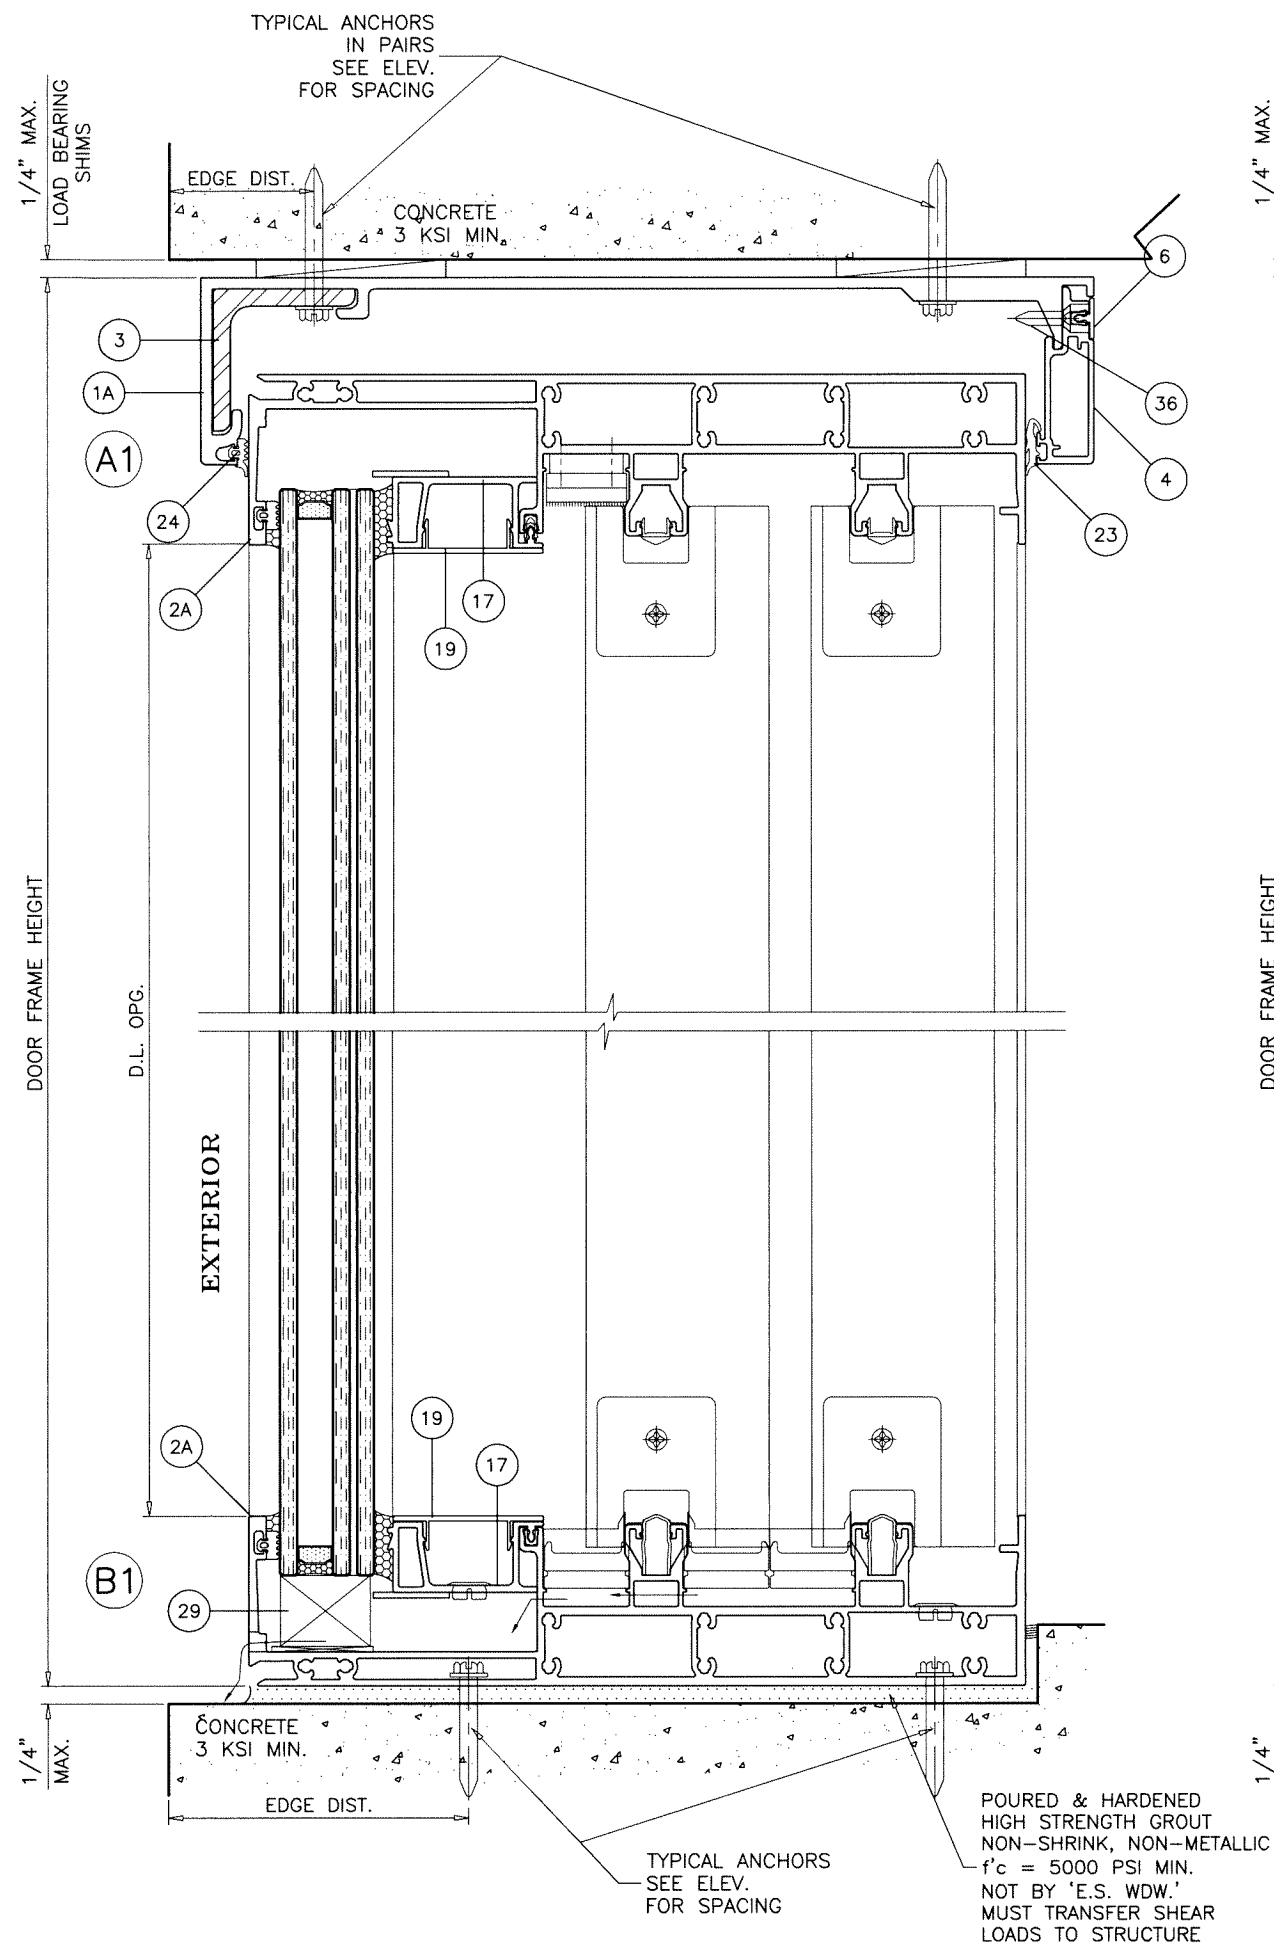

THREE (3) TRACK DOOR DETAILS

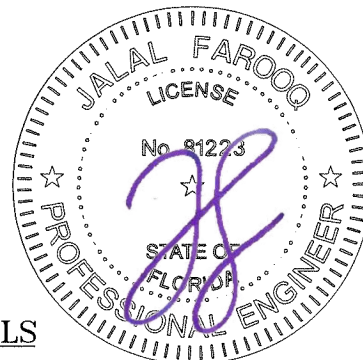

Sealed: 9/24/2026

FL #22232

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

COMP-ANL W16-77ES


ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		date		description	
no	date	no	date	no	description


date: 12-05-16
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W16-77
sheet 7 of 12

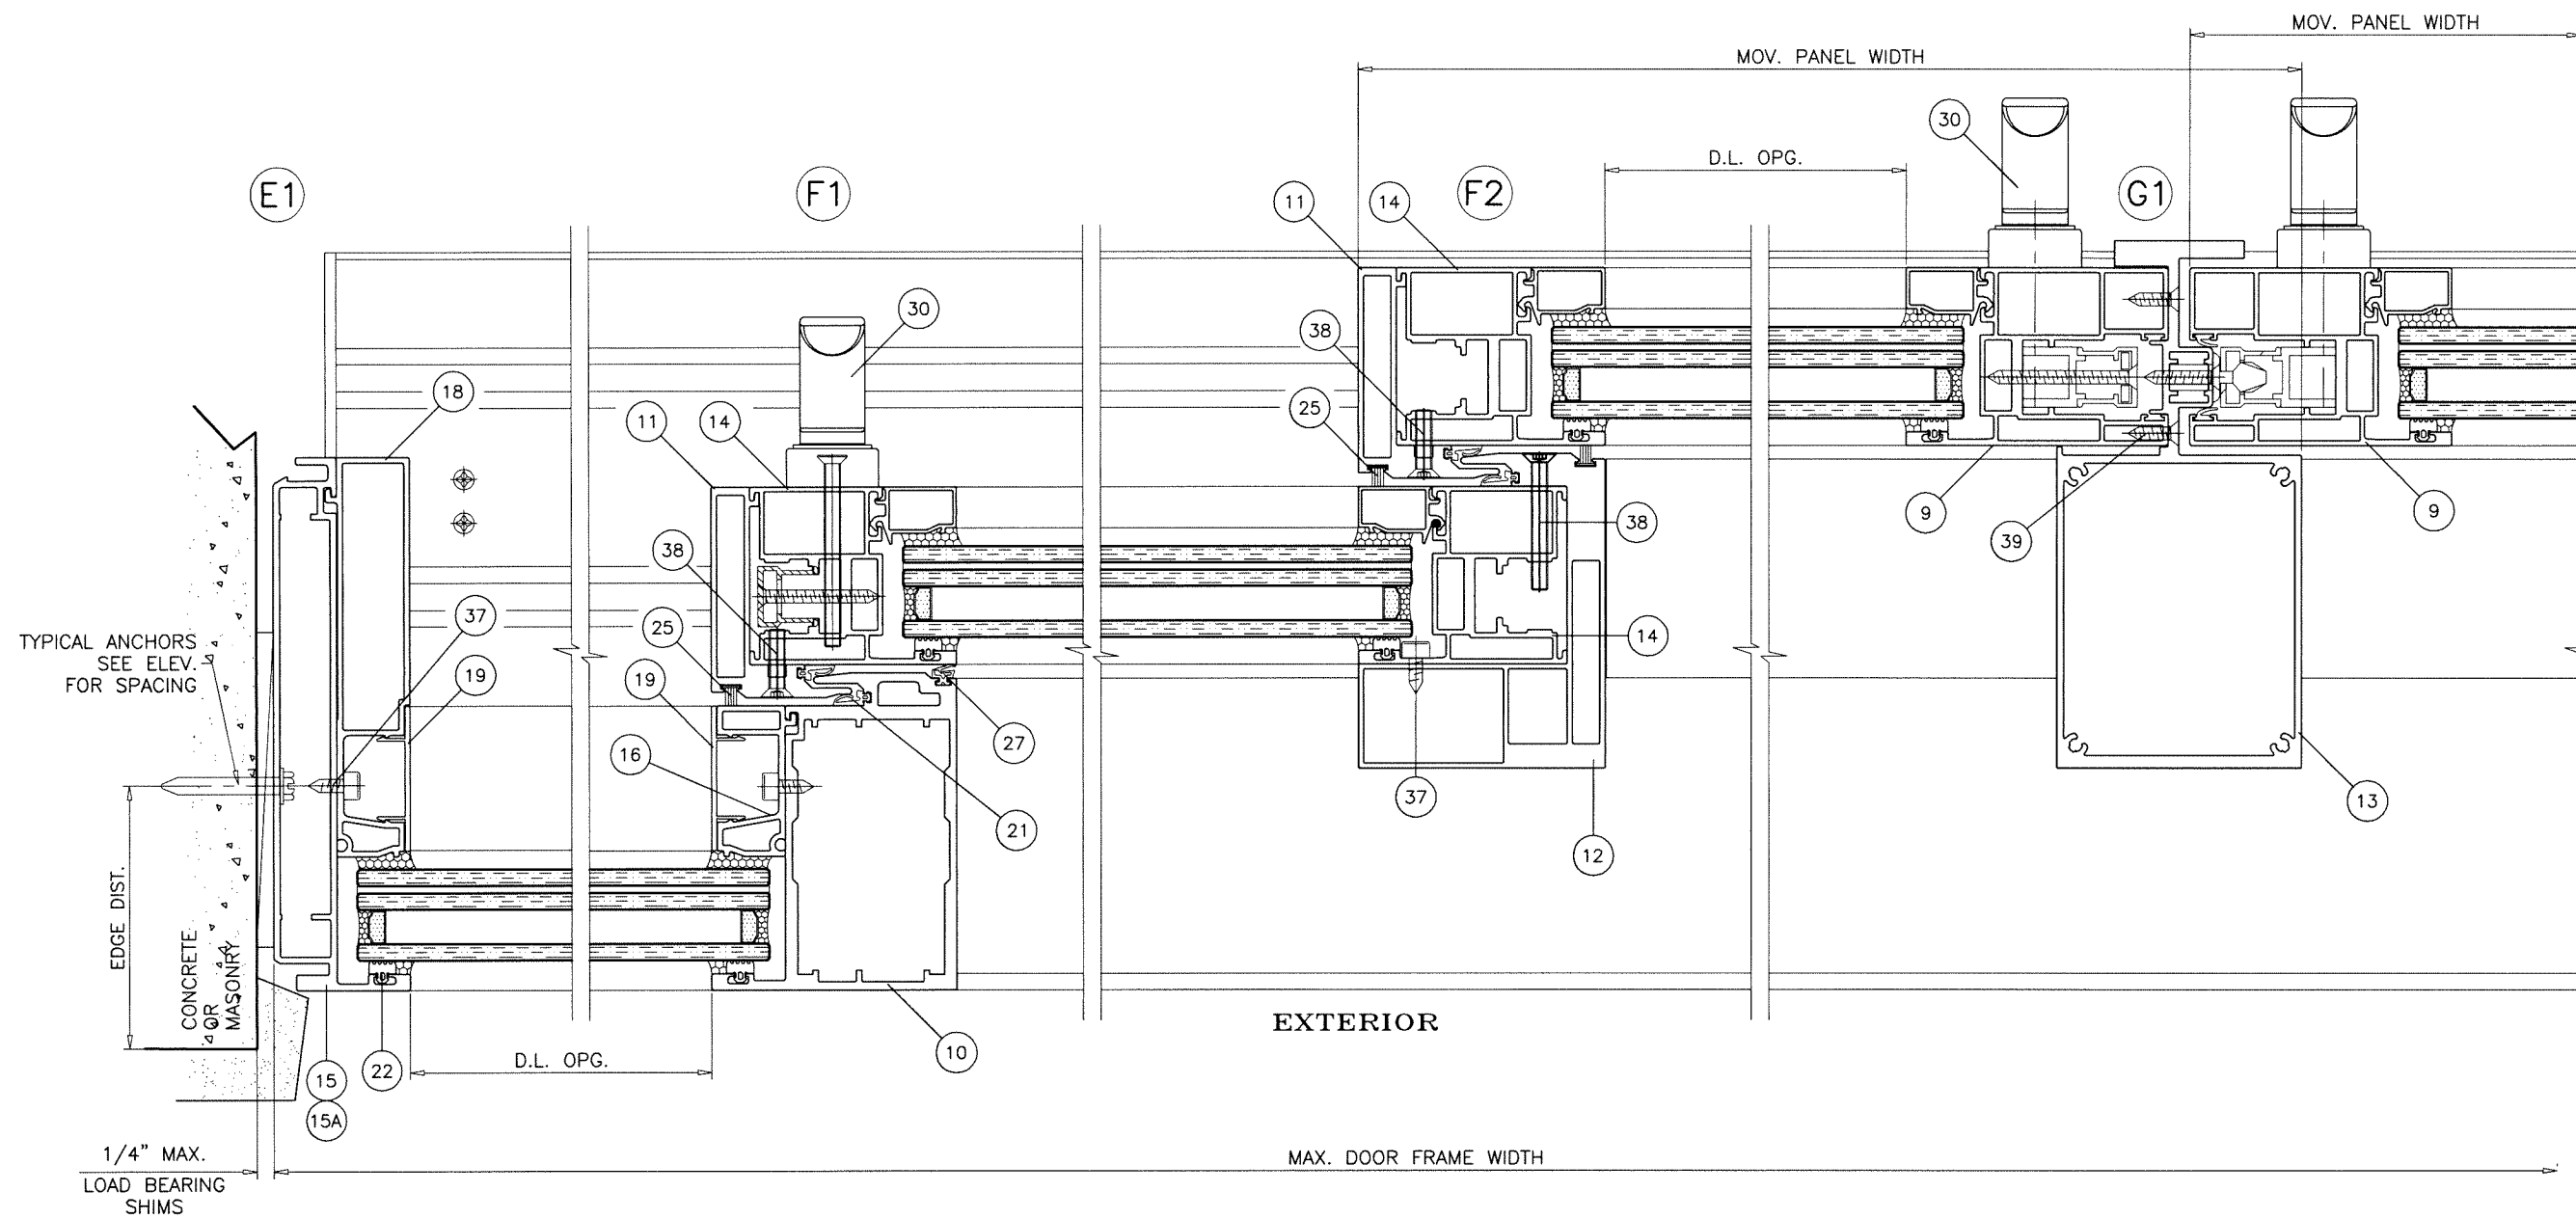

Sealed: 9/24/2026

FL #22232

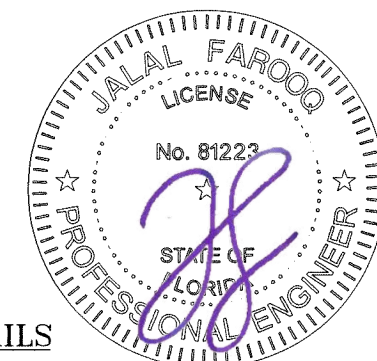

THREE (3) TRACK DOOR DETAILS

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL \ W16-77ES

ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by description

date: 12-05-16

scale: 3/8" = 1"


dr. by: TARIQ

chk. by:

drawing no.

W16-77



sheet 8 of 12

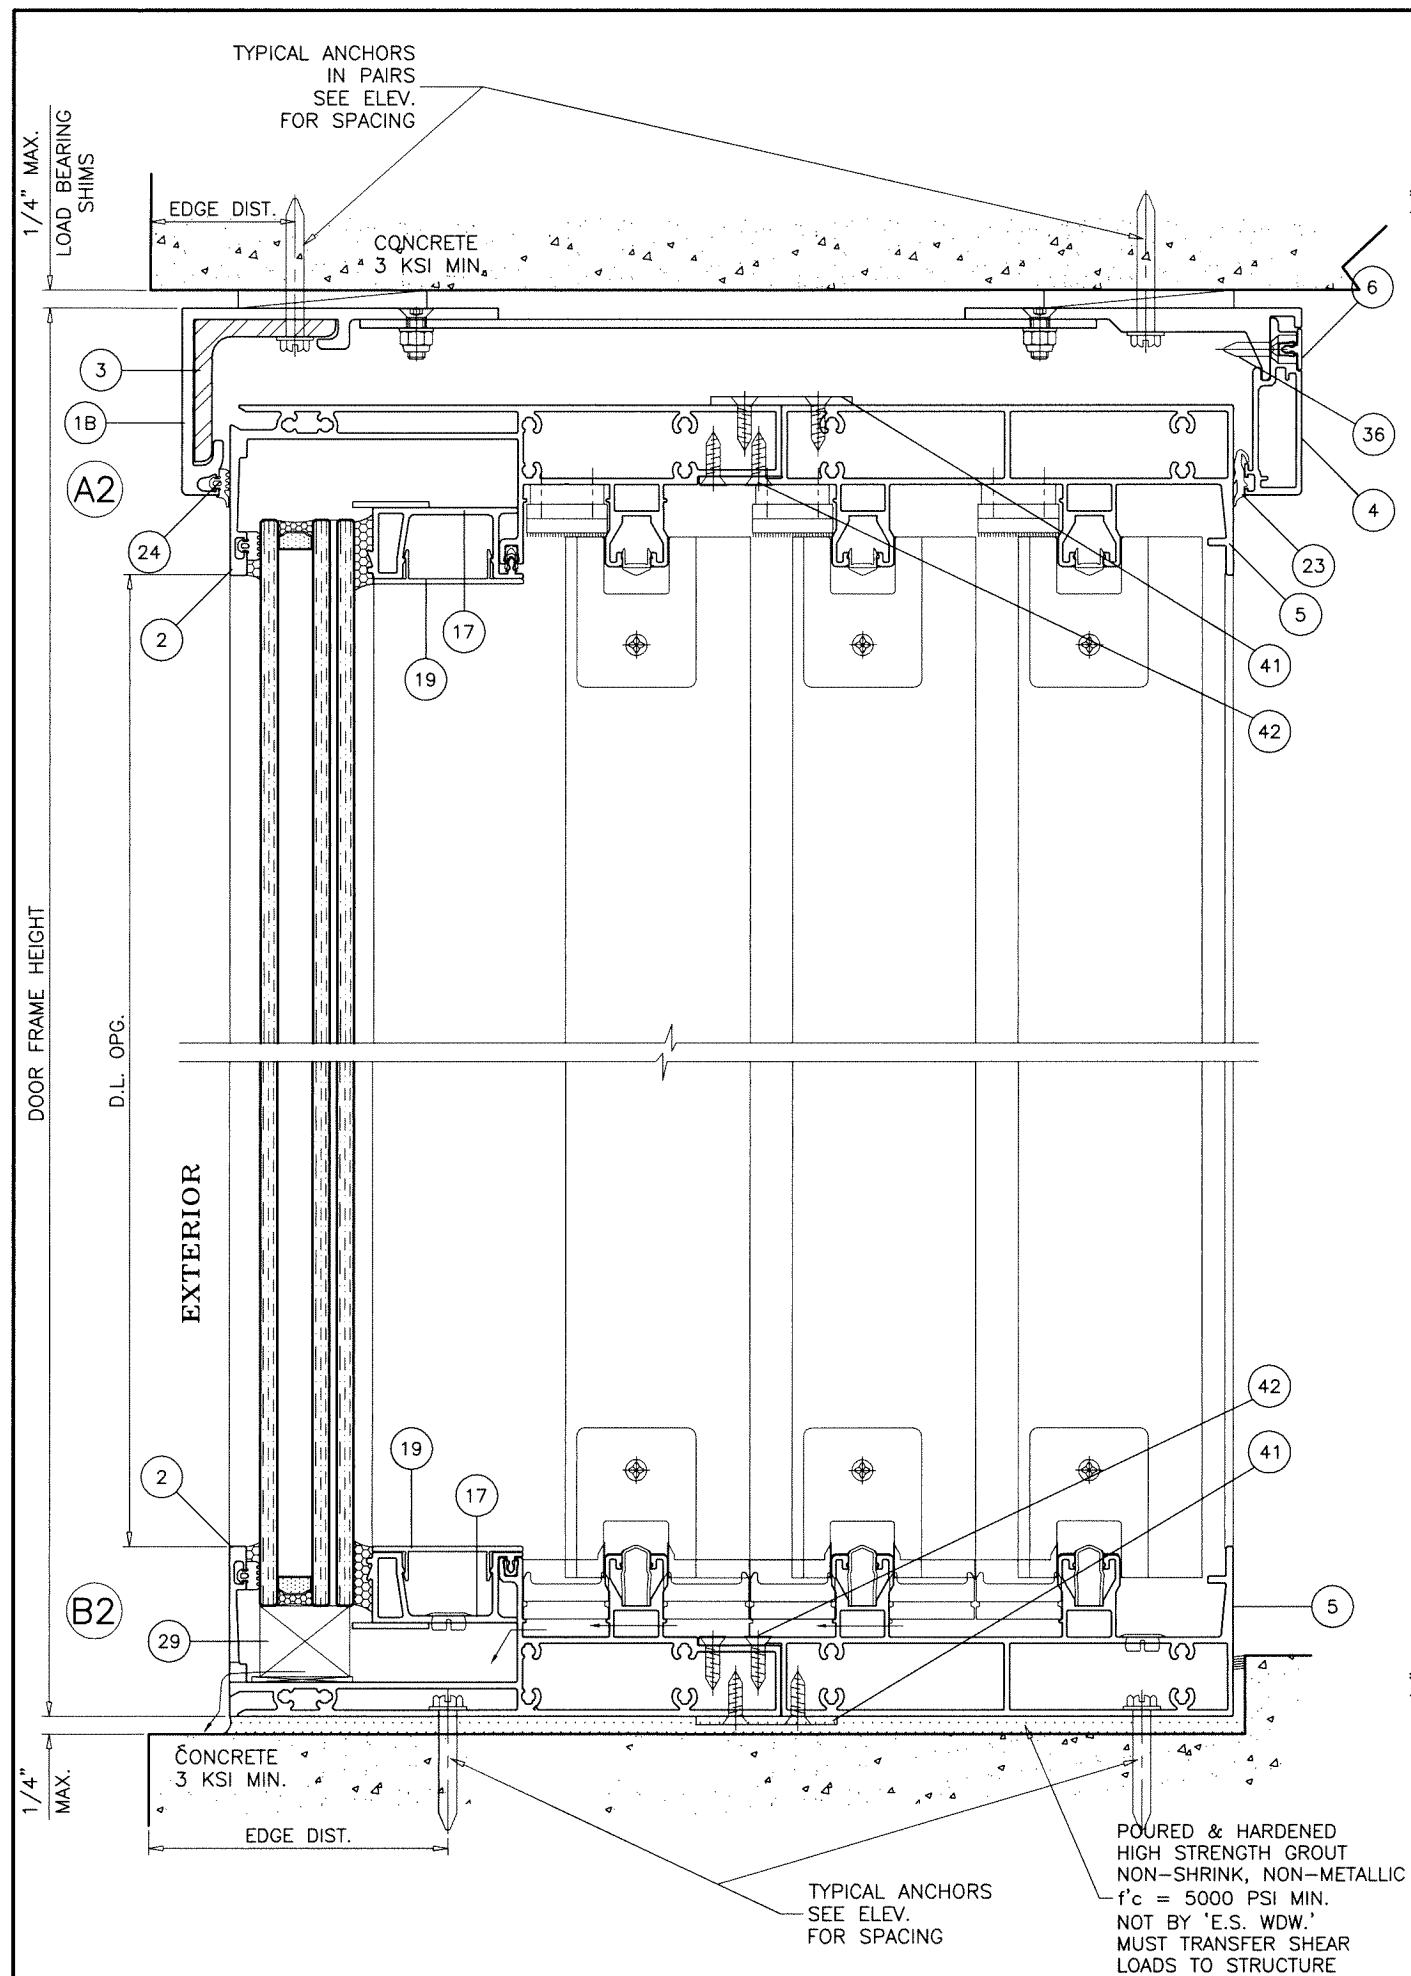

FOUR (4) TRACK DOOR DETAILS

date: 12-05-16		revisions:	
scale: 3/8" = 1"	no	date	by description
dr. by: TARIQ	no	date	by description
chk. by:	no	date	by description
drawing no.		sheet 9 of 12	
W16-77		E.S. WINDOWS, LLC 3550 N.W. 49 STREET MIAMI, FL. 33142 TEL. (305) 638-5151 FAX. (305) 638-5158	

ITEM NO.	PART NO.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES-LS7035-005	HEAD RECEPTOR (2 TRACK)	6063-T6	-
1A	ES-LS7035-059	HEAD RECEPTOR (3 TRACK)	6063-T6	-
1B	-	HEAD RECEPTOR (4 TRACK)	6063-T6	-
2	ES-LS7035-008	FRAME HEAD/SILL (2 TRACK)	6005-T5	-
2A	ES-LS7035-062	FRAME HEAD/SILL (3 TRACK)	6063-T6	-
3	-	ANCHOR CLIP, 26" LONG AT MTG. STILE, 18" LONG AT JAMBS	6063-T6	-
4	ES-LS7035-009	HEAD RECEPTOR INSERT	6063-T6	-
5	-	ADD-ON HEAD/SILL TRACK	6063-T6	-
6	ES-LS7035-019	HEAD RECEPTOR INSERT CLIP	6063-T6	-
7	ES-LS7035-023	THRESHOLD COVER	6063-T6	-
8	ES-LS7035-024	THRESHOLD COVER (3 TRACK)	6063-T6	-
9	ES-LS7035-018	PANEL TOP/BOTTOM RAIL, LOCK STILE	6063-T6	-
10	ES-LS7035-010	FIXED INTERLOCK	6063-T6	-
11	-	INTERLOCK STILE STIFFENER	6063-T6	-
12	ES-LS7035-012	INTERLOCK STILE STIFFENER (3 TRACK)	6063-T6	-
13	ES-LS7035-022	ASTRAGAL STILE	6063-T6	-
14	ES-LS7035-017	INTERLOCK STILE	6063-T6	-
15	ES-LS7035-001	FRAME JAMB	6063-T6	-
15A	ES-LS7035-033	ALT. FRAME JAMB	6063-T6	-
16	ES-LS7035-014	FIX. PANEL VERTICAL GLASS STOP	6063-T6	-
17	ES-LS7035-015	FIX. PANEL HORIZONTAL GLASS STOP	6063-T6	-
18	ES-LS7035-016	FRAME JAMB GLASS STOP	6063-T6	-
19	ES-LS7035-020	GLASS STOP COVER	6063-T6	-
20	ES-LS7035-021	PANEL GLASS STOP	6063-T6	-
21	-	INTERLOCK W'STRIPPING	EPDM	DUROMETER 70±5 SHORE A
22	-	GLAZING GASKET (EXTERIOR)	EPDM	DUROMETER 70±5 SHORE A
23	-	HEAD RECEPTOR GASKET (INTERIOR)	EPDM	DUROMETER 70±5 SHORE A
24	-	HEAD RECEPTOR GASKET (EXTERIOR)	EPDM	DUROMETER 70±5 SHORE A
25	-	PILE W'STRIPPING	WOOL	-
26	-	BOTTOM RAIL LEAF W'STRIPPING	EPDM	DUROMETER 70±5 SHORE A
27	-	LEAF W'STRIPPING AT COVER	EPDM	DUROMETER 70±5 SHORE A
28	-	SETTING BLOCKS AT 1/4 POINTS (1-1/4" X 1-3/16" X 1/4")	EPDM	DUROMETER 80±5 SHORE A
29	-	SETTING BLOCKS AT 1/4 POINTS (1-1/4" X 1-3/16" X 1-1/16")	EPDM	DUROMETER 80±5 SHORE A
30	-	DOOR HANDLE	-	-
31	-	ROLLER ASSEMBLY	-	-
32	-	LIFT AND SLIDE HARDWARE	-	-
33	-	-	-	-
34	-	PANEL ASSEMBLY FASTENERS	-	-
35	-	FRAME ASSEMBLY FASTENERS	-	-
36	-	RECEPTOR INSERT FASTENERS, AT 6" FROM ENDS & 12" O.C.	-	-
37	1/2" X 1"	GLASS STOP FASTENERS, AT 6" FROM ENDS & 12" O.C.	-	-
38	-	INTERLOCK REINF. FASTENERS	-	-
39	-	ASTRAGAL STILE FASTENERS	-	-
40	-	-	-	-
41	-	ADD-ON TRACK ATTACHMENT PLATE	-	-
42	-	ADD-ON TRACK PLATE FASTENERS	-	-

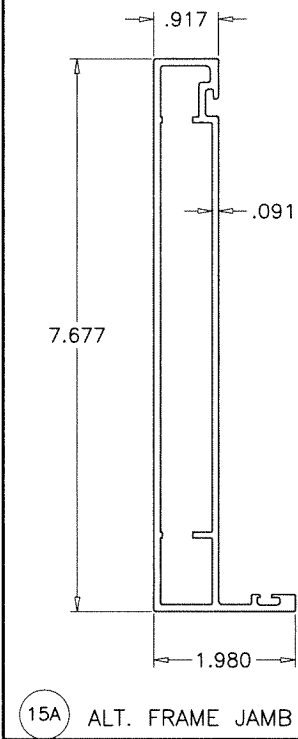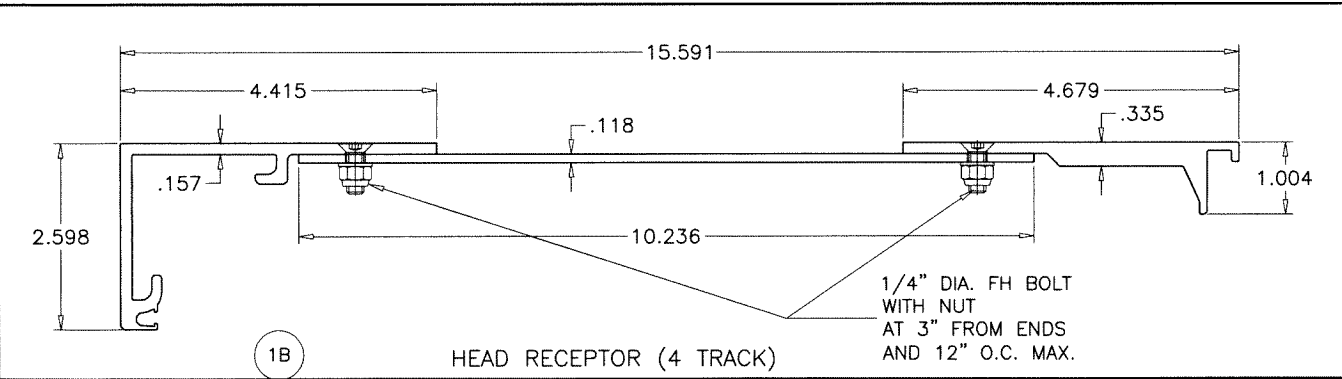

Sealed: 9/24/2026

FL #22232

JALAL FAROOQ

LICENSE

No. 81223

STATE OF FLORIDA

PROFESSIONAL ENGINEER

date: 12-05-16

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.

W16-77

sheet 11 of 12

af c

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220

MIAMI, FLORIDA 33173

TEL. (305) 262-6978

FAX. (305) 262-6978

(C.A.N. 3538)

ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC

3550 N.W. 49 STREET


MIAMI, FL. 33142

TEL. (305) 638-5151

FAX. (305) 638-5158


revisions:

no	date	by	description

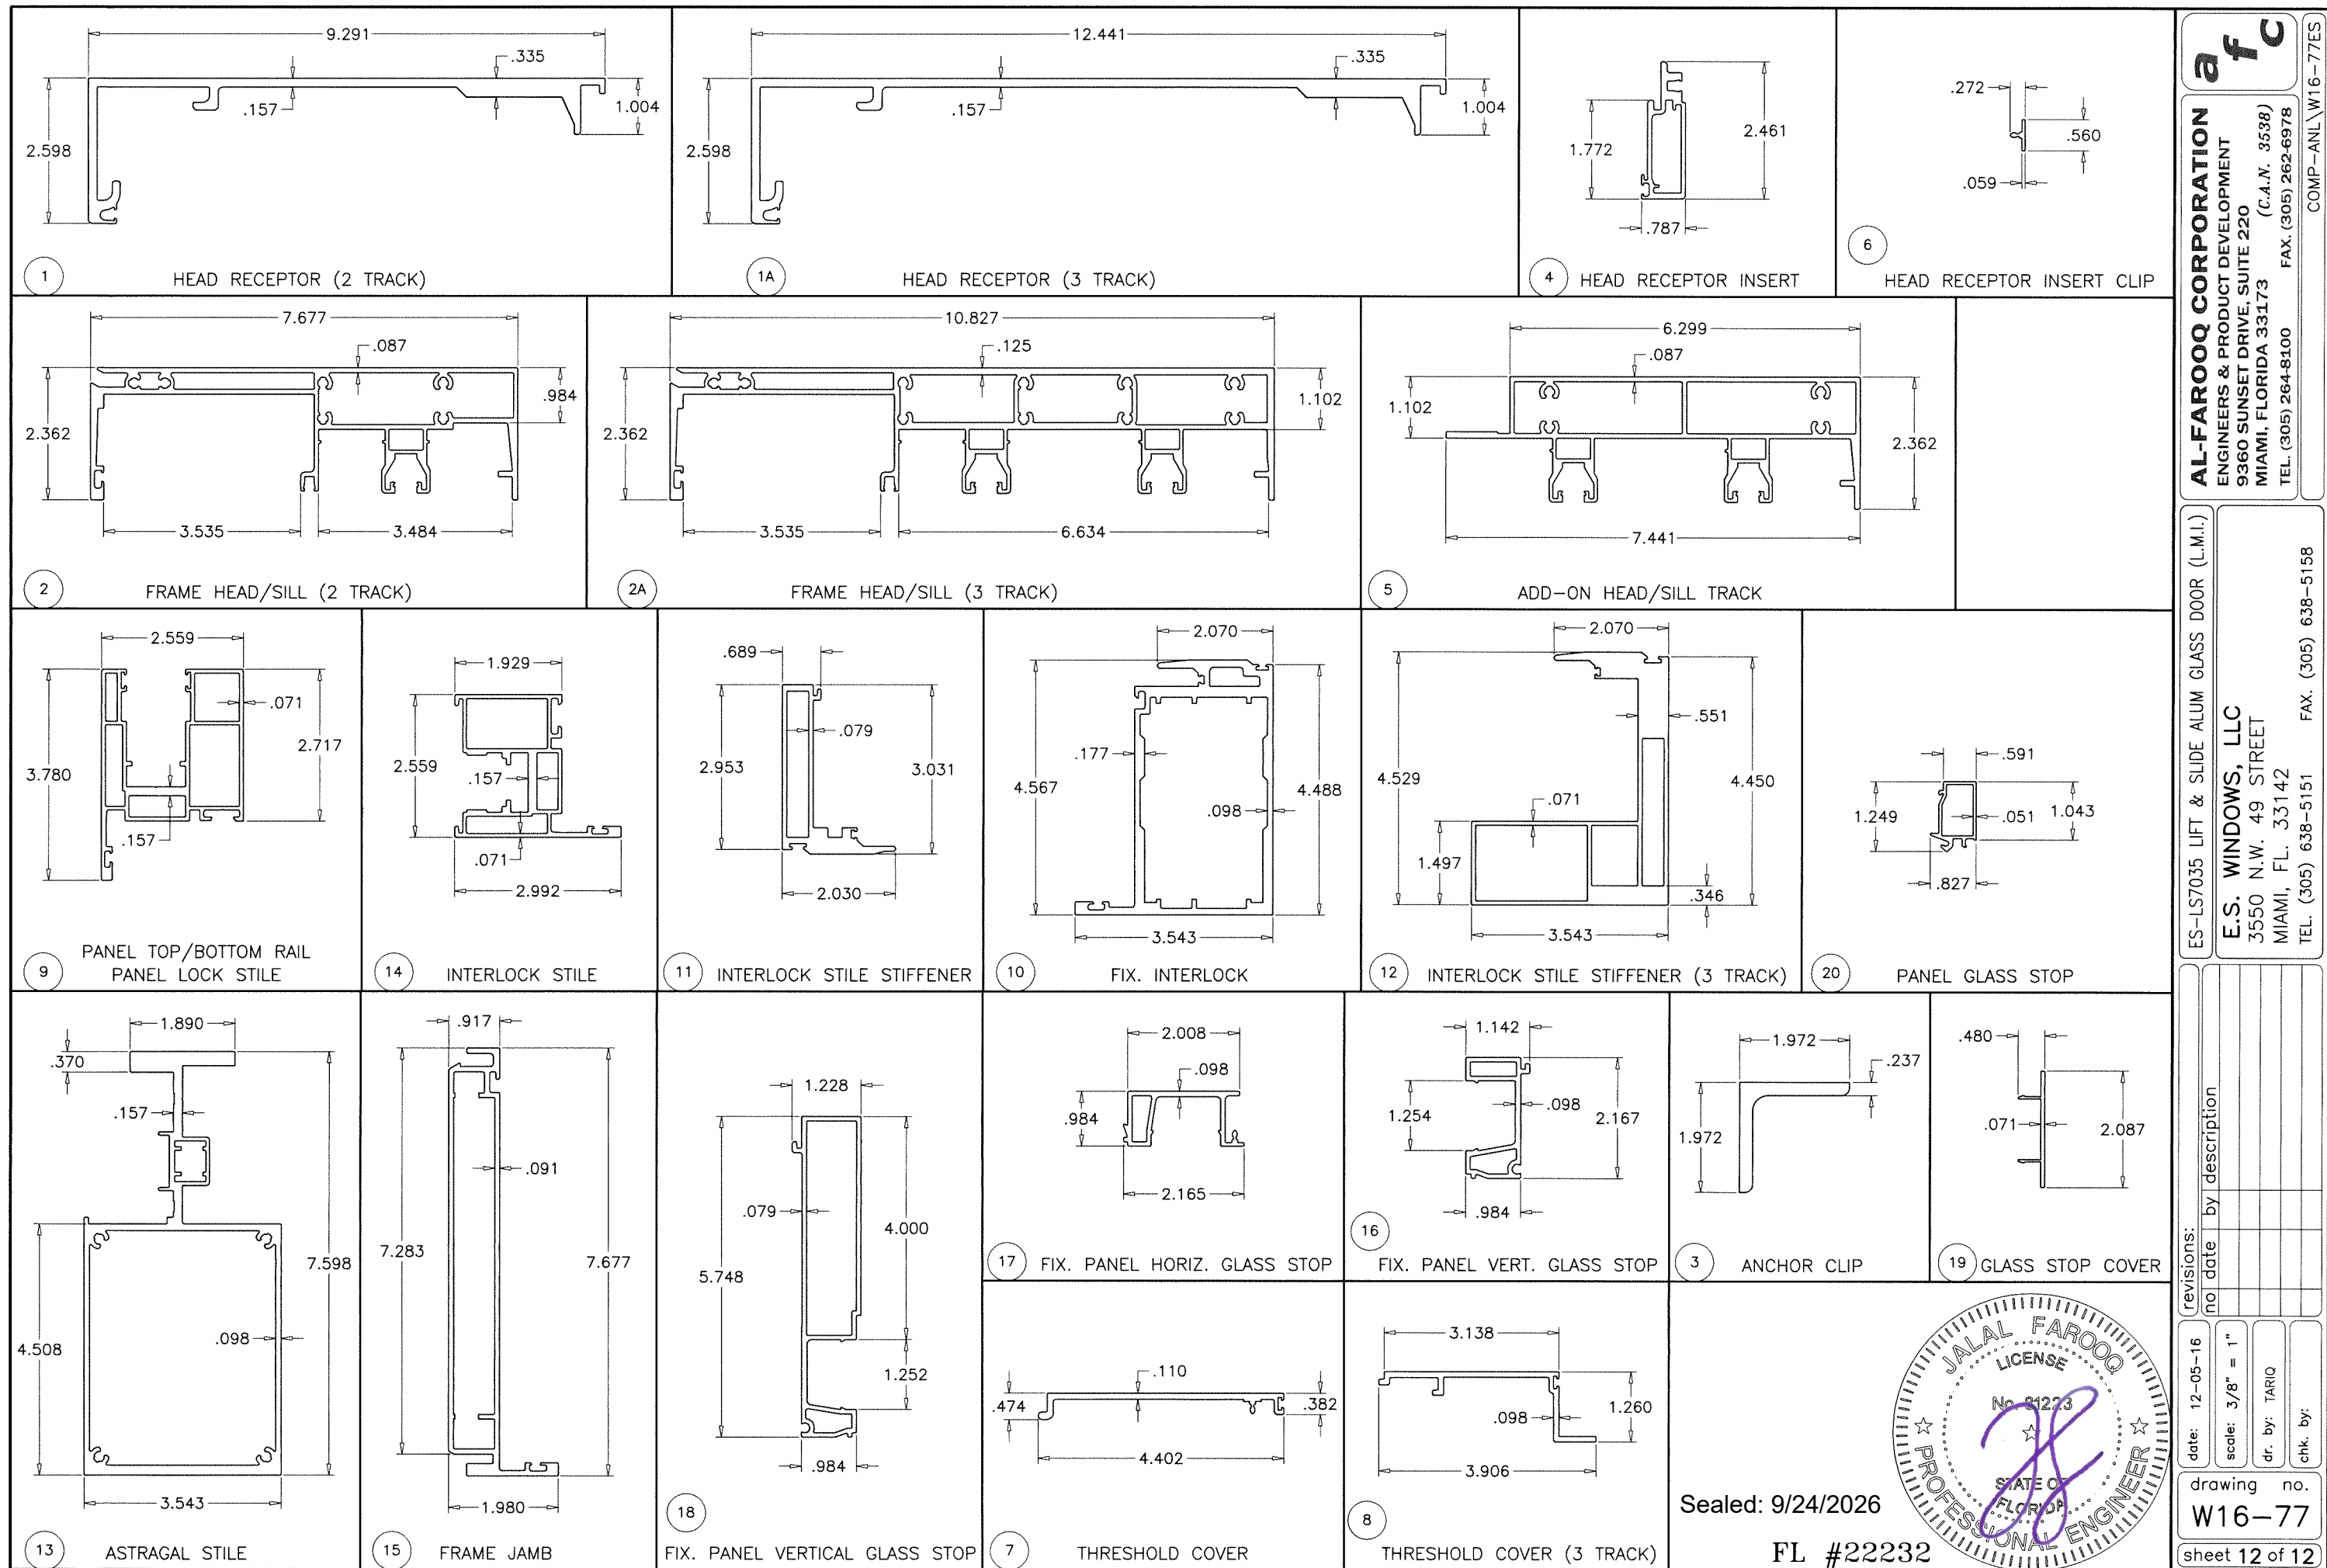

Sealed: 9/24/2026

FL #22232

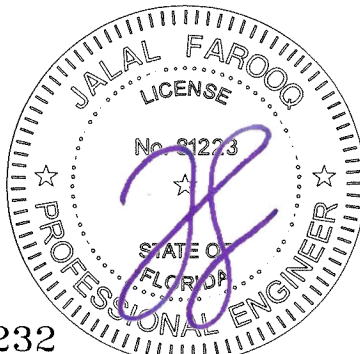

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W16-77ES

ES-LS7035 LIFT & SLIDE ALUM GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 12-05-16
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W16-77
sheet 12 of 12