




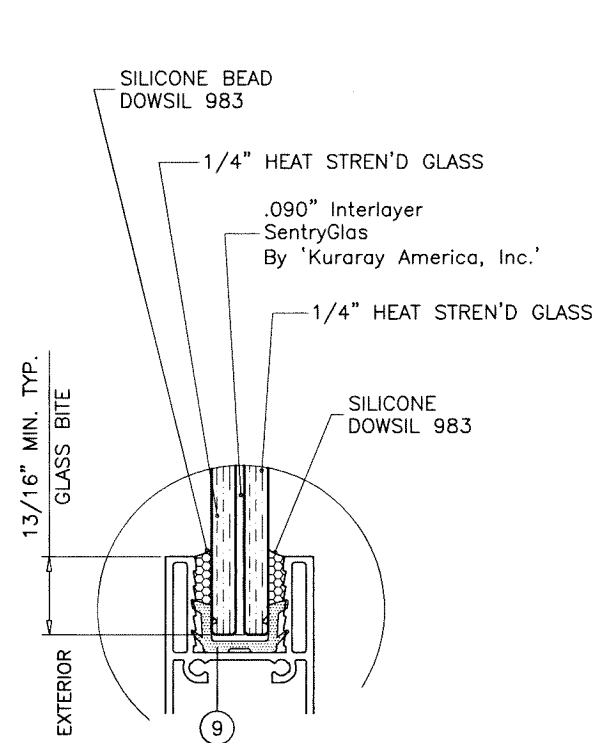

GLASS TYPE 'A'
9/16" OVERALL LAM. GLASS

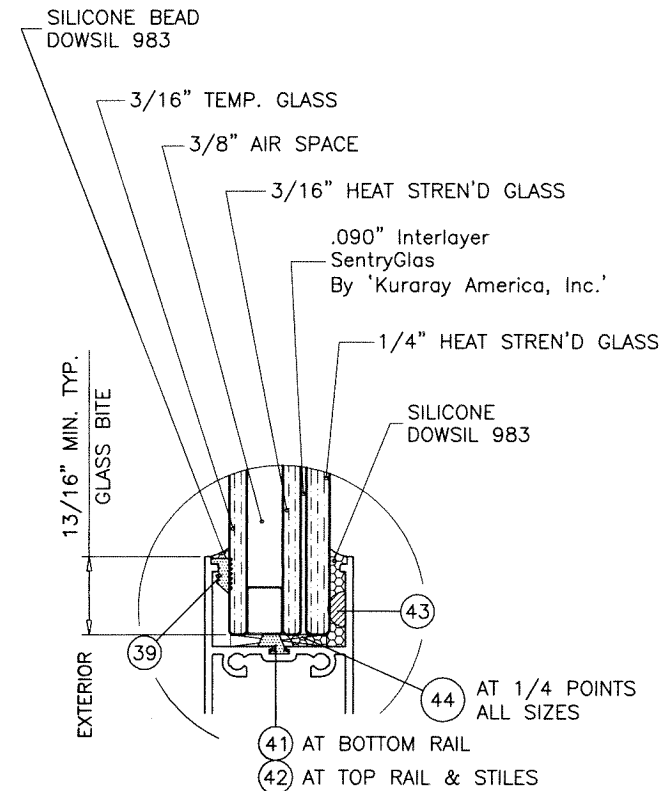

GLASS TYPE 'B'
1-1/16" OVERALL INSUL. LAM. GLASS

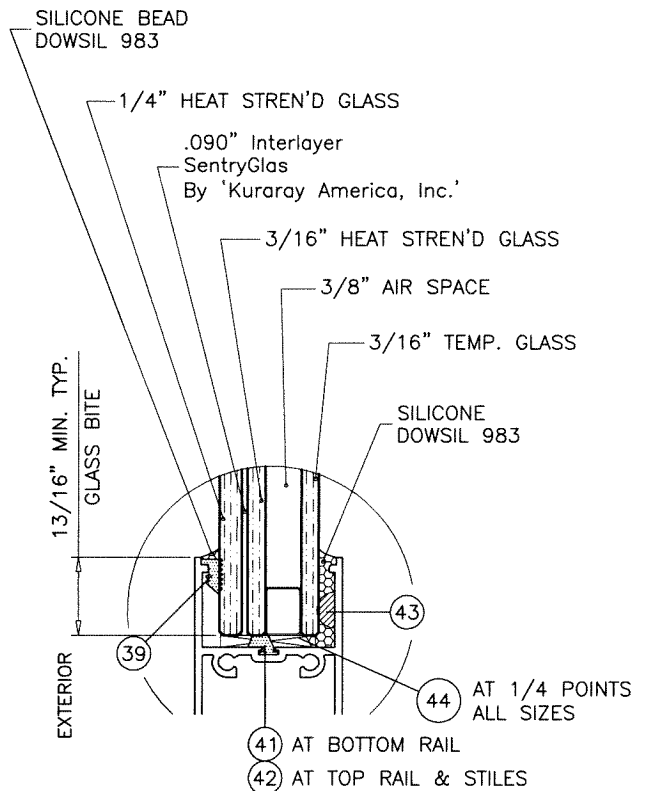

GLASS TYPE 'B' (REVERSE)
1-1/16" OVERALL INSUL. LAM. GLASS

GLAZING OPTIONS

3/8" AIR SPACE CONSISTING OF:

SPACER:

'HELIMA' LOW PROFILE ALUMINUM SPACER
BY 'LINGERMANN GMBH'
AROUND THE PERIMETER OF THE GLASS.


PERIMETER SEALANT:

SILICONE
DOWSIL 791
GE 2000

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

Sealed: 9/15/2026

FL #22251

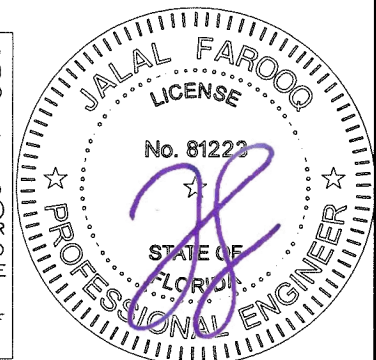

SERIES-6000-3 TRACK ALUMINUM SLIDING GLASS DOOR

SEE SHEETS 4 & 5 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE AND REQUIRED REINFORCING.

USING CHART ON SHEET 6 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOADS REQUIRED.

LOWER DESIGN PRESSURES FROM GLASS OR ANCHOR CHARTS WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

VERIFY COMPLIANCE WITH EGRESS LIMITATIONS WHERE REQUIRED.

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

no	date	by	description
A	07.25.23		UPDATED TO 2023 FBC
B	09.14.26		UPDATED TO 2026 FBC


date: 02-18-19
scale: -
dr. by: TARIQ
chk. by:

drawing no.

19-09F

sheet 1 of 13

COMP-ANL 19-09F-ES

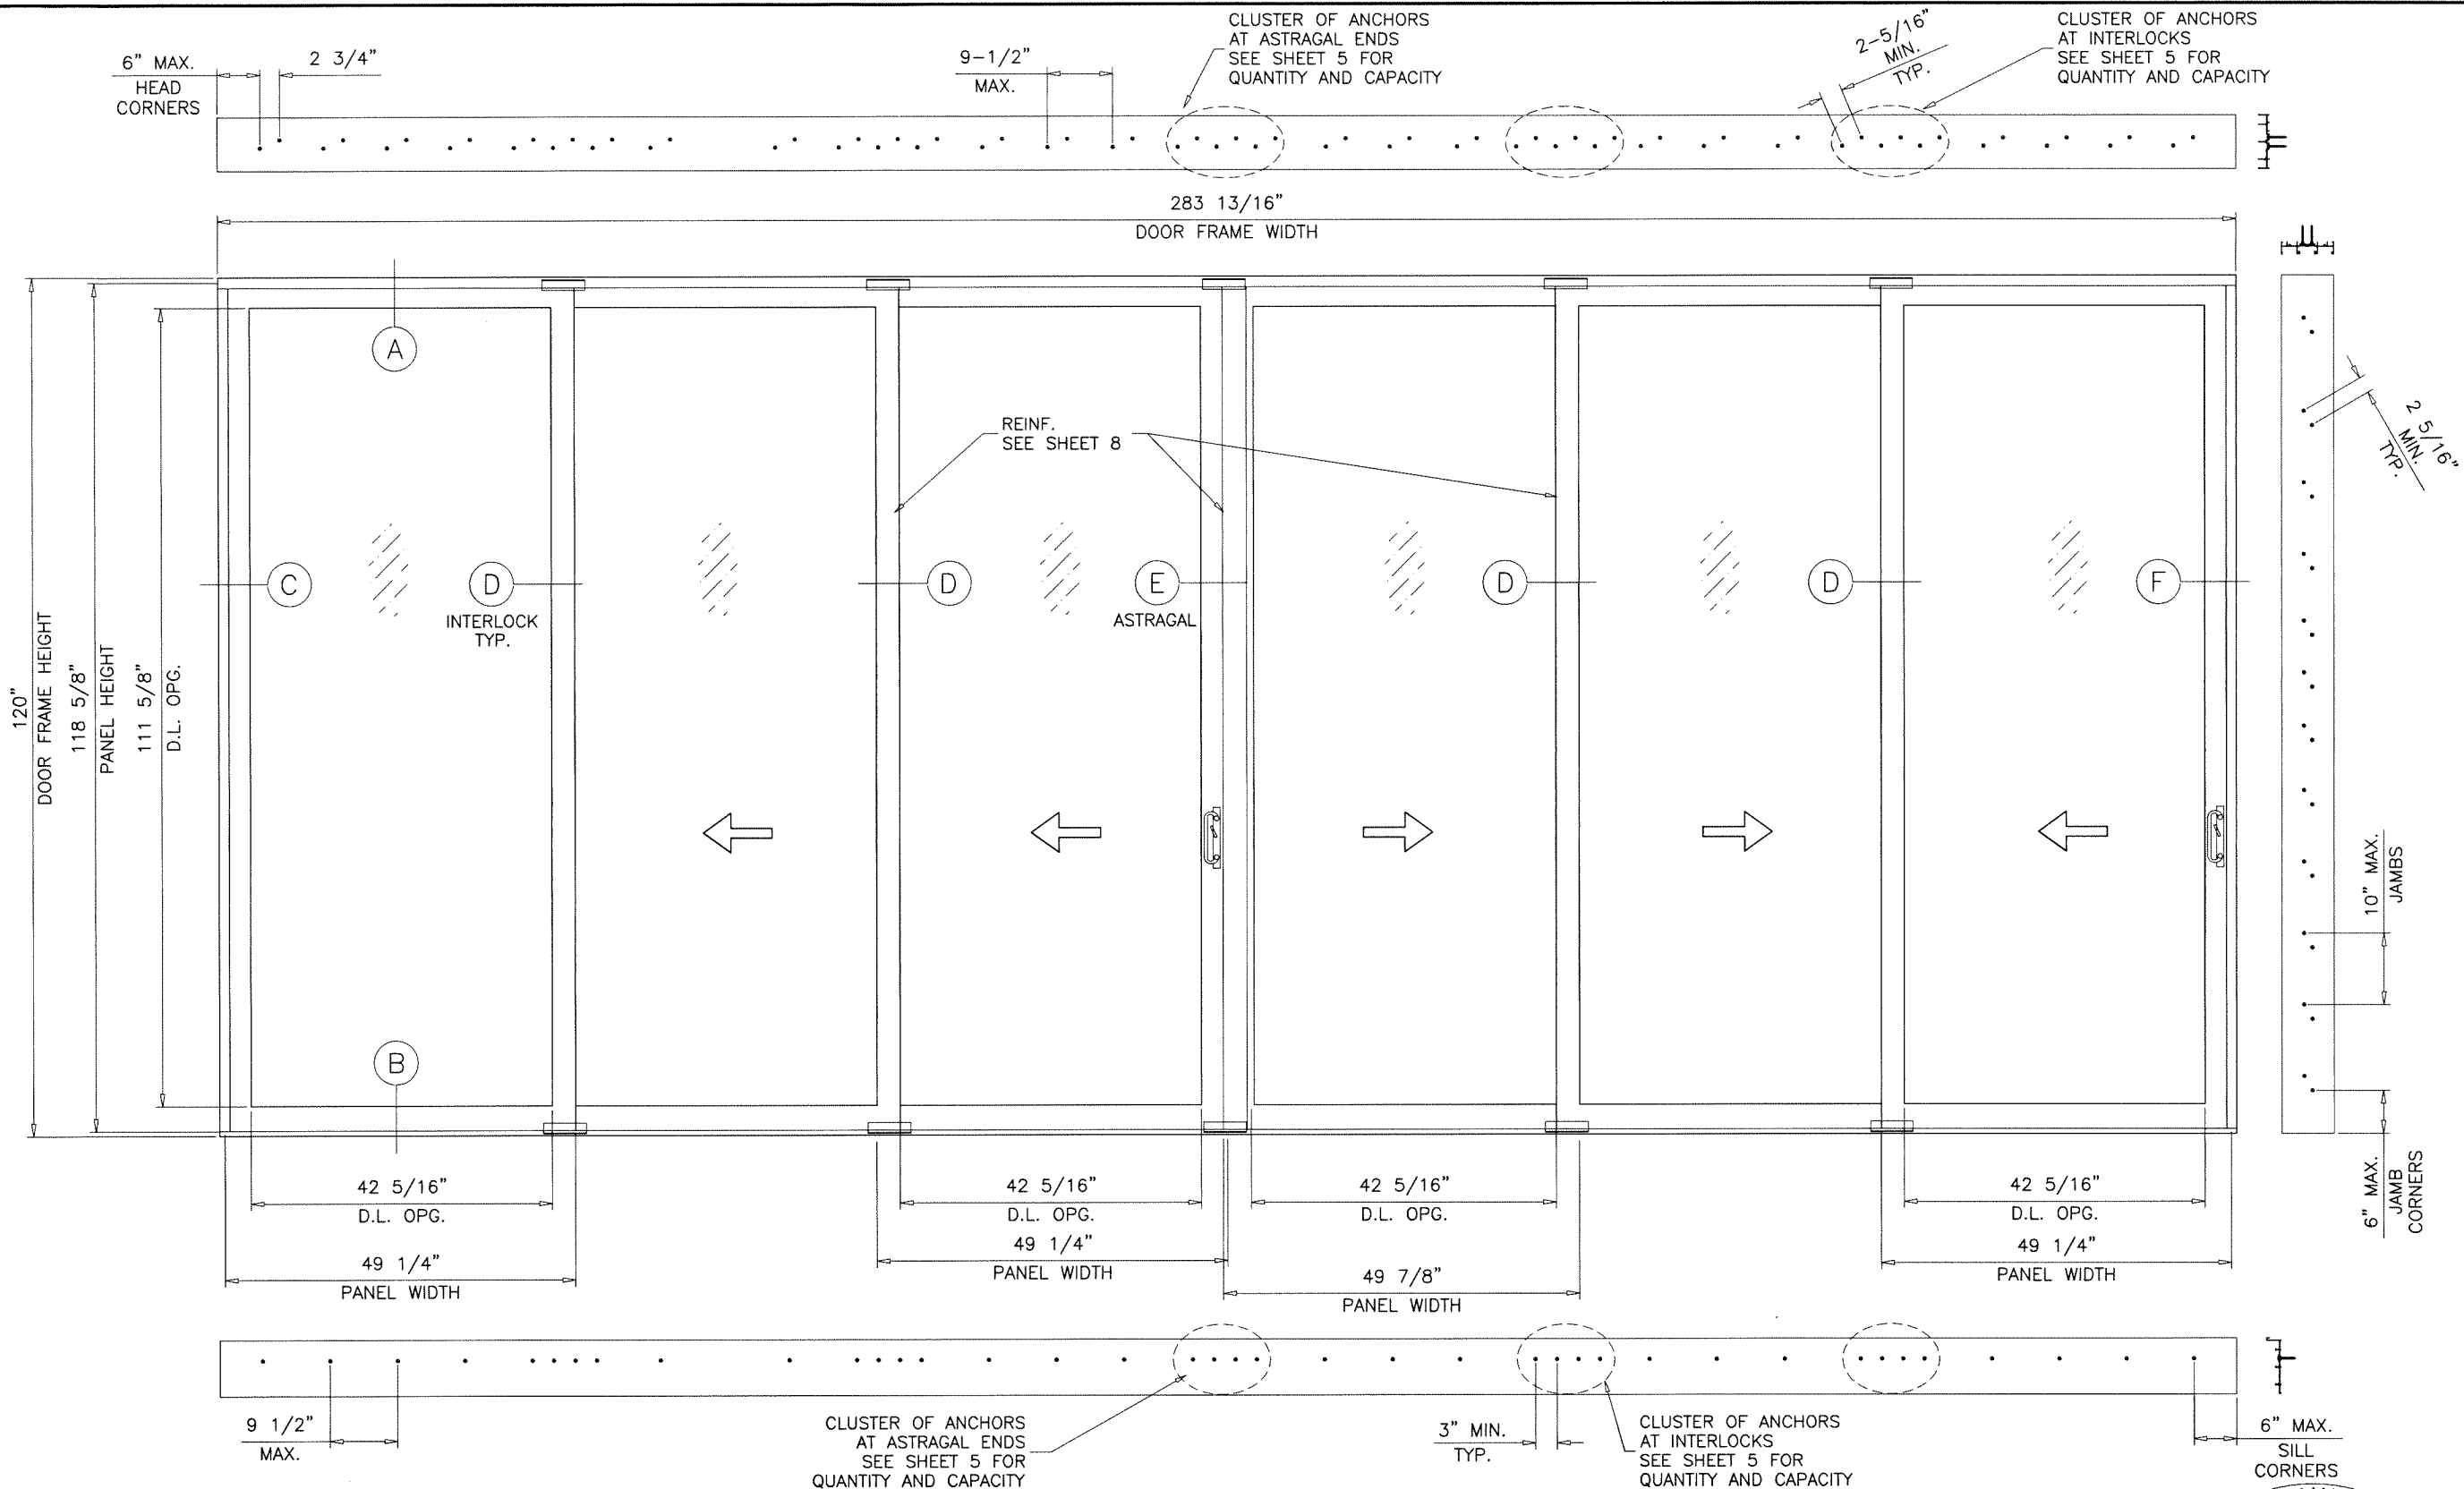


TYPICAL ELEVATION
THREE (3) TRACK DOORS
OXXXXX

DAYLITE OPENINGS:
D.L.O. HEIGHT = PANEL HEIGHT - 7.000"
D.L.O. WIDTH = PANEL WIDTH - 6.937"
PANEL HEIGHT = FRAME HEIGHT - 1.375"

Sealed: 9/15/2026

FL #22251

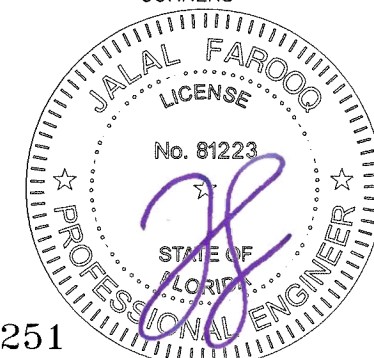

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978



COMP-ANL\19-09F-ES

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)





E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 02-18-19	scale: -	dr. by: TARIQ	chk. by:	drawing no. 19-09F
				sheet 2 of 13

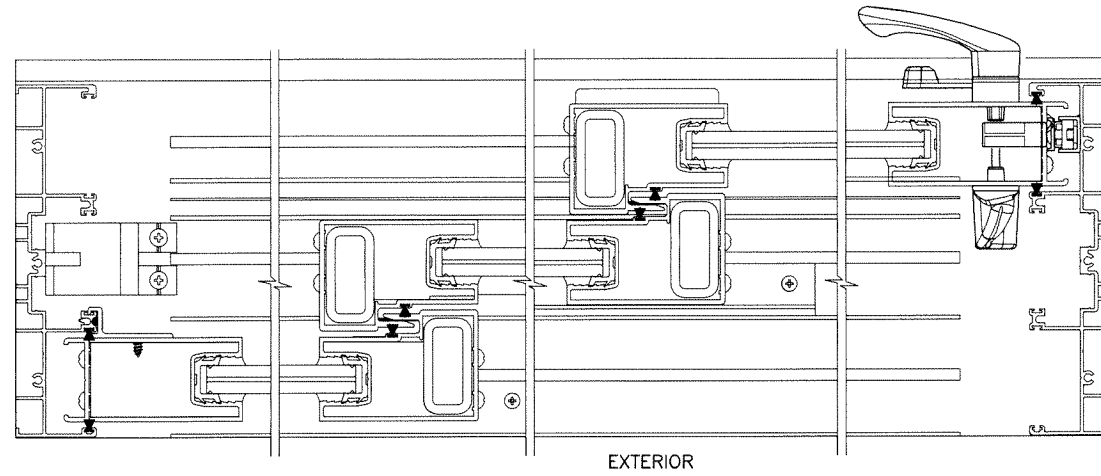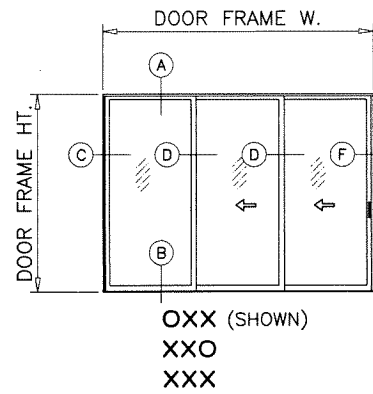


NOTE:
CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSE
SEE APPLICABLE DESIGN PRESSURE & SIZE IN
SHEETS 4 & 5.
SEE SHEET 6 FOR ANCHOR INSTALLATION.

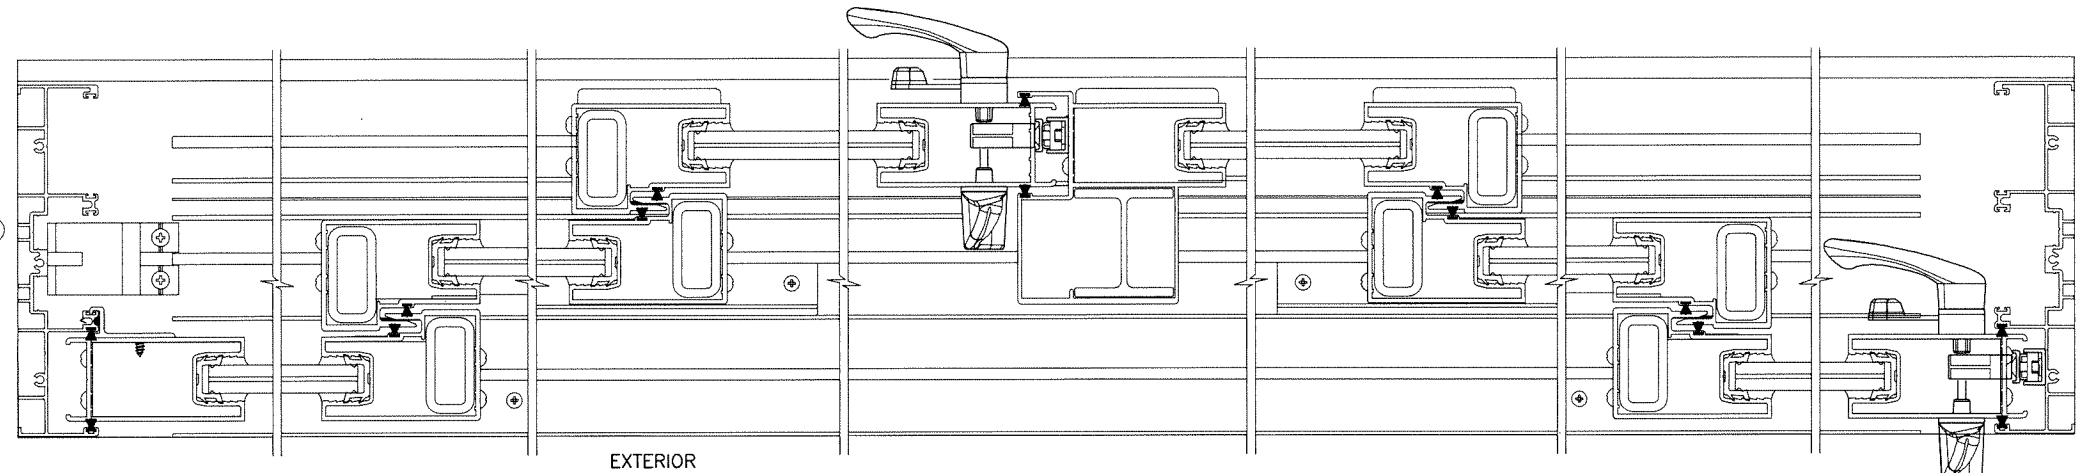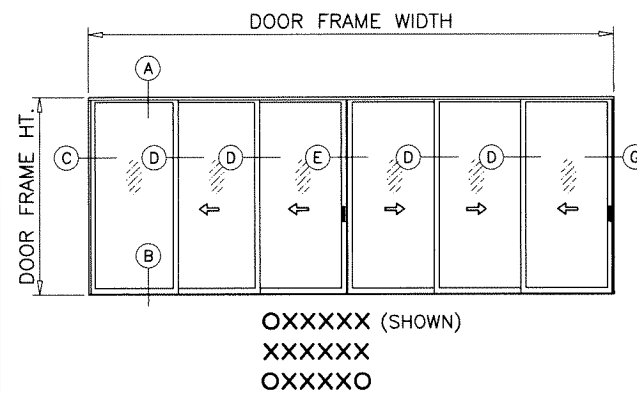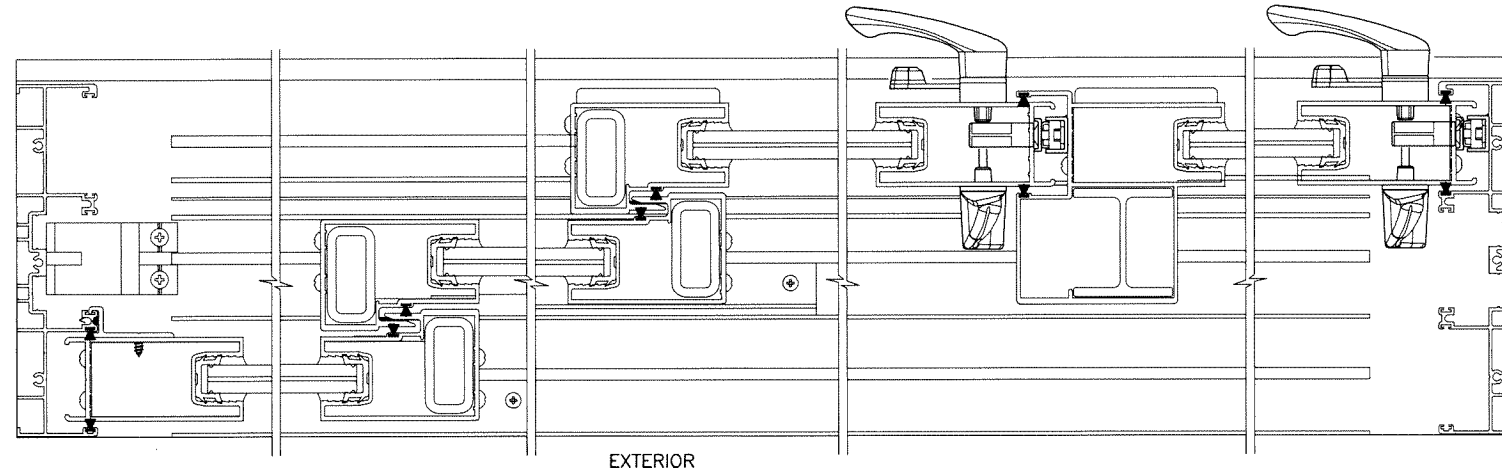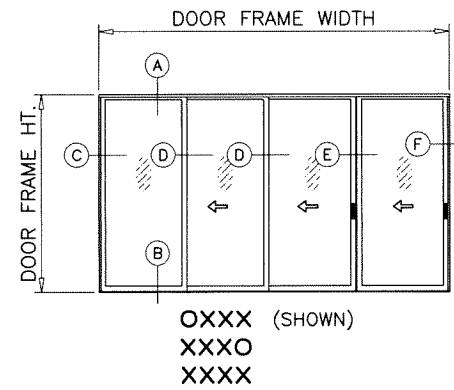

APPROVED CONFIGURATIONS

Sealed: 9/15/2026

FL #22251

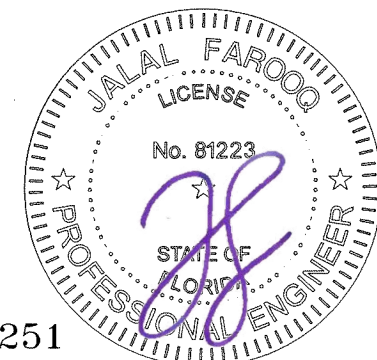

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

revisions:
no date by description

date: 02-18-19
scale: -
dr. by: TARIQ
chk. by:


drawing no.

19-09F

sheet 3 of 13

COMP-ANL\19-09F-ES


DESIGN LOAD CAPACITY - PSF							
REINFORCING LEVEL '1'							
PANEL WIDTH NOMINAL INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'B' REVERSE	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
36	82	85.0	110.0	85.0	110.0	85.0	110.0
40		85.0	110.0	85.0	110.0	85.0	110.0
44		85.0	110.0	85.0	110.0	85.0	110.0
48		85.0	110.0	85.0	110.0	85.0	110.0
50		81.6	110.0	81.6	110.0	81.6	105.6
53		77.0	110.0	77.0	110.0	77.0	99.6
56		72.9	110.0	72.9	110.0	72.9	94.3
60		68.0	104.0	68.0	104.0	68.0	88.0
36	96	85.0	110.0	85.0	110.0	85.0	110.0
40		85.0	110.0	85.0	110.0	85.0	110.0
44		85.0	110.0	85.0	110.0	85.0	110.0
48		85.0	110.0	85.0	110.0	85.0	110.0
50		81.6	110.0	81.6	110.0	81.6	105.6
53		77.0	110.0	77.0	110.0	77.0	99.6
56		72.9	110.0	72.9	110.0	72.9	94.3
60		68.0	104.0	68.0	104.0	68.0	88.0
36	102	85.0	110.0	85.0	110.0	85.0	110.0
40		85.0	110.0	85.0	110.0	85.0	110.0
44		85.0	110.0	85.0	110.0	85.0	110.0
48		85.0	110.0	85.0	110.0	85.0	110.0
50		81.6	110.0	81.6	110.0	81.6	105.6
53		77.0	110.0	77.0	110.0	77.0	99.6
56		72.9	110.0	72.9	110.0	72.9	94.3
36	108	85.0	110.0	85.0	110.0	85.0	110.0
40		85.0	110.0	85.0	110.0	85.0	110.0
44		85.0	110.0	85.0	110.0	85.0	110.0
48		85.0	110.0	85.0	110.0	85.0	110.0
50		81.6	110.0	81.6	110.0	81.6	105.6
53		77.0	110.0	77.0	110.0	77.0	99.6
36	114	85.0	110.0	85.0	110.0	85.0	110.0
40		85.0	110.0	85.0	110.0	85.0	110.0
44		85.0	110.0	85.0	110.0	85.0	110.0
48		85.0	110.0	85.0	110.0	85.0	110.0
50		81.6	105.6	81.6	105.6	81.6	105.6
36	120	85.0	110.0	85.0	110.0	85.0	110.0
40		85.0	110.0	85.0	110.0	85.0	110.0
44		85.0	110.0	85.0	110.0	85.0	110.0
48		85.0	110.0	85.0	110.0	85.0	110.0

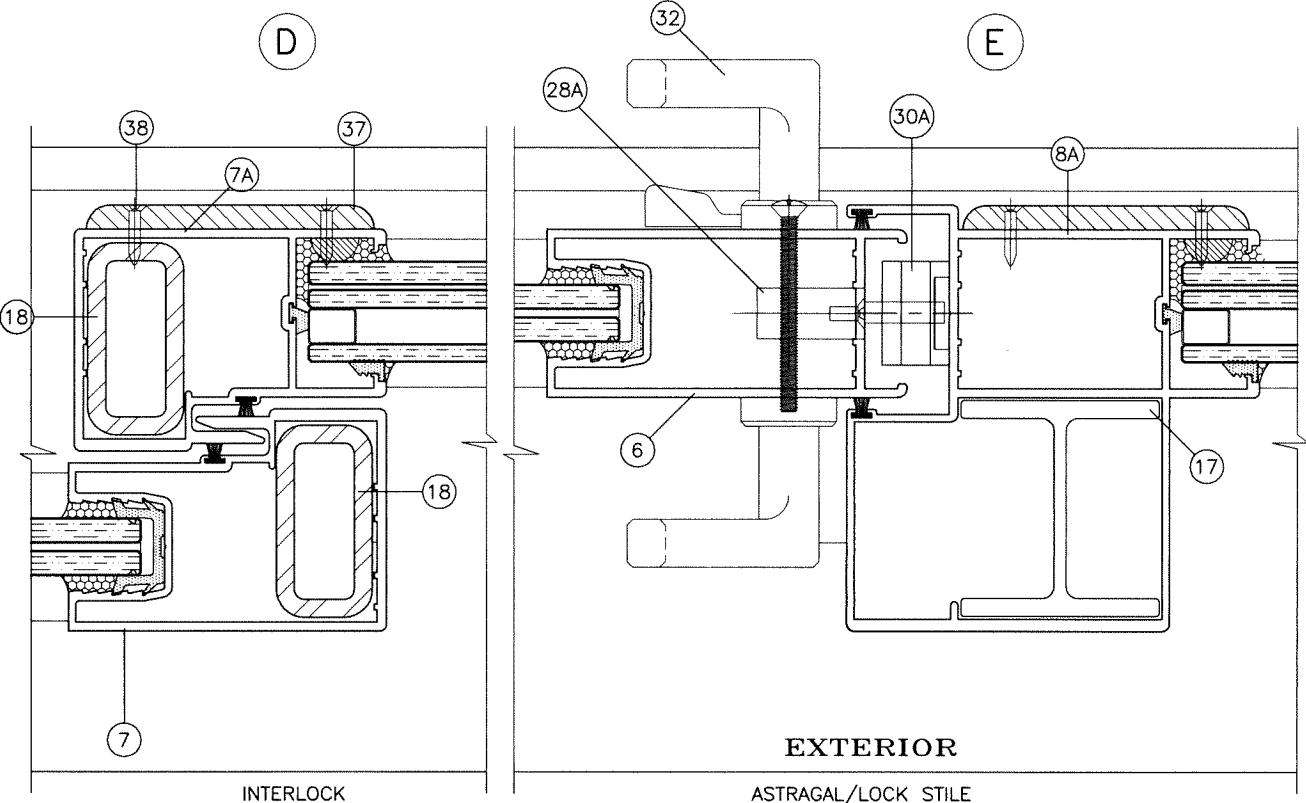

REINFORCING LEVEL '1'

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 9/15/2026

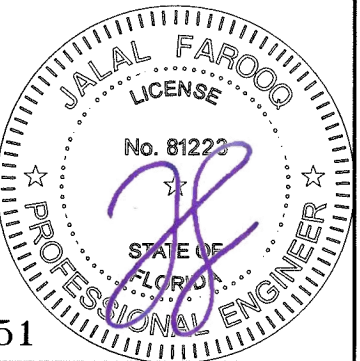

FL #22251

af c

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220

MIAMI, FLORIDA 33173

TEL. (305) 262-6978

FAX. (305) 264-8100

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC

3550 N.W. 49 STREET

MIAMI, FL. 33142

TEL. (305) 638-5151

FAX. (305) 638-5158

revisions:

no	date	by	description

date: 02-18-19

scale: 1/2" = 1"

dr. by: TARIQ


chk. by:

drawing no.

19-09F



sheet 4 of 13

DESIGN LOAD CAPACITY - PSF GLASS TYPE 'C'					
PANEL WIDTH NOMINAL INCHES	DOOR FRAME HEIGHT INCHES	REINF. LEVEL '1'		REINF. LEVEL '2'	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
36	82	85.0	95.0	85.0	125.0
42		85.0	95.0	85.0	125.0
44		85.0	95.0	85.0	125.0
48		85.0	95.0	85.0	125.0
54		85.0	95.0	85.0	125.0
60		85.0	95.0	85.0	125.0
36	96	85.0	95.0	85.0	125.0
42		85.0	95.0	85.0	125.0
44		85.0	95.0	85.0	125.0
48		85.0	95.0	85.0	125.0
54		85.0	95.0	85.0	125.0
60		85.0	95.0	85.0	125.0
36	102	85.0	95.0	85.0	125.0
42		85.0	95.0	85.0	125.0
44		85.0	95.0	85.0	125.0
48		85.0	95.0	85.0	125.0
54		85.0	95.0	85.0	125.0
60		85.0	95.0	85.0	125.0
36	108	85.0	95.0	85.0	125.0
42		85.0	95.0	85.0	125.0
44		85.0	95.0	85.0	125.0
48		85.0	95.0	85.0	125.0
54		85.0	95.0	85.0	125.0
55		85.0	95.0	85.0	125.0
60		85.0	95.0	85.0	125.0
36	114	85.0	95.0	85.0	125.0
42		85.0	95.0	85.0	125.0
44		85.0	95.0	85.0	125.0
48		85.0	95.0	85.0	125.0
54		85.0	95.0	85.0	125.0
55		85.0	95.0	85.0	125.0
36	120	85.0	95.0	85.0	125.0
42		85.0	95.0	85.0	125.0
44		85.0	95.0	85.0	125.0
48		85.0	95.0	85.0	125.0
54		85.0	95.0	85.0	125.0
55		85.0	95.0	85.0	125.0

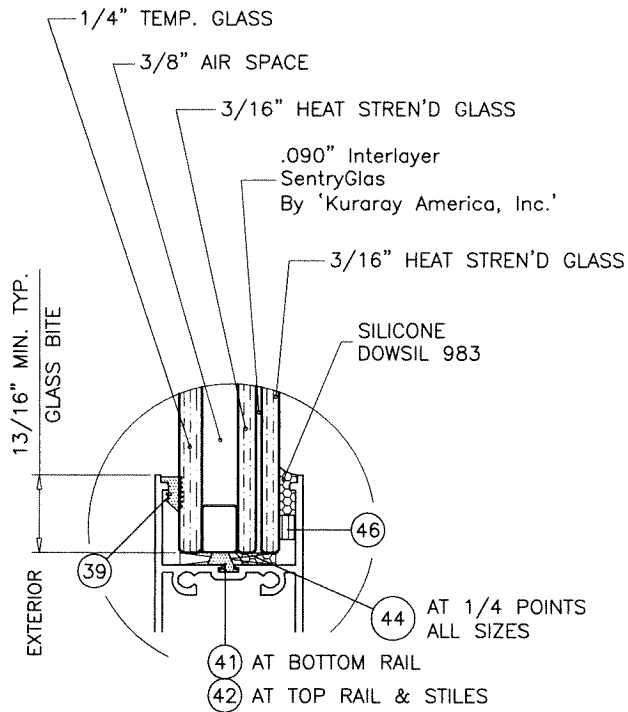

GLASS TYPE 'C'
1-1/16" OVERALL INSUL. LAM. GLASS
GLAZING DETAIL

3/8" AIR SPACE CONSISTING OF:
SPACER:
'HELIMA' LOW PROFILE ALUMINUM SPACER
BY 'LINGERMANN GMBH'
AROUND THE PERIMETER OF THE GLASS.
PERIMETER SEALANT:
SILICONE
DOWSIL 791
GE 2000

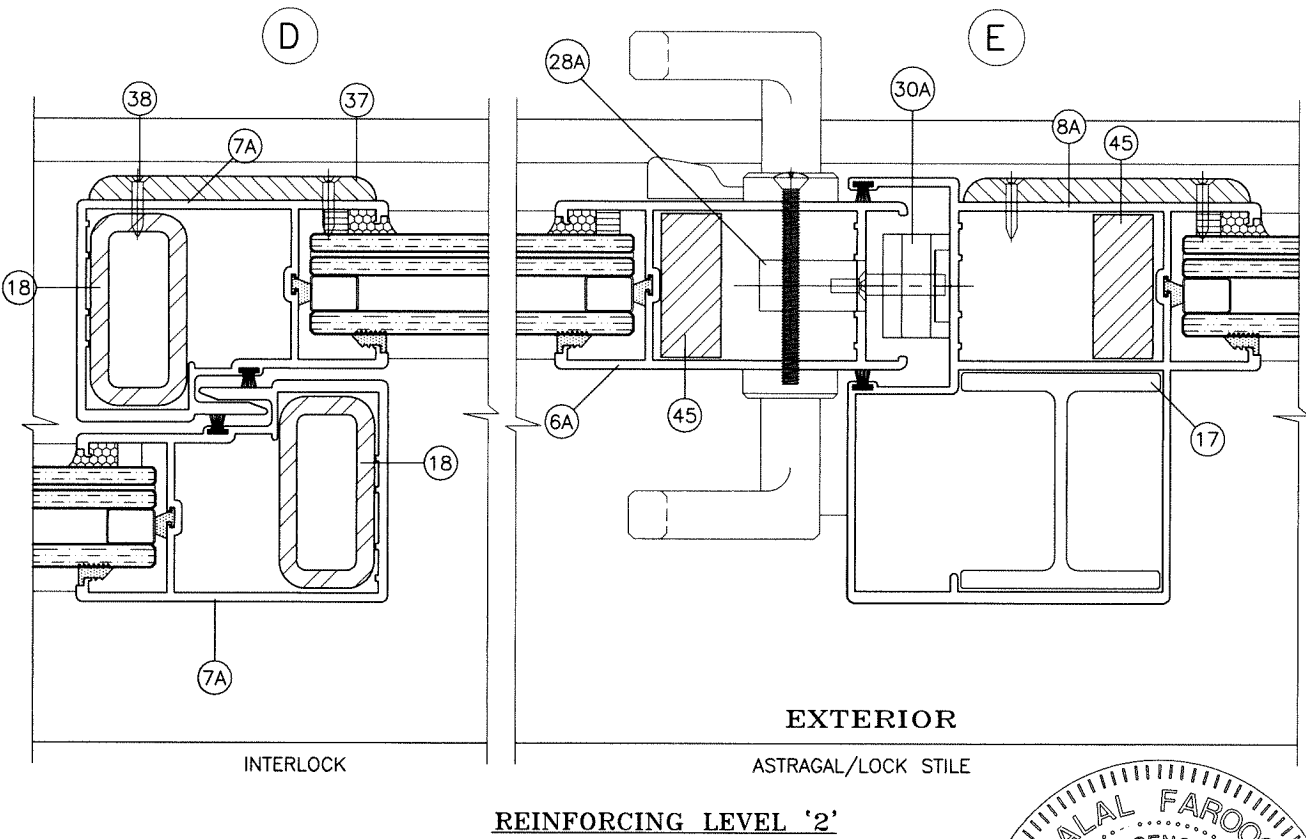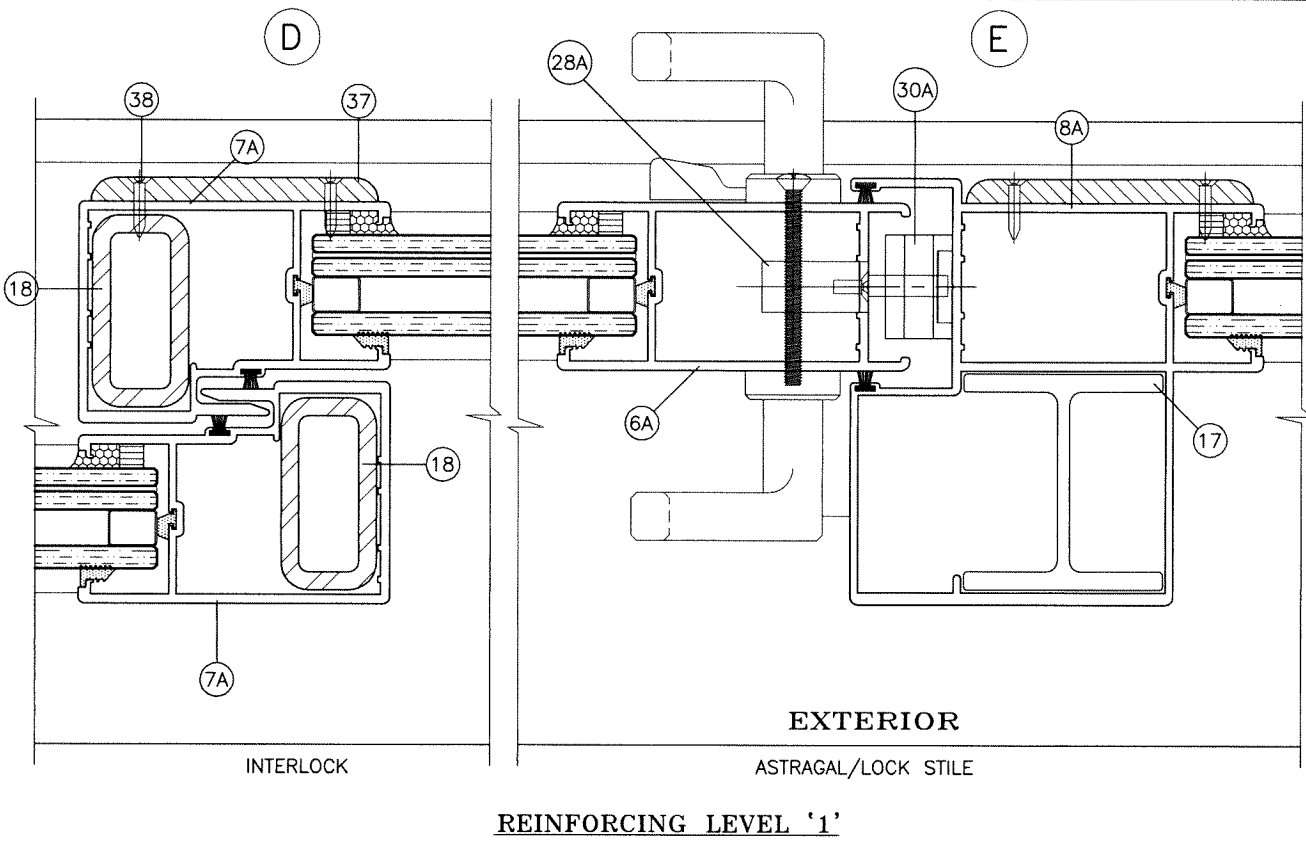

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 9/15/2026

FL #22251



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:
no date by description
date: 02-18-19
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:
drawing no.
19-09F
sheet 5 of 13

HEAD ANCHOR LOAD CAPACITY - PSF						
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	ANCHOR TYPE 'A'		ANCHOR TYPE 'B'		ANCHOR TYPE 'C'
		6 ANCHORS AT MTG. STYLE ENDS	7 ANCHORS AT MTG. STYLE ENDS	6 ANCHORS AT MTG. STYLE ENDS	7 ANCHORS AT MTG. STYLE ENDS	6 ANCHORS AT MTG. STYLE ENDS
		INT. (-)	INT. (-)	INT. (-)	INT. (-)	INT. (-)
36	82	125.0	125.0	125.0	125.0	125.0
40		125.0	125.0	125.0	125.0	125.0
42		125.0	125.0	125.0	125.0	125.0
44		125.0	125.0	125.0	125.0	125.0
48		125.0	125.0	125.0	125.0	125.0
50		125.0	125.0	125.0	125.0	125.0
53		125.0	125.0	125.0	125.0	125.0
54		125.0	125.0	125.0	125.0	125.0
56		125.0	125.0	125.0	125.0	125.0
60		125.0	125.0	125.0	125.0	125.0
36	96	125.0	125.0	125.0	125.0	125.0
40		125.0	125.0	125.0	125.0	125.0
42		125.0	125.0	125.0	125.0	125.0
44		125.0	125.0	125.0	125.0	125.0
48		125.0	125.0	125.0	125.0	125.0
50		125.0	125.0	125.0	125.0	125.0
53		125.0	125.0	125.0	125.0	125.0
54		125.0	125.0	125.0	125.0	125.0
56		125.0	125.0	125.0	125.0	125.0
60		125.0	125.0	125.0	125.0	125.0
36	102	125.0	125.0	125.0	125.0	125.0
40		125.0	125.0	125.0	125.0	125.0
42		125.0	125.0	125.0	125.0	125.0
44		125.0	125.0	125.0	125.0	125.0
48		125.0	125.0	125.0	125.0	125.0
50		125.0	125.0	125.0	125.0	125.0
53		124.2	125.0	125.0	125.0	125.0
54		121.9	125.0	125.0	125.0	125.0
56		125.0	125.0	125.0	125.0	125.0
60		121.9	125.0	125.0	125.0	125.0
36	108	125.0	125.0	125.0	125.0	125.0
40		125.0	125.0	125.0	125.0	125.0
42		125.0	125.0	125.0	125.0	125.0
44		125.0	125.0	125.0	125.0	125.0
48		125.0	125.0	125.0	125.0	125.0
50		124.3	125.0	125.0	125.0	125.0
53		117.3	125.0	125.0	125.0	125.0
54		115.1	125.0	125.0	125.0	125.0
55		125.0	125.0	125.0	125.0	125.0
60		115.1	125.0	125.0	125.0	125.0
36	114	125.0	125.0	125.0	125.0	125.0
40		125.0	125.0	125.0	125.0	125.0
42		124.6	125.0	125.0	125.0	125.0
44		119.0	125.0	125.0	125.0	125.0
48		122.7	125.0	125.0	125.0	125.0
50		117.8	125.0	125.0	125.0	125.0
54		109.1	121.2	125.0	125.0	125.0
55		119.0	125.0	125.0	125.0	125.0
36	120	125.0	125.0	125.0	125.0	125.0
40		124.3	125.0	125.0	125.0	125.0
42		118.4	125.0	125.0	125.0	125.0
44		113.0	125.0	125.0	125.0	125.0
48		116.6	125.0	125.0	125.0	125.0
54		103.6	115.1	121.9	125.0	125.0
55		113.0	124.3	125.0	125.0	125.0

SILL ANCHOR LOAD CAPACITY - PSF				
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	ANCHOR TYPE 'B'		
		4 ANCHORS AT MTG. STYLE ENDS	5 ANCHORS AT MTG. STYLE ENDS	
		INT. (-)	INT. (-)	
36	82	125.0	125.0	
40		125.0	125.0	
42		125.0	125.0	
44		125.0	125.0	
48		125.0	125.0	
50		125.0	125.0	
53		125.0	125.0	
54		125.0	125.0	
56		125.0	125.0	
60		125.0	125.0	
36	96	125.0	125.0	
40		125.0	125.0	
42		125.0	125.0	
44		125.0	125.0	
48		125.0	125.0	
50		125.0	125.0	
53		125.0	125.0	
54		125.0	125.0	
56		125.0	125.0	
60		125.0	125.0	
36	102	125.0	125.0	
40		125.0	125.0	
42		125.0	125.0	
44		125.0	125.0	
48		125.0	125.0	
50		125.0	125.0	
53		125.0	125.0	
54		125.0	125.0	
56		125.0	125.0	
60		125.0	125.0	
36	108	125.0	125.0	
40		125.0	125.0	
42		125.0	125.0	
44		125.0	125.0	
48		125.0	125.0	
50		125.0	125.0	
53		125.0	125.0	
54		125.0	125.0	
55		125.0	125.0	
60		125.0	125.0	
36	114	125.0	125.0	
40		125.0	125.0	
42		125.0	125.0	
44		125.0	125.0	
48		125.0	125.0	
50		125.0	125.0	
54		124.3	125.0	
55		122.0	125.0	
36	120	125.0	125.0	
40		119.5	125.0	
42		125.0	125.0	
44		125.0	125.0	
48		125.0	125.0	
54		118.0	125.0	
55		115.9	125.0	

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

— AT HEAD —

TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONCRETE
 1-1/2" MIN. EMBED INTO CONCRETE

TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 DIRECTLY INTO CONCRETE
 1-1/2" MIN. EMBED

TYPE 'C'— #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO F.B.C. APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

— AT SILL —

TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 DIRECTLY INTO CONCRETE
 1-3/4" MIN. EMBED

— AT JAMBS —

TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONC. OR BLOCKS

TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 DIRECTLY INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONC. OR BLOCKS

TYPE 'C'— #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO F.B.C. APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


ANCHOR EDGE DISTANCES

INTO CONCRETE = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

NOTE:
 SEE SHEETS 4 & 5 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.
 USING CHART ON THIS SHEET SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN
 DESIGN LOADS REQUIRED.
 LOWER DESIGN PRESSURES FROM GLASS OR HEAD, SILL, JAMB ANCHOR CHARTS WILL
 APPLY TO ENTIRE SYSTEM.

Sealed: 9/15/2026

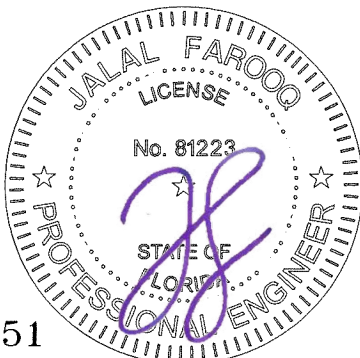

FL #22251

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 262-6978 FAX. (305) 262-6978
 (C.A.N. 3538)

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:

no	date	by	description

date: 02-18-19 scale: - dr. by: TARIQ chg. by:

drawing no. **19-09F**

sheet **6** of **13**

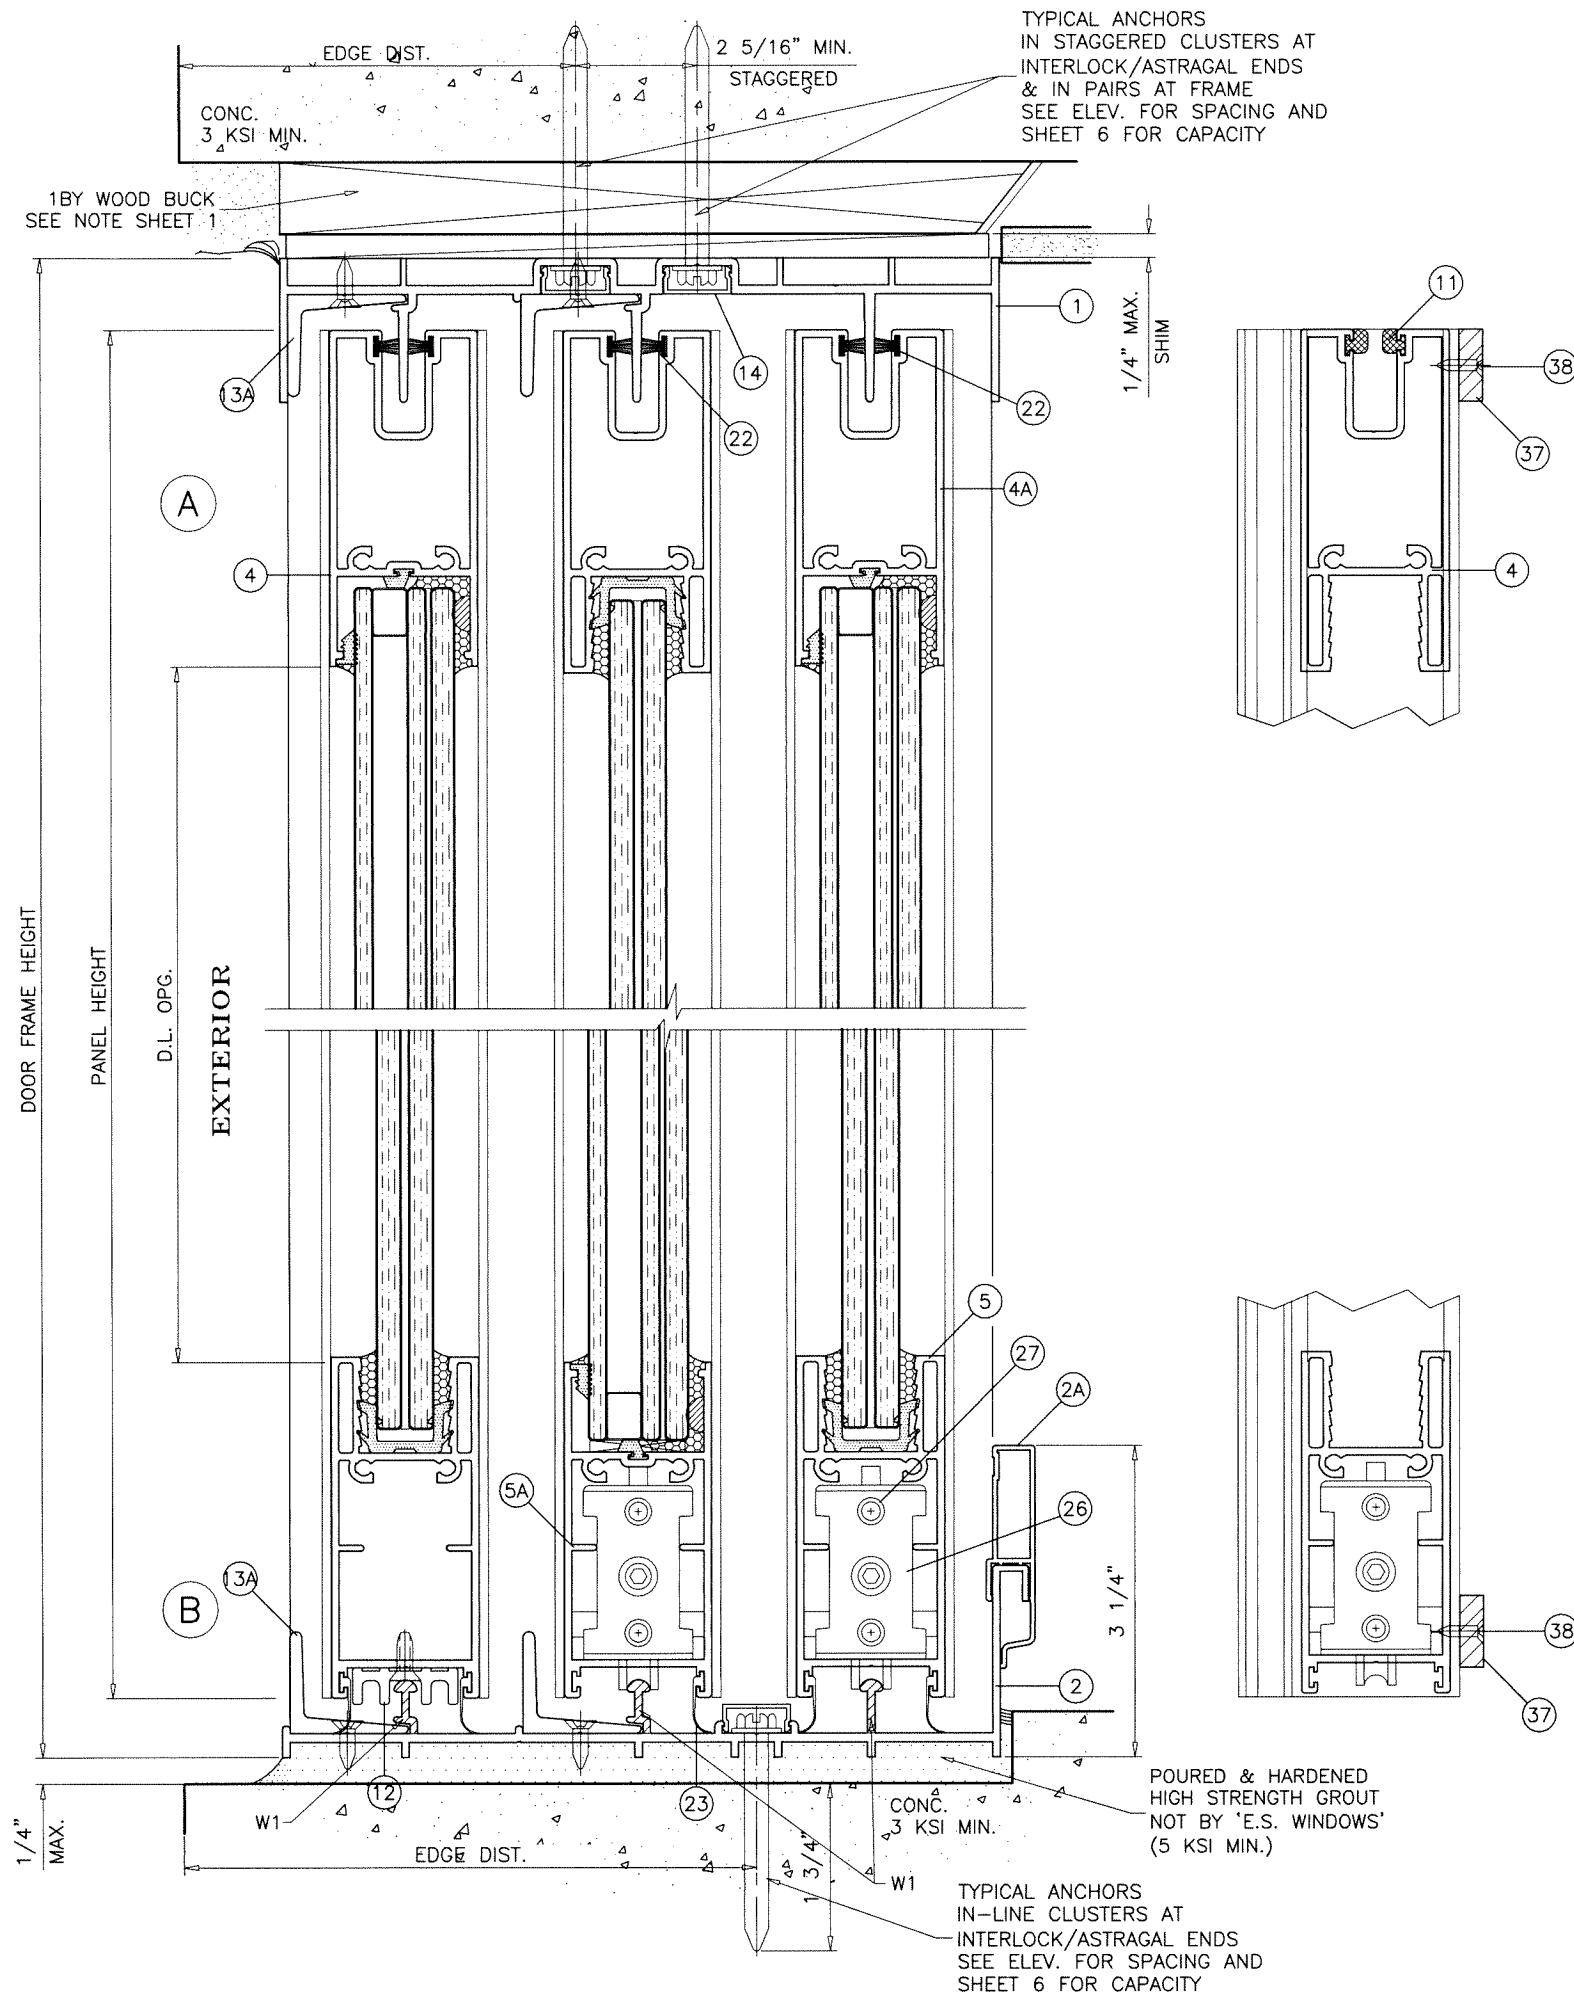

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

WEEPHOLES:

W1 = 2-5/8" LONG WEEP NOTCH AT EACH END

Sealed: 9/15/2026



FL #22251

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

COMP-ANL\19-09F-ES

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 02-18-19

scale: 1/2" = 1"





dr. by: TARIQ

chk. by:


drawing no.

19-09F

sheet 7 of 13

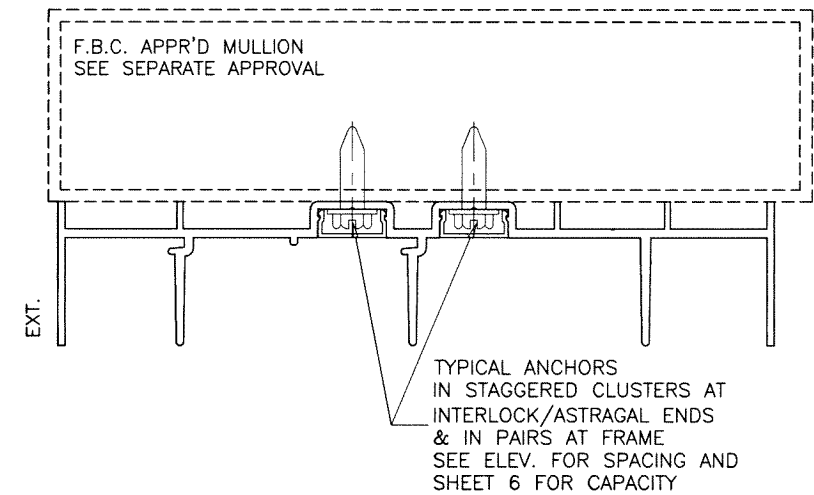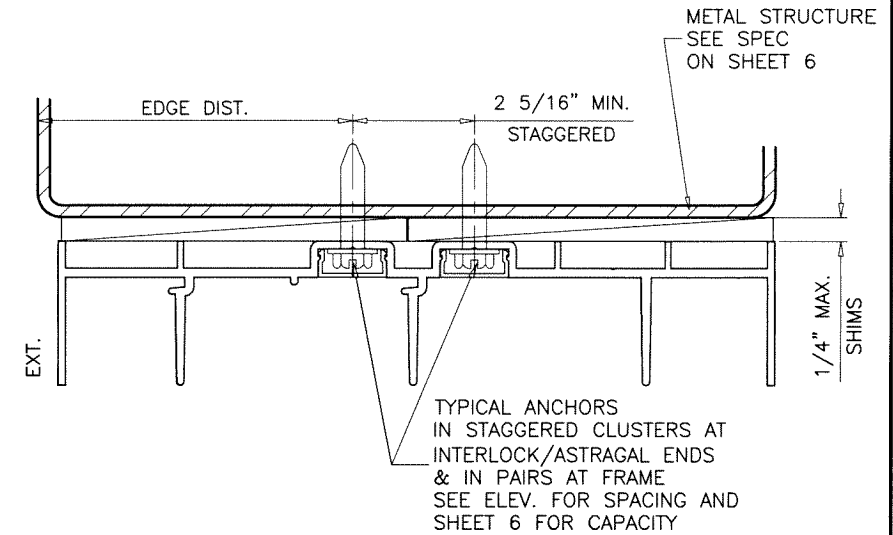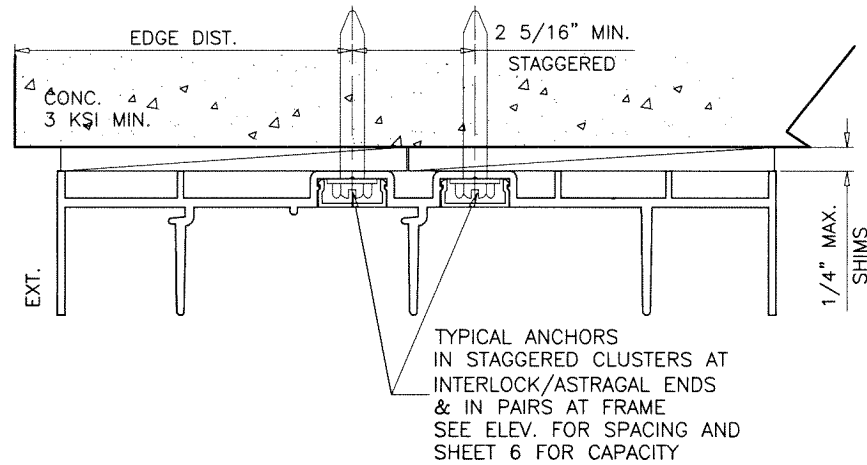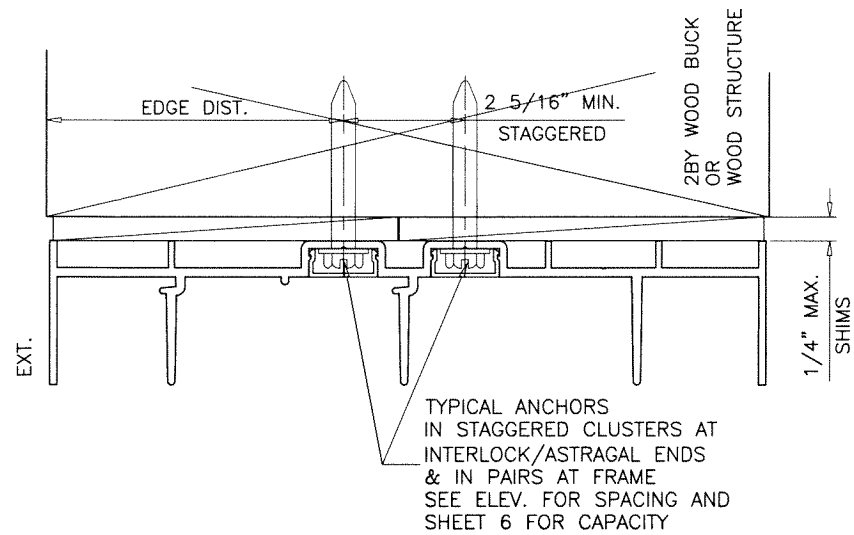

Sealed: 9/15/2026

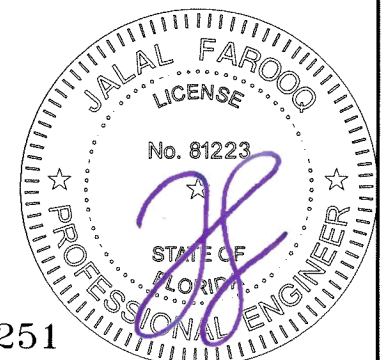

FL #22251


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		date: 02-18-19		scale: 1/2" = 1"		dr. by: TARIQ		chk. by:	
no	date	no	date	no	date	no	date	no	date

drawing no.
19-09F
sheet 8 of 13

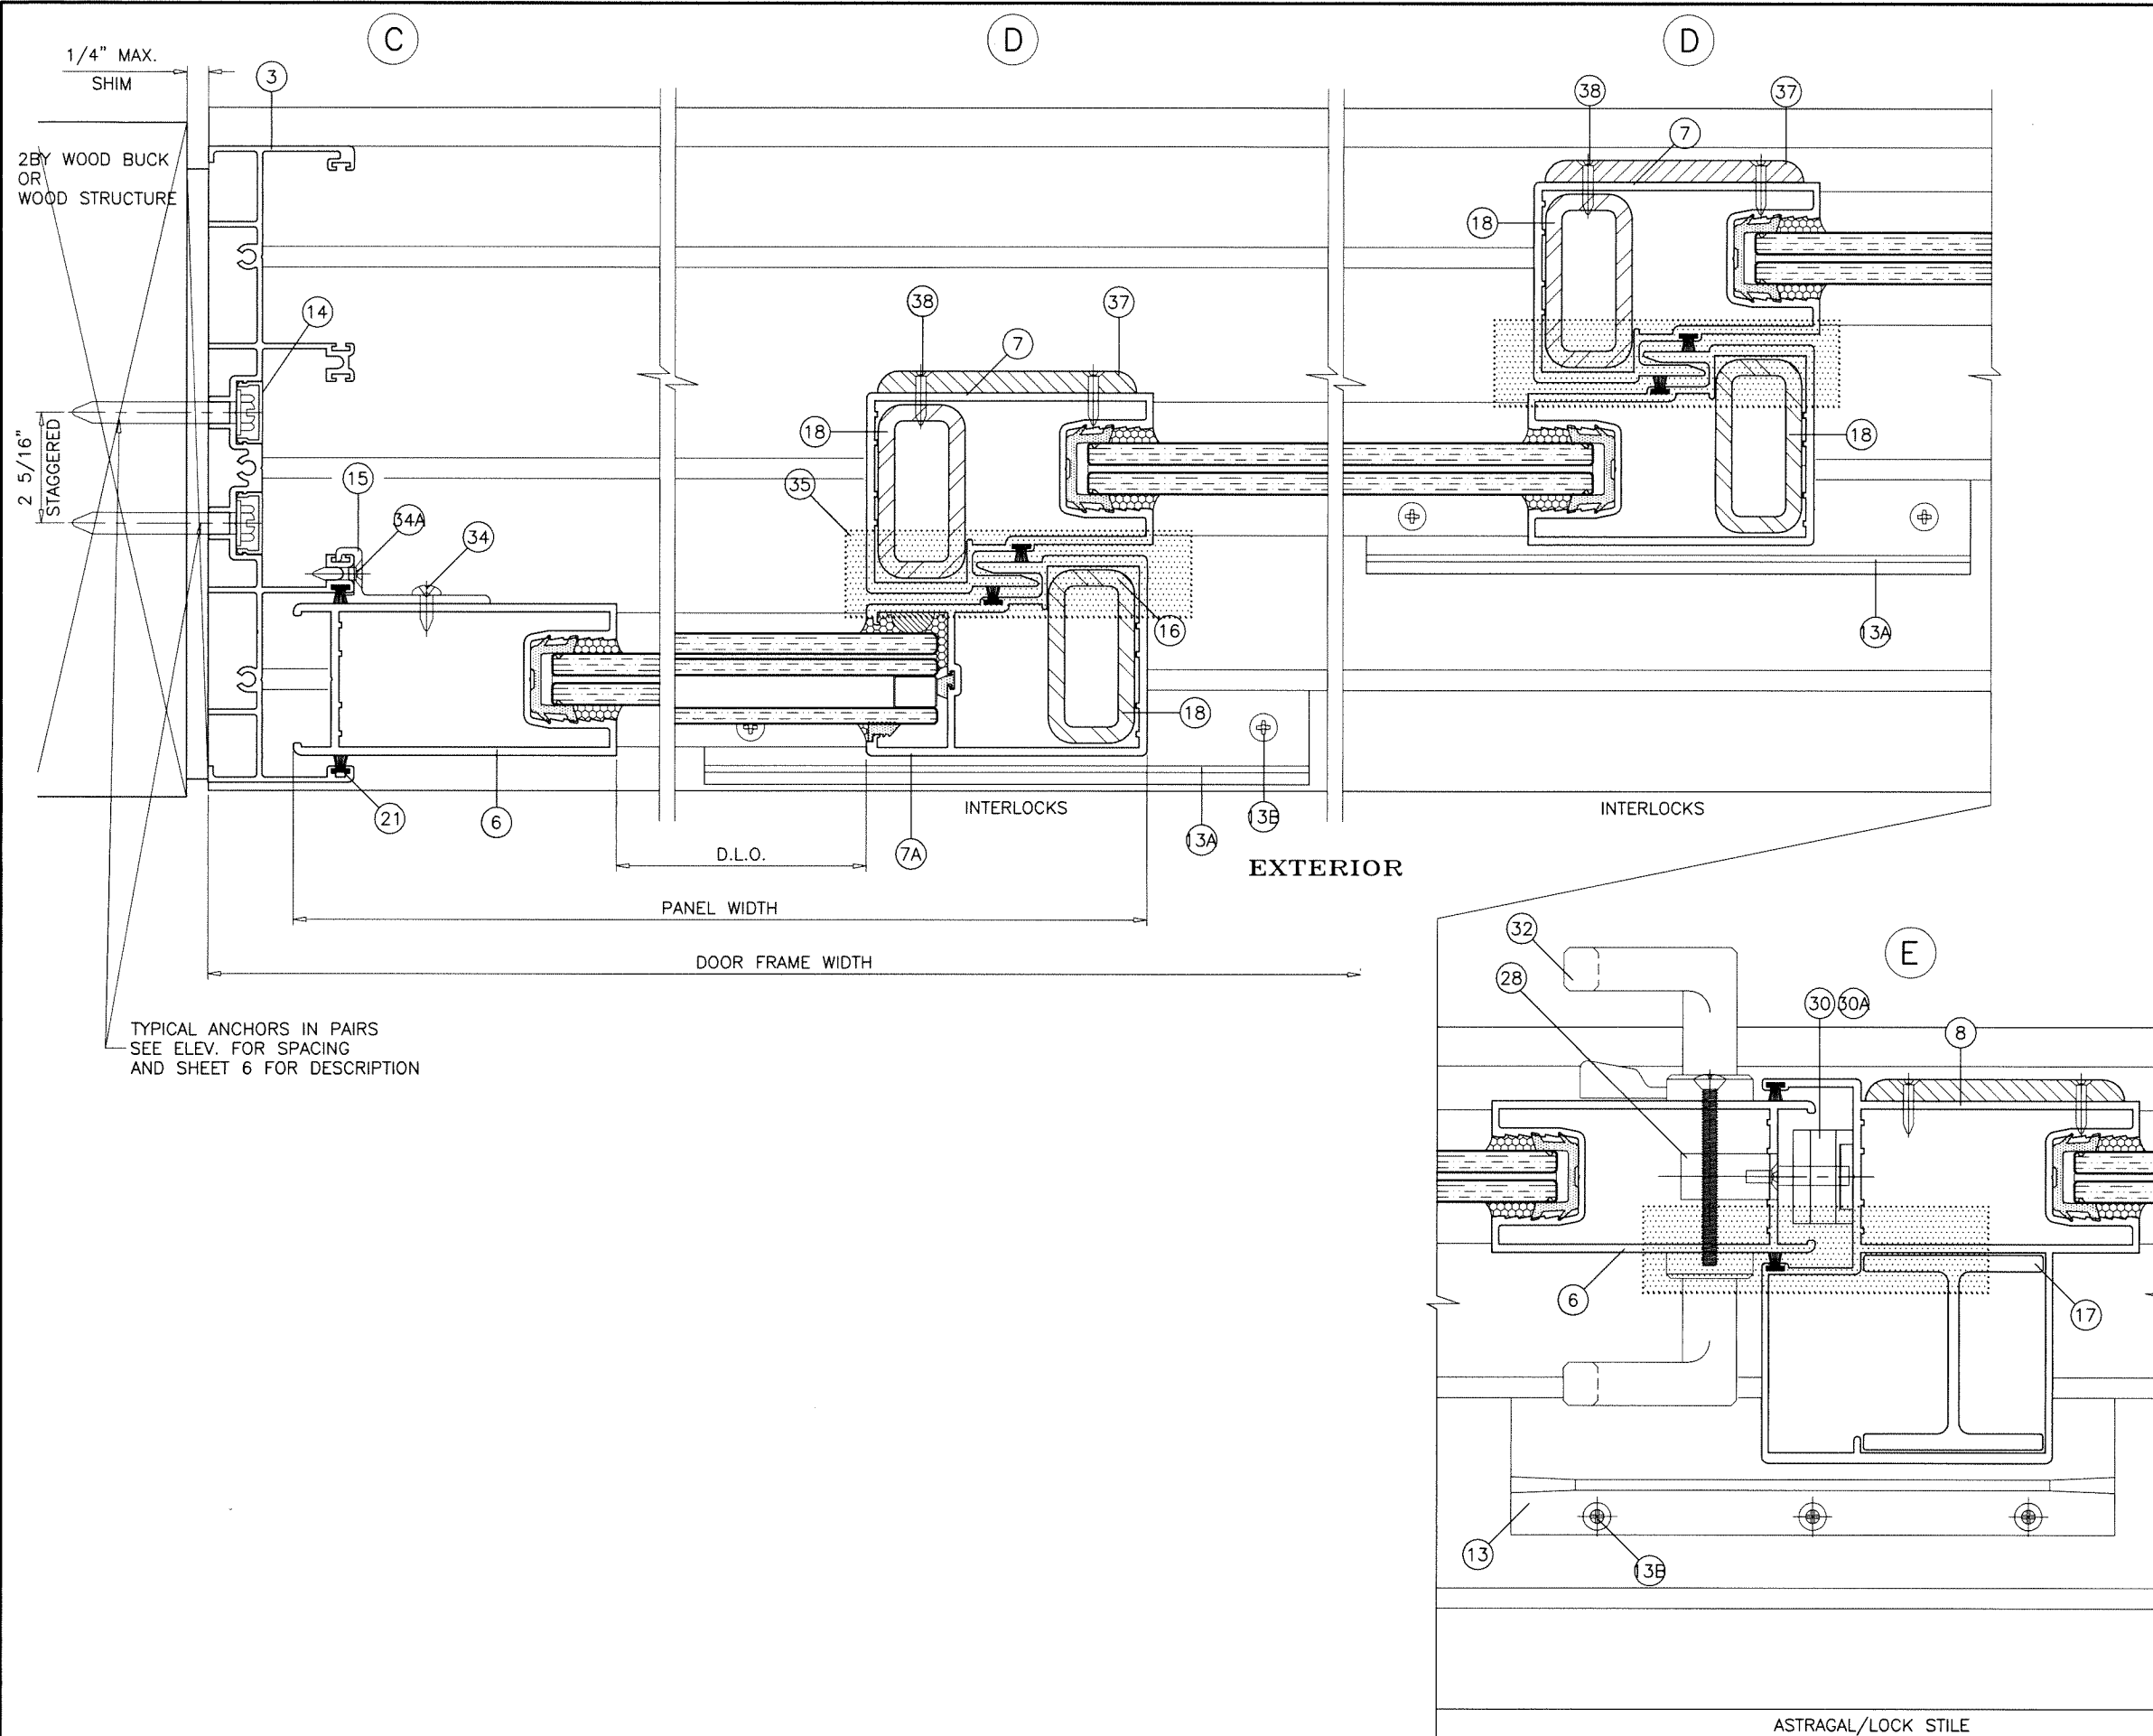

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING
AND SHEET 6 FOR DESCRIPTION

Sealed: 9/15/2026

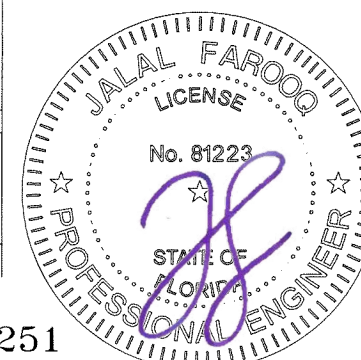

FL #22251

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c
COMP-ANL\19-09F-ES

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		date:		scale:		dr. by:		chk. by:	
no	date	no	date	1/2" = 1"	1/2" = 1"	TARIQ	TARIQ		

drawing no.
19-09F




sheet **9** of 13

date: 02-18-19


scale: 1/2" = 1"

dr. by: TARIQ

chk. by:

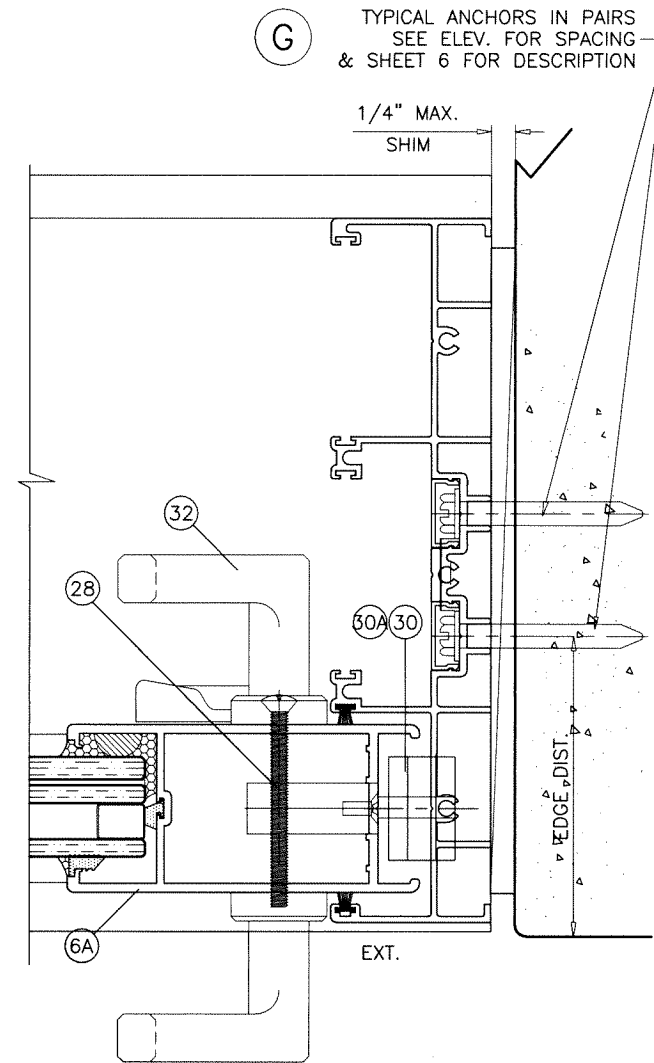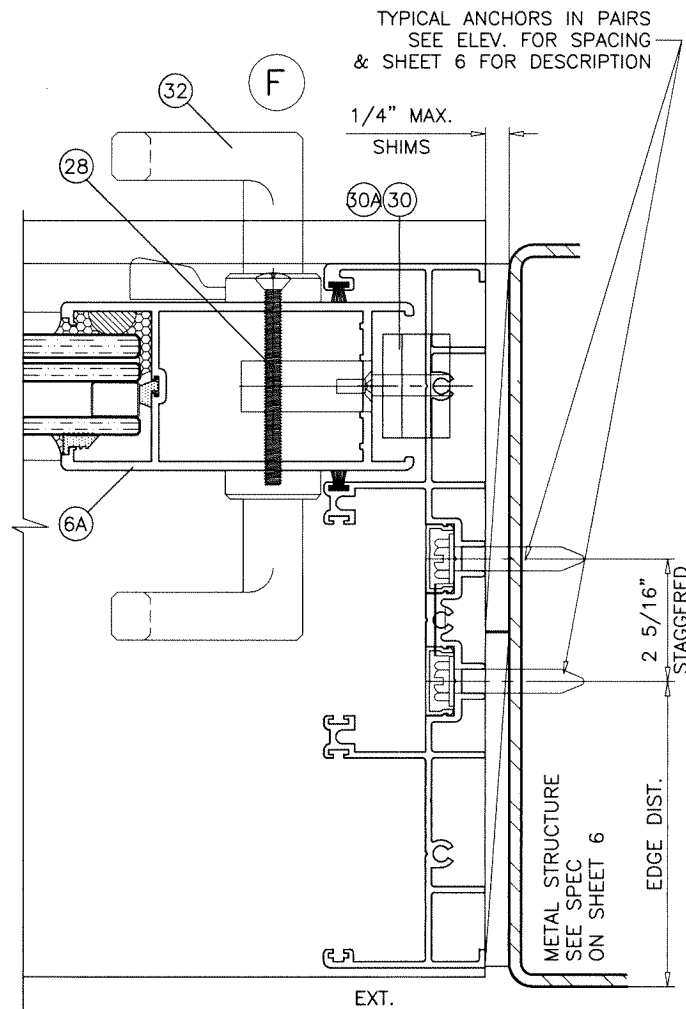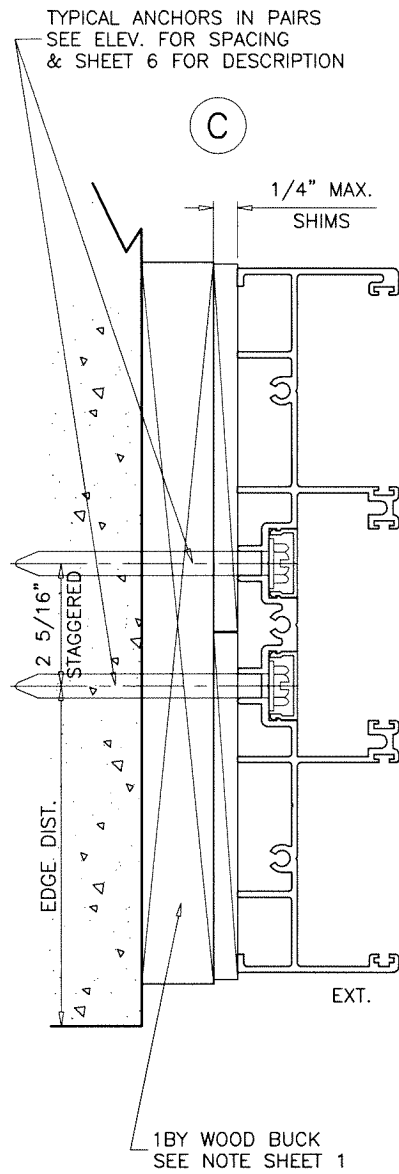

Sealed: 9/15/2026

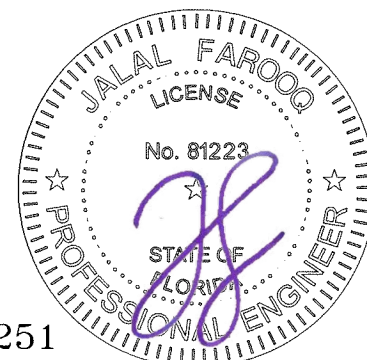

FL #22251

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

COMP-ANL\19-09F-ES

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		date:		scale:		dr. by:		chk. by:	
no	date	no	date	1/2" = 1"	1/2" = 1"	TARIQ	TARIQ		

drawing no.

19-09F

sheet 10 of 13


date: 02-18-19

scale: 1/2" = 1"

dr. by: TARIQ

chk. by:

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES-6000-408	1	FRAME HEAD	6005-T5	-
2	ES-6000-402	1	FRAME SILL	6005-T5	-
2A	ES-6028	1	SILL RISER	6063-T6	-
3	ES-6000-403	2	FRAME JAMB	6063-T6	-
4	ES-6000-040	2/ PANEL	TOP RAIL (LAM. GLASS)	6063-T6	-
4A	ES-6004	2/ PANEL	TOP RAIL (INSUL. LAM. GLASS)	6063-T6	-
5	ES-6000-041	2/ PANEL	BOTTOM RAIL (LAM. GLASS)	6063-T6	-
5A	ES-6005	2/ PANEL	BOTTOM RAIL (INSUL. LAM. GLASS)	6063-T6	-
6	ES-6000-042	AS REQD.	LOCK STILE (LAM. GLASS)	6063-T6	-
6A	ES-6006	AS REQD.	LOCK STILE (INSUL. LAM. GLASS)	6063-T6	-
7	ES-6000-043	AS REQD.	INTERLOCK (LAM. GLASS)	6063-T6	-
7A	ES-6007	AS REQD.	INTERLOCK (INSUL. LAM. GLASS)	6063-T6	-
8	ES-6000-044	AS REQD.	FEMALE ASTRAGAL (LAM. GLASS)	6063-T6	-
8A	ES-6008	AS REQD.	FEMALE ASTRAGAL (INSUL. LAM. GLASS)	6063-T6	-
9	ES-6500-G01A	4/ PANEL	GLAZING GASKET (LAM. GLASS)	SILICONE	DUROMETER 65±5 SHORE A, EXTRUSIONES S.A.
11	ES-6016	4/ PANEL	PANEL GUIDE (TOP ONLY)	CELCON	LOCATED AT PANEL ENDS
12	ES-6015	2/ PANEL	FIXED PANEL BOTTOM CLIP , 7" LONG MIN.	6063-T6	SECURE W/ (2) #8 X 3/4" FH SMS
13	ES-6010	2/ PANEL	RETAINER CLIP, 7" LONG AT SILL, 8" LONG HEAD	6005-T5	AT ASTRAGAL STILE HEAD & SILL ENDS
13A	ES-6000-405	2/ PANEL	RETAINER CLIP, 7" LONG AT SILL, 8" LONG AT HEAD	6005-T5	AT INTERLOCK STILES HEAD & SILL ENDS
13B	#10 X 3/4"	3/ CLIP	RETAINER CLIP FASTENERS	-	FH SELF DRILLING SCREWS
14	ES-6011	2/ JAMB	JAMB SCREW COVER	6063-T5	OPTIONAL
17	ES-6013	AS REQD.	ASTRAGAL STIFFENER (LENGTH = PANEL HT. - 2-3/8")	6063-T6	-
18	1" X 2" X 3/16"	AS REQD.	STEEL TUBE REINFORCING (LENGTH = PANEL HT. - 2-3/8")	A36 STEEL	TO BE PAINTED
21	W222521K	AS REQD.	STILE & JAMB W'STRIPPING	-	ULTRAFAB
22	W223221K	AS REQD.	TOP RAIL PILE W'STRIPPING	-	ULTRAFAB
23	ES-6027	AS REQD.	BOTTOM RAIL W'STRIPPING	EPDM	DUROMETER 75±4 SHORE A
24	#10 X 1-1/2" PH SMS	8/ PANEL	PANEL ASSY SCREWS	ST. STEEL	-
25	#10 X 1" PH SMS	2/ CORNER	FRAME ASSY SCREWS	ST. STEEL	-
26	GTT-354/460-A	2/ MOV. PANEL	TANDEM ACETAL WHEELS IN METALLIC HOUSING	-	PABOSE
27	1/4-20 X 1-3/4" PH MS	2/ ROLLER	ROLLER INST. SCREWS	ST. STEEL	-
28	191014	1/ MOV. PANEL	MULTI POINT MORTISE LOCK, AT 40" FROM BOTTOM	ST. STEEL	INTERLOCK (ASSA ABLOY)
29	#10-24 X 3/8" PH MS	2/ LOCK	LOCK INSTALLATION SCREW	ST. STEEL	-
30	191040	1/ LOCK	LOCK KEEPER (MULTI POINT LOCK), AT 48-1/2" FROM BOTTOM	ST. STEEL	INTERLOCK (ASSA ABLOY)
31	#10 X 5/8" PH SMS B	2/ LOCK	LOCK KEEPER MOUNT. SCREW (STD. LOCK)	ST. STEEL	-
31A	#8 X 3/4" FH SMS	4/ LOCK	LOCK KEEPER MOUNT. SCREW (MULTI POINT LOCK)	ST. STEEL	-
32	#623Z	1/ LOCK	INTERIOR AND EXTERIOR PULL	-	(3) #6-32 X 1/2" FH MS, ST. STEEL
35	-	AS REQD.	1"X4" LONG SELF ADHESIVE PILE PAD	WOOLPILE	AT HEAD AND SILL
37	ES-6019	AS REQD.	RESTRAINING PLATE	NYLON	AT TOP & BOTT. INTERLOCKS & ASTRAGAL
38	#8 X 3/4" FH SMS	2/ PLATE	RESTRAINING PLATE FASTENER	-	-
39	ES-3000-G01	AS REQD.	GLAZING WEDGE	SILICONE	DUROMETER 70±5 SHORE A
41	ES-4014	AS REQD.	BOTTOM RAIL GLASS STOP	EPDM	DUROMETER 68±4 SHORE A
42	ES-4018	AS REQD.	TOP RAIL & STILES GLASS STOP	EPDM	DUROMETER 75±4 SHORE A
43	ES-8011A	AS REQD.	BUMPER SPACER	SILICONE	DUROMETER 65±5 SHORE A
44	-	2/ LITE	SETTING BLOCK, 1" X 1/8" X 2-1/2" LONG	EPDM	DUROMETER 80±5 SHORE A
45	-	AS REQD.	REINFORCING BAR AT ASTRAGAL	STEEL	A36, Fu MIN. = 58 KSI
46	-	AS REQD.	1/4" X 1/4" GLAZING TAPE	FOAM	-

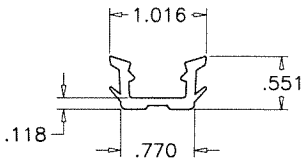

9 GLAZING GASKET
(LAMINATED GLASS)

BASE POLYMER = EPDM RUBBER
DENSITY = 10.26 Lbs/Gal
HARDNESS = 70±5
TENSILE STRENGTH = 905 PSI
ELONGATION AT BREAK = 273%
TEAR STRENGTH = 1.343 Kip/ft
BRITTLENESS TEMPERATURE = -40° F
COMPRESSION SET = 27% (22h@158°F)

Sealed: 9/15/2026



FL #22251

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 264-8100

COMP-ANL\19-09F-ES


SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no		date		by		description	

date:	02-18-19
scale:	1/2" = 1"
dr. by:	TARIQ
chk. by:	

drawing no.
19-09F
sheet 11 of 13

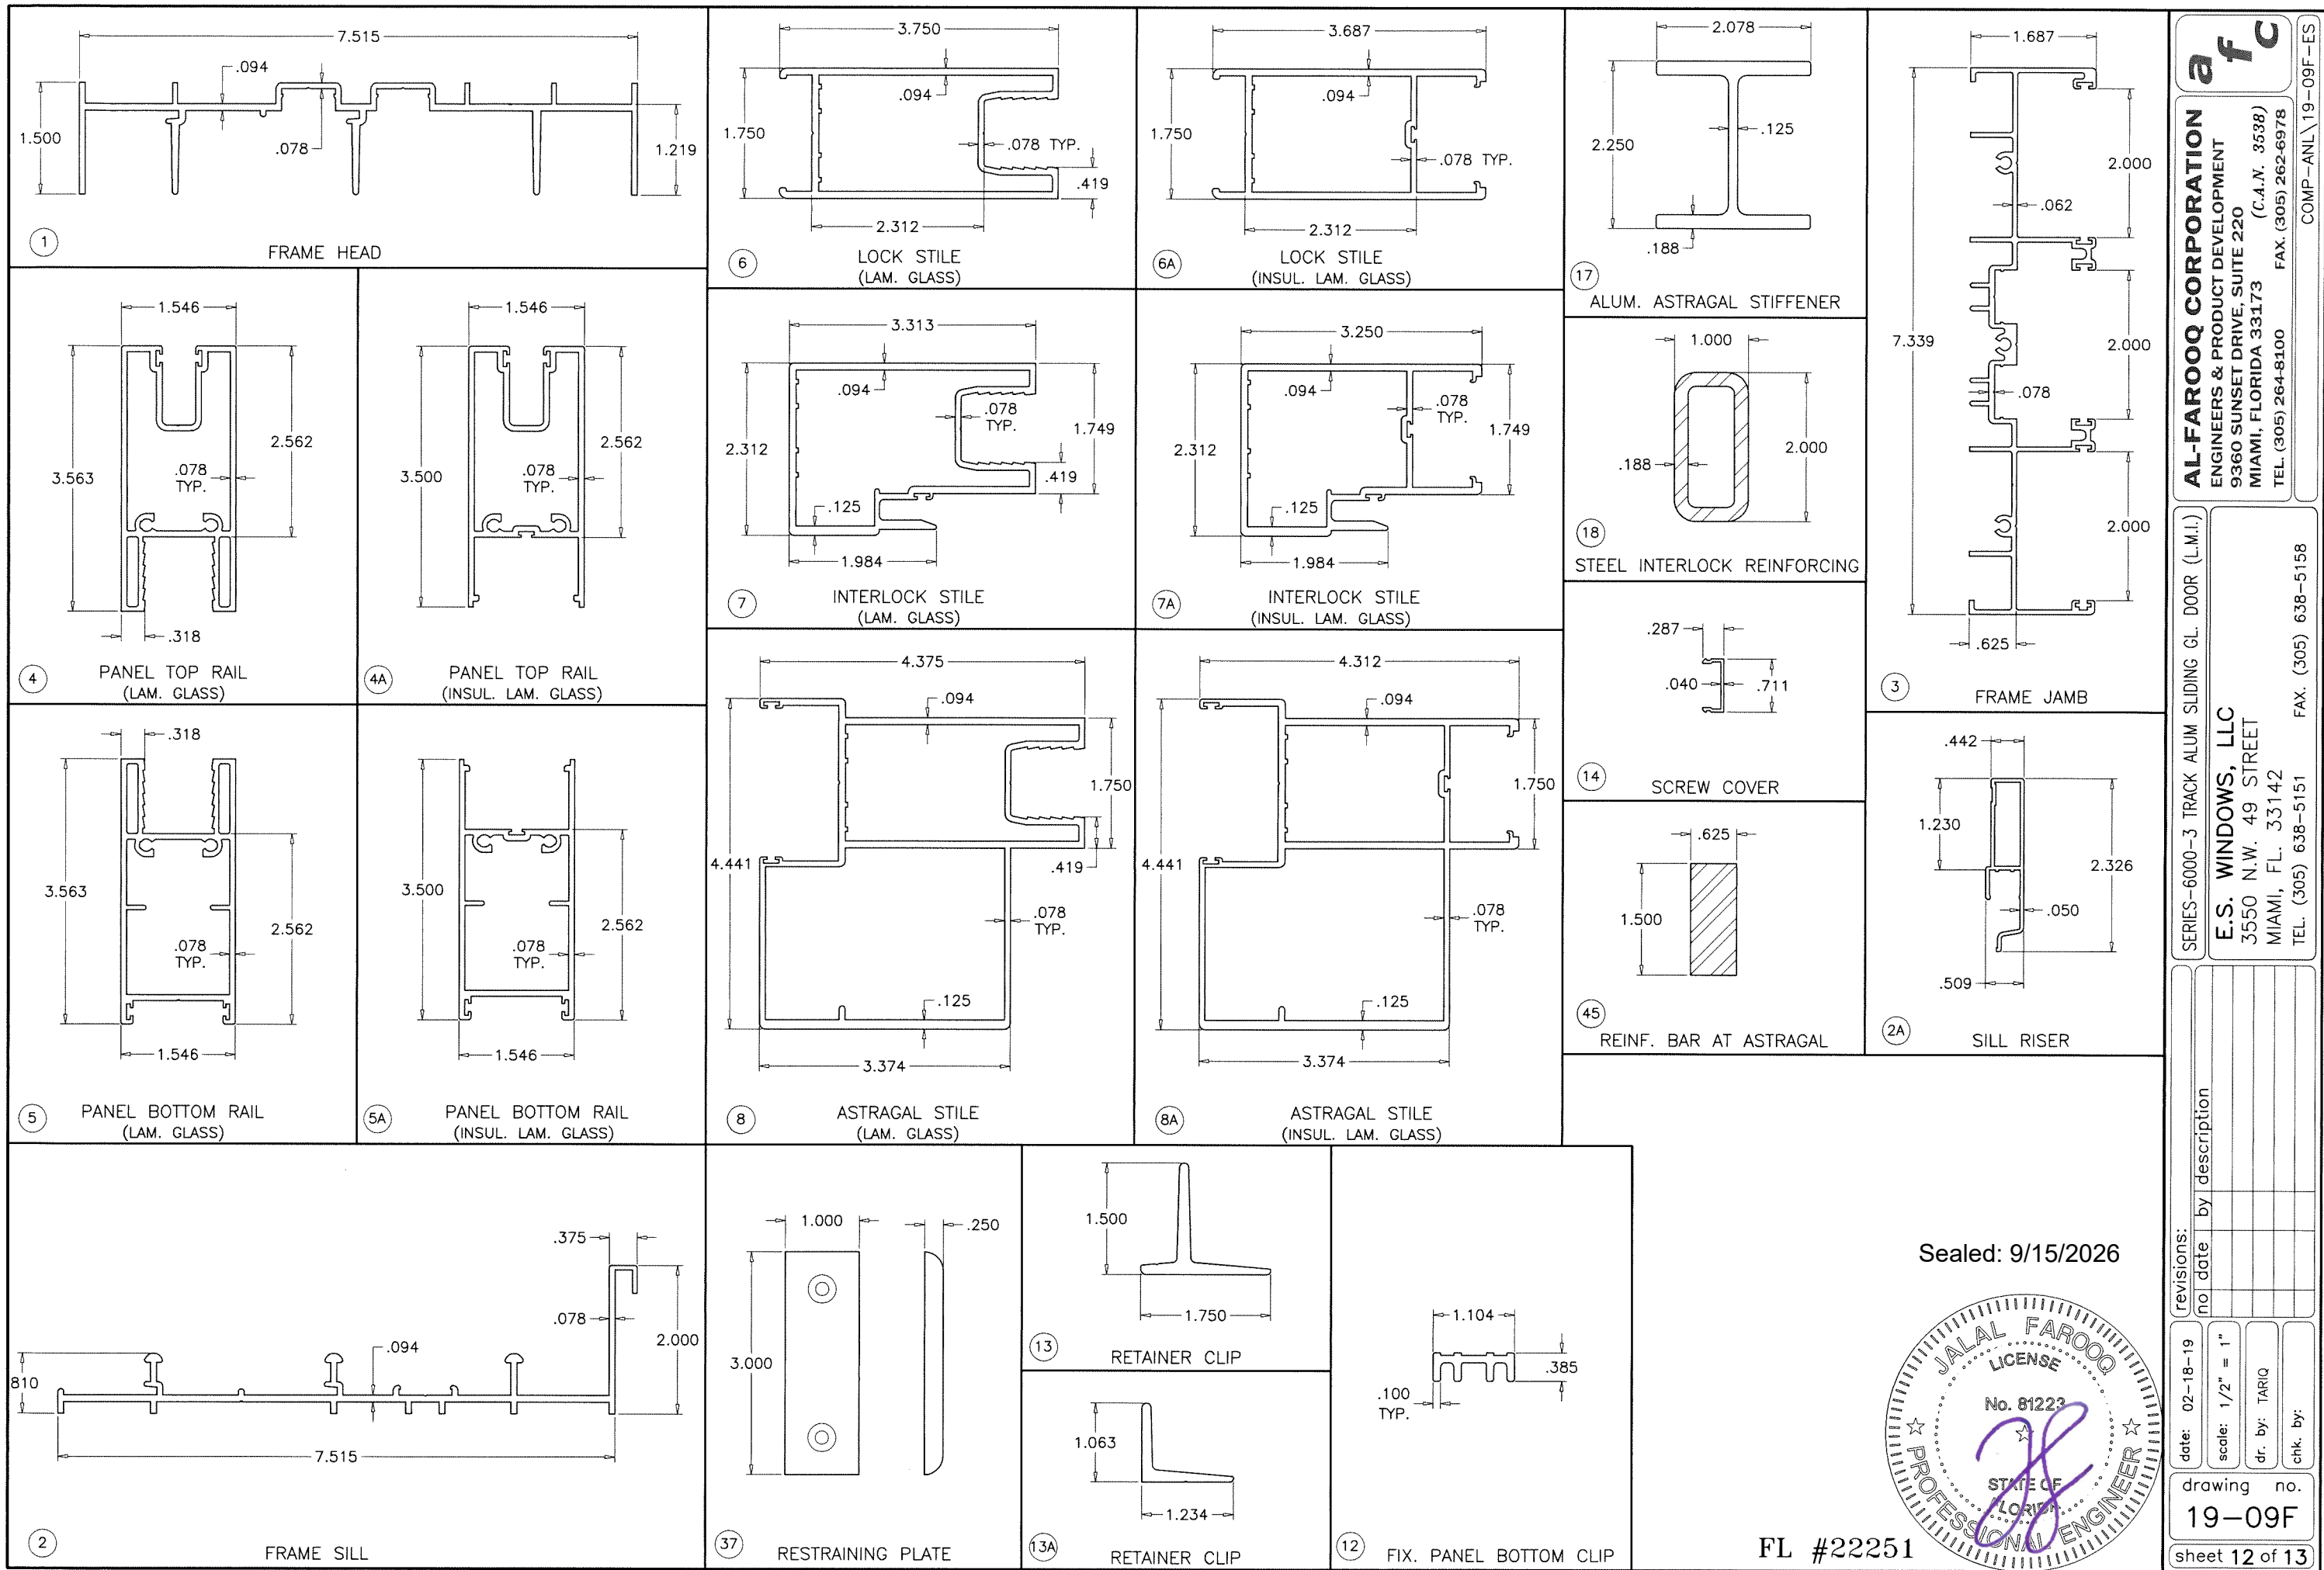

a f c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\19-09F-ES

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)


E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date

date:	scale:	dr. by:	chk. by:
02-18-19	1/2" = 1"	TARIQ	


drawing no.
19-09F

sheet 12 of 13


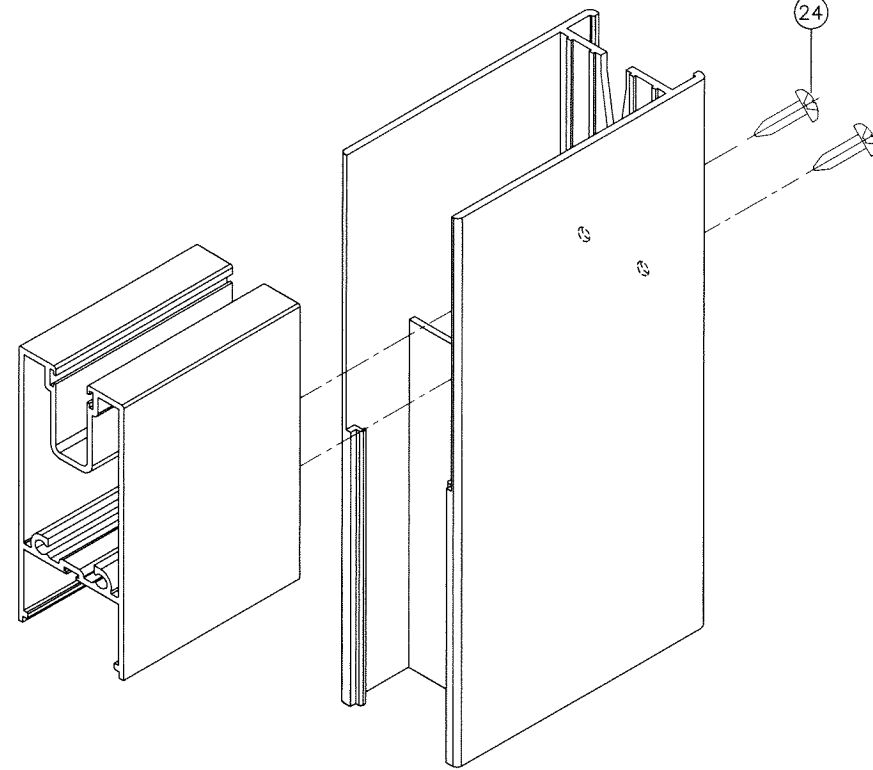


PANEL TOP CORNER


INSUL. LAM. GLASS RAIL & STILE (SHOWN)
LAM. GLASS RAIL & STILE (SIMILAR)

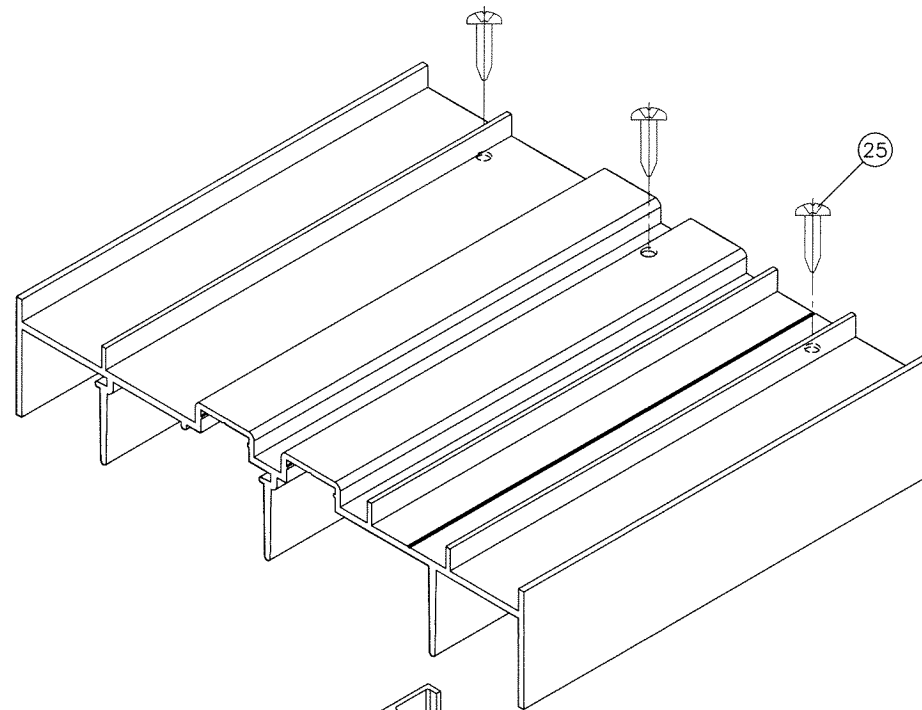

FRAME TOP CORNER

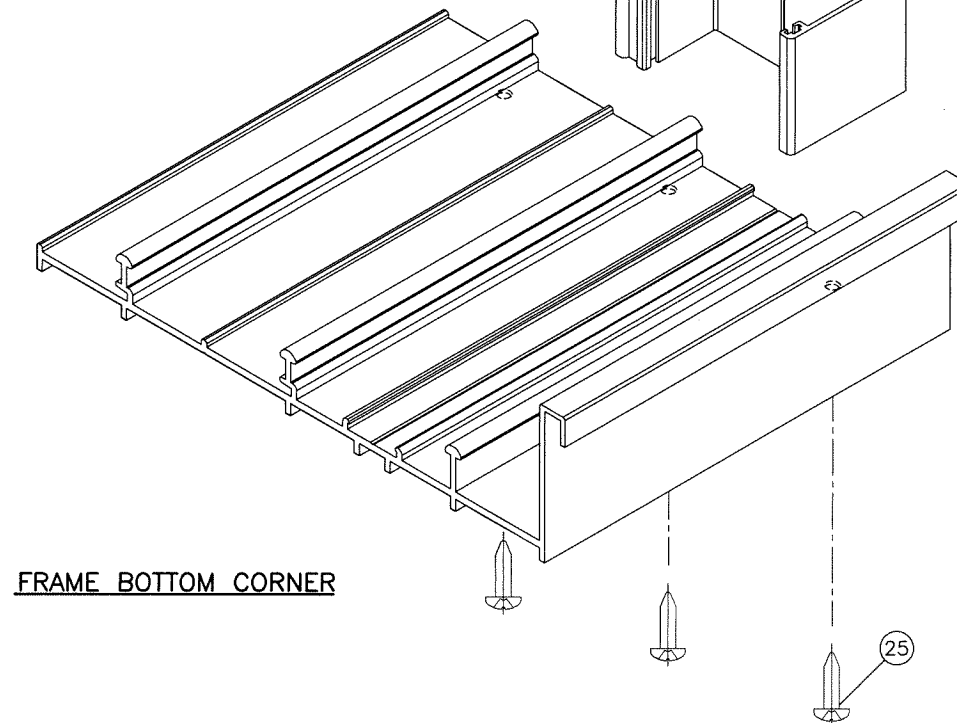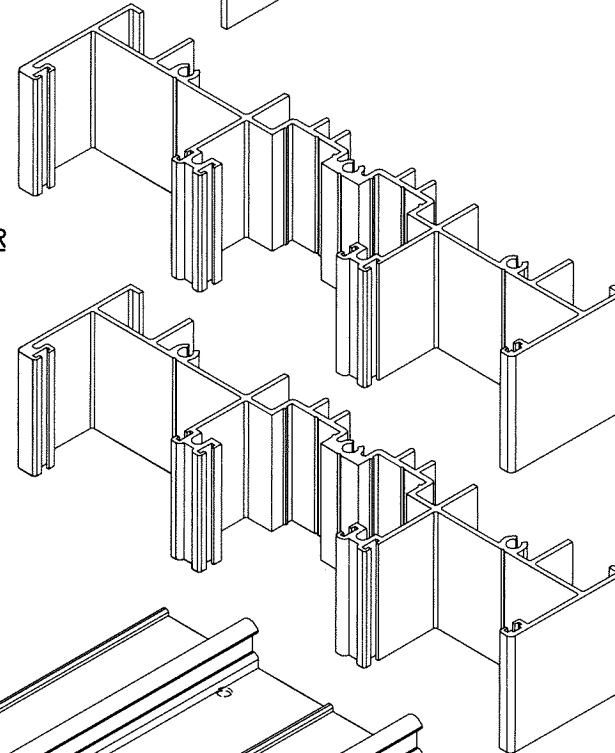


FRAME BOTTOM CORNER

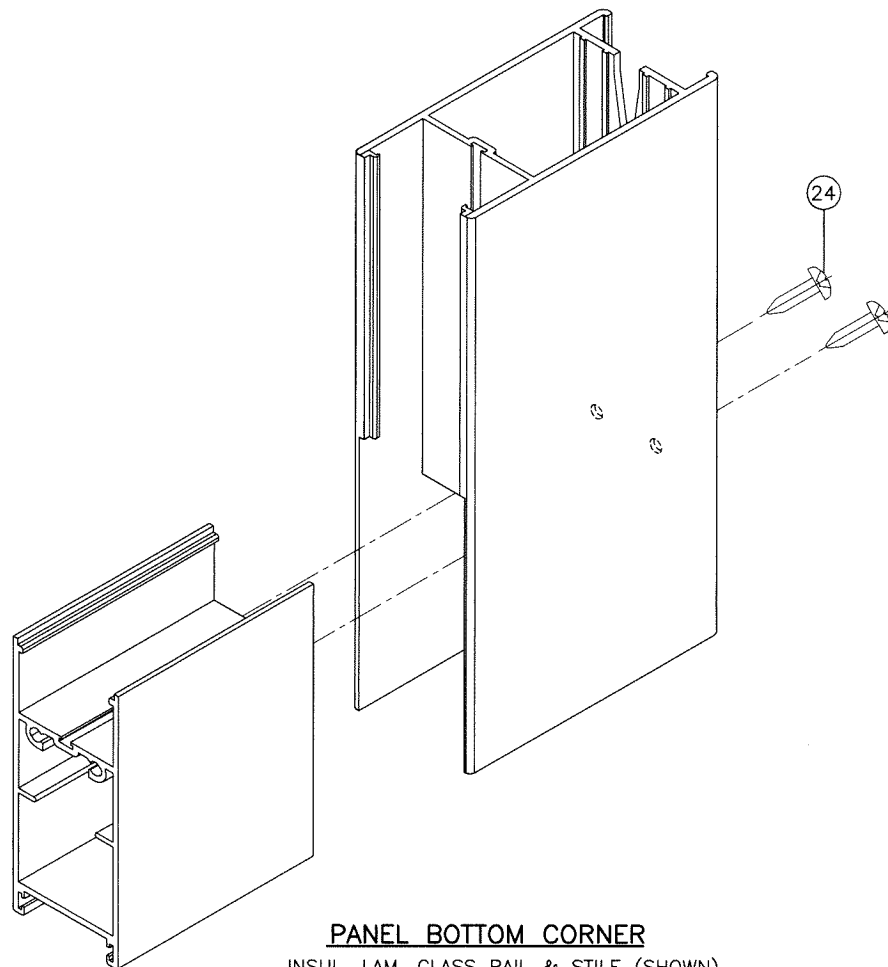

PANEL BOTTOM CORNER

INSUL. LAM. GLASS RAIL & STILE (SHOWN)
LAM. GLASS RAIL & STILE (SIMILAR)

Sealed: 9/15/2026

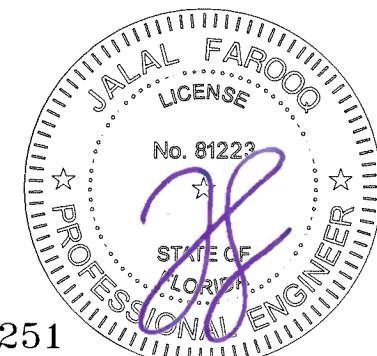

FL #22251

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-6000-3 TRACK ALUM SLIDING GL. DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		date		by		description	
no	date	no	date	no	date	no	date

date: 02-18-19
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-09F
sheet 13 of 13

COMP-ANL\19-09F-ES