

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" FENESTRATION UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. FENESTRATION UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: FOAM PVC CO-EX.
12. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

14. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. ALL FASTENERS TO BE CORROSION RESISTANT.
18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .058" THICK MINIMUM
19. APPROVED CONFIGURATIONS: O, X, OX, XO, OXX, XXO, O/O, O/X, X/O, O/OX, OX/O, O/XO, XO/O, OXX/O, O/OXX, XXO/O, O/XXO.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3	GLAZING DETAILS
4 - 9	INSTALLATION DETAILS
10	CONNECTION DETAIL

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR - NON-IMPACT
NOTES

DRAWN:
V.L.

DWG NO.
08-02978

REV
B


SCALE NTS

DATE 01/19/17


SHEET 1 OF 10

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/09/2026

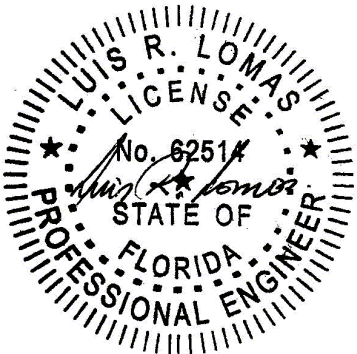

Luis R. Lomas P.E.
FL No.: 62514

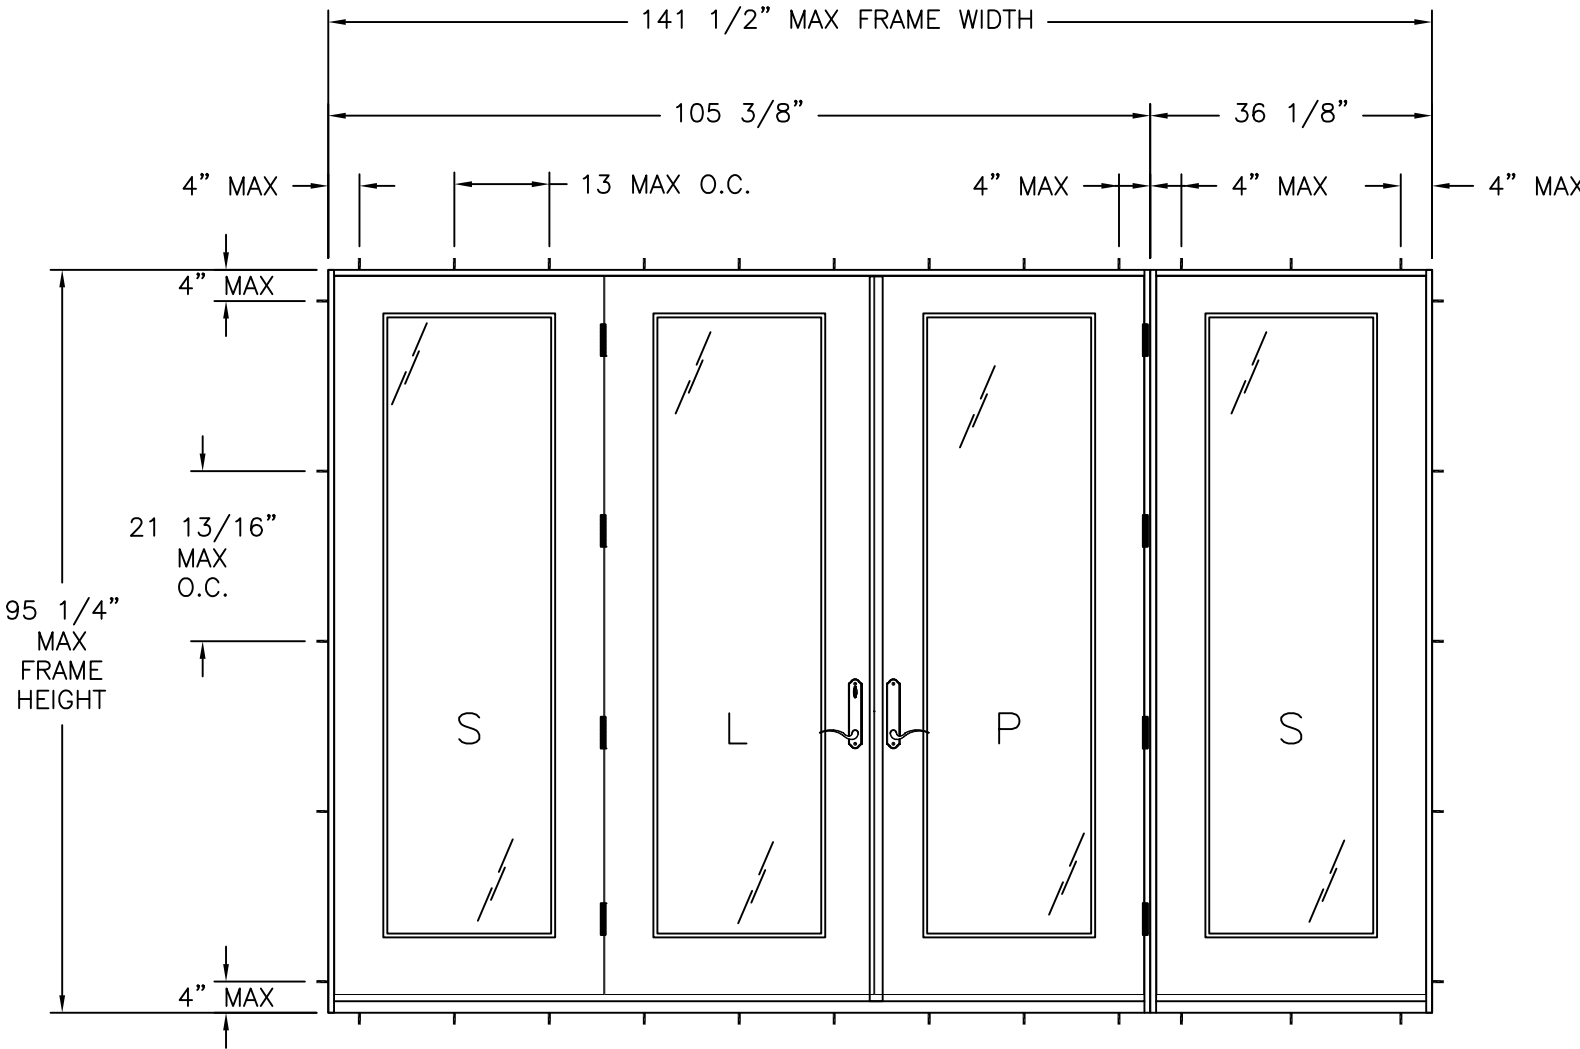

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

- NOTES:
- 1. MAXIMUM PANEL SIZE: 34 1/2" X 92 1/16"
 - 2. MAXIMUM D.L.O.: 21" X 79"

SERIES SLPS INSWING GLAZED FIBERGLASS SIDE-HINGED PATIO DOOR
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
+40.0/-60.0PSF	NONE

FOR AREAS WHERE WATER INFILTRATION
RESISTANCE IS REQUIRED

DESIGN PRESSURE RATING	IMPACT RATING
±60.0PSF	NONE

FOR AREAS WHERE WATER INFILTRATION
RESISTANCE IS NOT REQUIRED

HARDWARE SCHEDULE	
A.	(1) MULTI-POINT LOCKING SYSTEM 9" FROM HEAD AND SILL AND 36" FROM FRAME SILL
B.	SLAB MULTI-POINT LOCK KEEPER
C.	TOP/BOTTOM BAR KEEPER AT FRAME HEAD AND SILL
D.	4X4 DOOR HINGE AT 8", 34", 60", AND 86" FROM FRAME HEAD
E.	CONNECTION PLATE
F.	ALUMINUM REINFORCEMENT (A) AT ASTRAGAL
G.	STEEL REINFORCEMENT AT ACTIVE, PASSIVE, FIXED AND STATIONARY PANEL STILES

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
ELEVATION

DRAWN:
V.L.

DWG NO.
08-02978

REV
B

SCALE
NTS

DATE
01/19/17

SHEET
2 OF 10


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/09/2026

Luis R. Lomas P.E.
FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

APPROVED PANEL CONFIGURATIONS

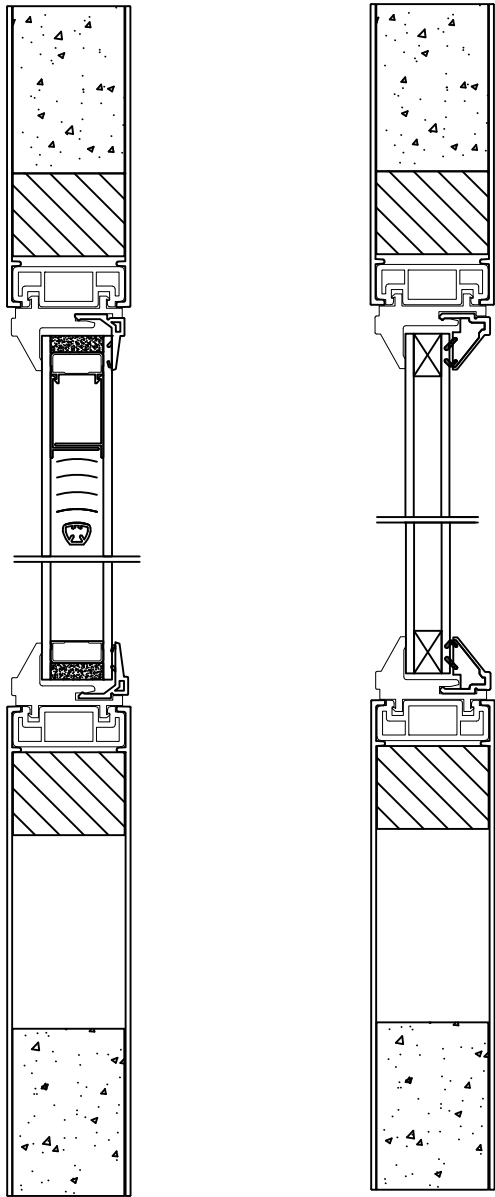

W/MINI-BLIND

STANDARD

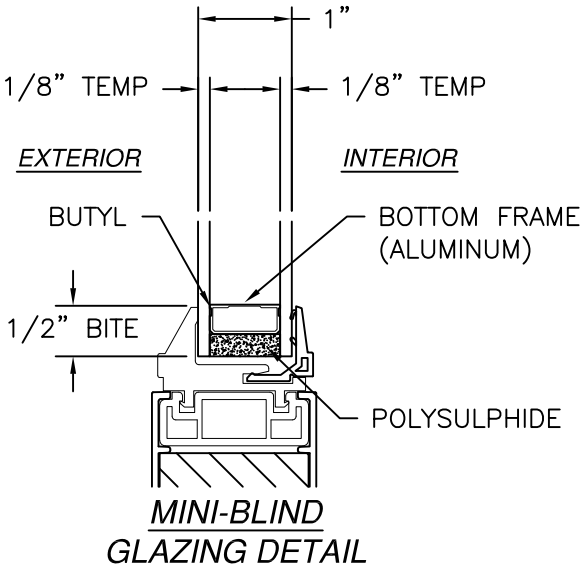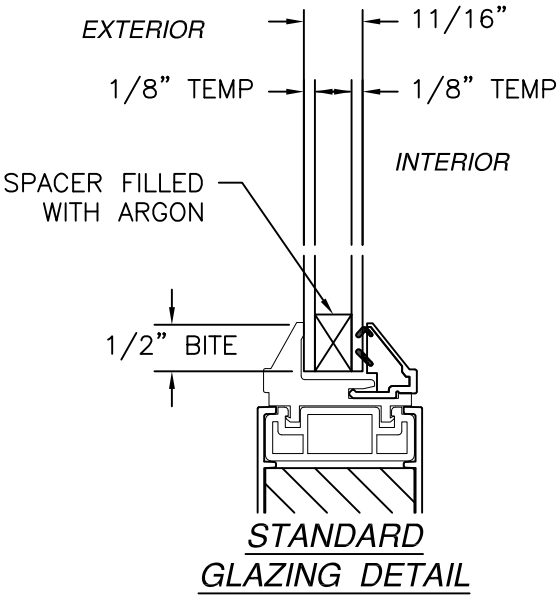

SIGNED: 07/09/2026

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
GLAZING DETAILS

DRAWN:
V.L.

DWG NO.
08-02978

REV
B

SCALE NTS

DATE 01/19/17

SHEET 3 OF 10



L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

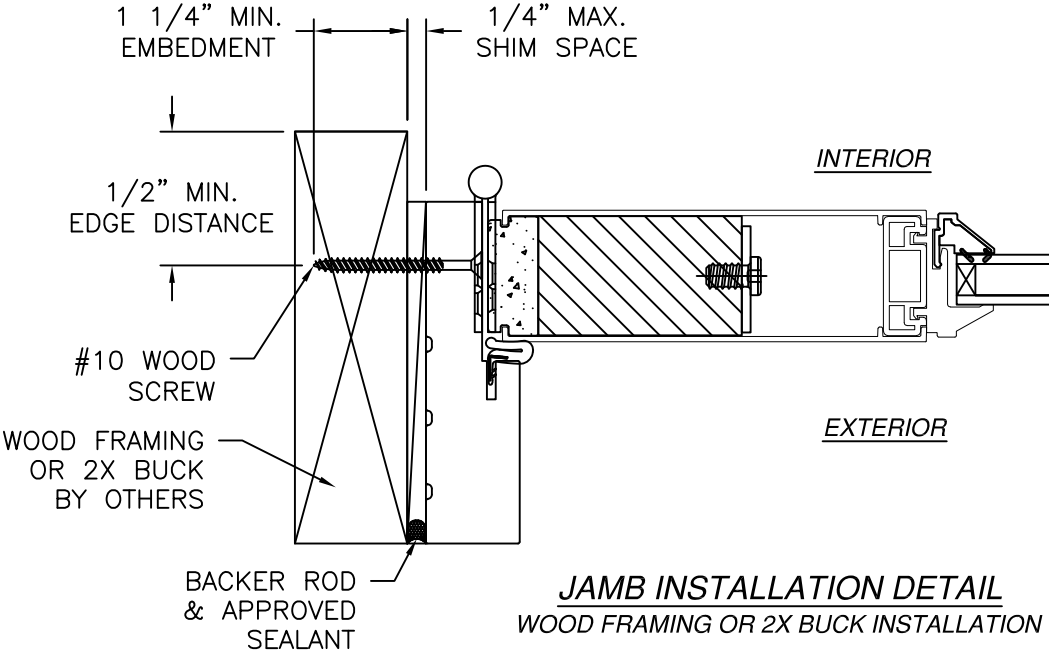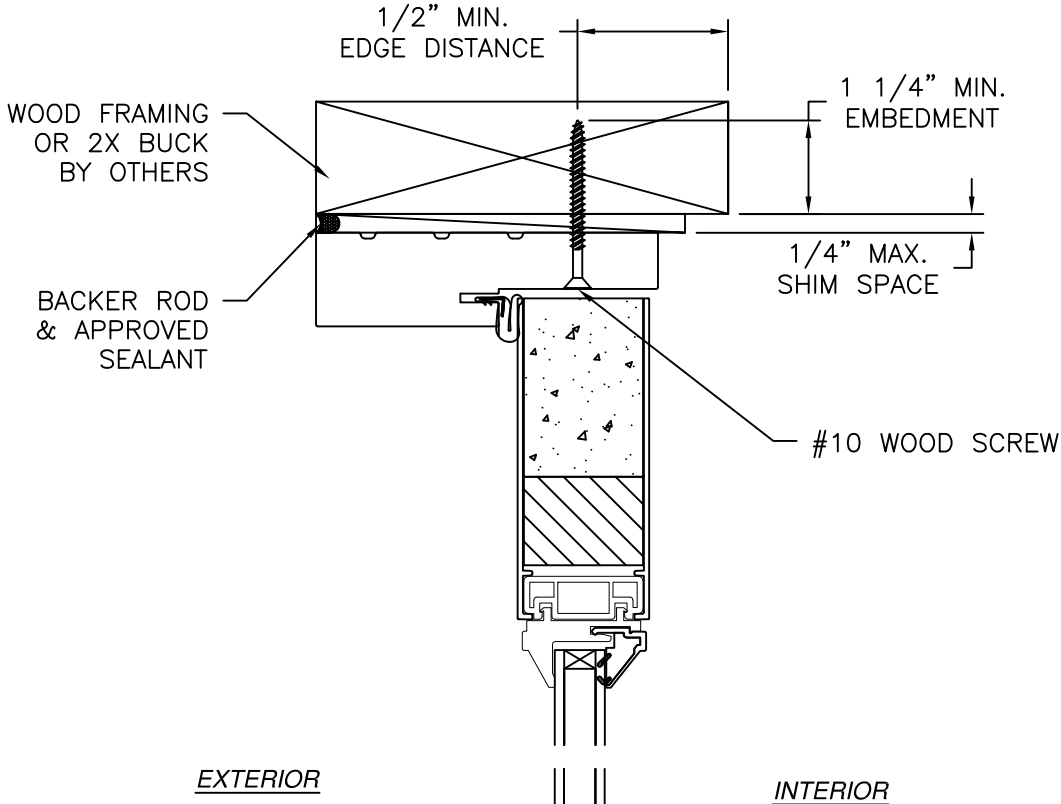

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

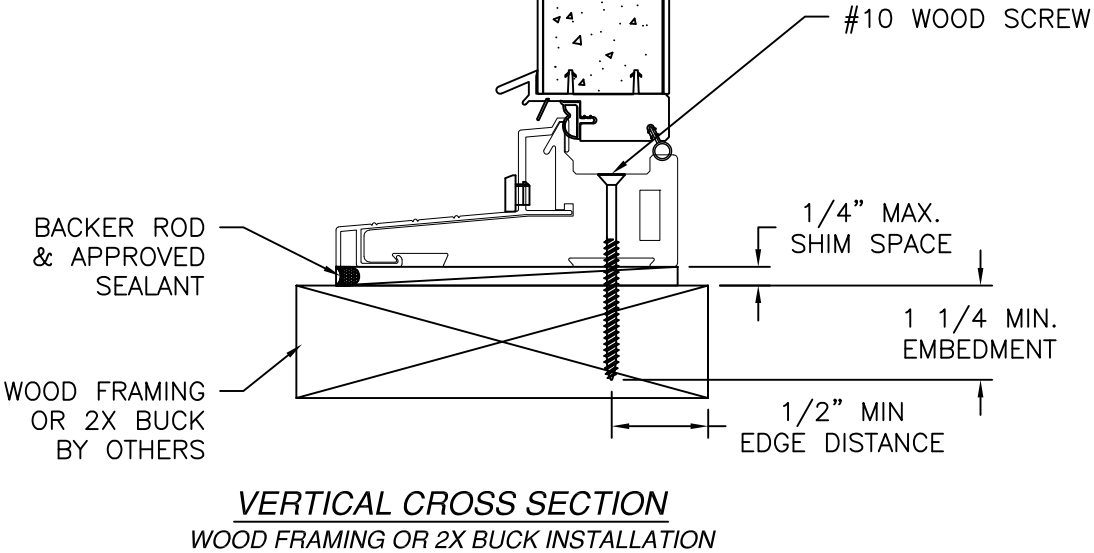

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
DOOR INSTALLATION DETAILS

DRAWN:
V.L.

DWG NO.
08-02978

REV
B

SCALE
NTS

DATE
01/19/17


SHEET
4 OF 10

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com


SIGNED: 07/09/2026

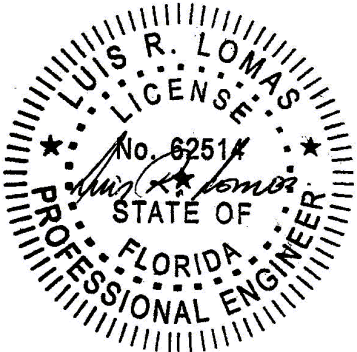


Luis R. Lomas P.E.
FL No.: 62514

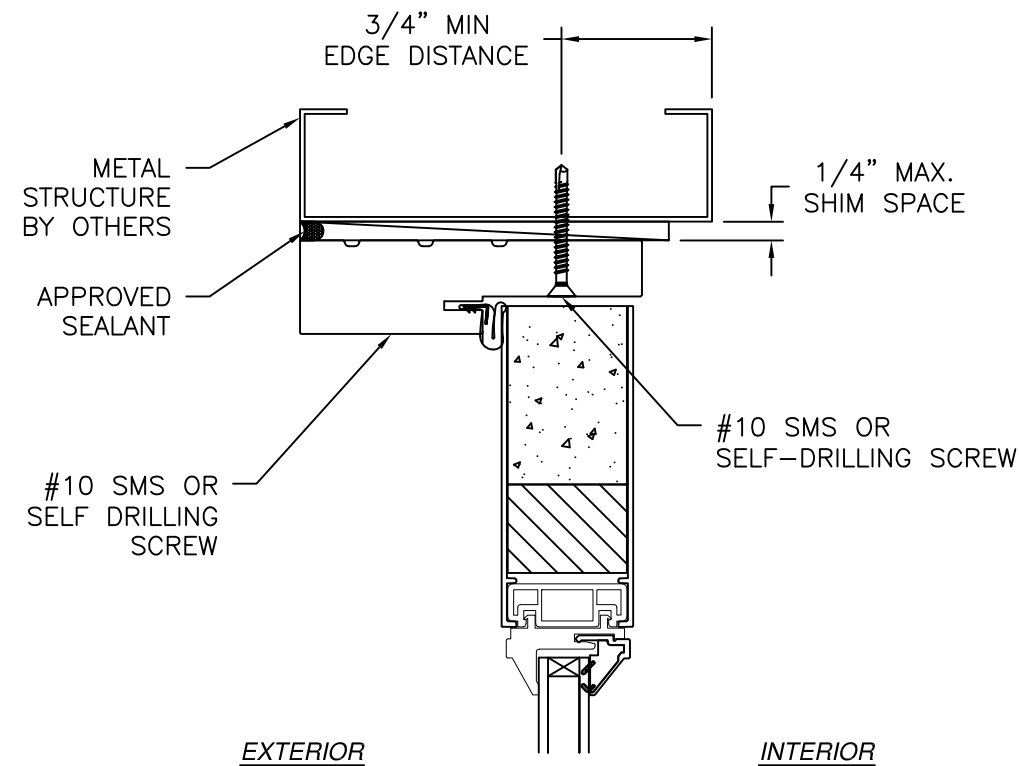

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

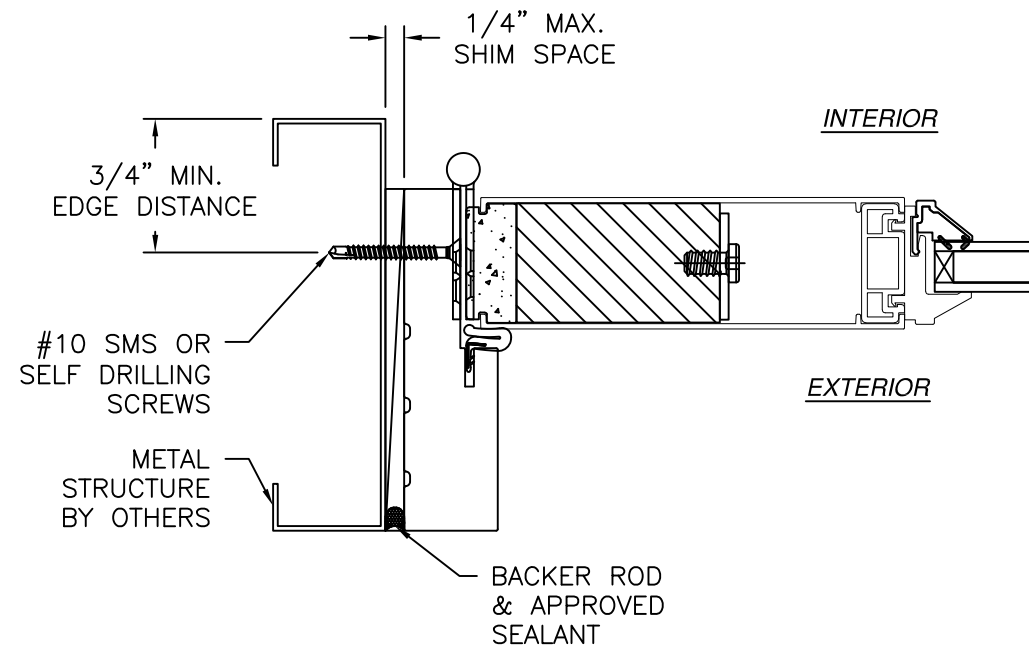

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

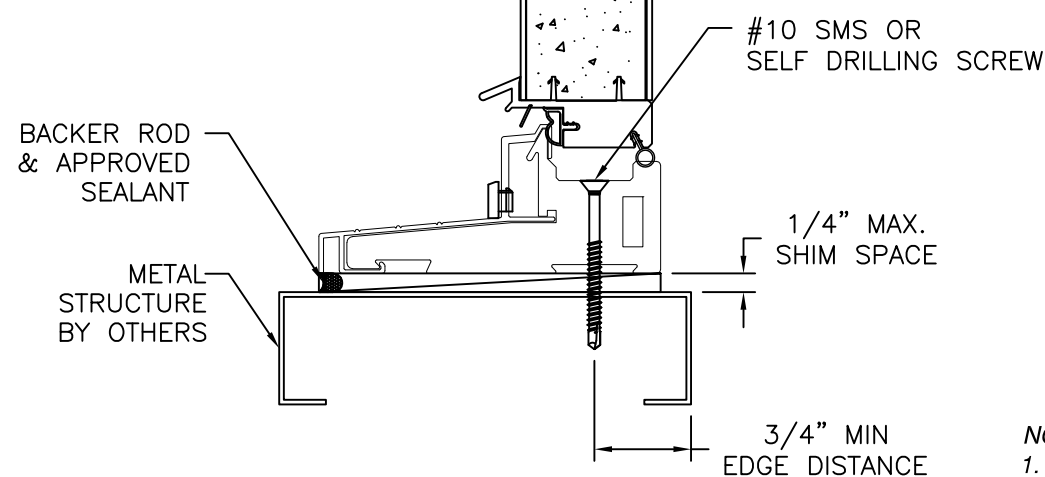


- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

NAN YA PLASTICS CORP. USA 4016 SHADRACK ST. HOUSTON, TX 77013		
SERIES SLPS INSWING GLAZED FIBERGLASS SIDE-HINGED PATIO DOOR – NON-IMPACT DOOR INSTALLATION DETAILS		
DRAWN: V.L.	DWG NO. 08-02978	REV B
SCALE NTS	DATE 01/19/17	SHEET 5 OF 10
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 07/09/2026

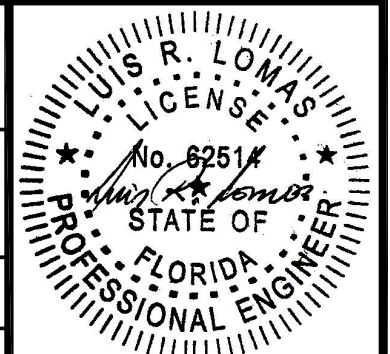

Luis R. Lomas P.E.
FL No.: 62514

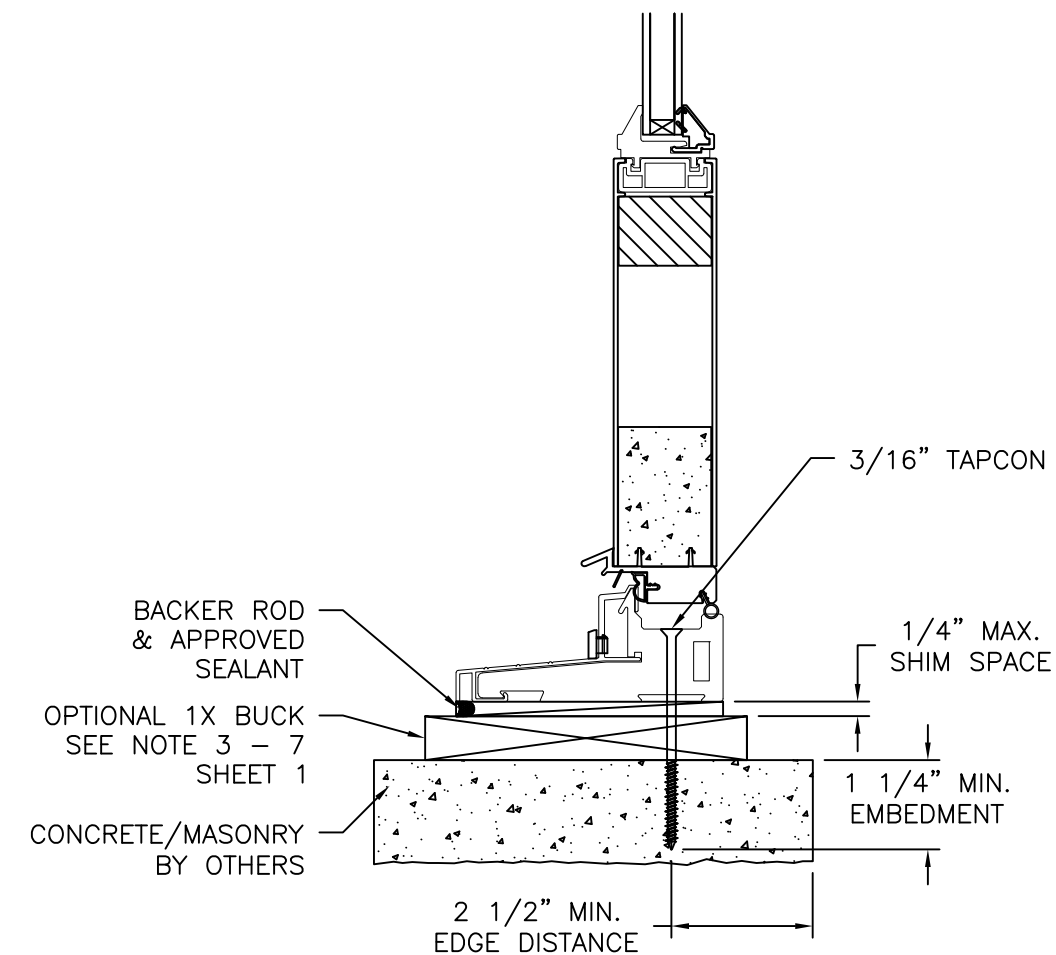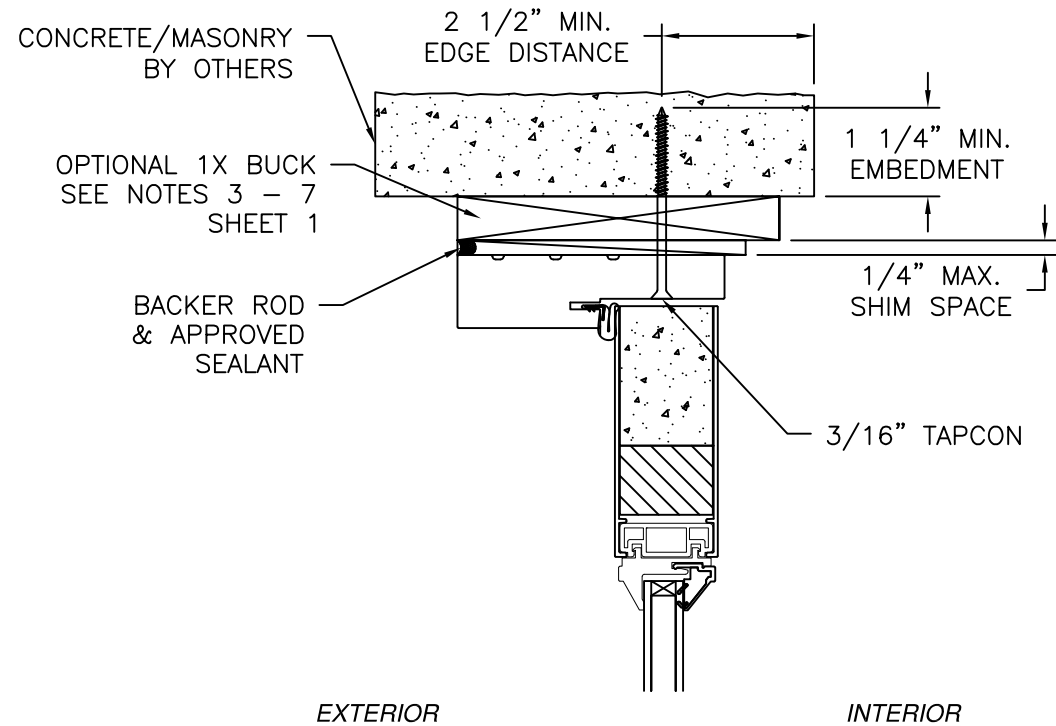


VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

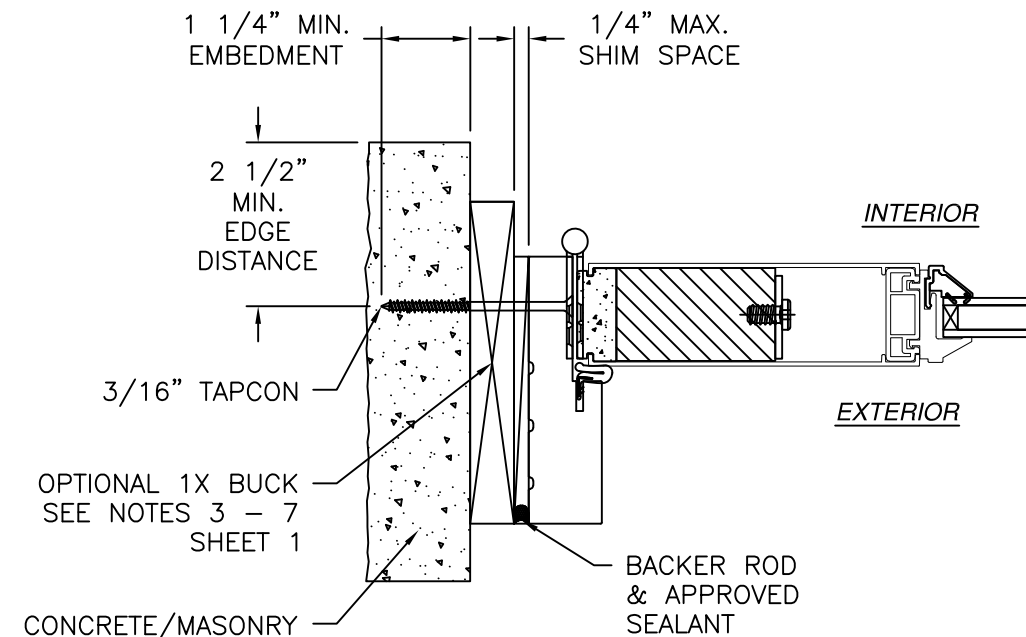

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

NAN YA PLASTICS CORP. USA


4016 SHADRACK ST.
HOUSTON, TX 77013

**SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
DOOR INSTALLATION DETAILS**


DRAWN: V.L.	DWG NO. 08-02978	REV B
SCALE NTS	DATE 01/19/17	SHEET 6 OF 10

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 07/09/2026

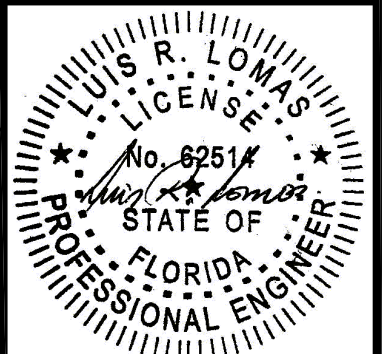

Luis R. Lomas P.E.
FL No.: 62514

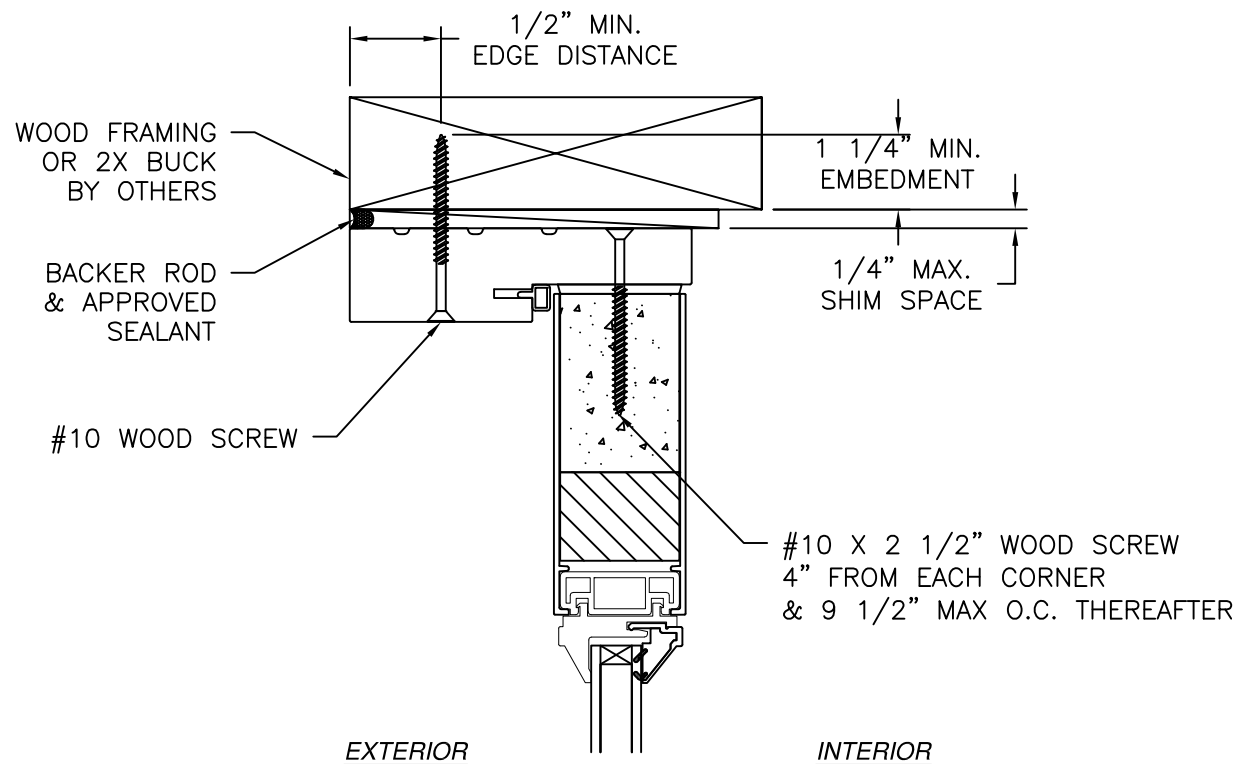

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

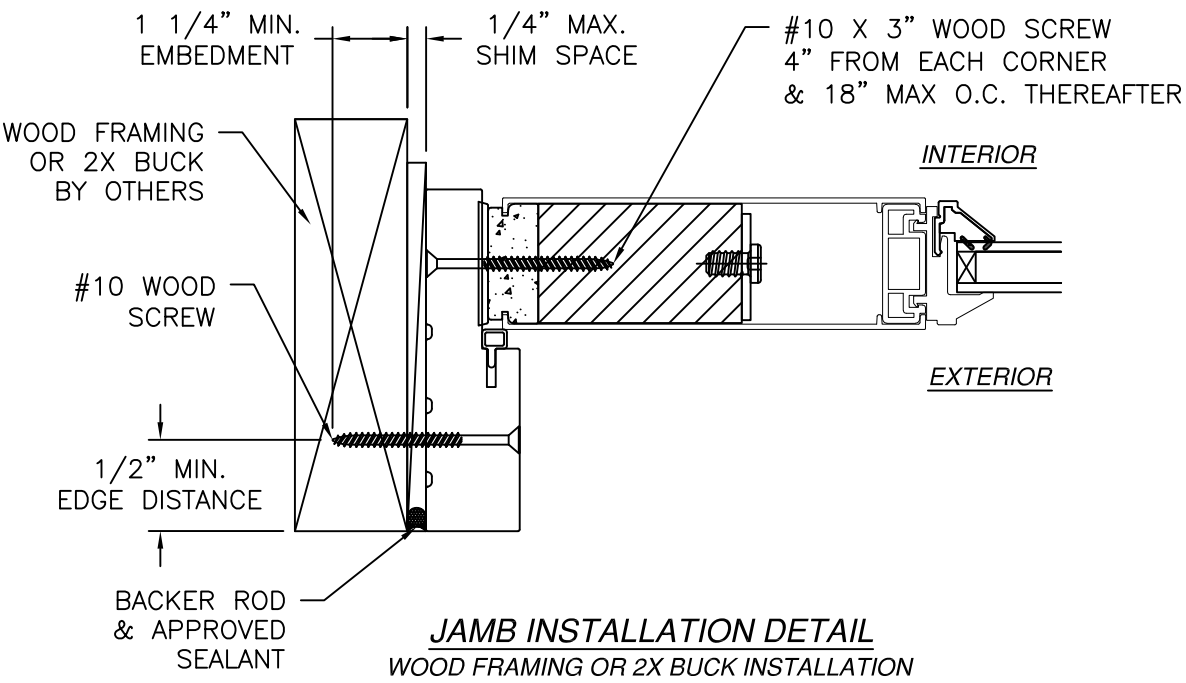

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

SIGNED: 07/09/2026

NAN YA PLASTICS CORP. USA
4016 SHADRACK ST.
HOUSTON, TX 77013

**SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
SIDELITE INSTALLATION DETAILS**

DRAWN:
V.L.

DWG NO.
08-02978


REV
B

SCALE NTS

DATE 01/19/17



SHEET 7 OF 10

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

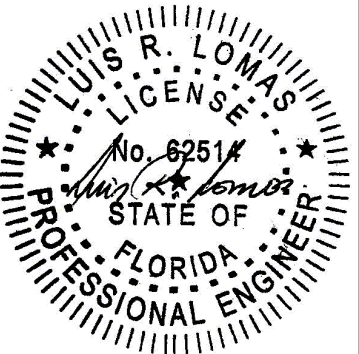


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

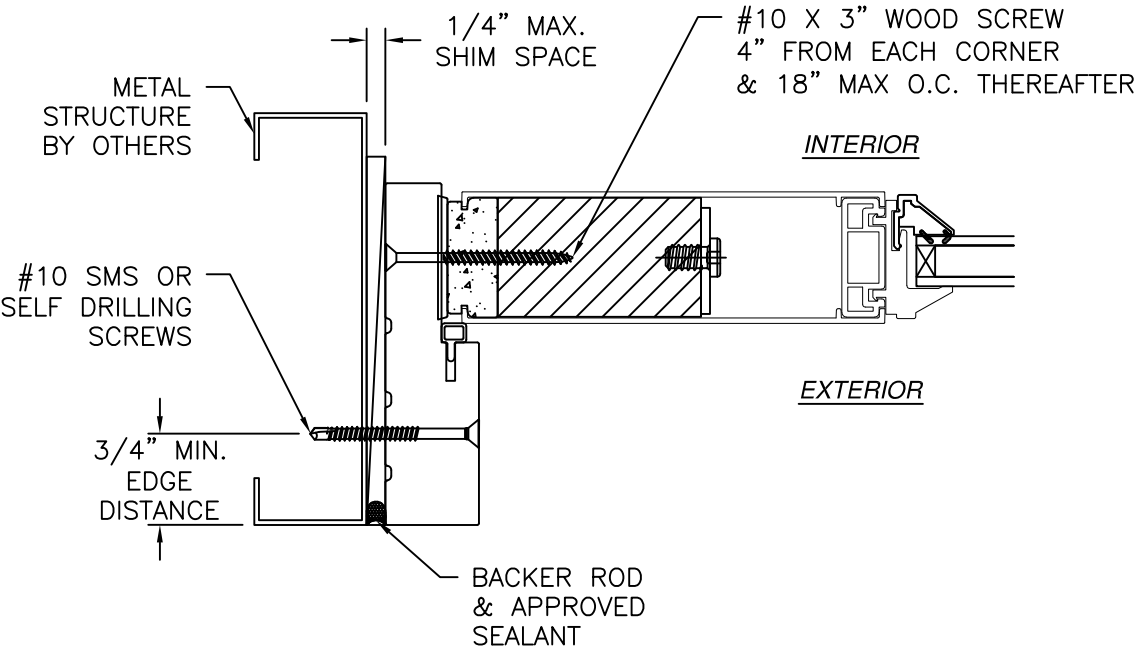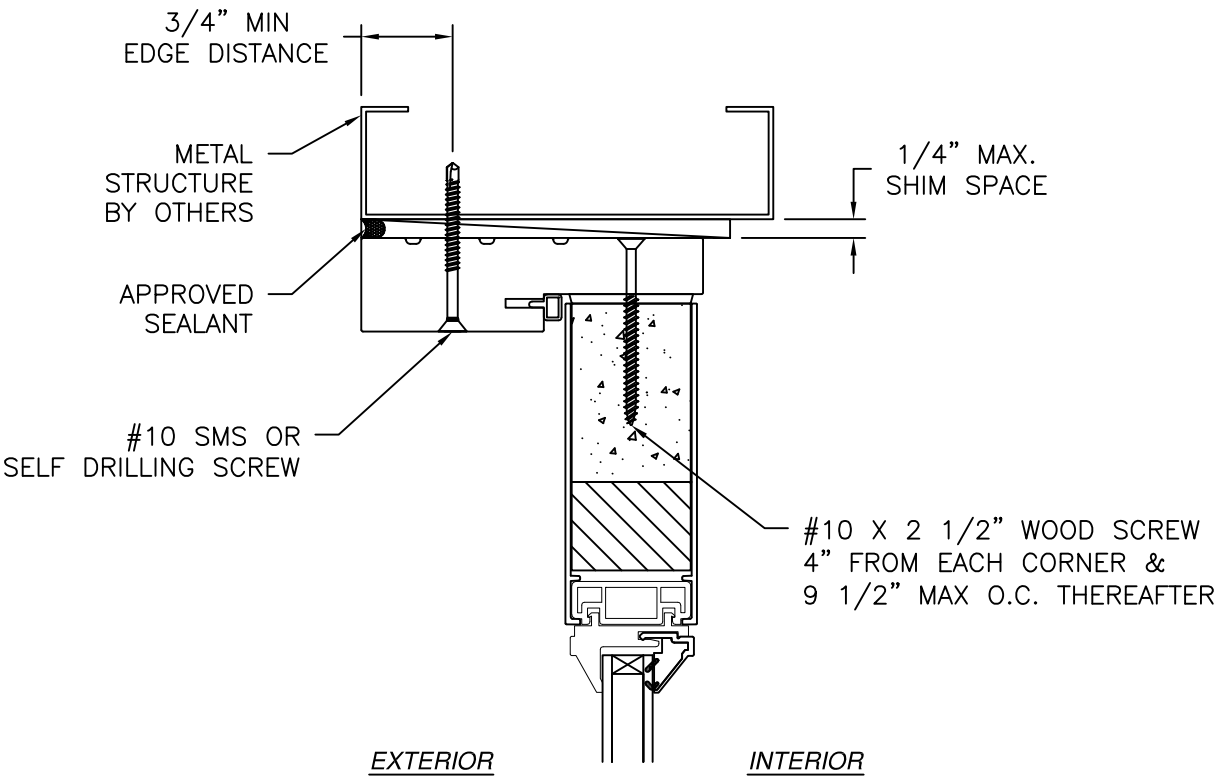

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

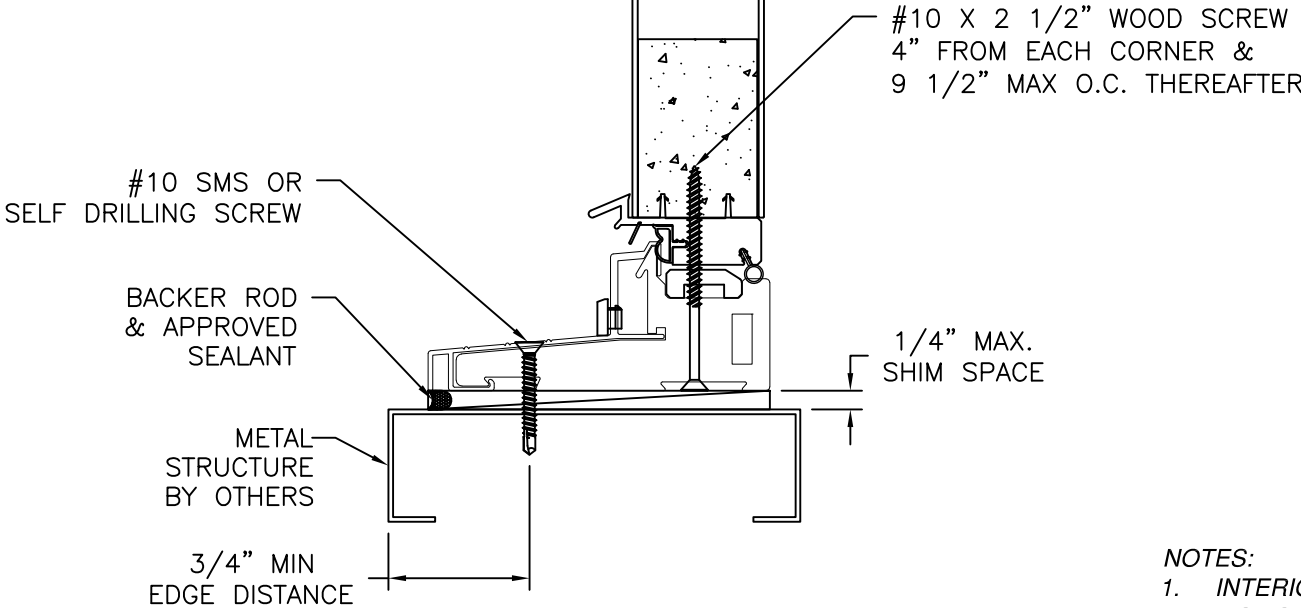

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
SIDELITE INSTALLATION DETAILS

DRAWN:
V.L.

DWG NO.
08-02978

REV
B

SCALE
NTS

DATE
01/19/17


SHEET
8 OF 10

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903



434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/09/2026

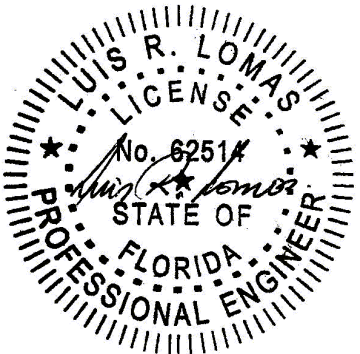


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

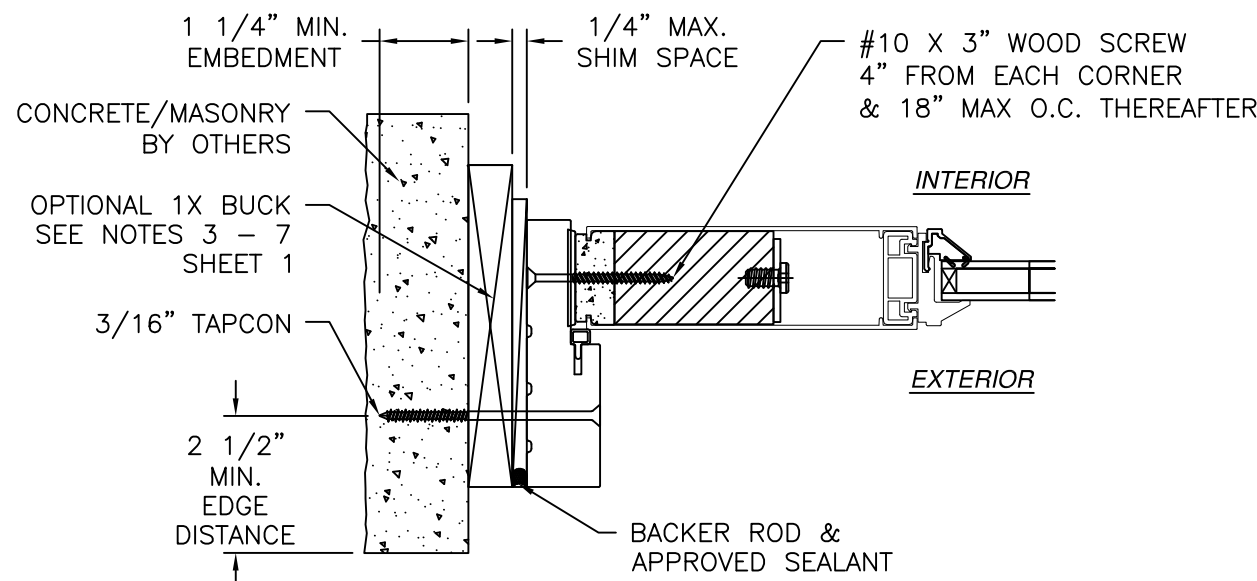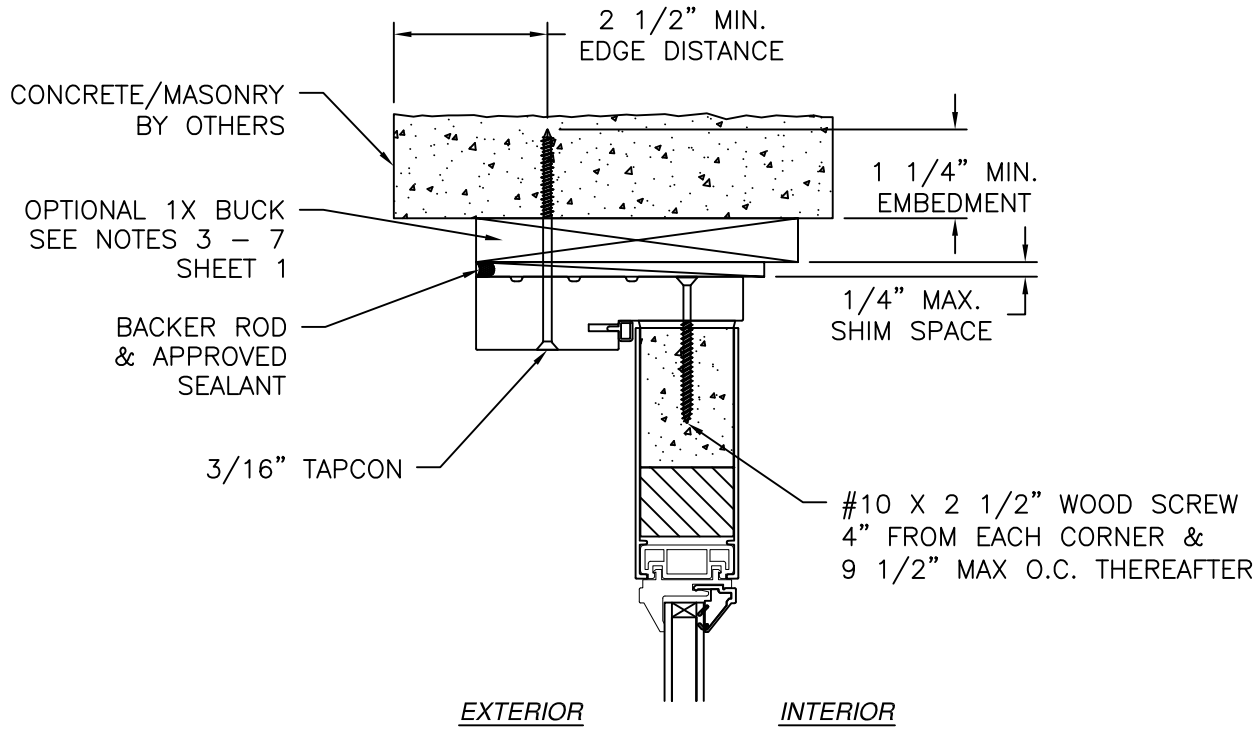

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

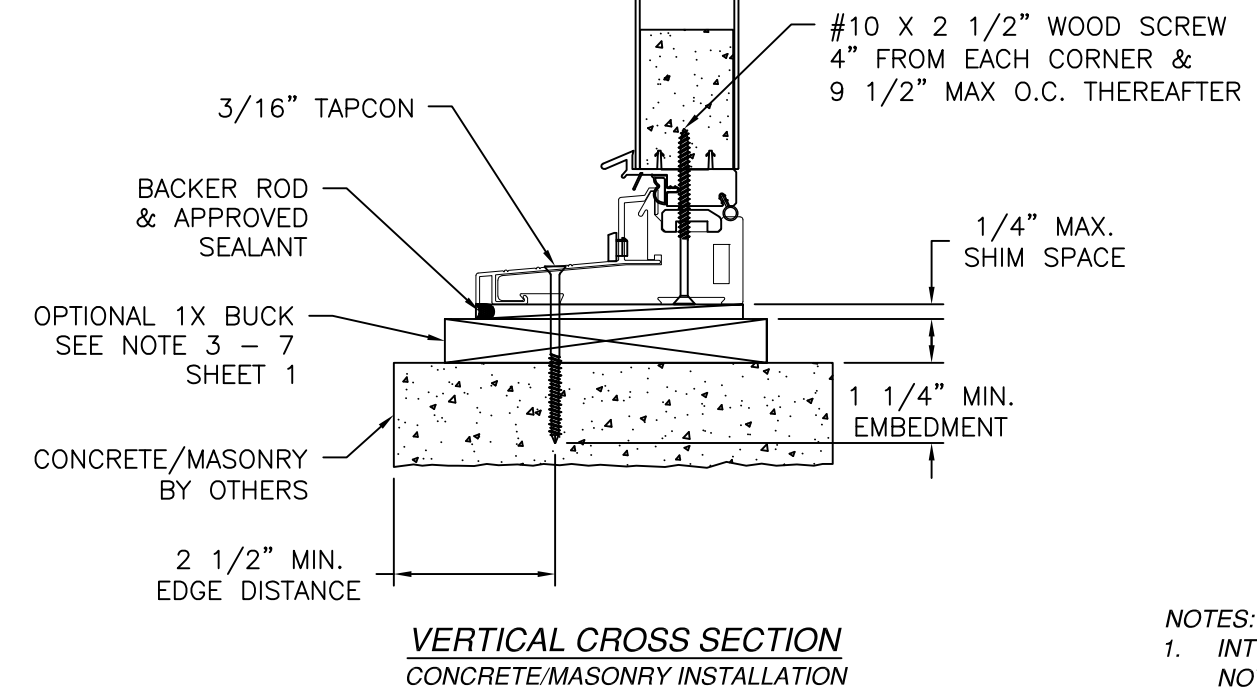

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SLPS INSWING GLAZED FIBERGLASS
SIDE-HINGED PATIO DOOR – NON-IMPACT
SIDELITE INSTALLATION DETAILS

DRAWN: V.L.

DWG NO. 08-02978

REV B

SCALE NTS

DATE 01/19/17


SHEET 9 OF 10

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 07/09/2026

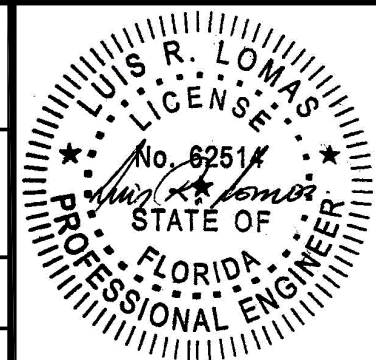

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED MANUFACTURER ADDRESS	07/09/2026	R.L.

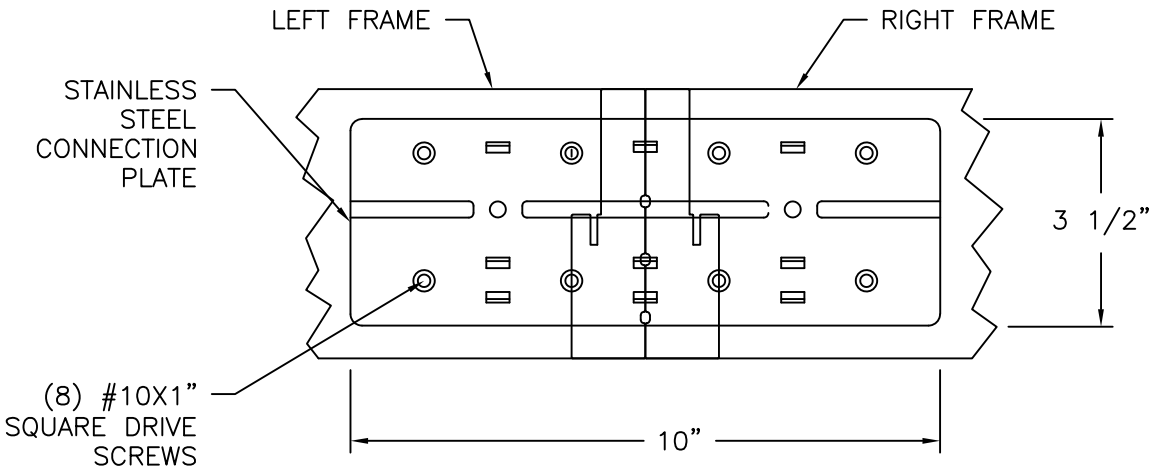

FRAME CONNECTION DETAIL

SIGNED: 07/09/2026

NAN YA PLASTICS CORP. USA 4016 SHADRACK ST. HOUSTON, TX 77013			
SERIES SLPS INSWING GLAZED FIBERGLASS SIDE-HINGED PATIO DOOR – NON-IMPACT CONNECTION DETAIL			
DRAWN: V.L.	DWG NO. 08-02978	REV B	
SCALE NTS	DATE 01/19/17	SHEET 10 OF 10	
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com			

Luis R. Lomas P.E.
FL No.: 62514