

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED FOAM PVC CO-EX.
12. PANEL SKIN MATERIAL: SMC FIBERGLASS .075" THICK.
13. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 3 FOR GLASS DETAILS.
14. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4" ELCO CRETE-FLEX TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .060" THICK MINIMUM.
20. APPROVED CONFIGURATIONS: OX/O, O/XO, OX, XO.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3	GLAZING DETAILS
4	ANCHORING LAYOUT
5 - 7	INSTALLATION DETAILS
8	COMPONENTS

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR

IMPACT - HVHZ

NOTES

DRAWN:
V.L.

DWG NO.
08-02987

REV
B

SCALE NTS

DATE 10/19/16


SHEET 1 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

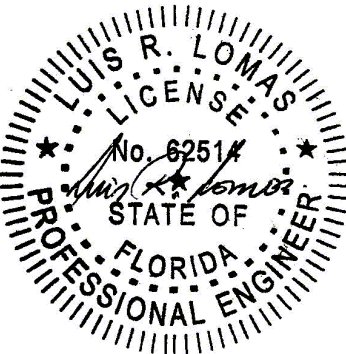

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

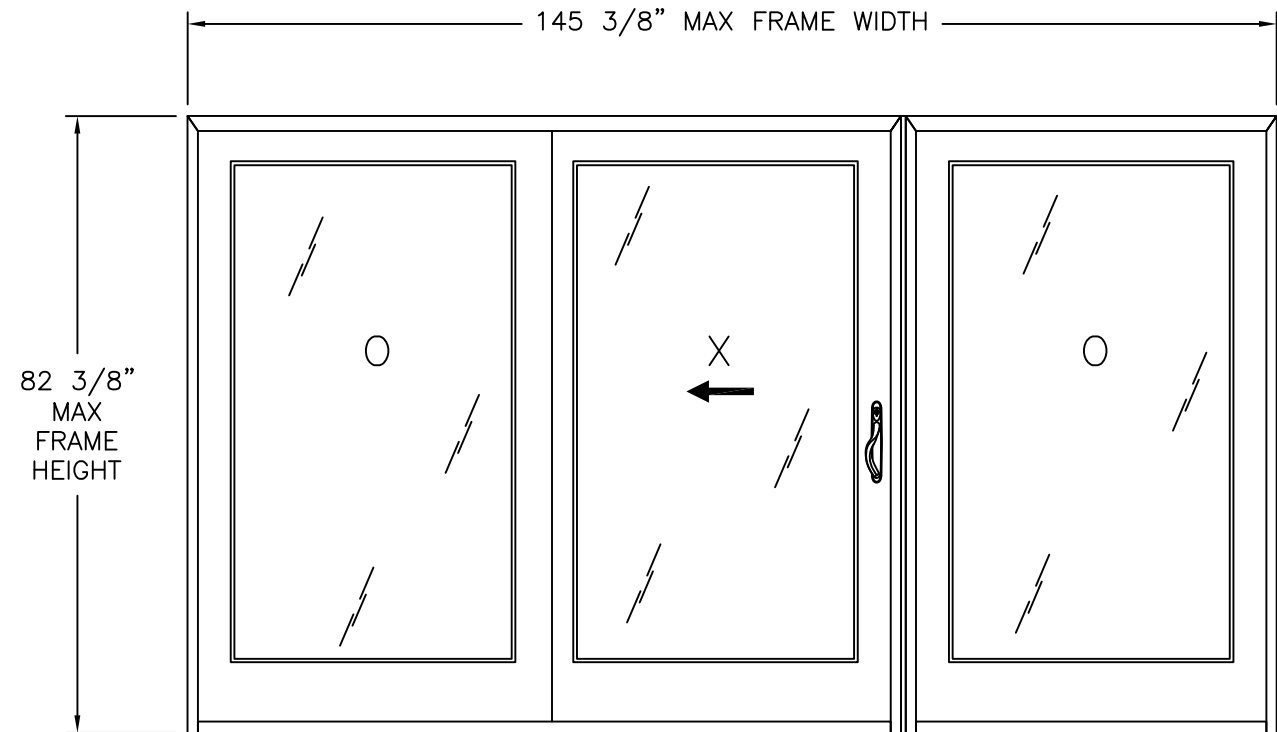

- NOTES:
1. MAXIMUM PANEL SIZE: 47 3/4" X 79 1/4"
 2. MAXIMUM D.L.O.: 37" X 66"

SRS GLIDING PATIO DOOR
EXTERIOR VIEW

WITH STANDARD SILL OR SILL RISER

DESIGN PRESSURE RATING	IMPACT RATING
$\pm 50.0\text{PSF}$	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4 AND HVHZ

NOTE: STANDARD SILL WAS TESTED TO 7.5PSF WATER PENETRATION RESISTANCE,
3" SILL RISER WAS TESTED TO 15.0PSF WATER PENETRATION RESISTANCE

HARDWARE SCHEDULE	
A.	DIE CASTING HANDLE SETS
B.	STAINLESS STEEL TANDEM ROLLER
C.	DIE CASTING LOCK KEEPER
D.	STAINLESS STEEL TWO-POINT LOCK
E.	ALUMINUM 6063-T5 MULLION

NAN YA PLASTICS CORP. USA
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR
IMPACT – HVHZ
ELEVATION

DRAWN:
V.L.

DWG NO.
08-02987

REV
B

SCALE NTS

DATE 10/19/16

SHEET 2 OF 8





L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

APPROVED PANEL CONFIGURATIONS

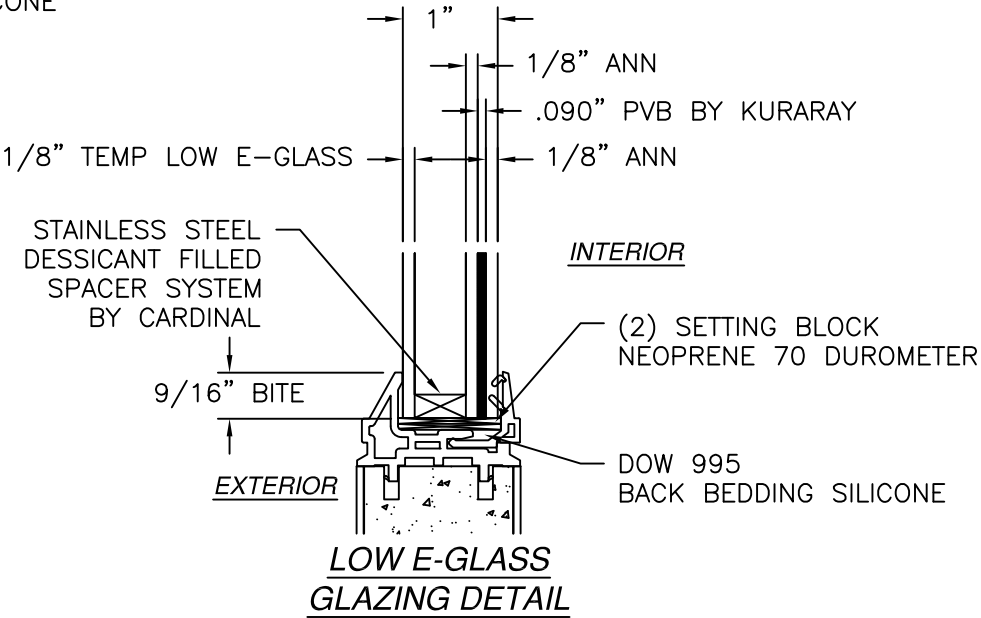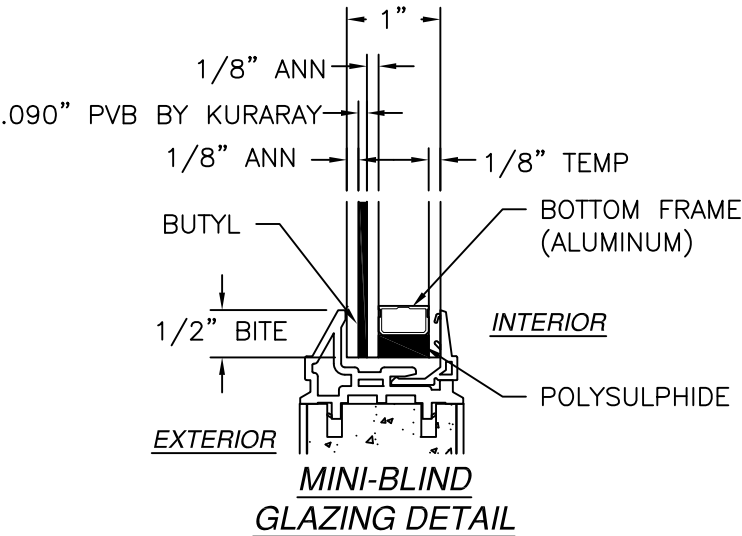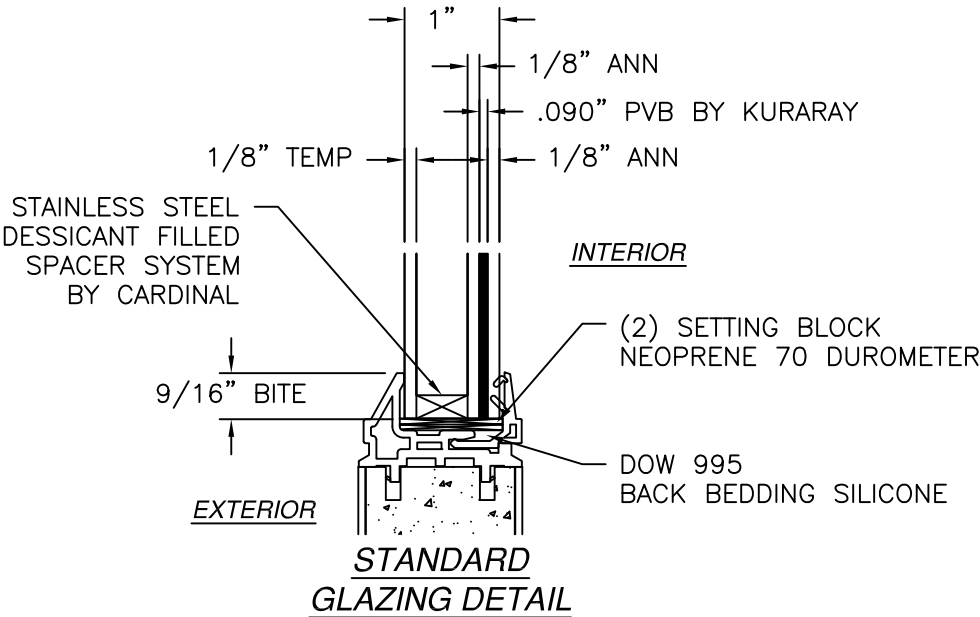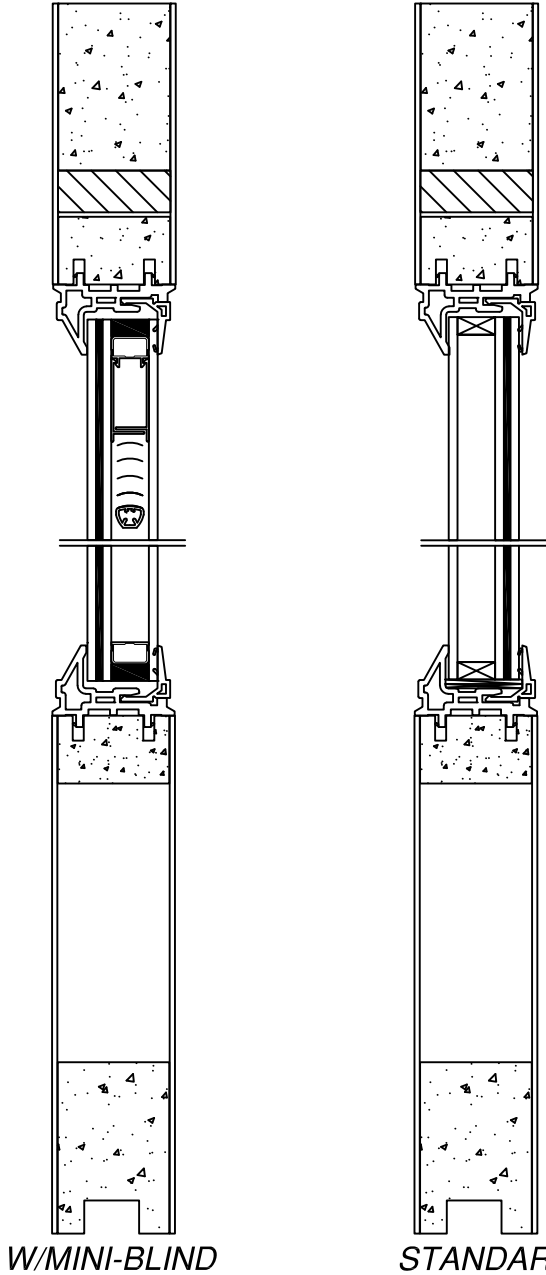

SIGNED: 08/11/2026

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR

IMPACT – HVHZ

GLAZING DETAILS

DRAWN: V.L.

DWG NO. 08-02987

REV B

SCALE NTS


DATE 10/19/16

SHEET 3 OF 8


L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

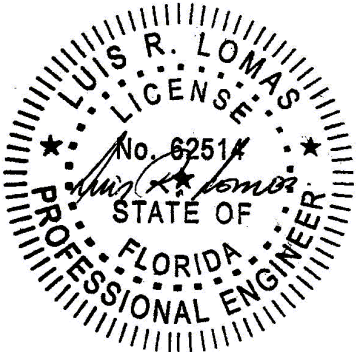

Luis R. Lomas P.E.
FL No.: 62514

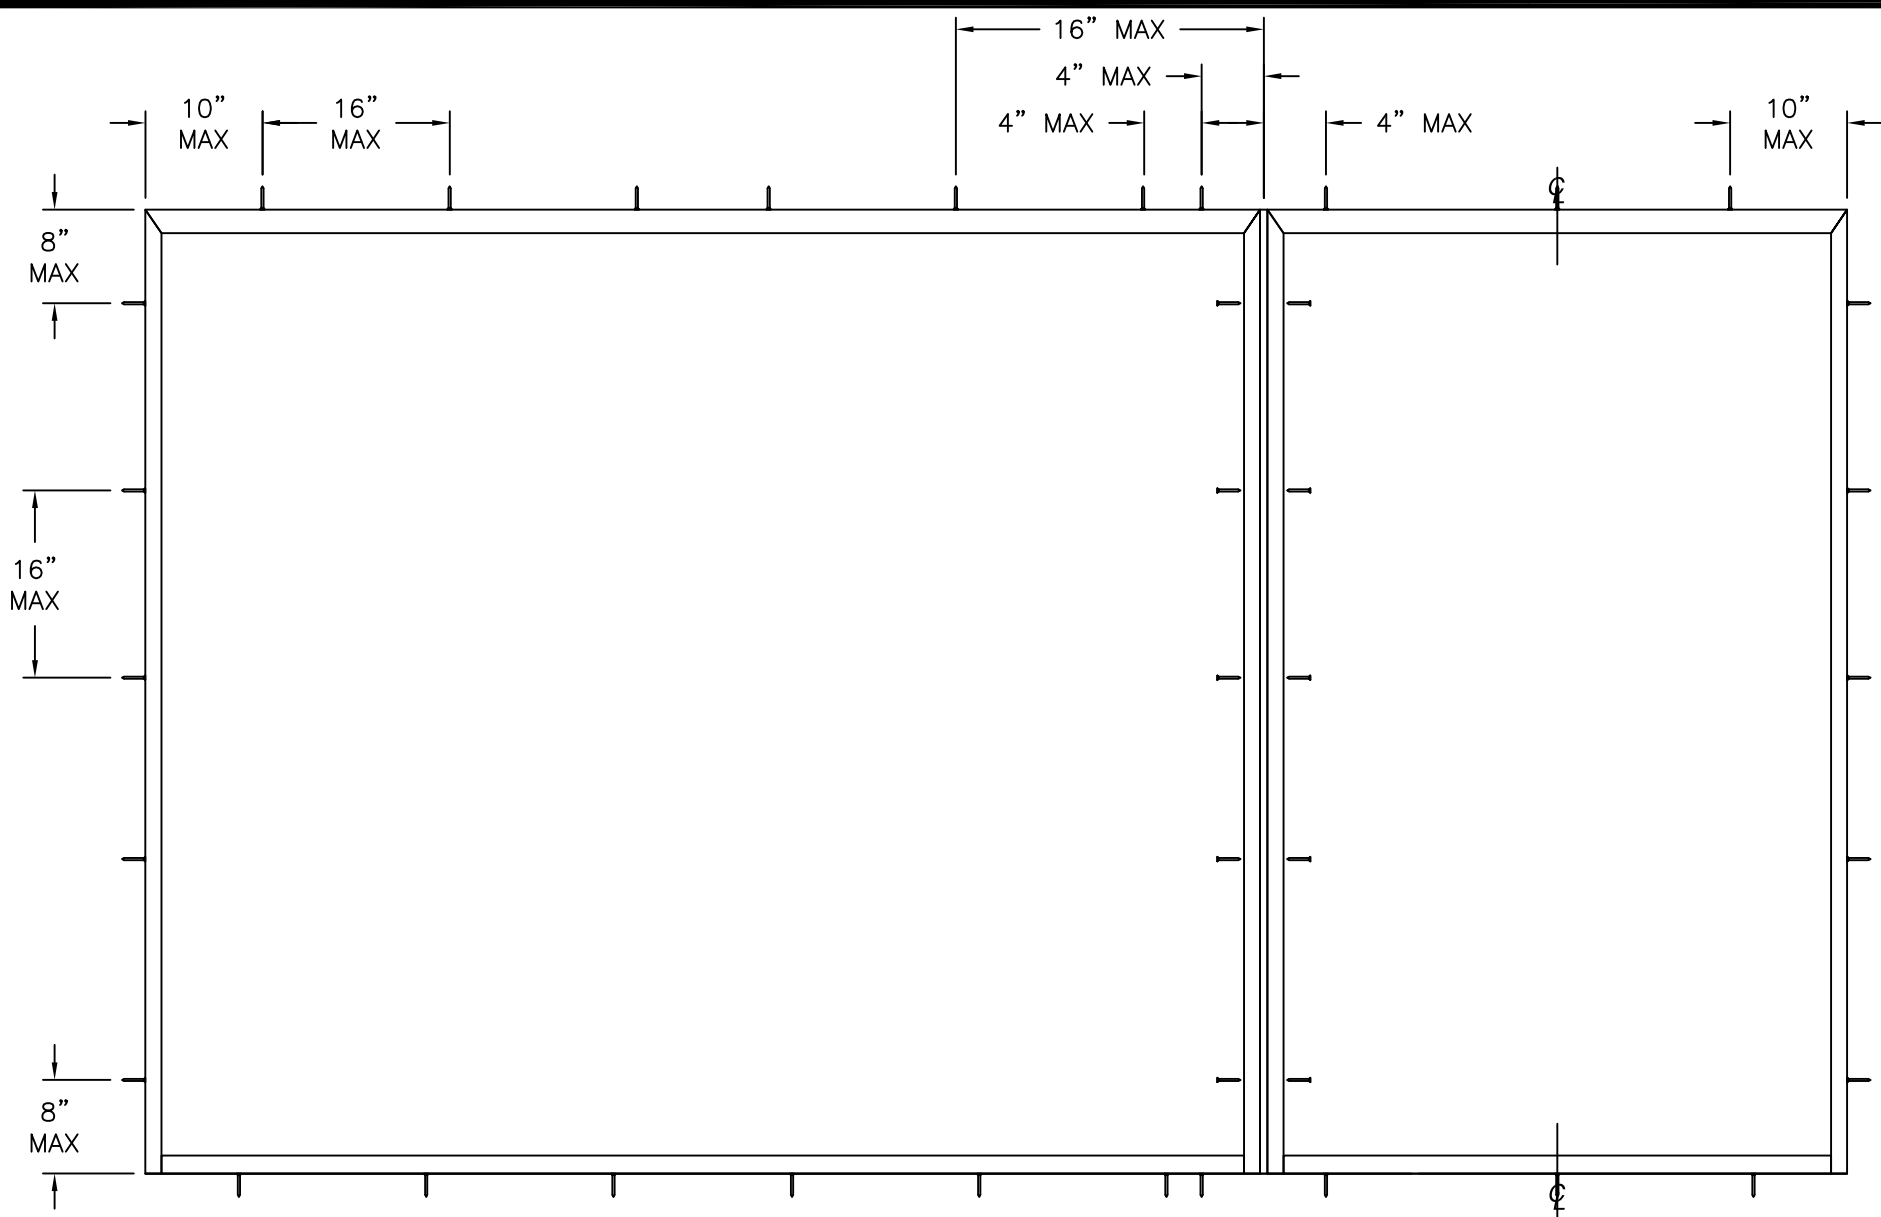

SRS GLIDING PATIO DOOR
ANCHORING LAYOUT

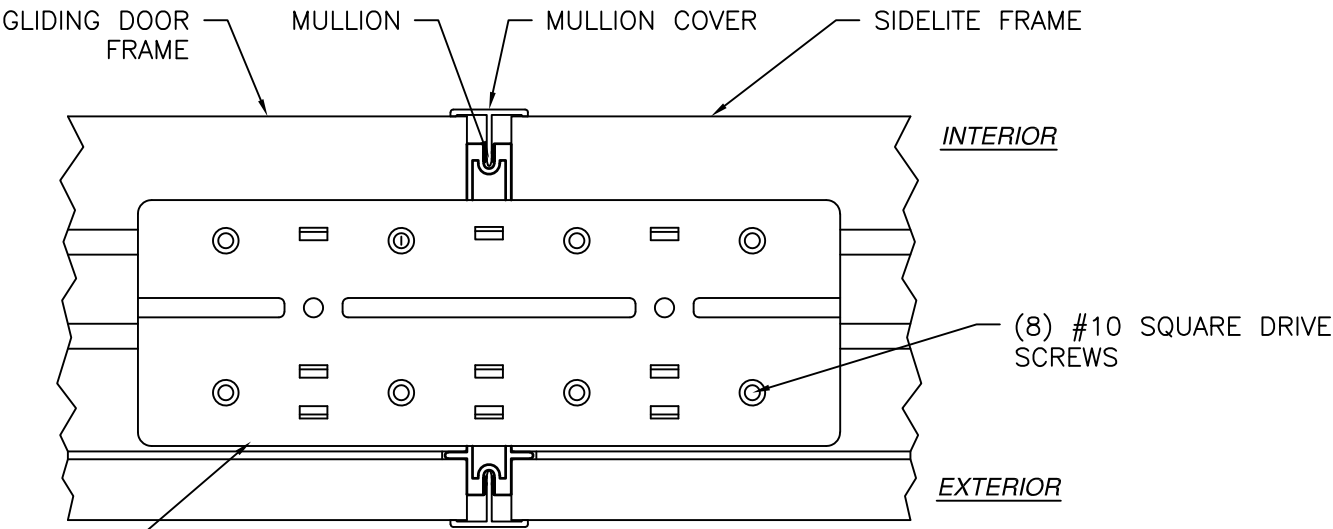

CONNECTION PLATE **MULLION CONNECTION DETAIL**

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

NAN YA PLASTICS CORP. USA
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR
IMPACT – HVHZ
ANCHORING LAYOUT

DRAWN:
V.L.

DWG NO.
08-02987

REV
B


SCALE NTS

DATE 10/19/16



SHEET 4 OF 8

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 08/11/2026

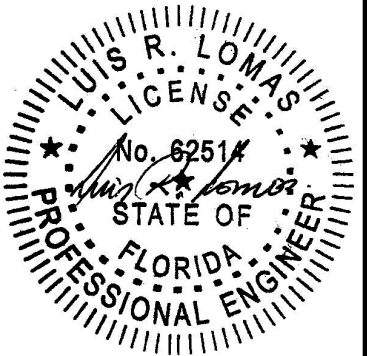

Luis R. Lomas P.E.
FL No.: 62514

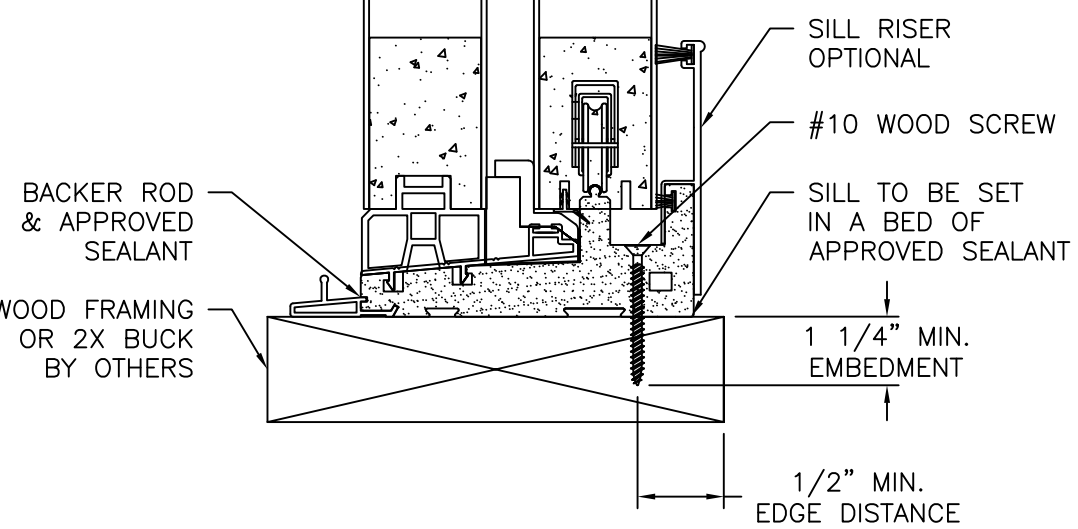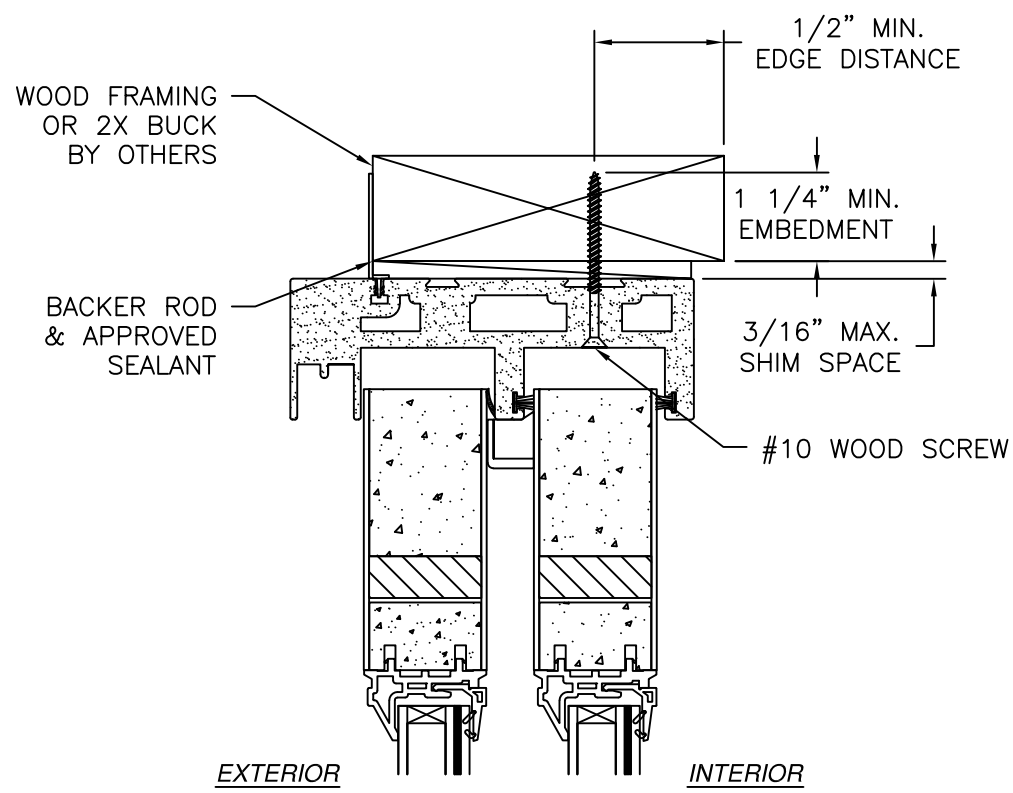

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

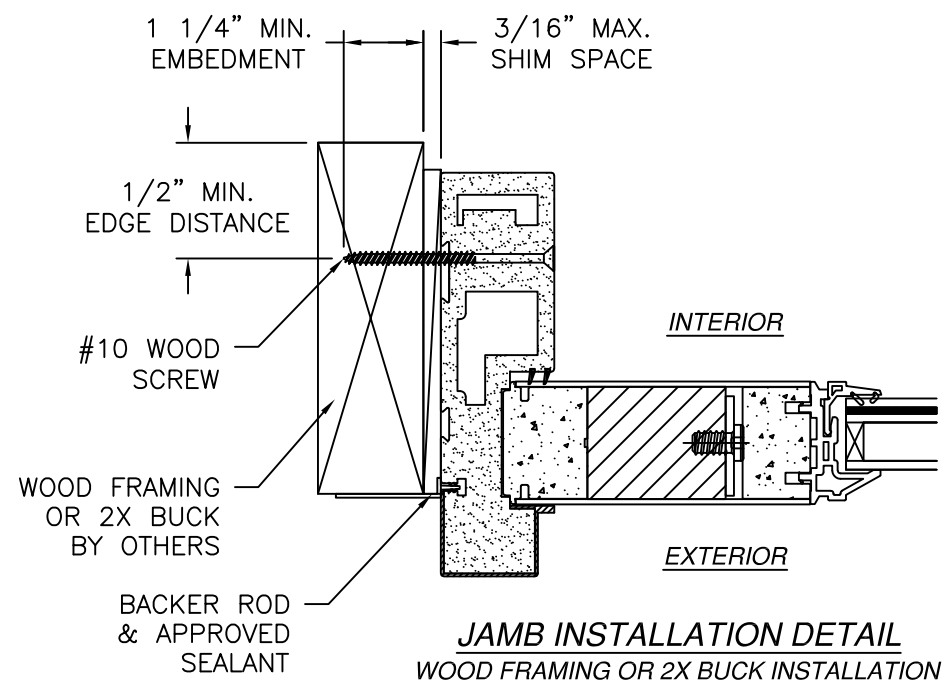

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

NAN YA PLASTICS CORP. USA
4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR
IMPACT – HVHZ
INSTALLATION DETAILS

DRAWN: V.L.	DWG NO. 08-02987	REV B
SCALE NTS	DATE 10/19/16	SHEET 5 OF 8



L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

LUIS R. LOMAS
LICENSED PROFESSIONAL ENGINEER
No. 62514
STATE OF FLORIDA

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

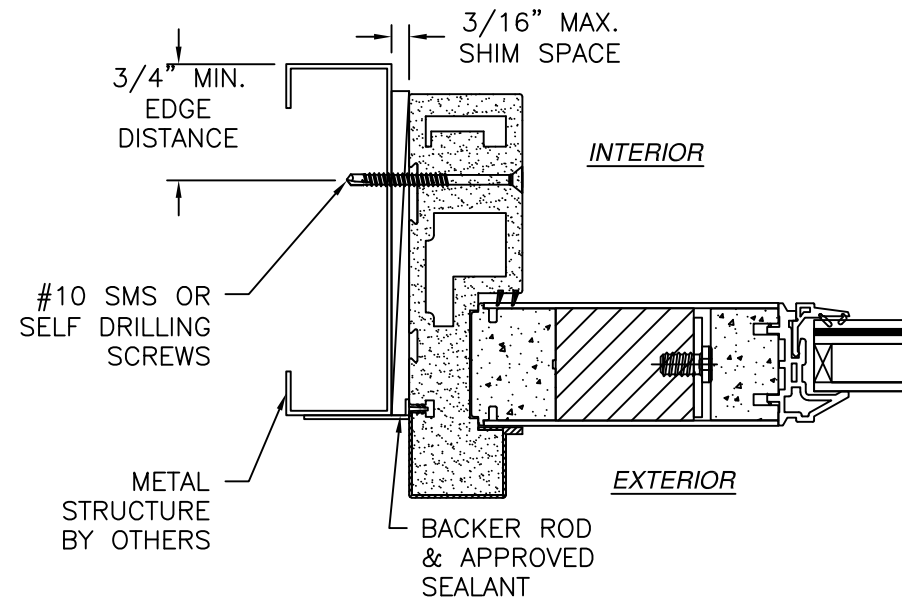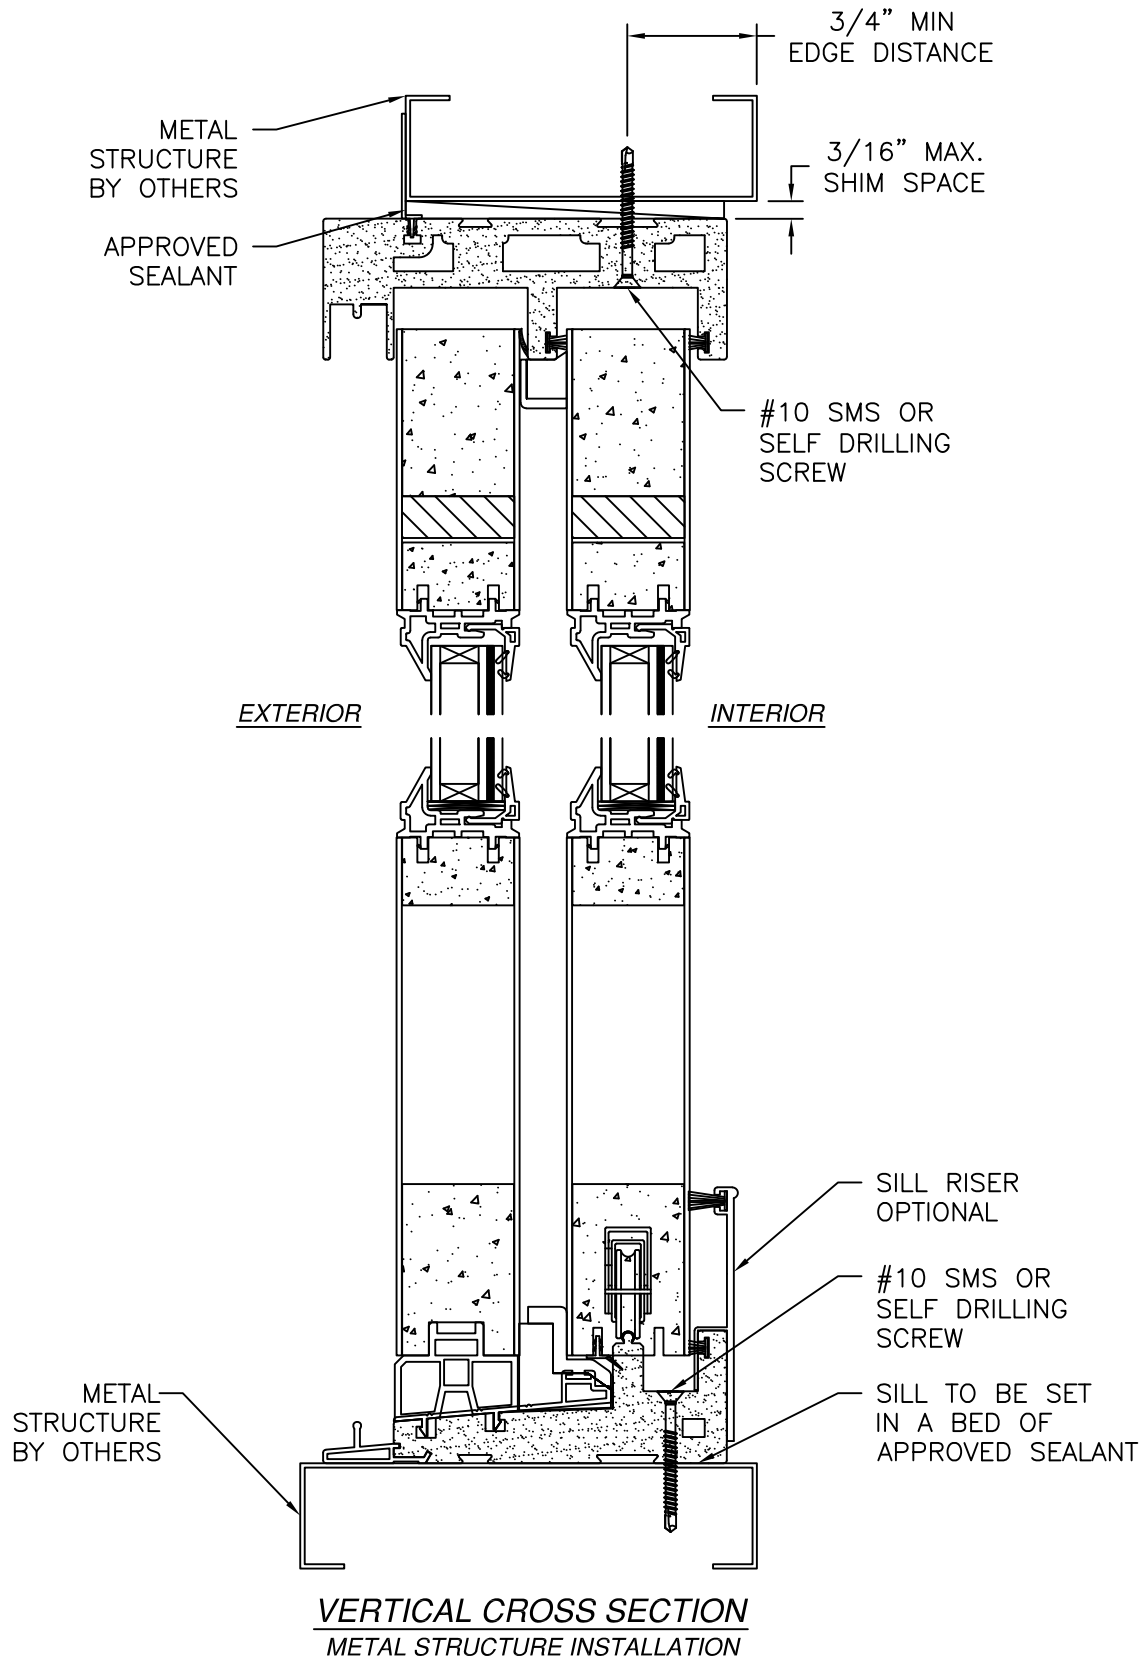

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/11/2026


NAN YA PLASTICS CORP. USA 4016 SHADRACK ST. HOUSTON, TX 77013			
SERIES SRS GLIDING PATIO DOOR IMPACT – HVHZ INSTALLATION DETAILS			
DRAWN: V.L.	DWG NO. 08-02987	REV B	
SCALE NTS	DATE 10/19/16	SHEET 6 OF 8	
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com			

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

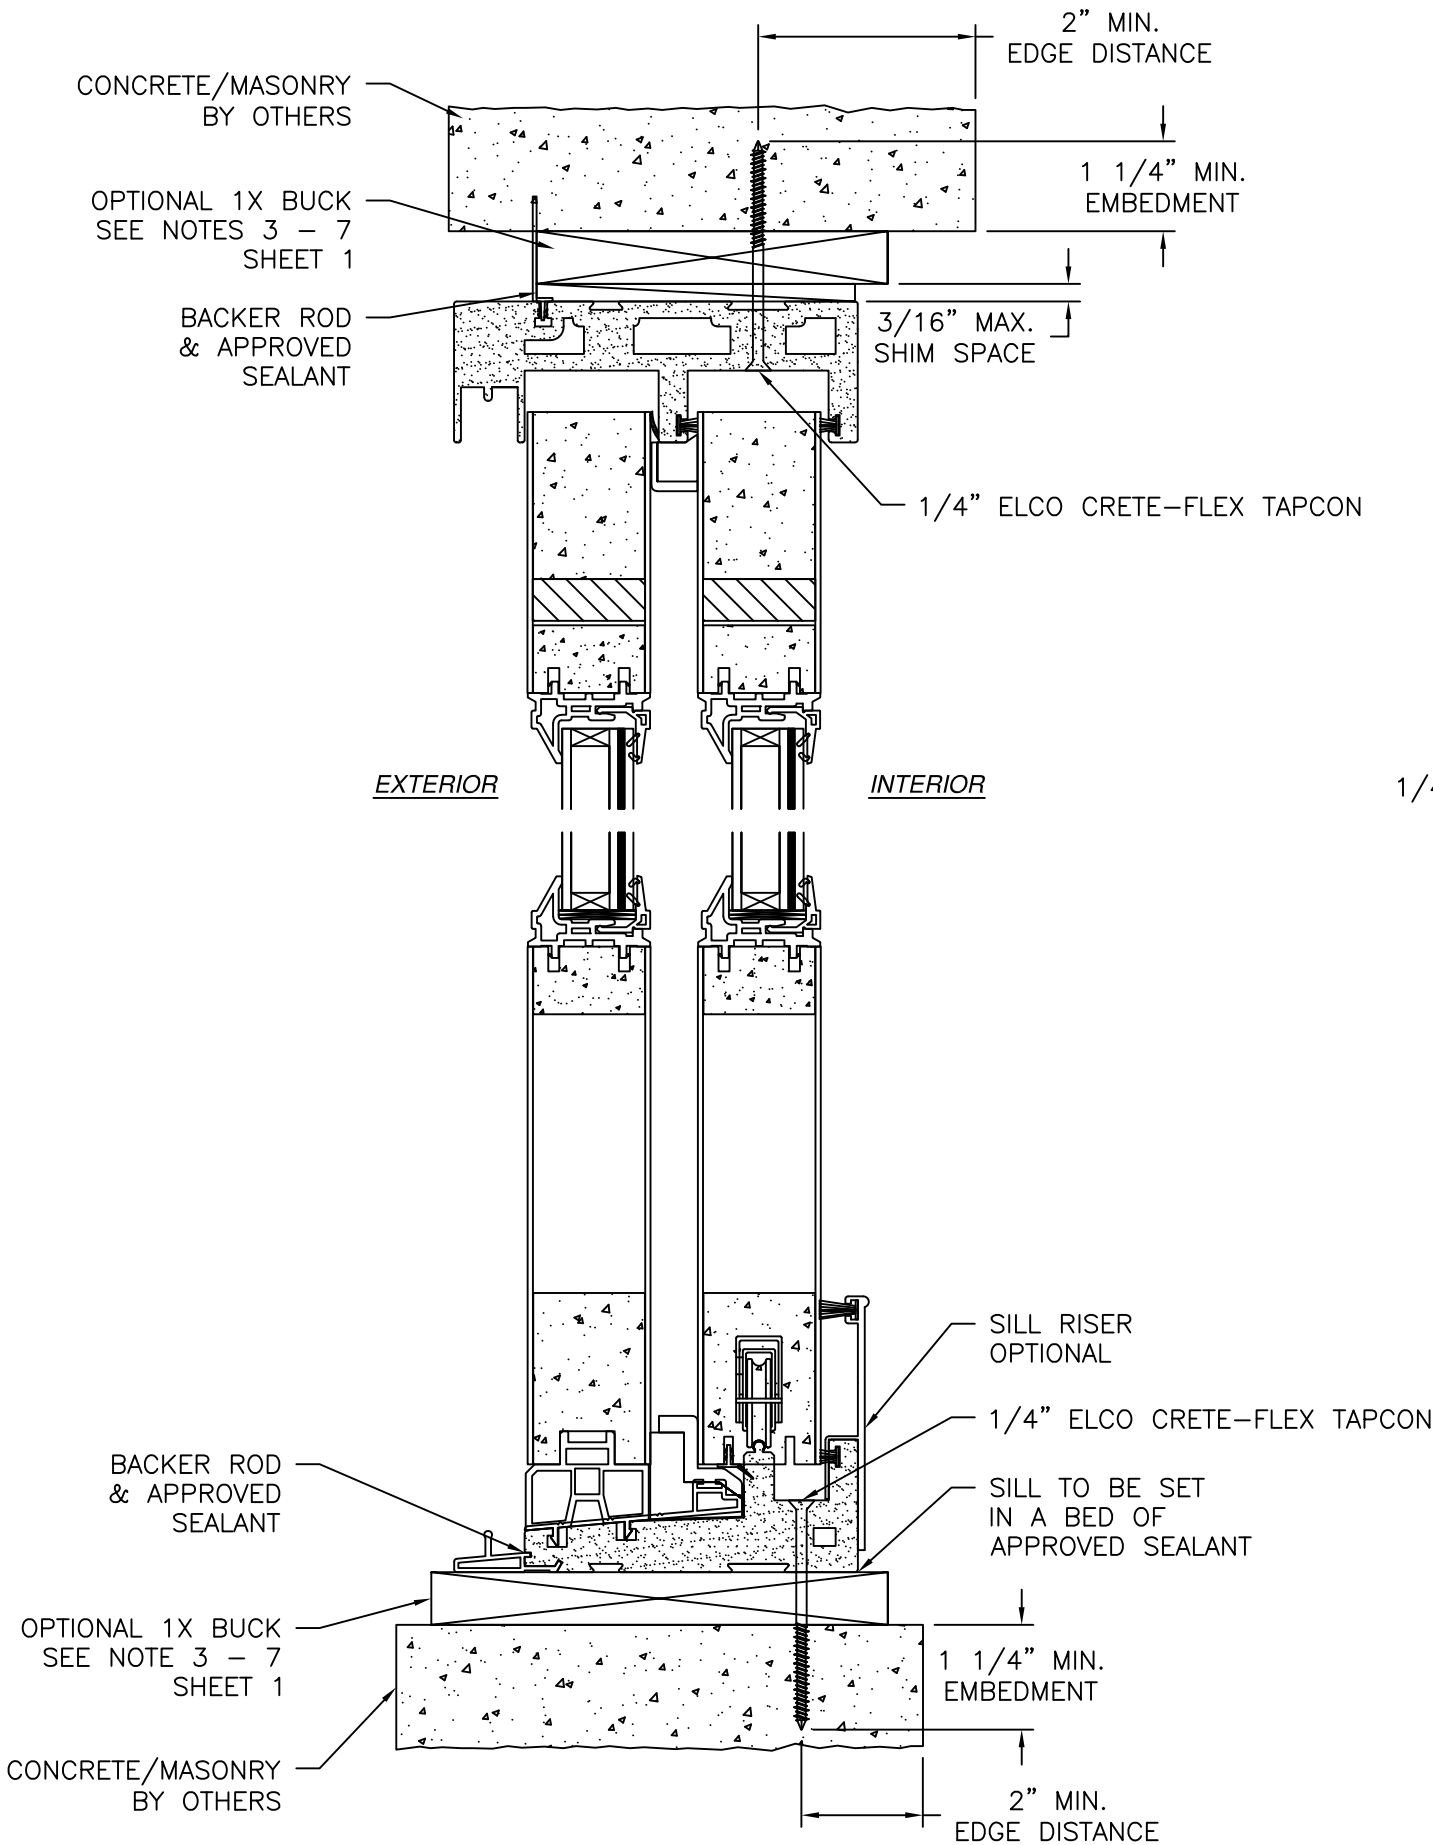

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

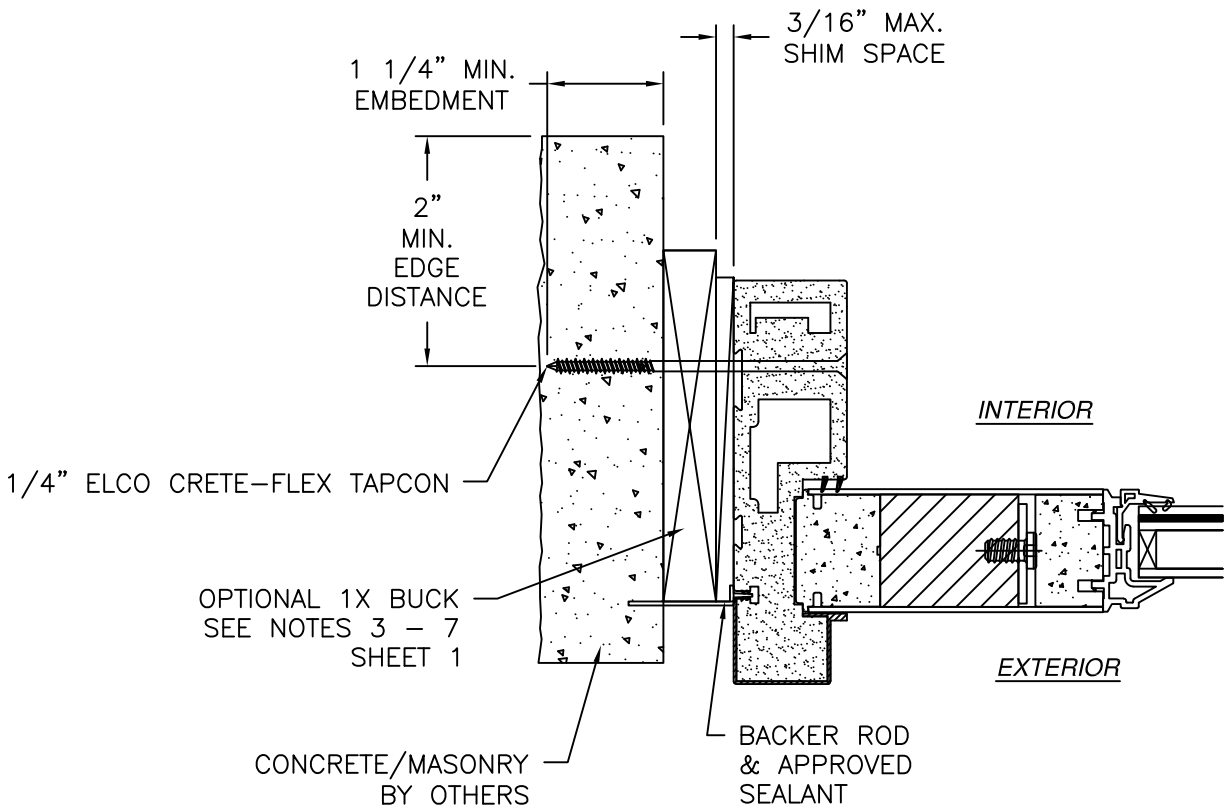

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/11/2026

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR

IMPACT – HVHZ

INSTALLATION DETAILS

DRAWN: V.L.

DWG NO. 08-02987

REV B

SCALE NTS


DATE 10/19/16

SHEET 7 OF 8

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

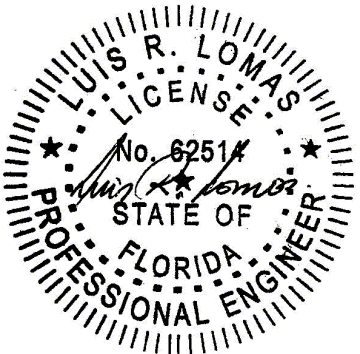


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
B	REVISED ADDRESS & SILL RISER	07/10/2026	R.L.

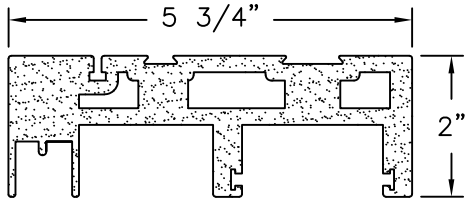


HEAD FRAME
FOAM PVC CO-EX

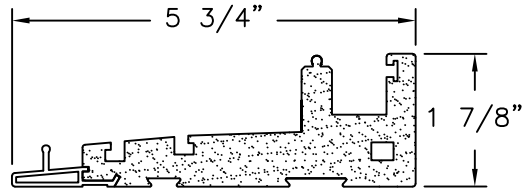


SILL
FOAM PVC & ALUMINUM

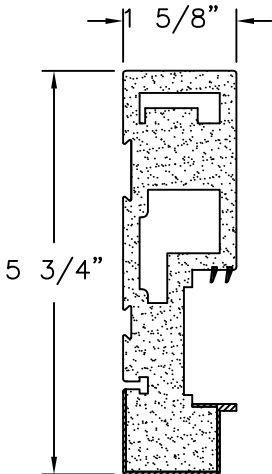

SIDE JAMB
FOAM PVC

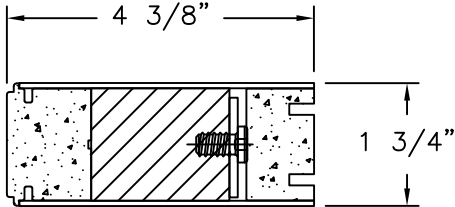

STILE
FOAM PVC AND WOOD

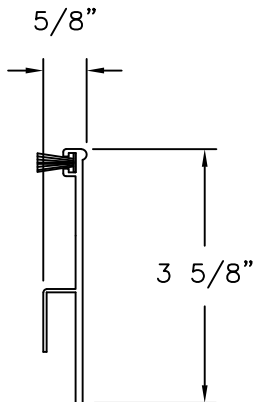

SILL RISER
ALUMINUM



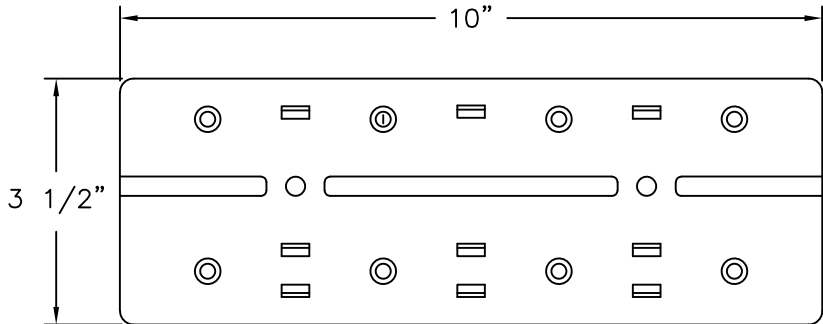



PLATE
STAINLESS STEEL

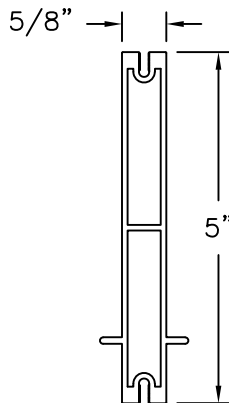


MULLION
ALUMINUM 6063-T5 (.078" THICK)

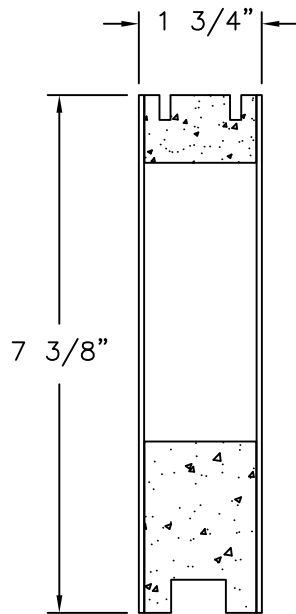

FIXED PANEL BOTTOM RAIL
FOAM PVC

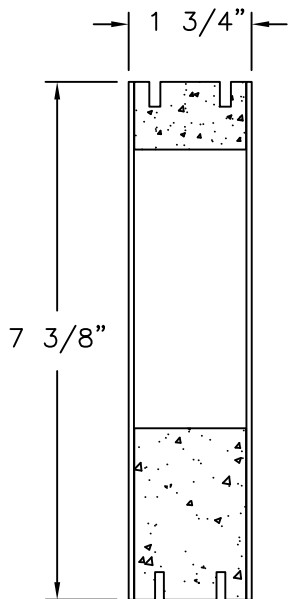

OPERABLE PANEL BOTTOM RAIL
FOAM PVC

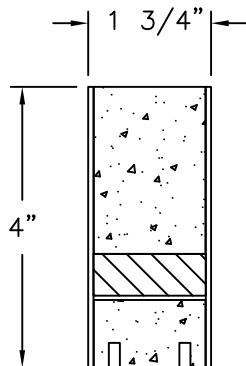

OPERABLE AND FIXED PANEL TOP RAIL
FOAM PVC

NAN YA PLASTICS CORP. USA

4016 SHADRACK ST.
HOUSTON, TX 77013

SERIES SRS GLIDING PATIO DOOR

IMPACT – HVHZ

COMPONENTS

DRAWN: V.L.

DWG NO. 08-02987

REV B

SCALE NTS

DATE 10/19/16


SHEET 8 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/11/2026

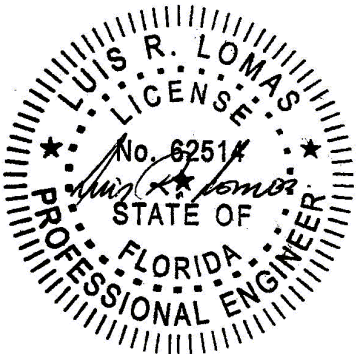

Luis R. Lomas P.E.
FL No.: 62514