




"Gulf Armor"  
WOOD GLAZED OR OPAQUE  
SINGLE DOOR w/ SIDELITE(S)  
INSWING/OUTSWING  
"IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

| TABLE OF CONTENTS |                                                      |
|-------------------|------------------------------------------------------|
| SHEET#            | DESCRIPTION                                          |
| 1                 | Typical Elevations, Design Pressures & General Notes |
| 2                 | Door Panel Details                                   |
| 3                 | Sidelite Panel Details                               |
| 4                 | Elevations                                           |
| 5                 | Horizontal & Vertical Cross Sections (2X Buck)       |
| 6                 | Horizontal & Vertical Cross Sections (1X Buck)       |
| 7                 | Horizontal Cross Sections                            |
| 8                 | Vertical Cross Sections (Thresholds)                 |
| 9                 | Buck & Frame Anchoring (OX)                          |
| 10                | Buck & Frame Anchoring (OXO)                         |
| 11                | Hardware Details                                     |
| 12                | Bill of Materials & Components                       |

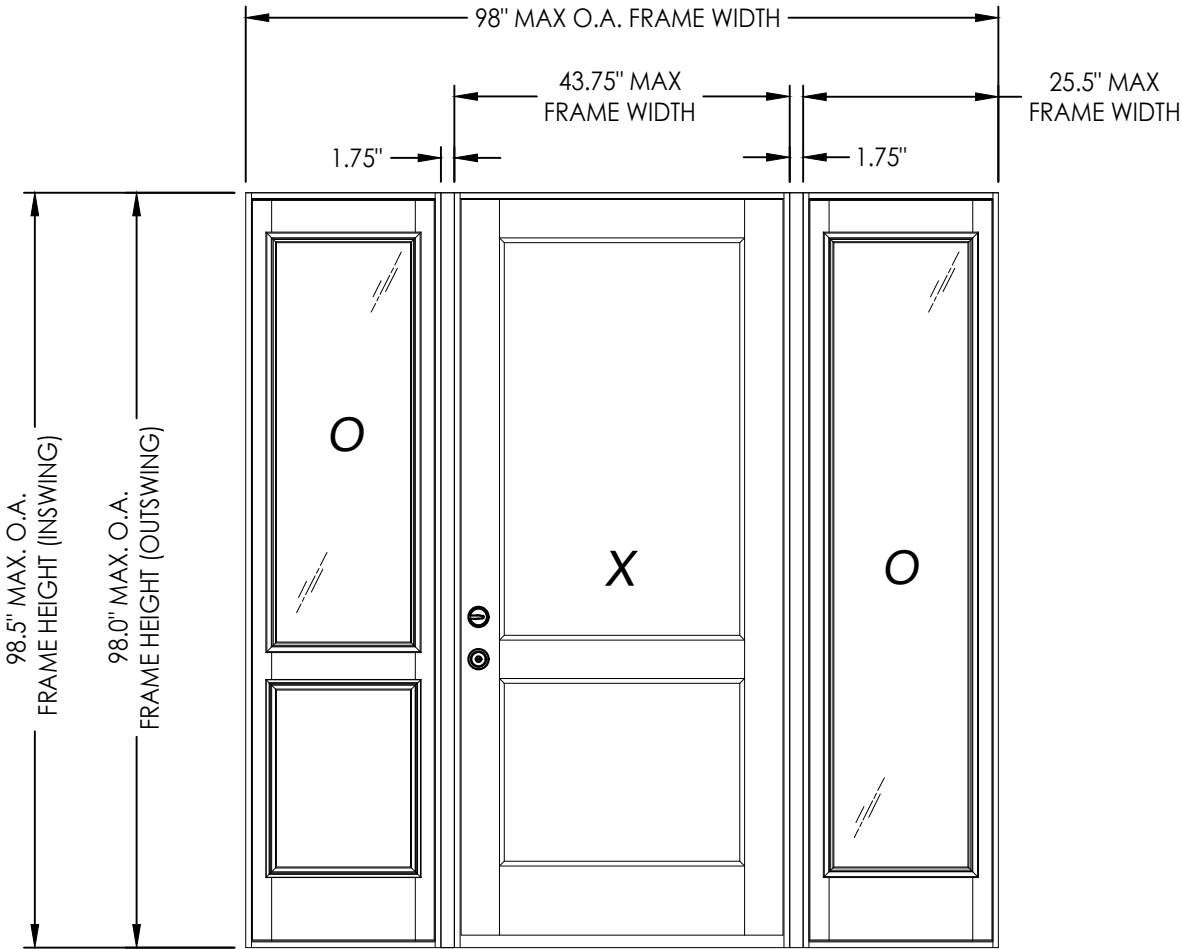

| CONFIGURATION | DESIGN PRESSURE (PSF)<br>INSWING |          | DESIGN PRESSURE (PSF)<br>OUTSWING |          |
|---------------|----------------------------------|----------|-----------------------------------|----------|
|               | POSITIVE                         | NEGATIVE | POSITIVE                          | NEGATIVE |
| OX, XO, OXO   | +50.0                            | -50.0    | +50.0                             | -50.0    |

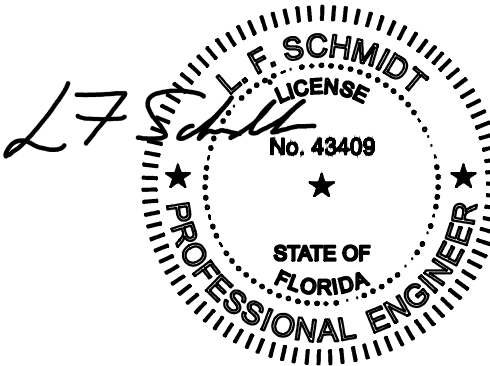

Digitally signed by Lyndon F Schmidt  
Date: 2023.10.18 12:05:45 -04'00'

This item has been digitally signed and sealed by  
L. F. Schmidt, P.E. on the date adjacent to the seal.  
Printed copies of this document are not  
considered signed and sealed and the signature  
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID  
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

PRODUCT:  
Builders FirstSource  
WOOD DOOR

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-22347.2

SHEET 1 OF 12

PART OR ASSEMBLY:  
TYPICAL ELEVATION, DESIGN  
PRESSURES & GENERAL NOTES

REVISIONS

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-22347.2

SHEET 1 OF 12

Building Consultants, Inc.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

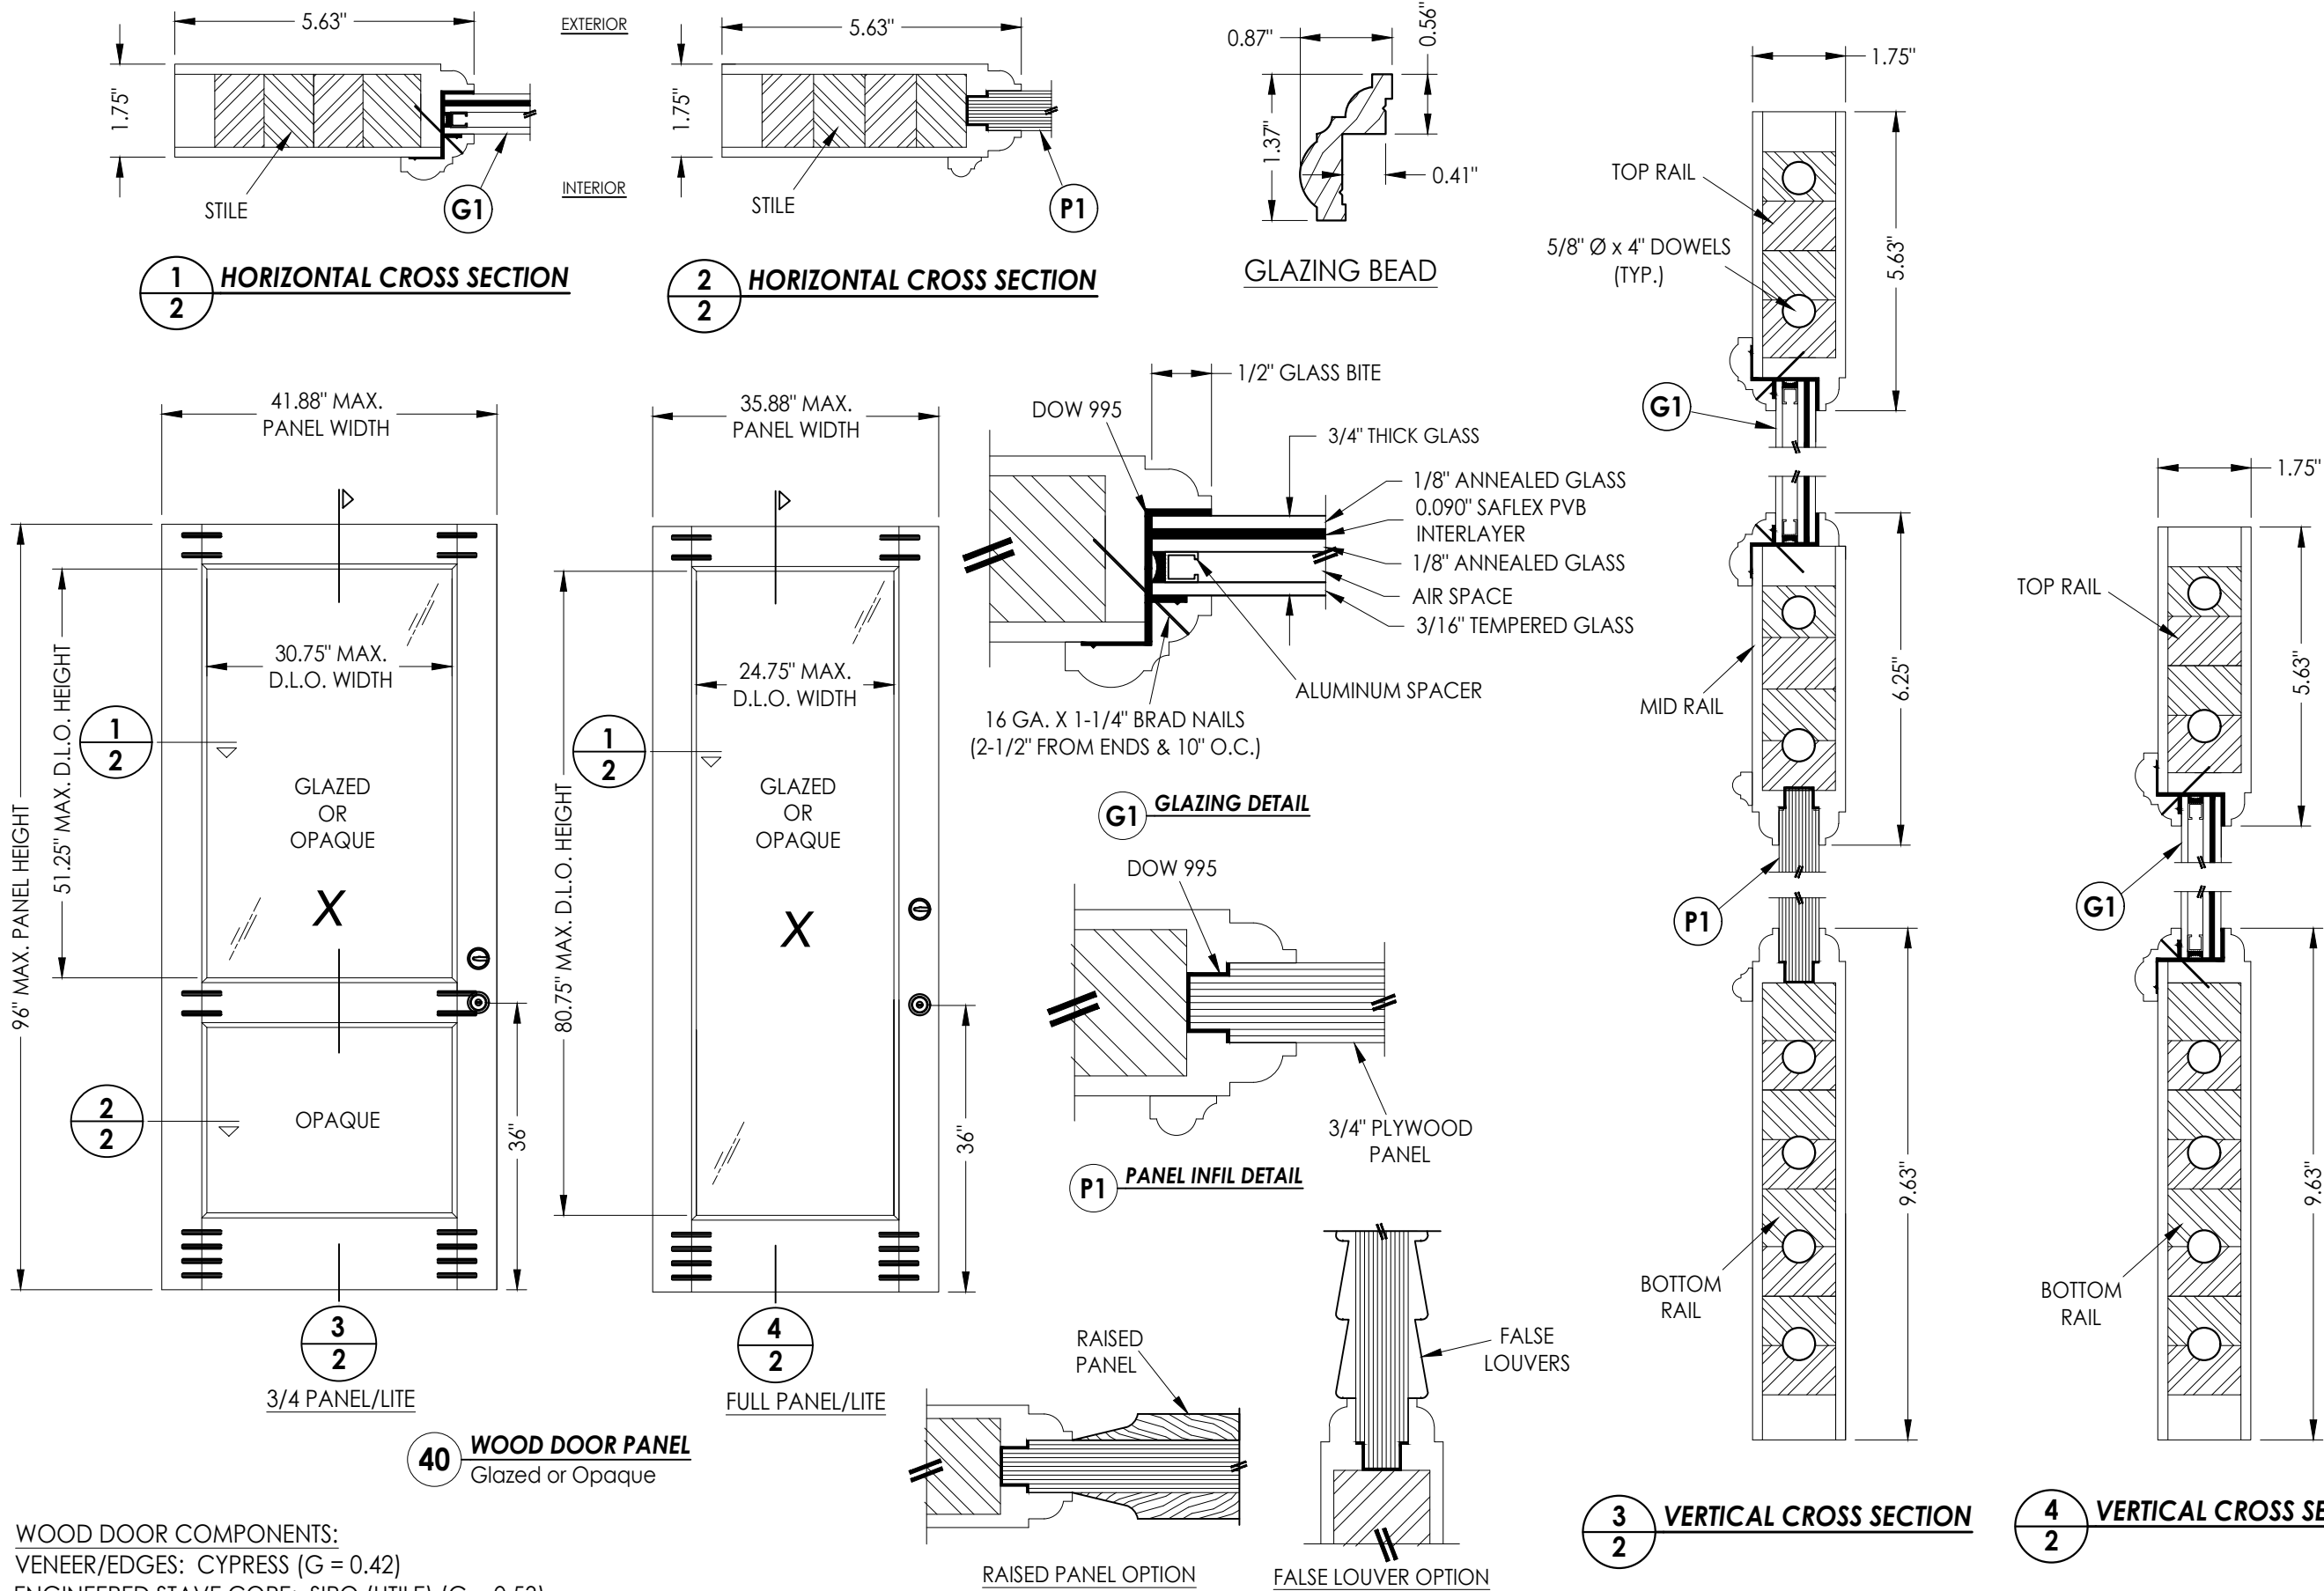

WOOD DOOR COMPONENTS:  
VENEER/EDGES: CYPRESS (G = 0.42)  
ENGINEERED STAVE CORE: SIPO (UTILE) (G = 0.53)

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

PRODUCT:  
Builders FirstSource  
WOOD DOOR

| NO. | DATE     | REVISIONS                | BY  |
|-----|----------|--------------------------|-----|
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) | FBC |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) | FBC |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) | FBC |

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-22347.2

SHEET 2 OF 12


RW BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

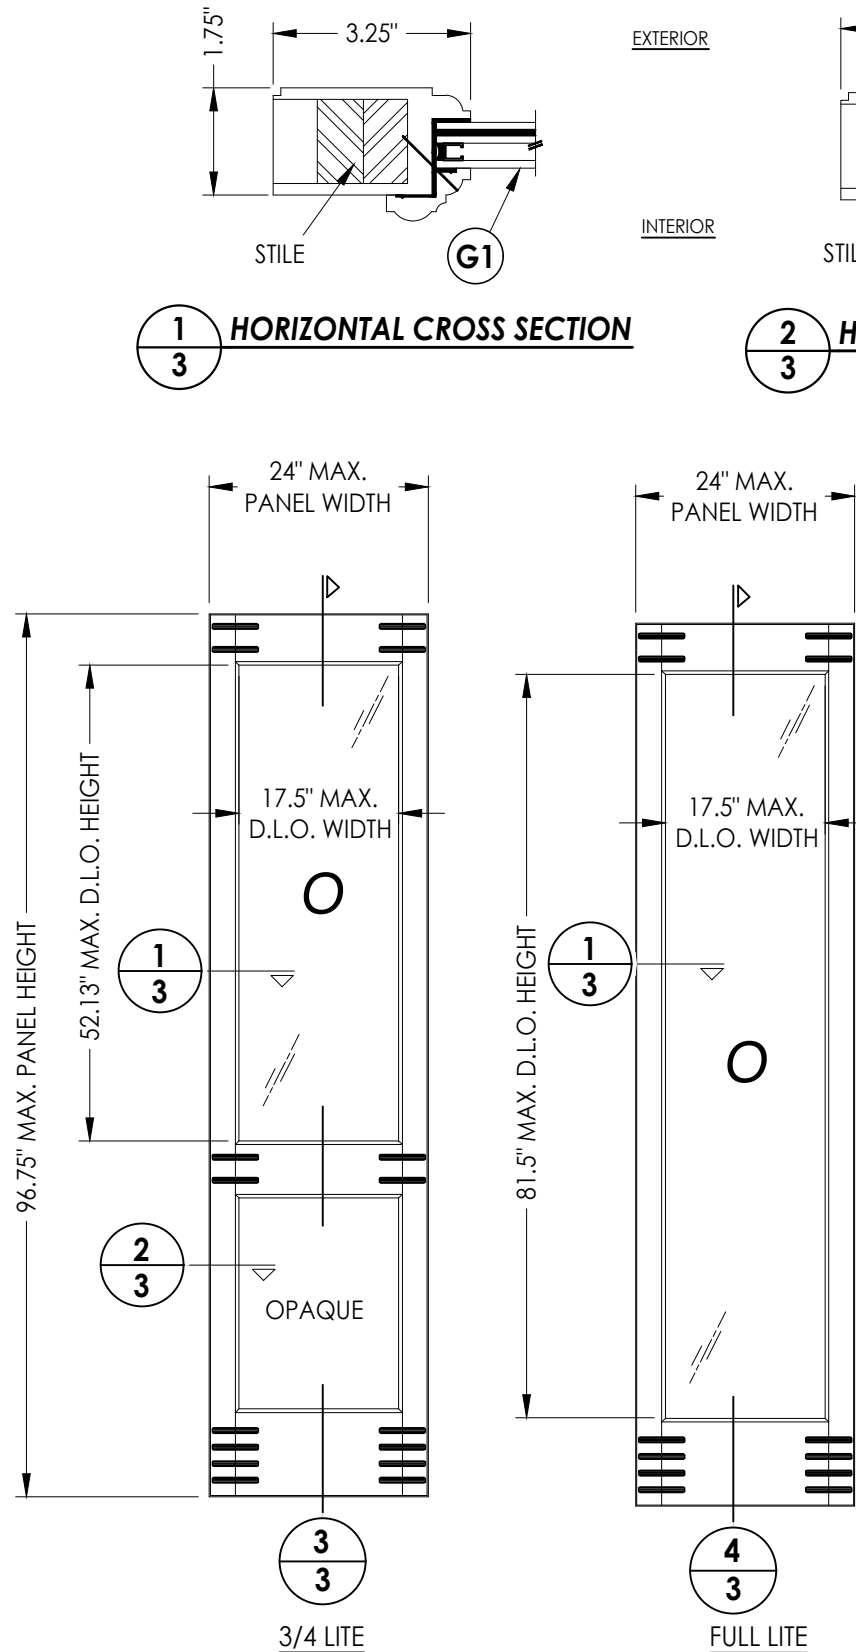


50 WOOD SIDELITE PANEL


WOOD SIDELITE COMPONENTS:  
VENEER/EDGES: CYPRESS (G = 0.42)  
ENGINEERED STAVE CORE: SIPO (UTILE) (G = 0.53)

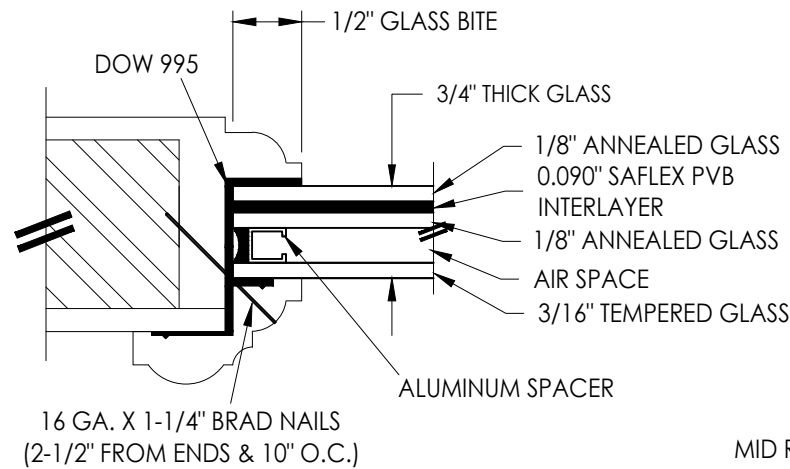


G1 GLAZING DETAIL

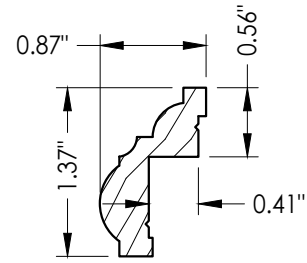


GLAZING BEAD

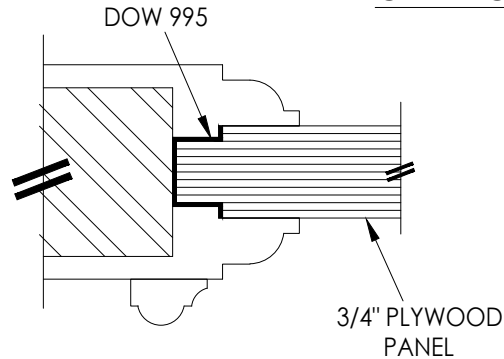

P1 PANEL INFIL DETAIL

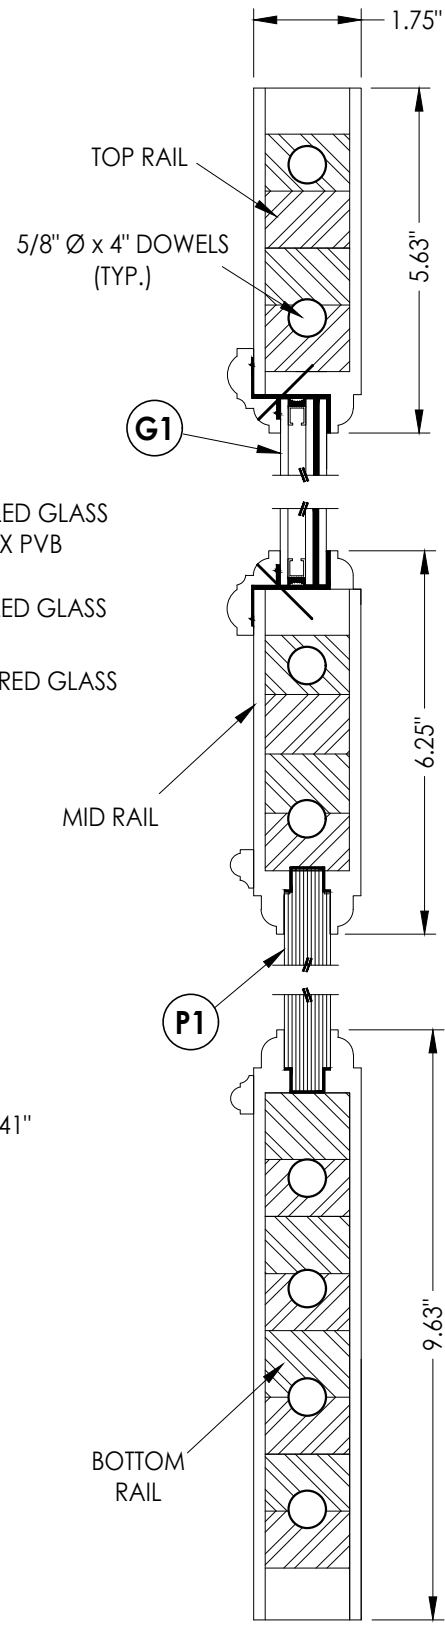





3/3 VERTICAL CROSS SECTION

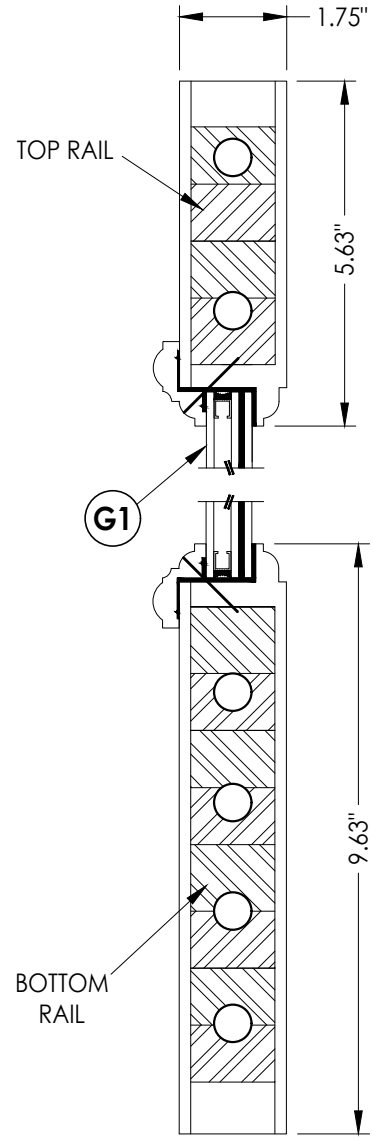

4/3 VERTICAL CROSS SECTION

|                                                               |          |                                                                                                                    |     |
|---------------------------------------------------------------|----------|--------------------------------------------------------------------------------------------------------------------|-----|
| Documents Prepared By:<br>Lyndon F. Schmidt<br>P.E. No. 43409 |          | BUILDING CONSULTANTS, INC.<br>P.O. Box 230, Valrico, FL 33595<br>Phone No.: 813.659.9197<br>FBPE Registry No. 9813 |     |
| PRODUCT:<br>Builders FirstSource<br>WOOD DOOR                 |          | PART OR ASSEMBLY:<br>SIDELITE PANEL<br>DETAILS                                                                     |     |
|                                                               |          | LFS                                                                                                                | BY  |
| 3                                                             | 9/18/23  | UPDATE TO 8TH ED. (2023)                                                                                           | FBC |
| 2                                                             | 8/10/20  | UPDATE TO 7TH ED. (2020)                                                                                           | FBC |
| 1                                                             | 10/12/17 | UPDATE TO 6TH ED. (2017)                                                                                           | FBC |
| NO.                                                           | DATE     |                                                                                                                    |     |
| REVISIONS                                                     |          |                                                                                                                    |     |
| DATE: 5/10/17                                                 |          |                                                                                                                    |     |
| SCALE: N.T.S.                                                 |          |                                                                                                                    |     |
| DWG. BY: JK                                                   |          |                                                                                                                    |     |
| CHK. BY: LFS                                                  |          |                                                                                                                    |     |
| DRAWING NO.: FL-22347.2                                       |          |                                                                                                                    |     |
| SHEET 3 OF 12                                                 |          |                                                                                                                    |     |

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

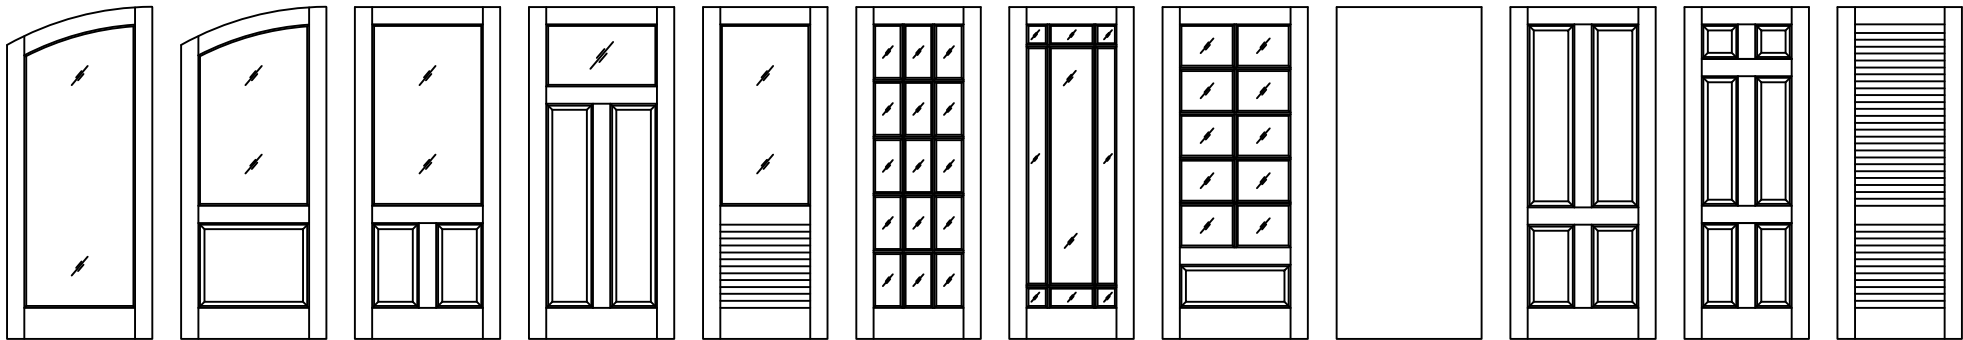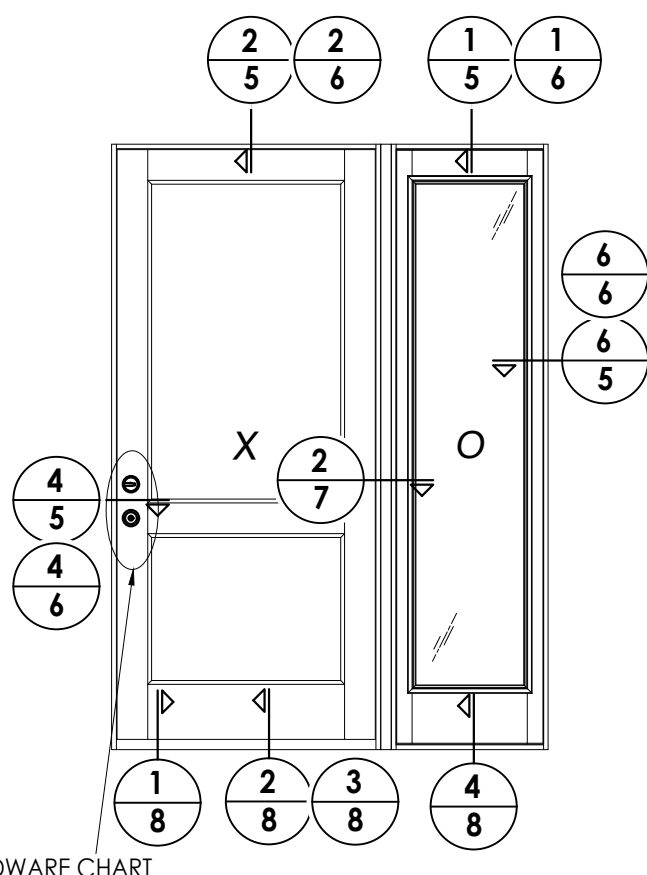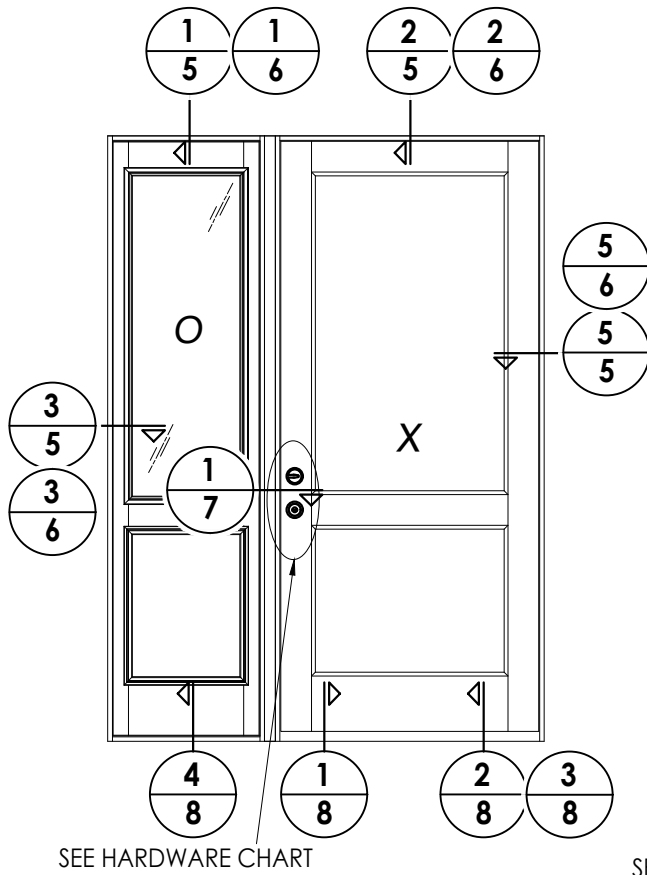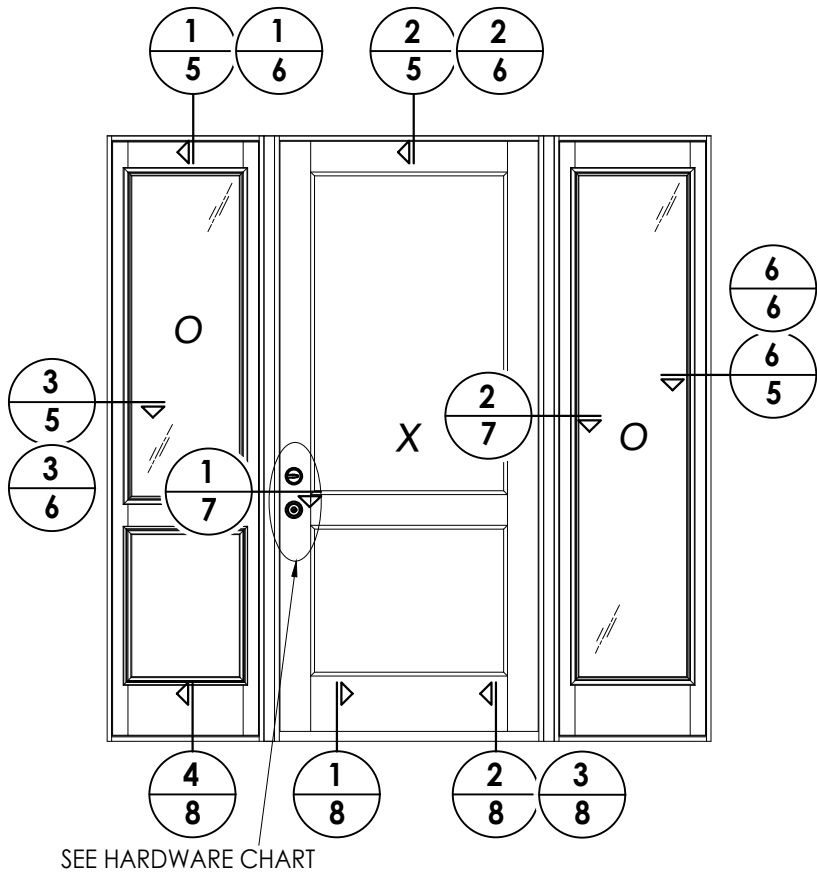

**Builders FirstSource Door Panel Options**  
Panel options shown are for illustration and are representative only.  
Surface applied muntins are used for simulated divided lites shown.

| HARDWARE TABLE |                                                            |
|----------------|------------------------------------------------------------|
| MANUFACTURER   | MODEL                                                      |
| EMTEK          | Morlise: 3545 Entry Set                                    |
| SCHLAGE        | KNOB: F51<br>DEADBOLT: B60N                                |
| KWIKSET        | KNOB: SIGNATURE SERIES<br>DEADBOLT: SIGNATURE SERIES (980) |

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

PRODUCT:  
Builders FirstSource  
WOOD DOOR

PART OR ASSEMBLY:  
ELEVATIONS

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-22347.2


SHEET 4 OF 12

REVISIONS


| NO. | DATE     | BY                           |
|-----|----------|------------------------------|
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) FBC |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) FBC |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) FBC |

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

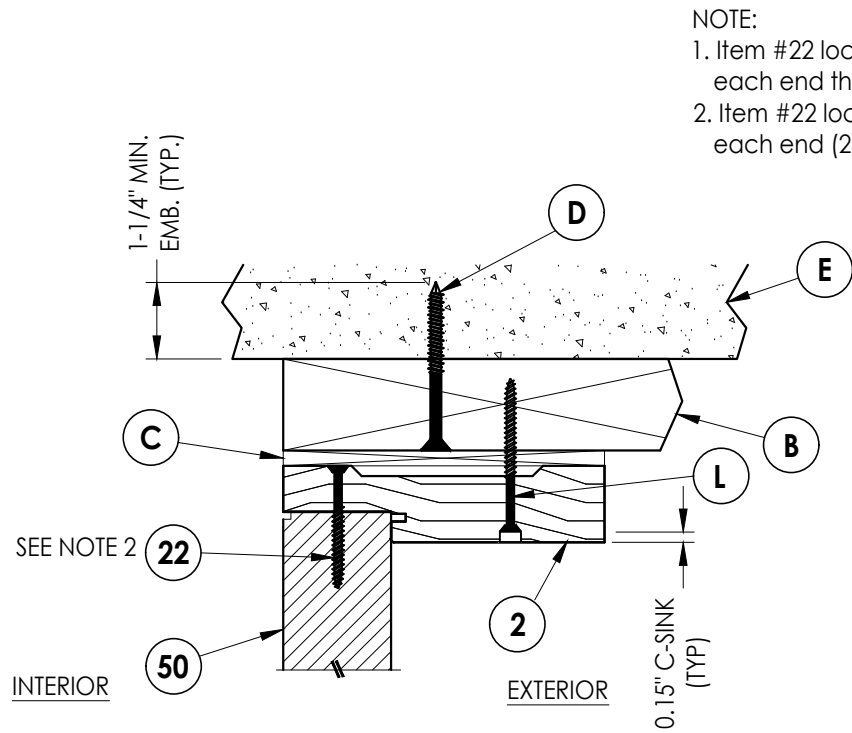


**1** **VERTICAL CROSS SECTION**  
**5** Shown w/ 2X Buck  
Inswing shown (Outswing similar)

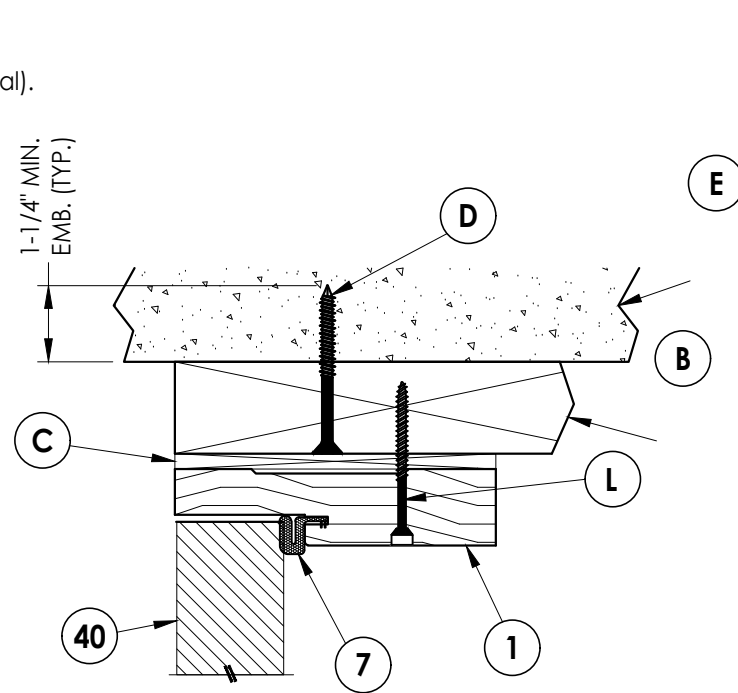


**2** **VERTICAL CROSS SECTION**  
**5** Shown w/ 2X Buck  
Inswing shown (Outswing similar)

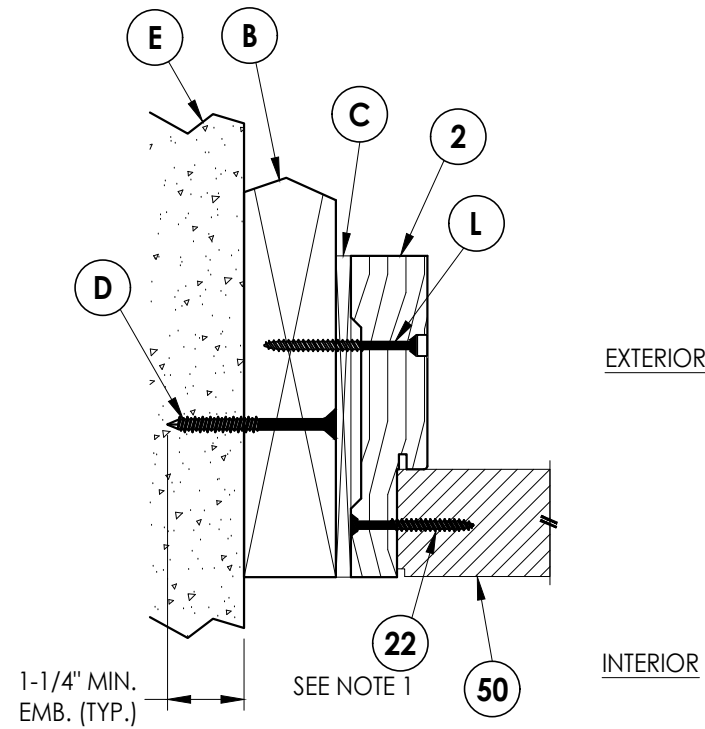


**3** **HORIZONTAL CROSS SECTION**  
**5** Shown w/ 2X Buck  
Inswing shown (Outswing similar)

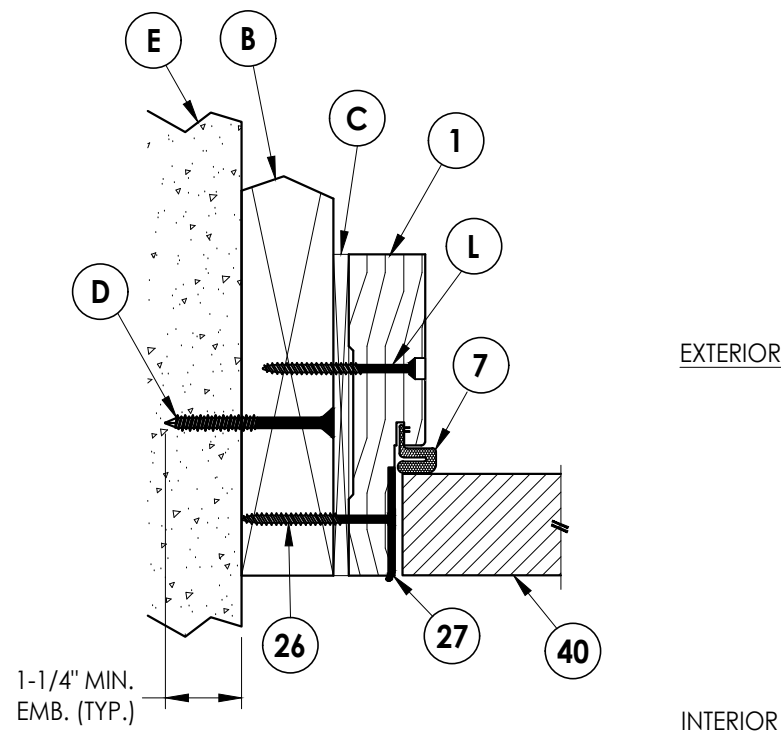

**4** **HORIZONTAL CROSS SECTION**  
**5** Shown w/ 2X Buck  
Inswing shown (Outswing similar)

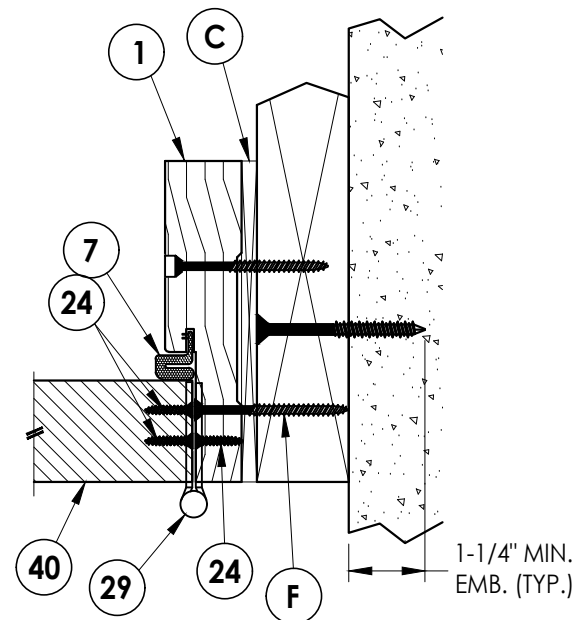

**5** **HORIZONTAL CROSS SECTION**  
**5** Shown w/ 2X Buck  
Inswing shown (Outswing similar)

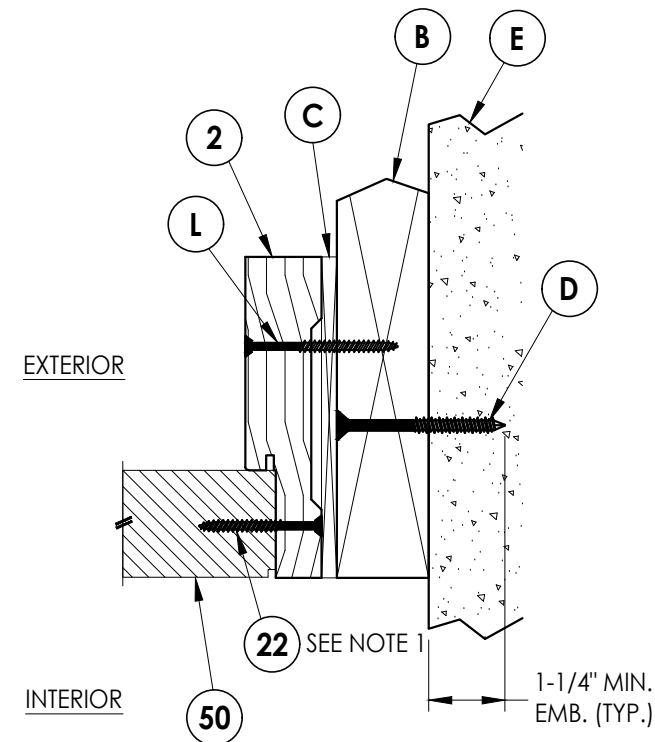

**6** **HORIZONTAL CROSS SECTION**  
**5** Shown w/ 2X Buck  
Inswing shown (Outswing similar)

NOTE:  
1. Item #22 located 4" from  
each end then 7 more (9 total).  
2. Item #22 located 6" from  
each end (2 total).

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**Building Consultants, Inc.**  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT:  
Builders FirstSource  
WOOD DOOR

PART OR ASSEMBLY:  
HORIZONTAL & VERTICAL  
CROSS SECTIONS (2X BUCK)

| NO. | DATE     | REVISIONS                |     |             |  |
|-----|----------|--------------------------|-----|-------------|--|
|     |          | DATE                     | BY  | DESCRIPTION |  |
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) | FBC | LFS         |  |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) | FBC | LFS         |  |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) | FBC | LFS         |  |

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-22347.2


SHEET 5 OF 12

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg


NOTE:  
1. Item #22 located 4" from  
each end then 7 more (9 total).  
2. Item #22 located 6" from  
each end (2 total).

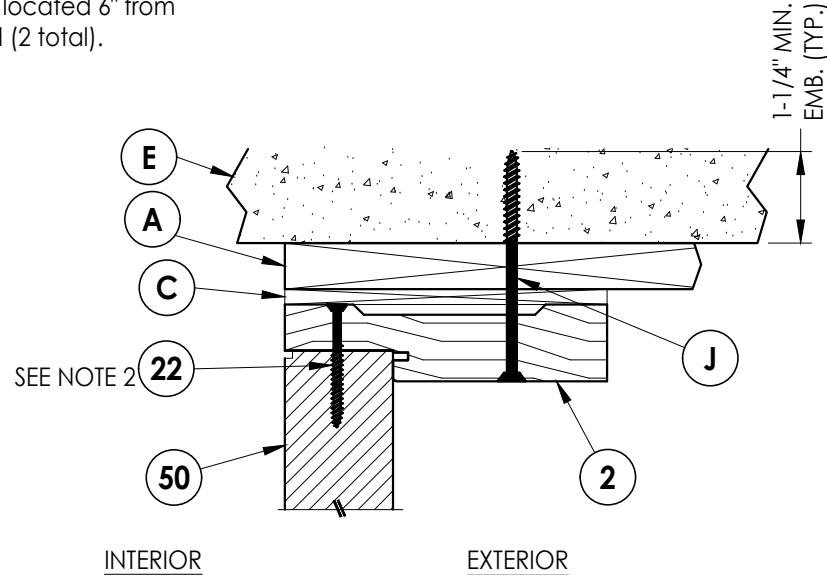


**1**  
**6** **VERTICAL CROSS SECTION**  
Shown w/ 1X Buck  
Inswing shown (Outswing similar)

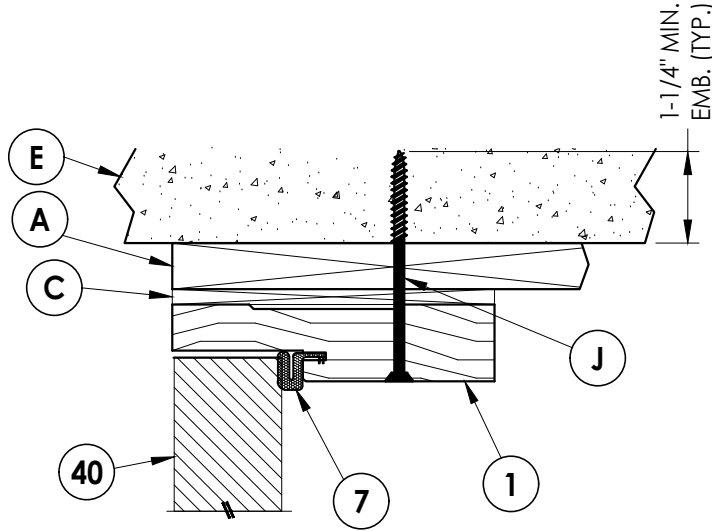


**2**  
**6** **VERTICAL CROSS SECTION**  
Shown w/ 1X Buck  
Inswing shown (Outswing similar)

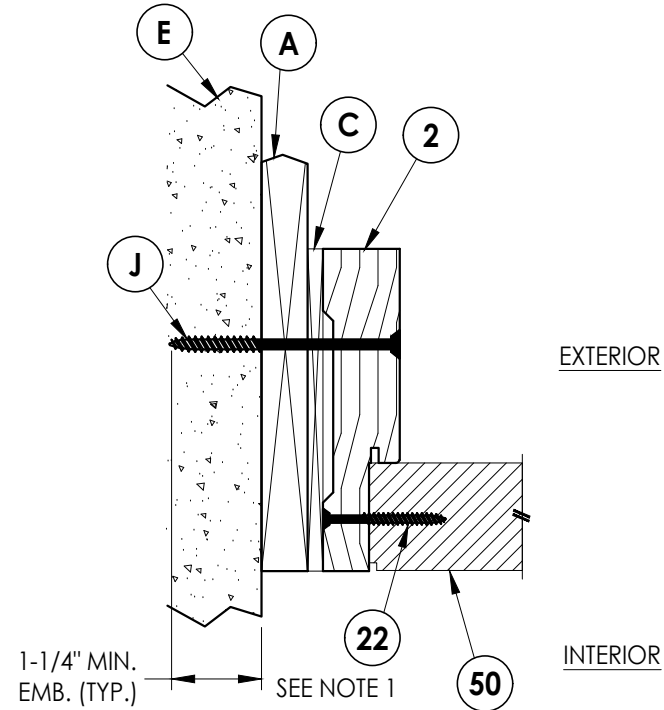


**3**  
**6** **HORIZONTAL CROSS SECTION**  
Shown w/ 1X Buck  
Inswing shown (Outswing similar)

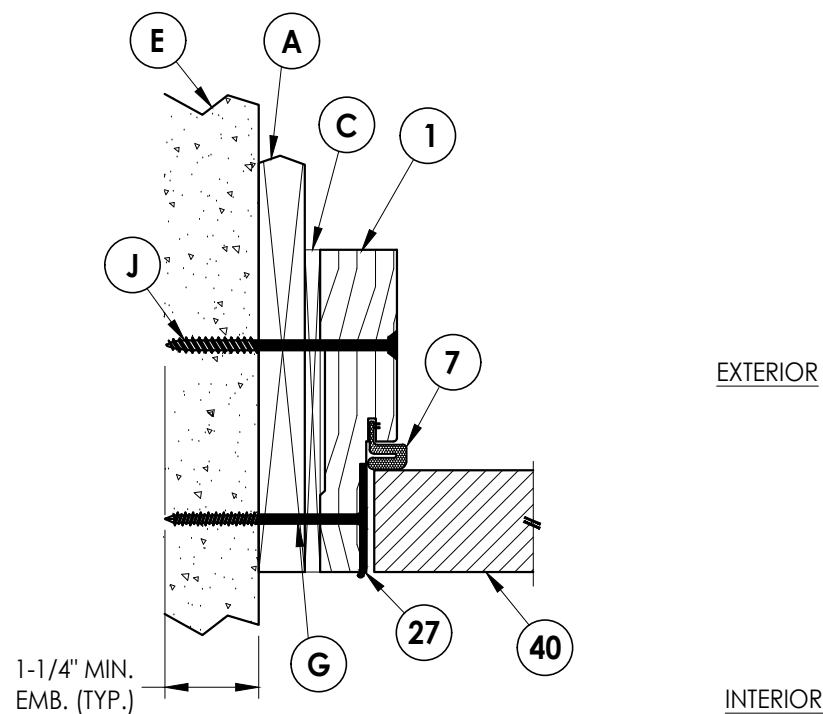

**4**  
**6** **HORIZONTAL CROSS SECTION**  
Shown w/ 1X Buck  
Inswing shown (Outswing similar)

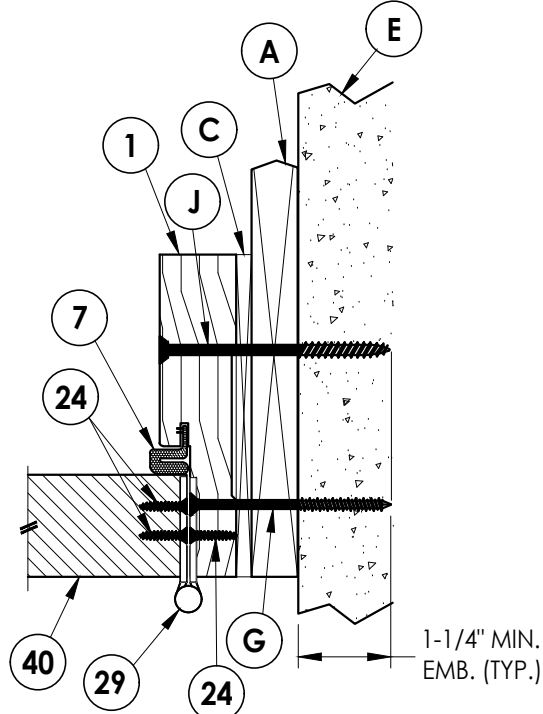

**5**  
**6** **HORIZONTAL CROSS SECTION**  
Shown w/ 1X Buck  
Inswing shown (Outswing similar)

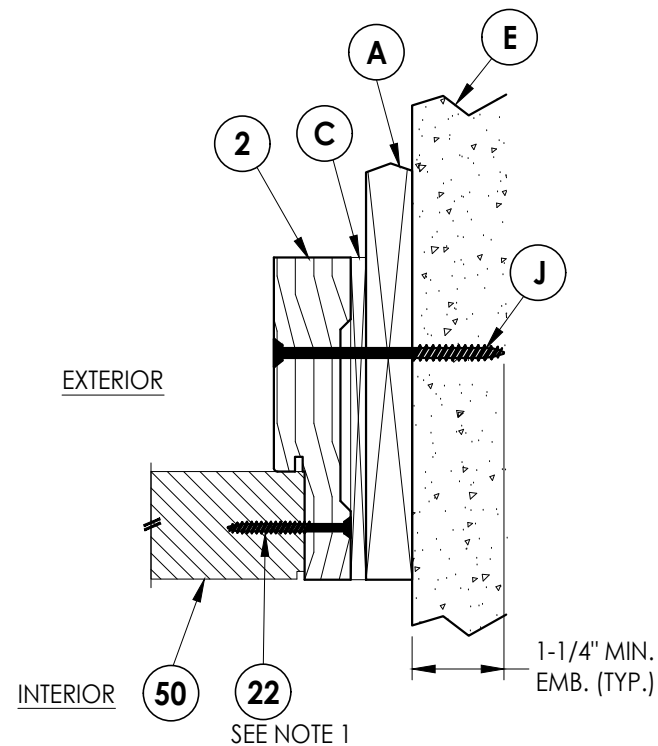

**6**  
**6** **HORIZONTAL CROSS SECTION**  
Shown w/ 1X Buck  
Inswing shown (Outswing similar)

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT:  
Builders FirstSource  
WOOD DOOR

PART OR ASSEMBLY:  
HORIZONTAL & VERTICAL  
CROSS SECTIONS (1X BUCK)

| NO. | DATE     | REVISIONS                        |
|-----|----------|----------------------------------|
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) FBC LFS |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) FBC LFS |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) FBC LFS |

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK



CHK. BY: LFS

DRAWING NO.:

FL-22347.2

SHEET 6 OF 12





NOTE:  
1. Item #22 located 4" from  
each end then 7 more (9 total).

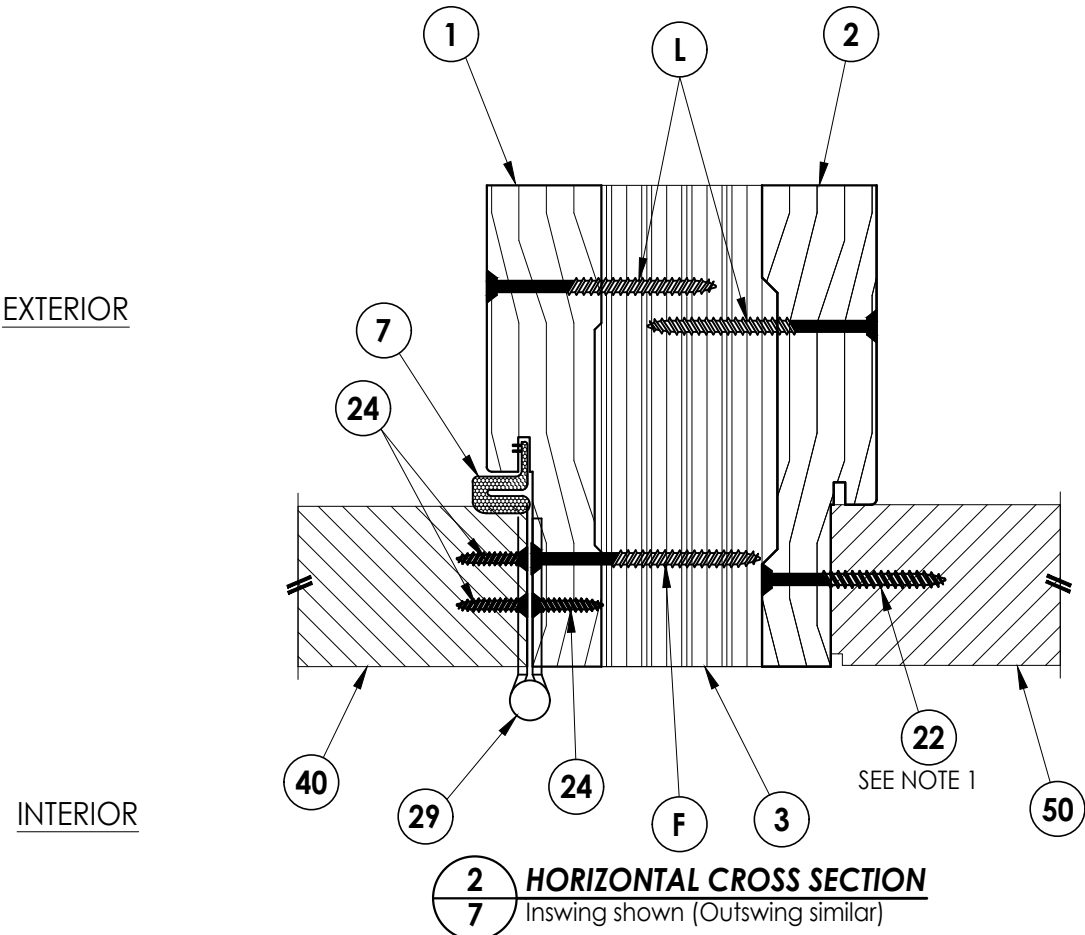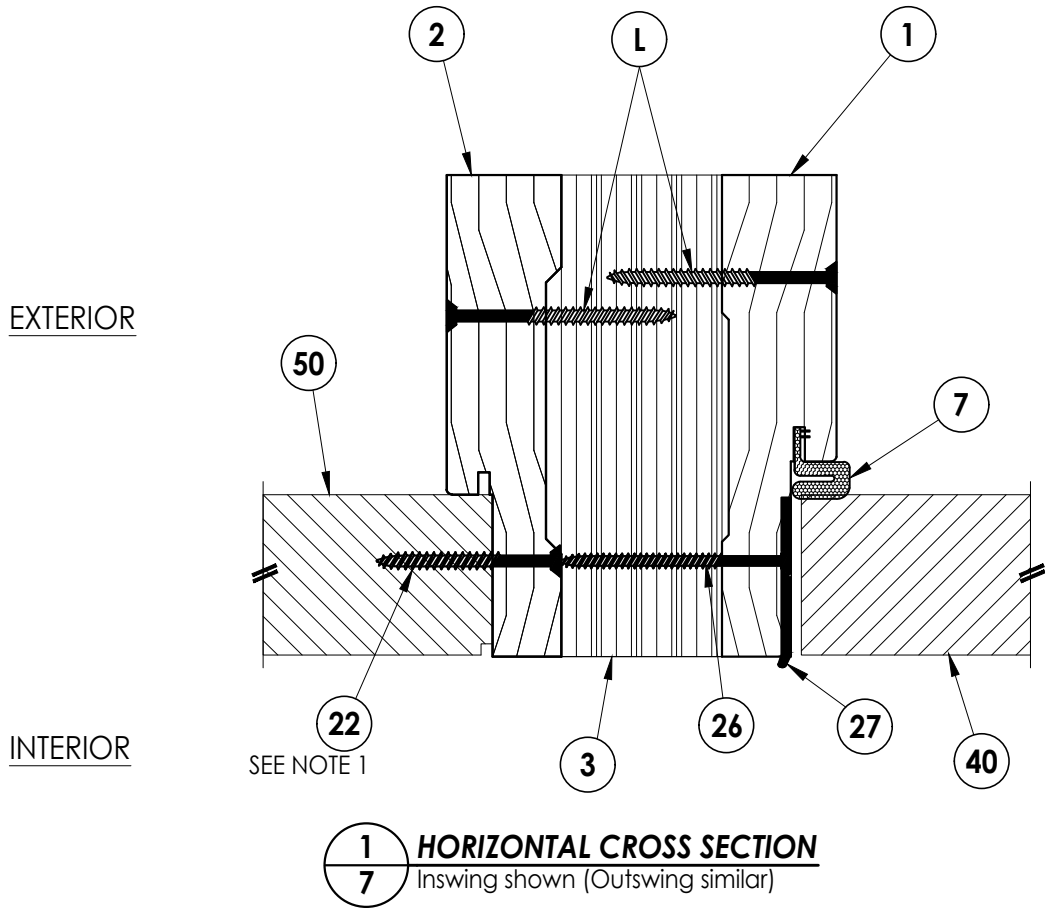

|                                                               |          |                          |     |     |                                                                                                                    |  |  |  |  |
|---------------------------------------------------------------|----------|--------------------------|-----|-----|--------------------------------------------------------------------------------------------------------------------|--|--|--|--|
| Documents Prepared By:<br>Lyndon F. Schmidt<br>P.E. No. 43409 |          |                          |     |     | BUILDING CONSULTANTS, INC.<br>P.O. Box 230, Valrico, FL 33595<br>Phone No.: 813.659.9197<br>FBPE Registry No. 9813 |  |  |  |  |
| PRODUCT:<br>Builders FirstSource<br>WOOD DOOR                 |          |                          |     |     | PART OR ASSEMBLY:<br>HORIZONTAL<br>CROSS SECTIONS                                                                  |  |  |  |  |
|                                                               |          |                          |     |     |                                                                                                                    |  |  |  |  |
|                                                               |          |                          |     |     |                                                                                                                    |  |  |  |  |
|                                                               |          |                          |     |     |                                                                                                                    |  |  |  |  |
| 3                                                             | 9/18/23  | UPDATE TO 8TH ED. (2023) | FBC | LFS |                                                                                                                    |  |  |  |  |
| 2                                                             | 8/10/20  | UPDATE TO 7TH ED. (2020) | FBC | LFS |                                                                                                                    |  |  |  |  |
| 1                                                             | 10/12/17 | UPDATE TO 6TH ED. (2017) | FBC | LFS |                                                                                                                    |  |  |  |  |
| NO.                                                           | DATE     |                          |     | BY  |                                                                                                                    |  |  |  |  |
|                                                               |          |                          |     |     | REVISIONS                                                                                                          |  |  |  |  |
| DATE: 5/10/17                                                 |          |                          |     |     |                                                                                                                    |  |  |  |  |
| SCALE: N.T.S.                                                 |          |                          |     |     |                                                                                                                    |  |  |  |  |
| DWG. BY: JK                                                   |          |                          |     |     |                                                                                                                    |  |  |  |  |
| CHK. BY: LFS                                                  |          |                          |     |     |                                                                                                                    |  |  |  |  |
| DRAWING NO.:<br>FL-22347.2                                    |          |                          |     |     |                                                                                                                    |  |  |  |  |
| SHEET 7 OF 12                                                 |          |                          |     |     |                                                                                                                    |  |  |  |  |

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

NOTE:  
1. Item #22 located 6" from  
each end (2 total).

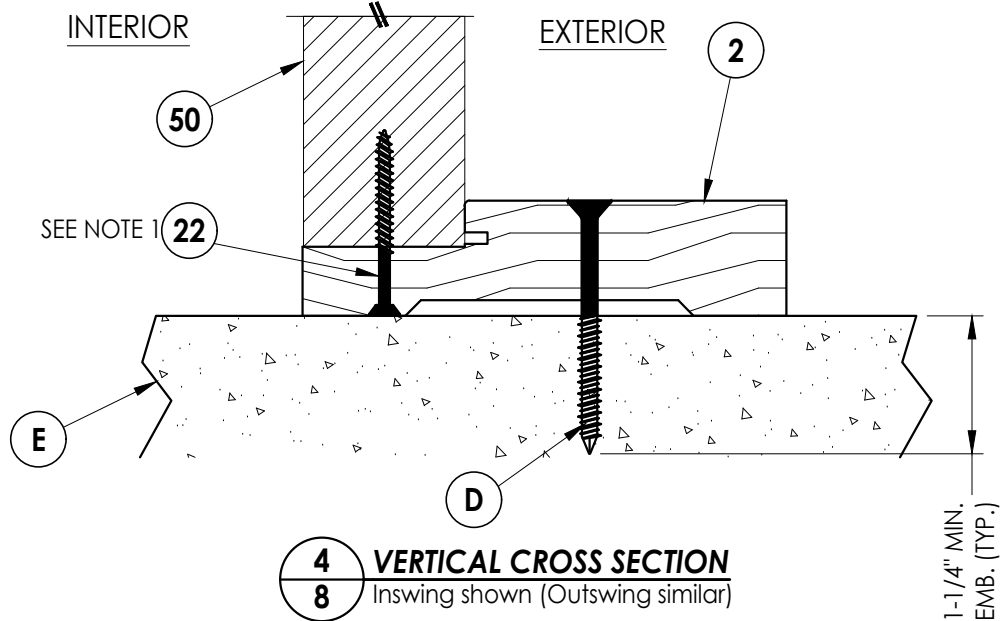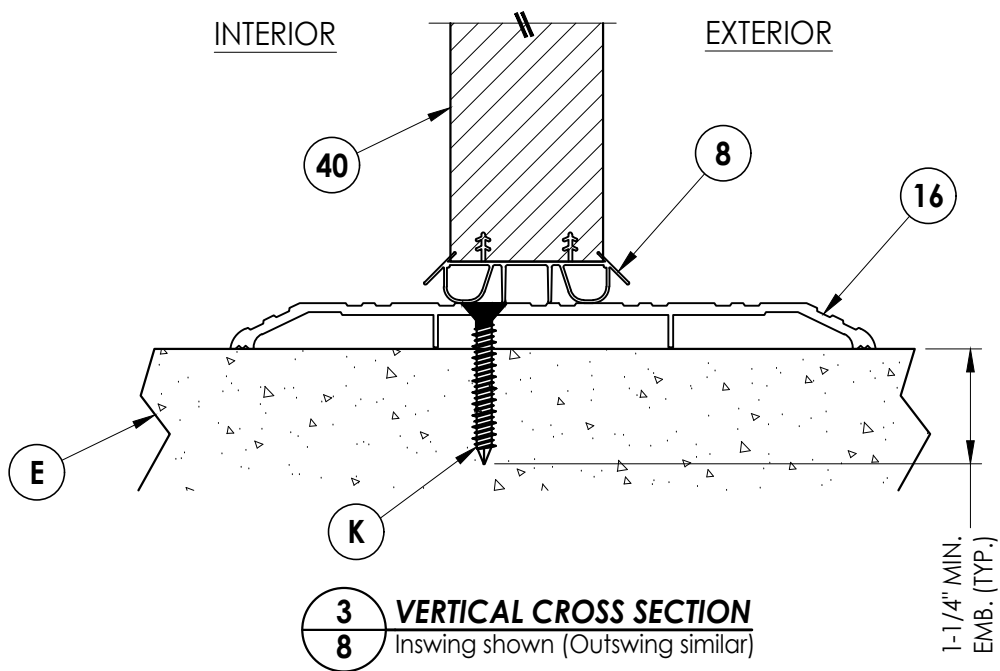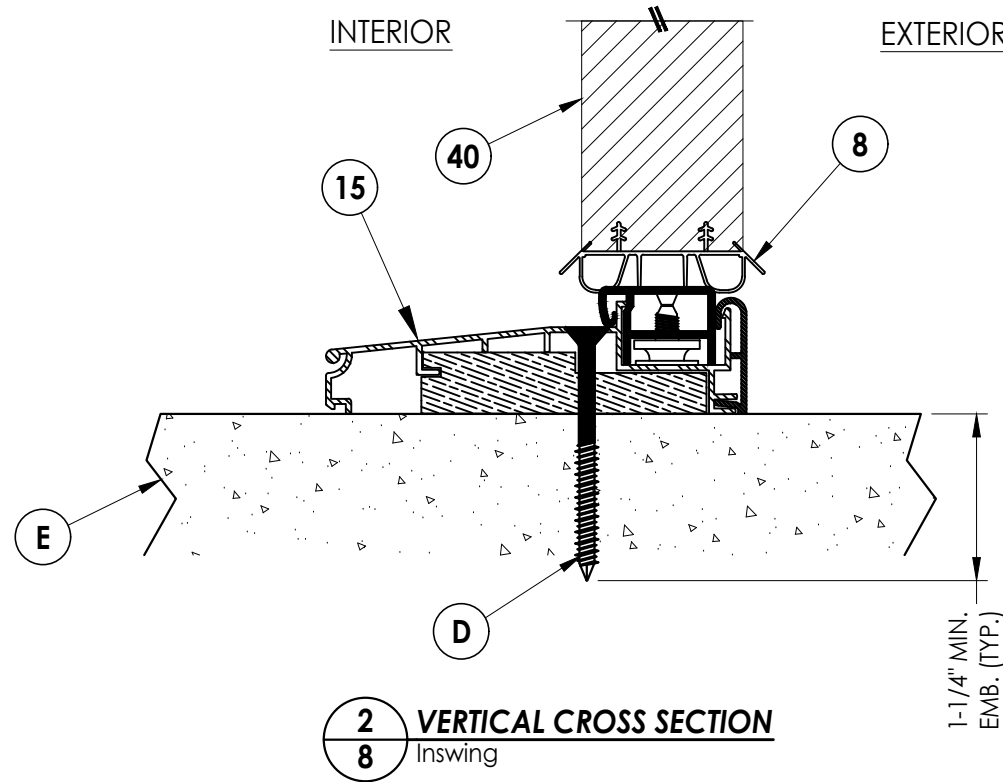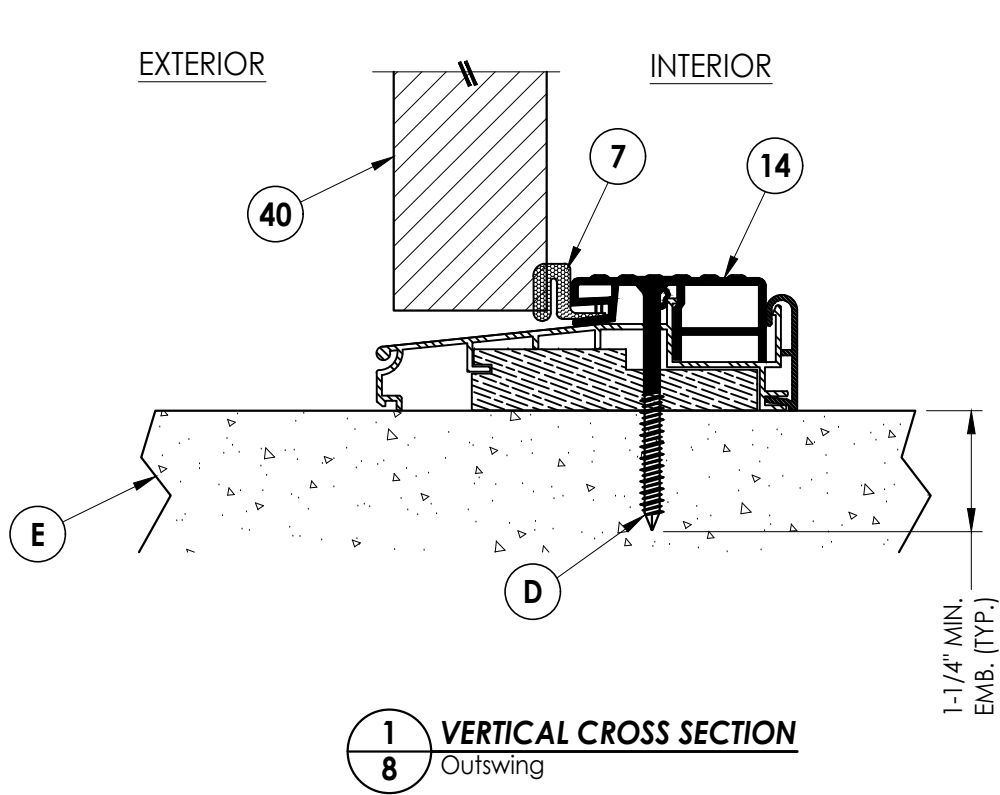

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

*RW* BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT:  
Builders FirstSource  
WOOD DOOR

PART OR ASSEMBLY:  
VERTICAL CROSS  
SECTIONS (THRESHOLD)

| NO. | DATE     | REVISIONS                |      |             |
|-----|----------|--------------------------|------|-------------|
|     |          | BY                       | DATE | DESCRIPTION |
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) | FBC  | LFS         |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) | FBC  | LFS         |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) | FBC  | LFS         |

DATE: 5/10/17



SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-22347.2


SHEET 8 OF 12

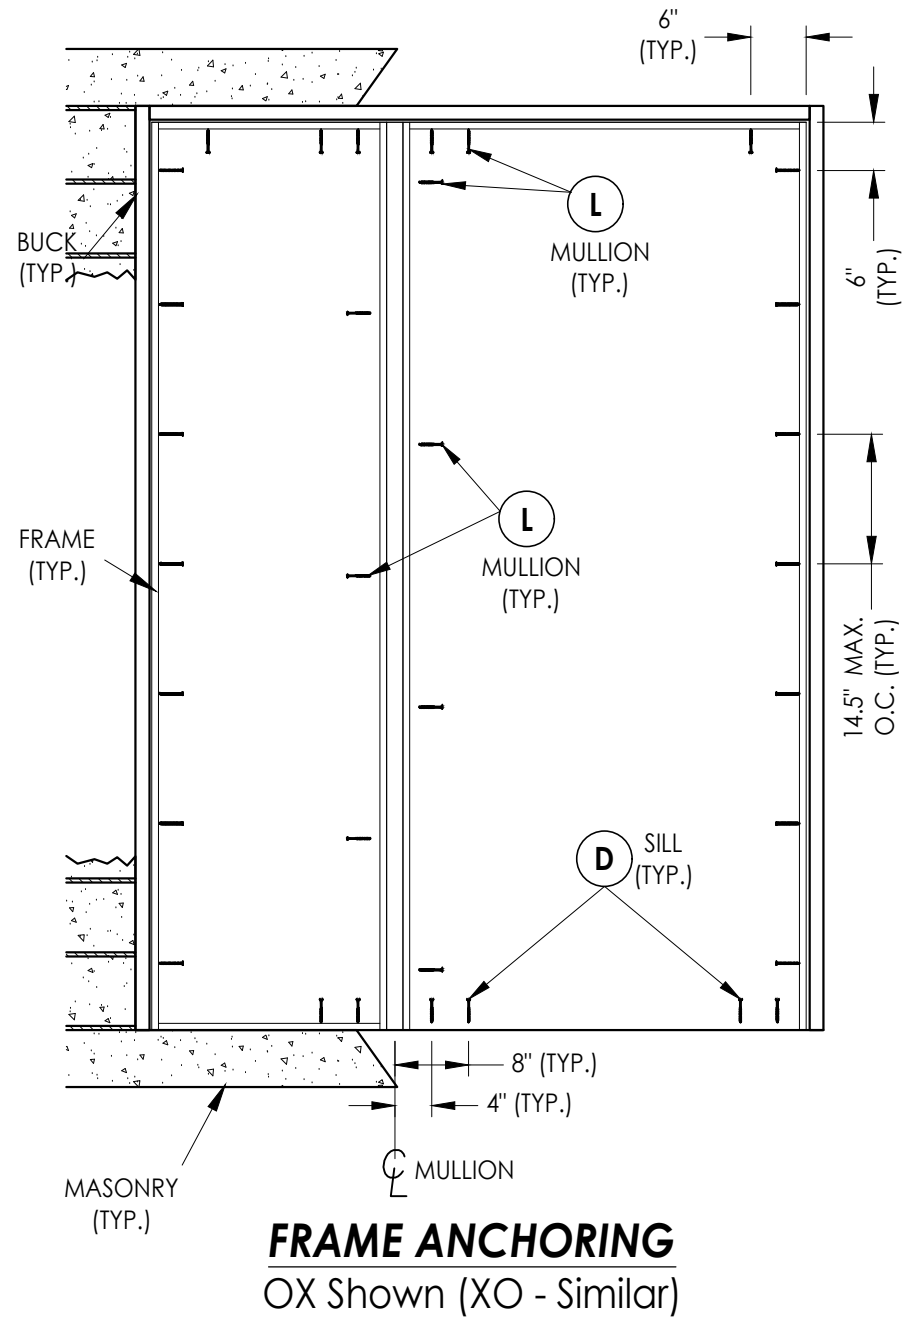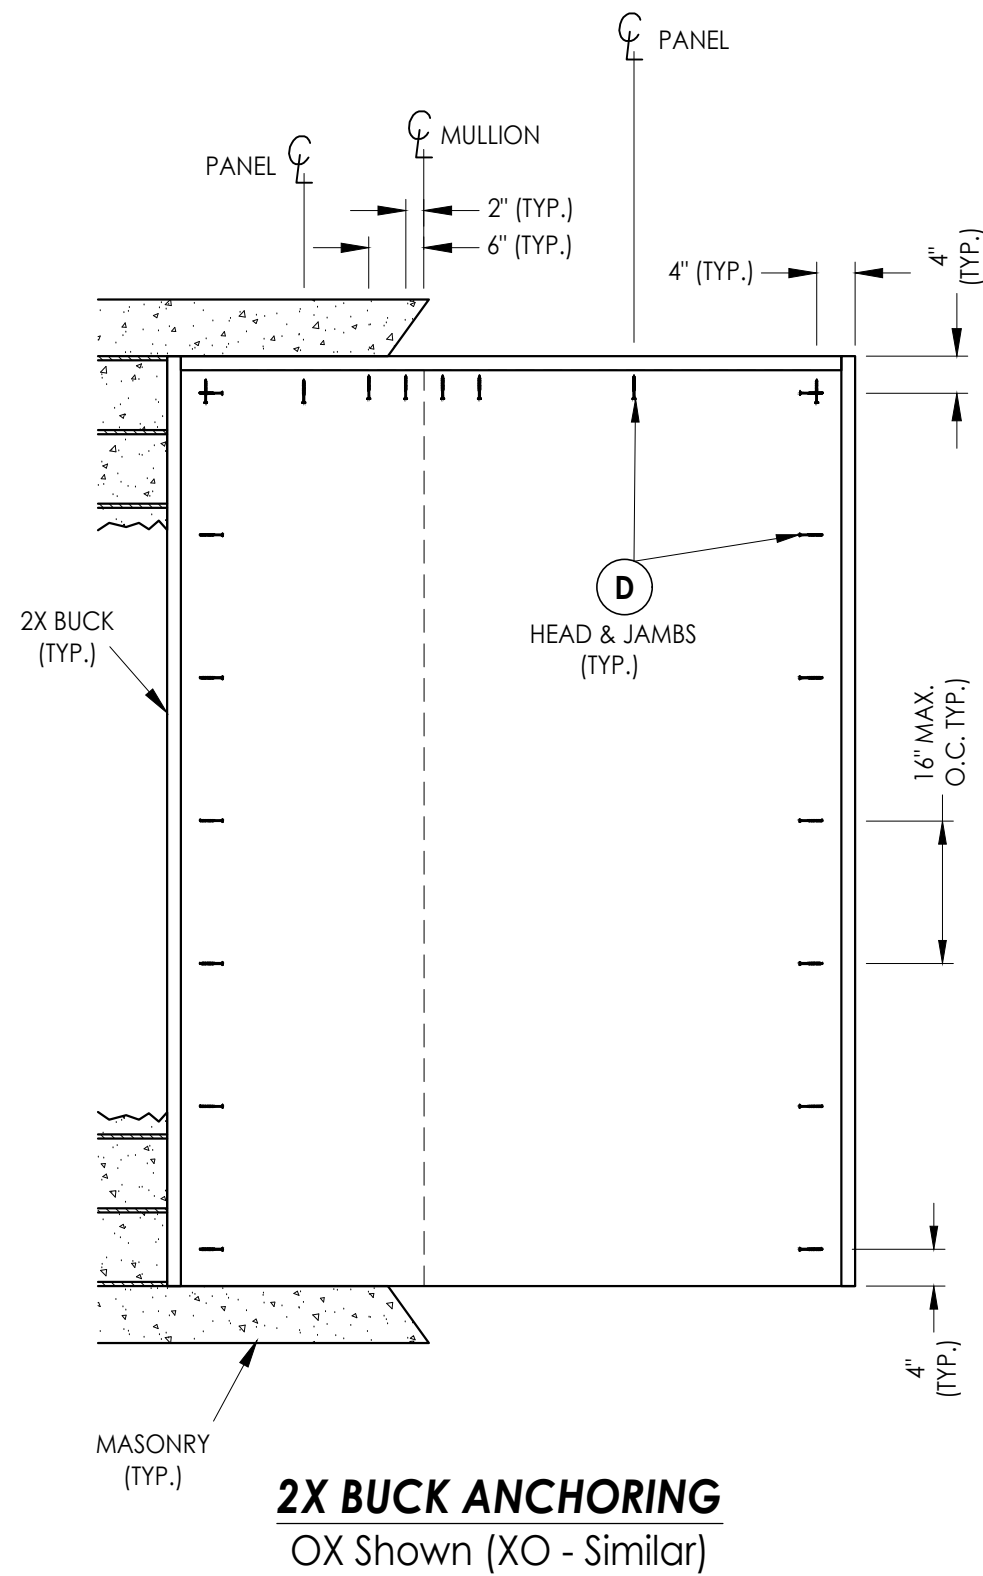


NOTE:  
1. ALL FRAME CORNERS SECURED WITH (3) #8 X 2-1/2" FH DEEP THREAD WOOD SCREWS @ SILL.

[illegible]

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

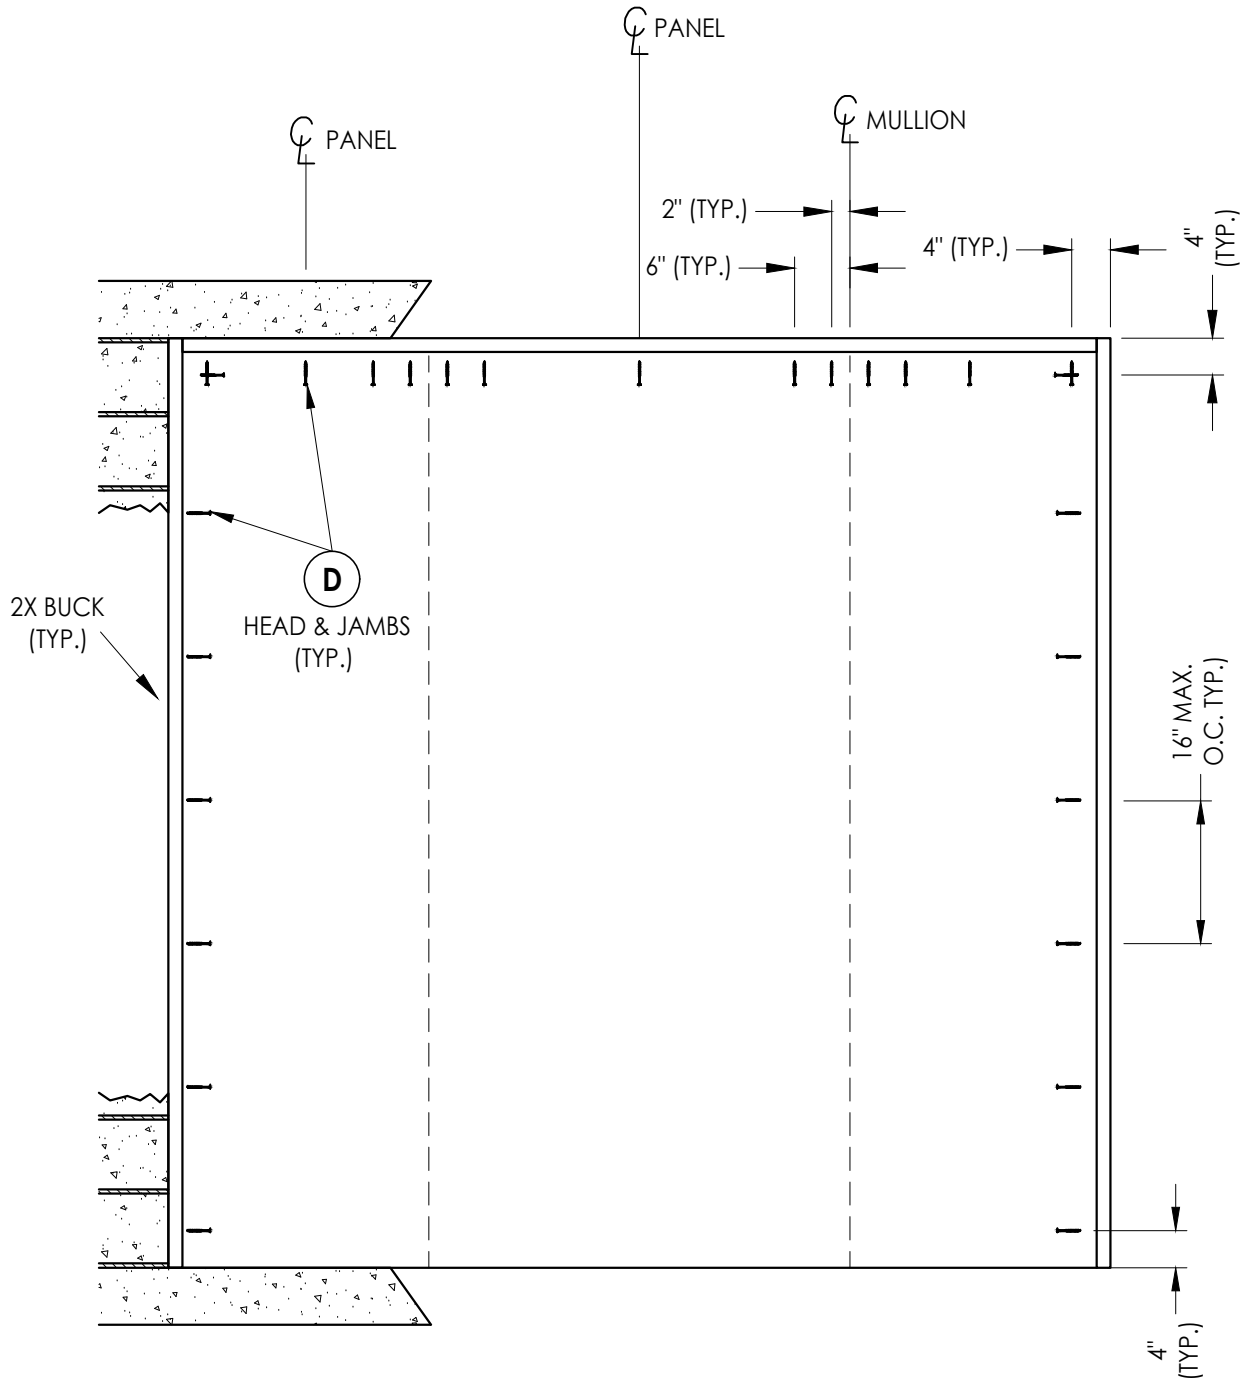

**2X BUCK ANCHORING**  
OXO

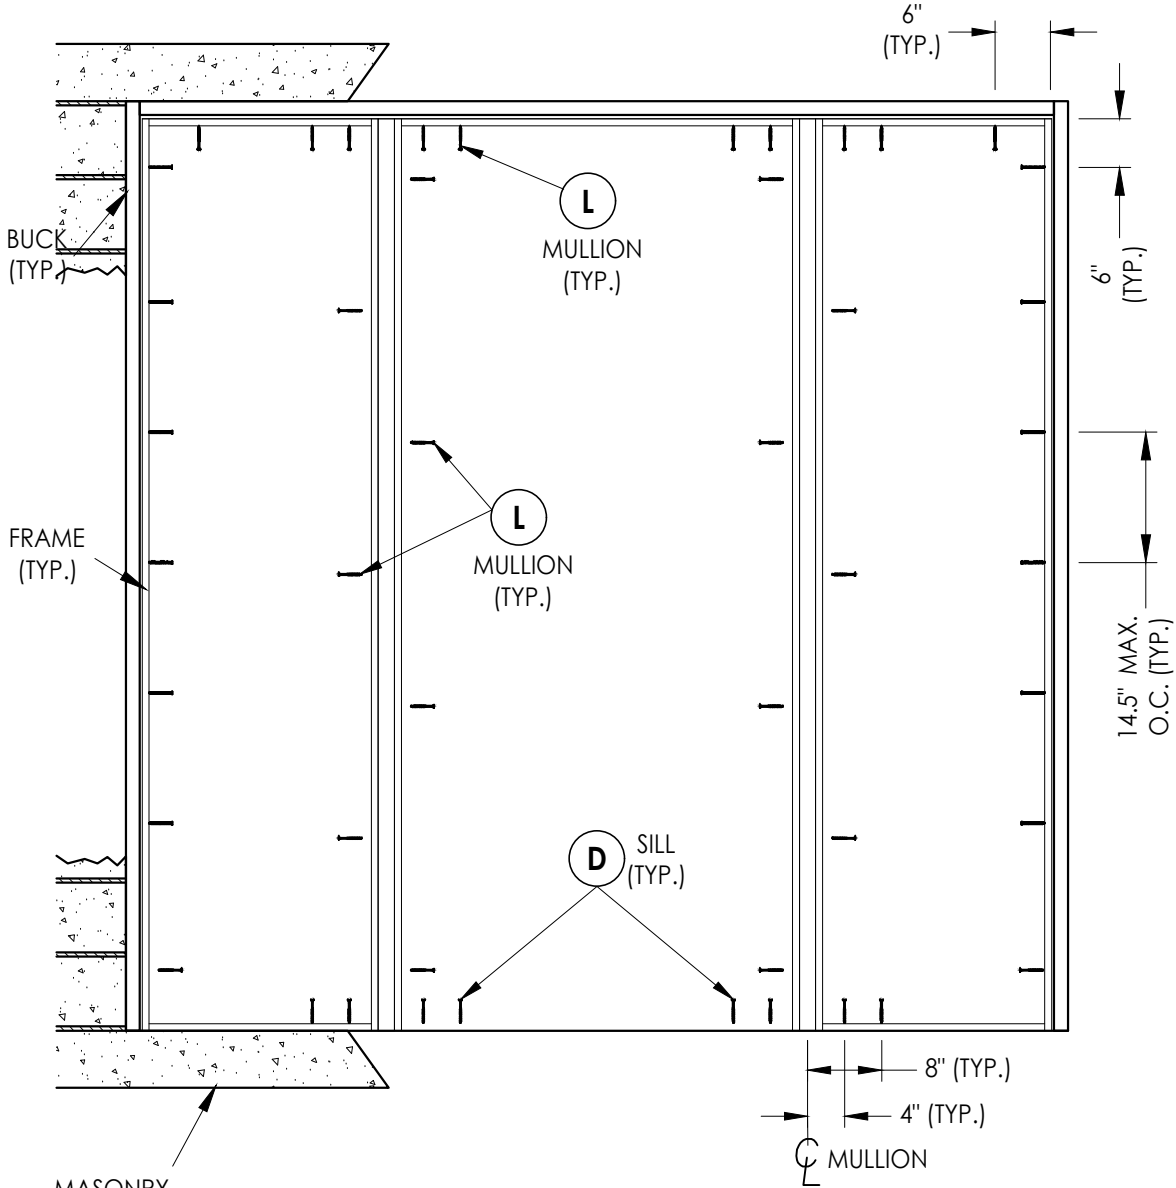


**FRAME ANCHORING**  
OXO


NOTE:  
1. ALL FRAME CORNERS SECURED WITH (3) #8 X 2-1/2" FH DEEP THREAD WOOD SCREWS @ SILL.

|                                                               |  |                                                      |          |                                                                                                                              |     |    |  |
|---------------------------------------------------------------|--|------------------------------------------------------|----------|------------------------------------------------------------------------------------------------------------------------------|-----|----|--|
| Documents Prepared By:<br>Lyndon F. Schmidt<br>P.E. No. 43409 |  |                                                      |          | <b>RW</b> BUILDING CONSULTANTS, INC.<br>P.O. Box 230, Valrico, FL 33595<br>Phone No.: 813.659.9197<br>FBPE Registry No. 9813 |     |    |  |
| PRODUCT:<br>Builders FirstSource<br>WOOD DOOR                 |  | PART OR ASSEMBLY:<br>BUCK & FRAME ANCHORING<br>(OXO) |          |                                                                                                                              |     |    |  |
|                                                               |  |                                                      | LFS      |                                                                                                                              |     |    |  |
|                                                               |  | 3                                                    | 9/18/23  | UPDATE TO 8TH ED. (2023)                                                                                                     | FBC |    |  |
|                                                               |  | 2                                                    | 8/10/20  | UPDATE TO 7TH ED. (2020)                                                                                                     | FBC |    |  |
|                                                               |  | 1                                                    | 10/12/17 | UPDATE TO 6TH ED. (2017)                                                                                                     | FBC |    |  |
|                                                               |  | NO.                                                  | DATE     |                                                                                                                              |     | BY |  |
|                                                               |  |                                                      |          | REVISIONS                                                                                                                    |     |    |  |
| DATE: 5/10/17                                                 |  |                                                      |          |                                                                                                                              |     |    |  |
| SCALE: N.T.S.                                                 |  |                                                      |          |                                                                                                                              |     |    |  |
| DWG. BY: JK                                                   |  |                                                      |          |                                                                                                                              |     |    |  |
| CHK. BY: LFS                                                  |  |                                                      |          |                                                                                                                              |     |    |  |
| DRAWING NO.: FL-22347.2                                       |  |                                                      |          |                                                                                                                              |     |    |  |
| SHEET 10 OF 12                                                |  |                                                      |          |                                                                                                                              |     |    |  |


Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

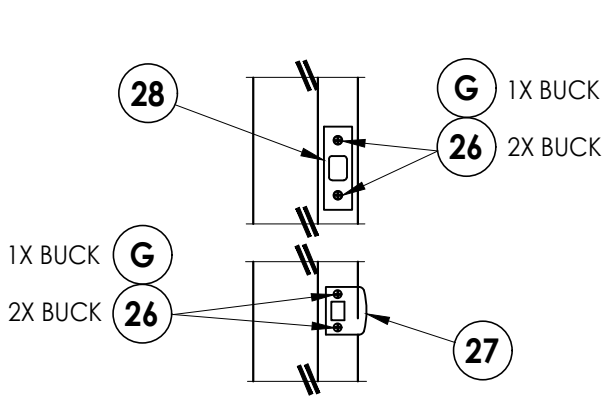


**LATCH & DEADBOLT STRIKE DETAIL**  
SCHLAGE

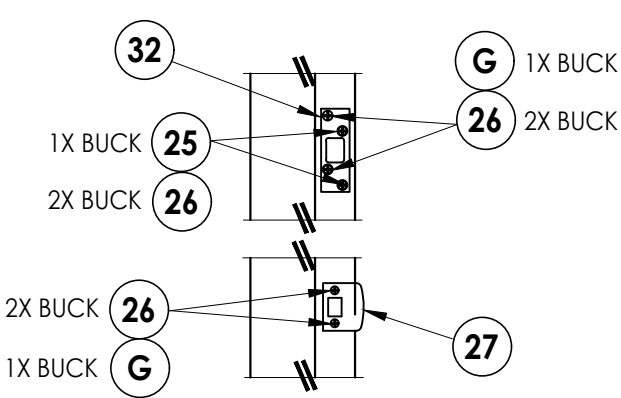


**LATCH & DEADBOLT STRIKE DETAIL**  
KWIKSET

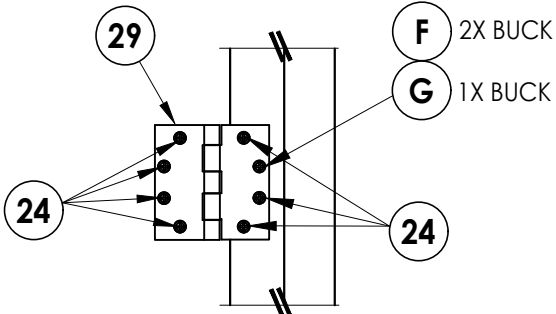


**HINGE DETAIL**

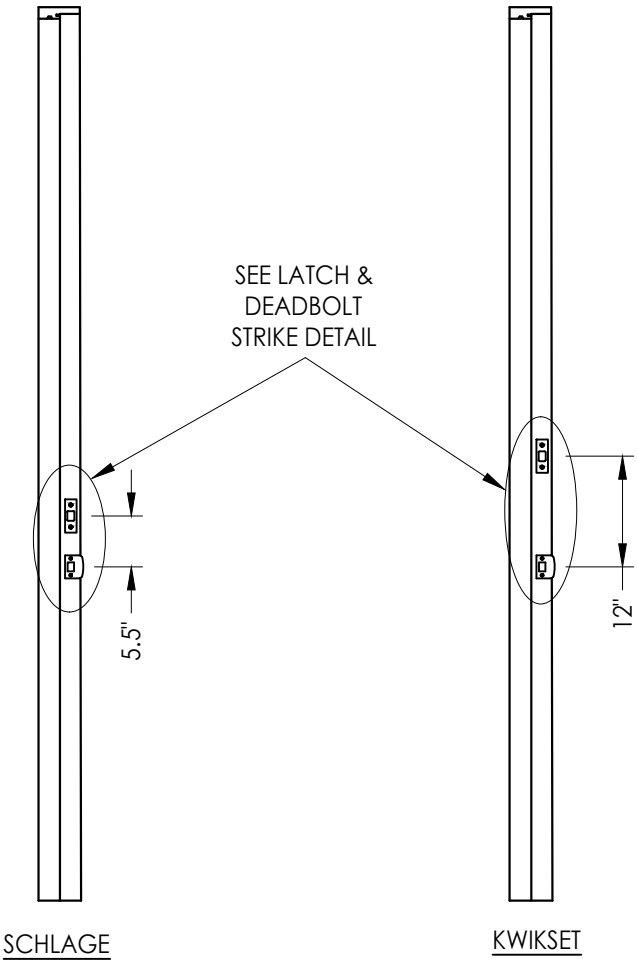

**LATCH & DEADBOLT DETAILS**

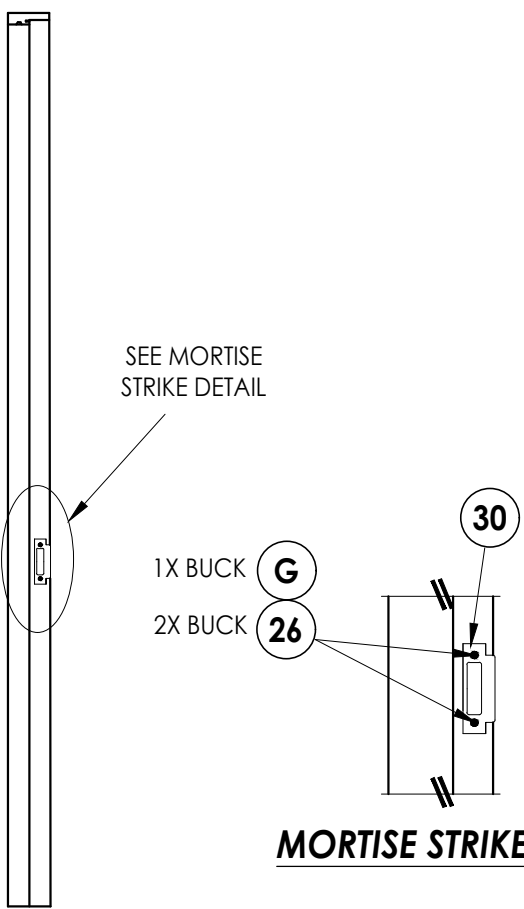

**MORTISE LOCK DETAILS**

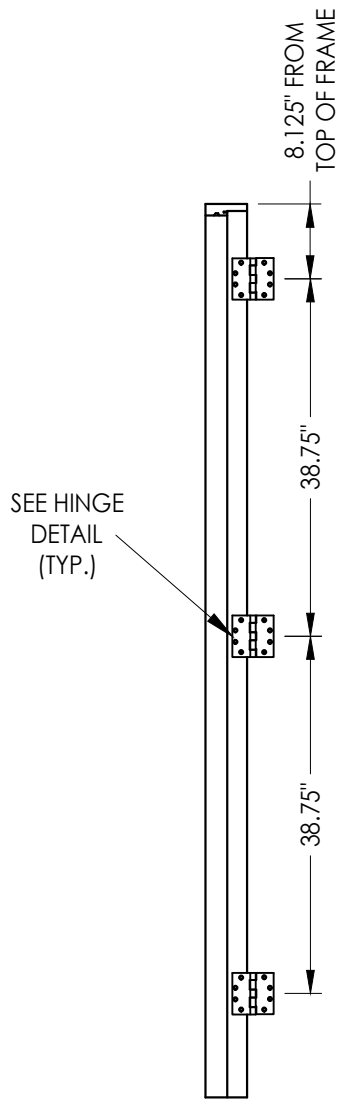

**HINGE JAMB**

| NO. |          | DATE                     | REVISIONS |     |  |  |
|-----|----------|--------------------------|-----------|-----|--|--|
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) | FBC       | LFS |  |  |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) | FBC       | LFS |  |  |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) | FBC       | LFS |  |  |
|     |          |                          |           | BY  |  |  |

DATE: 5/10/17  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-22347.2  
SHEET 11 OF 12

PRODUCT: Builders FirstSource WOOD DOOR  
PART OR ASSEMBLY: HARDWARE DETAILS

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409  
*RW* BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Builders FirstSource\FL-22347\FL-22347.1-3.dwg

| BILL OF MATERIALS |                                                                                                |           |
|-------------------|------------------------------------------------------------------------------------------------|-----------|
| ITEM #            | DESCRIPTION                                                                                    | MATERIAL  |
| A                 | 1X BUCK (SG >= 0.42)                                                                           | WOOD      |
| B                 | 2X BUCK (SG >= 0.42)                                                                           | WOOD      |
| C                 | 1/4" MAX. SHIM SPACE                                                                           | -         |
| D                 | 1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW                                                 | STEEL     |
| E                 | MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90 | CONCRETE  |
| F                 | #12 X 2-1/2" PFH WOOD SCREW                                                                    | STEEL     |
| G                 | 3/16" X 3-1/4" PFH ITW CONCRETE SCREW                                                          | STEEL     |
| J                 | 1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW                                                 | STEEL     |
| L                 | #10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)                                             | STEEL     |
| K                 | 1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW                                                 | STEEL     |
| 1                 | JAMB (Door)                                                                                    | WOOD      |
| 2                 | JAMB (Sidelite)                                                                                | WOOD      |
| 3                 | MULLION                                                                                        | LSL       |
| 7                 | WEATHERSTRIP                                                                                   | FOAM      |
| 8                 | SWEEP                                                                                          | VINYL     |
| 14                | OUTSWING THRESHOLD                                                                             | ALUM/COMP |
| 15                | INSWING THRESHOLD                                                                              | ALUM/COMP |
| 16                | ADA THRESHOLD                                                                                  | ALUM      |
| 22                | #10 X 2" PFH WOOD SCREW                                                                        | STEEL     |
| 24                | #12 x 1" PFH WOOD SCREW                                                                        | STEEL     |
| 25                | #8 x 1-3/4 PFH WOOD SCREW                                                                      | STEEL     |
| 26                | #8 x 2-1/2" PFH WOOD SCREW                                                                     | STEEL     |
| 27                | LATCH STRIKE PLATE                                                                             | STEEL     |
| 28                | DEADBOLT STRIKE PLATE                                                                          | STEEL     |
| 29                | 4.5" X 4.5" HINGE                                                                              | STEEL     |
| 30                | MORTISE STRIKE PLATE                                                                           | STEEL     |
| 32                | DEADBOLT SECURITY STRIKE PLATE                                                                 | STEEL     |
| 40                | DOOR PANEL                                                                                     | -         |
| 50                | SIDELITE PANEL                                                                                 | -         |
| 70                | TRANSOM PANEL                                                                                  | -         |

WOOD FRAME COMPONENTS: SIPO (UTILE) (G = 0.53)


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


| ANCHOR TYPE        | ANCHOR SIZE | MIN. EMBEDMENT | MIN. CLEARANCE TO MASONRY EDGE | MIN. CLEARANCE TO ADJACENT ANCHOR |
|--------------------|-------------|----------------|--------------------------------|-----------------------------------|
| ITW TAPCON®        | 1/4"        | 1-1/4"         | 2"                             | 4"                                |
| DeWALT ULTRA CON+® | 1/4"        | 1-1/4"         | 1"                             | 4"                                |
| ITW TAPCON®        | 3/16"       | 1-1/4"         | 3"                             | 1-1/2"                            |

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

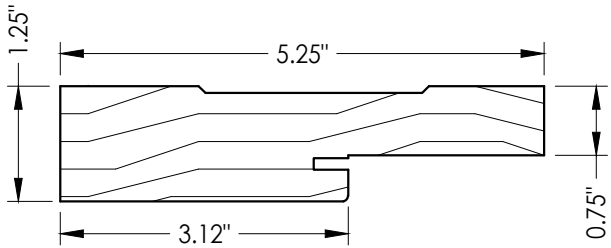


1 WOOD JAMB  
(Door)

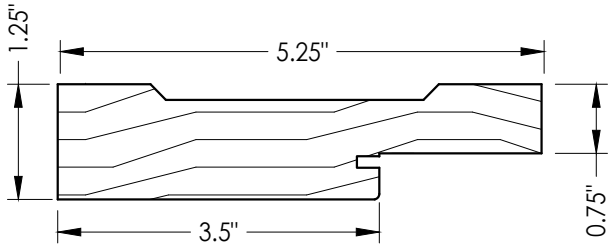


2 WOOD JAMB  
(Sidelite)

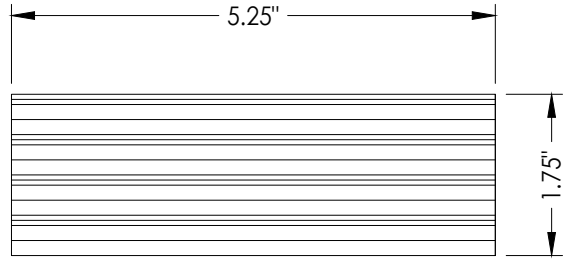


3 MULLION  
VERSA-LAM® 3100 Fb-2.0E

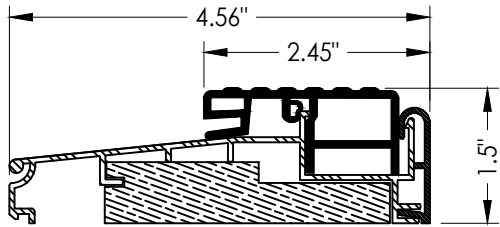

14 OUTSWING THRESHOLD  
WORLDWIDE

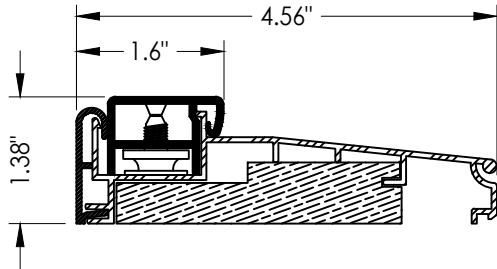

15 INSWING THRESHOLD  
WORLDWIDE

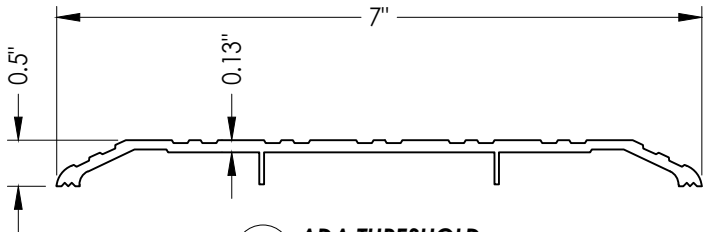

16 ADA THRESHOLD

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT:  
Builders FirstSource  
WOOD DOOR

PART OR ASSEMBLY:  
BILL OF MATERIALS  
& COMPONENTS

| NO. | DATE     | REVISIONS                        |
|-----|----------|----------------------------------|
| 3   | 9/18/23  | UPDATE TO 8TH ED. (2023) FBC LFS |
| 2   | 8/10/20  | UPDATE TO 7TH ED. (2020) FBC LFS |
| 1   | 10/12/17 | UPDATE TO 6TH ED. (2017) FBC LFS |

DATE: 5/10/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-22347.2

SHEET 12 OF 12