



HPC FIBERGLASS WITH MULTIPOINT HARDWARE
6'-8" DOUBLE DOOR WITH / WITHOUT SIDELITES

GENERAL NOTES

- EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
- WHEN INSTALLED IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS REQUIRED.
- WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION, HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS REQUIRED.
- POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.

5. PLASTICS TESTING:


TEST DESCRIPTION	DESIGNATION	FACING	LITE FRAME
SELF IGNITION TEMP	ASTM D1929	752 °F > 650 °F	740 °F > 650 °F
RATE OF BURNING	ASTM D635	0.56 IN/MIN	0.77 IN/MIN
SMOKE DENSITY	ASTM D2843	53.4%	13.4%
TENSILE STRENGTH*	ASTM D638	3.2% DIFF	7.1% DIFF

6. PLASTICS TESTING OF WORLDWIDE COMPOSITE FRAME (WHERE USED):


TEST DESCRIPTION	DESIGNATION	RESULT
SELF IGNITION TEMP	ASTM D1929	779 °F > 650 °F
RATE OF BURNING	ASTM D635	0.0 IN/MIN
SMOKE DENSITY	ASTM D2843	39.0%
TENSILE STRENGTH*	ASTM D638	3.6% DIFF

* COMPARATIVE TENSILE STRENGTH AFTER WEATHERING
4500 HOURS XENON ARC METHOD 1

- DOOR SLABS MUST BE STAMPED "HPC" ON TOP RAIL.

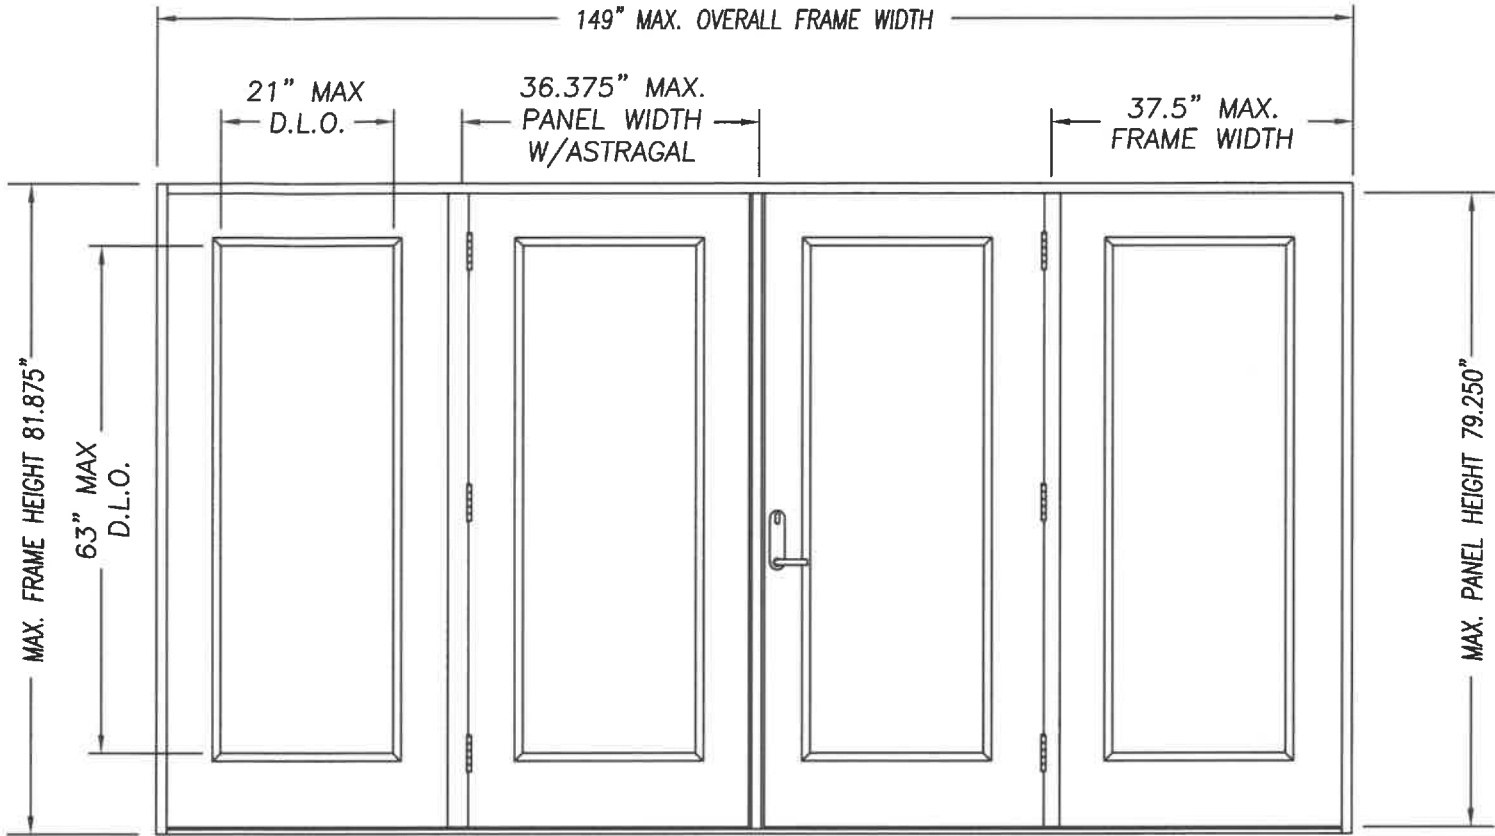

DOUBLE DOOR UNIT W/SIDELITES

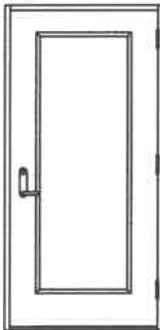


SINGLE DOOR UNIT




DOUBLE DOOR UNIT




SINGLE DOOR UNIT
WITH SIDELITE

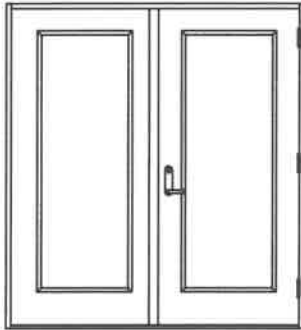

SINGLE DOOR UNIT
WITH SIDELITE

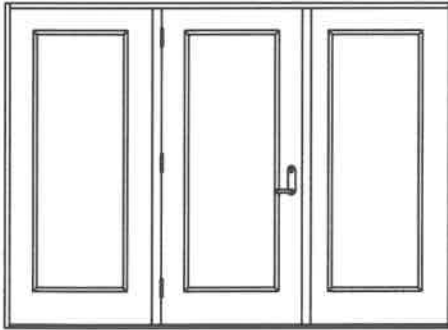

SINGLE DOOR UNIT W/SIDELITES

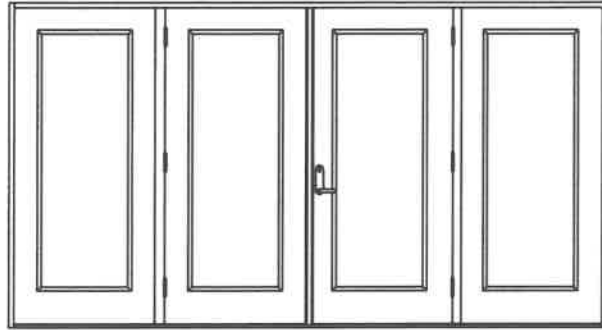

DOUBLE DOOR UNIT W/SIDELITES

CONFIG	MAX WIDTH	DESIGN PRESSURE RATING (1:1 OVERHANG OR WHERE NO WATER REQUIRED)		WHERE WATER INFILTRATION PERFORMANCE IS REQUIRED TO BE 15% OF DESIGN PRESSURE				
		INSWING	OUTSWING	BUMPER O/S	Z-SERIES O/S	T4 O/S	HIGH DAM O/S	
X	37.5"	+50.0 / -50.0	+50.0 / -50.0	+25.0 / -25.0	+40.0 / -40.0	+50.0 / -50.0	+50.0 / -50.0	
XX	74"	+50.0 / -50.0	+50.0 / -50.0	+25.0 / -25.0	+40.0 / -40.0	+50.0 / -50.0	+50.0 / -50.0	
OX or XO	75"	+50.0 / -50.0	+50.0 / -50.0	+25.0 / -25.0	+40.0 / -40.0	+50.0 / -50.0	+50.0 / -50.0	
OXO	112.5"	+50.0 / -50.0	+50.0 / -50.0	+25.0 / -25.0	+40.0 / -40.0	+50.0 / -50.0	+50.0 / -50.0	
OXXO	149"	+50.0 / -50.0	+50.0 / -50.0	+25.0 / -25.0	+40.0 / -40.0	+50.0 / -50.0	+50.0 / -50.0	

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS
3	ANCHORING LOCATIONS & DETAILS

PRODUCT: EXTERIOR DOOR PRODUCT*

DOUBLE 6'8" GLAZED

FIBERGLASS DOOR

PART OR ASSEMBLY:

TYPICAL ELEVATIONS

& GENERAL NOTES

SWS

SWS

SWS

BY

11/21/23

ADDED PANOLock

MISC EDITS

MISC UPDATES

DATE

C

B

A

NO.

REVISIONS

11/21/23

7/18/20

11/27/17

DATE

C

B

A

NO.

REVISIONS

11/21/23

7/18/20

11/27/17

DATE

C

B

A

NO.

REVISIONS

DATE: 4/26/17

SCALE: N.T.S.


DWG. BY: SWS

CHK. BY:

DRAWING NO.:

DWG-MA-FL0201-17

SHEET 1 OF 3

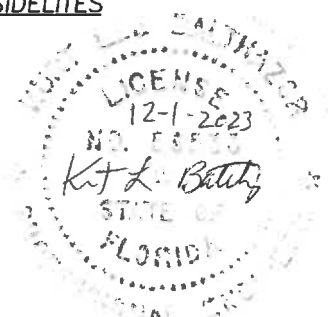

KURT BALTHAZOR
FLORIDA P.E.
#56533

