

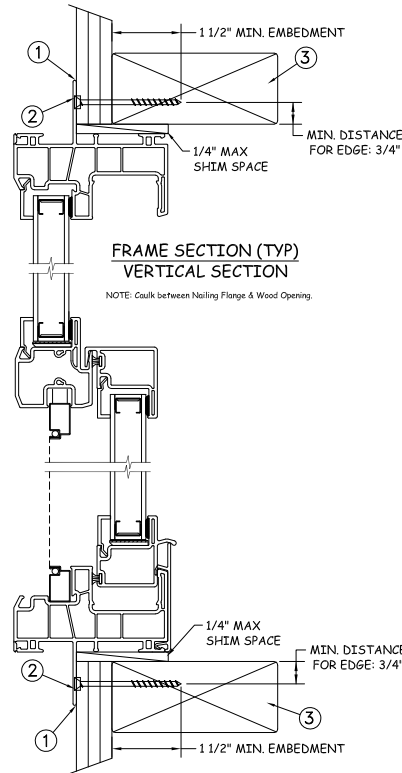


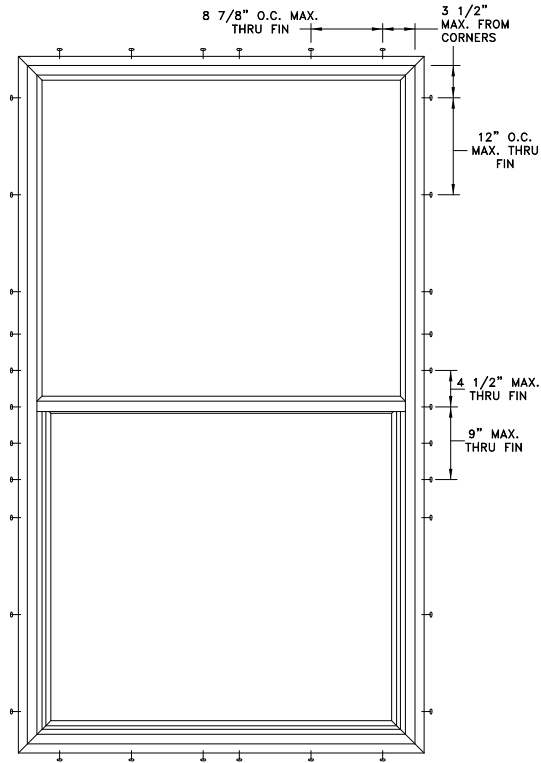

NAIL FIN INSTALLATION

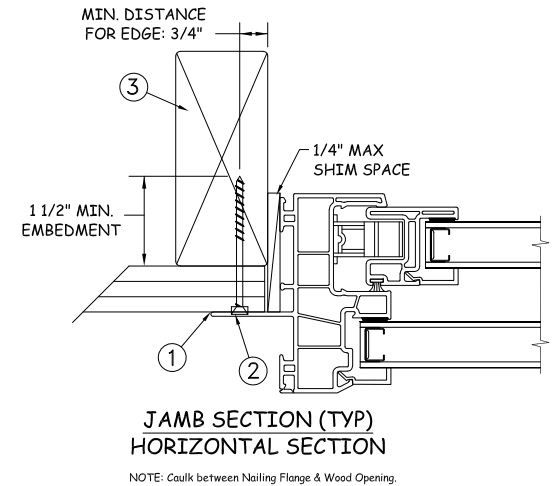

Max Frame	DP RATING	IMPACT
48 x 84	+50/-55	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #8 X PH or greater fastener through the nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For two (2X) wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.



2021.03.02 16:06:35 -05'00'
JOSEPH A. REED, P.E.
 FLORIDA P.E. No. 58920. REG.No. 33747
 5 LEIGH DRIVE
 YORK, PA. 17406
 (717) 846-1200

DRAWN BY:
A. MCMILLAN

CHECKED BY:
J. GOOSSEN

APPROVED BY:
J. GOOSSEN

RECORD No.:
D011889

REPORT No.:
SJW2014-130

DATE:
03/02/2021

SCALE:
NTS

TITLE:

Premium Vinyl Single Hung Side Load Window



JELD-WEN

3737 Lakeport Blvd
 Klamath Falls, OR. 97601
 Phone: (800) 535-3936


CAD DWG. No.:

REV:
A

SHEET
 1 OF 4

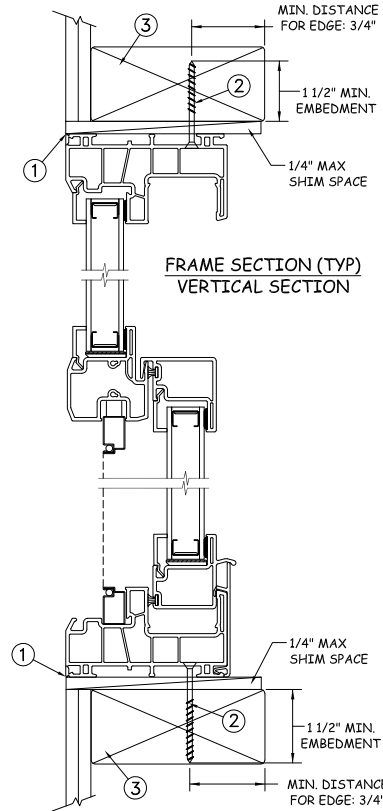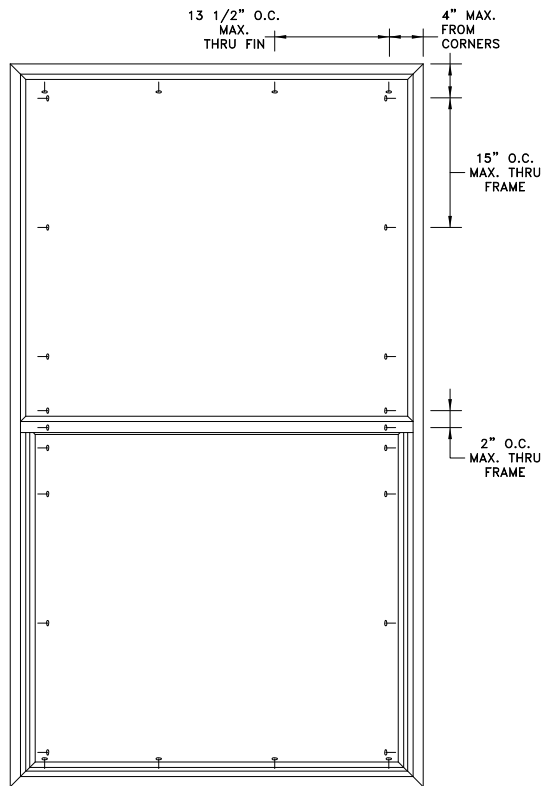

THROUGH FRAME INSTALLATION

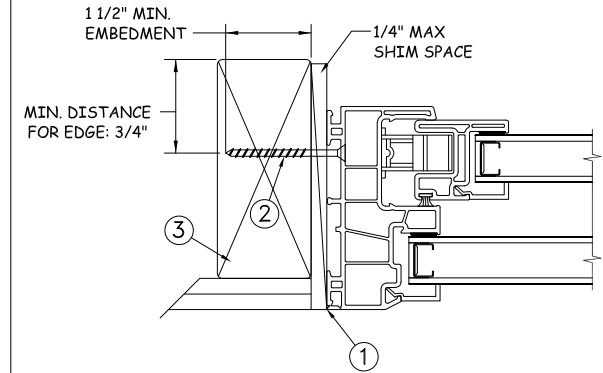

JAMB SECTION (TYP)
HORIZONTAL SECTION

Max Frame	DP RATING	IMPACT
48 x 84	+50/-55	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For two (2X) wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.



General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. Use structural or composite shims where required.




2021.03.02 16:06:35 -05'00'
JOSEPH A. REED, P.E.
FLORIDA P.E. No. 58920. REG.No. 33747
5 LEIGH DRIVE
YORK, PA. 17406
(717) 846-1200

DRAWN BY: A. MCMILLAN	DATE: 03/02/2021	JELD-WEN 3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936	
	SCALE: NTS		
	CHECKED BY: J. GOOSSEN		
	APPROVED BY: J. GOOSSEN		
RECORD No.:	D011889	Premium Vinyl Single Hung Side Load Window	
REPORT No.:	SJW2014-130		
CAD DWG. No.:	REV: A	SHEET 2 OF 4	

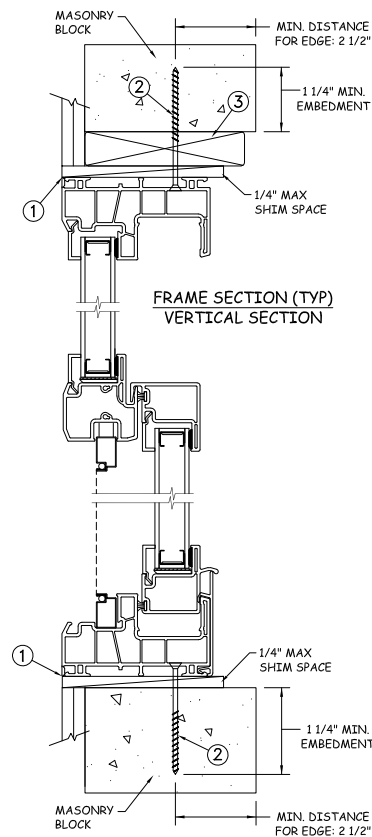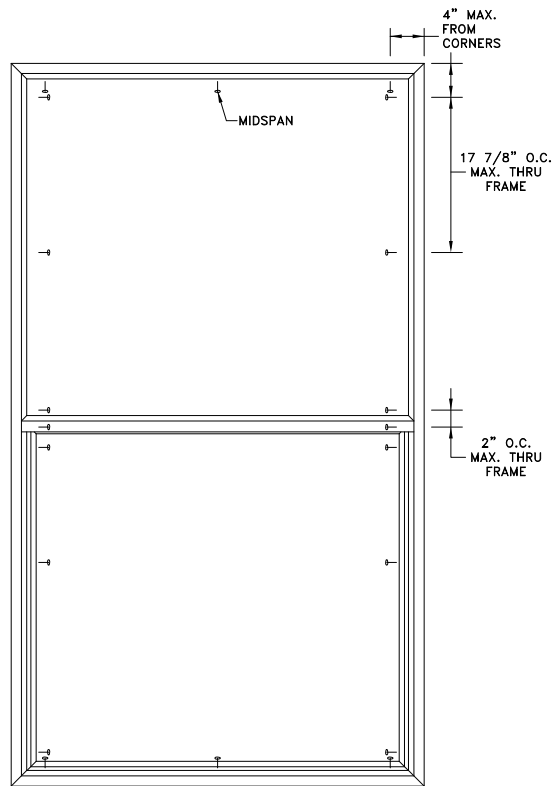

MASONRY INSTALLATION

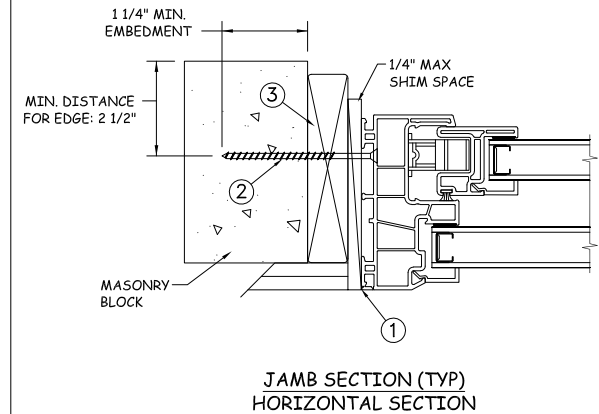

Max Frame	DP RATING	IMPACT
48 x 84	+50/-55	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 3/16" Tapcon or equivalent fasteners through frame with sufficient length to penetrate a minimum of 1 1/4" into concrete or masonry at each location with a 2 1/2" min from edge distance. For concrete (min. = 3000psi) or masonry (min. = 2000psi) (CMU shall conform to ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. Use structural or composite shims where required.



2021.03.02 16:06:35 -05'00'
JOSEPH A. REED, P.E.
 FLORIDA P.E. No. 58920. REG.No. 33747
 5 LEIGH DRIVE
 YORK, PA. 17406
 (717) 846-1200

DATE:
03/02/2021

DRAWN BY:
A. MCMILLAN

SCALE:
NTS

CHECKED BY:
J. GOOSSEN

TITLE:

APPROVED BY:
J. GOOSSEN

Premium Vinyl Single Hung Side Load Window

RECORD No.:
D011889

REPORT No.:
SJW2014-130



JELD-WEN

3737 Lakeport Blvd
 Klamath Falls, OR. 97601
 Phone: (800) 535-3936


CAD DWG. No.:

REV: **A**

SHEET
3 OF 4

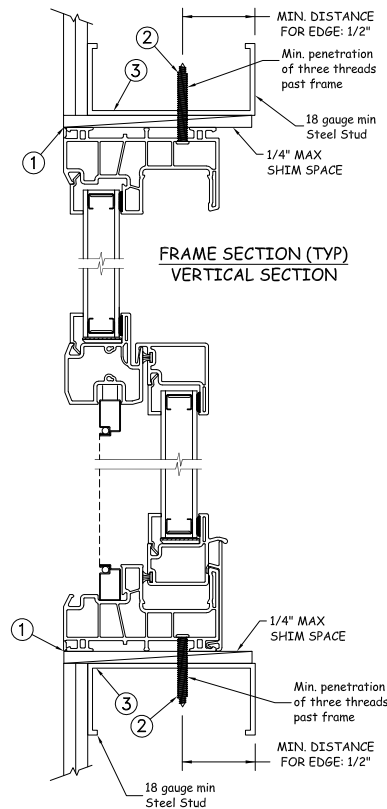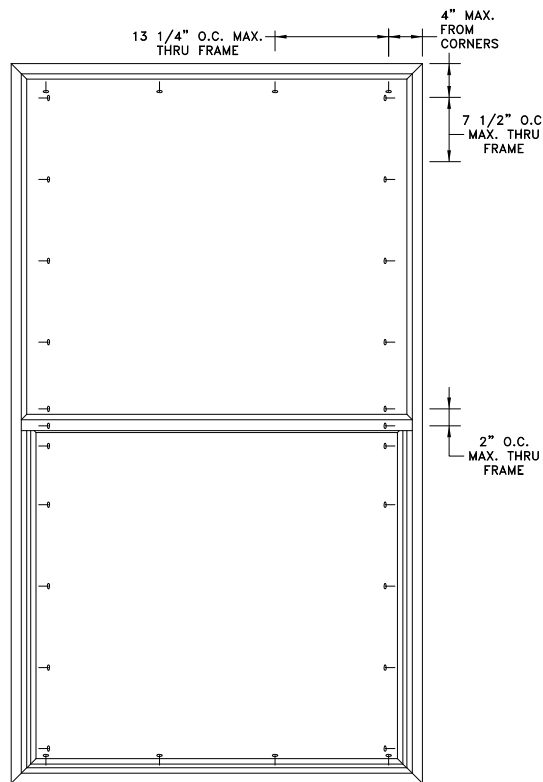

STEEL INSTALLATION

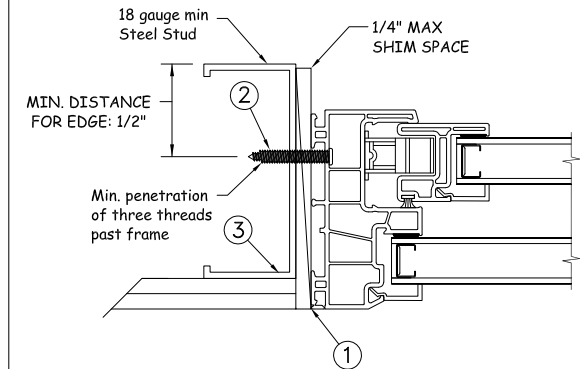

JAMB SECTION (TYP)
HORIZONTAL SECTION

Max Frame	DP RATING	IMPACT
48 x 84	+50/-55	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. For anchoring into metal framing, use #10 TEK Self Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Locate anchors as shown in elevations and installation details. Steel substrate min. 18ga., fy = 33 ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. Use structural or composite shims where required.



2021.03.02 16:06:35 -05'00'
JOSEPH A. REED, P.E.
FLORIDA P.E. No. 58920. REG.No. 33747
5 LEIGH DRIVE
YORK, PA. 17406
(717) 846-1200

DRAWN BY: A. MCMILLAN	DATE: 03/02/2021	JELD-WEN 3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936	
	SCALE: NTS		
	CHECKED BY: J. GOOSSEN		
	APPROVED BY: J. GOOSSEN		
RECORD No.:	D011889	Premium Vinyl Single Hung Side Load Window	
REPORT No.:	SJW2014-130		
CAD DWG. No.:	REV: A	SHEET 4 OF 4	