

ATRIUM CORPORATION


SERIES 130 1.25" TUBE MULLION (NON IMPACT RATED)

GENERAL NOTES:


- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ , AND HAVE BEEN EVALUATED TO FLORIDA BUILDING CODE, SECTION 1709.8.
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- MULLION & CLIP MATERIAL: ALUMINUM 6063-T6
- SEE SHEETS 5-8 FOR INSTALLATION ANCHOR REQUIREMENTS FOR SPECIFIC MULLION CONFIGURATIONS AND DESIGN LOAD CAPACITIES.
- IN ACCORDANCE WITH THE CURRENT FBC, DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS DEFINED IN CHAPTER 20.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.42.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
 - HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

TRIBUTARY WIDTH = $\frac{W1 + W2}{2}$


TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES AND ELEVATIONS
2	MULLION DETAILS (STANDARD CLIP)
3	MULLION DETAILS (OFFSET CLIP)
4	TWO-WAY DETAILS & FRAME DETAIL
5	ONE-WAY MULL TABLES (TAPCONS ONLY)
6	ONE-WAY MULL TABLES (ALL OTHER ANCHORS)
7	TWO-WAY MULL TABLES (TAPCONS ONLY)
8	TWO-WAY MULL TABLES (ALL OTHER ANCHORS)

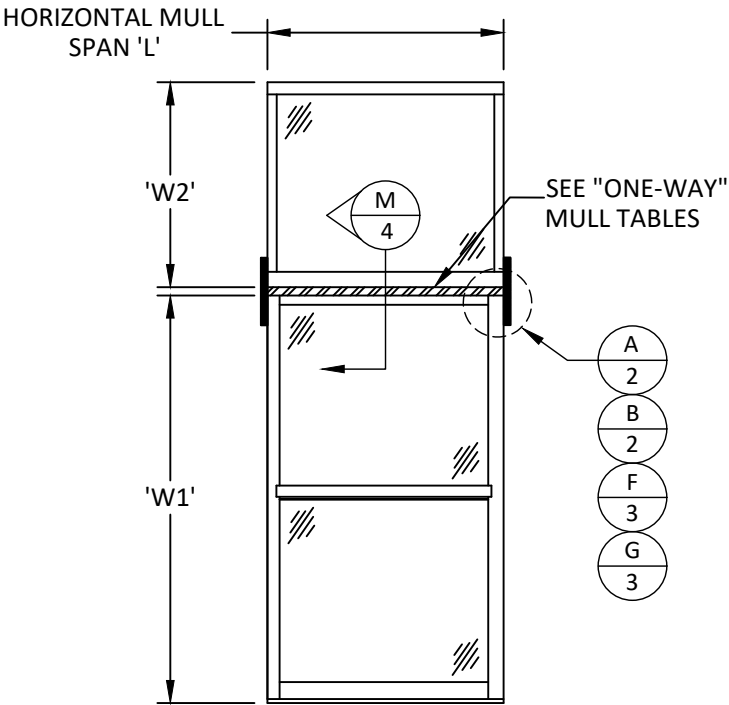


HORIZONTAL SPAN

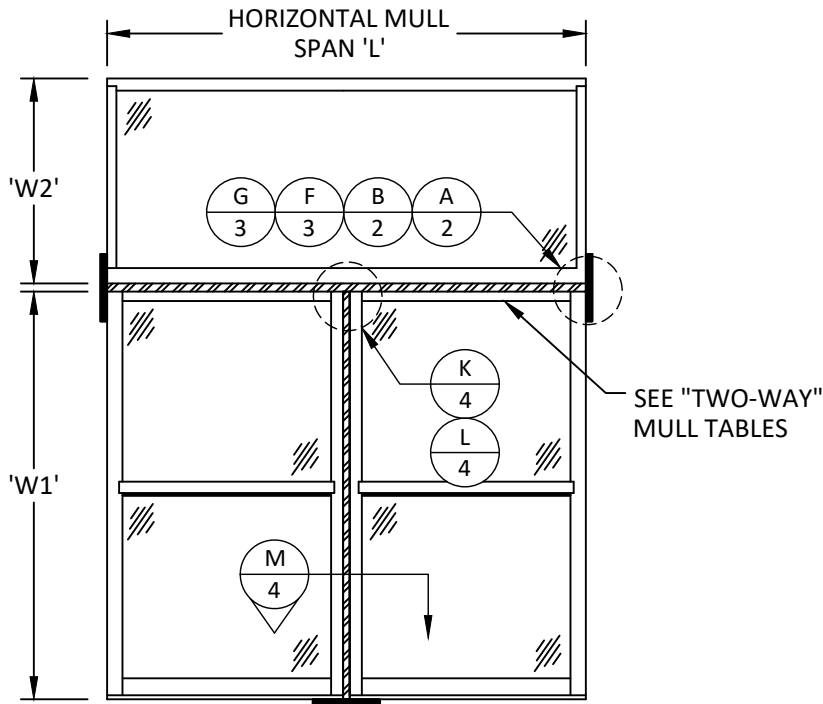

HORIZONTAL "T" MULL SPAN

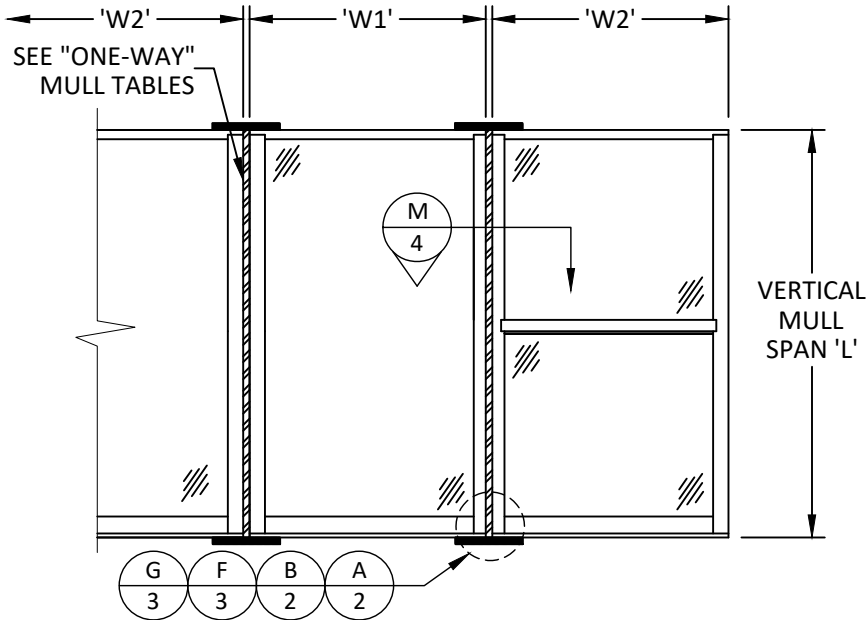

VERTICAL SPAN

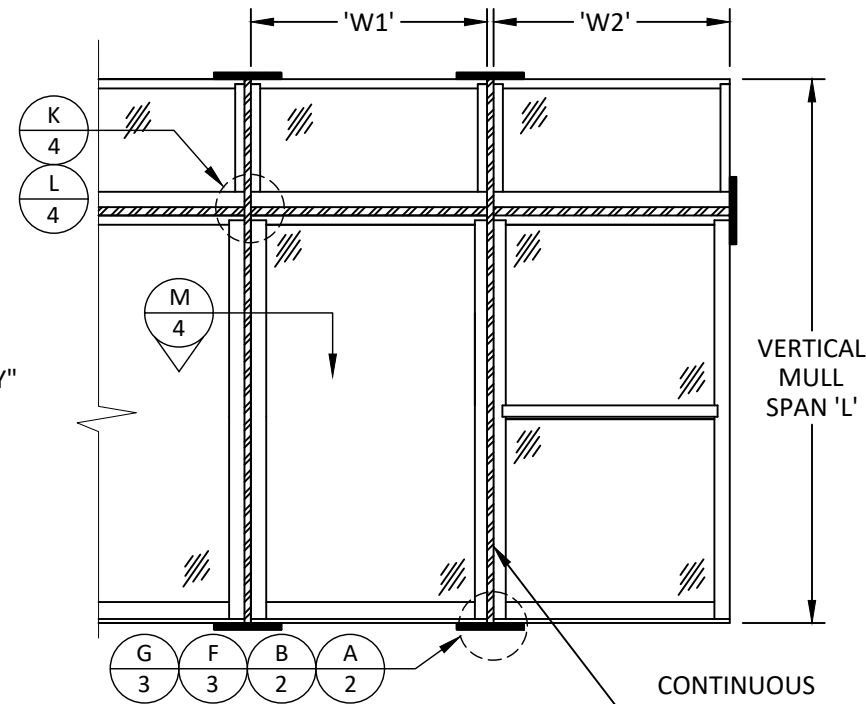

VERTICAL SPAN

CONTINUOUS VERTICAL MULL
SEE "TWO-WAY"
MULL TABLES



ATRIUM
 WINDOWS & DOORS
 ATRIUM WINDOWS AND DOORS
 9001 AMBASSADOR ROW
 DALLAS, TEXAS 75247
 PH: (214)637-2696 FAX: (214)424-6734

TITLE:
130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL

INSTALLATION & GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.04.01 07:53:56 -04'00'

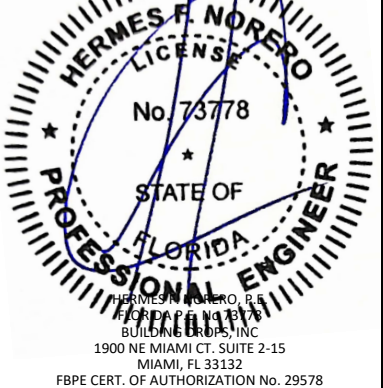

FL #:	22377
DATE:	10.03.17
DWG. BY:	AR/AG
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ATR110

SECTION:

1

OF 8

TITLE: 130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL

MULLION DETAILS
(STANDARD CLIP)

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com




REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26


THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.




FL #:	22377
DATE:	10.03.17
DWG. BY:	AR/AG
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ATR110
SECTION:	2

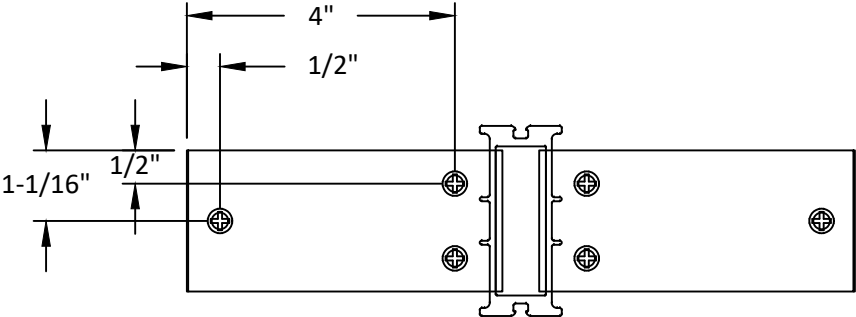


C
2 TOP VIEW
END CLIP DETAIL WITH HOLE LAYOUT
WOOD OR STEEL STUD INSTALLATION

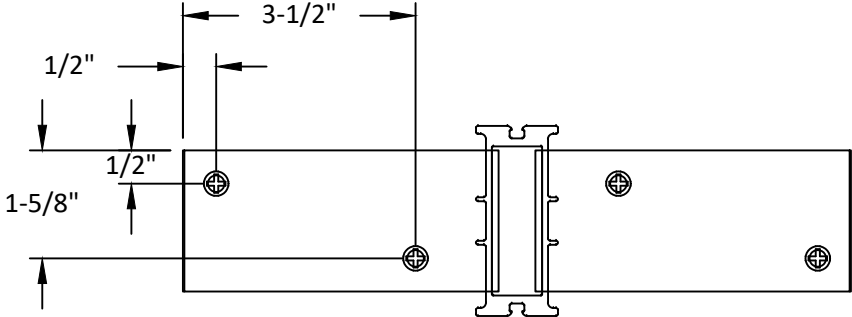


D
2 TOP VIEW
END CLIP DETAIL WITH HOLE LAYOUT
ITW TAPCONS INTO CONCRETE/MASONRY

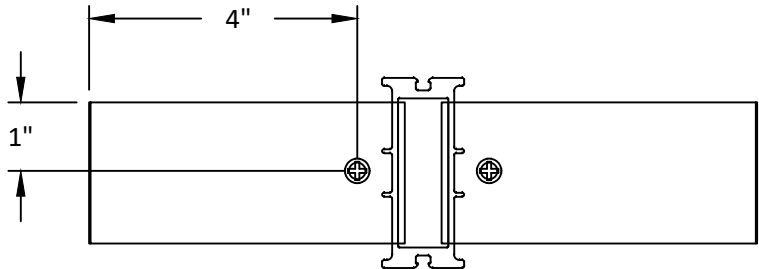


E
2 TOP VIEW
END CLIP DETAIL WITH HOLE LAYOUT
HILTI KWIK BOLTS INTO CONCRETE/MASONRY

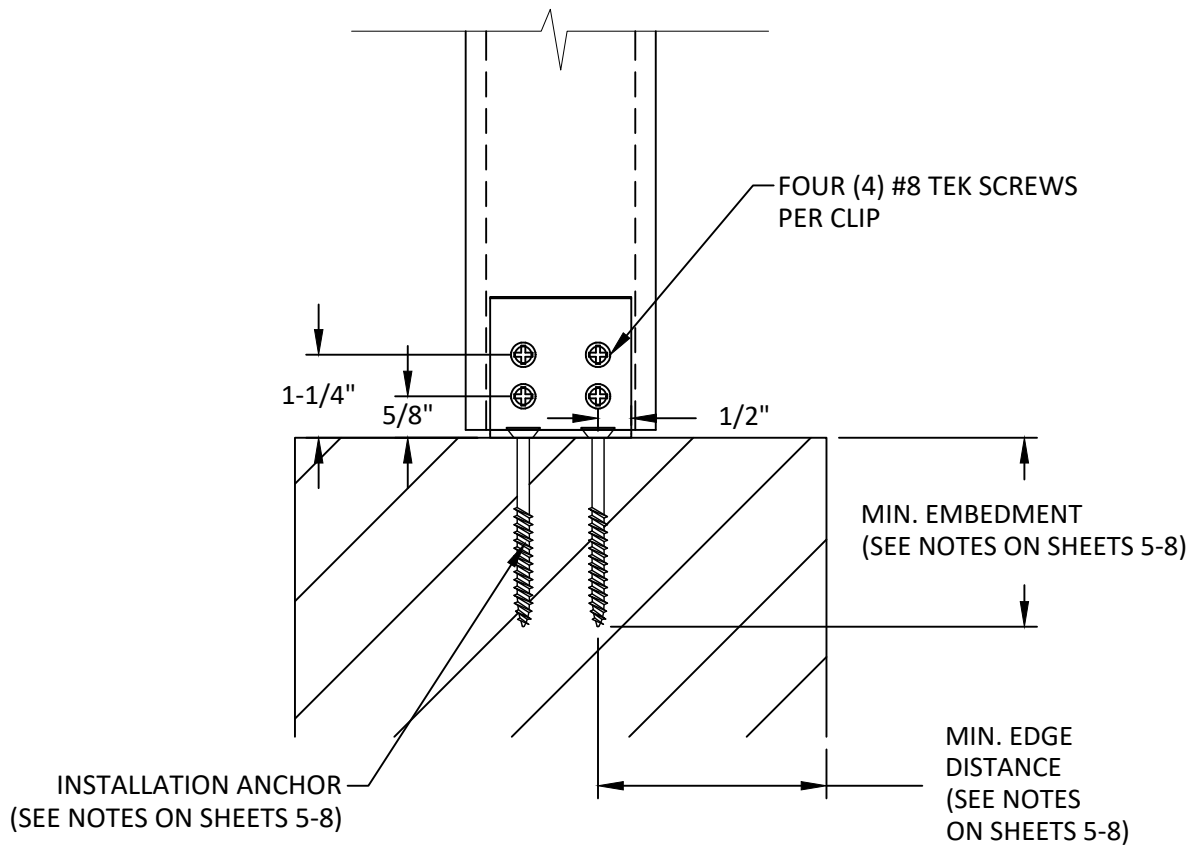


A
2 SIDE VIEW
MULLION W/ END CLIPS (ONE OR TWO WAY)
STANDARD CLIP

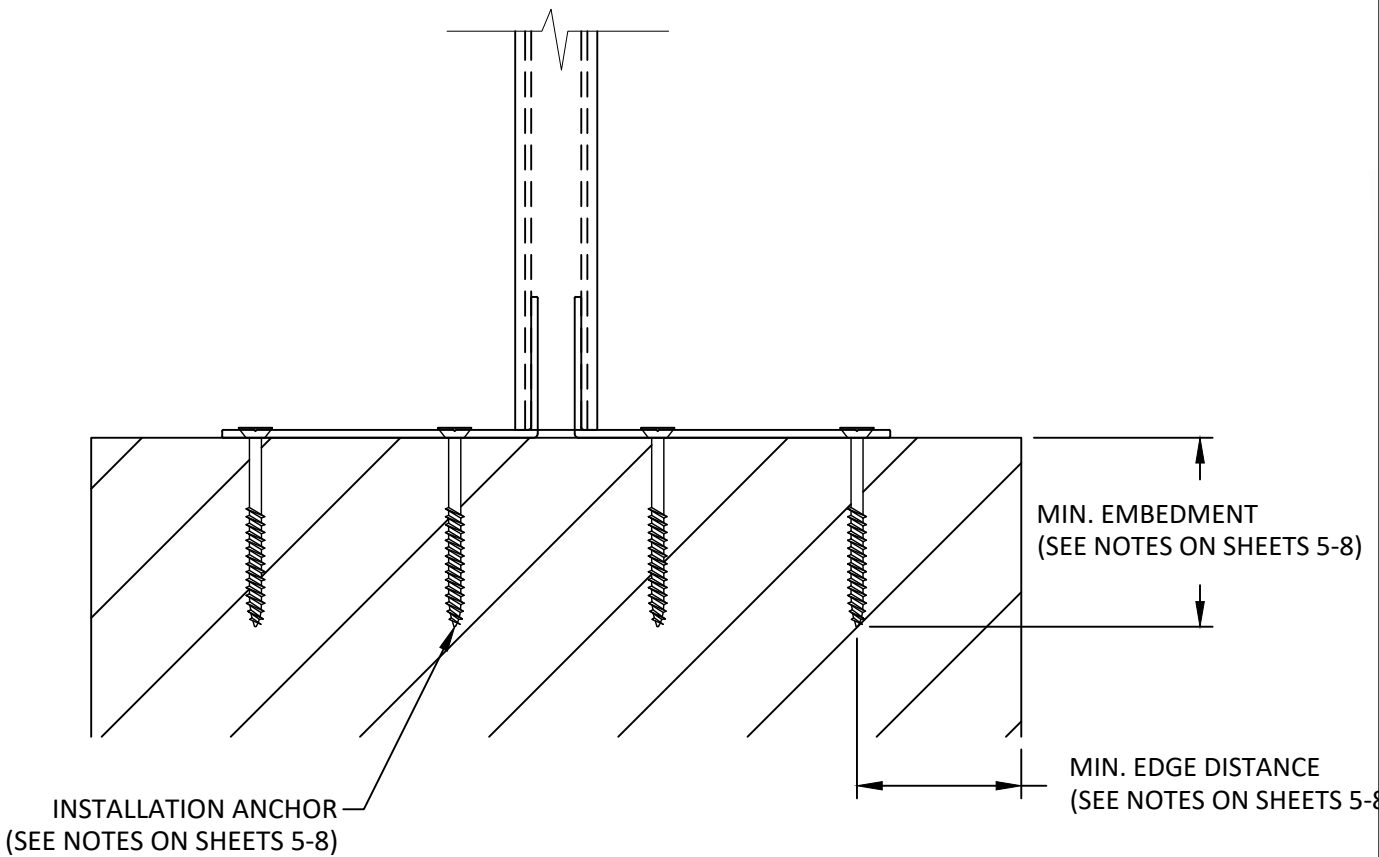


B
2 FRONT VIEW
MULLION W/ END CLIPS (ONE OR TWO WAY)
STANDARD CLIP

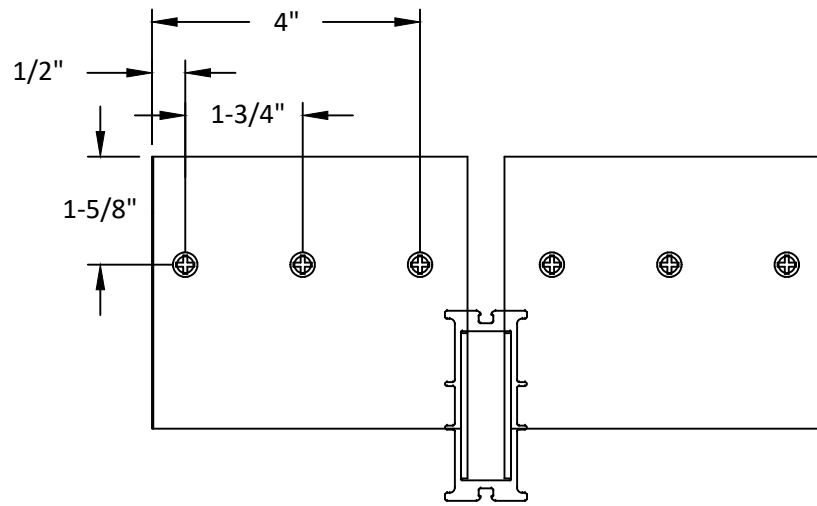


H
3 **TOP VIEW**
END CLIP DETAIL WITH HOLE LAYOUT
WOOD OR STEEL STUD INSTALLATION

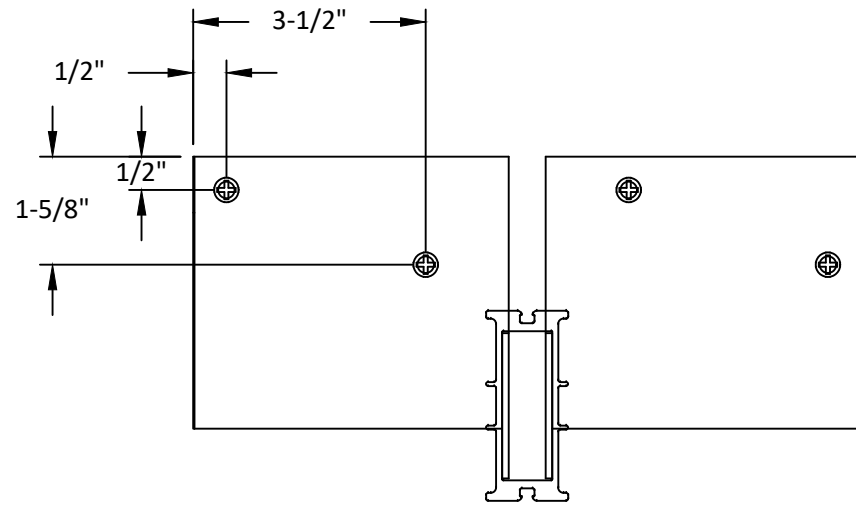


I
3 **TOP VIEW**
END CLIP DETAIL WITH HOLE LAYOUT
ITW TAPCONS INTO CONCRETE/MASONRY

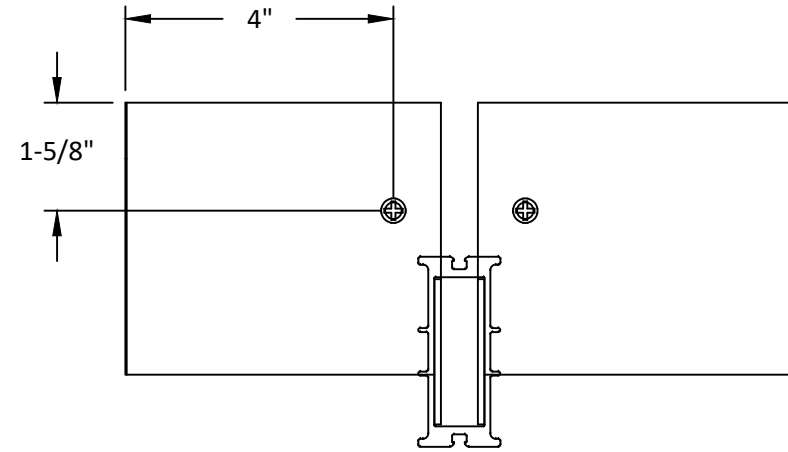

J
3 **TOP VIEW**
END CLIP DETAIL WITH HOLE LAYOUT
HILTI KWIK BOLTS INTO CONCRETE/MASONRY

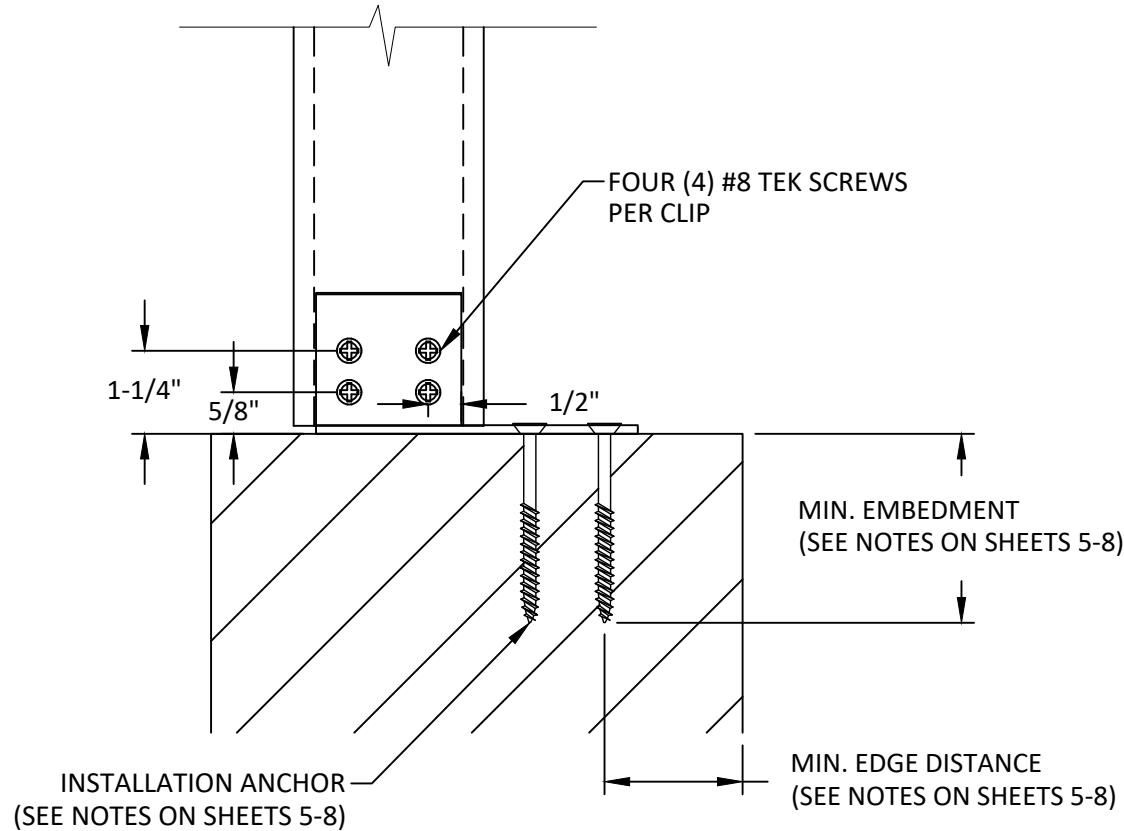

F
3 **SIDE VIEW**
MULLION W/ END CLIPS (ONE OR TWO WAY)
OFFSET CLIP

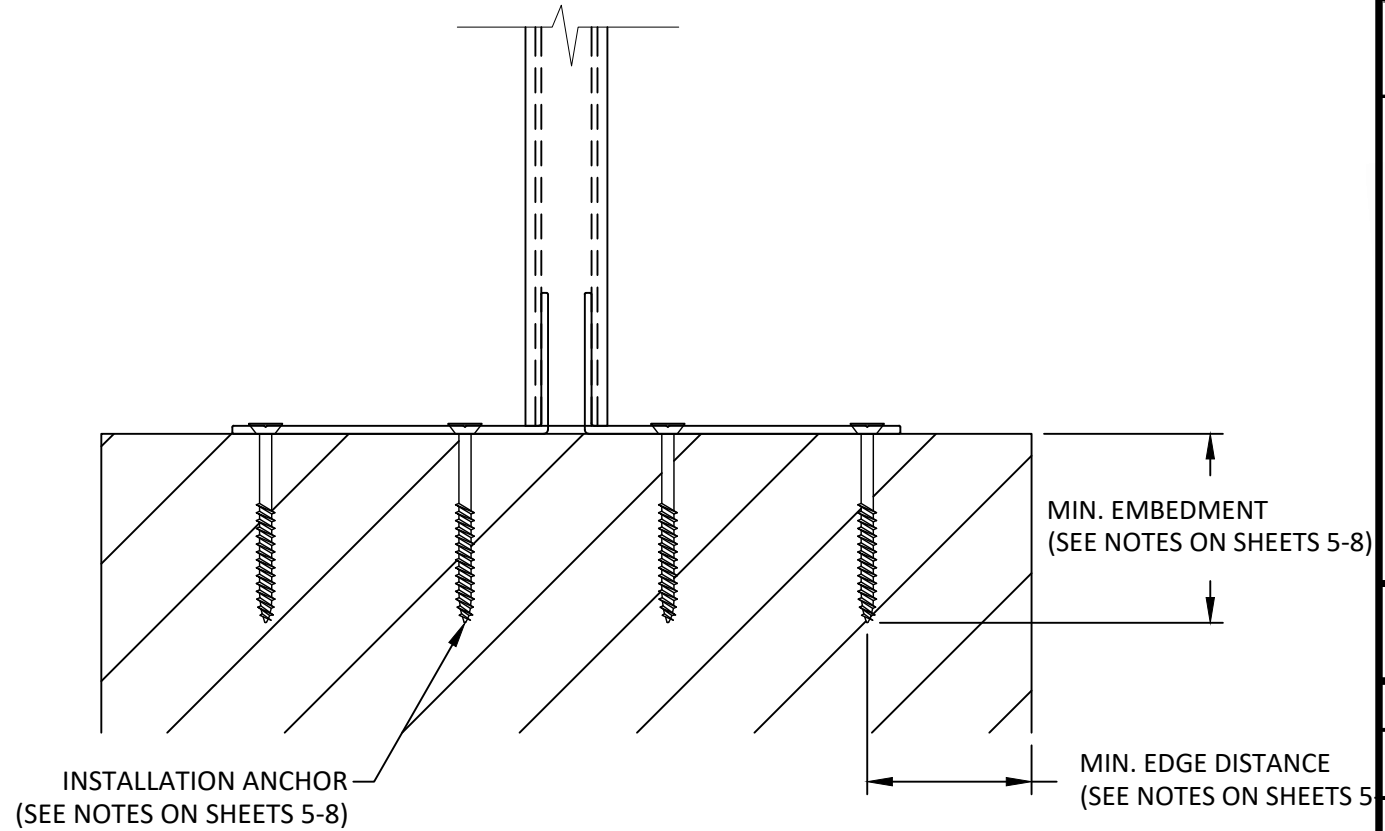

G
3 **FRONT VIEW**
MULLION W/ END CLIPS (ONE OR TWO WAY)
OFFSET CLIP

TITLE: 130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL


MULLION DETAILS
(OFFSET CLIP)

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26


THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

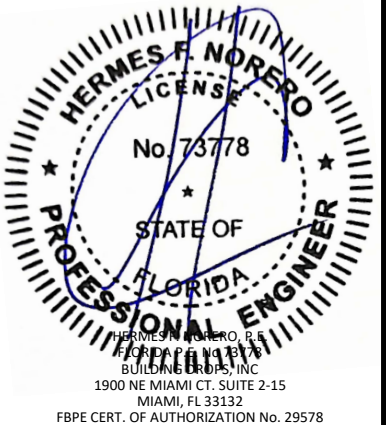


FL #:	22377
DATE:	10.03.17
DWG. BY:	AR/AG
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ATR110
SECTION:	3

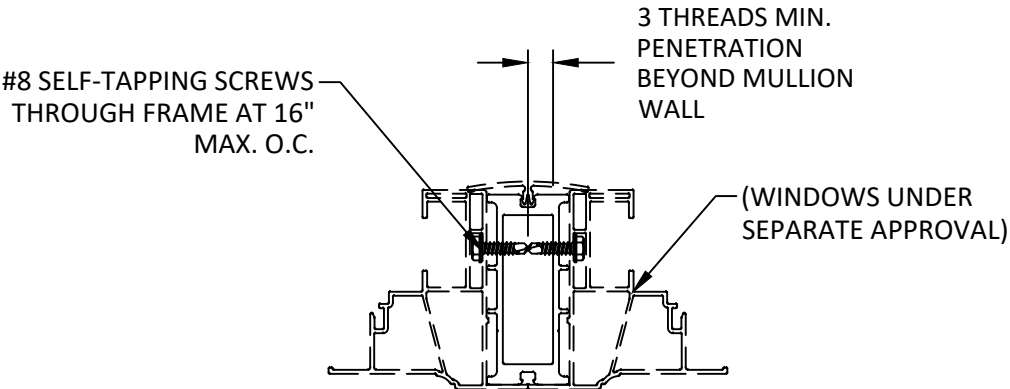

M
4 **HORIZONTAL SECTION**
FRAME CONNECTION TO MULLION
TYPICAL

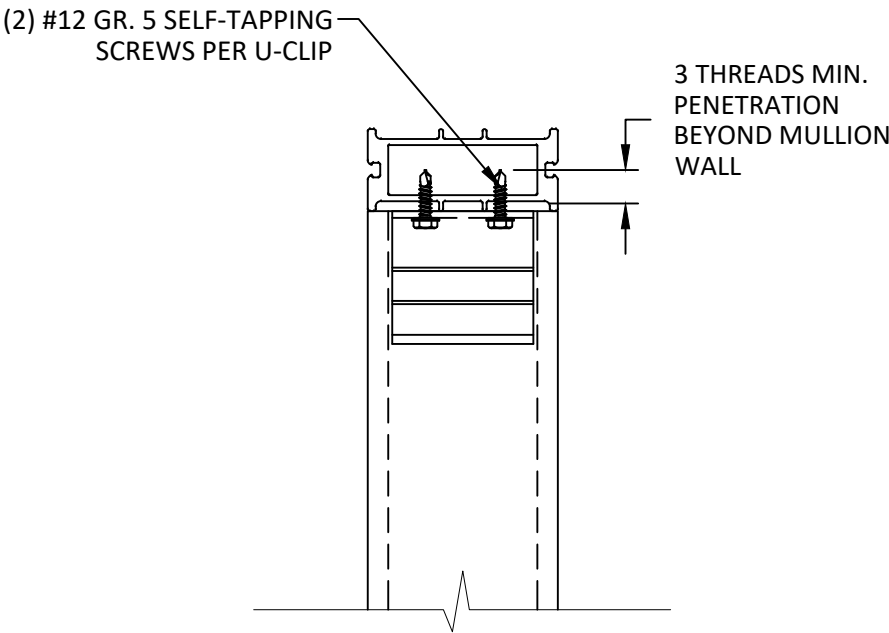

K
4 **SIDE VIEW**
MULLION WITH U-CLIP (TWO WAY)
TYPICAL

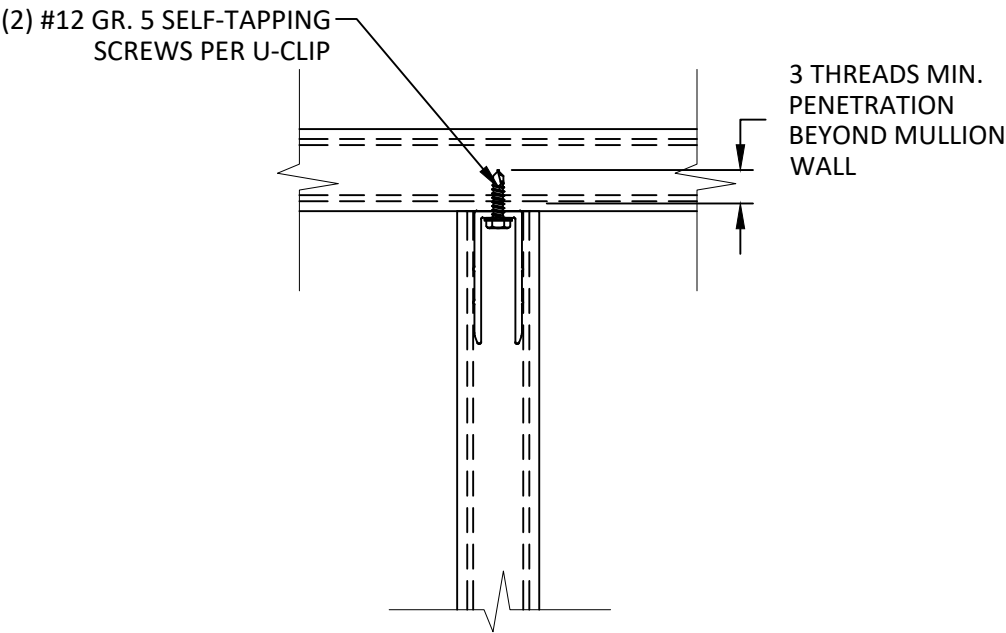

L
4 **FRONT VIEW**
MULLION WITH U-CLIP (TWO WAY)
TYPICAL


TITLE: 130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL
TWO-WAY DETAILS &
FRAME DETAIL

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

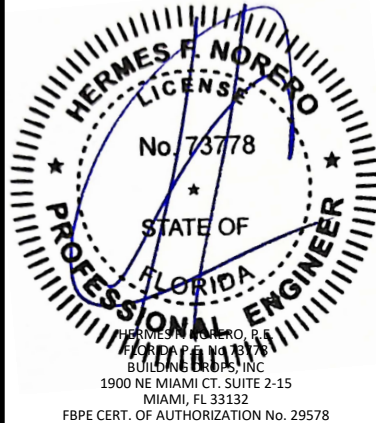

FL #:	22377
DATE:	10.03.17
DWG. BY:	CHK. BY:
AR/AG	HFN
SCALE:	NTS
DWG. #:	ATR110
SECTION:	

Maximum design pressure capacity chart (psf)
One-Way Mullions (Tapcons only)

L - Mull Length (in)	W - Tributary Width (in)													
	18.0	21.0	24.0	27.0	30.0	33.0	36.0	42.0	48.0	54.0	60.0	66.0	72.0	78.0
24.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
30.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
36.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
42.0	150.0	150.0	143.7	134.5	127.8	123.0	119.8	117.3	117.3	117.3	117.3	117.3	117.3	117.3
48.0	147.4	131.4	119.8	111.1	104.5	99.6	95.8	91.3	89.8	89.8	89.8	89.8	89.8	89.8
54.0	127.8	113.3	102.7	94.6	88.5	83.6	79.9	74.7	71.9	71.0	71.0	71.0	71.0	71.0
60.0	112.7	99.6	89.8	82.4	76.7	72.1	68.4	63.2	59.9	58.1	57.5	57.5	57.5	57.5
66.0	100.9	88.8	79.9	73.0	67.6	63.4	59.9	54.8	51.3	49.1	47.9	47.5	47.5	47.5
72.0	91.3	80.1	71.9	65.5	60.5	56.5	53.2	48.3	44.9	42.6	41.1	40.2	39.9	39.9
78.0	83.3	73.0	65.1	58.4	53.2	49.0	45.5	40.3	36.6	34.0	32.2	31.0	30.3	30.1
84.0	68.0	58.7	51.8	46.5	42.2	38.8	36.0	31.7	28.7	26.5	24.9	23.7	23.0	22.5
90.0	55.2	47.6	41.9	37.6	34.1	31.3	29.0	25.5	22.9	21.0	19.6	18.6	17.9	17.4
96.0	45.4	39.1	34.4	30.8	28.0	25.6	23.7	20.8	18.6	17.0	15.8	-	-	-

NOTES:

1. MULLION CHART APPLIES TO MULLION ASSEMBLIES WHEN USED TO MULL WINDOWS IN ONE-WAY CONFIGURATIONS SHOWN ON SHEET 1 USING ITW TAPCON ANCHORS ONLY. SEE DETAILS D/2 & I/3.
2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL WINDOW UNITS OF INSTALLATION UNDER SEPARATE APPROVAL.
5. FOR CONCRETE/MASONRY INSTALLATION USE TWO (2) 1/4" DIAMETER ITW TAPCON SCREWS AT EACH ANCHOR CLIP. TAPCONS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 1-1/4" EMBEDMENT AND MINIMUM 2-1/2" EDGE DISTANCE. SEE DETAILS D/2 & I/3.
6. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

6.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.1 (e.g., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

6.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.2 (e.g., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).



ATRIUM
WINDOWS & DOORS

ATRIUM WINDOWS AND DOORS

9001 AMBASSADOR ROW
DALLAS, TEXAS 75247

PH: (214)637-2696 FAX: (214)424-6734

TITLE:
130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL
ONE-WAY MULL TABLES
(TAPCONS ONLY)


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

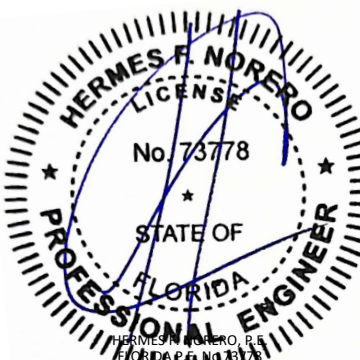

HERMES F. NORERO, P.E.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
22377

DATE: **10.03.17**

DWG. BY:
AR/AG

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ATR110**

SECTION:
5

OF 8

Maximum design pressure capacity chart (psf)
One-Way Mullions (All other anchors)

L - Mull Length (in)	W - Tributary Width (in)													
	18.0	21.0	24.0	27.0	30.0	33.0	36.0	42.0	48.0	54.0	60.0	66.0	72.0	78.0
24.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
30.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
36.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
42.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
48.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	148.3	148.3	148.3	148.3	148.3	148.3
54.0	150.0	150.0	150.0	150.0	146.0	138.0	131.8	123.2	118.6	117.1	117.1	117.1	117.1	117.1
60.0	150.0	150.0	146.8	132.8	121.9	113.3	106.4	96.5	90.4	87.1	86.0	86.0	86.0	86.0
66.0	142.0	123.1	109.1	98.4	90.0	83.3	77.9	69.9	64.6	61.2	59.4	58.7	58.7	58.7
72.0	108.8	94.2	83.3	74.9	68.4	63.1	58.8	52.3	47.9	44.9	42.9	41.8	41.5	41.5
78.0	85.2	73.7	65.1	58.4	53.2	49.0	45.5	40.3	36.6	34.0	32.2	31.0	30.3	30.1
84.0	68.0	58.7	51.8	46.5	42.2	38.8	36.0	31.7	28.7	26.5	24.9	23.7	23.0	22.5
90.0	55.2	47.6	41.9	37.6	34.1	31.3	29.0	25.5	22.9	21.0	19.6	18.6	17.9	17.4
96.0	45.4	39.1	34.4	30.8	28.0	25.6	23.7	20.8	18.6	17.0	15.8	-	-	-

NOTES:

1. MULLION CHART APPLIES TO MULLION ASSEMBLIES WHEN USED TO MULL WINDOWS IN ONE-WAY CONFIGURATIONS SHOWN ON SHEET 1 USING ALL OTHER ANCHOR OPTIONS. SEE DETAILS C/2, E/2, H/3, & J/3.
2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL WINDOW UNITS OF INSTALLATION UNDER SEPARATE APPROVAL.
5. FOR WOOD FRAME INSTALLATION USE THREE (3) #14 WOOD SCREWS AT EACH ANCHOR CLIP. WOOD SCREWS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 1-1/2" EMBEDMENT AND MINIMUM 3/4" EDGE DISTANCE. SEE DETAILS C/2 & H/3.
6. FOR STEEL STUD INSTALLATION USE THREE (3) 1/4" TEK SCREWS AT EACH ANCHOR CLIP. TEK SCREWS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND STEEL STRUCTURE EMBEDMENT AND MINIMUM 1/2" EDGE DISTANCE. SEE DETAILS C/2 & H/3.
5. FOR CONCRETE INSTALLATION USE ONE (1) 3/8" DIAMETER HILTI KWIK BOLT III EXPANSION ANCHOR AT EACH ANCHOR CLIP. BOLTS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 2-1/2" EMBEDMENT AND MINIMUM 2-1/2" EDGE DISTANCE. SEE DETAILS E/2 & J/3.
6. FOR GROUT-FILLED CMU INSTALLATION USE ONE (1) 3/8" DIAMETER HILTI KWIK BOLT III EXPANSION ANCHOR AT EACH ANCHOR CLIP. BOLTS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 2-1/2" EMBEDMENT AND MINIMUM 3-1/2" EDGE DISTANCE. SEE DETAILS E/2 & J/3.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

7.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.1 (e.g., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

7.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.2 (e.g., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).



ATRIM
WINDOWS & DOORS

ATRIUM WINDOWS AND DOORS

9001 AMBASSADOR ROW
DALLAS, TEXAS 75247

PH: (214)637-2696 FAX: (214)424-6734

TITLE:
130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL
ONE-WAY MULL TABLES
(ALL OTHER ANCHORS)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.



HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
22377

DATE: **10.03.17**

DWG. BY: **AR/AG**CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ATR110**

SECTION:
6

OF 8

Maximum design pressure capacity chart (psf)
Two-Way Mullions (Tapcons Only)

L - Mull Length (in)	W - Tributary Width (in)														
	18.0	21.0	24.0	27.0	30.0	33.0	36.0	42.0	48.0	54.0	55.0	60.0	66.0	72.0	78.0
24.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	143.7	130.7	119.8	110.6
30.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	143.7	127.8	125.4	115.0	104.5	95.8	88.5
36.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	136.9	119.8	106.5	104.5	95.8	87.1	79.9	73.7
42.0	150.0	150.0	150.0	150.0	150.0	149.3	136.9	117.3	102.7	91.3	89.6	82.1	74.7	68.4	63.2
48.0	150.0	150.0	150.0	150.0	143.7	130.7	119.8	102.7	89.8	79.9	78.4	71.9	65.3	59.9	55.3
54.0	150.0	150.0	150.0	142.0	127.8	116.2	106.5	91.3	79.9	71.0	69.7	63.9	58.1	53.2	49.1
60.0	150.0	150.0	137.5	122.2	110.0	100.0	91.7	78.6	68.8	61.1	60.0	55.0	50.0	45.8	42.3
66.0	137.8	118.1	103.3	91.8	82.7	75.1	68.9	59.0	51.7	45.9	45.1	41.3	37.6	34.4	31.8
72.0	106.1	91.0	79.6	70.7	63.7	57.9	53.1	45.5	39.8	35.4	34.7	31.8	28.9	26.5	24.5
74.0	97.7	83.8	73.3	65.2	58.6	53.3	48.9	41.9	36.7	32.6	32.0	29.3	26.7	24.4	22.6
78.0	83.5	71.5	62.6	55.6	50.1	45.5	41.7	35.8	31.3	27.8	27.3	25.0	22.8	20.9	19.3
84.0	66.8	57.3	50.1	44.6	40.1	36.5	33.4	28.6	25.1	22.3	21.9	20.0	18.2	16.7	15.4
90.0	54.3	46.6	40.7	36.2	32.6	29.6	27.2	23.3	20.4	18.1	17.8	16.3	-	-	-
96.0	44.8	38.4	33.6	29.8	26.9	24.4	22.4	19.2	16.8	-	-	-	-	-	-

NOTES:

1. MULLION CHART APPLIES TO MULLION ASSEMBLIES WHEN USED TO MULL WINDOWS IN TWO-WAY CONFIGURATIONS SHOWN ON SHEET 1 USING ITW TAPCON ANCHORS ONLY. SEE DETAILS D/2, I/3, K/4 & L/4.
2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL WINDOW UNITS OF INSTALLATION
5. FOR CONCRETE/MASONRY INSTALLATION USE TWO (2) 1/4" DIAMETER ITW TAPCON SCREWS AT EACH ANCHOR CLIP. TAPCONS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 1-1/4" EMBEDMENT AND MINIMUM 2-1/2" EDGE DISTANCE. SEE DETAILS D/2 & I/3.
6. FOR TWO-WAY CONNECTION OF U-CLIP TO MULLION USE TWO (2) 1/4" TEK SCREWS AT EACH ANCHOR CLIP. TEK SCREWS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND ALUMINUM MULLION STRUCTURE. SEE DETAILS K/4 & L/4.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

7.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.1 (e.g., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

7.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.2 (e.g., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).



ATRIUM
WINDOWS & DOORS

ATRIUM WINDOWS AND DOORS

9001 AMBASSADOR ROW
DALLAS, TEXAS 75247

PH: (214)637-2696 FAX: (214)424-6734

TITLE:
130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL

TWO-WAY MULL TABLES
(TAPCONS ONLY)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.



HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
22377

DATE:
10.03.17

DWG. BY:
AR/AG

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
ATR110

SECTION:
7

OF 8

Maximum design pressure capacity chart (psf)
Two-Way Mullions (All other anchors)

L - Mull Length (in)	W - Tributary Width (in)														
	18.0	21.0	24.0	27.0	30.0	33.0	36.0	42.0	48.0	54.0	55.0	60.0	66.0	72.0	78.0
24.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0
30.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	146.0
36.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	143.8	131.8	121.6
42.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	143.1	140.5	128.8	117.1	107.3	99.1
48.0	150.0	150.0	150.0	150.0	150.0	150.0	150.0	140.9	123.3	109.6	107.6	98.6	89.7	82.2	75.9
54.0	150.0	150.0	150.0	150.0	150.0	137.2	125.8	107.8	94.3	83.8	82.3	75.5	68.6	62.9	58.0
60.0	150.0	150.0	137.5	122.2	110.0	100.0	91.7	78.6	68.8	61.1	60.0	55.0	50.0	45.8	42.3
66.0	137.8	118.1	103.3	91.8	82.7	75.1	68.9	59.0	51.7	45.9	45.1	41.3	37.6	34.4	31.8
72.0	106.1	91.0	79.6	70.7	63.7	57.9	53.1	45.5	39.8	35.4	34.7	31.8	28.9	26.5	24.5
74.0	97.7	83.8	73.3	65.2	58.6	53.3	48.9	41.9	36.7	32.6	32.0	29.3	26.7	24.4	22.6
78.0	83.5	71.5	62.6	55.6	50.1	45.5	41.7	35.8	31.3	27.8	27.3	25.0	22.8	20.9	19.3
84.0	66.8	57.3	50.1	44.6	40.1	36.5	33.4	28.6	25.1	22.3	21.9	20.0	18.2	16.7	15.4
90.0	54.3	46.6	40.7	36.2	32.6	29.6	27.2	23.3	20.4	18.1	17.8	16.3	-	-	-
96.0	44.8	38.4	33.6	29.8	26.9	24.4	22.4	19.2	16.8	-	-	-	-	-	-

NOTES:

1. MULLION CHART APPLIES TO MULLION ASSEMBLIES WHEN USED TO MULL WINDOWS IN TWO-WAY CONFIGURATIONS SHOWN ON SHEET 1 USING ALL OTHER ANCHOR OPTIONS. SEE DETAILS C/2, E/2, H/3, J/3, K/4, & L/4.
2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL WINDOW UNITS OF INSTALLATION UNDER SEPARATE APPROVAL.
5. FOR WOOD FRAME INSTALLATION USE THREE (3) #14 WOOD SCREWS AT EACH ANCHOR CLIP. WOOD SCREWS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 1-1/2" EMBEDMENT AND MINIMUM 3/4" EDGE DISTANCE. SEE DETAILS C/2 & H/3.
6. FOR STEEL STUD INSTALLATION USE THREE (3) 1/4" TEK SCREWS AT EACH ANCHOR CLIP. TEK SCREWS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND STEEL STRUCTURE EMBEDMENT AND MINIMUM 1/2" EDGE DISTANCE. SEE DETAILS C/2 & H/3.
5. FOR CONCRETE INSTALLATION USE ONE (1) 3/8" DIAMETER HILTI KWIK BOLT III EXPANSION ANCHOR AT EACH ANCHOR CLIP. BOLTS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 2-1/2" EMBEDMENT AND MINIMUM 2-1/2" EDGE DISTANCE. SEE DETAILS E/2 & J/3.
6. FOR GROUT-FILLED CMU INSTALLATION USE ONE (1) 3/8" DIAMETER HILTI KWIK BOLT III EXPANSION ANCHOR AT EACH ANCHOR CLIP. BOLTS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM 2-1/2" EMBEDMENT AND MINIMUM 3-1/2" EDGE DISTANCE. SEE DETAILS E/2 & J/3.
7. FOR TWO-WAY CONNECTION OF U-CLIP TO MULLION USE TWO (2) 1/4" TEK SCREWS AT EACH ANCHOR CLIP. TEK SCREWS SHALL BE OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND ALUMINUM MULLION STRUCTURE. SEE DETAILS K/4 & L/4.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

8.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.1 (e.g., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

8.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH FLORIDA BUILDING CODE SECTION 1711.1.2 (e.g., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).



ATRIUM
WINDOWS & DOORS

ATRIUM WINDOWS AND DOORS

9001 AMBASSADOR ROW
DALLAS, TEXAS 75247

PH: (214)637-2696 FAX: (214)424-6734

TITLE:
130 1.25" TUBE MULLION
VERTICAL & HORIZONTAL


TWO-WAY MULL TABLES
(ALL OTHER ANCHORS)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-FBC 5th ED.CODE CHANGE	SM	06.03.14
B-ADDITIONAL SIZING	LS	04.14.16
C-FBC 2017 CODE CHANGE	AG	10.03.17
D-CURRENT FBC	LH	07.20.26

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

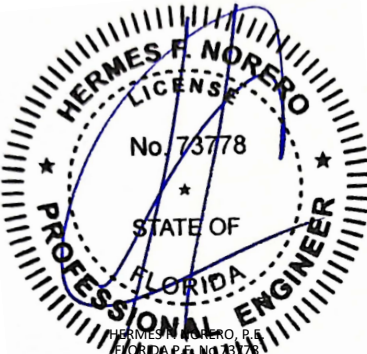

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
22377

DATE:
10.03.17

DWG. BY:
AR/AG

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
ATR110

SECTION:


OF 8