



1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
2. WHEN INSTALLED IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS REQUIRED.
3. WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION, EXCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM IS NOT REQUIRED.
4. POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.

* COMPARATIVE TENSILE STRENGTH AFTER WEATHERING
4500 HOURS XENON ARC METHOD 1



12-1-2023
NO. 3
Kot L. Bhatnag
STATE OF
FLORIDA

DATE:	4/24/17
SCALE:	N.T.S.
DWG. BY:	SWS
CHK. BY:	
DRAWING NO.:	
DWG-MA-FLO210-17	
SHEET	1 OF 3

MASONITE INTERNATIONAL CORP.
1955 POWIS ROAD
WEST CHICAGO, IL 60185

PRODUCT: "EXTERIOR DOOR PRODUCT"
SINGLE OPAQUE
FIBERGLASS DOOR


PART OR ASSEMBLY:
TYPICAL ELEVATIONS
& GENERAL NOTES

REVISIONS


BY

DATE _____


on

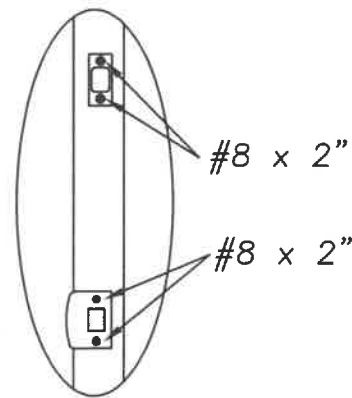


DETAIL "D"

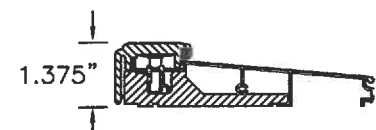


INSWING THRESHOLD

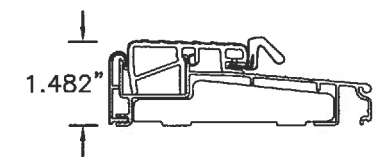


Z-SERIES O/S THRESHOLD

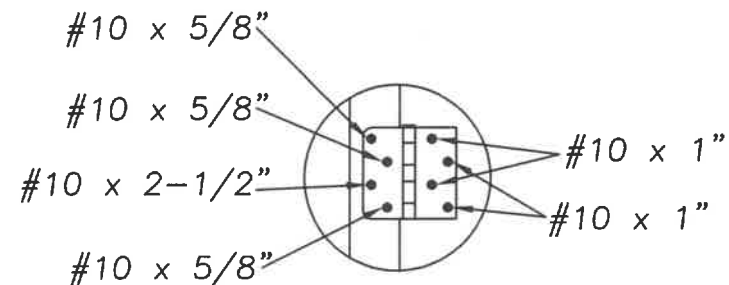


DETAIL "C"

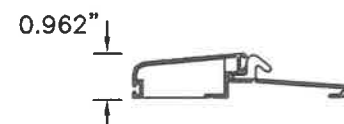



BUMPER O/S THRESHOLD

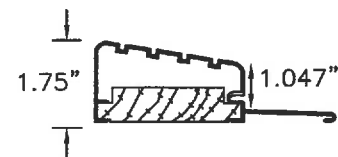


HIGH DAM O/S THRESHOLD

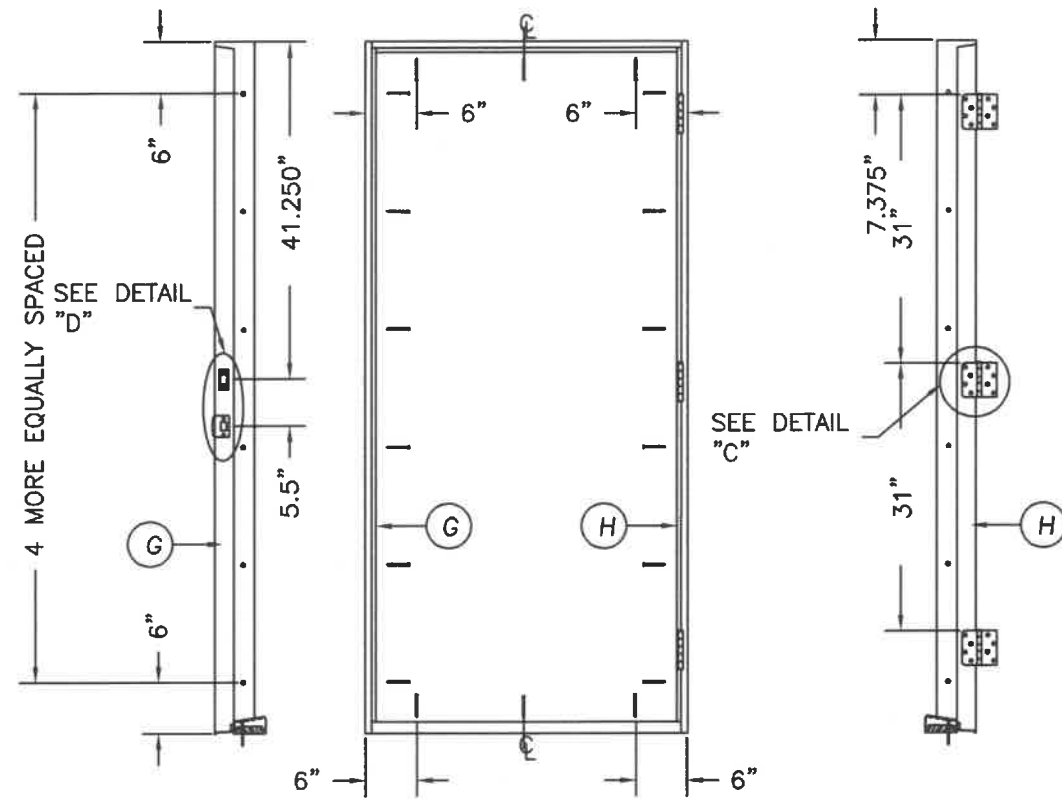

6'-8" HEIGHT UNIT

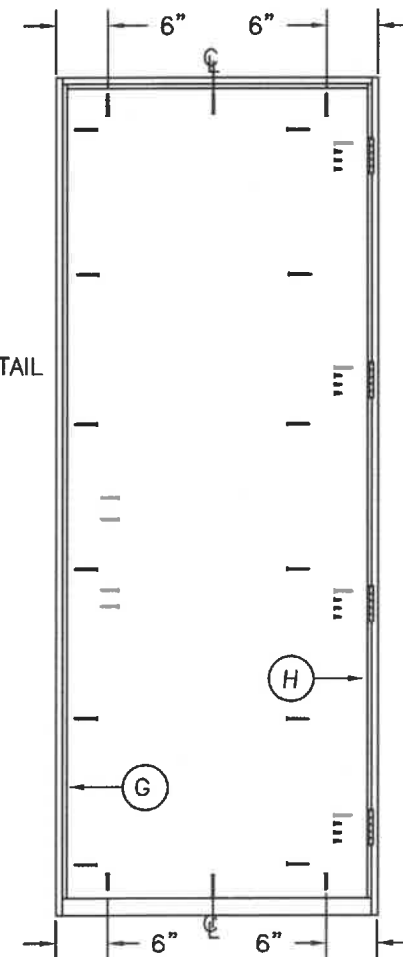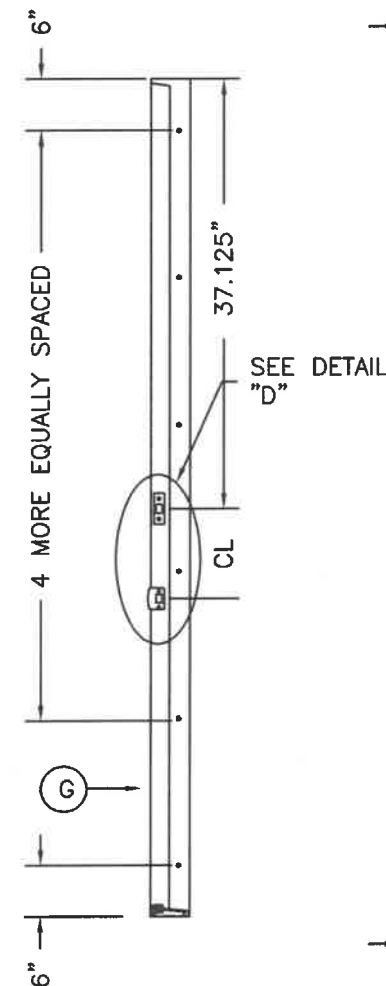

8'-0" HEIGHT UNIT

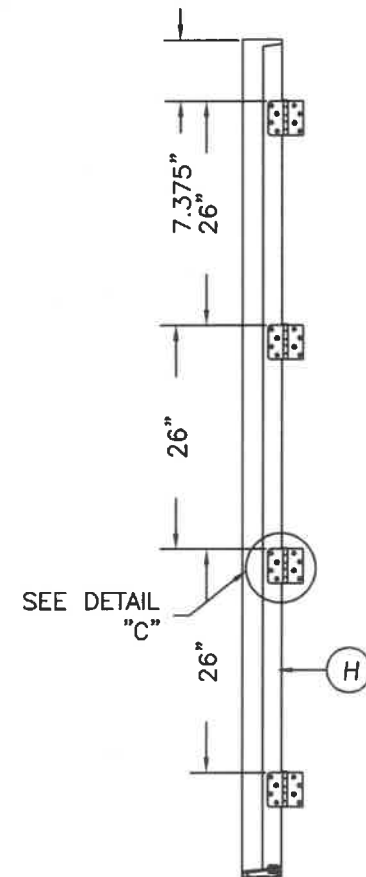

MASONITE INTERNATIONAL CORP.
1955 POWIS ROAD
WEST CHICAGO, IL 60185

PRODUCT:
"EXTERIOR DOOR PRODUCT"
FIBERGLASS OPAQUE
SINGLE DOOR UNIT
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

REVISIONS			
NO.	DATE	BY	

DATE: 4/24/17
SCALE: N.T.S.
DWG. BY: SWS
CHK. BY:
DRAWING NO.:
DWG-MA-FL0210-17
SHEET 2 OF 3

