




"COASTAL IMPACT DOORS"
WOOD GLAZED OR OPAQUE
DOUBLE DOOR
w/ TRANSOM
INSWING/OUTSWING
"IMPACT"

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details
3	Transon Panel Details
4	Elevations
5	Horizontal & Vertical Cross Sections (2X Buck)
6	Vertical Cross Sections (Thresholds)
7	Buck & Frame Anchoring
8	Hardware Details
9	Bill of Materials & Components

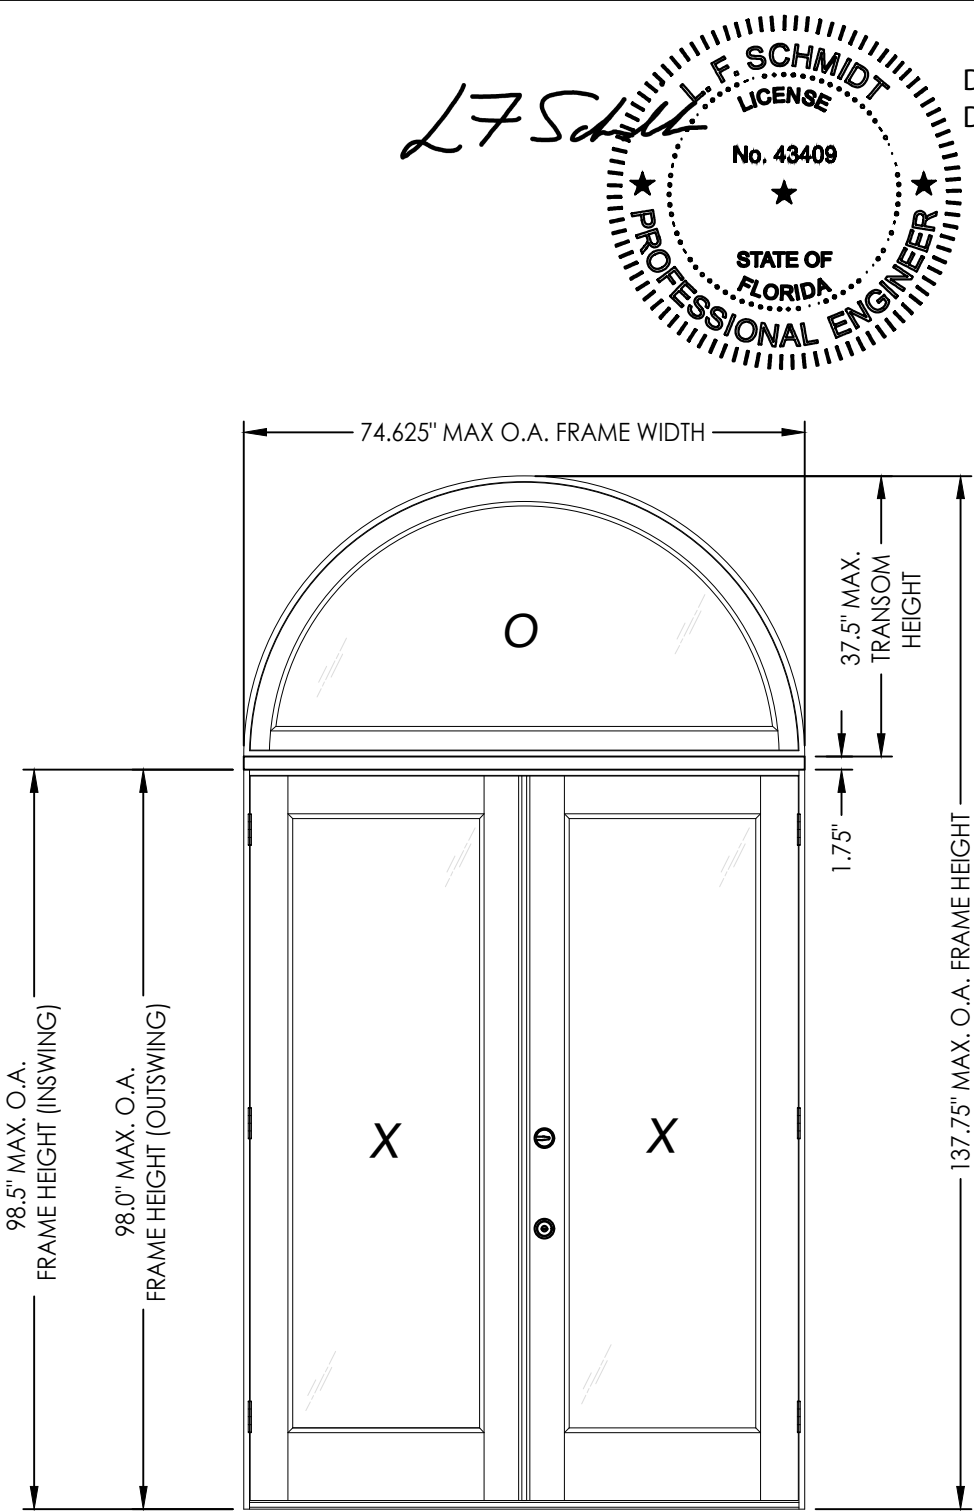

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
$\frac{O}{XX}$	+50.0	-50.0	+50.0	-50.0

Digitally signed by Lyndon F Schmidt
Date: 2023.09.27 10:29:31 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33486
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ALL PHASE CUSTOM MILL SHOP
"Impact" Wood Doors

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

[illegible]

DATE: 6/5/17

SCALE: *N.T.S.*

DWG. BY: JK













CHK. BY: LFS

DRAWING NO.:

FL=22595.

© 2017 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\All Phase Custom Mill Shop\FL-22393 R3\FL-22393.4-5.dwg

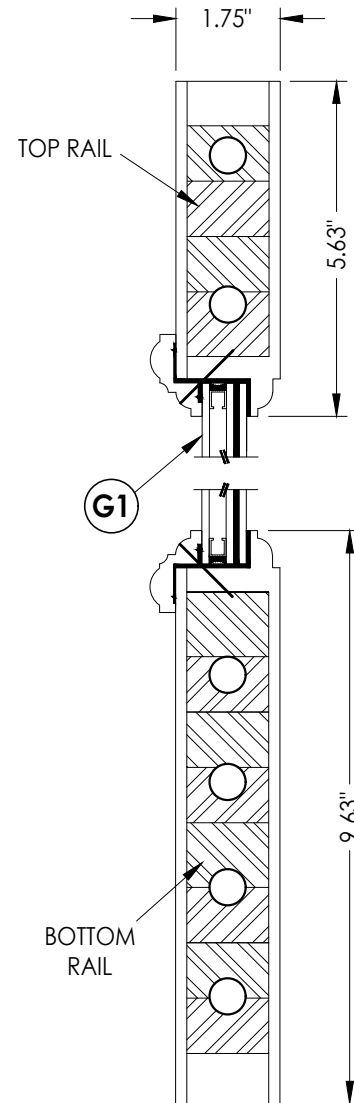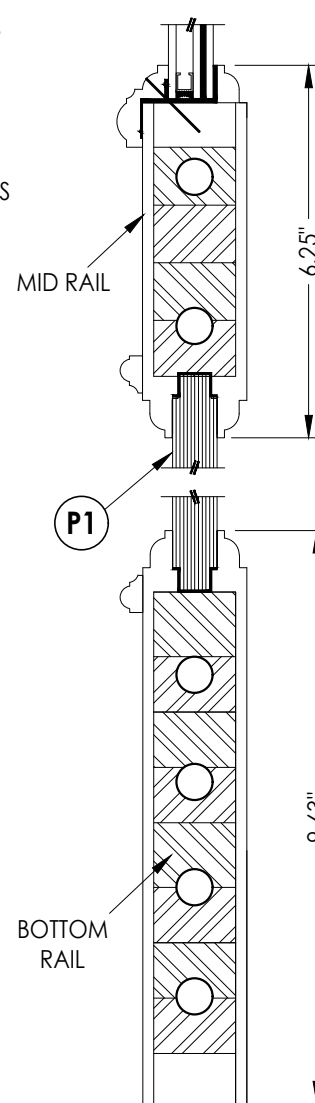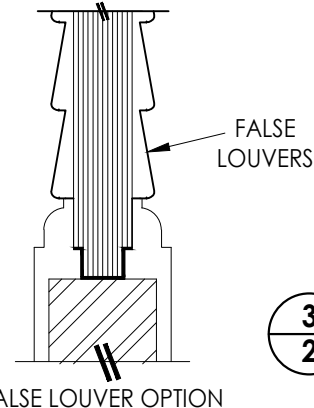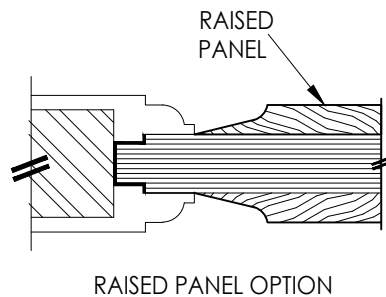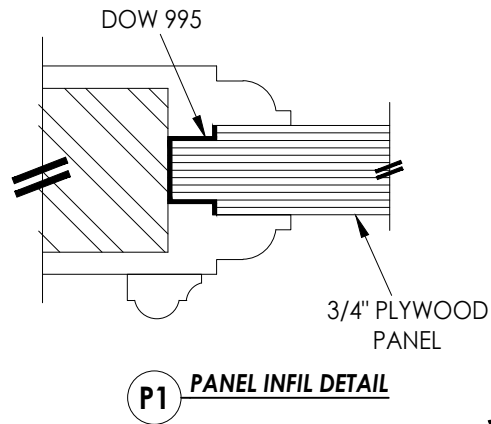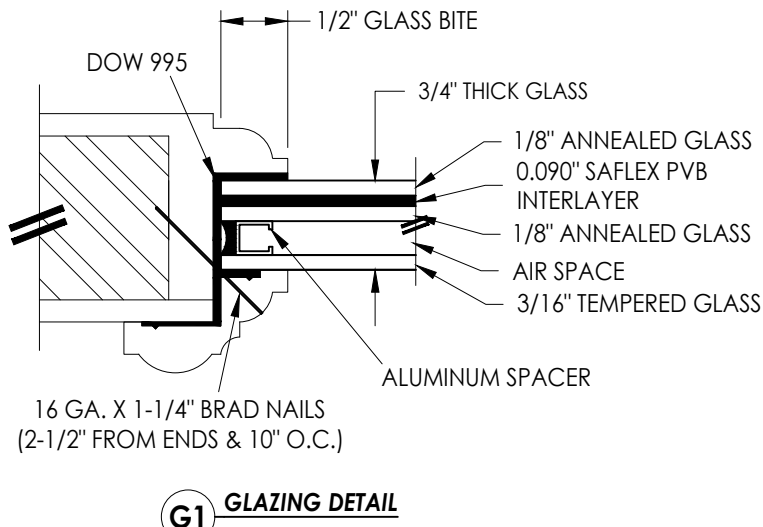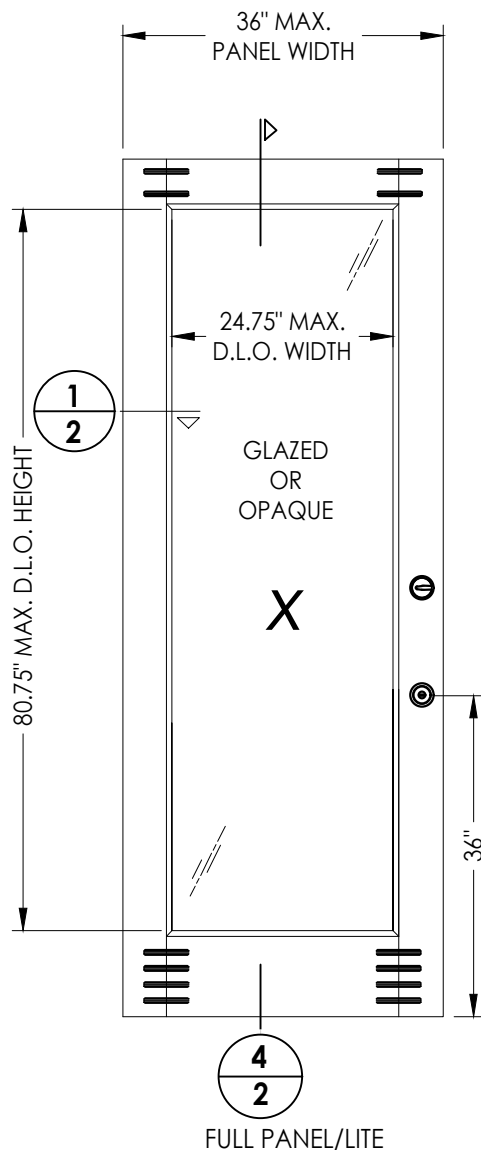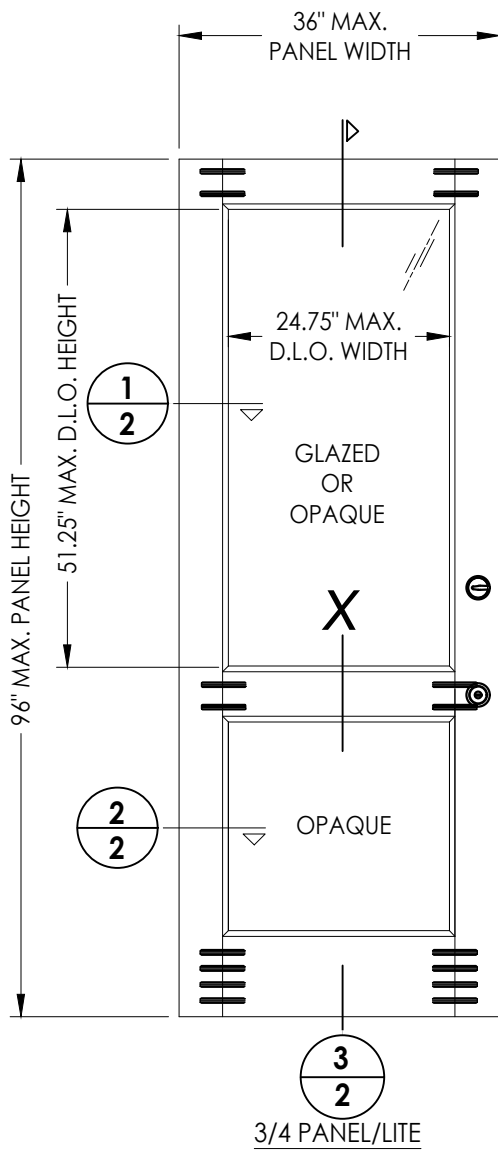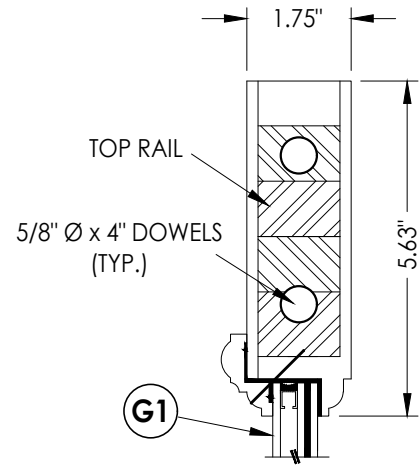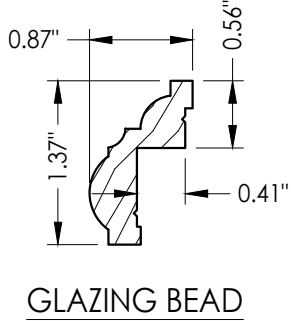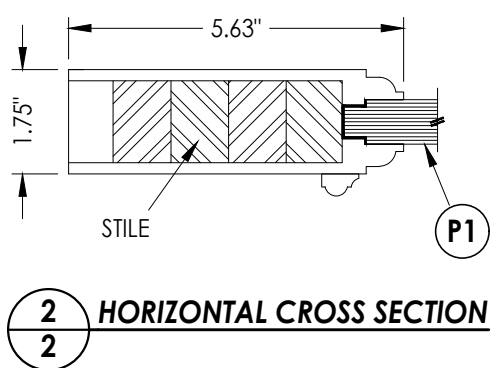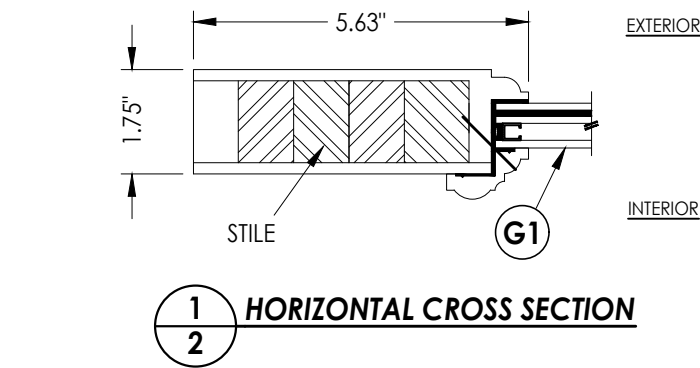

WOOD DOOR COMPONENTS:
VENEER/EDGES: CYPRESS (G = 0.42)
ENGINEERED STAVE CORE: SIPO (UTILE) (G = 0.53)

40 **WOOD DOOR PANEL**
Glazed or Opaque

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
ALL PHASE CUSTOM MILL SHOP
"Impact" Wood Doors

PART OR ASSEMBLY:

DOOR PANEL
DETAILS

NO.	DATE	REVISIONS			
		BY	CHK.	DATE	DESCRIPTION
3	9/27/23	JK	LFS		UPDATE TO 8TH ED. (2023) FBC
2	9/02/20	JK	LFS		UPDATE TO 7TH ED. (2020) FBC
1	10/12/17	JK	LFS		UPDATE TO 6TH ED. (2017) FBC

DATE: 6/5/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-22393.5


SHEET 2 OF 9

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


© 2017 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\All Phase Custom Mill Shop\FL-22393 R3\FL-22393.4-5.dwg


WOOD TRANSOM COMPONENTS:
VENEER/EDGES: CYPRESS (G = 0.42)
ENGINEERED STAVE CORE: SIPO (UTILE) (G = 0.53)

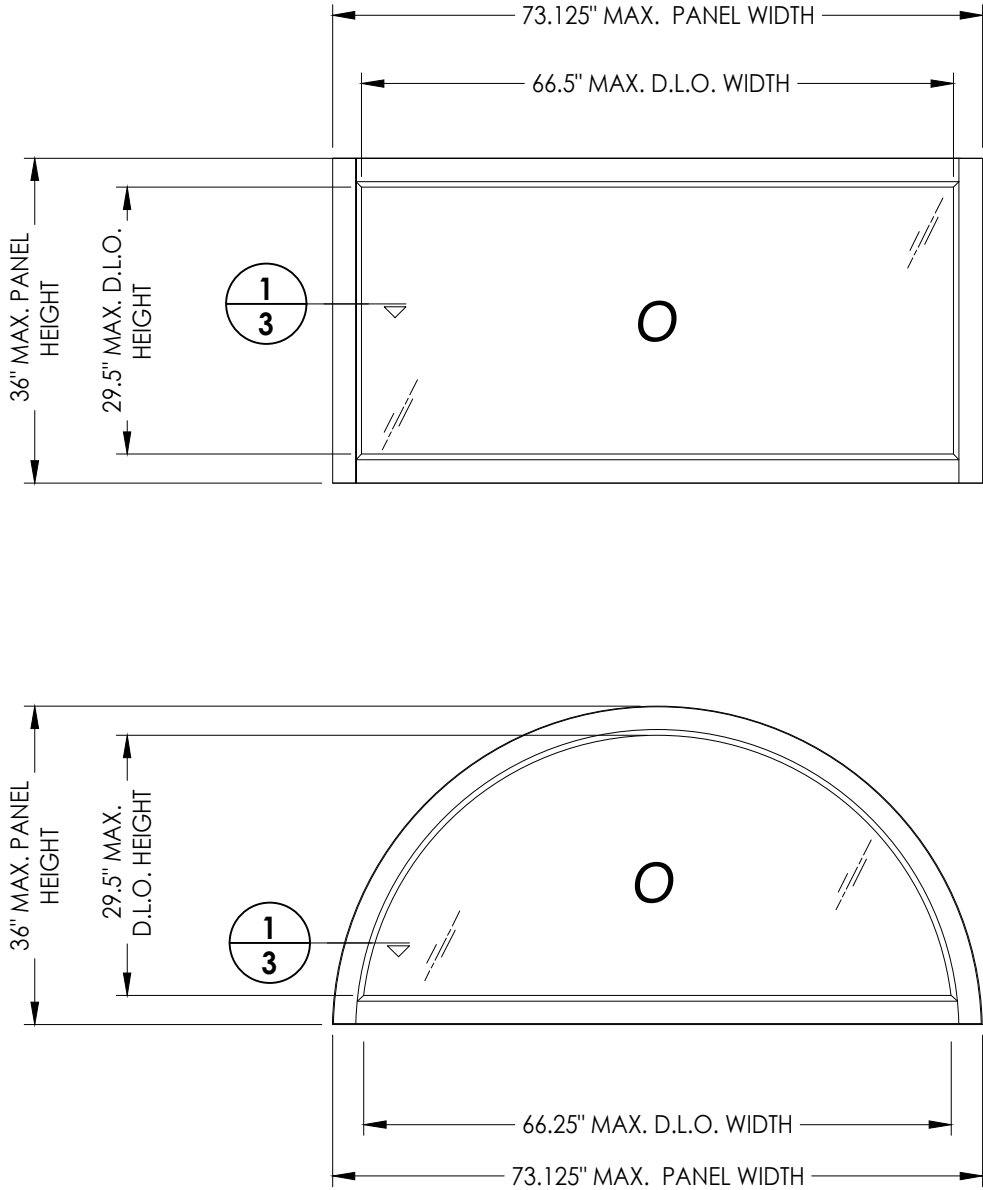

70 WOOD TRANSOM PANEL



GLAZING BEAD

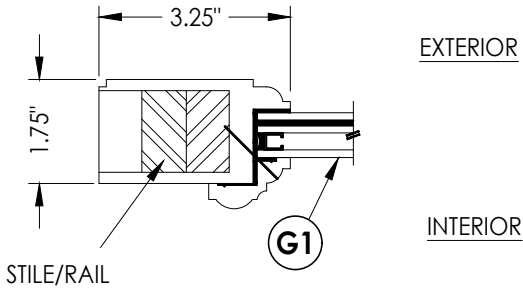

1 3 HORIZONTAL CROSS SECTION

DATE: 6/5/17	
SCALE: N.T.S.	
DWG. BY: JK	
CHK. BY: LFS	
DRAWING NO.: FL-22393.5	
SHEET 3	OF 9



NO.	DATE	REVISIONS
3	9/27/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	9/02/20	UPDATE TO 7TH ED. (2020) FBC LFS
1	10/12/17	UPDATE TO 6TH ED. (2017) FBC JK
		BY

PRODUCT: ALL PHASE CUSTOM MILL SHOP "Impact" Wood Doors	
PART OR ASSEMBLY: TRANSOM PANEL DETAILS	

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\All Phase Custom Mill Shop\FL-22393 R3\FL-22393.4-5.dwg

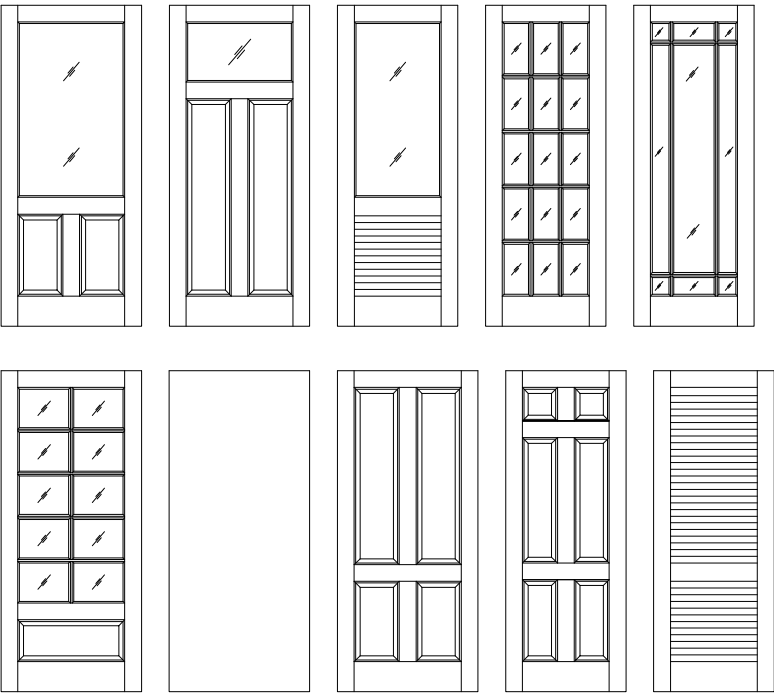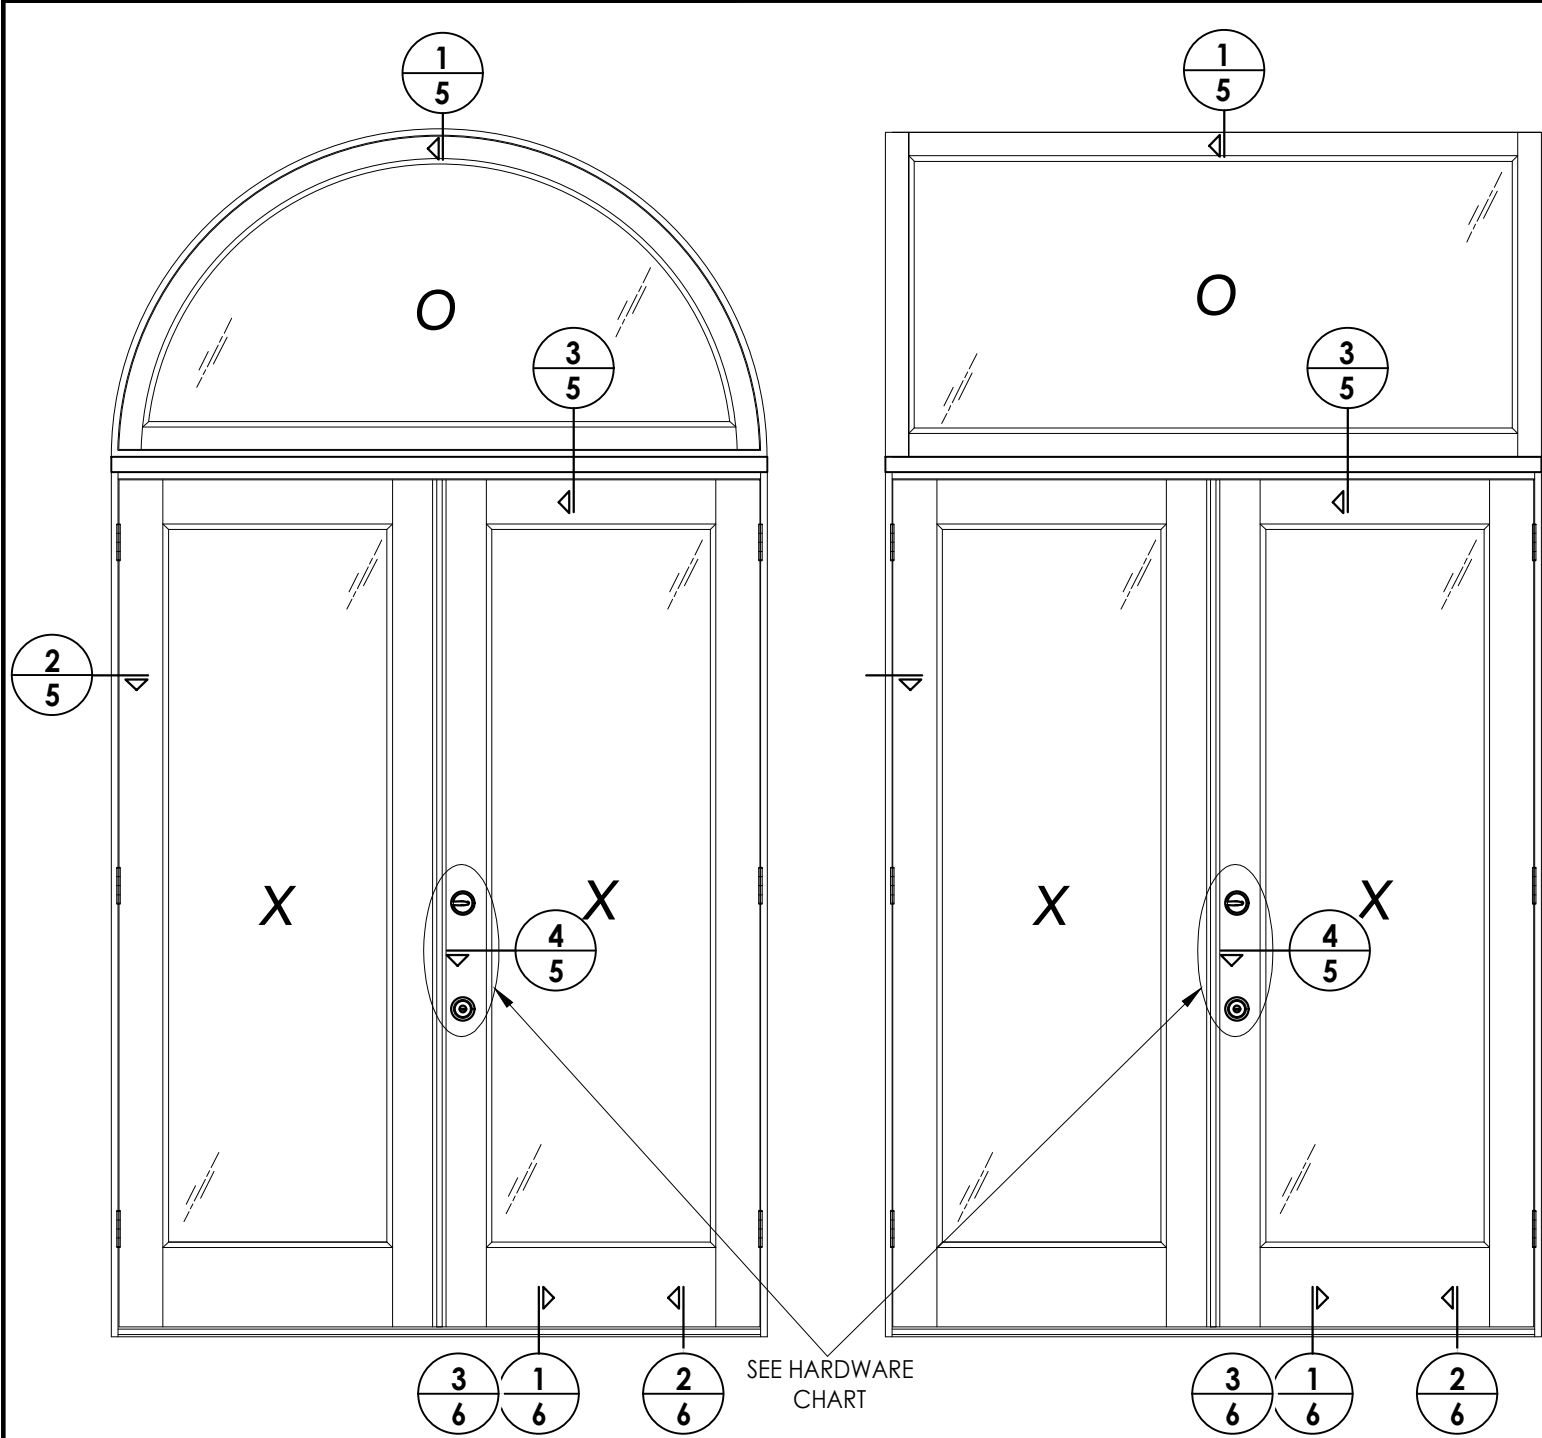

ALL PHASE CUSTOM MILL SHOP Door Panel Options
Panel options shown are for illustration and are representative only.
Surface applied muntins are used for simulated divided lites shown.

HARDWARE TABLE		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)
HOPPE	HLS9000 MULTIPOINT HARDWARE	
	ACTIVE :	TONGUE/SHOOTBOLT
	INACTIVE:	SHOOTBOLT

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
ALL PHASE CUSTOM MILL SHOP
"Impact" Wood Doors

PART OR ASSEMBLY:
ELEVATIONS

DATE: 6/5/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-22393.5

SHEET 4 OF 9

3 9/27/23 UPDATE TO 8TH ED. (2023) FBC LFS

2 9/02/20 UPDATE TO 7TH ED. (2020) FBC LFS

1 10/12/17 UPDATE TO 6TH ED. (2017) FBC JK


NO. DATE

REVISIONS


BY

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\All Phase Custom Mill Shop\FL-22393 R3\FL-22393.4-5.dwg

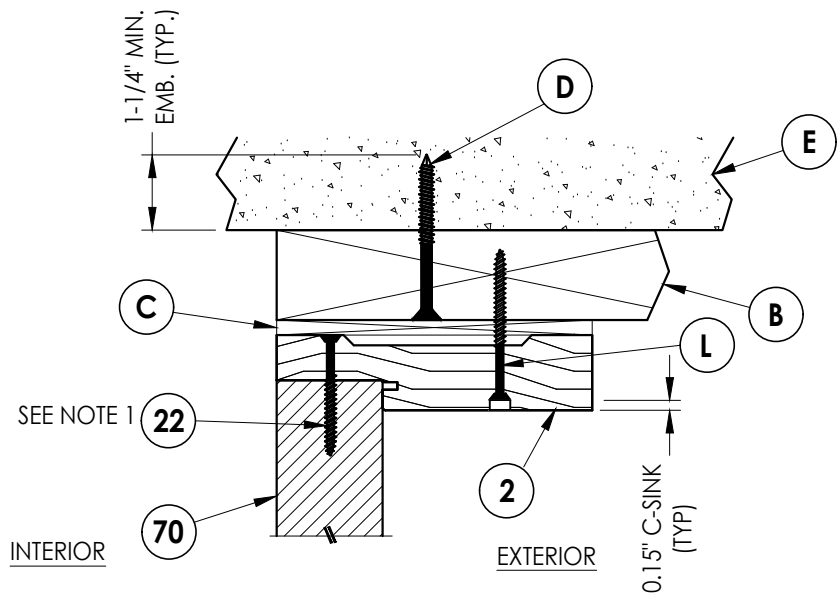


1
5 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Inswing shown (Outswing similar)

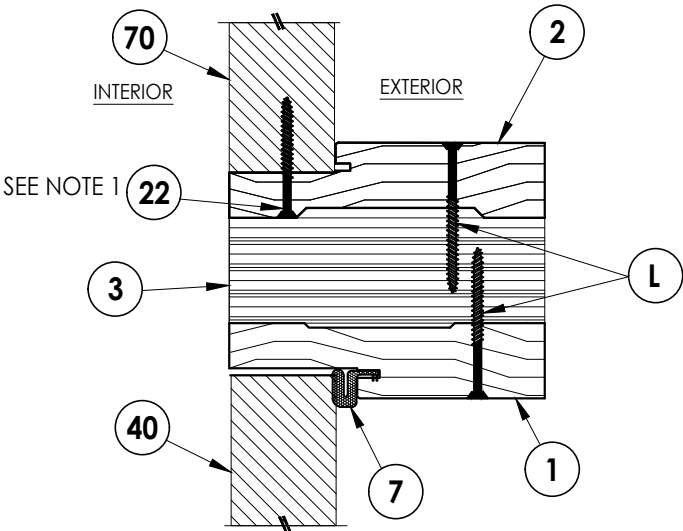

3
5 **VERTICAL CROSS SECTION**
Shown w/ 2X Buck
Inswing shown (Outswing similar)

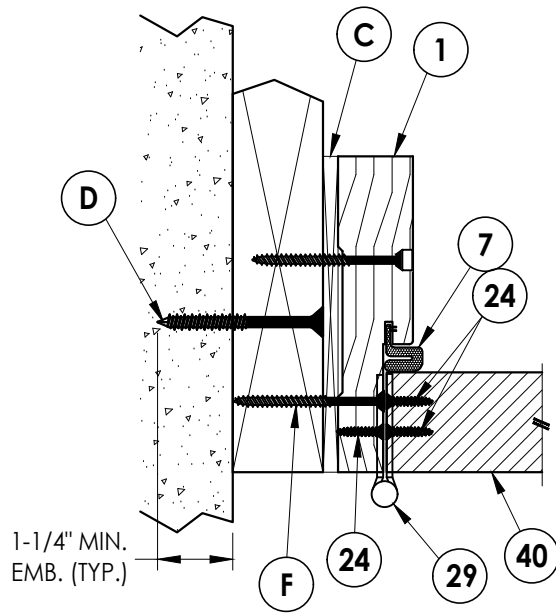

2
5 **HORIZONTAL CROSS SECTION**
Shown w/ 2X Buck
Inswing shown (Outswing similar)

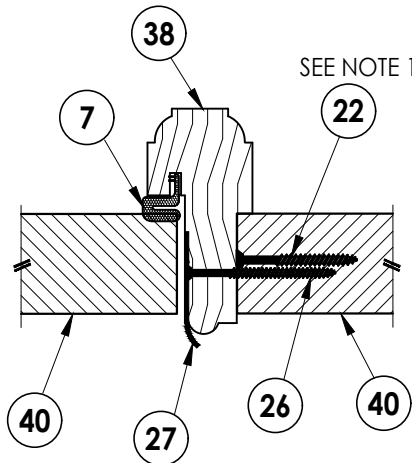

4
5 **HORIZONTAL CROSS SECTION**
Inswing shown (Outswing similar)

NOTE:
1. Item #22 located 4" from each end then 7 more (9 total).

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
ALL PHASE CUSTOM MILL SHOP
"Impact" Wood Doors

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS
3	9/27/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	9/02/20	UPDATE TO 7TH ED. (2020) FBC LFS
1	10/12/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 6/5/17

SCALE: N.T.S.

DWG. BY: JK




CHK. BY: LFS

DRAWING NO.:

FL-22393.5

SHEET 5 OF 9

Z:\2023 FBC Drawings\All Phase Custom Mill Shop\FL-22393 R3\FL-22393.4-5.dwg

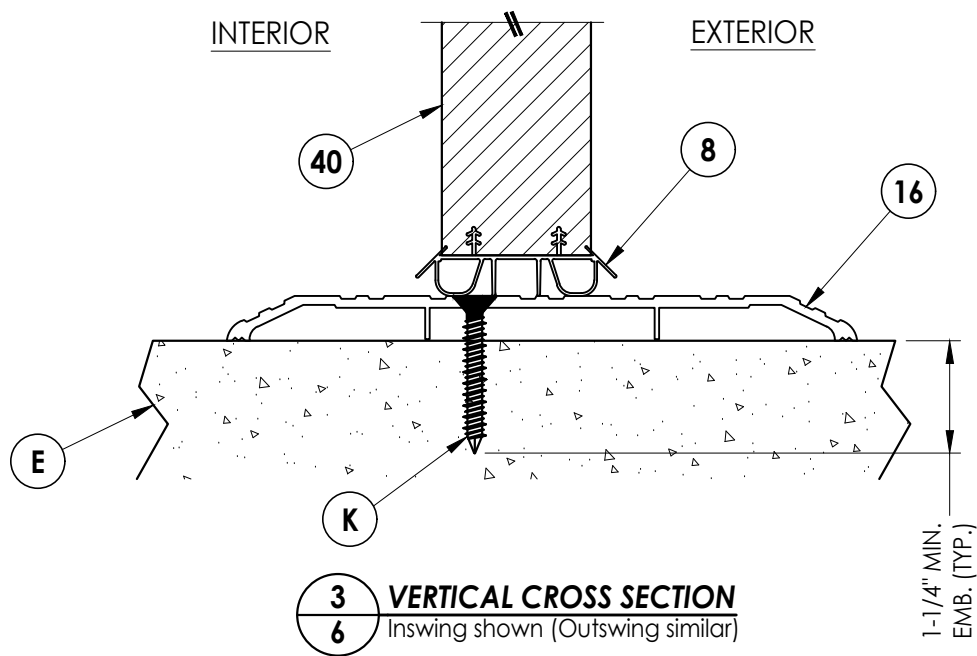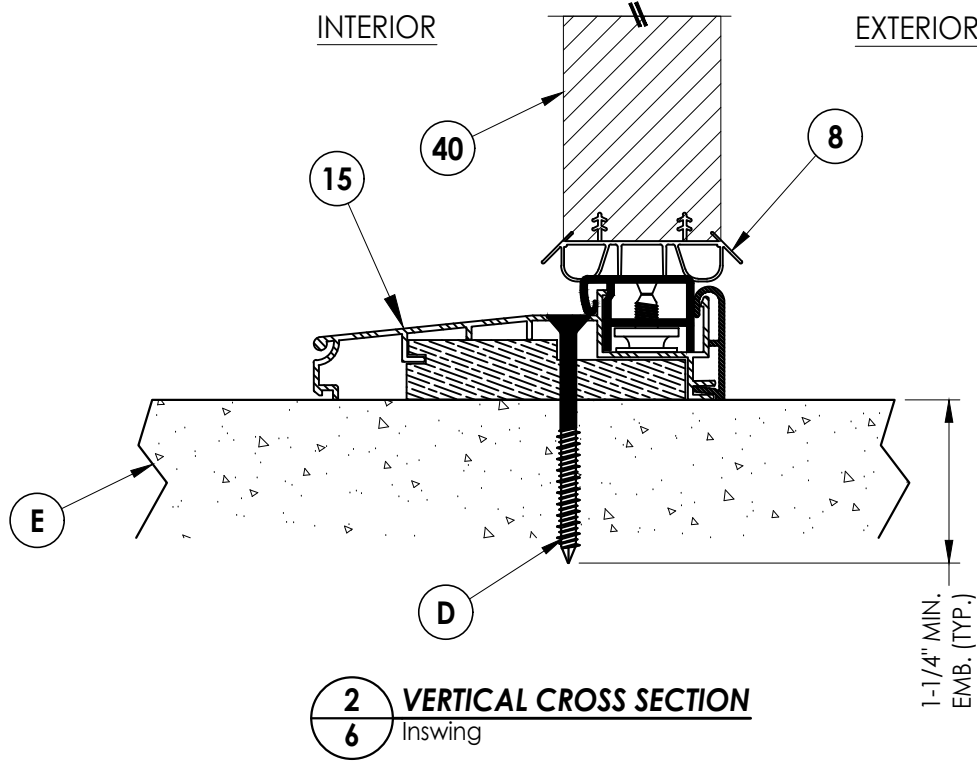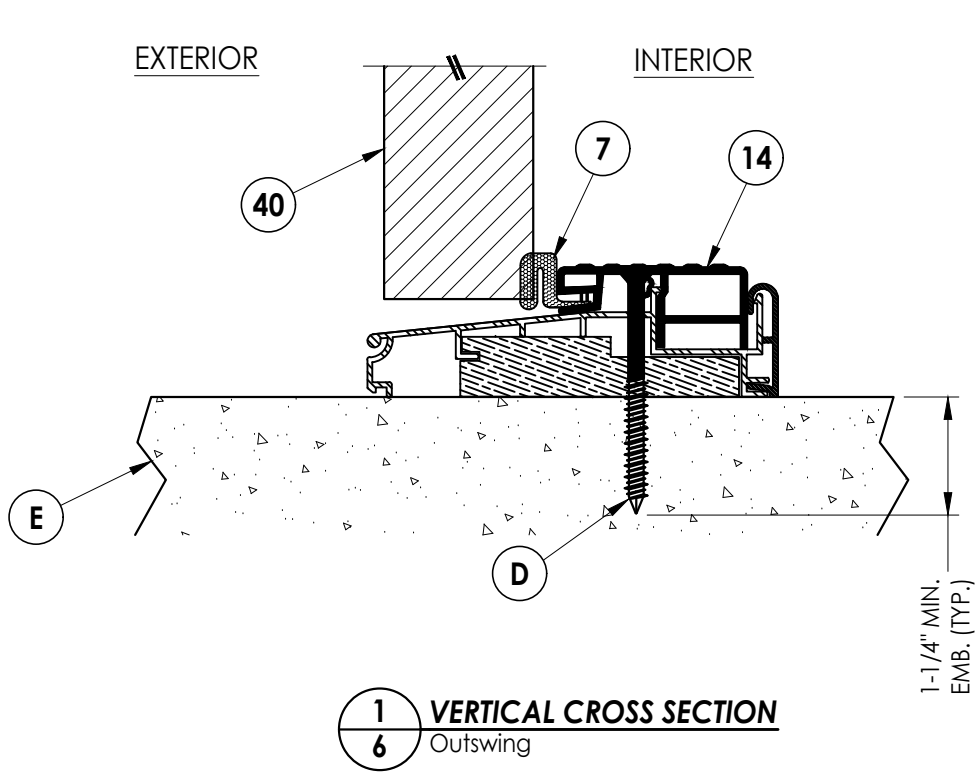

DATE:	6/5/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-21894.5
SHEET	6 OF 9

PRODUCT:	ALL PHASE CUSTOM MILL SHOP "Impact" Wood Doors
PART OR ASSEMBLY:	VERTICAL CROSS SECTIONS (THRESHOLD)



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

NO.	DATE	REVISIONS
3	9/27/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	9/02/20	UPDATE TO 7TH ED. (2020) FBC LFS
1	10/12/17	UPDATE TO 6TH ED. (2017) FBC JK



1. ALL FRAME CORNERS SECURED WITH (3) #8 X 2-1/2" FH DEEP THREAD WOOD SCREWS.

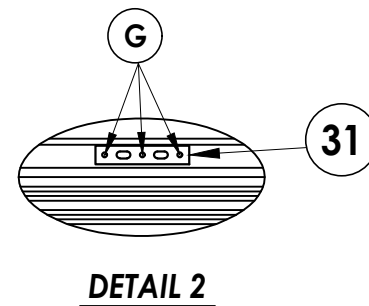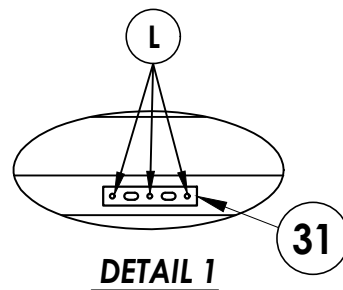


DATE: 6/5/17		PRODUCT: ALL PHASE CUSTOM MILL SHOP "Impact" Wood Doors	
SCALE: N.T.S.		PART OR ASSEMBLY: BUCK & FRAME NCHORING	
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-22393.5			
SHEET 7 OF 9			
3	9/27/23	UPDATE TO 8TH ED. (2023)	FBC LFS
2	9/02/20	UPDATE TO 7TH ED. (2020)	FBC LFS
1	10/12/17	UPDATE TO 6TH ED. (2017)	JK
NO.	DATE		BY
REVISIONS			


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\All Phase Custom Mill Shop\FL-22393 R3\FL-22393.4-5.dwg

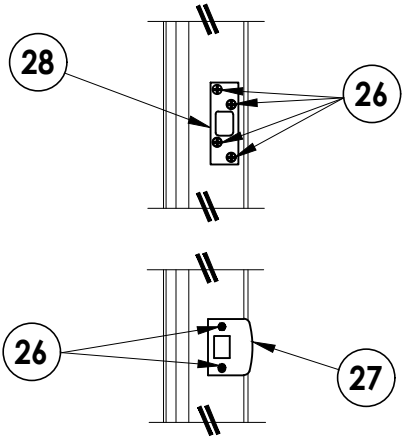


LATCH & DEADBOLT STRIKE PLATE DETAIL

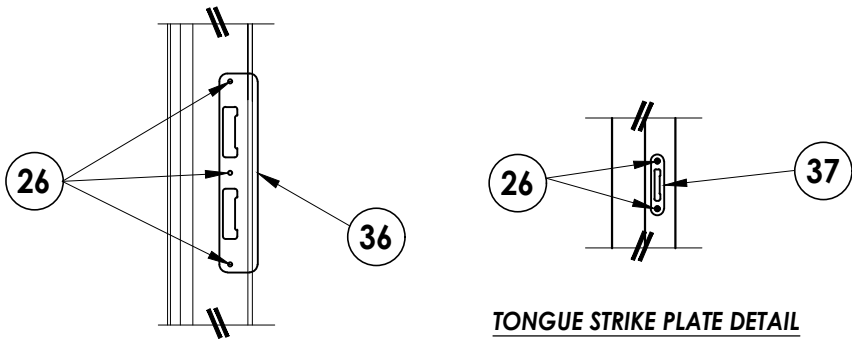


MULTIPOINT STRIKE PLATE DETAIL


TONGUE STRIKE PLATE DETAIL

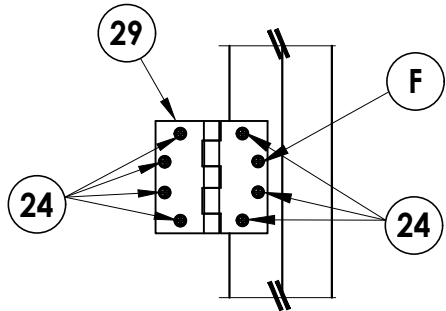


HINGE DETAIL

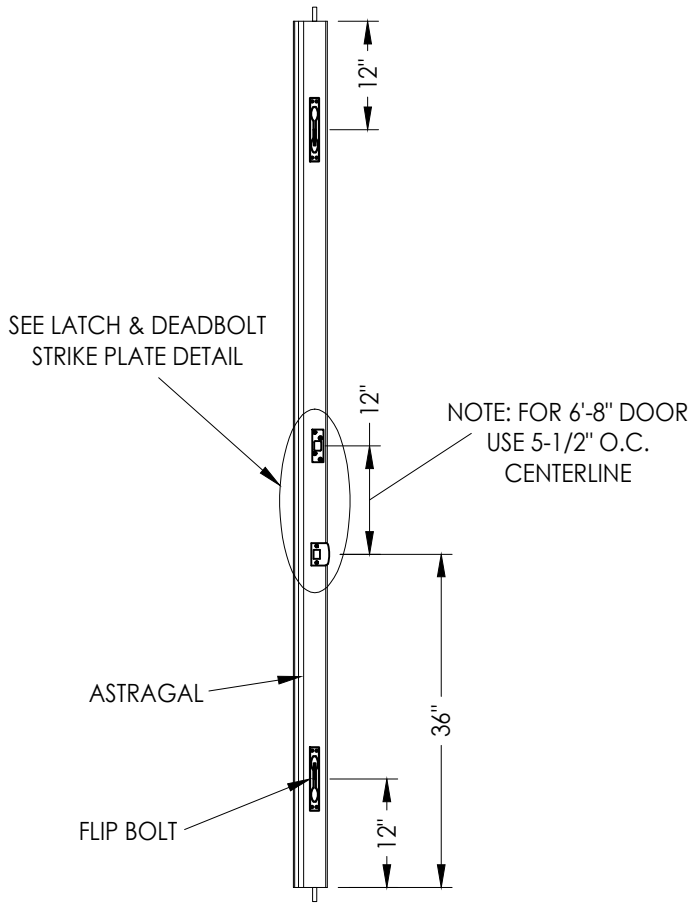

LATCH & DEADBOLT DETAILS

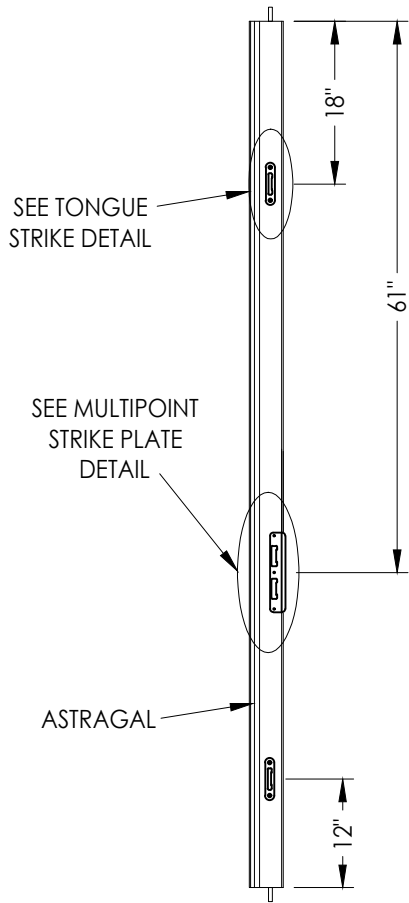

MULTIPOINT LOCK DETAILS

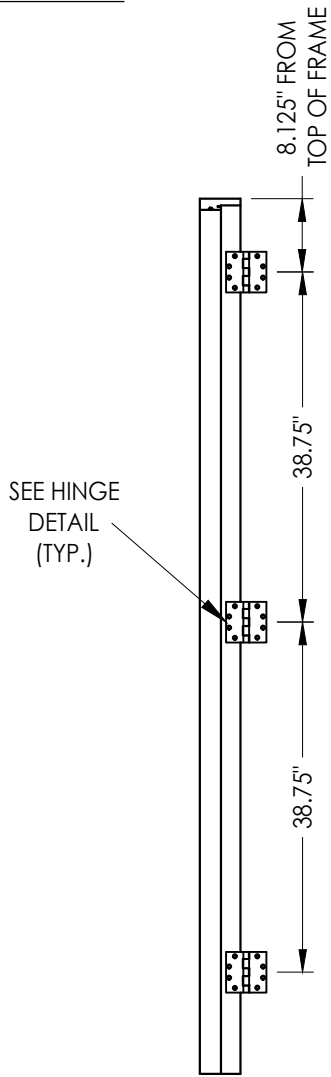

HINGE JAMB

NO.	DATE	REVISIONS
3	9/27/23	UPDATE TO 8TH ED. (2023) FBC
2	9/02/20	UPDATE TO 7TH ED. (2020) FBC
1	10/12/17	UPDATE TO 6TH ED. (2017) FBC
NO.	DATE	BY

DATE: 6/5/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-22393.5

SHEET 8 OF 9

PRODUCT: ALL PHASE CUSTOM MILL SHOP
Impact Wood Doors

PART OR ASSEMBLY: HARDWARE DETAILS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#12 X 2-1/2" PFH WOOD SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
K	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	JAMB (Door)	WOOD
2	JAMB (Transom)	WOOD
3	MULLION	WOOD
7	WEATHERSTRIP	FOAM
8	SWEEP	VINYL
14	OUTSWING THRESHOLD	ALUM/COMP
15	INSWING THRESHOLD	ALUM/COMP
16	ADA THRESHOLD	ALUM
22	#10 X 2" PFH WOOD SCREW	STEEL
24	#12 x 1" PFH WOOD SCREW	STEEL
26	#8 x 2-1/2" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT SECURITY STRIKE PLATE	STEEL
29	4.5" X 4.5" HINGE	STEEL
31	MULITPOINT LOCK SHOOTBOLT STRIKE PLATE	STEEL
36	MULITPOINT LOCK STRIKE PLATE	STEEL
37	MULTIPOINT LOCK TONGUE STRIKE PLATE	STEEL
38	ASTRAGAL	WOOD
40	DOOR PANEL	-
70	TRANSOM PANEL	-

WOOD FRAME COMPONENTS: SIPO (UTILE) ($G = 0.53$)








CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

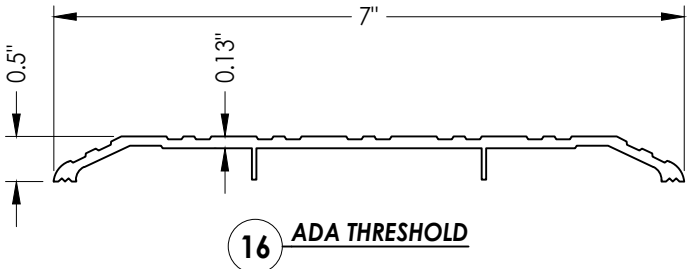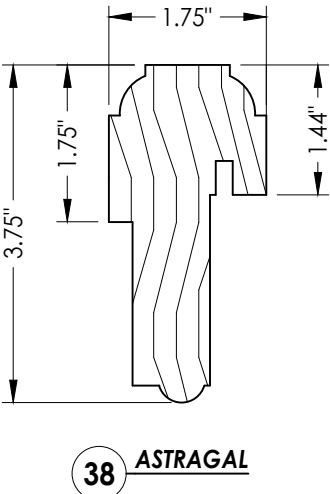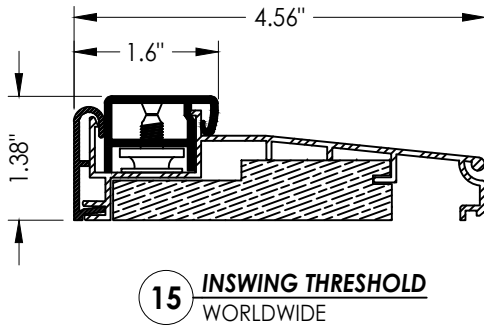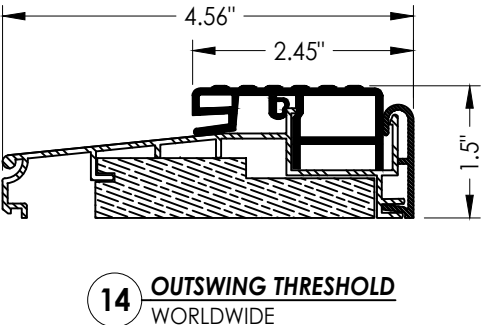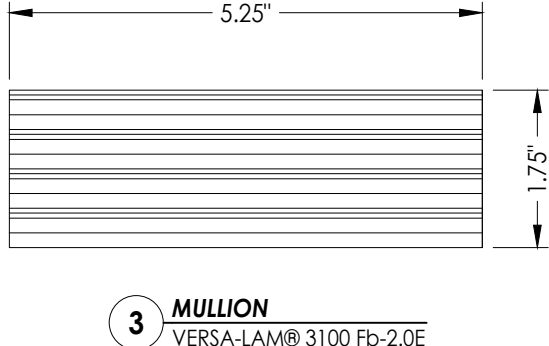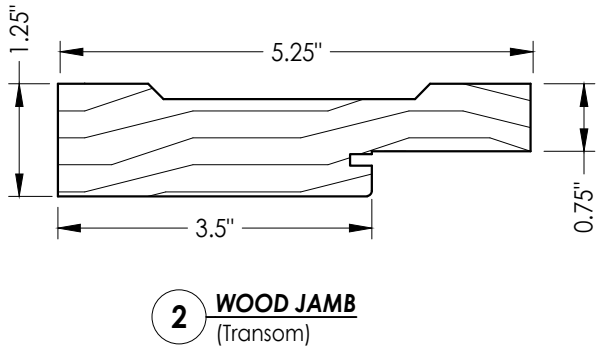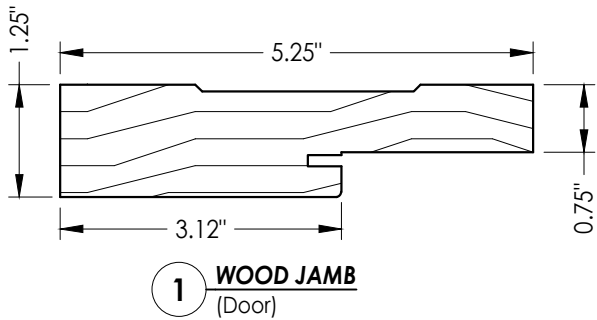

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: ALL PHASE CUSTOM MILL SHOP "Impact" Wood Doors		PART OR ASSEMBLY: BILL OF MATERIALS & COMPONENTS	
3	9/27/23	UPDATE TO 8TH ED. (2023)	FBC LFS
2	9/02/20	UPDATE TO 7TH ED. (2020)	FBC LFS
1	10/12/17	UPDATE TO 6TH ED. (2017)	FBC JK
NO.	DATE		BY
			REVISIONS
DATE: 6/5/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-22393.5			
SHEET 9 OF 9			