


$$\text{PANEL HEIGHT} = \text{DOOR FRAME HEIGHT} - 1.250''$$

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

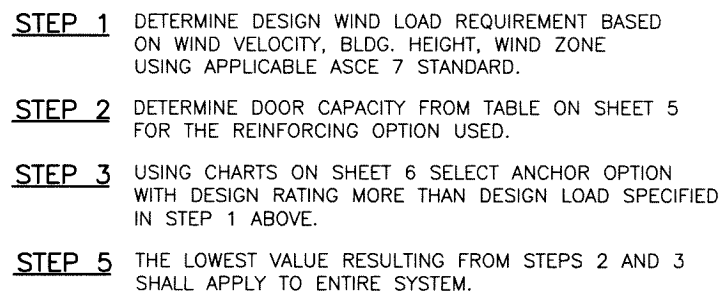



A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

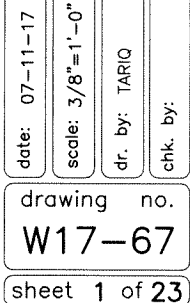

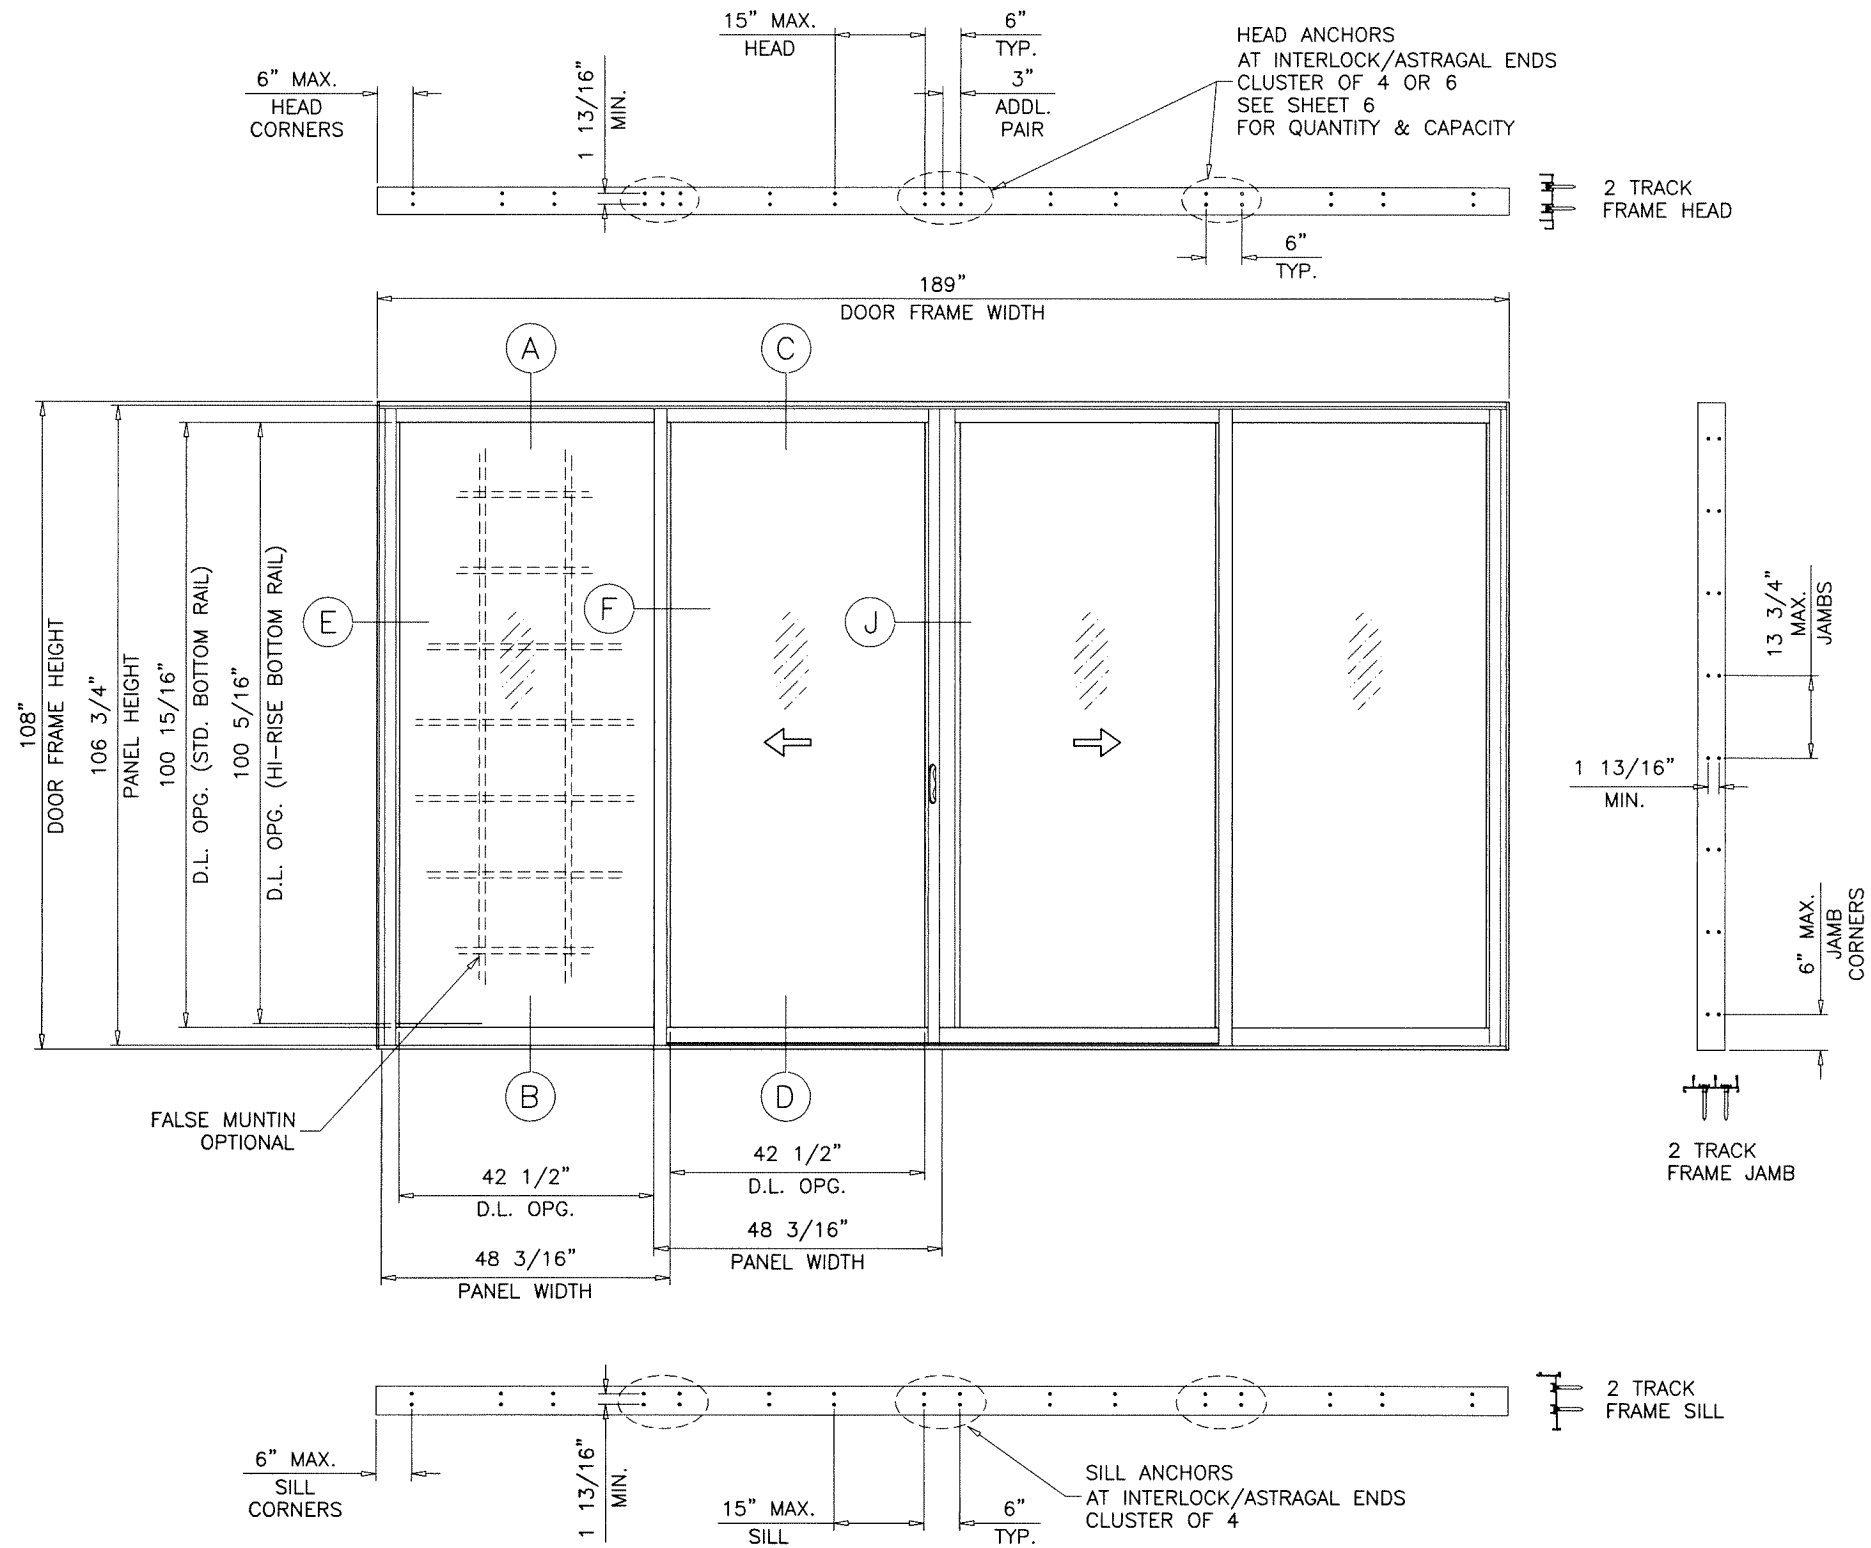

TYPICAL ELEVATION
OX—XO

Sealed: 12/11/2025



FL #22645

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX

FAX. (305) 638-5158

date: 07-11-17

scale: 3/8" = 1'-0"

dr. by: TARIQ

chk. by:


revisions:

no	date	by	description

drawing no.


W17-67

sheet 2 of 23

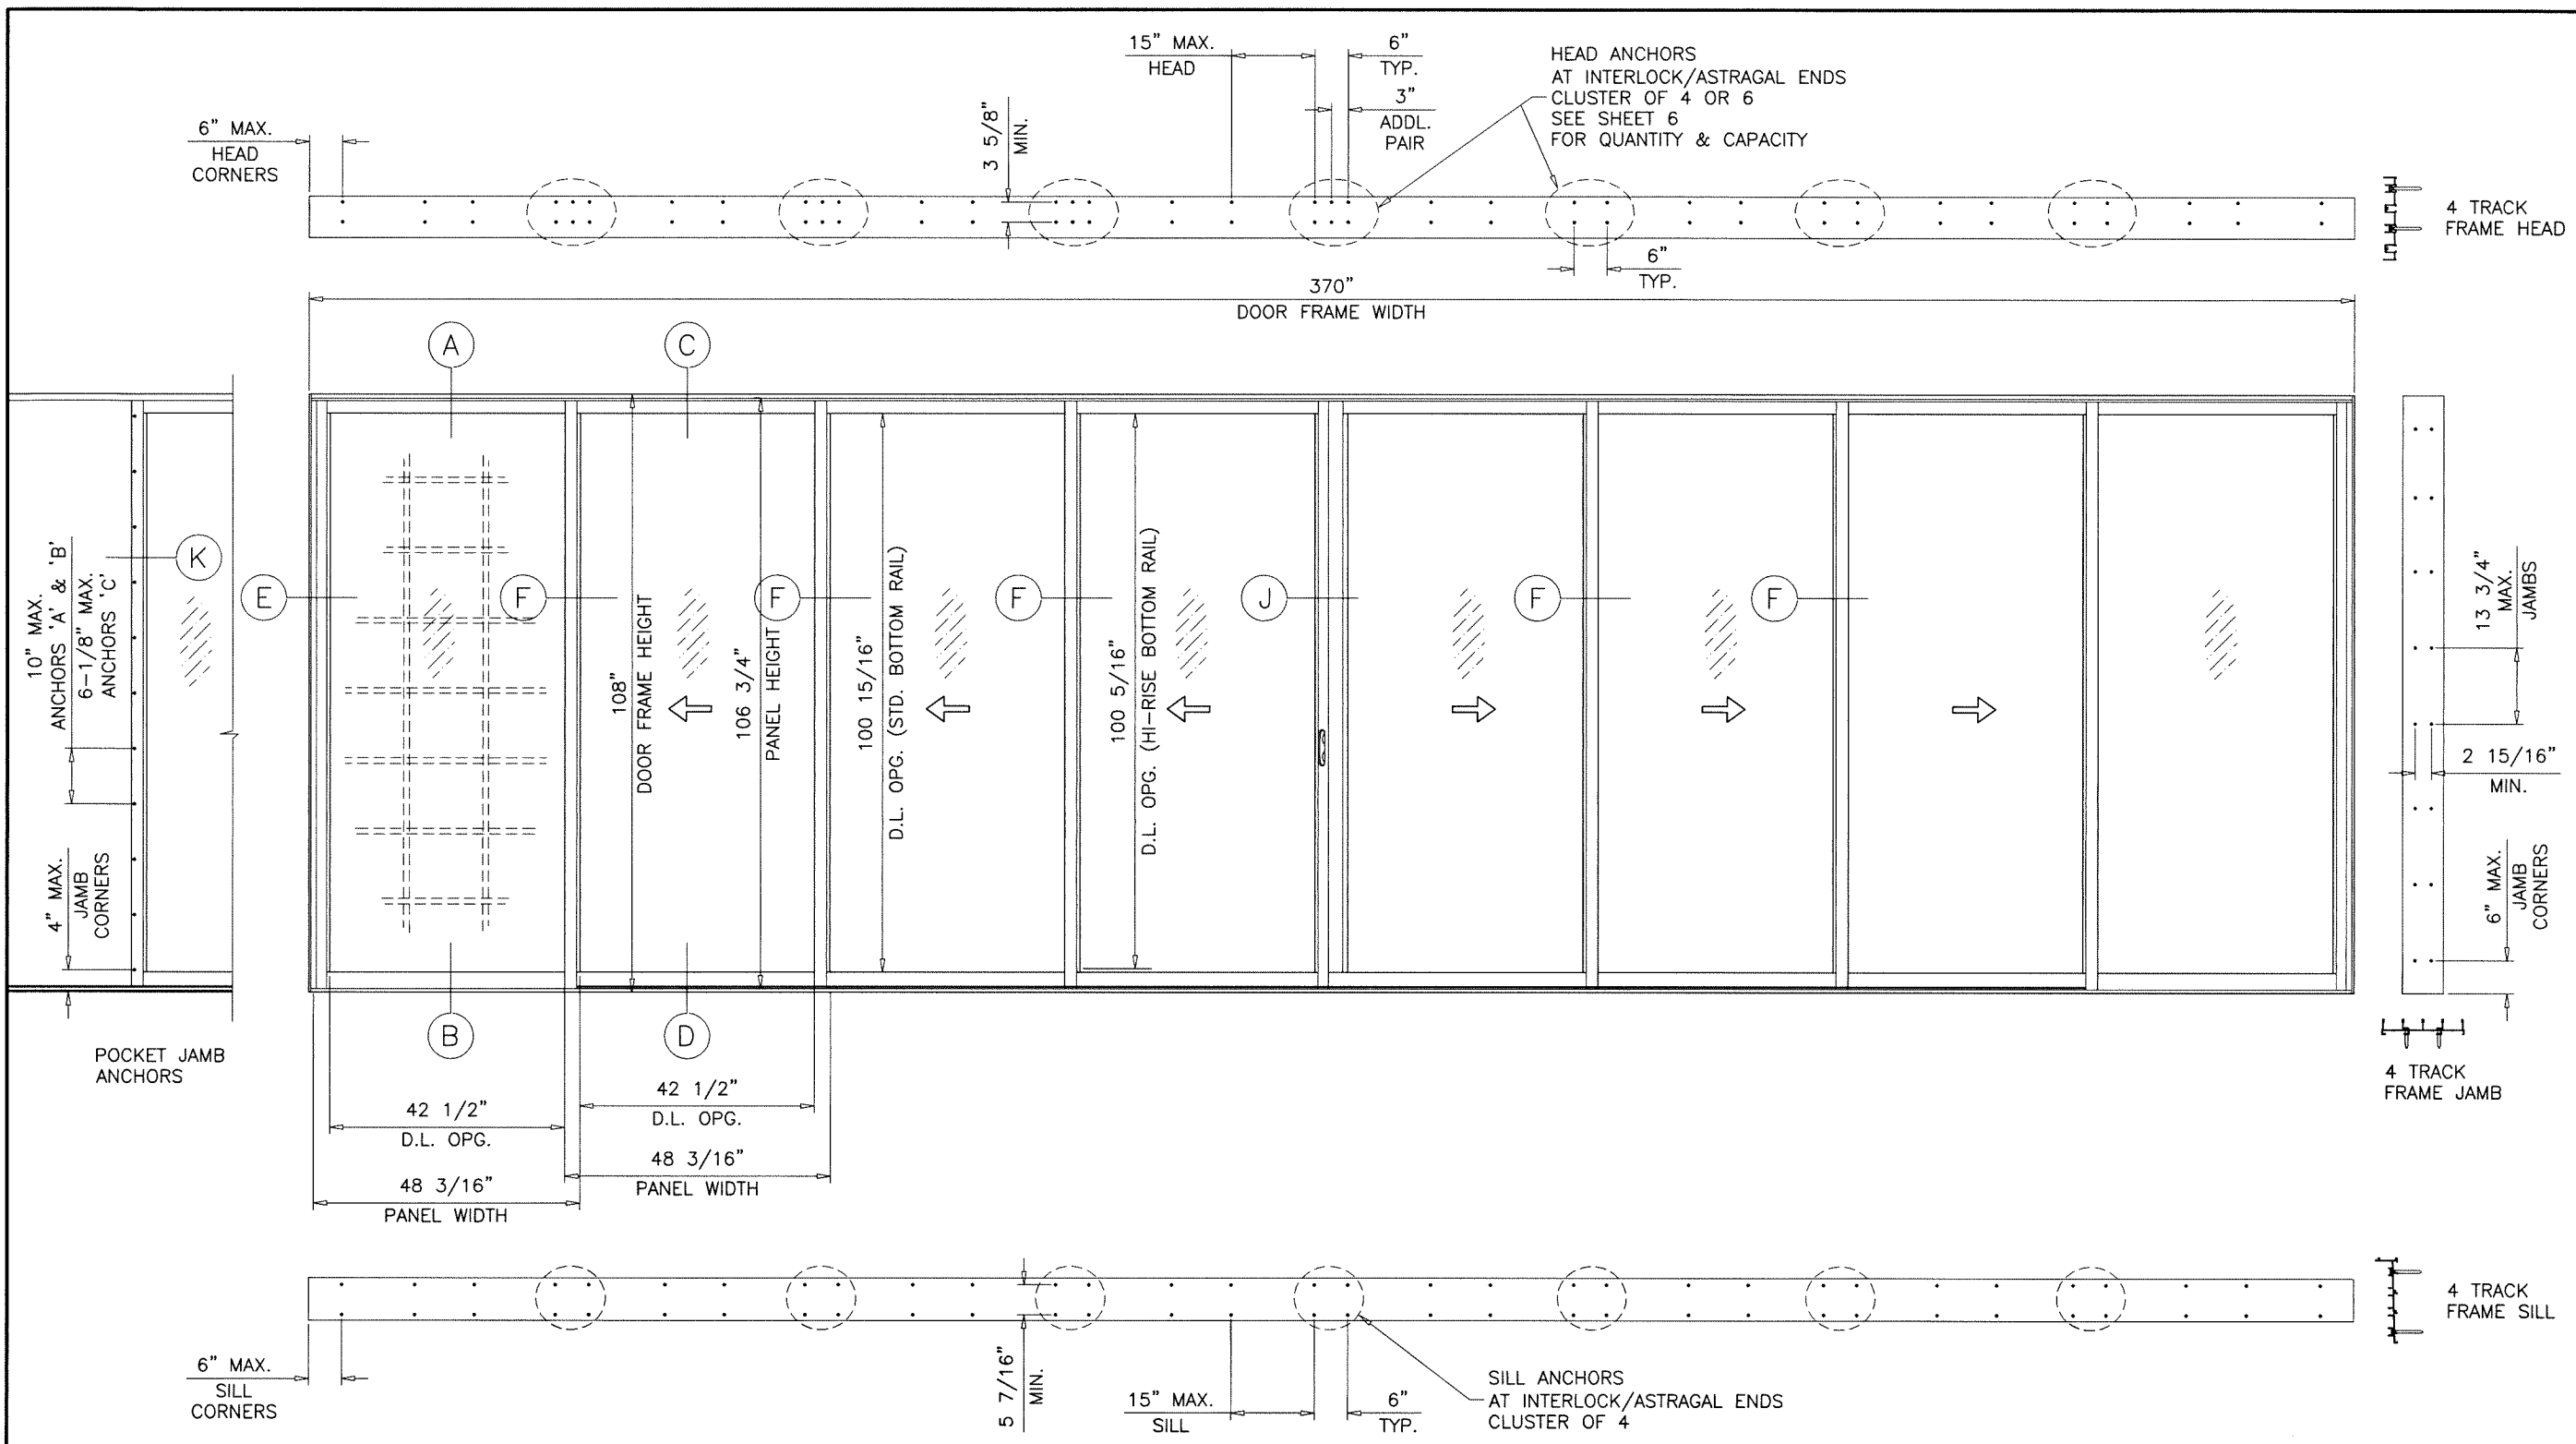

TYPICAL ELEVATION
OXXX-XXXO

Sealed: 12/11/2025

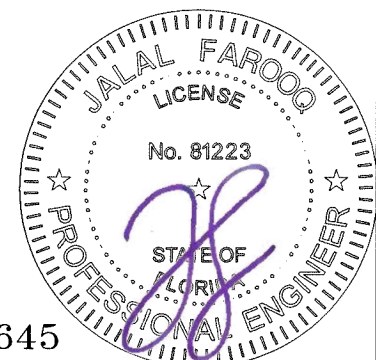

FL #22645

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W17-67ES


ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 07-11-17	scale: 3/8"=1'-0"	dr. by: TARIQ	chk. by:
drawing no. W17-67		sheet 4 of 23	


DESIGN LOAD CAPACITY – PSF					
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	INTERLOCK & ASTRAGAL STILES WITHOUT REINF.		INTERLOCK & ASTRAGAL STILES WITH REINF.	
		EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
30	82	60.0	60.0	80.0	80.0
36		60.0	60.0	80.0	80.0
42		60.0	60.0	80.0	80.0
47–1/4		60.0	60.0	80.0	80.0
48		59.1	59.1	78.8	78.8
54		52.5	52.5	70.0	70.0
60		–	–	47.3	47.3
30	84	60.0	60.0	80.0	80.0
36		60.0	60.0	80.0	80.0
42		60.0	60.0	80.0	80.0
47–1/4		60.0	60.0	80.0	80.0
48		59.1	59.1	78.8	78.8
54		52.5	52.5	70.0	70.0
60		–	–	47.3	47.3
30	90	60.0	60.0	80.0	80.0
36		60.0	60.0	80.0	80.0
42		60.0	60.0	80.0	80.0
47–1/4		60.0	60.0	80.0	80.0
48		59.1	59.1	78.8	78.8
54		–	–	52.5	52.5
30	96	60.0	60.0	80.0	80.0
36		60.0	60.0	80.0	80.0
42		60.0	60.0	80.0	80.0
47–1/4		60.0	60.0	80.0	80.0
48		59.1	59.1	59.1	59.1
30	102	–	–	60.0	60.0
36		–	–	60.0	60.0
42		–	–	60.0	60.0
47–1/4		–	–	60.0	60.0
48		–	–	59.1	59.1
30	108	–	–	60.0	60.0
36		–	–	60.0	60.0
42		–	–	60.0	60.0
47–1/4		–	–	60.0	60.0
48		–	–	60.0	60.0

ALL EXT.(+) LOADS SHOWN IN CHART ARE FOR DOOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED.
FOR DOOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED LIMIT EXT.(+) LOADS AS FOLLOWS.
FOR 3–11/16" SILL HEIGHT LIMIT EXT.(+) LOADS TO 80.0 PSF
FOR 3–1/8" SILL HEIGHT LIMIT EXT.(+) LOADS TO 66.6 PSF
FOR 2–3/4" SILL HEIGHT LIMIT EXT.(+) LOADS TO 53.3 PSF
SEE SHEET 14 FOR DETAILS

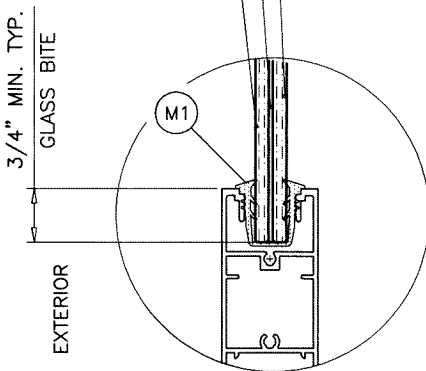

GLASS TYPE 'A'
7/16" OVERALL LAM. GLASS


NOTE:
FOR SENTRYGLAS INTERLAYER
LIMIT MAX. D.L.O. AREA TO 25.7 SQ. FT.

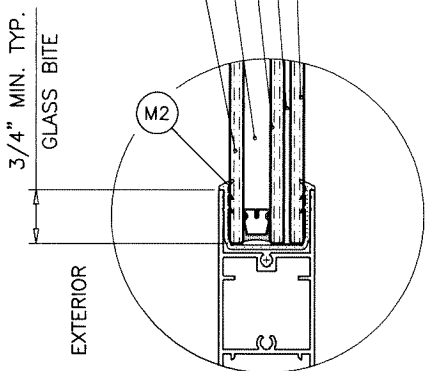

GLASS TYPE 'A1'
1" OVERALL INSUL. LAM. GLASS

NOTE:
FOR SENTRYGLAS INTERLAYER
AND SALEX CP INTERLAYER
LIMIT MAX. D.L.O. AREA TO 25.7 SQ. FT.

GLAZING OPTIONS

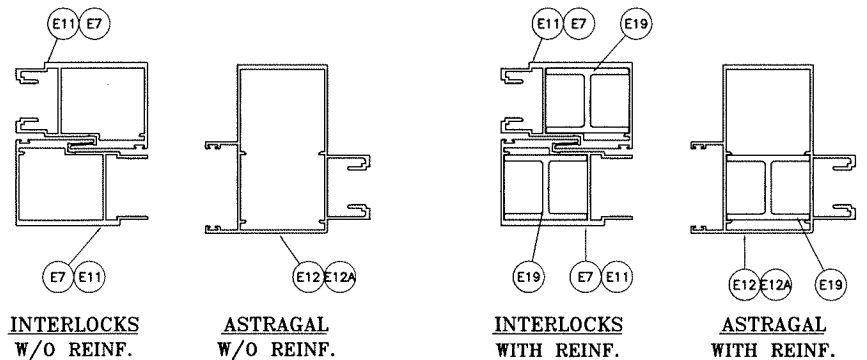

AVERAGE PANEL WIDTH = DOOR FRAME WIDTH / NUMBER OF PANELS


DOOR HEIGHT AND WIDTH SIZE MUST COMPLY WITH EGRESS REQUIREMENTS PER FBC AS REQUIRED.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300–09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05–DEC–219

SEE CHART ABOVE FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE AND REINFORCING TYPES.
SEE CHART ON SHEET 6 FOR HEAD ANCHOR CAPACITY.
LOWER DESIGN PRESSURES FROM DESIGN LOAD CHART OR HEAD ANCHOR CHART WILL APPLY TO ENTIRE SYSTEM.

3/8" AIR SPACE CONSISTING OF:
SPACER:
'HELIMA' LOW PROFILE ALUMINUM SPACER BY 'LINGERMANN GMBH'
AROUND THE PERIMETER OF THE GLASS.
PERIMETER SEALANT:
SILICONE
DOWSIL 791
GE 2000

Sealed: 12/11/2025

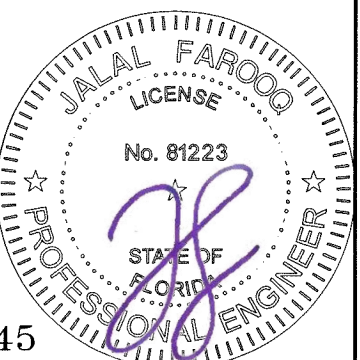

FL #22645

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
COMP-ANL W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:
no. date by description
1 07-11-17 3/8" = 1" dr. by: TARIQ
chk. by:
drawing no. **W17-67**
sheet 5 of 23

HEAD ANCHOR LOAD CAPACITY - PSF									
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	ANCHOR TYPES 'A' & 'B'						ANCHOR TYPE 'C'	
		1/4" MAX. SHIM		3/8" MAX. SHIM		1/2" MAX. SHIM		3/8" MAX. SHIM	
		4 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS	4 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS	4 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS	4 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS
		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	82	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0	71.5	80.0	80.0	80.0
47-1/4		80.0	80.0	80.0	80.0	63.6	80.0	80.0	80.0
48		80.0	80.0	80.0	80.0	62.6	80.0	80.0	80.0
54		80.0	80.0	71.6	80.0	55.6	74.2	72.7	80.0
60		72.7	80.0	64.4	80.0	50.1	66.8	65.4	80.0
30	84	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0	69.8	80.0	80.0	80.0
47-1/4		80.0	80.0	79.8	80.0	62.1	80.0	80.0	80.0
48		80.0	80.0	78.6	80.0	61.1	80.0	79.8	80.0
54		78.9	80.0	69.9	80.0	54.3	72.4	71.0	80.0
60		71.0	80.0	62.9	80.0	48.9	65.2	63.9	80.0
30	90	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	76.1	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0	65.2	80.0	80.0	80.0
47-1/4		80.0	80.0	74.5	80.0	57.9	77.3	75.7	80.0
48		80.0	80.0	73.4	80.0	57.0	76.1	74.5	80.0
54		73.6	80.0	65.2	80.0	50.7	67.6	66.2	80.0
30	96	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0	71.3	80.0	80.0	80.0
42		80.0	80.0	78.6	80.0	61.1	80.0	79.8	80.0
47-1/4		78.9	80.0	69.9	80.0	54.3	72.4	71.0	80.0
48		60.0	60.0	60.0	60.0	53.5	60.0	60.0	60.0
30	102	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
36		60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
42		60.0	60.0	60.0	60.0	57.5	60.0	60.0	60.0
47-1/4		60.0	60.0	60.0	60.0	51.1	60.0	60.0	60.0
48		60.0	60.0	60.0	60.0	50.3	60.0	60.0	60.0
30	108	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
36		60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
42		60.0	60.0	60.0	60.0	54.3	60.0	60.0	60.0
47-1/4		60.0	60.0	60.0	60.0	48.3	60.0	60.0	60.0

SEE CHART ON SHEET 5 FOR DESIGN LOAD CAPACITY OF
DESIRED GLASS SIZE AND REINFORCING TYPES.

SEE CHART ABOVE FOR HEAD ANCHOR CAPACITY.

LOWER DESIGN PRESSURES FROM DESIGN LOAD CHART
OR HEAD ANCHOR CHART WILL APPLY TO ENTIRE SYSTEM.

Sealed: 12/11/2025



FL #22645

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
(C.A.N. 3538)

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)









E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:
no date by description

date: 07-11-17
scale: -
dr. by: TARIQ
chk. by:

drawing no.
W17-67
sheet 6 of 23

COMP-ANL\W17-67ES

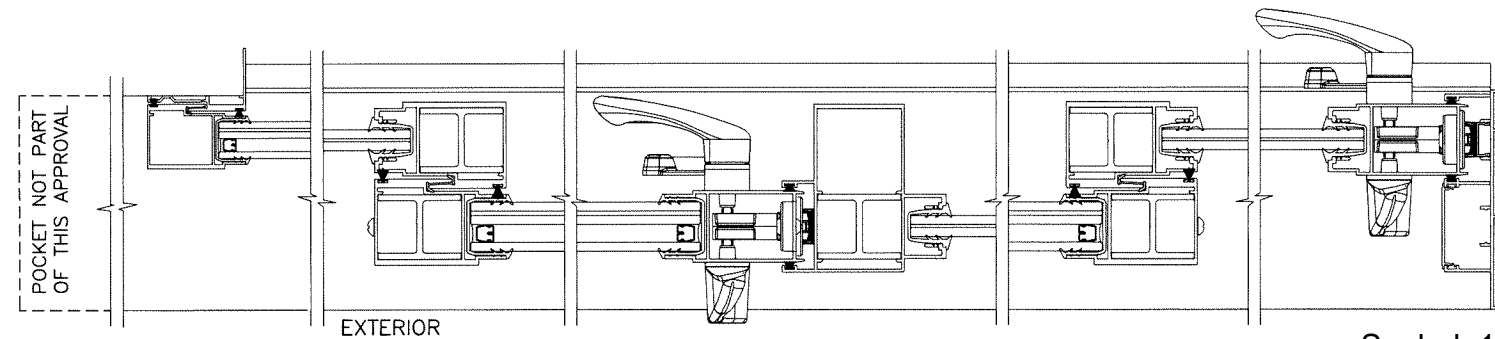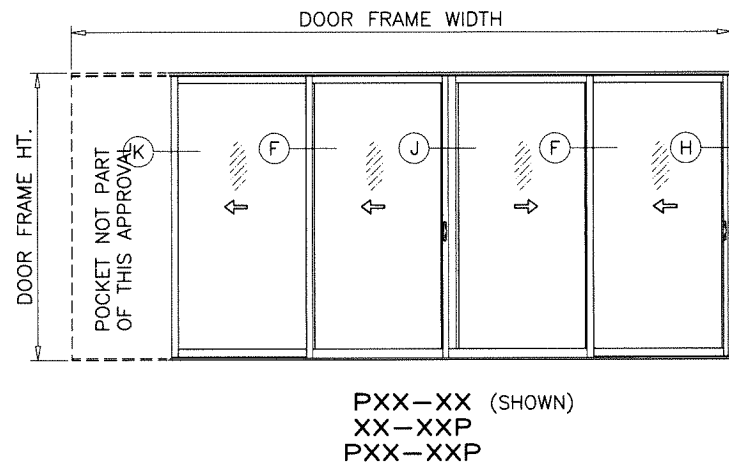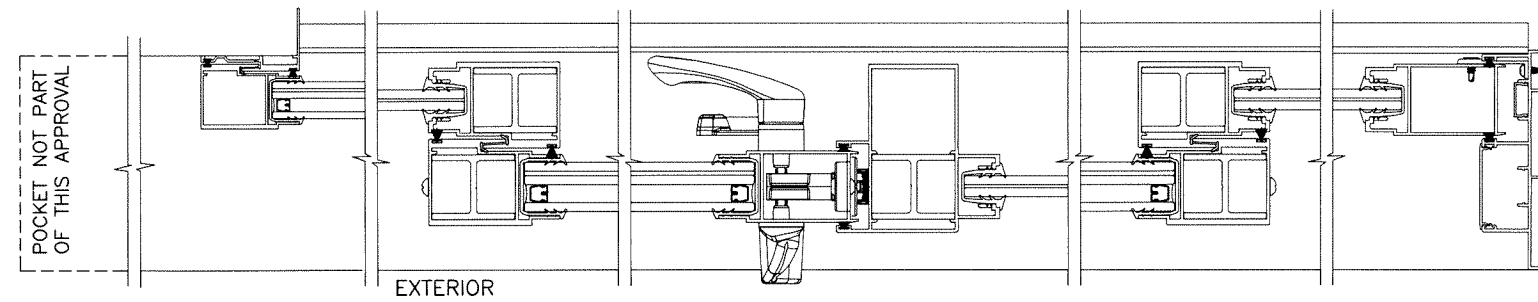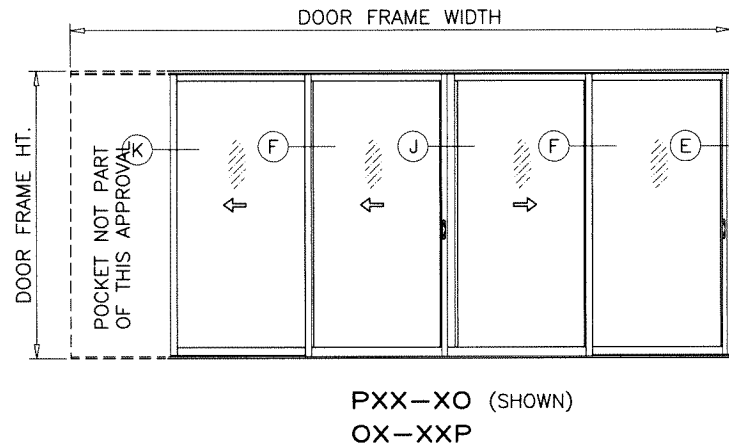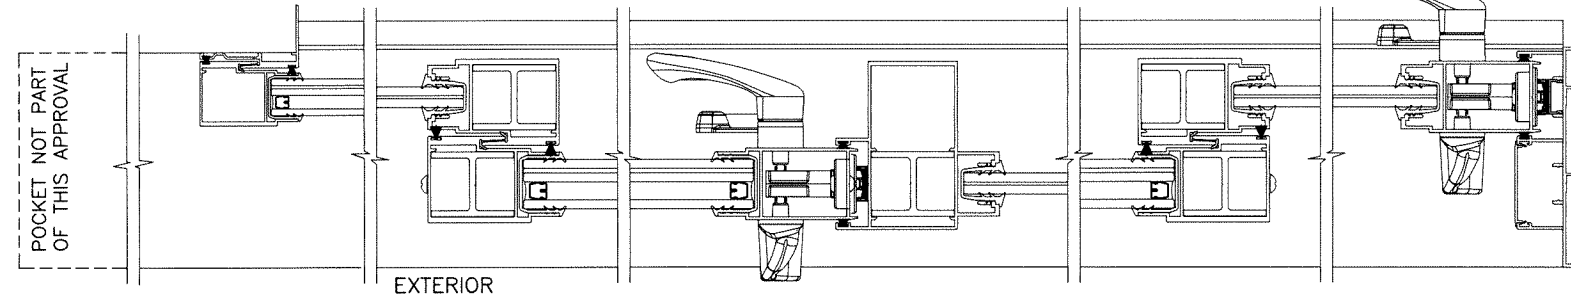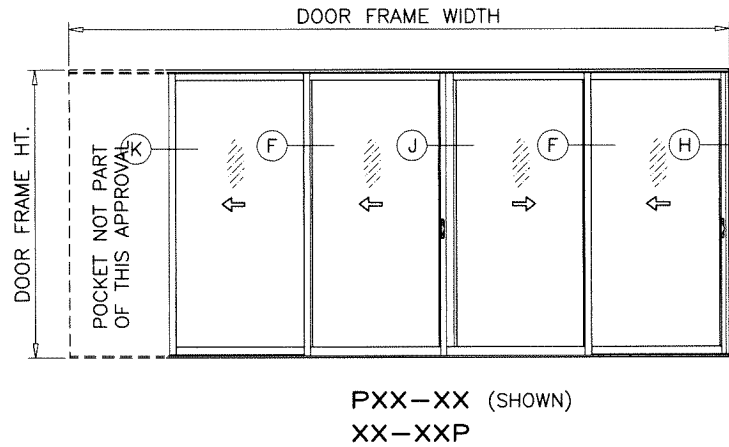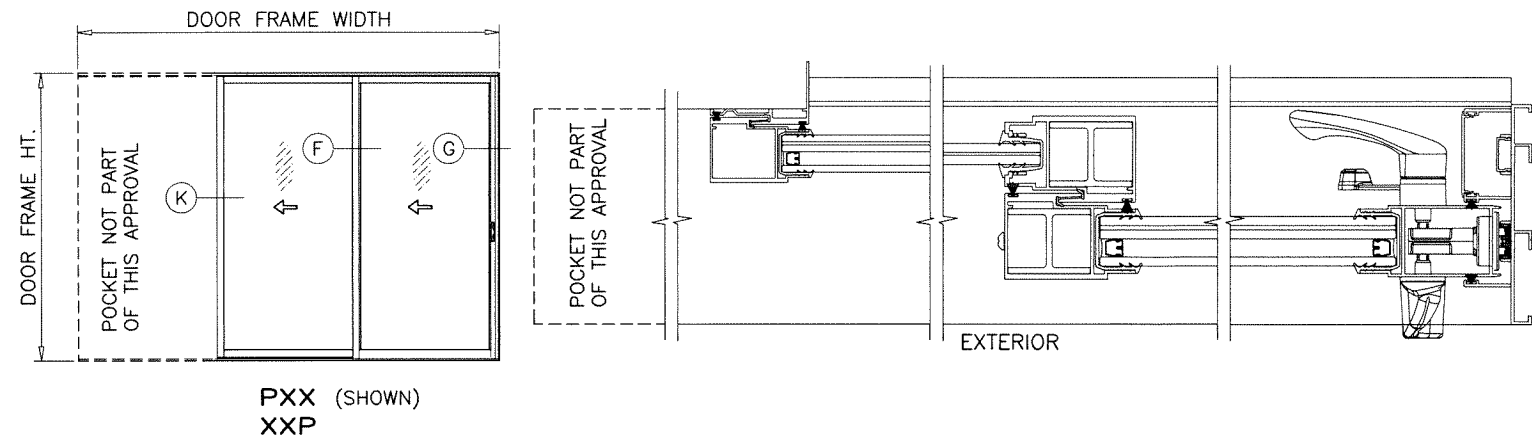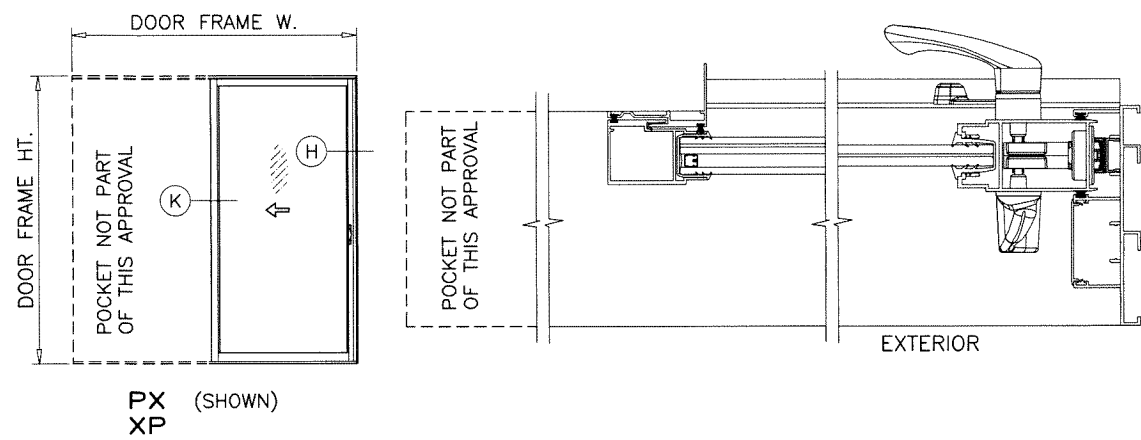

- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 5.
 3. FOR ANCHOR DETAILS SEE SHEETS 14 THRU 19.

APPROVED CONFIGURATIONS
POCKETED DOORS
TWO (2) TRACKS

Sealed: 12/11/2025



FL #22645

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

(C.A.N. 3538)
FAX. (305) 262-6978







ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

COMP-ANL W17-67ES

Revisions:	
no	date by description


date: 07-11-17	scale: -	dr. by: TARIQ	chk. by:	drawing no. W17-67
				sheet 8 of 23

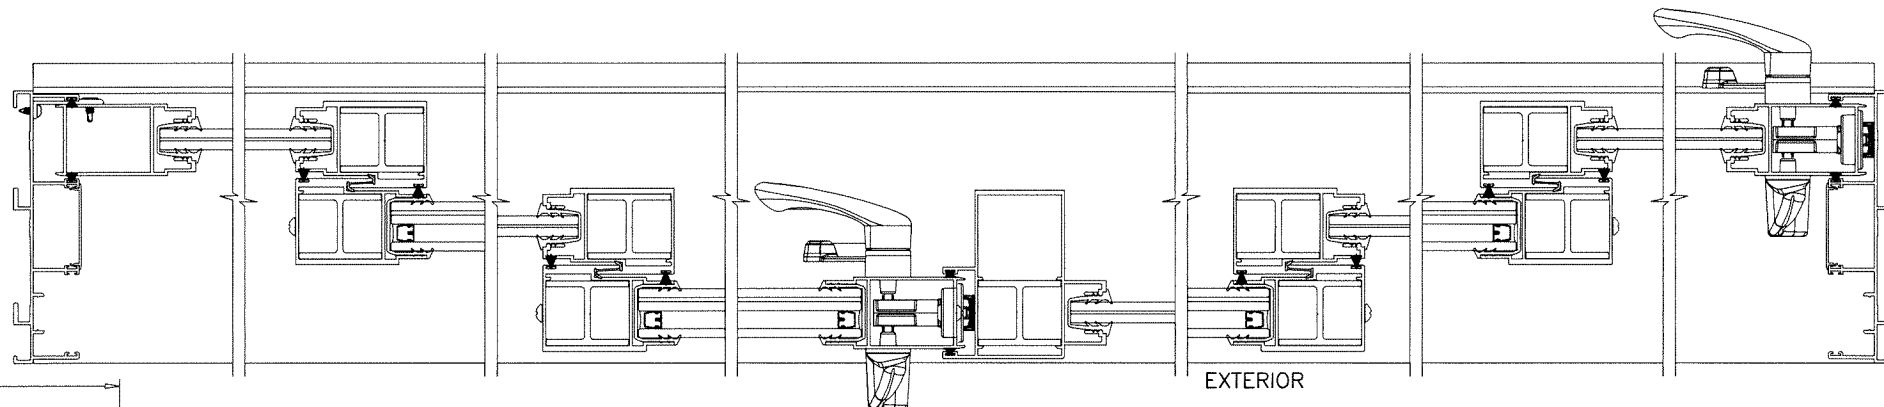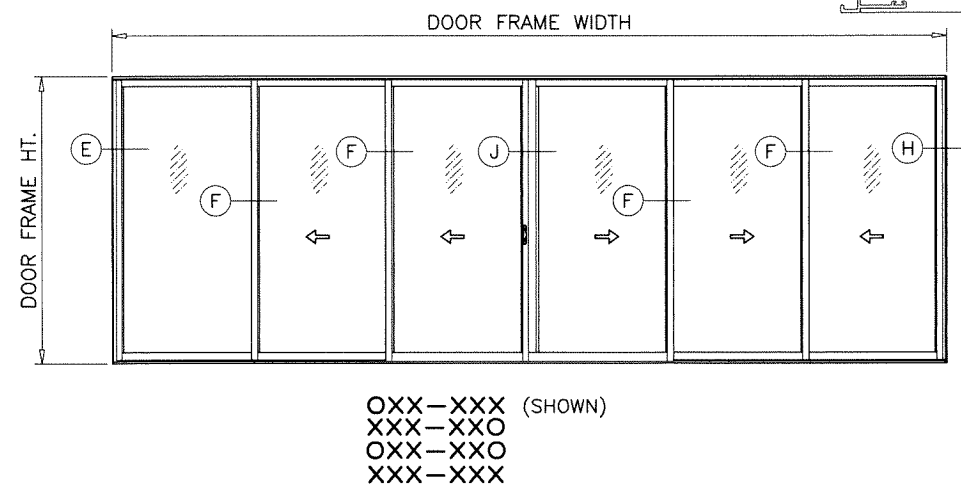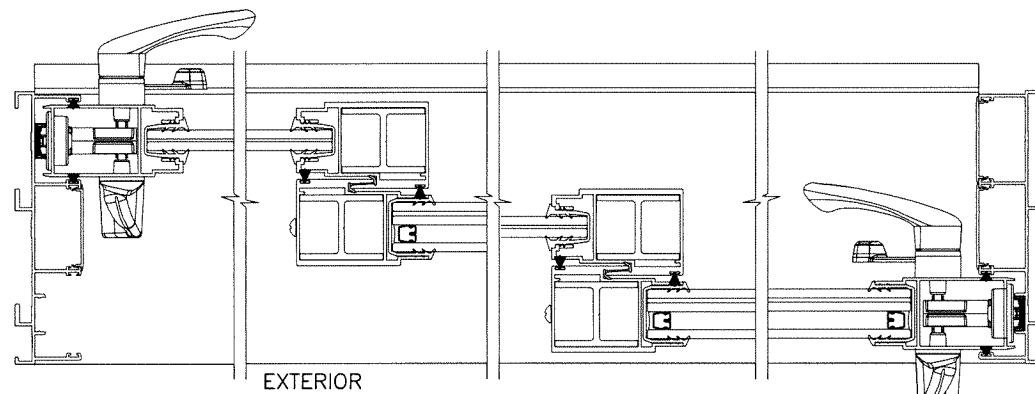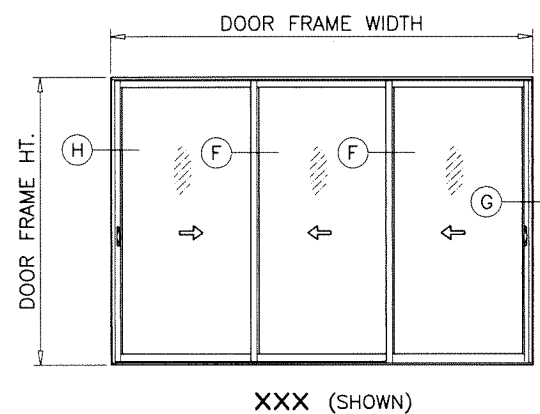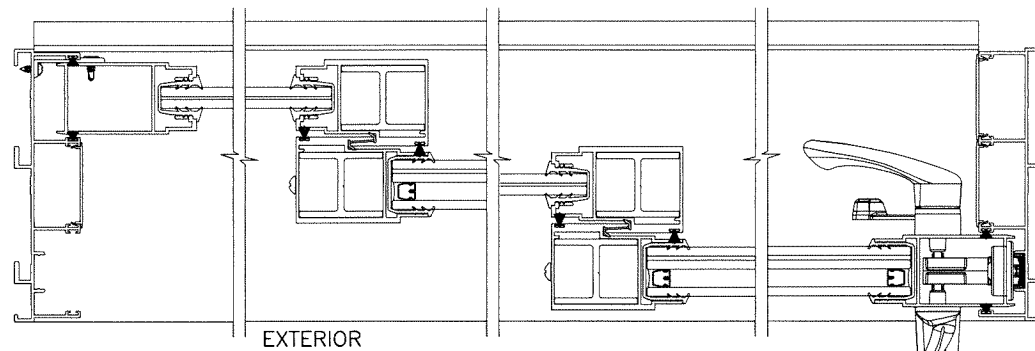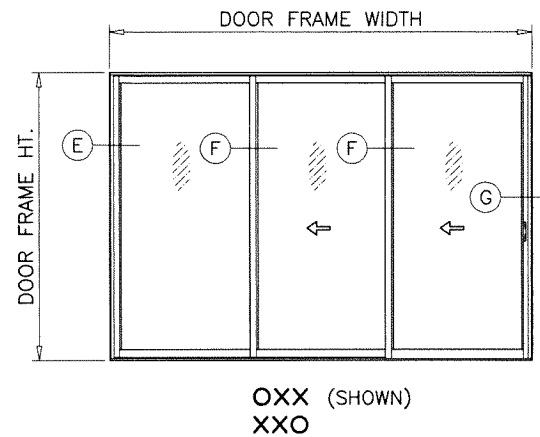

NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES AND REINFORCEMENTS REQUIREMENTS SEE SHEET 5.
3. FOR ANCHOR DETAILS SEE SHEETS 14 THRU 19.

Sealed: 12/11/2025

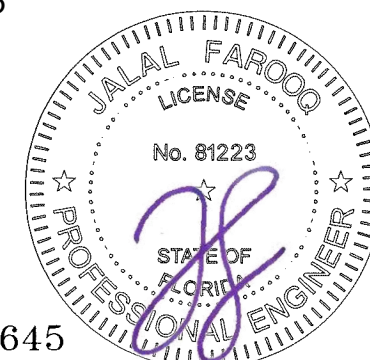

APPROVED CONFIGURATIONS
NON-POCKETED DOORS
THREE (3) TRACKS

FL #22645

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W17-67ES


ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158



revisions:
no date by description

date: 07-11-17
scale: -
dr. by: TARIQ
chk. by:



drawing no.
W17-67
sheet 9 of 23

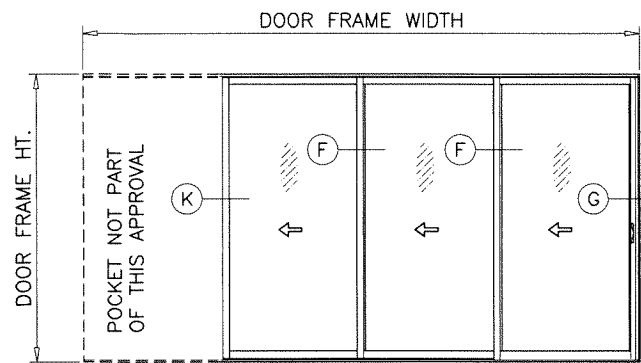


PXXX (SHOWN)
XXXX

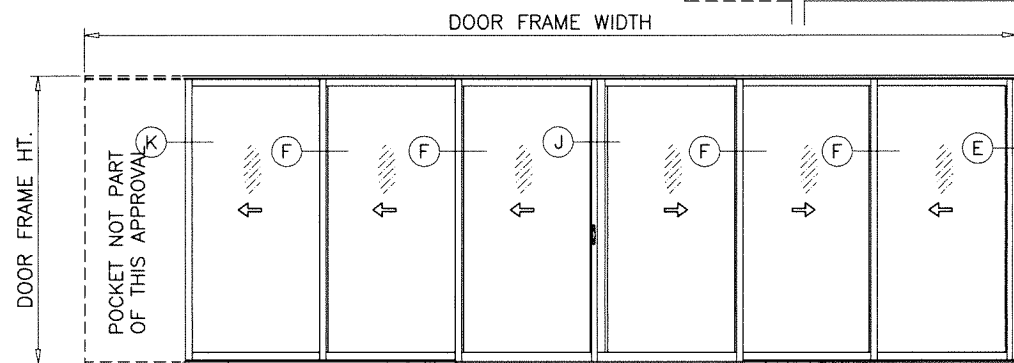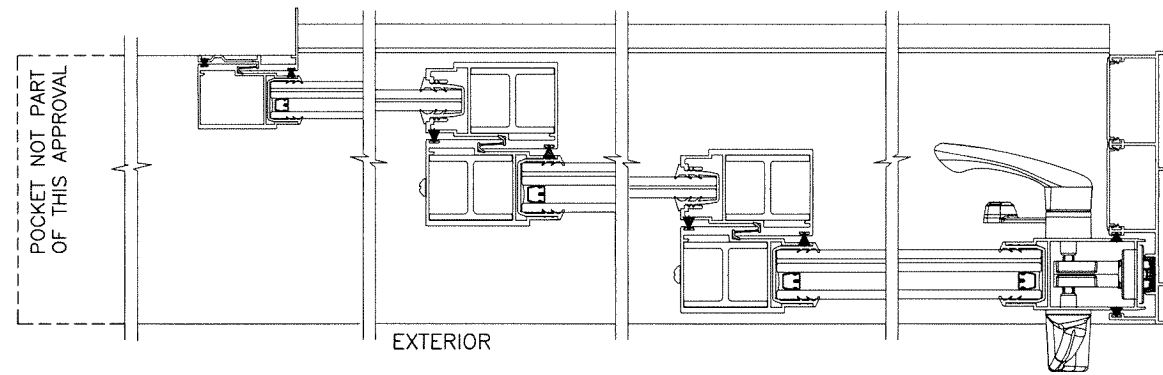

PXXX-XXO (SHOWN)
OXX-XXXXP

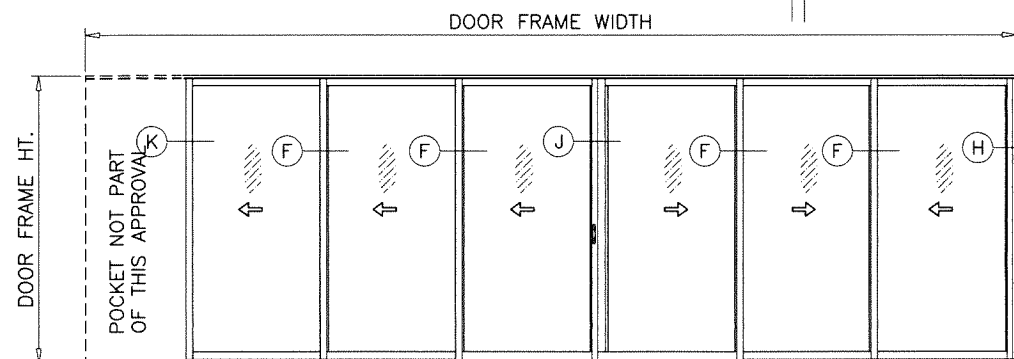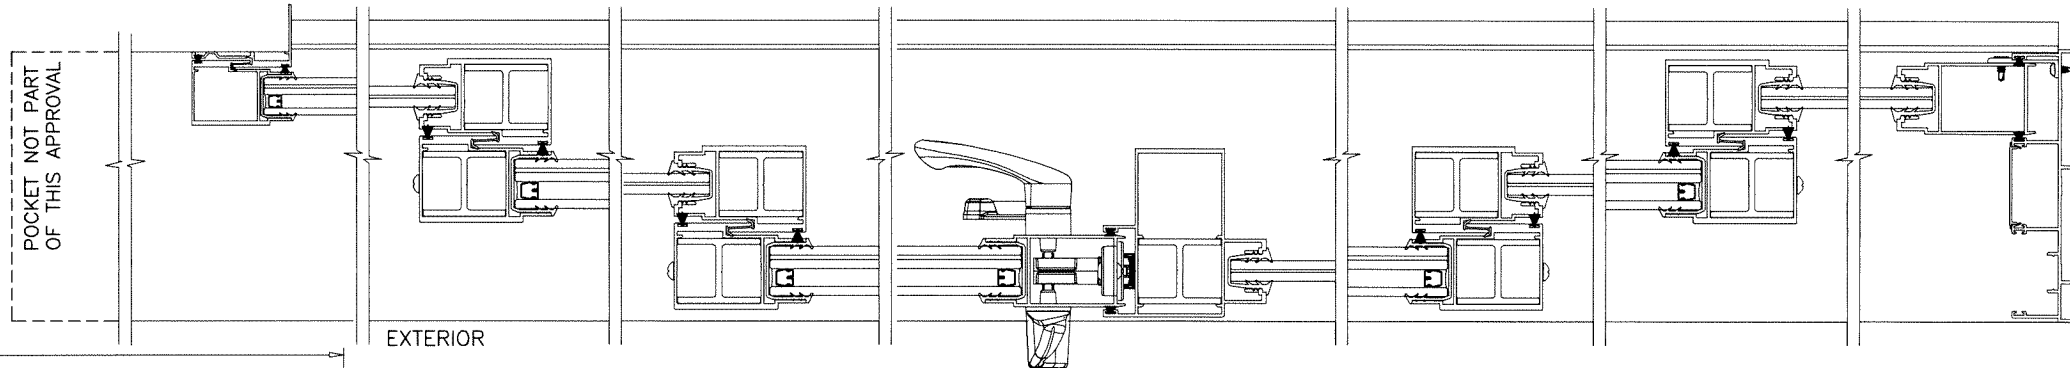


PXXX-XXX (SHOWN)
XXX-XXXXP
PXXX-XXXXP

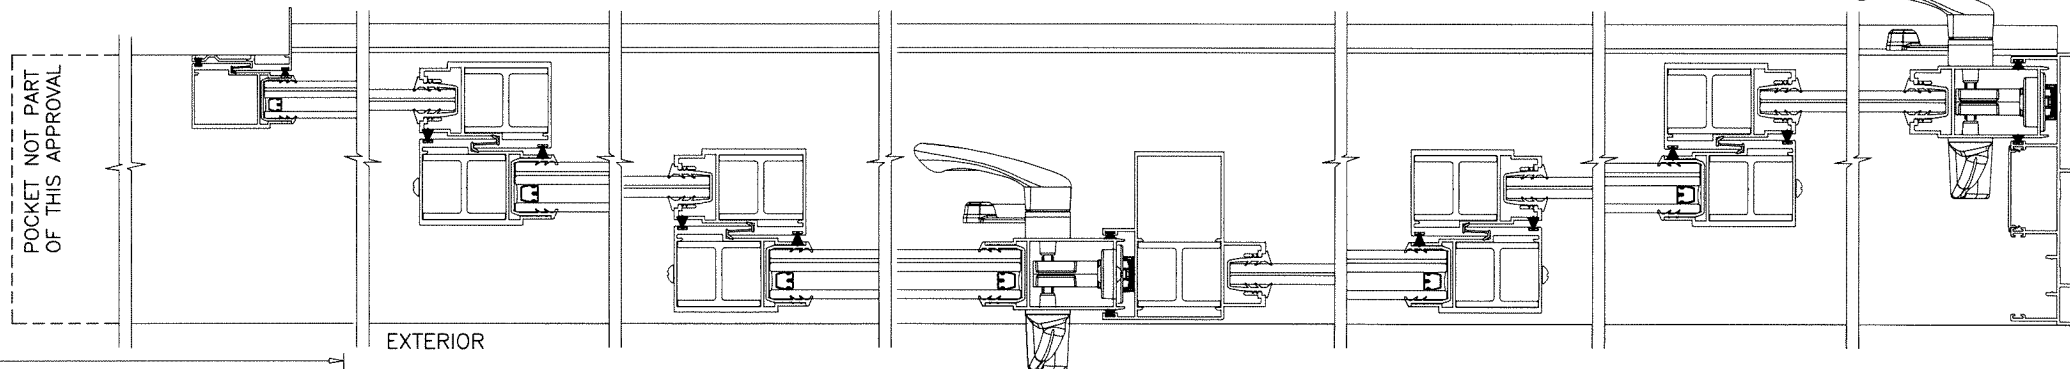

- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES AND REINFORCEMENTS REQUIREMENTS SEE SHEET 5.
 3. FOR ANCHOR DETAILS SEE SHEETS 14 THRU 19.

Sealed: 12/11/2025

APPROVED CONFIGURATIONS
POCKETED DOORS
THREE (3) TRACKS

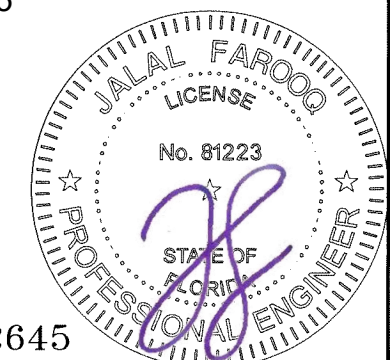

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538


ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no date by description	
date:	07-11-17	no	date
scale:	-	by	description
dr. by:	TARIQ		
chk. by:			
drawing no.	W17-67		
sheet	10 of 23		

FL #22645

COMP-ANL\W17-67ES

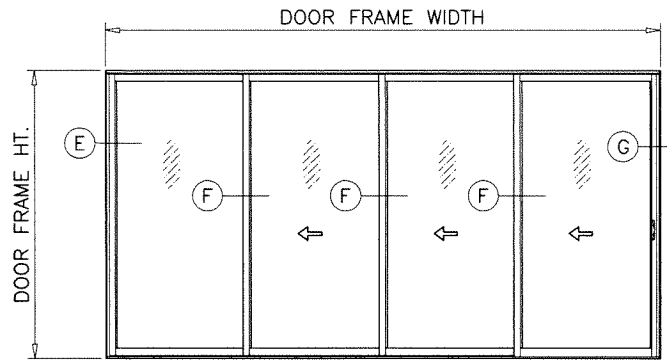


XXXX (SHOWN)
XXXXO



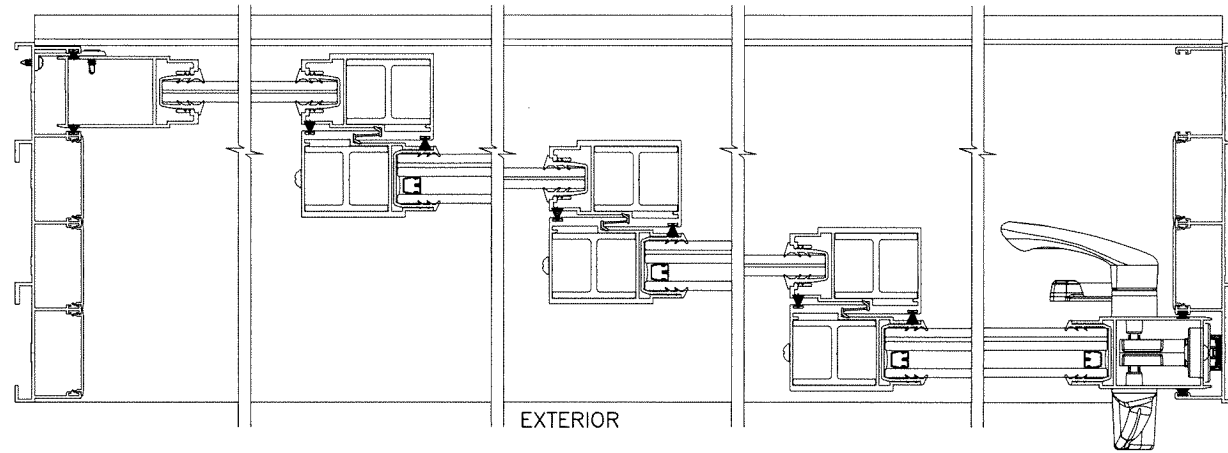


NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES AND REINFORCEMENTS REQUIREMENTS SEE SHEET 5.
3. FOR ANCHOR DETAILS SEE SHEETS 14 THRU 19.

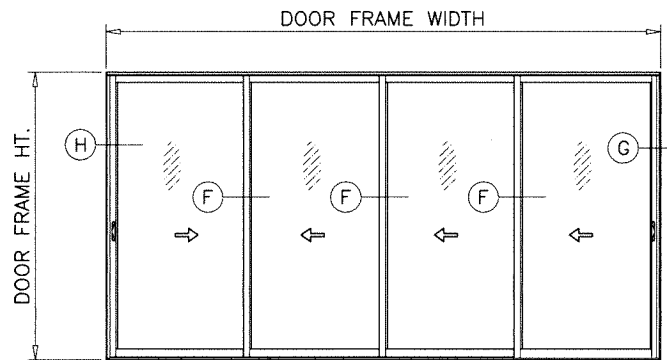


XXXX (SHOWN)

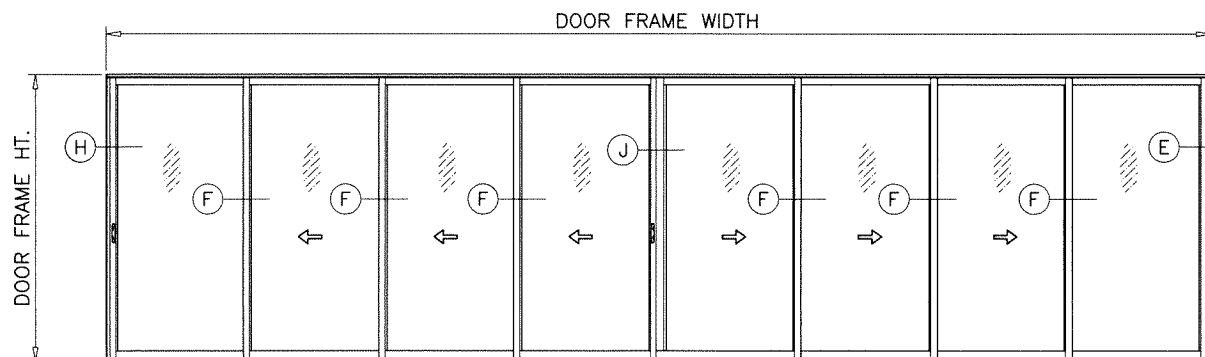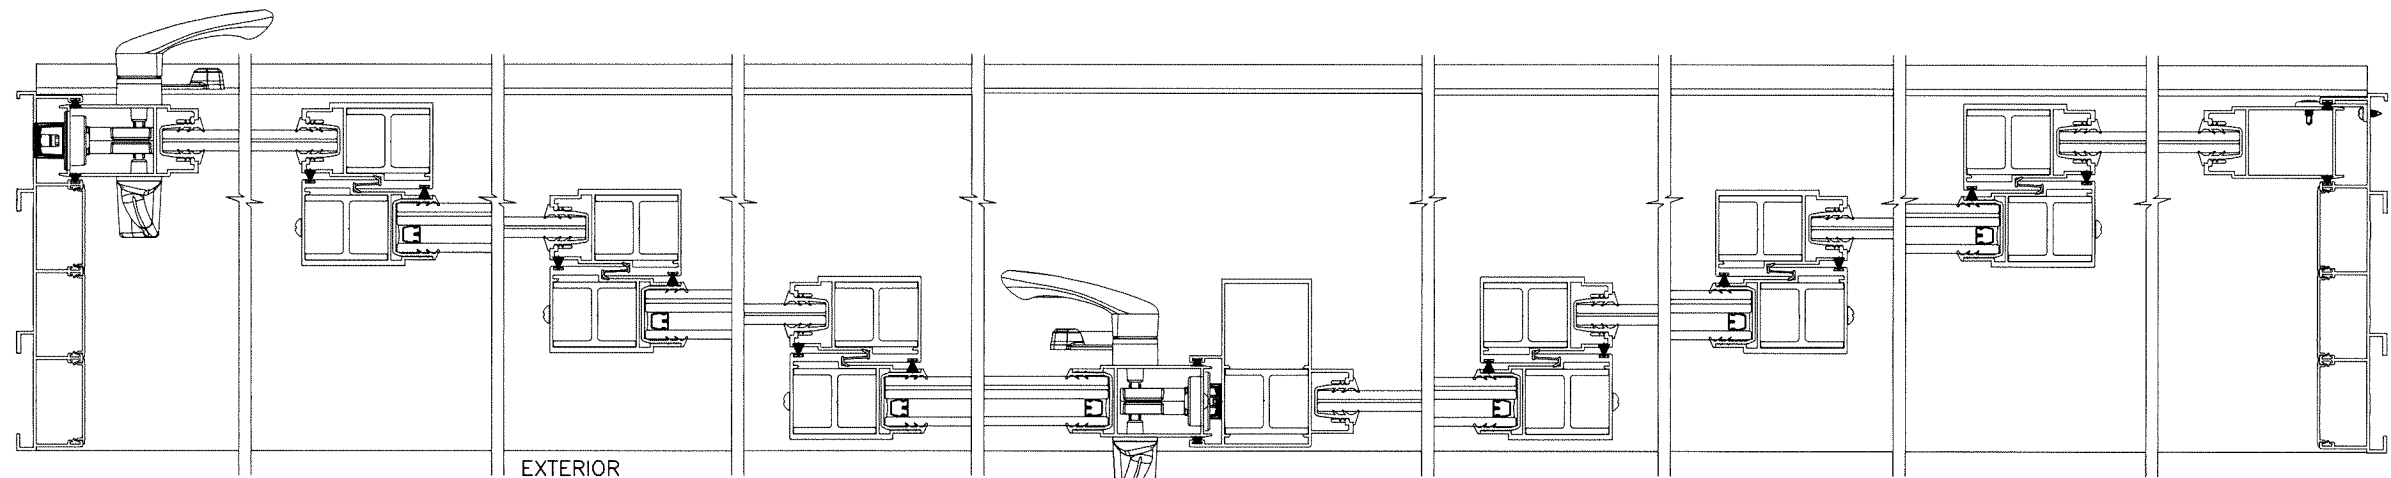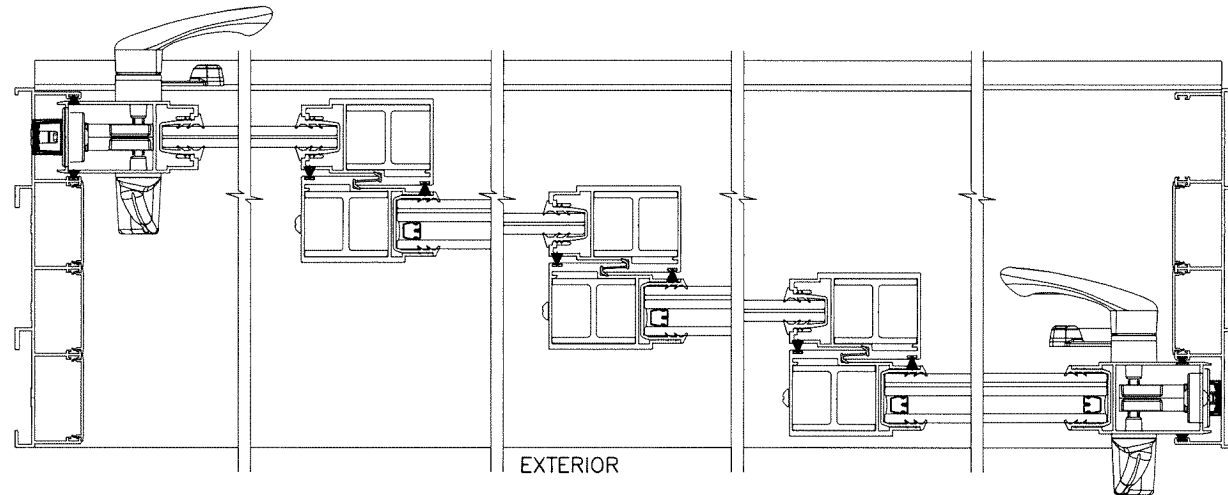

XXXX-XXXXO (SHOWN)
XXXX-XXXX
XXXX-XXXXO
XXXX-XXXX

APPROVED CONFIGURATIONS
NON-POCKETED DOORS
FOUR (4) TRACKS

Sealed: 12/11/2025

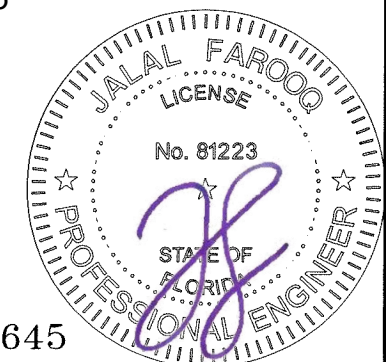

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)


E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:
no date by description


date: 07-11-17
scale: -
dr. by: TARIQ
chk. by:

drawing no.
W17-67
sheet 11 of 23

FL #22645


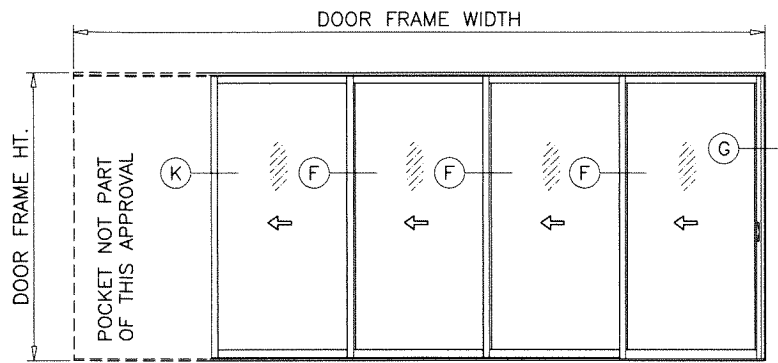


PXXXX (SHOWN)
XXXXP

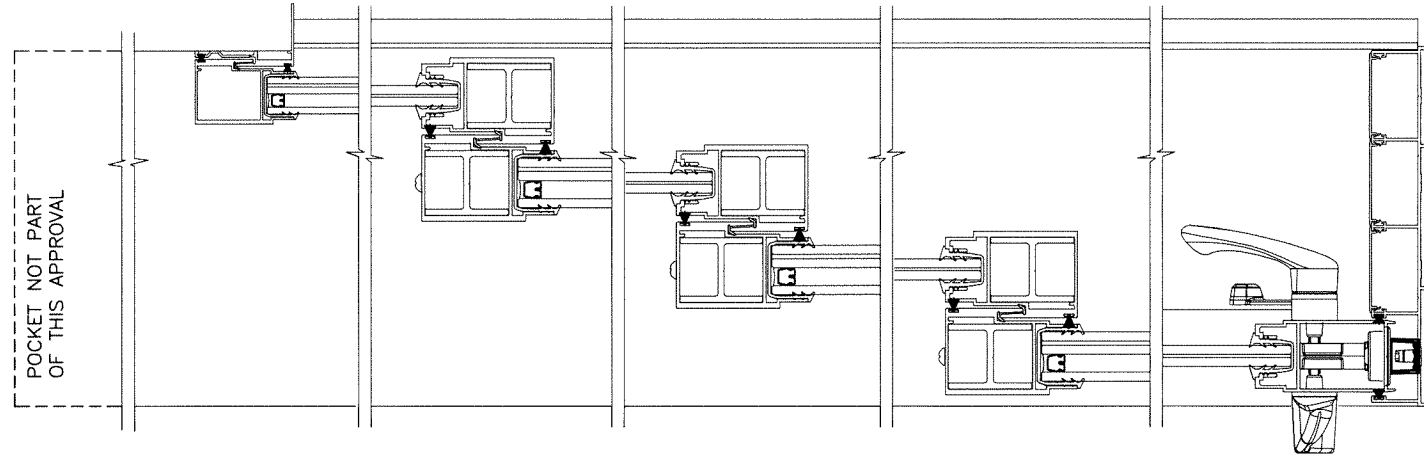

NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES AND REINFORCEMENTS REQUIREMENTS SEE SHEET 5.
3. FOR ANCHOR DETAILS SEE SHEETS 14 THRU 19.

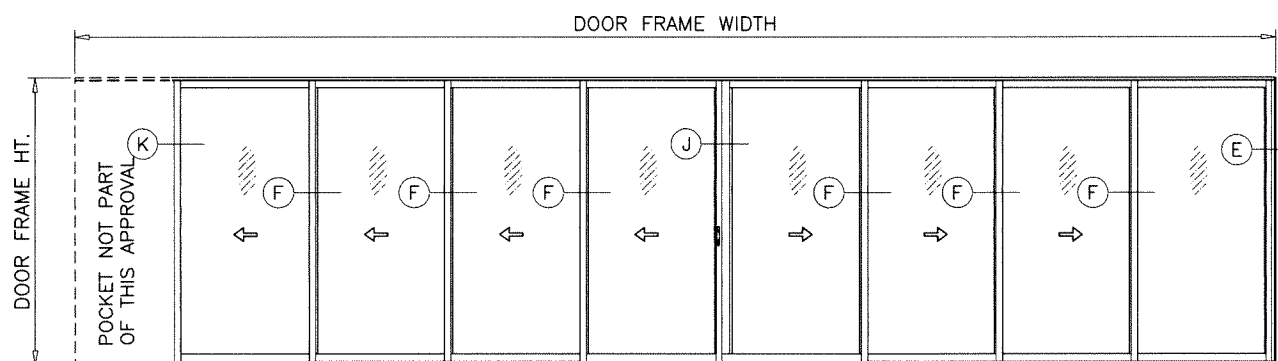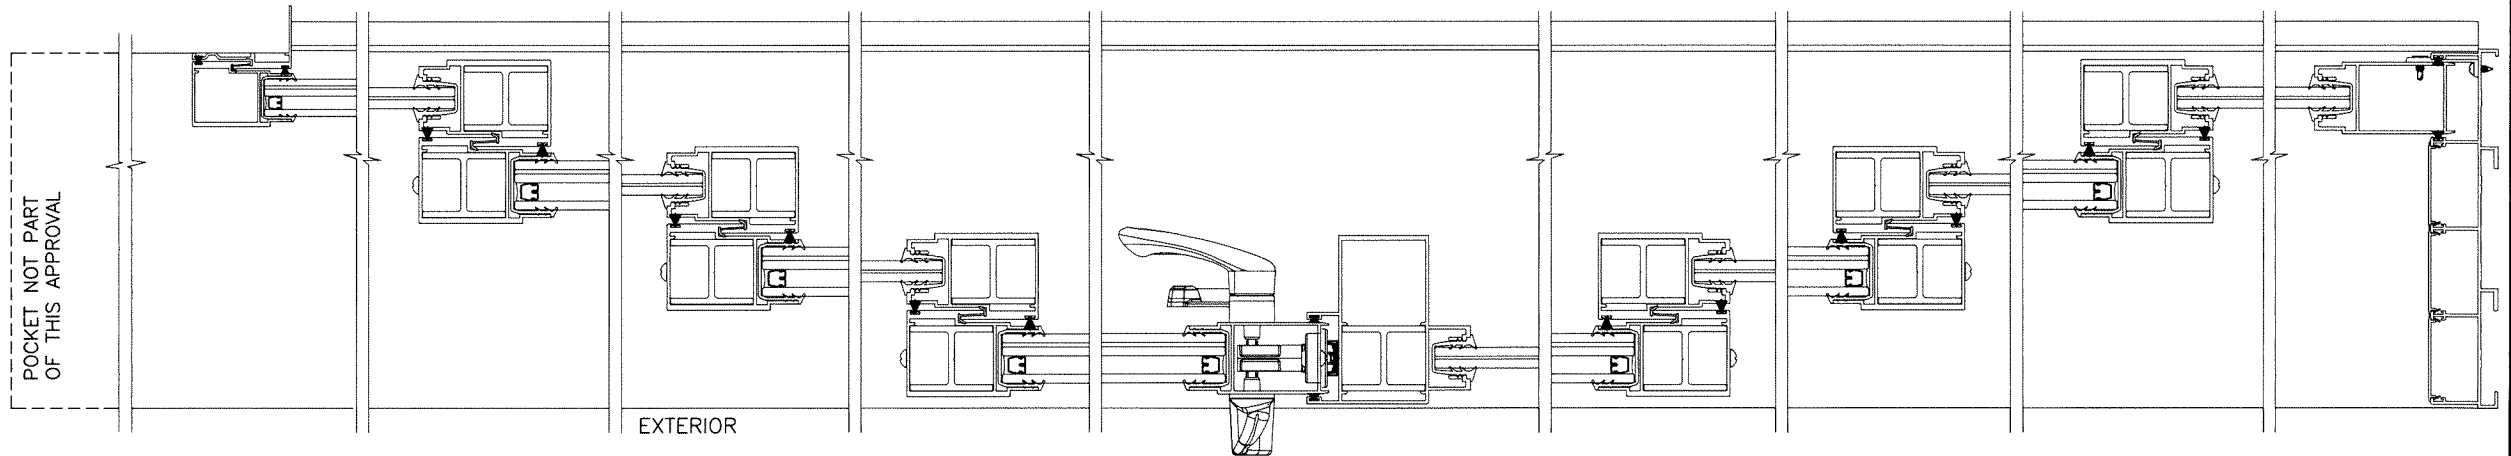

PXXXX-XXXXO (SHOWN)
OXXX-XXXXP

APPROVED CONFIGURATIONS
POCKETED DOORS
FOUR (4) TRACKS

Sealed: 12/11/2025




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no date by description	
date:	07-11-17	no	date by description
scale:	-		
dr. by:	TARIQ		
chk. by:			
drawing no.	W17-67		
sheet	12 of 23		

COMP-ANL W17-67ES

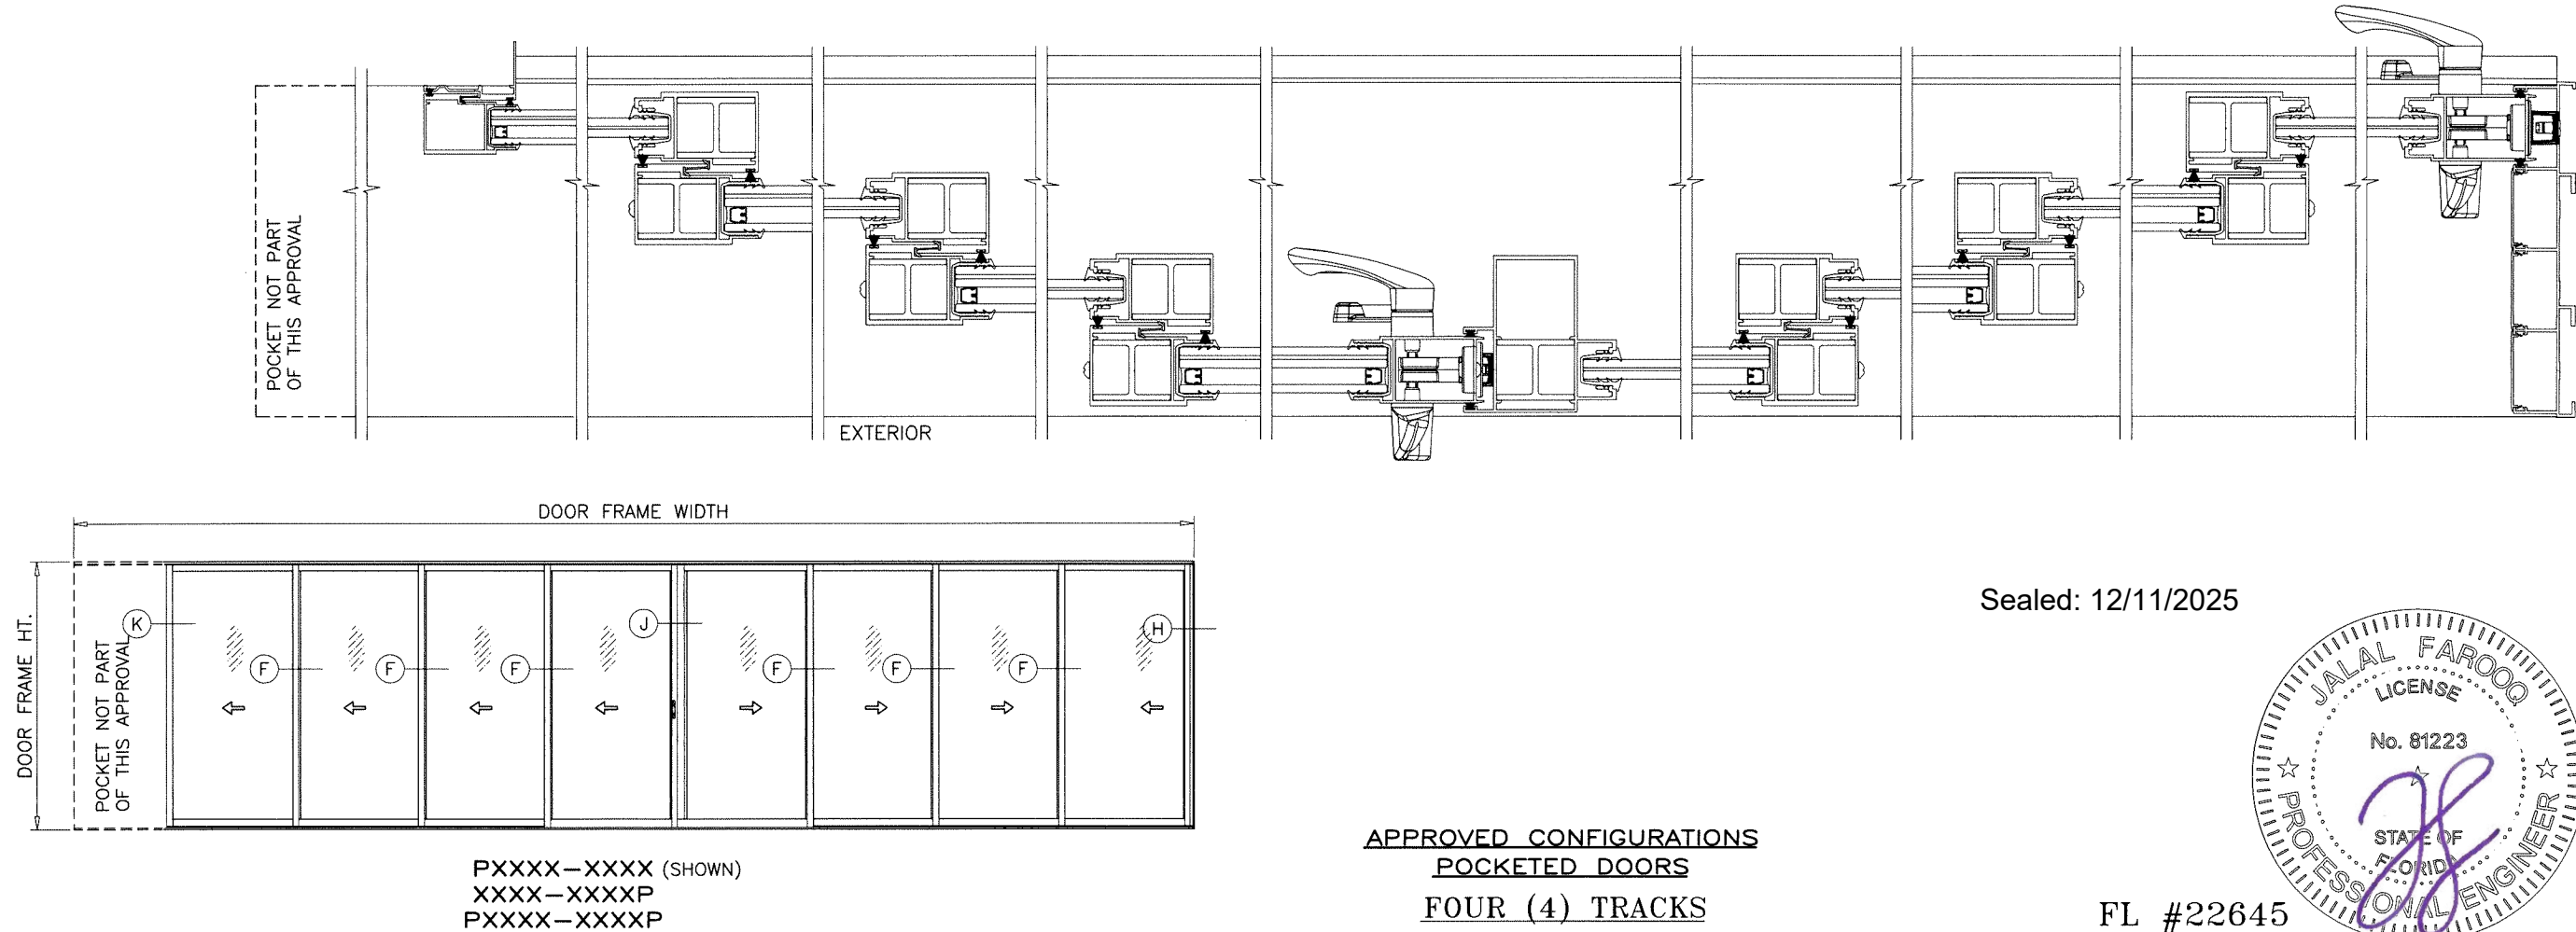


PXXXX-XXXX (SHOWN)
XXXX-XXXXP
PXXXX-XXXXP

APPROVED CONFIGURATIONS
POCKETED DOORS
FOUR (4) TRACKS

FL #22645

NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES AND REINFORCEMENTS REQUIREMENTS SEE SHEET 5.
3. FOR ANCHOR DETAILS SEE SHEETS 14 THRU 19.

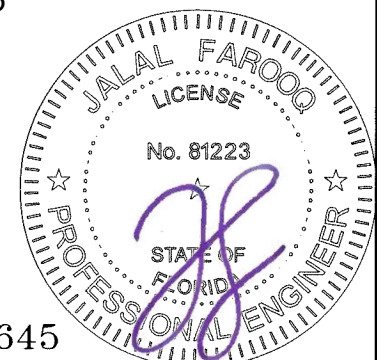



date: 07-11-17	revisions:	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 10%;">no</th> <th style="width: 10%;">date</th> <th style="width: 80%;">by description</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> </tbody> </table>	no	date	by description																														
no	date	by description																																	
scale: —	dr. by: TARIQ																																		
chk. by:																																			
drawing no.																																			
W17-67																																			
sheet 13 of 23																																			

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W17-67ES

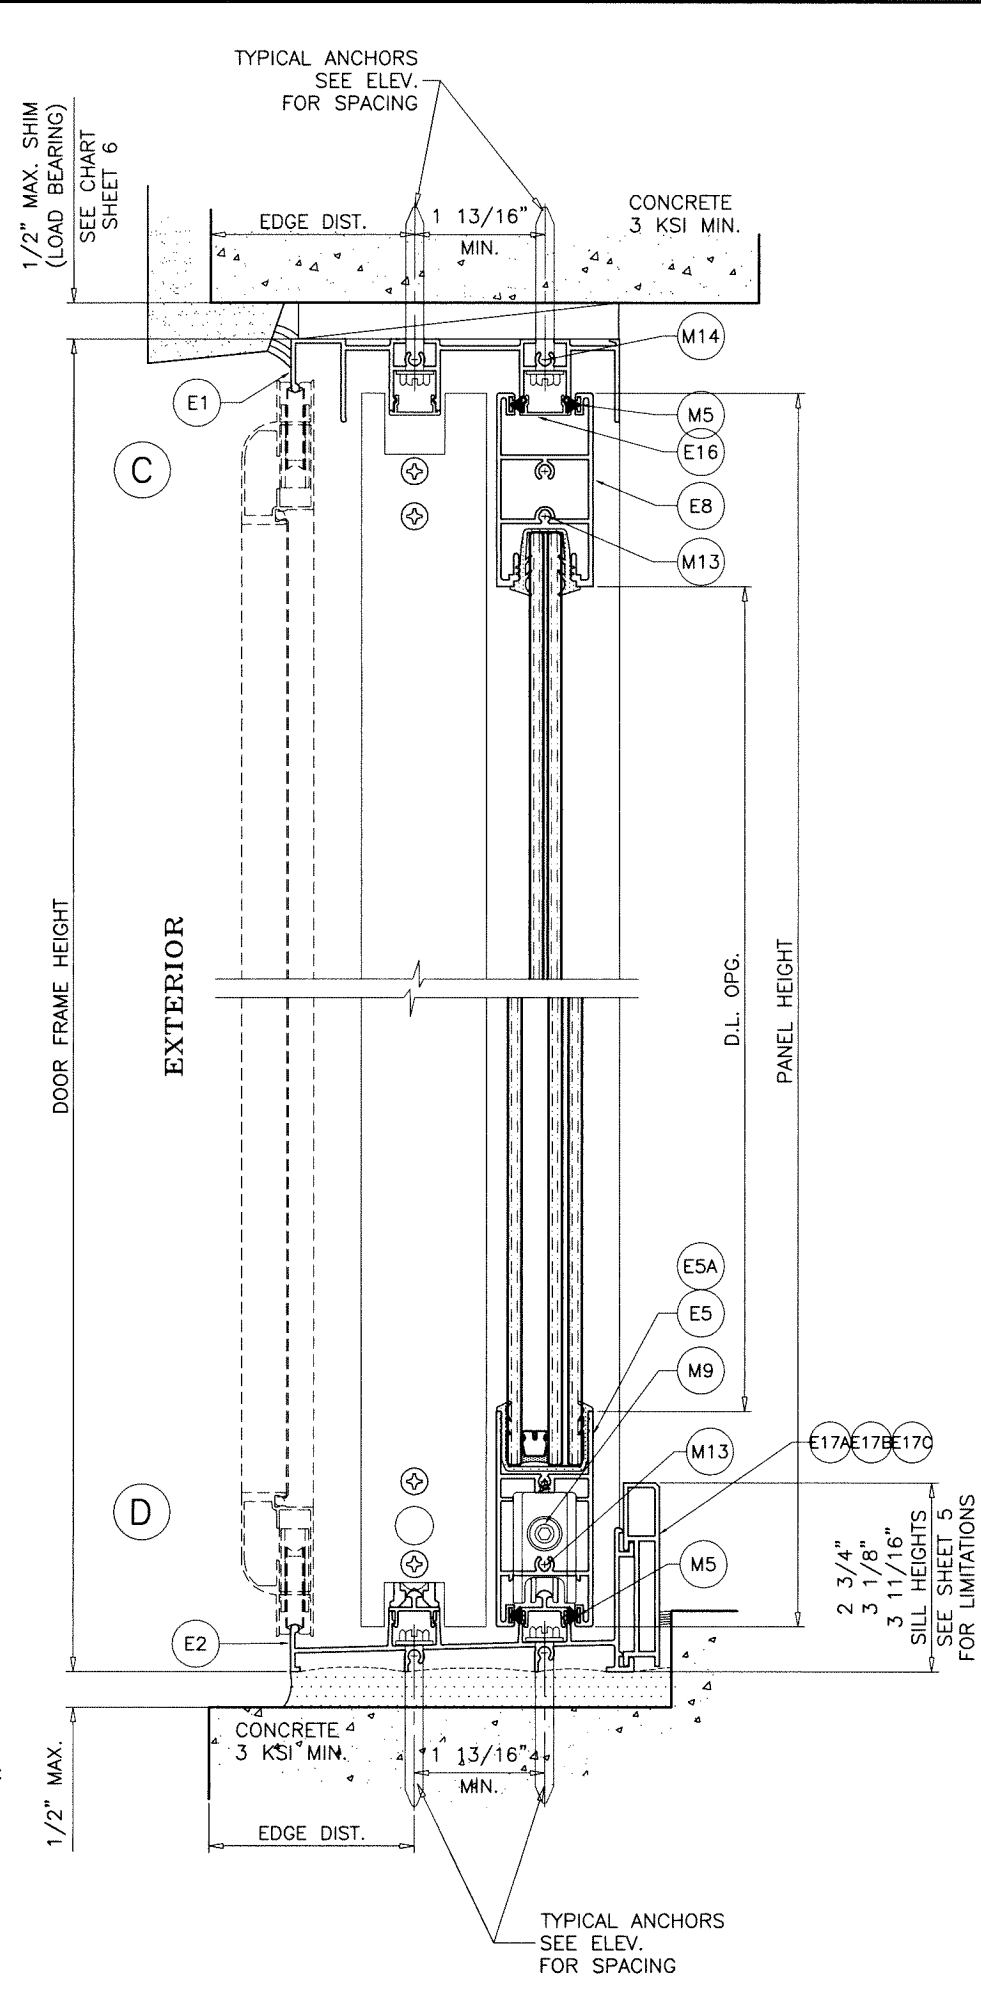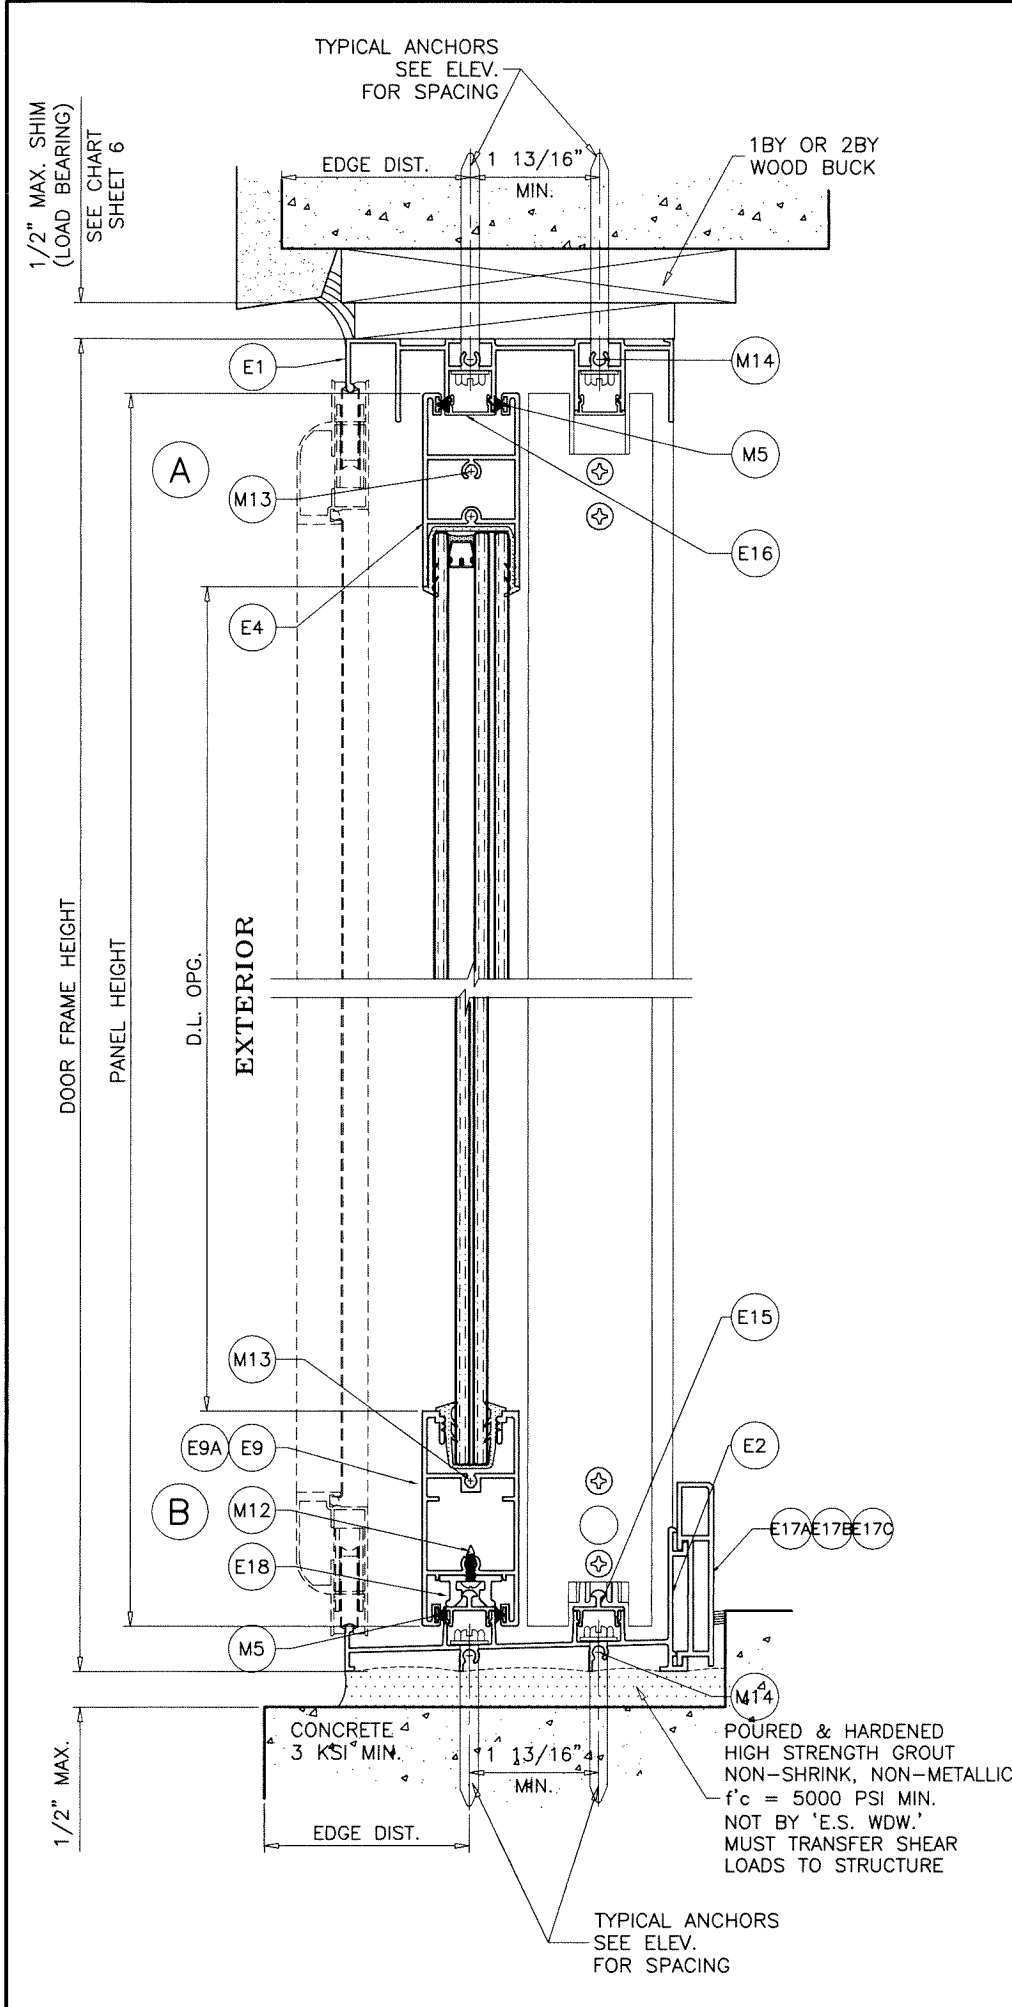

Sealed: 12/11/2025

FL #22645

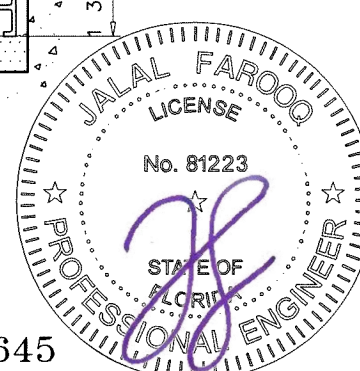

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 COMP-ANL\W17-67ES	
ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)	
E.S. WINDOWS, LLC 3550 N.W. 49 STREET MIAMI, FL. 33142 TEL. (305) 638-5151 FAX. (305) 638-5158	
revisions: no. date by description	
date: 07-11-17 scale: 3/8" = 1" dr. by: TARIQ chk. by:	
drawing no. W17-67	
sheet 14 of 23	

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
— AT HEAD

- TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO WOOD STRUCTURES
2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONCRETE
1-3/4" MIN. EMBED INTO CONCRETE, 1-1/2" MIN. EDGE DIST.
THRU 2BY BUCKS INTO CONCRETE
1-1/2" MIN. EMBED INTO CONCRETE, 1-1/2" MIN. EDGE DIST.
- TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
2" MIN. EMBED INTO CONCRETE, 1-1/2" MIN. EDGE DIST.
- TYPE 'C'— 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

— AT SILL

- TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED INTO CONCRETE




— AT JAMBS

- TYPE 'A'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO WOOD STRUCTURES
2" MIN. PENETRATION INTO WOOD
THRU 1BY OR 2BY BUCKS INTO CONC. OR FILLED BLOCK
1-1/4" MIN. EMBED INTO CONCRETE
1-1/2" MIN. EMBED INTO FILLED BLOCKS
- TYPE 'B'— 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE OR GROUT FILLED BLOCKS
2" MIN. EMBED INTO CONCRETE
2" MIN. EMBED INTO GROUT FILLED BLOCKS
- TYPE 'C'— 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO CONCRETE AND MASONRY = 2-1/2" MIN. (UNLESS SPECIFIED OTHERWISE)
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

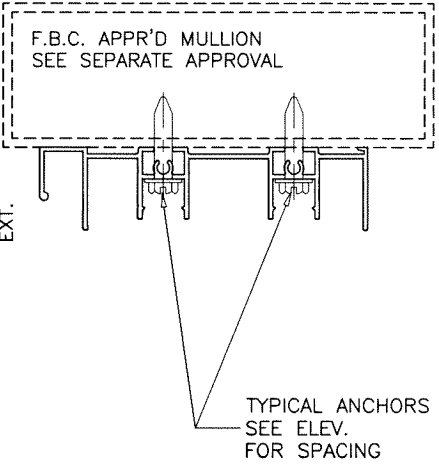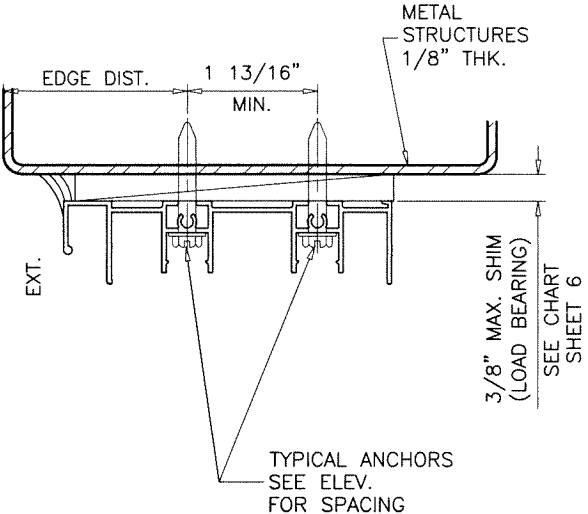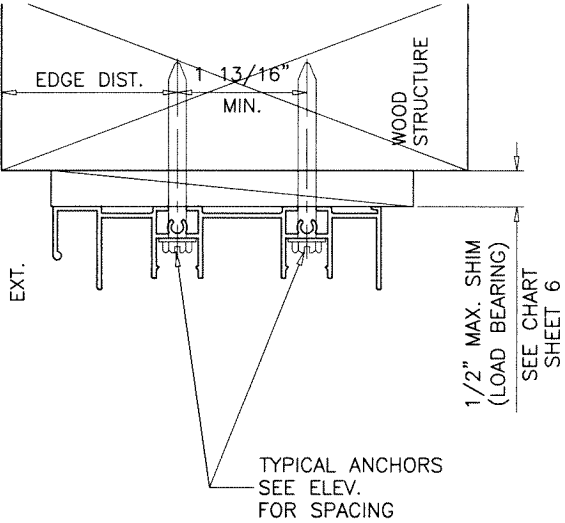

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'E.S. WDW.'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Sealed: 12/11/2025



FL #22645





AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 07-11-17	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no. W17-67			
sheet 15 of 23			

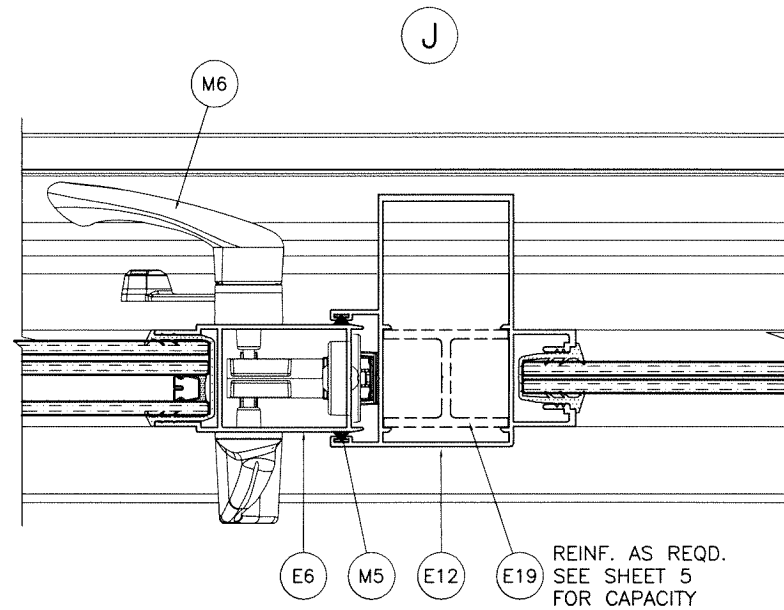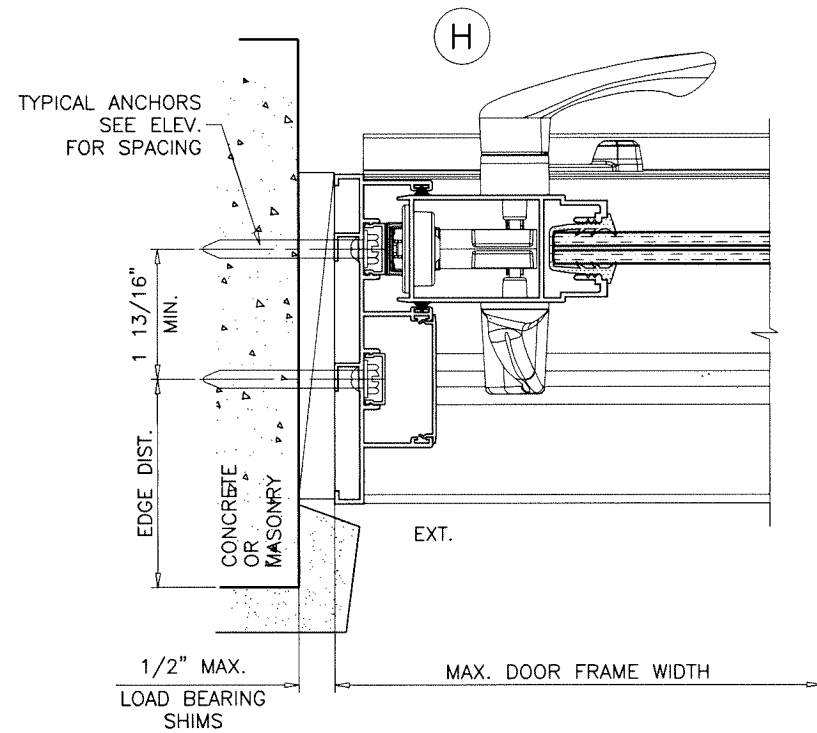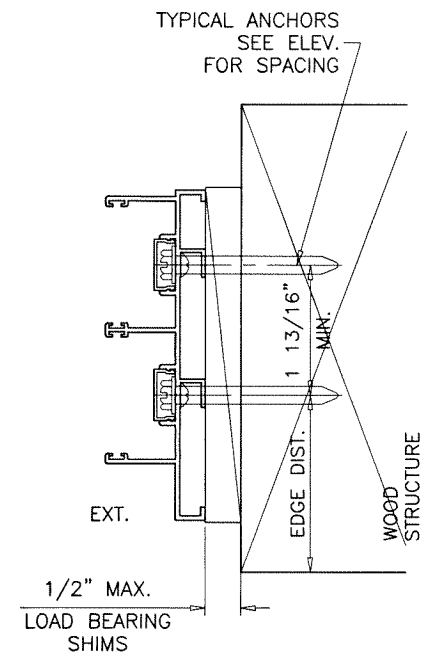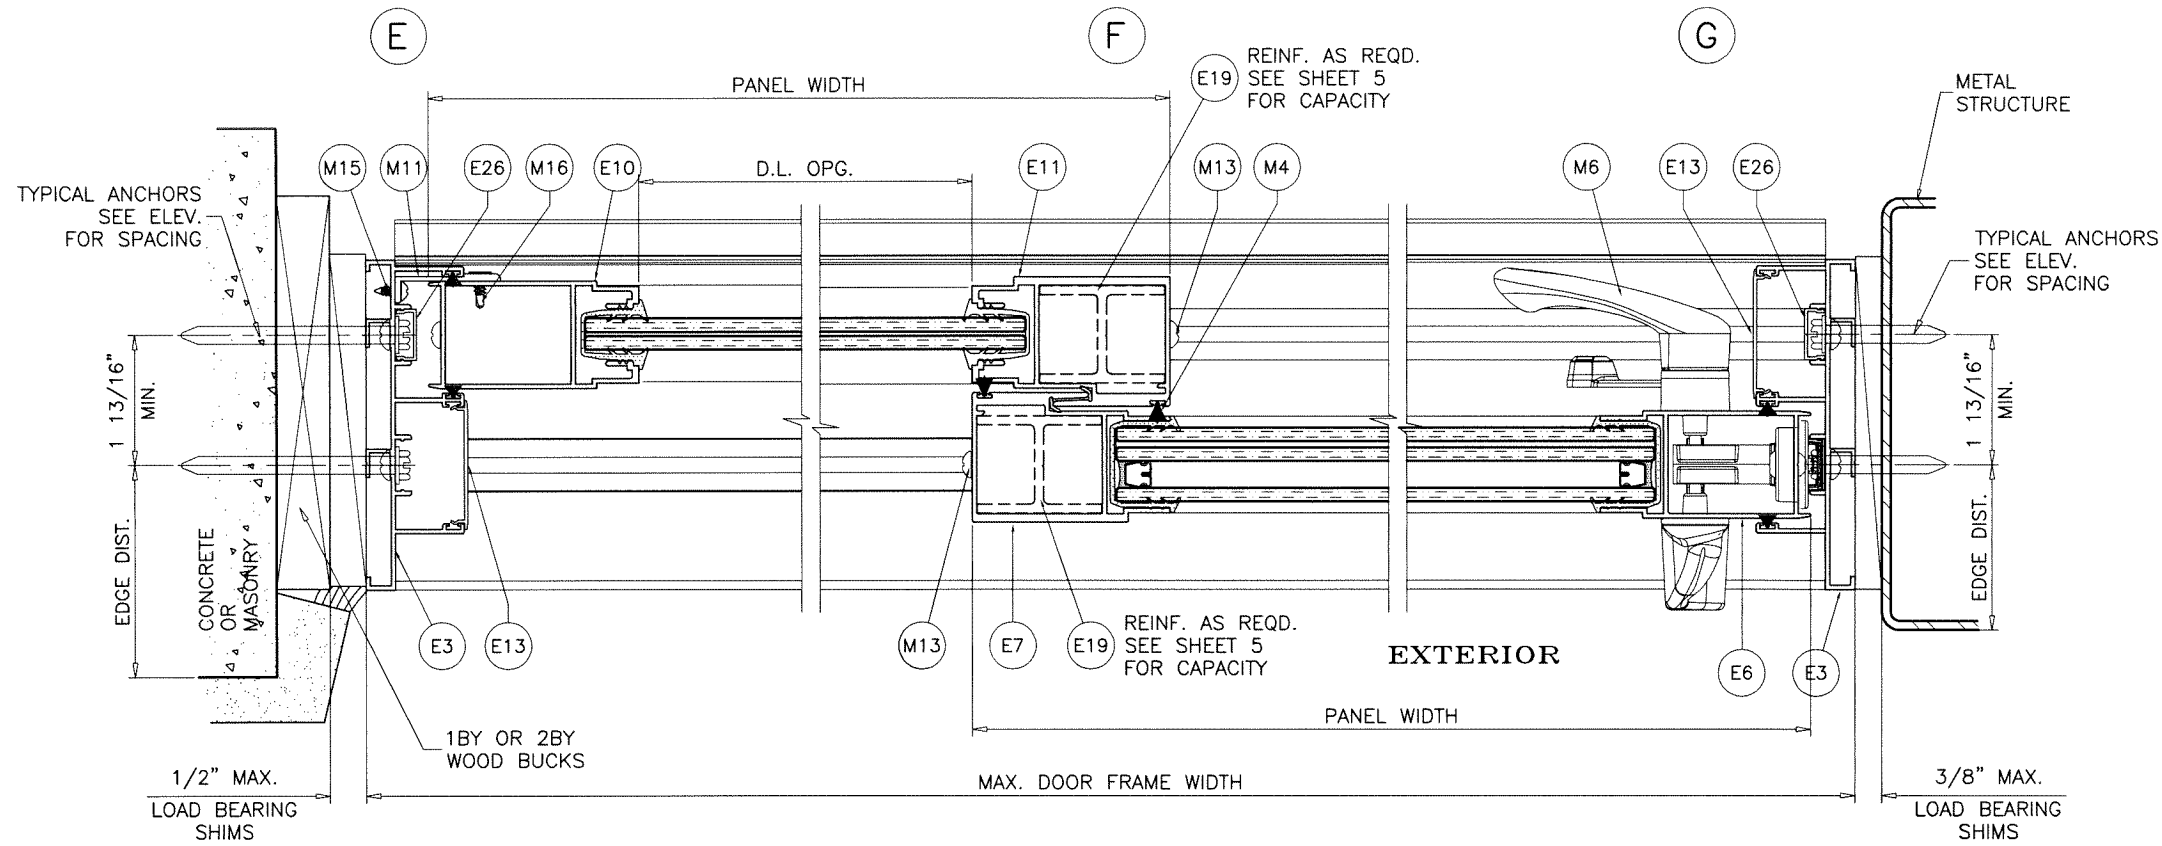

Sealed: 12/11/2025




FL #22645

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no date by description	
date:	07-11-17	scale:	3/8" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.	W17-67		
sheet	16 of 23		

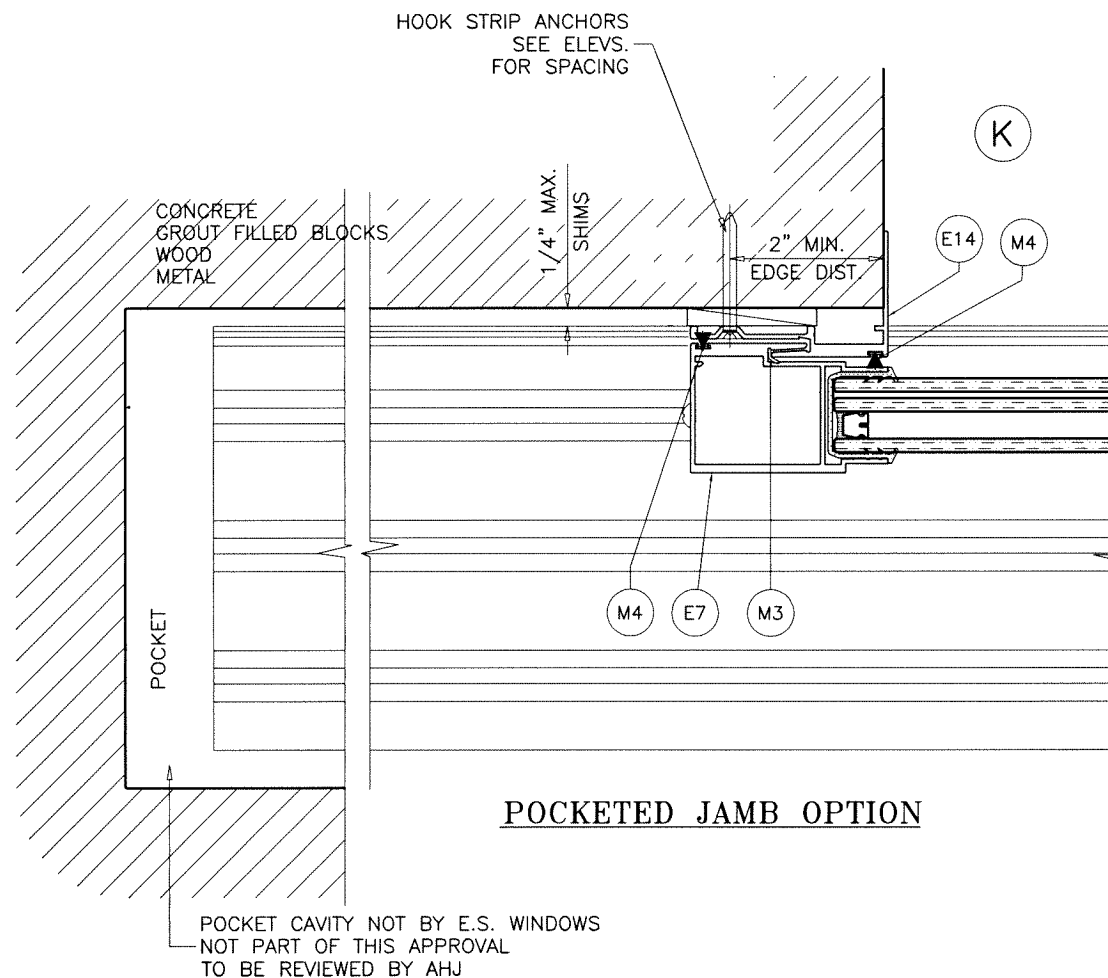

POCKETED JAMB OPTION

HOOK STRIP ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

DIRECTLY INTO CONCRETE OR GROUT FILLED BLOCKS
 1-3/4" MIN. EMBED INTO CONCRETE
 1-3/4" MIN. EMBED INTO GROUT FILLED BLOCKS

#14 SMS (GRADE 2 CRS)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

Sealed: 12/11/2025



FL #22645

afc

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978











COMP-ANL\W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no		date		by		description	

date: 07-11-17
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:
 drawing no.
W17-67
 sheet 17 of 23

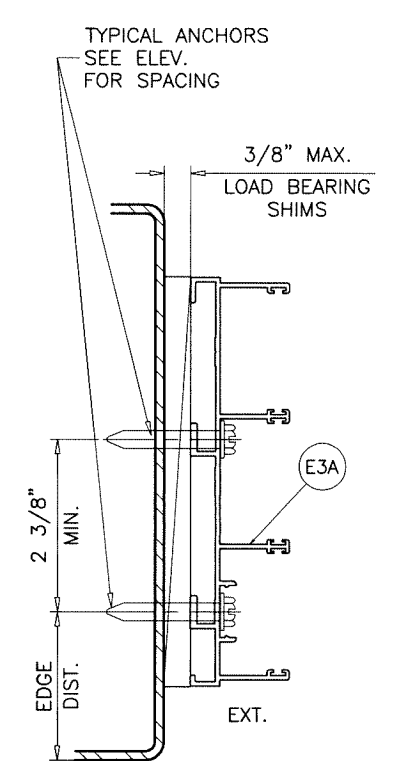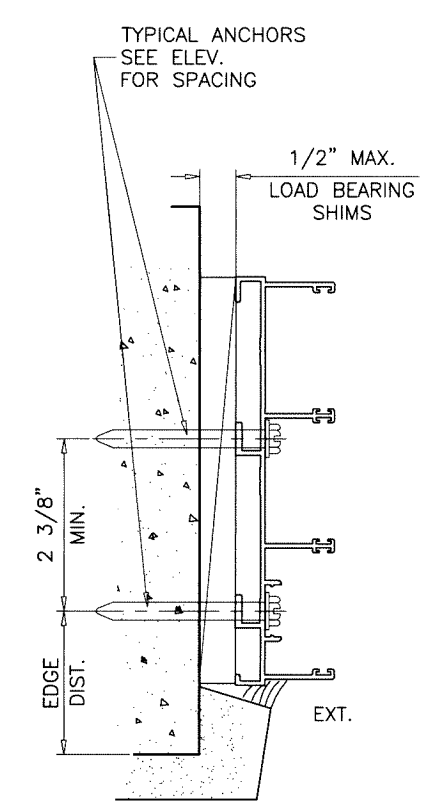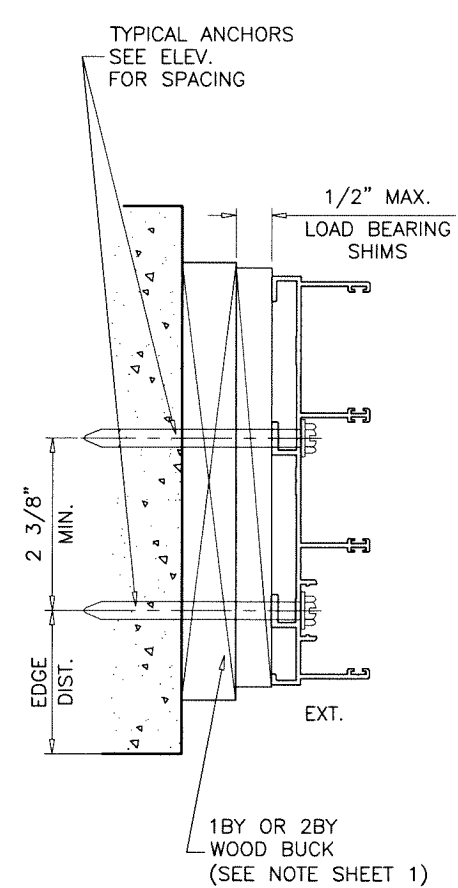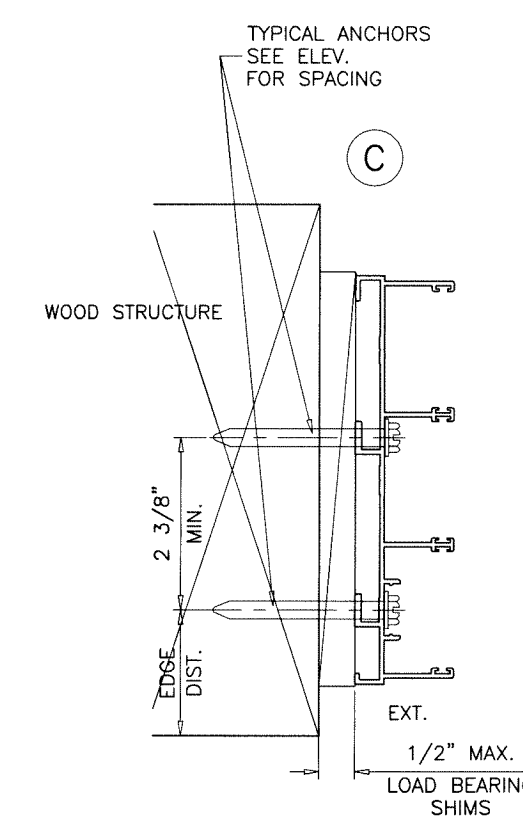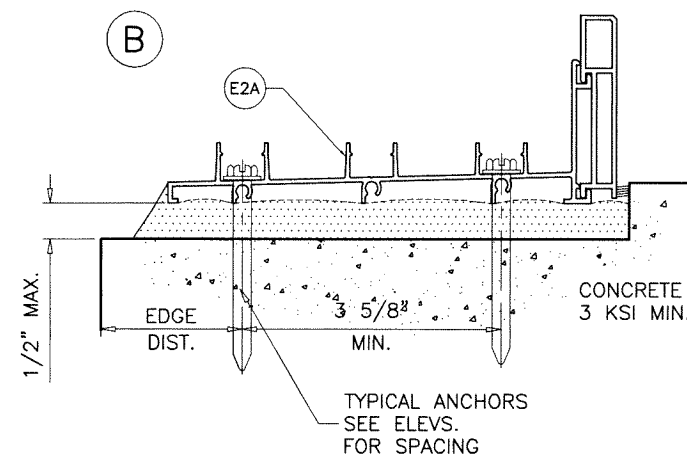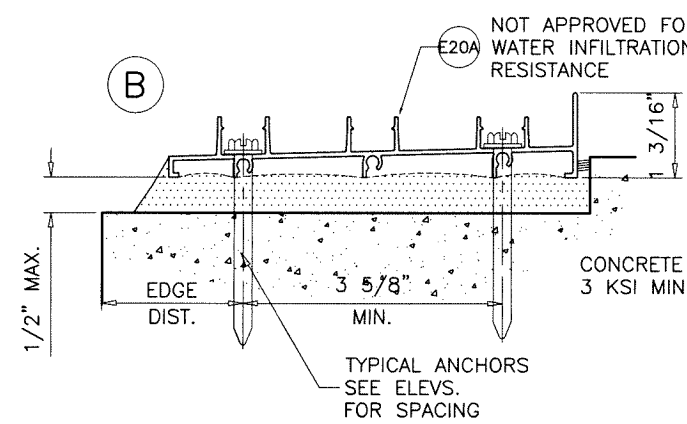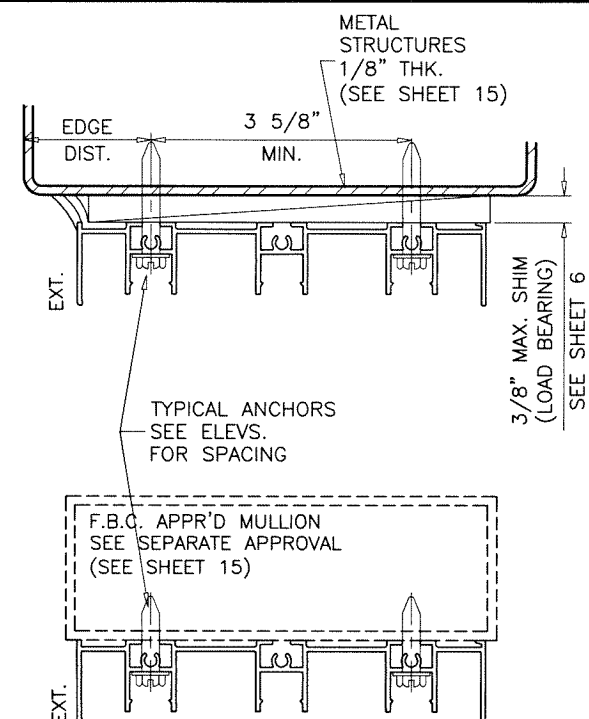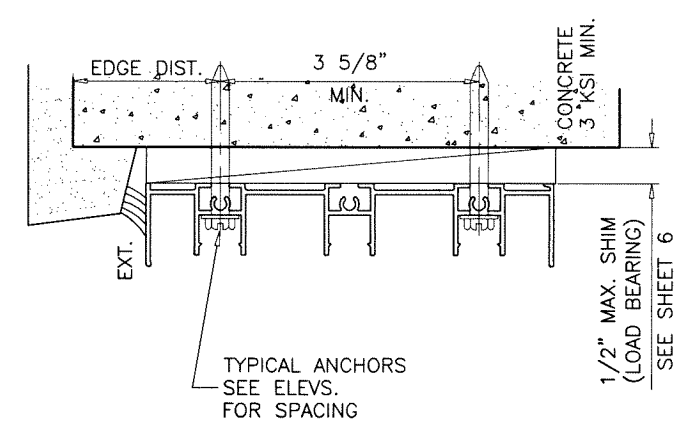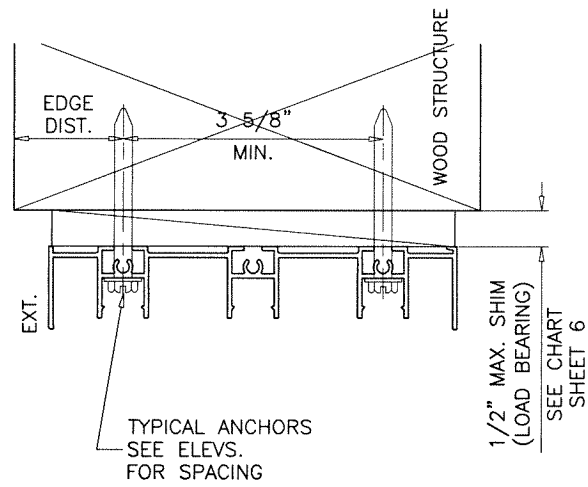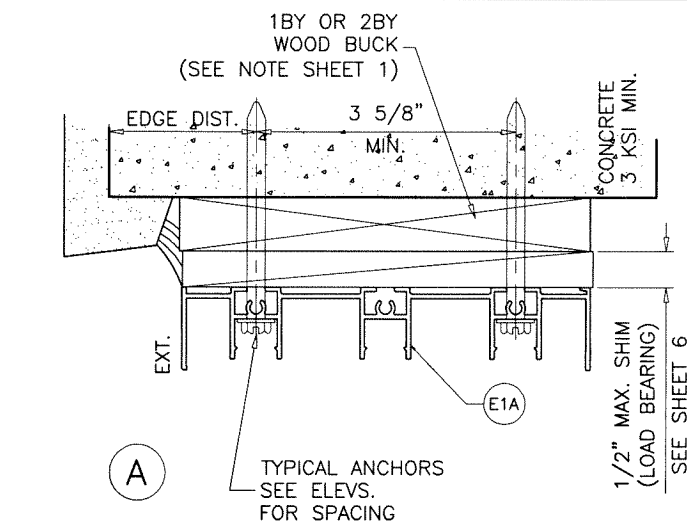

3 TRACK FRAMES
ANCHOR LOCATIONS

Sealed: 12/11/2025

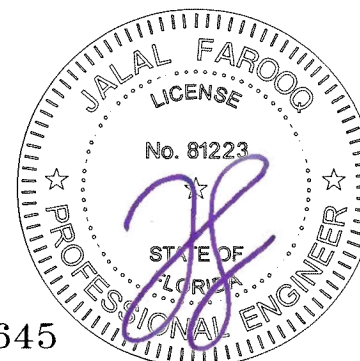

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c
(C.A.N. 3538)
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978







ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description

date: 07-11-17
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:


drawing no.
W17-67
sheet 18 of 23

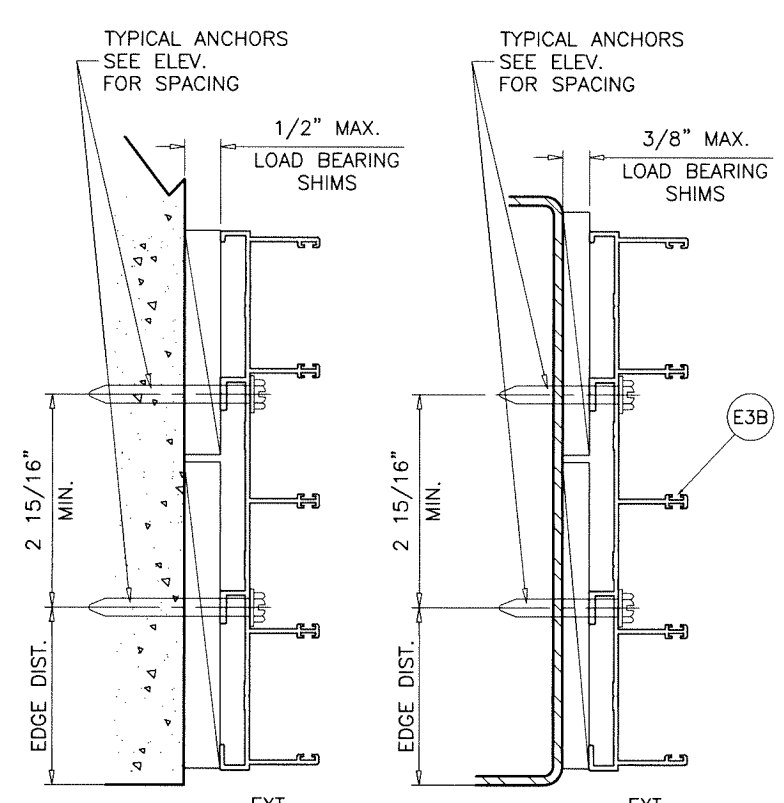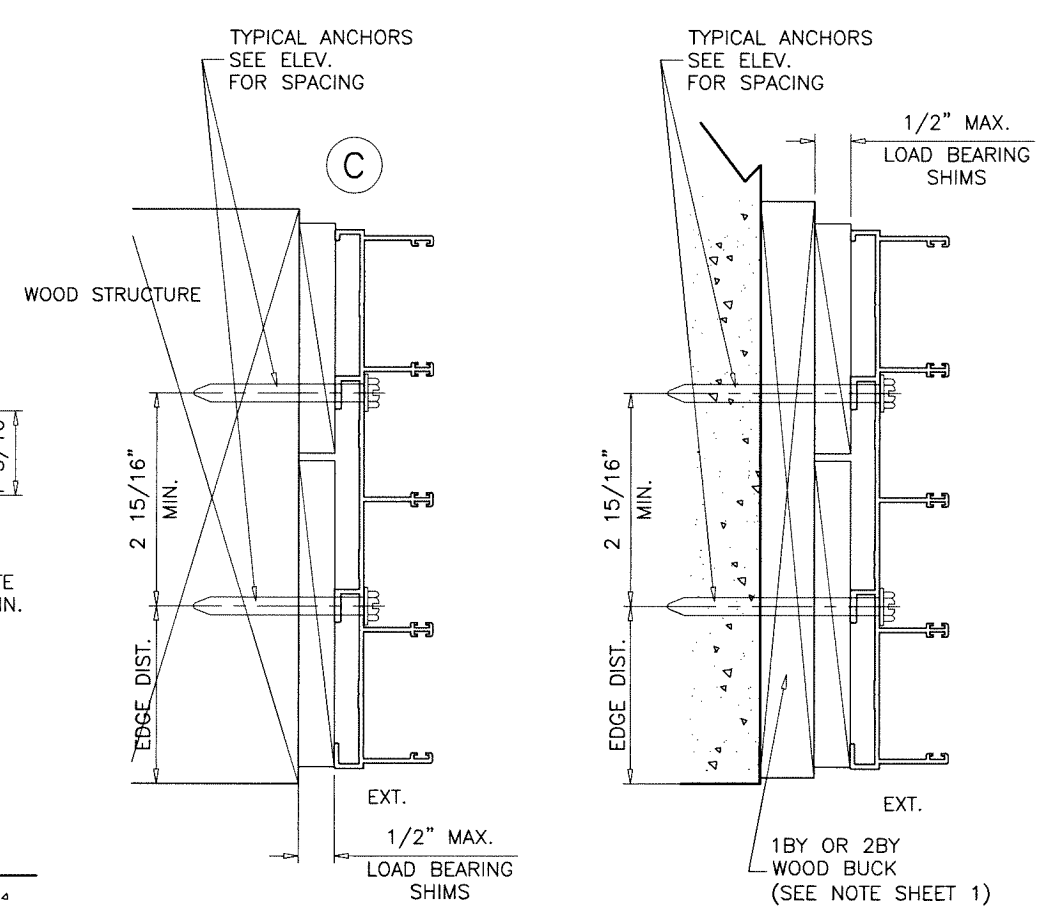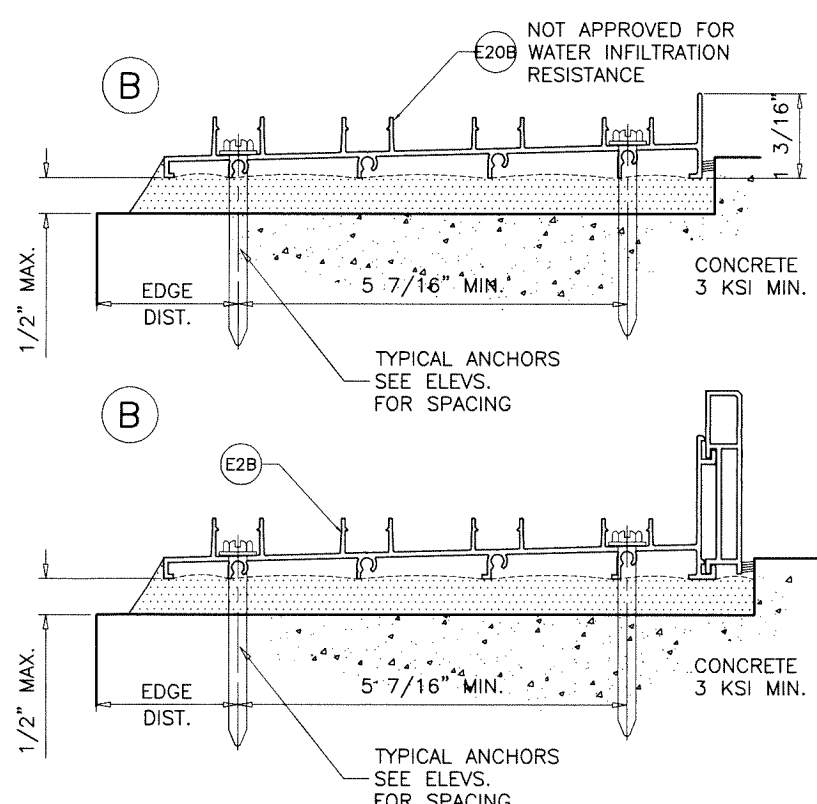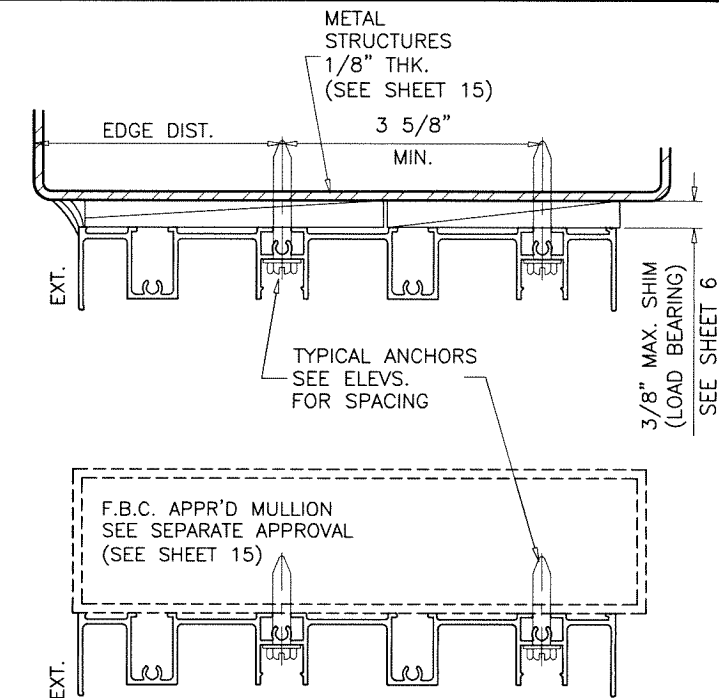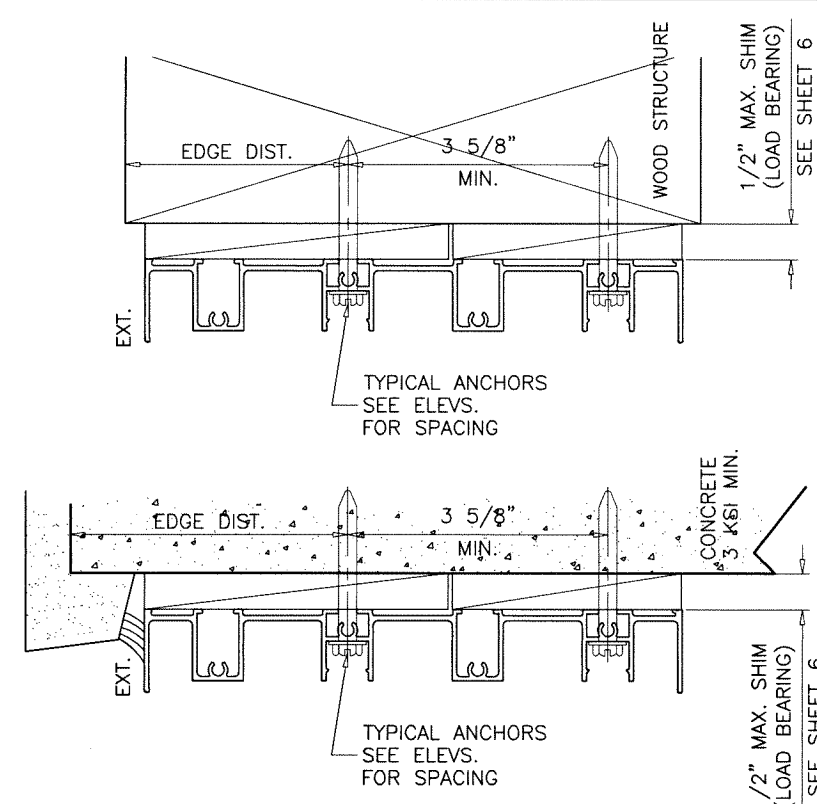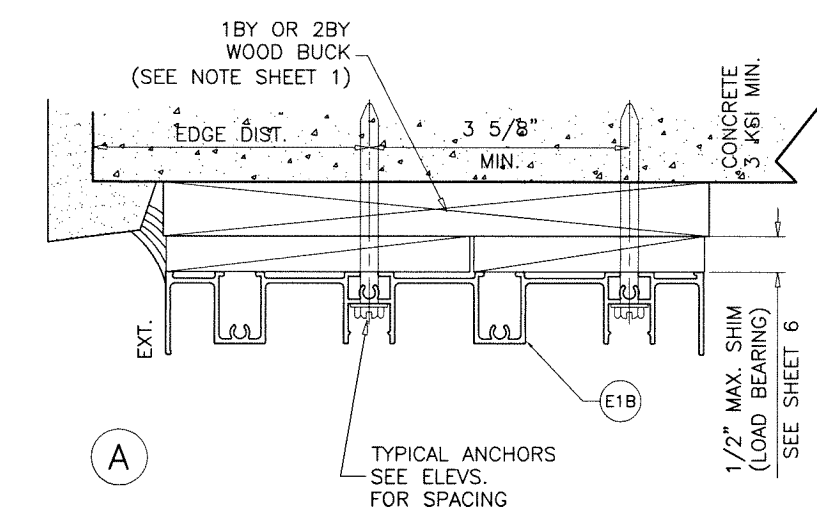

Sealed: 12/11/2025

4 TRACK FRAMES
ANCHOR LOCATIONS

FL #22645

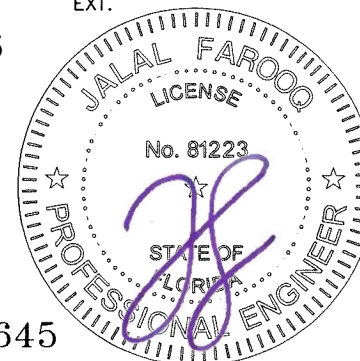

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c

COMP-ANL W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description

date: 07-11-17
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W17-67

sheet 19 of 23

FL #22645

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	ES-EL400-001	1	FRAME HEAD (2 TRACK)	6063-T6	-
E1A	ES-EL400-201	AS REQD.	FRAME HEAD (3 TRACK)	6063-T6	-
E1B	ES-EL400-205	AS REQD.	FRAME HEAD (4 TRACK)	6063-T6	-
E2	ES-EL400-002	1	FRAME SILL (2 TRACK)	6063-T6	-
E2A	ES-EL400-202	AS REQD.	FRAME SILL (3 TRACK)	6063-T6	-
E2B	ES-EL400-206	AS REQD.	FRAME SILL (4 TRACK)	6063-T6	-
E3	ES-EL400-003	2	FRAME JAMB (2 TRACK)	6063-T6	-
E3A	ES-EL400-203	AS REQD.	FRAME JAMB (3 TRACK)	6063-T6	-
E3B	ES-EL400-207	AS REQD.	FRAME JAMB (4 TRACK)	6063-T6	-
E4	ES-EL400-004	1/ PANEL	TOP RAIL (INSUL. LAM. GLASS)	6063-T6	-
E5	ES-EL400-005	1/ PANEL	BOTTOM RAIL (STANDARD) (INSUL. LAM. GLASS)	6063-T6	-
E5A	ES-EL400-410A	1/ PANEL	BOTTOM RAIL (HI-RISE) (INSUL. LAM. GLASS)	6063-T6	-
E6	ES-EL400-006	AS REQD.	JAMB STILE (INSUL. LAM. GLASS)	6063-T6	-
E7	ES-EL400-007	AS REQD.	INTERLOCK STILE (INSUL. LAM. GLASS)	6063-T6	-
E8	ES-EL400-009	1/ PANEL	TOP RAIL (LAM. GLASS)	6063-T6	-
E9	ES-EL400-010	1/ PANEL	BOTTOM RAIL (STANDARD) (LAM. GLASS)	6063-T6	-
E9A	ES-EL400-409A	1/ PANEL	BOTTOM RAIL (HI-RISE) (LAM. GLASS)	6063-T6	-
E10	ES-EL400-011	AS REQD.	JAMB STILE (LAM. GLASS)	6063-T6	-
E11	ES-EL400-012	AS REQD.	INTERLOCK STILE (LAM. GLASS)	6063-T6	-
E12	ES-EL400-013	AS REQD.	ASTRAGAL STILE (LAM. GLASS)	6063-T6	-
E12A	ES-EL400-008	AS REQD.	ASTRAGAL STILE (INSUL. LAM. GLASS)	6063-T6	-
E13	ES-EL400-014	AS REQD.	JAMB COVER	6063-T5	-
E14	ES-EL400-015	AS REQD.	POCKET JAMB	6063-T6	-
E15	ES-EL400-016	AS REQD.	SILL TRACK	6063-T6	-
E16	ES-EL400-017	AS REQD.	HEAD COVER	6063-T5	-
E17A	ES-2020-008	AS REQD.	SILL RISER	6063-T6	-
E17B	ES-2020-007	AS REQD.	ALT. SILL RISER	6063-T6	-
E17C	ES-2020-041	AS REQD.	ALT. SILL RISER	6063-T6	-
E18	ES-EL400-020	AS REQD.	FIXED PANEL BOTTOM GUIDE	6063-T6	-
E19	ES-EL400-021	AS REQD.	INTERLOCK REINFORCEMENT	6005-T5	-
E20	ES-EL400-401	1	FRAME SILL (2 TRACK)	6063-T6	-
E20A	ES-EL400-403	AS REQD.	FRAME SILL (3 TRACK)	6063-T6	-
E20B	ES-EL400-404	AS REQD.	FRAME SILL (4 TRACK)	6063-T6	-
E26	ES-6011	AS REQD.	SCREW COVER	6063-T6	-
M1	ES-EL400-G01	4/ PANEL	GLAZING GASKET (LAM. GLASS)	SILICONE	DUROMETER 70±3 SHORE A
M2	ES-EL400-G02	4/ PANEL	GLAZING GASKET (INSUL. LAM. GLASS)	SILICONE	DUROMETER 70±3 SHORE A
M3	ES2020-G04	AS REQD.	INTERLOCK BUMPER	PVC	DUROMETER 60±5 SHORE D
M4	W33271NK	AS REQD.	PILE W'STRIPPING (INTERLOCK)	WOOL	-
M5	W33181NK	AS REQD.	PILE W'STRIPPING	WOOL	-
M6	PS01-0014	AS REQD.	DOOR HANDLE	DIE CAST ALUM	TWO POINT HANDLE
M7	PS01-1015	AS REQD.	STRIKE FOR MORTISE LOCK	ST. STEEL	-
M8	PS01-1036	AS REQD.	MORTISE 2 POINT LOCK	ST. STEEL	-
M9	GT-R34/3-01-A	2/ PANEL	ROLLER ASSEMBLY	ZAMAK	-
M10	6844.1	AS REQD.	BUMPER	ALUM/NYLON	-
M11	ES-EL400-FPI SL	2/ PANEL	FIX. PANEL CLIPS, AT 12" FROM TOP & BOTTOM	6063-T6	-
M12	#8 X 3/4"	AS REQD.	KEEPER FASTENERS	ST. STEEL	P.H. SMS
M13	#10 X 1-1/4"	AS REQD.	PANEL ASSEMBLY FASTENERS	ST. STEEL	P.H. SMS
M14	#12 X 1-1/2"	AS REQD.	FRAME ASSEMBLY FASTENERS	ST. STEEL	P.H. SMS
M15	#6 X 3/8"	AS REQD.	FIX. PANEL CLIP FASTENERS	ST. STEEL	P.H. SMS
M16	#8 X 1/2"	AS REQD.	FIX. PANEL CLIP FASTENERS	ST. STEEL	F.H. SMS
M18	#10 X 1/2"	AS REQD.	ROLLER FASTENERS	ST. STEEL	P.H. SMS
M19	#10 X 1"	AS REQD.	LOCK INSTALLATION FASTENERS	ST. STEEL	F.H. SMS
M20	#8 X 1/2"	AS REQD.	HANDLE INSTALLATION FASTENERS	ST. STEEL	F.H. SMS

LOCK:

SURFACE MOUNT METALLIC HANDLE AT 44" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #8 X 1/2" FH SMS (M20)

SURFACE MOUNT METALLIC 3 PLY DUAL HOOK LOCK
44" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #10 X 1" FH SMS

SURFACE MOUNT METALLIC KEEPER AT 44" FROM BOTTOM
FASTENED TO FRAME JAMB AND ASTRAGAL STILE WITH
(3) #8 X 3/4" PH SMS (M12)

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH
WHITE/ALUMINUM COLORED SILICONE.

Sealed: 12/11/2025



FL #22645

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FAX. (305) 262-6978

COMP-ANL\W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:

no	date	by	description

date: 07-11-17


scale: 3/8" = 1"

dr. by: TARIQ


chk. by:

drawing no.
W17-67

sheet 20 of 23

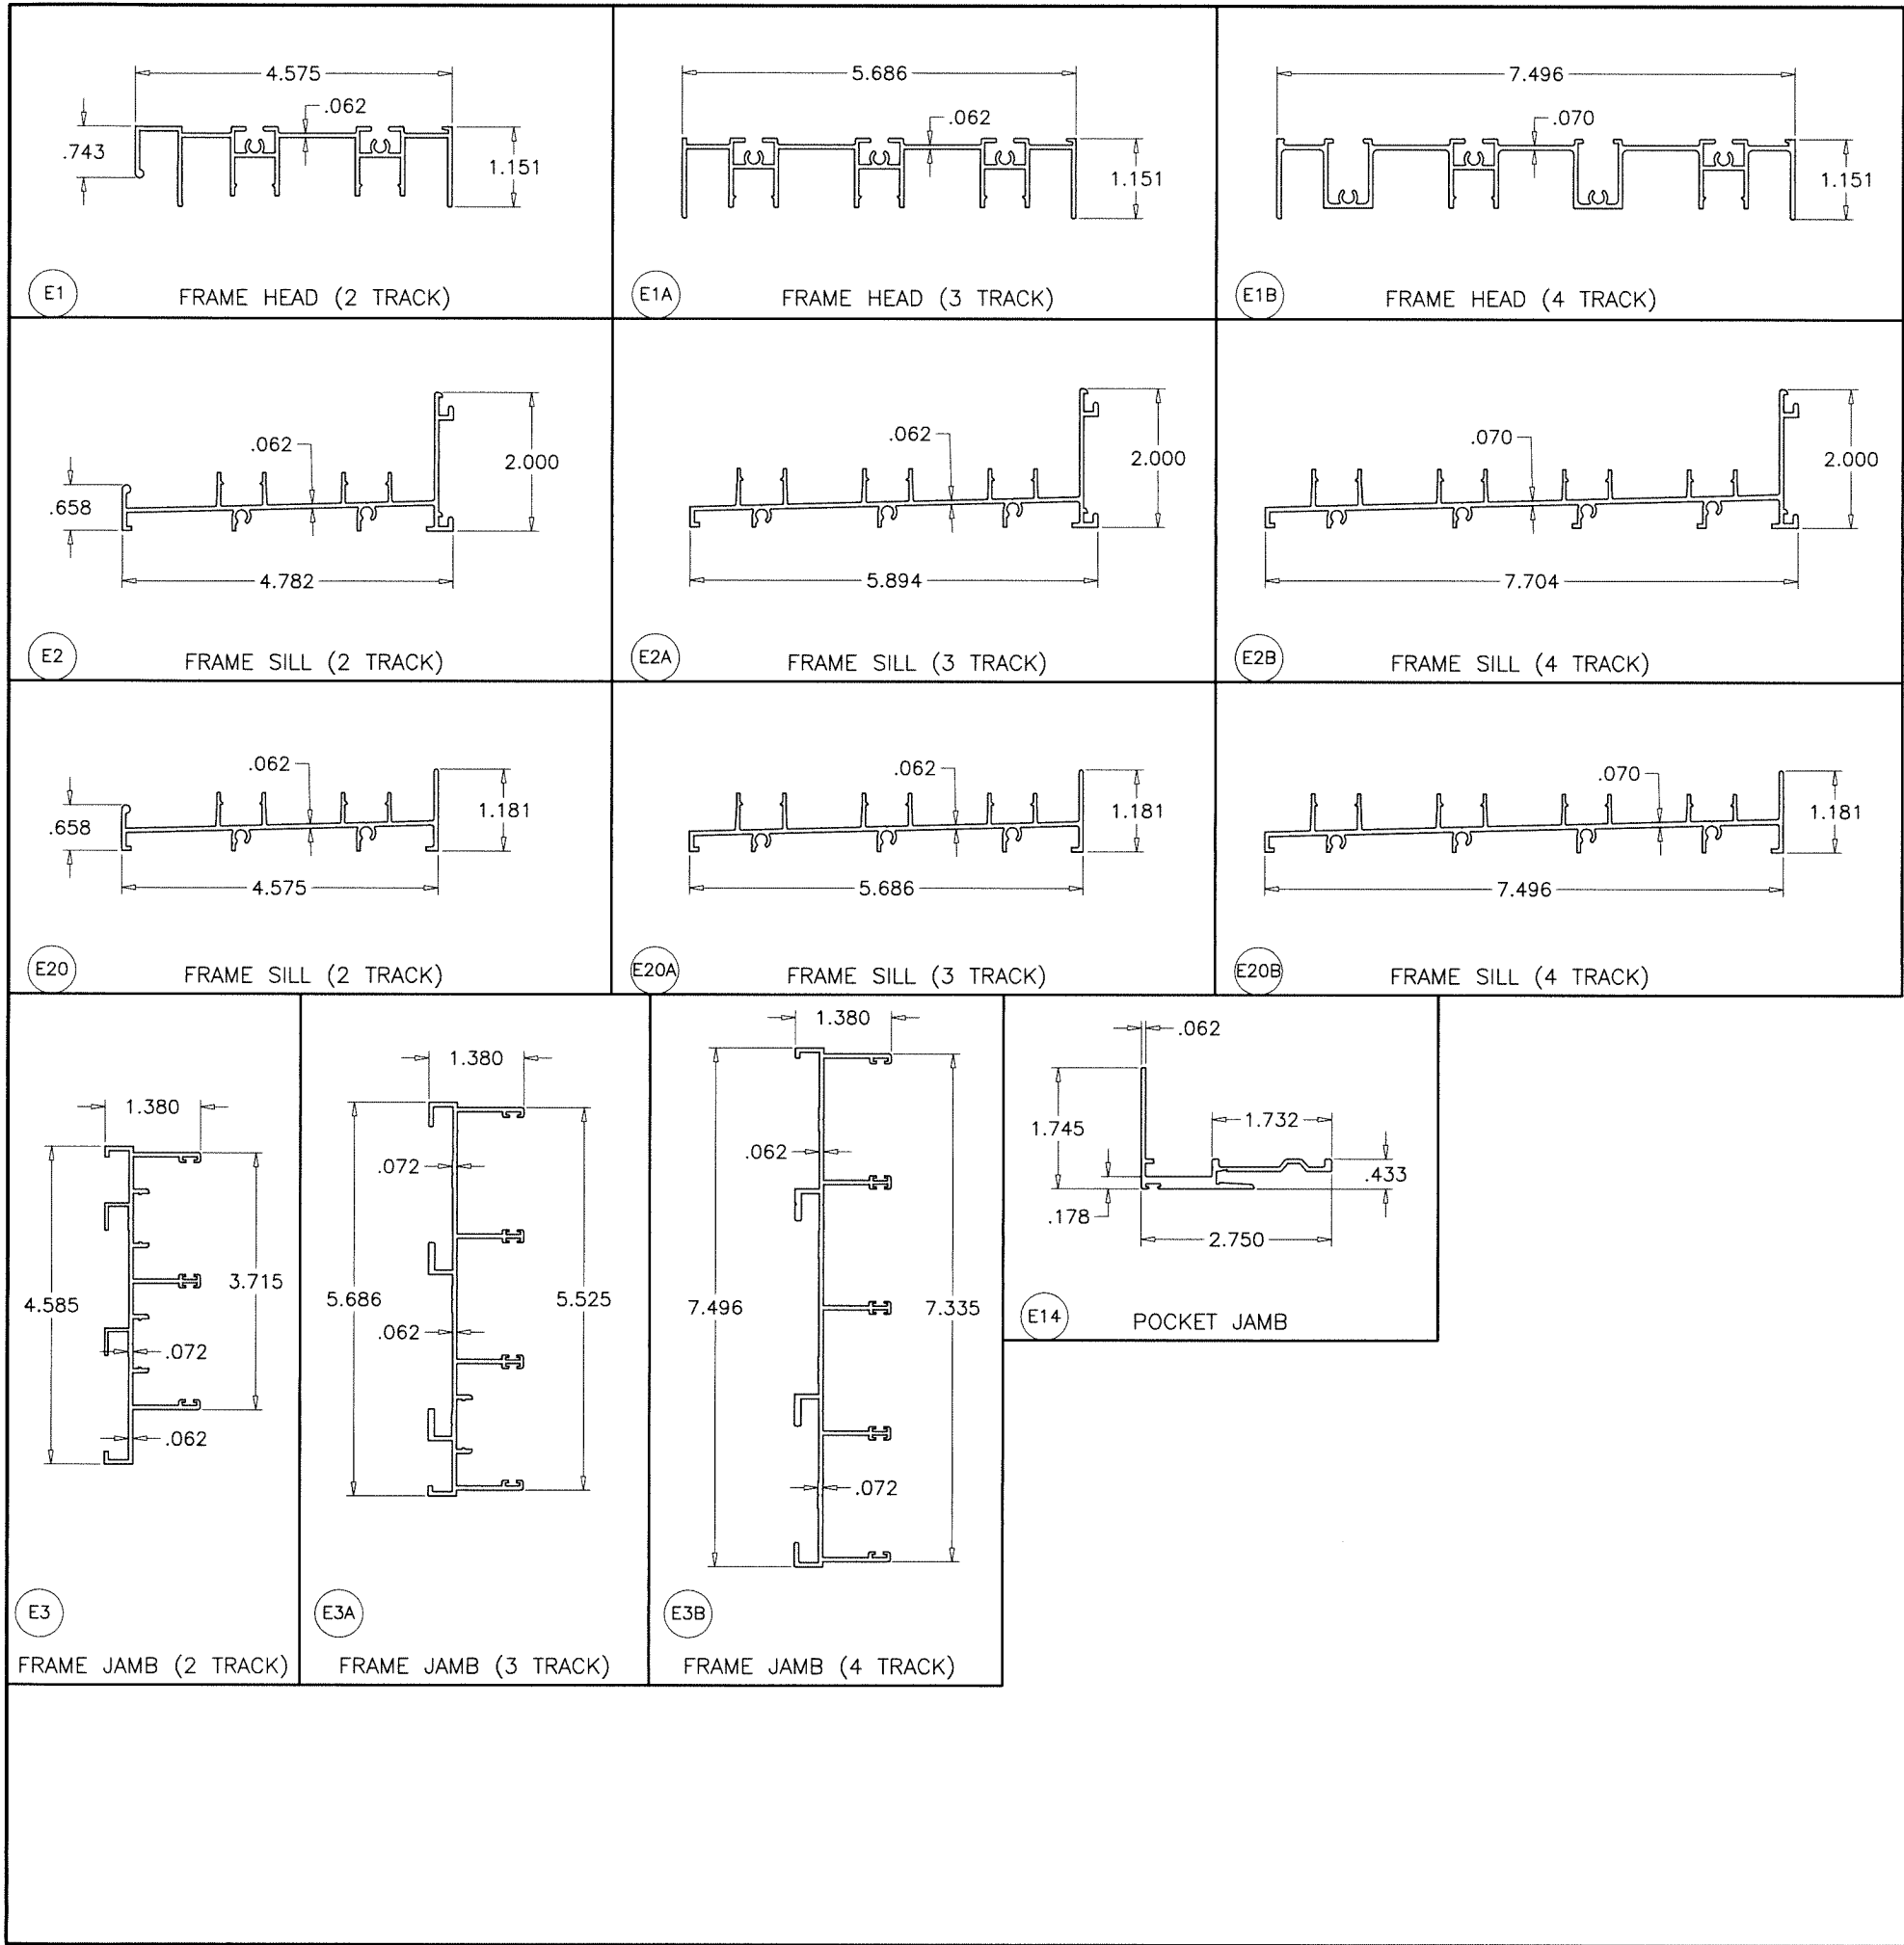

Sealed: 12/11/2025

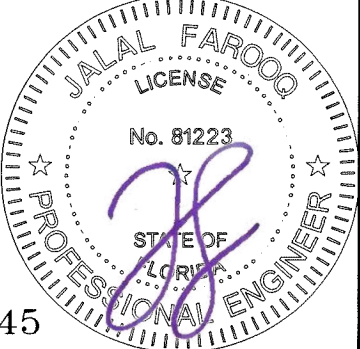

FL #22645

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978


COMP-ANL\W17-67ES

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description

date: 07-11-17	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:	drawing no. W17-67
sheet 21 of 23				

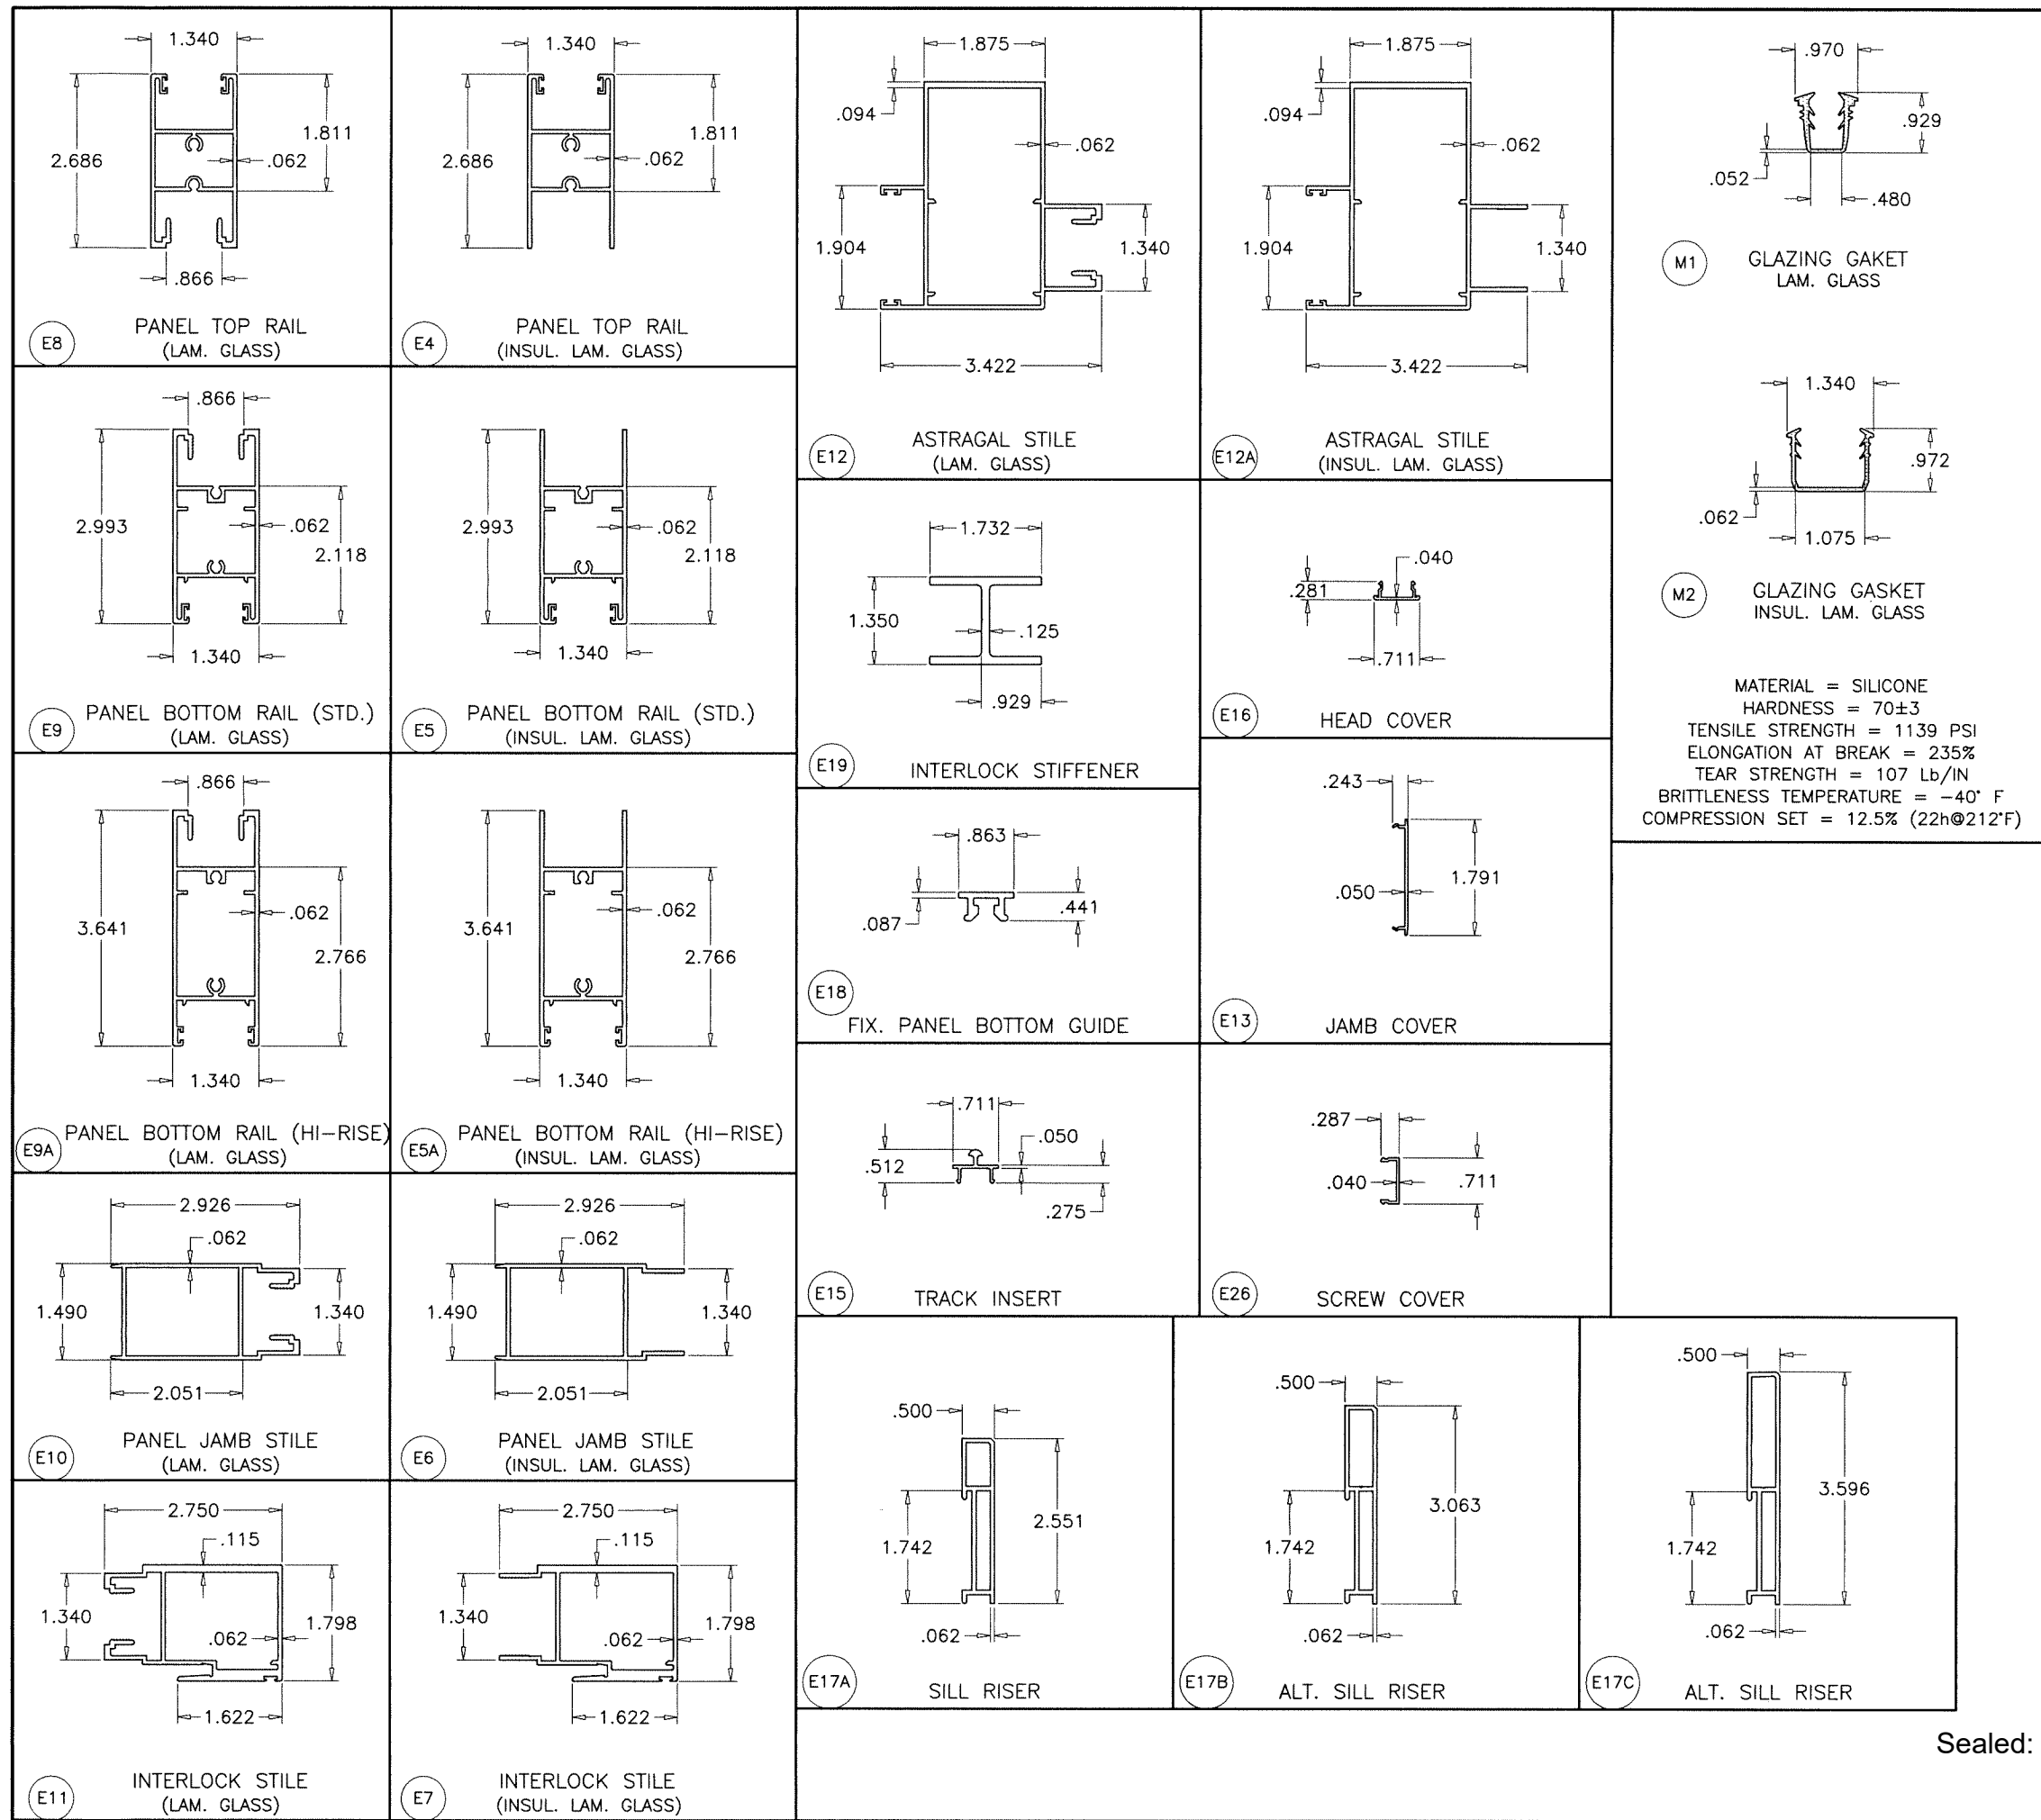

Sealed: 12/11/2025
 FL #22645



AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

ES-EL400 ALUM SLIDING GLASS DOOR (L.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	date by description

date: 07-11-17

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.
W17-67

sheet 22 of 23

