


GENERAL NOTES AND SPECIFICATIONS:

1. DOUBLE & SINGLE SERIES 8080 & 4080 EMBOSSED OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR SHOWN ON THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) HAS BEEN VERIFIED FOR CODE COMPLIANCE IN ACCORDANCE WITH THE **2026 (9th EDITION)** OF THE FLORIDA BUILDING CODE. DOOR MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES.
- DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTIONS 1620 & 1609 OF THE ABOVE MENTIONED CODE, USING **ASCE 7-22** AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON SHEET 3.
- IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER **ASCE 7-22** SHALL FIRST BE REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE WITH MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON SHEET 3.
- THIS DOOR'S ADEQUACY FOR WIND AND IMPACT LOAD HAS BEEN VERIFIED IN ACCORDANCE WITH SECTIONS **1626 & 1609.1.2** OF THE ABOVE MENTIONED CODE AS PER PROTOCOLS TAS-201, TAS-202, TAS-203 AS PER CERTIFIED TESTING LAB. REPORTS #CTLA 2045W, #CTLA 2045W-1, #CTLA 2045W-2, #CTLA 2045W-3 AND AS PER SUBMITTED STRUCTURAL CALCULATIONS, PERFORMED AS PER SECTIONS **1616 & 1604** OF THE FLORIDA BUILDING CODE.
2. ALL COMPONENTS SHALL BE AS SPECIFIED ON APPLICABLE DETAIL SHEETS AND AT THE BILL OF MATERIALS (SHEET 4) OF THIS DRAWING.
3. COMPLIANCE OF EGRESS / ESCAPE REQUIREMENTS OF THESE DOORS PER FLORIDA BUILDING CODE SHALL BE DETERMINED BY BUILDING OFFICIALS ON A CASE-BY-CASE BASIS.
4. ALL SCREWS USED FOR ASSEMBLY CONNECTIONS (METAL TO METAL) SHALL BE STAINLESS STEEL 304 OR 316 AISI SERIES OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018 WITH 50 ksi YIELD POINT AND 90 ksi TENSILE STRENGTH & SHALL COMPLY WITH FLORIDA BUILDING CODE SECTIONS **2411.3.3.4 & 1711**.
5. ALL WELDING TO CONFORM WITH AMERICAN WELDING SOCIETY A.W.S. D.1.3 AND D-19.0 REGULATIONS WITH E60XX ELECTRODES, FOR GALVANNEAL MATERIAL, AND WITH AMERICAN WELDING SOCIETY A.W.S. D.1.6 REGULATIONS WITH E-308 ELECTRODES (FU=80k.s.i.) FOR STAINLESS STEEL MATERIAL
6. ALL ANCHORS FOR DOOR FRAME CONNECTIONS TO EXISTING STRUCTURE SHALL BE AS SPECIFIED ON SHEET 10 OF THIS DRAWING. ANCHORS SHALL COMPLY WITH SECTION 1711 OF THE FLORIDA BUILDING CODE. MAXIMUM ANCHOR SPACINGS SHALL BE AS PER SCHEDULE ON SHEET 10 AND ELEVATIONS ON SHEET 2 OF THIS DRAWING. SEE SHEET 2 FOR THRESHOLD ANCHORS, AND SHEET 2 FOR MULLION ANCHORS.
7. PROVIDE MAX. LOAD BEARING SHIM SPACE AS INDICATED ON SHEETS 3.
8. THIS DOOR WILL NOT REQUIRE A HURRICANE PROTECTION DEVICE.
9. THESE DOOR ASSEMBLIES ARE APPROVED FOR WATER AND AIR INFILTRATION AS PER THE TESTING INDICATED ON GENERAL NOTE 1, AND SHALL BE LIMITED TO DESIGN PRESSURE RATINGS INDICATED ON SHEET 3.
10. PROVIDE SPECIFIED SEALANT AT ALL DOOR FRAME & THRESHOLD COMPONENTS INDICATED ON THIS DRAWING.
11. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE BUILDING STRUCTURE AND, MUST BE SOUTHERN PINE WITH G=0.55, AND SHALL COMPLY WITH SECTIONS 2411.3.3.3; 2326 OF THE FLORIDA BUILDING CODE.
12. THE PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO SUSTAIN THE SUPERIMPOSED LOADS TRANSFERRED BY THESE DOORS.
13. (a) THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE-SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.
- (b) THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.E.D., PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT THE SITE IS THE CONTRACTOR'S RESPONSIBILITY.
- (c) THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- (d) THE ORIGINAL P.E.D SHALL BEAR THE DATE, SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD WHO PREPARED IT.
14. PRODUCT MANUFACTURER'S LABEL SHALL BE LOCATED AT A READILY VISIBLE LOCATION ON THE PRODUCT IN ACCORDANCE WITH SECTION 1709.5 OF THE FLORIDA BUILDING CODE. ONE LABEL SHALL BE PLACED FOR EVERY OPENING.

THIS DRAWING SHALL ONLY BE USED TO
OBTAIN PERMITS IN THE STATE OF FLORIDA

SHEETS CONTENT:

- SHEET #1 INDEX, COVER SHEET & GENERAL NOTES.
SHEET #2 ASSEMBLY ELEVATIONS No 1 & 2.
SHEET #3 MAX. DESIGN PRESSURE RATING (psf.) SCHEDULE.
SHEET #4 BILL OF MATERIALS.
SHEET #5 COMPONENTS.
SHEET #6 DOOR CONSTRUCTION DETAILS.
SHEET #7 VERTICAL SECTIONS AND DOOR FRAME DETAILS.
SHEET #8 HORIZONTAL SECTIONS & VERTICAL SECTIONS AT HARDWARE.
SHEET #9 RIM EXIT DEVICE W/ REMOVABLE MULLION.
SHEET #10 ANCHOR DETAILS & MAX. SPACING SCHEDULE.

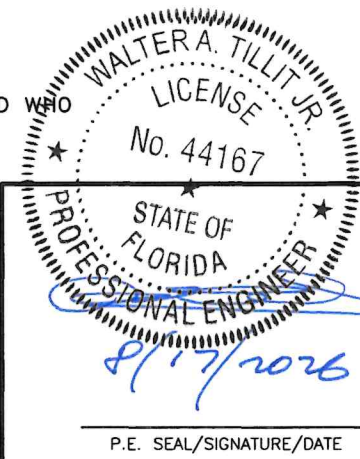


FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.


TILTECO inc.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167


DOUBLE & SINGLE SERIES 8080 & 4080 OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR FLUSH OR EMBOSSED				DRAWN BY: W.H.	
DAYBAR INDUSTRIES LTD				08/06/2026 DATE	
50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4 TEL: 905 625-8000 FAX: 905 625-4204				26-246 DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-179	08/06/2026	3		
2			4		
				SHEET 1 OF 10	

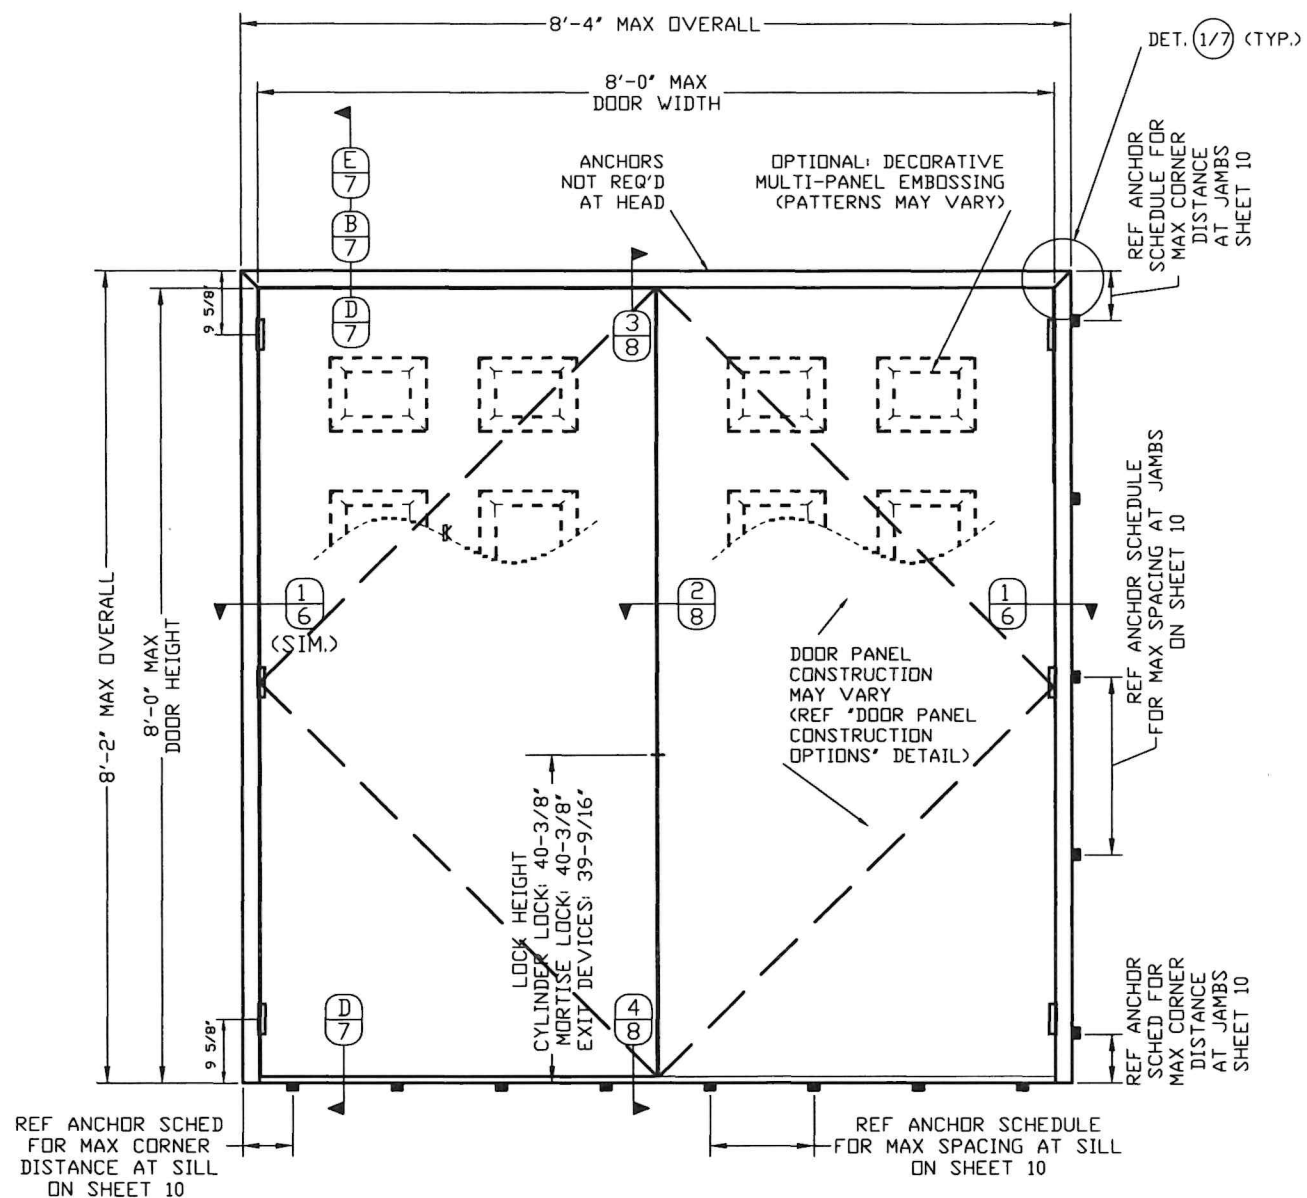

DOUBLE DOOR EXTERIOR ELEVATION: SERIES 8080

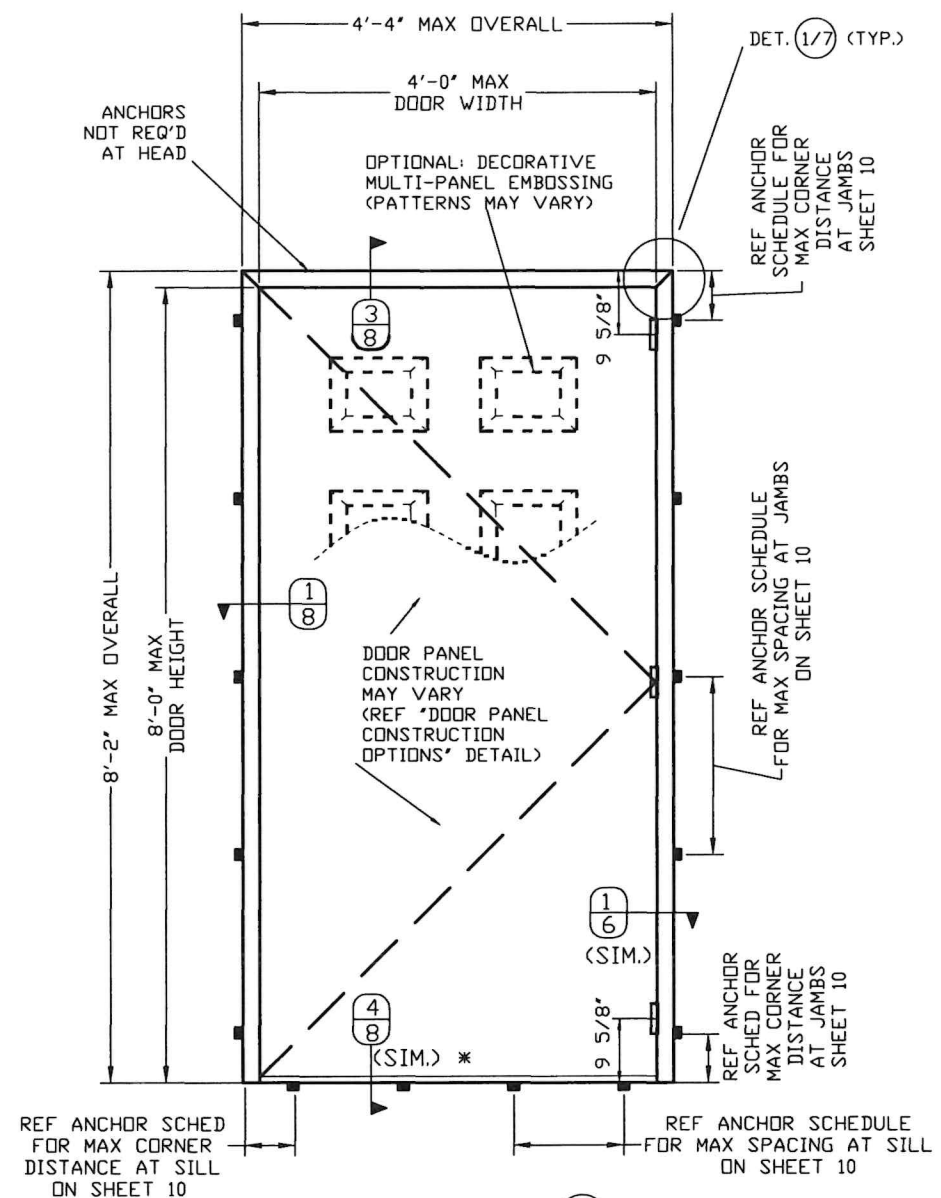

SINGLE DOOR EXTERIOR ELEVATION: SERIES 4080

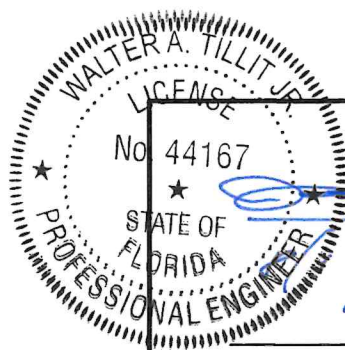

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES 8080 & 4080
OUTSWING COMMERCIAL GALVANNEAL OR
STAINLESS STEEL FRAME DOOR
FLUSH OR EMBOSSED

DAYBAR INDUSTRIES LTD
50 WEST DRIVE, BRAMPTON,
ON CANADA, L6T 2J4
TEL: 905 625-8000
FAX: 905 625-4204

DRAWN BY:
W.H.

08/06/2026
DATE

26-246
DRAWING No

SHEET 2 OF 10


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-179	08/06/2026	3		
2			4		

MAX. A.S.D. DESIGN PRESSURE RATING (psf.) SCHEDULE FOR INSTALLATIONS COVERING
SERIES 8080 & SERIES 4080 DOORS FOR A GIVEN ANCHOR JAMB TYPE *

ITEM (SEE SHEET 5)	ANCHOR SPECIFICATIONS AT JAMBS *	SERIES 8080 DOOR (SEE SHEET 2)	SERIES 4080 DOOR (SEE SHEET 2)
35	0.157" DIA.x9 1/2" LONG WIRE ANCHOR (SEE DETAIL 1/10)	+50, -50	+70, -70
36	2 PIECE COMBINATION STUD ANCHOR (SEE DETAIL 5/10 & 5A/10)	+50, -50	+70, -70
37	EXISTING MASONRY ANCHOR & E.M.A. (SEE DETAIL 2/10)	+50, -50	+70, -70
37	EXISTING WOOD BUCK ANCHOR W/WOOD SCREW LAG BOLT & E.M.A. (SEE DETAIL 3/10)	+50, -50	+70, -70
37	EXISTING WOOD BUCK ANCHOR W/ STEEL CARRIAGE BOLT & E.M.A. (SEE DETAIL 4/10)	+50, -50	+70, -70
37	CHANNEL IRON THROUGH BOLTING W/3/8" x 3 1/2" STEEL FLAT HEAD MACHINE SCREW & E.M.A. (SEE DETAIL 6/10)	+50, -50	+70, -70
-	CHANNEL IRON W/3/8" STITCH WELD (SEE DETAIL 7/10)	+50, -50	+70, -70

* NOTES ON FRAME HEAD REQUIREMENTS

1. FOR SINGLE & DOUBLE DOORS INSTALLED AT WOOD FRAME BUILDINGS, DOOR HEADS SHALL BE CONTINUOUSLY RETAINED BY EXISTING BUILDINGS WOOD HEADER FOLLOWING DETAILS AS PER SECTION E, SHEET 7.
2. FOR SINGLE & DOUBLE DOORS INSTALLED AT STEEL FRAME BUILDINGS, DOOR HEADS SHALL BE CONTINUOUSLY WELDED TO EXISTING BUILDINGS STEEL FRAME HEADER FOLLOWING DETAILS AS PER SECTION E, SHEET 7 & DETAIL 7 ON SHEET 10.
3. FOR SINGLE & DOUBLE DOORS INSTALLED AT CONCRETE /MASONRY BUILDINGS, DOOR HEADS NEED NOT BE ATTACHED TO EXISTING BUILDINGS HEADER. APPLICABLE TO SECTIONS 1/10 & 3/8.

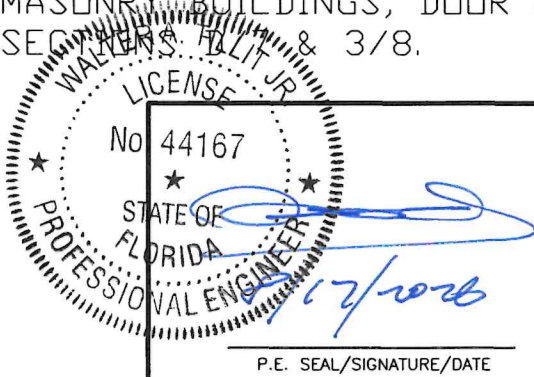

©2026 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES 8080 & 4080
OUTSWING COMMERCIAL GALVANNEAL OR
STAINLESS STEEL FRAME DOOR
FLUSH OR EMBOSSED

DAYBAR INDUSTRIES LTD
50 WEST DRIVE, BRAMPTON,
ON CANADA, L6T 2J4
TEL: 905 625-8000
FAX: 905 625-4204

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-179	08/06/2026	3		
2			4		

DRAWN BY:
W.H.

08/06/2026
DATE


26-246
DRAWING No

SHEET 3 OF 10

BILL OF MATERIALS:

ITEM	DESCRIPTION	MATERIAL	SIZE AND SPEC'S
1	PERIMETER FRAME (HEAD, SILL, JAMB)	16ga (0.051") GALVANNEAL STEEL; ASTM A653, TYPE B, WITH A40 PAINTABLE GALVANNEAL COATING	(Fy=45ksi, Fu=52ksi) OR AISI 304 SERIES STAINLESS STEEL (Fy=45ksi, Fu=101ksi).
2	DOOR PANEL ASSEMBLY (FLUSH OR EMBOSSED)	GALVANNEAL STEEL; ASTM A924, ASTM A653, TYPE B, WITH A40 PAINTABLE GALVANNEAL COATING	(Fy=45ksi, Fu=60ksi) OR AISI 304 SERIES STAINLESS STEEL (Fy=45ksi, Fu=101ksi).
4	THRESHOLD: HAGER 477S	EXTRUDED ALUMINUM 6063-T5 WITH VINYL BUMPER	
5	THRESHOLD: HAGER 520S	EXTRUDED ALUMINUM 6063-T5 WITH VINYL BUMPER	
6	DOOR TOP/BOTTOM CHANNEL: 1.6875' x 1.439'	16ga (0.051") GALVANNEAL STEEL (ASTM A653 WITH G60 COATING) OR STAINLESS STEEL (AISI 304 SERIES)	
7	DOOR SNAP-IN TOP/BOTTOM CAP: 1.5625' x 1.00'	20ga (0.032") GALVANNEAL STEEL (ASTM A653 WITH G60 COATING) OR STAINLESS STEEL (AISI 304 SERIES)	
8	CONTINUOUS HINGE: HAGER ROTON 780-224 HD	6063-T6 ALUMINUM	
9A	FULL MORTISE HINGE (STANDARD): HAGER #BB-1279	STEEL (PER MFR'S SPECS)	
9B	FULL MORTISE HINGE (STANDARD): HAGER #BB-1191	STAINLESS STEEL (PER MFR'S SPECS)	
10A	FULL MORTISE HINGE (HEAVY): HAGER #BB-1168	STEEL (PER MFR'S SPECS)	
10B	FULL MORTISE HINGE (HEAVY): HAGER #BB-1199	STAINLESS STEEL (PER MFR'S SPECS)	
11	RIM EXIT DEVICE: HAGER 4500 SERIES	STAINLESS STEEL (PER MFR'S SPECS)	
12	RIM STRIKE: HAGER 4920F	STAINLESS STEEL (PER MFR'S SPECS)	W/ TOP LATCH #492 & #4928 AT ENDS.
13	SVR EXIT DEVICE: HAGER 4500 SERIES	STAINLESS STEEL (PER MFR'S SPECS)	
14	SVR TOP STRIKE: HAGER 4923F	STAINLESS STEEL (PER MFR'S SPECS)	
15	CYLINDRICAL LOCK: HAGER 3400 OR 3500 SERIES	STAINLESS STEEL (PER MFR'S SPECS)	
16	DEAD BOLT: HAGER 3100 SERIES	STAINLESS STEEL (PER MFR'S SPECS)	
17	MORTISE LOCKSET W/ DEADBOLT: HAGER 3800 SERIES	STAINLESS STEEL (PER MFR'S SPECS)	
18	SURFACE BOLT: HAGER #275D (8' LONG)	STAINLESS STEEL (PER MFR'S SPECS)	
19	DOOR HINGE STILE REINFORCEMENT (REQUIRED FOR MORTISE HINGES ONLY)	8ga GALVANNEAL STEEL OR STAINLESS STEEL	
20	FRAME HINGE REINFORCEMENT (REQUIRED FOR MORTISE HINGES ONLY)	8ga GALVANNEAL STEEL OR STAINLESS STEEL	
21	ASTRAGAL STRIKE REINFORCEMENT	12ga GALVANNEAL STEEL OR STAINLESS STEEL	
22	FRAME STRIKE REINFORCEMENT	14ga (0.074") GALVANNEAL STEEL OR STAINLESS STEEL	
23	DOOR LOCK STILE REINF (MORTISE LOCK): 3.500' x 1.660'	14ga (0.074") GALVANNEAL STEEL OR STAINLESS STEEL	
24	CYLINDRICAL LOCK AND DEADBOLT REINFORCEMENT	STEEL, SATIN COATING	
25	DOOR SURFACE BOLT REINFORCEMENT: 1.688' x 3.5' x 9'	14ga (0.074") GALVANNEAL STEEL OR STAINLESS STEEL	
26	DOOR CLOSER REINFORCEMENT: 1.688' x 3.5' x 16.25'	14ga (0.074") GALVANNEAL STEEL OR STAINLESS STEEL	
27	BUTTERFLY ANCHOR CLIP: EMA #PT1-008	STEEL (PER MFR'S SPECS)	
29	CLIP-IN STUD ANCHOR	20ga (0.035") ASTM A653 A-60 GALVANNEALED STEEL	
30	ASTRAGAL WEATHERSTRIPPING: HAGER 872S	PER MFR'S SPECS (NEOPRENE INSERT)	
31	ASTRAGAL WEATHERSTRIPPING: HAGER 874S	PER MFR'S SPECS (NEOPRENE INSERT)	
32	PRESS-ON WEATHERSTRIPPING: HAGER 726S	SILICONE, SELF-ADHESIVE	
33	PERIMETER WEATHERSTRIPPING: HAGER 891S	PER MFR'S SPECS (VINYL BUMPER)	
34	DOOR SWEEP: HAGER 770S	PER MFR'S SPECS (VINYL BUMPER)	
35	WIRE MASONRY FRAME ANCHORS	STEEL W/ MIN. YIELD STRENGTH = 40.2Ksi AND MIN. TENSILE STRENGTH = 95.9 Ksi	9 1/2' LONG X 0.157' MIN. DIAMETER.
36	SNAPIN STUD ANCHORS (2 PIECE COMBINATION)	STEEL, ASTM A-653, A-60 GALVANNEAL	MUST COMPLY WITH SECTIONS 1711.1.2.2 & 1711.1.2.3 OF THE FLORIDA BUILDING CODE.
37	EMA BUTTERFLY ANCHOR (PART #PT1-008)	STEEL	18 GAUGE STEEL SATIN COAT.
38	8' LONG # 275 D HAGER SURFACE BOLT	STEEL W/ US26D FINISH	ENGAGED TO THE DOOR AT TOP AND BOTTOM TO HEADER & THRESHOLD RESPECTIVELY & FASTENED TO DOOR W/ (4) #10-24 x 1 1/2' THRU BOLT EACH CONNECTION.
39	VON DUPRIN #9954 REMOVABLE MULLION	0.125' THICK A 500 GRADE B STEEL	SECURED TO 499 STRIKE PLATE WITH (8) 5/16"-18x1"(MIN.) MACHINE SCREWS.
40	CAULKING GE SILICONE II	SILICONE	AS SHOWN ON DETAIL.
41	SURFACE STRIKE REINFORCEMENT	12 GAGE GALVANNEAL OR STAINLESS STEEL	12 GAGE (0.097" MIN.) x 154' x 11.875' LONG (SEE SHEET 9).
42	MULLION FITTING #8620	STEEL	USE AT (39)

* AISI 304 SERIES STAINLESS STEEL WITH Fy =45.75 Ksi
AND Fu= 101.38 Ksi

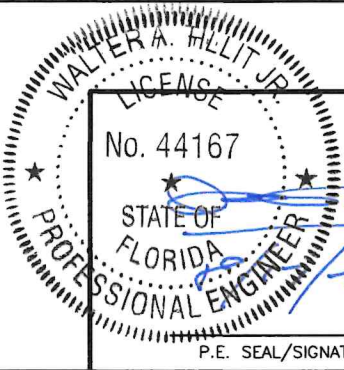


FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.


TILTECO inc.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167


DOUBLE & SINGLE SERIES 8080 & 4080 OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR FLUSH OR EMBOSSED		DRAWN BY: W.H.
DAYBAR INDUSTRIES LTD 50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4 TEL: 905 625-8000 FAX: 905 625-4204		08/06/2026 DATE
REV. No		26-246 DRAWING No
1	DESCRIPTION OLD 23-179	DATE 08/06/2026
2	DESCRIPTION	DATE
		SHEET 4 OF 10

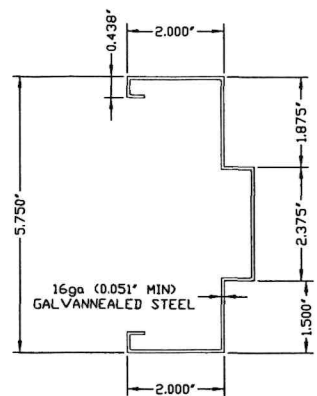


① PERIMETER FRAME




④ THRESHOLD (520S)




⑤ THRESHOLD (477S)




⑥ DOOR TOP/BOTTOM CHANNEL




③⑩ ASTRAGAL SEAL (872S)




③② PRESS-ON SEAL




③④ DOOR SWEEP




②⑤ SURFACE BOLT REINFORCEMENT

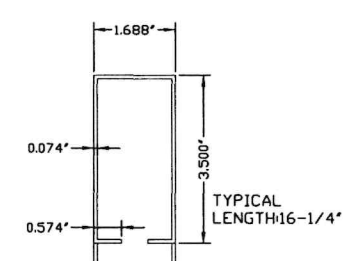


②⑥ DOOR CLOSER REINFORCEMENT

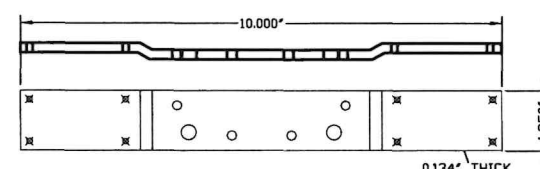


①⑨ DOOR STILE HINGE REINF

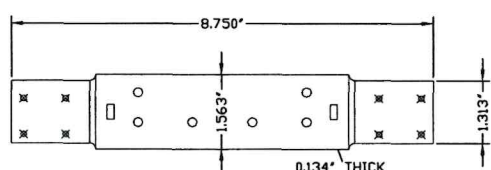


②⑩ FRAME HINGE REINF




③① ASTRAGAL SEAL (874S)




③③ PERIMETER BUMPER

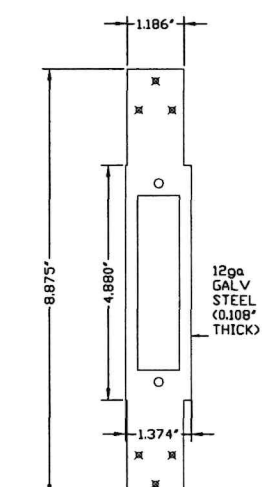


②① ASTRAGAL STRIKE REINF

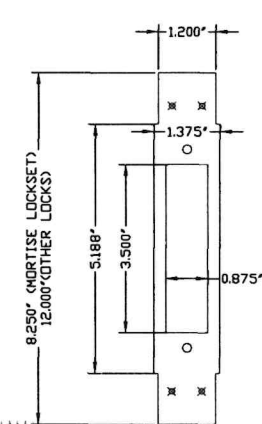


②② FRAME STRIKE REINF

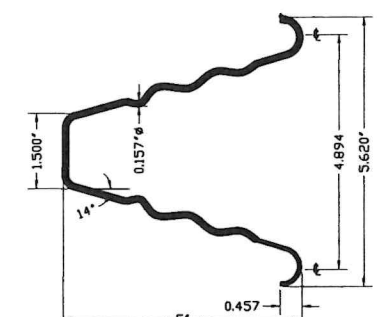


③⑤ WIRE ANCHOR FOR DETAIL #21/17
STEEL WIRE ANCHORS
(0.157\"/>

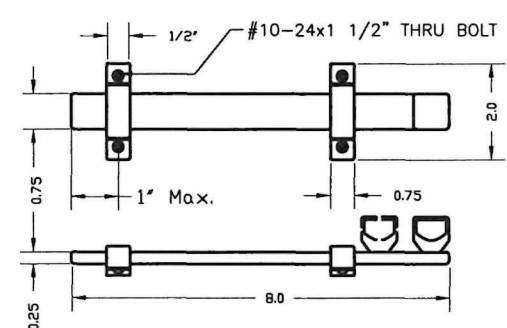


③⑧ SURFACE BOLT

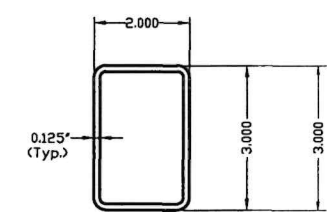

③⑨ REMOVABLE MULLION

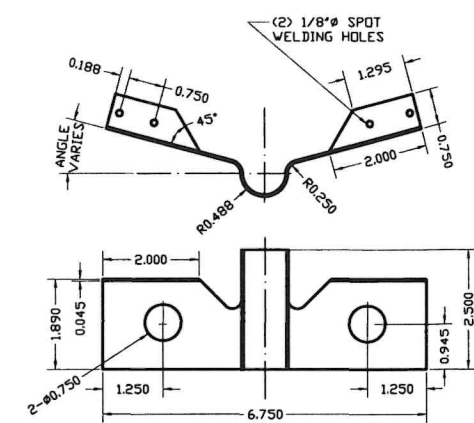

③⑦ EMA BUTTERFLY ANCHOR (PART #PT1-008)
FOR DETAILS 2/10, 3/10 4/10 & 6/10
MATERIAL: 18 GA SATIN COAT



③⑥ 2 PIECE COMBINATION STUD ANCHOR FOR DETAILS #5, 5A/10
CLIPIN STUD ANCHOR MATERIAL: GAUGE 20 (0.035) ASTM A-653, A-60 GALVANNEALED STEEL (SEE B.O.M. ON SHEET 4)


COMPONENTS

WALTER A. TILLIT
LICENSED PROFESSIONAL ENGINEER
No. 44167
STATE OF FLORIDA
P.E. SEAL/SIGNATURE/DATE


FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.
TILTECO inc.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167


DOUBLE & SINGLE SERIES 8080 & 4080 OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR FLUSH OR EMBOSSED			DRAWN BY: W.H.	
DAYBAR INDUSTRIES LTD 50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4 TEL: 905 625-8000 FAX: 905 625-4204			08/06/2026 DATE	
			26-246 DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION
1	OLD 23-179	08/06/2026	3	
2			4	
			SHEET 5 OF 10	

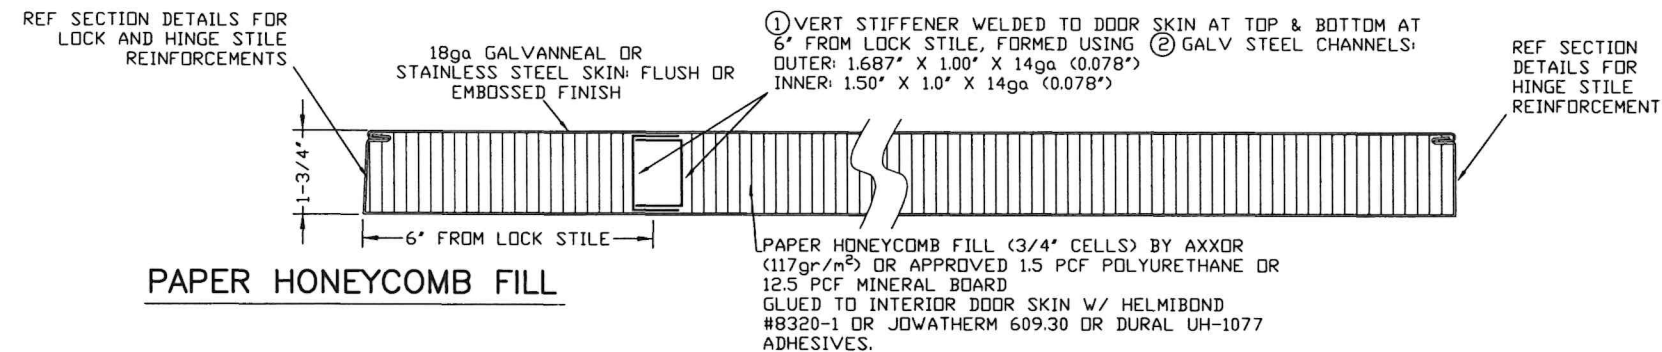

PAPER HONEYCOMB FILL

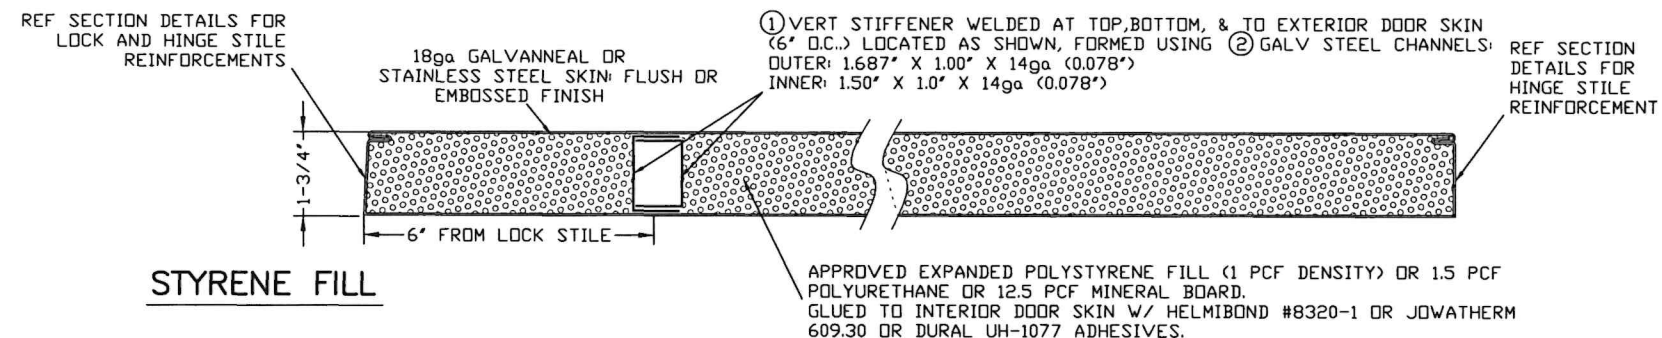


STYRENE FILL

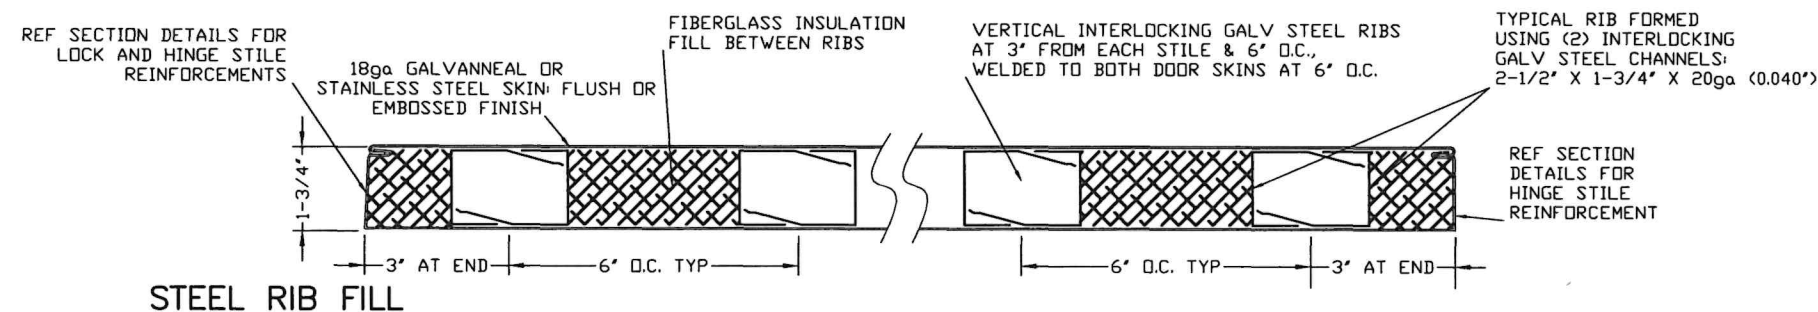


STEEL RIB FILL

DOOR PANEL CONSTRUCTION OPTIONS (HORIZONTAL SECTIONS)

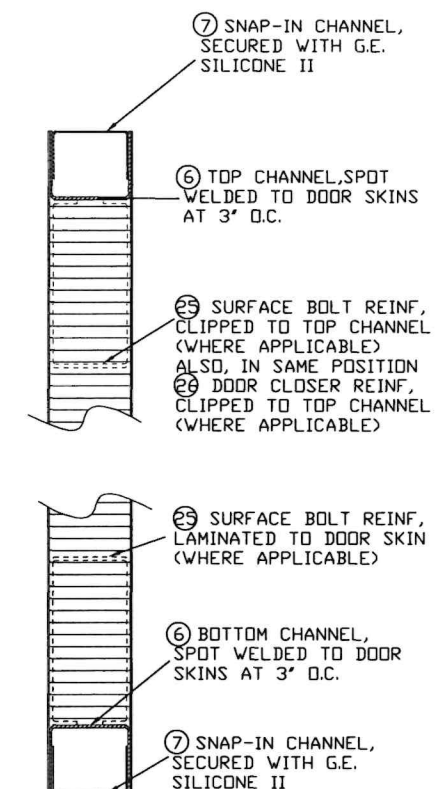


TYPICAL DOOR TOP & BOTTOM

CONSTRUCTION (VERTICAL SECTION)

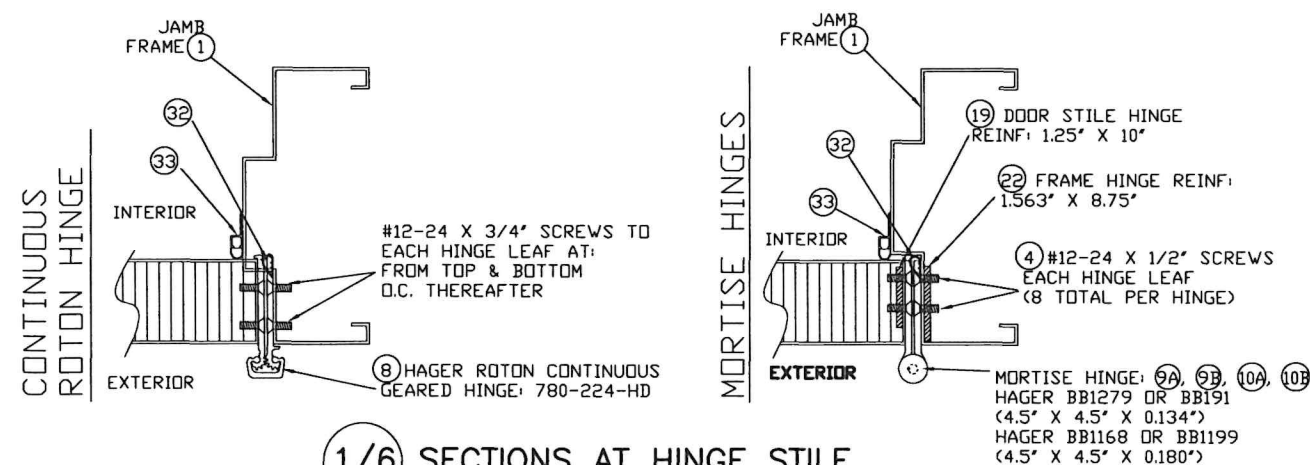

1/6 SECTIONS AT HINGE STILE

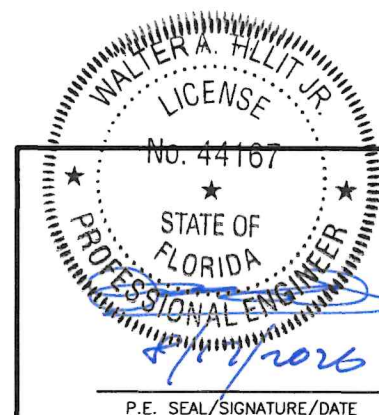

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.

TILTECO Inc.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305)871-1530 Fax: (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES 8080 & 4080
OUTSWING COMMERCIAL GALVANNEAL OR
STAINLESS STEEL FRAME DOOR
FLUSH OR EMBOSSED

DAYBAR INDUSTRIES LTD

50 WEST DRIVE, BRAMPTON,
ON CANADA, L6T 2J4
TEL: 905 625-8000
FAX: 905 625-4204


DRAWN BY:
W.H.

08/06/2026
DATE

26-246
DRAWING No




SHEET 6 OF 10

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 25-179	08/06/2026	3		
2			4		

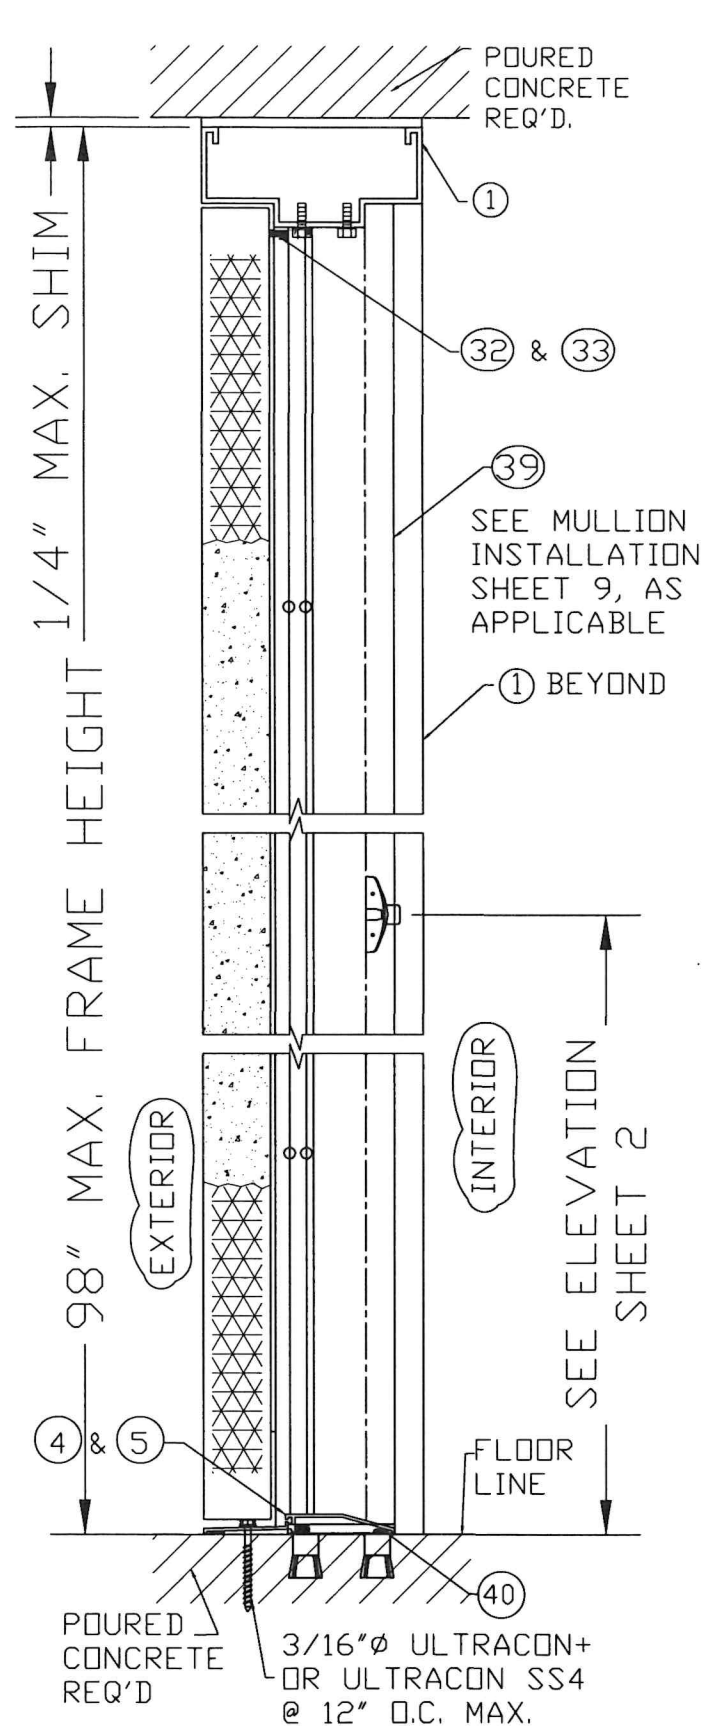


SECTION D-D

SINGLE DOOR DOES NOT NEED MULLION.
LATCH ONTO REINFORCED JAMB

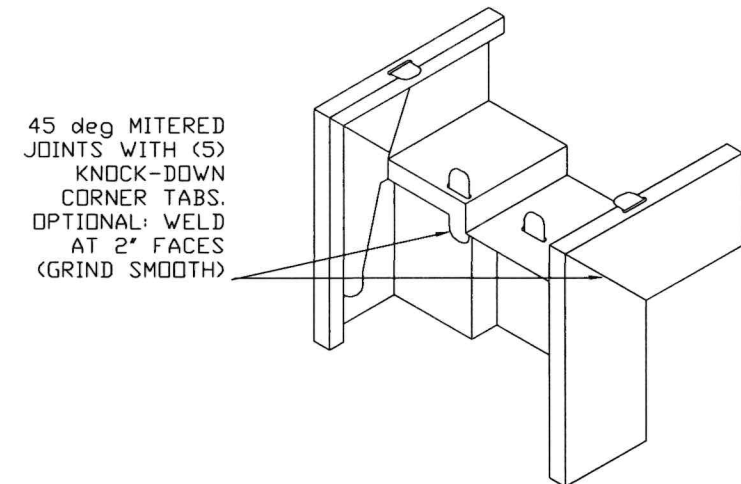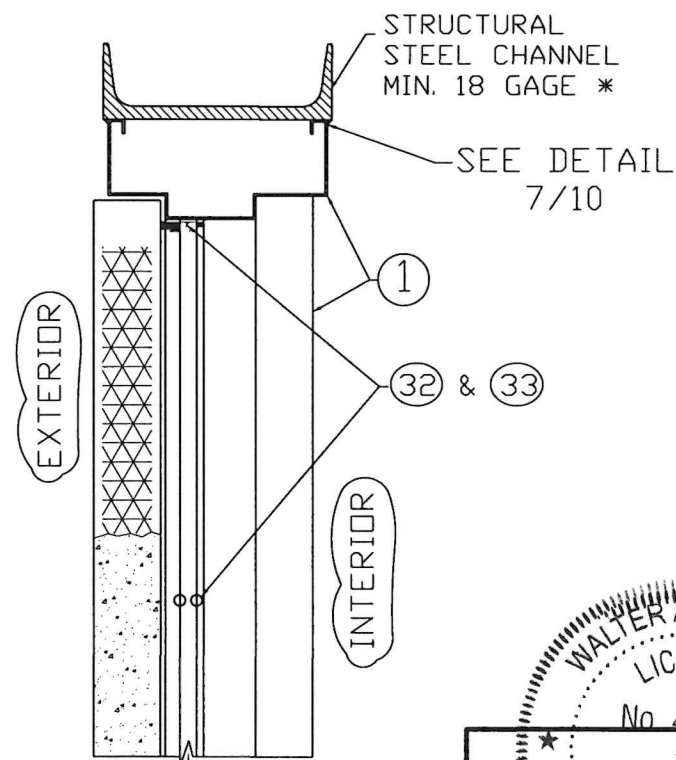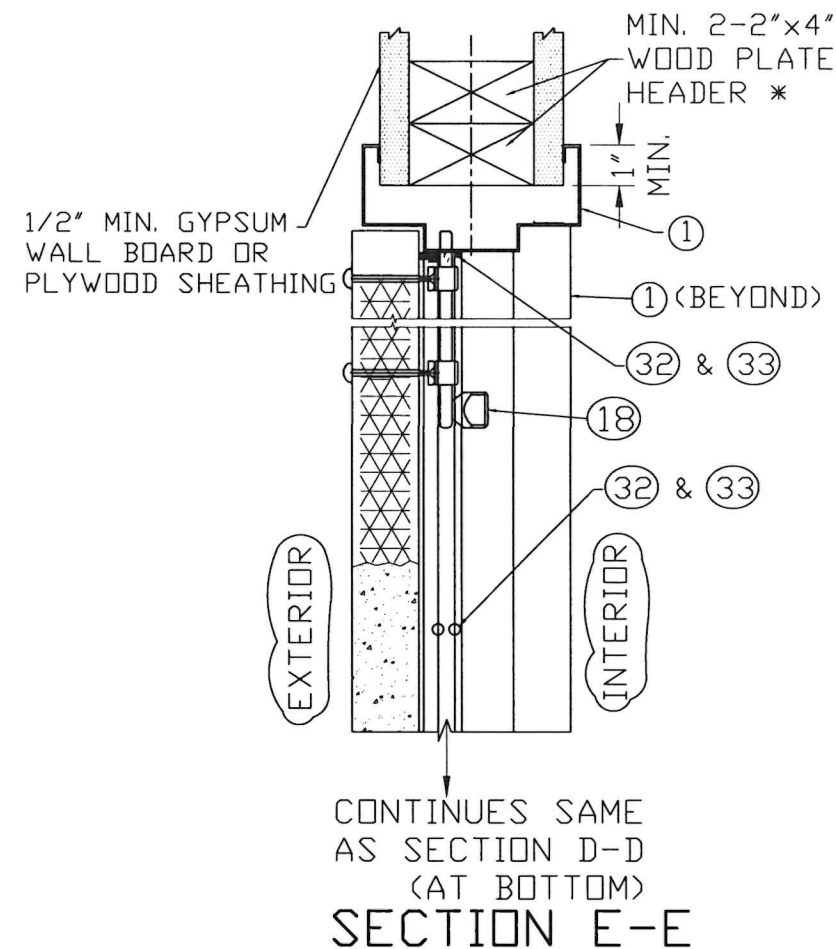

1/7 FRAME CORNER: TABBED KNOCKDOWN ASSEMBLY

* STRUCTURAL MEMBER AT HEADER MUST BE DESIGNED TO CARRY 174 #/FT & BE REVIEWED BY BUILDING OFFICIAL

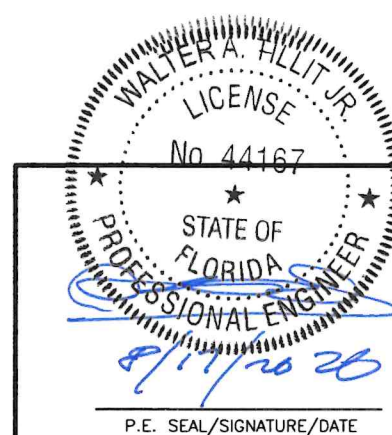

©2026 TILTECO, INC.

TILTECO Inc.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 • Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES 8080 & 4080
OUTSWING COMMERCIAL GALVANNEAL OR
STAINLESS STEEL FRAME DOOR
FLUSH OR EMBOSSED

DAYBAR INDUSTRIES LTD

50 WEST DRIVE, BRAMPTON,
ON CANADA, L6T 2J4
TEL: 905 625-8000
FAX: 905 625-4204

DRAWN BY:
W.H.


08/06/2026
DATE

26-246
DRAWING No


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-179	08/06/2026	3		
2			4		

SHEET 7 OF 10


RIM EXIT DEVICE SINGLE POINT LATCH

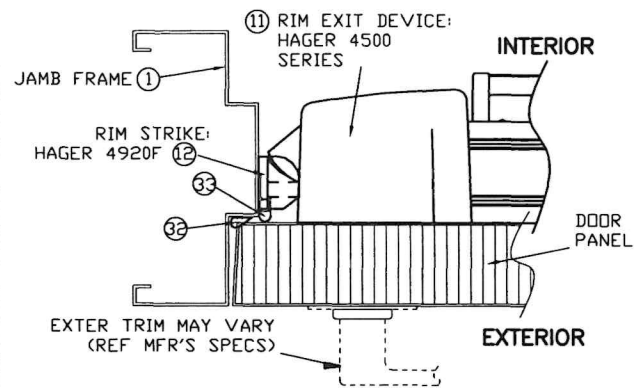


SVR EXIT DEVICE

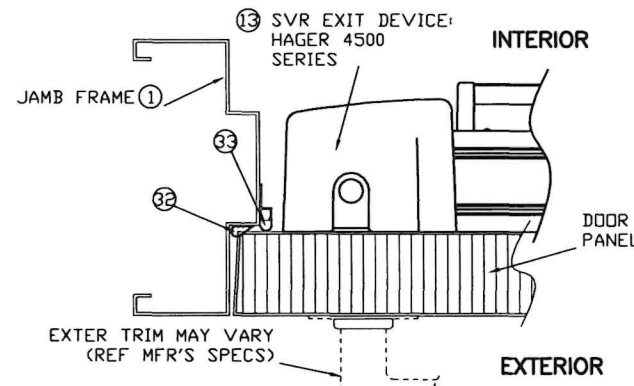

MORTISE LOCK

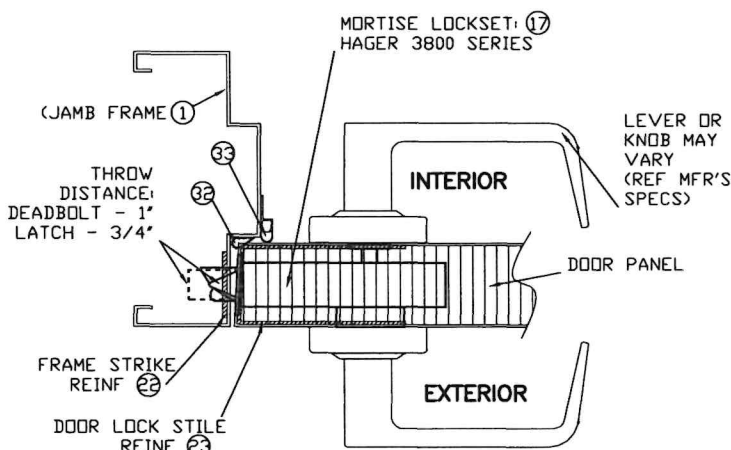


CYLINDRICAL LOCK

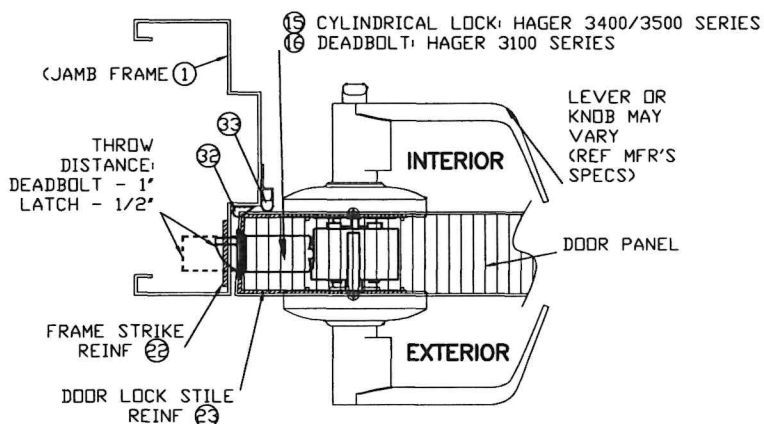


1 SECTION AT LOCK STILE (SINGLE DOOR)
SCALE: 3" = 1'-0" HORIZONTAL SECTION


RIM EXIT DEVICE SINGLE POINT LATCH

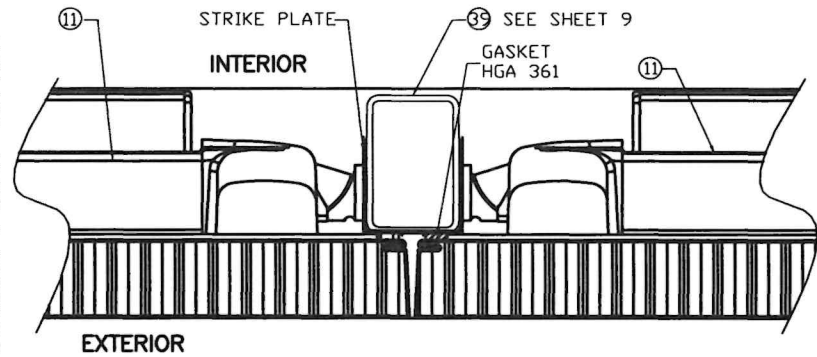


SVR EXIT DEVICE

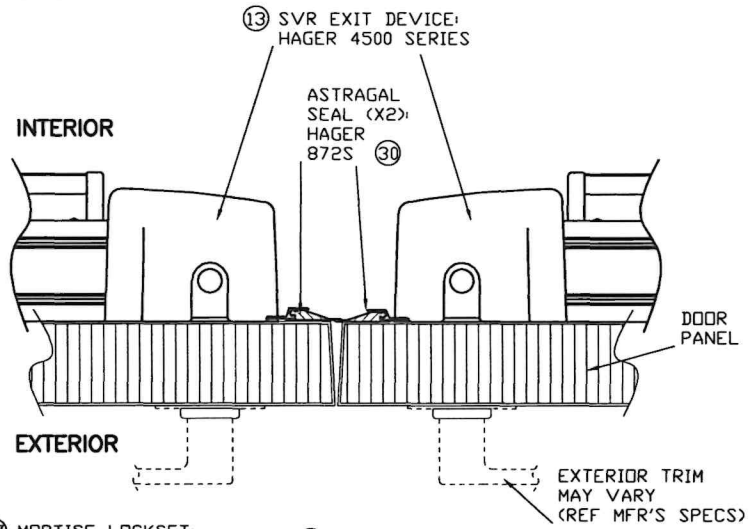


MORTISE LOCK

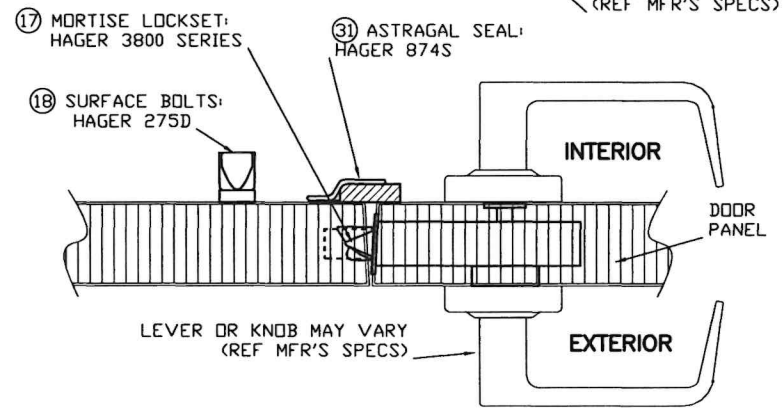


CYLINDRICAL LOCK

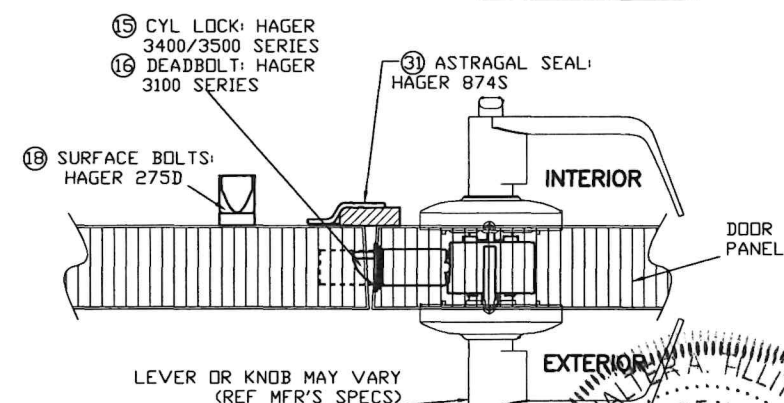

2 SECTION AT LOCK STILE (DOUBLE DOOR)
SCALE: 3" = 1'-0" HORIZONTAL SECTION

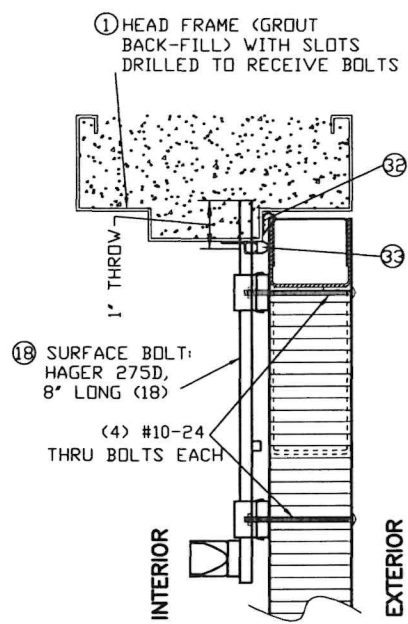


SURFACE BOLTS

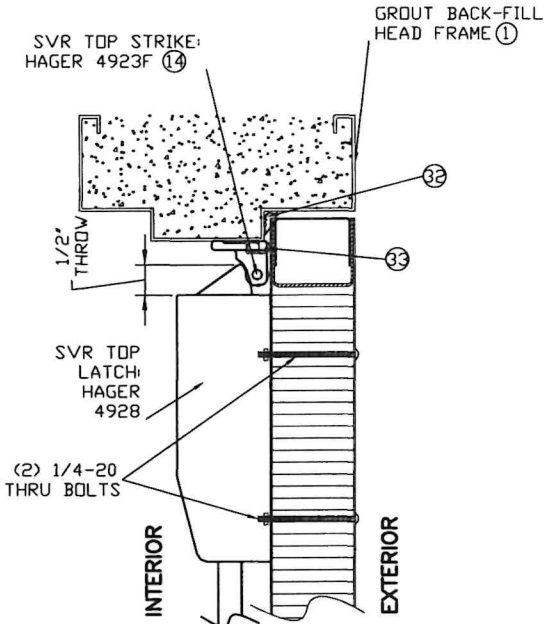


SVR EXIT DEVICE

3 VERTICAL SECTION AT DOOR HEAD

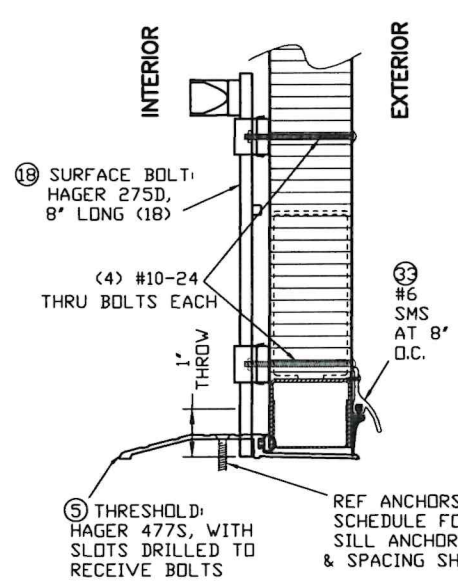

SURFACE BOLTS

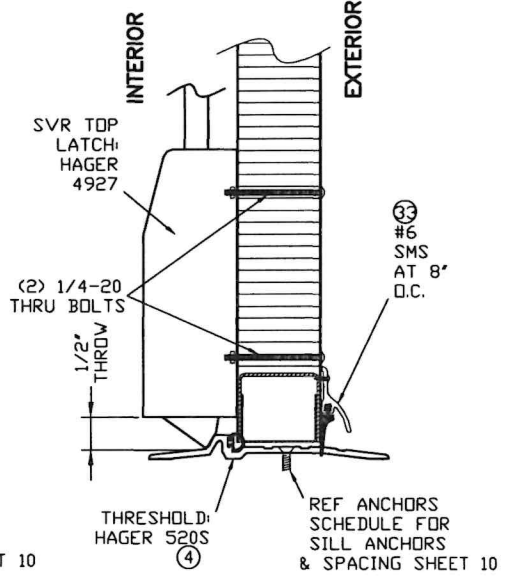









SVR EXIT DEVICE

4 VERTICAL SECTION AT DOOR SILL


FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

		©2026 TILTECO, INC. TILTECO inc. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305) 871-1530 Fax: (305) 871-1531 e-mail: tilteco@aol.com CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167		DOUBLE & SINGLE SERIES 8080 & 4080 OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR FLUSH OR EMBOSSED	DRAWN BY: W.H. 08/06/2026 DATE
		DAYBAR INDUSTRIES LTD 50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4 TEL: 905 625-8000 FAX: 905 625-4204		26-246 DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-179	08/06/2026	3		
2			4		

SHEET 8 OF 10

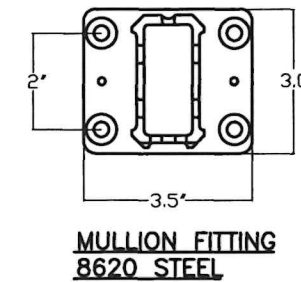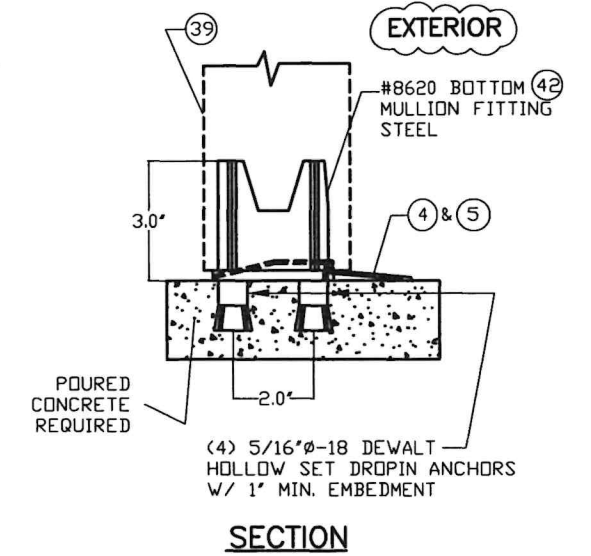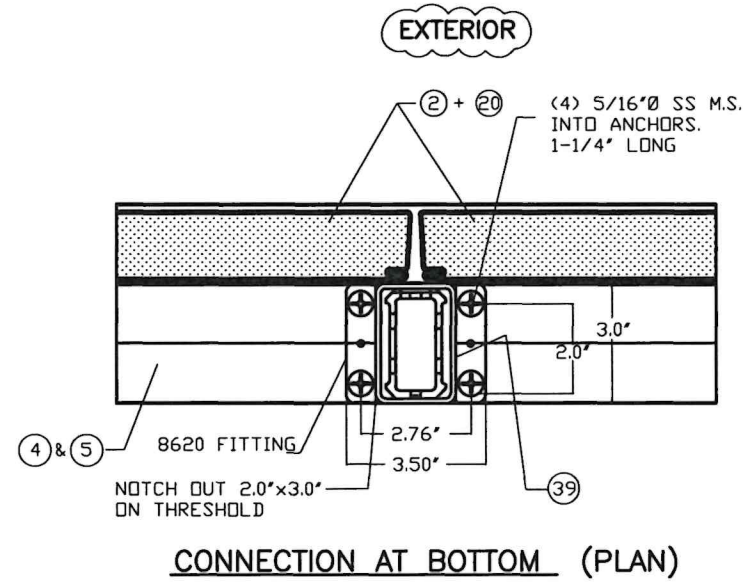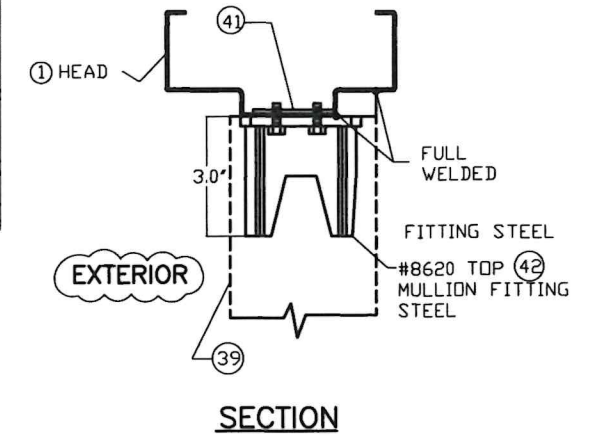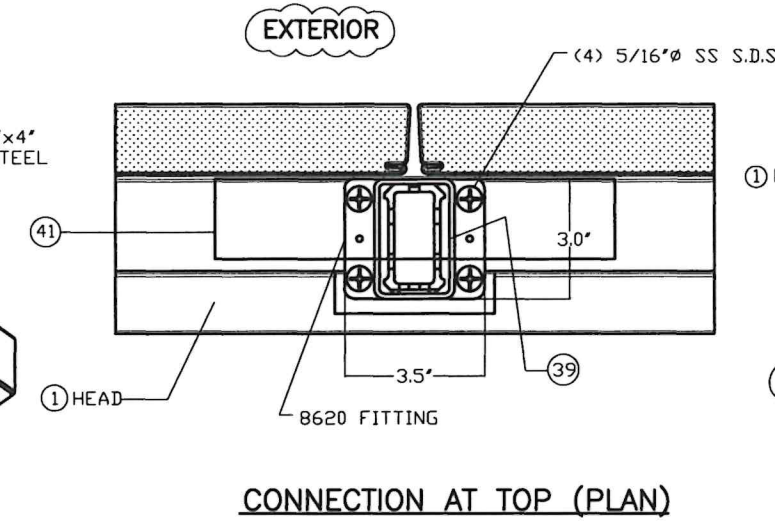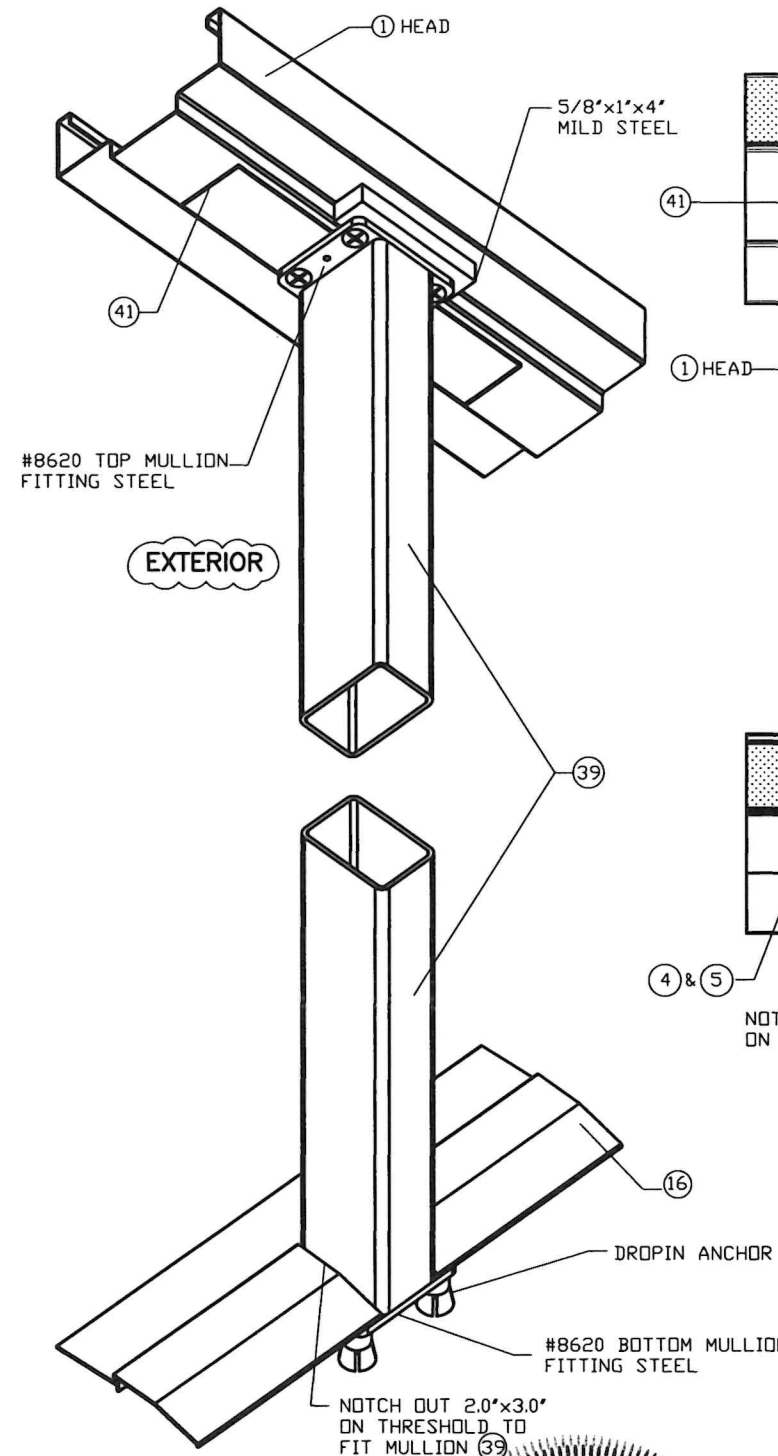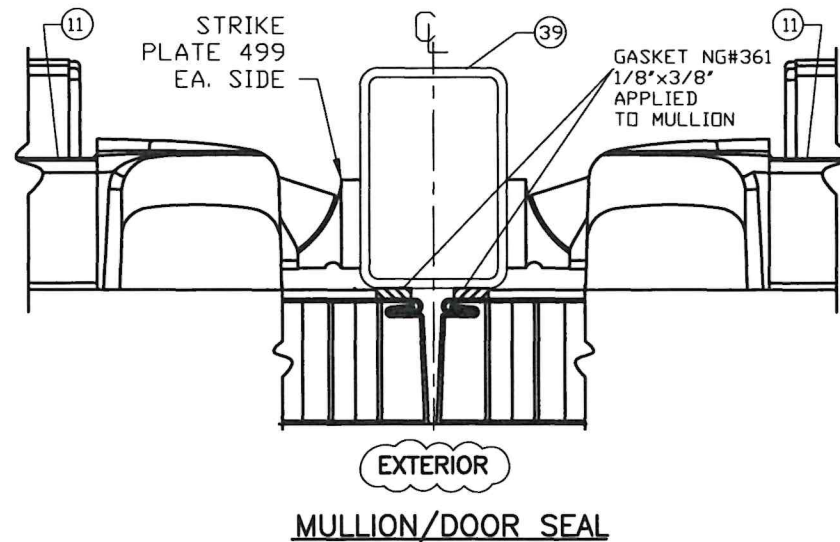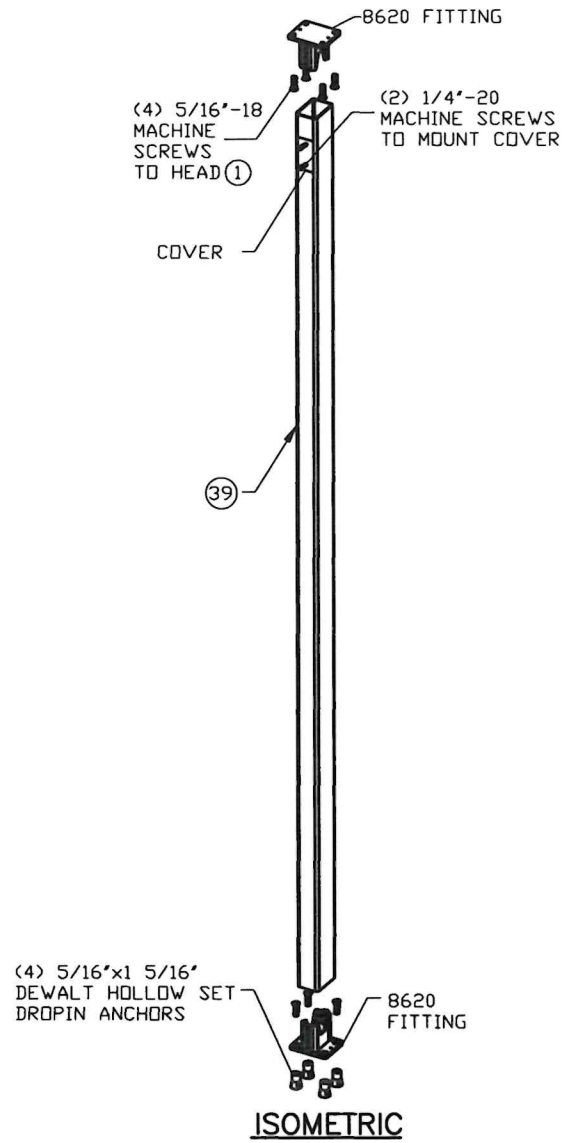

39 VON DUPRIN SERIES 9954 (W/ 499 STRIKE PLATE) MULLION INSTALLATION

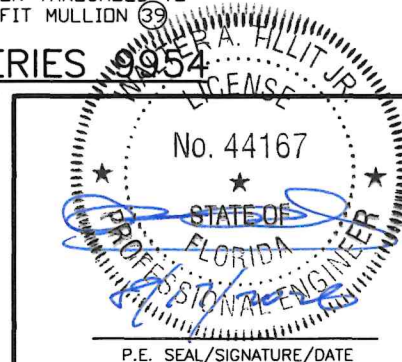


FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.


TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167


DOUBLE & SINGLE SERIES 8080 & 4080 OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR FLUSH OR EMBOSSED			DRAWN BY: W.H.		
DAYBAR INDUSTRIES LTD			08/06/2026 DATE		
50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4			26-246 DRAWING No		
TEL: 905 625-8000			SHEET 9 OF 10		
FAX: 905 625-4204					
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-179	08/06/2026	3		
2			4		

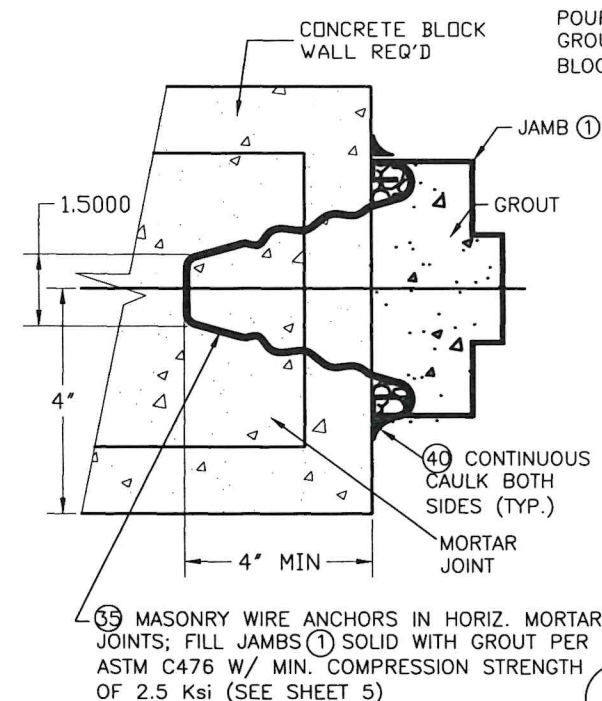


1 WIRE ANCHOR 35 INSTALLATION TO MASONRY WALLS

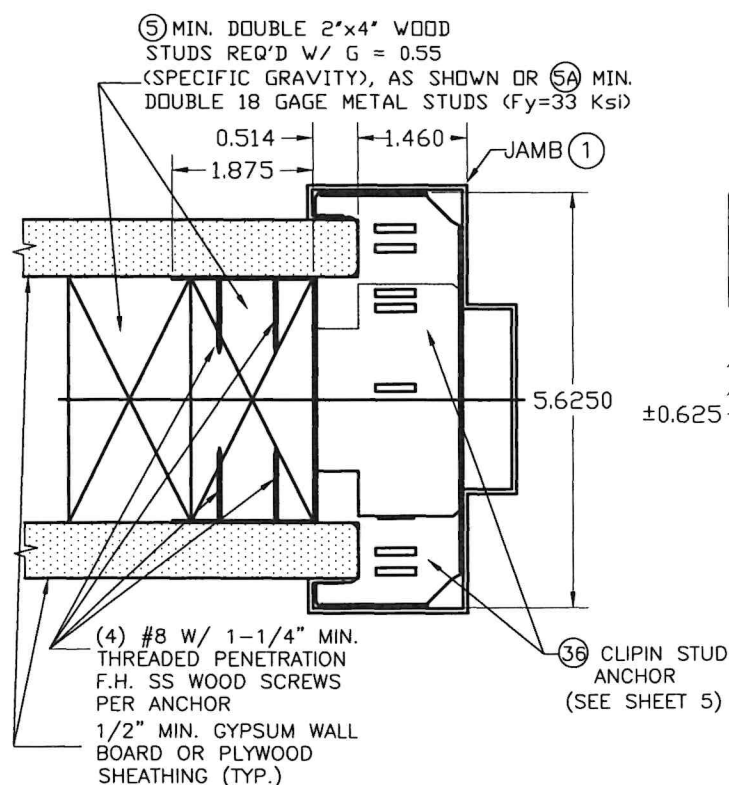


5 & 5A INSTALLATION OF 2 PIECE SNAPIN COMBINATION STUD ANCHOR 36 INTO WOOD FRAME OR METAL STUD WALLS

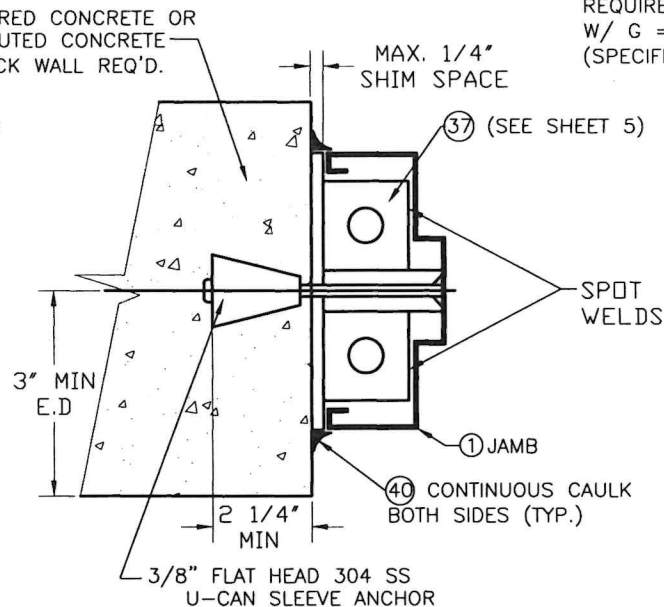

2 INSTALLATION OF SLEEVE ANCHOR TO MASONRY WALLS

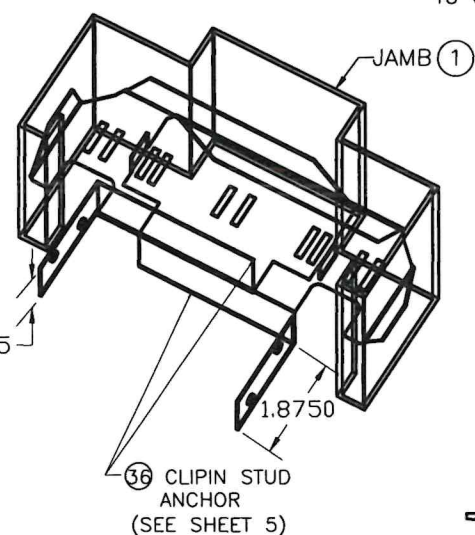

3 INSTALLATION OF 3/8 inch LAG SCREW 9 TO WOOD FRAME WALLS

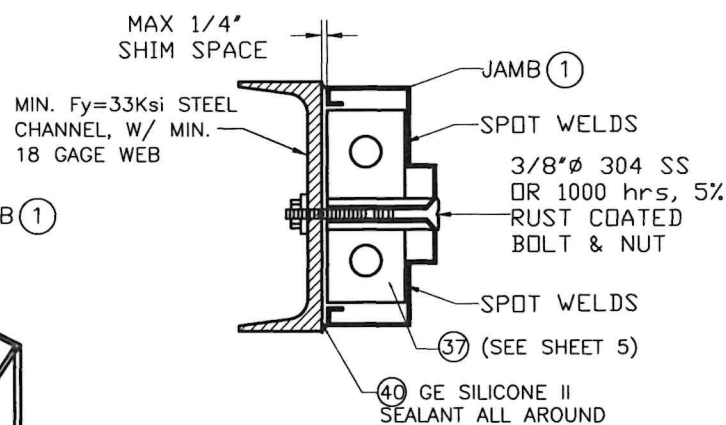

4 INSTALLATION OF 3/8 inch CARRIAGE BOLT 9A TO WOOD FRAME WALLS


ANCHOR SCHEDULE

DETAIL	ANCHOR	SUBSTRATE	SINGLE DOORS				DOUBLE DOORS			
			SILL		JAMBS		SILL		JAMBS	
			CORNERS	SPACING	CORNERS	SPACING	CORNERS	SPACING	CORNERS	SPACING
2/10	3/8" U-CAN SLEEVE ANCHORS	CONCRETE OR G.F. MASONRY	6"	12" OC	6"	21" OC	6"	12" OC	6"	21" OC
6/10	3/8" BOLT & NUT	STEEL	6"	12" OC	6"	21" OC	6"	12" OC	6"	21" OC
3/10	3/8" LAG SCREWS	WOOD	6"	12" OC	6"	16" OC	6"	12" OC	6"	12" OC
5/10	CLIP-IN STUD ANCHORS	WOOD STUDS	N / A		9"	17" OC	N / A		9"	17" OC
5A/10	CLIP-IN STUD ANCHORS	METAL STUDS	N / A		9"	17" OC	N / A		9"	17" OC
1/10	MASONRY WIRE	MASONRY	N / A		16"	16" OC	N / A		16"	16" OC
7/10	DIRECT WELD	STEEL	N / A		6"	21" OC	N / A		6"	21" OC
D-D/7	3/16" DEVALT ULTRACONS	CONCRETE OR WOOD	5"	12" OC	N / A	N / A	5"	12" OC	N / A	N / A

ANCHOR NOTES:

- SEE EXTERIOR ELEVATION & ANCHOR SCHEDULE FOR ANCHOR LOCATIONS AND/OR SPACING.
- NO ANCHORS REQUIRED AT FRAME HEAD.
- ANCHOR SCHEDULE GIVES MAXIMUM CORNER DISTANCE AND SPACING.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- 3/8" SLEEVE ANCHOR OPTIONS FOR INSTALLATION TO CONCRETE OR GROUT-FILLED BLOCK:
3/8" RED HEAD DYNABOLT SLEEVE ANCHOR WITH 1-1/2" MIN EMBED, 2-1/4" MIN EDGE DISTANCE.
3/8" HILTI HLC SLEEVE ANCHOR WITH 1-1/4" MIN EMBED, 4" MIN EDGE DISTANCE
5. 3/8" LAG SCREWS SHALL HAVE 2" MIN EMBED & 1-1/2" MIN EDGE DISTANCE.
3/16" TAPCONS W/ 1 1/2" MIN. EMBEDMENT & 2 1/2" MIN. EDGE DISTANCE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
- CONCRETE HOST STRUCTURE SHALL HAVE 3,000 PSI MIN COMPRESSIVE STRENGTH. GROUT-FILLED MASONRY SHALL BE ASTM C90 BLOCK WITH MIN 2,000 PSI GROUT.
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD (U.N.O.).
- "STEEL" SUBSTRATE SHALL HAVE 18ga (0.048") MIN THICKNESS.
- MACHINE SCREWS USED WITH SLEEVE ANCHORS SHALL HAVE MINIMUM OF 1/2" ENGAGEMENT OF THREADS IN BASE ANCHOR.
- MASONRY WIRE ANCHORS ARE ONLY APPLICABLE AT JAMBS.

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

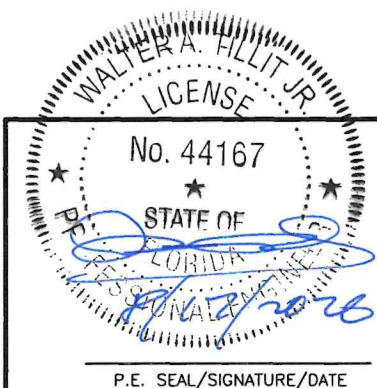

©2026 TILTECO, INC.

TILTECO inc.

TILLIT TESTING & ENGINEERING COMPANY
6355N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES 8080 & 4080 OUTSWING COMMERCIAL GALVANNEAL OR STAINLESS STEEL FRAME DOOR FLUSH OR EMBOSSED			DRAWN BY: W.H.	
DAYBAR INDUSTRIES LTD 50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4 TEL: 905 625-8000 FAX: 905 625-4204			08/06/2026 DATE	
REV. No DESCRIPTION DATE REV. No DESCRIPTION DATE			26-246 DRAWING No	
1	OLD 23-179	08/06/2026	3	
2			4	
			SHEET 10 OF 10	

7 INSTALLATION OF JAMB 1 TO STEEL CHANNEL THRU WELDING ANCHOR DETAILS: