

CONTINENTAL GLASS SYSTEMS, LLC.

SERIES 3020 WINDOW WALL (LMI & SMI)

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHORS ON HEAD, SILL, AND JAMB FOR EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **THROUGH FRAME:** FOR INSTALLATION INTO WOOD FRAMING USE 5/16 INCH DIAMETER ELCO ULTRACON SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT.
6. **THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY OR DIRECTLY INTO CONCRETE/MASONRY USE 5/16 INCH DIAMETER ELCO ULTRACON SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO CONCRETE/MASONRY.
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
9. FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
10. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
11. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - C. GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN TESTED AND EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - AAMA 501-15
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: 6063-T6 ALUMINUM
7. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 8 FOR GLAZING DETAILS.
8. DESIGNATION "O" STANDS FOR THE FOLLOWING:
 - O: FIXED PANEL
 - O/O: FIXED PANEL OVER FIXED PANEL
 - O-O: FIXED PANEL NEXT TO FIXED PANEL
9. CONFIGURATIONS SHOWN ON DRAWING ARE TYPICAL. ALTERNATE CONFIGURATIONS MAY BE QUALIFIED ON A SITE SPECIFIC BASIS

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION & GENERAL NOTES
2	-	ELEVATIONS
3	-	ELEVATIONS
4	-	VERTICAL SECTIONS
5	-	HORIZONTAL SECTIONS
6	-	ANCHOR LOCATIONS
7	-	BOM & COMPONENTS
8	-	GLAZING DETAILS
9	-	REINFORCING DETAILS AND ASSEMBLY NOTES

CONFIGURATION	MAX OVERALL SIZE		DESIGN PRESSURE	REINFORCING	GLAZING OPTIONS	DLO	MISSILE IMPACT RATING
	WIDTH	HEIGHT					
O/O	120"	103.5"	+/- 90 PSF	STEEL	GL-1, GL-1A, GL-1B, GL-3 & GL-3A	115" X 48"	LARGE MISSILE
O-O/O-O	154"	120"			GL-1, GL-1A, GL-1B, GL-3 GL-3A & GL-5	48" X 115"	LARGE MISSILE
O-O/O-O	154"	120"			GL-2, GL-2A, GL-2B & GL-4A	48" X 115"	SMALL MISSILE
O-O-O	154"	120"			GL-1, GL-1A, GL-1B, GL-3 GL-3A & GL-5	48" X 115"	LARGE MISSILE
O-O-O	154"	120"			GL-2, GL-2A, GL-2B, GL-4 & GL-4A	48" X 115"	SMALL MISSILE
O-O-O	154"	96"	+/- 60 PSF	-	GL-1, GL-1A, GL-1B, GL-3 GL-3A & GL-5	48" X 91"	LARGE MISSILE
O/O	96"	103.5"			GL-1, GL-1A, GL-1B, GL-3 GL-3A & GL-5	91" X 48"	LARGE MISSILE
O-O-O	154"	96"			GL-2, GL-2A, GL-2B, GL-4, GL-4A	48" X 91"	SMALL MISSILE
O/O	96"	103.5"			GL-2, GL-2A, GL-2B, GL-4, GL-4A	91" X 48"	SMALL MISSILE

Manufacturer:


CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, FL 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

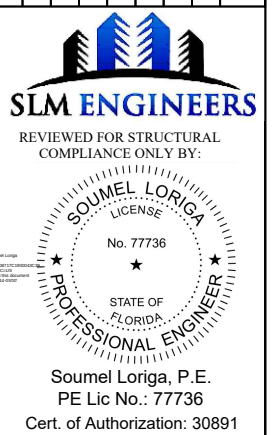[illegible]

FLORIDA NUMBER:

FL# 23314

SERIES:

3020 SERIES
L.M.I. & S.M.I.

Description:

W.W. SYSTEM




Drawn Date 10-10-2020	Scale AS NOTED
--------------------------	-------------------

Project No.	
FLORIDA APPROVAL 2020	

Drawing Title
**INSTALLATIONS &
 GENERAL NOTES**

Sheet No.


SHEET: 1 OF: 9

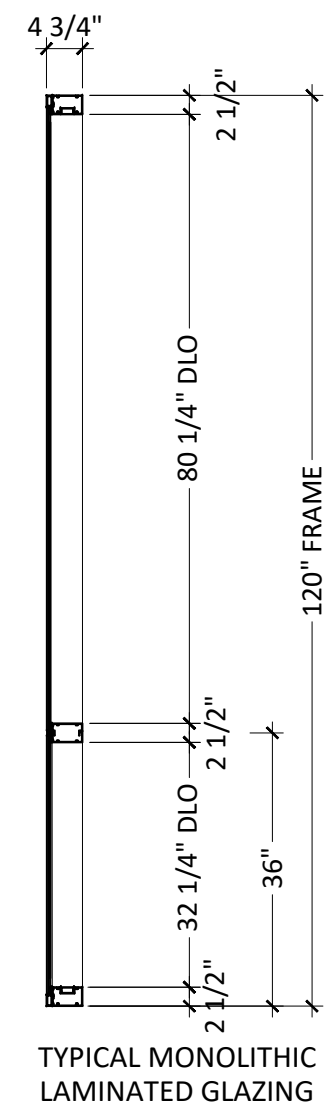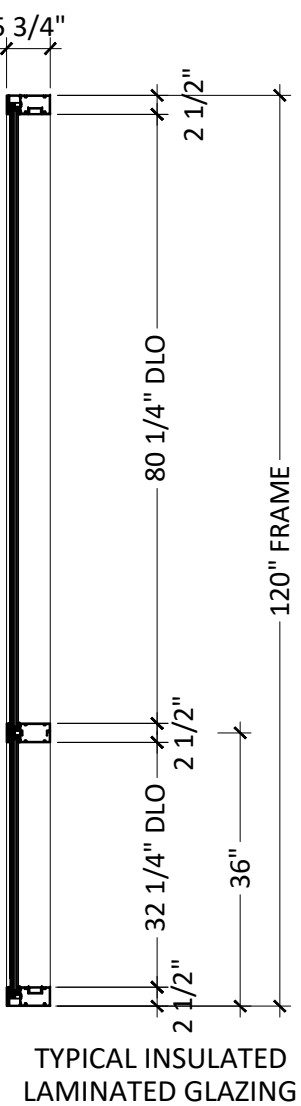

NOTE, O-O/O-O CONFIGURATION SHOWN IS TYPICAL OF O, O-O, AND O-O-O CONFIGURATIONS. ALTERNATE CONFIGURATIONS ARE POSSIBLE AND SHALL BE QUALIFIED ON A SITE SPECIFIC BASIS.

[illegible]

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:



Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 23314

SERIES:

3020 SERIES
L.M.I. & S.M.I.

Description:

W.W. SYSTEM


Drawn Date 10-10-2020	Scale AS NOTED
--------------------------	-------------------

Project No.	
FLORIDA APPROVAL 2020	


Drawing Title
ELEVATIONS

Sheet No.

SHEET: 2 OF: 9




Manufacturer:									
CGS									
CONTINENTAL GLASS SYSTEMS LLC.									
325 West 74 Place Hialeah, FL 33014									
Phone 305.231.1101									
Toll Free 1.877.221.1101									
								FBC 2020 CODE CHANGE	
									Submittal/Revision Description
								Drawn By	
								10/10/20	Date
							A		Rev. No.
									Sub. No.
 SLM ENGINEERS REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:  Soumel Loriga, P.E. PE Lic No.: 77736 Cert. of Authorization: 30891 FLORIDA NUMBER:									
FL# 23314									
SERIES:									
3020 SERIES L.M.I. & S.M.I.									
Description:									
W.W. SYSTEM									
Drawn Date 10-10-2020					Scale AS NOTED				
Project No.									
FLORIDA APPROVAL 2020									
Drawing Title									
ELEVATIONS									
Sheet No.									
SHEET: 3 OF: 9									

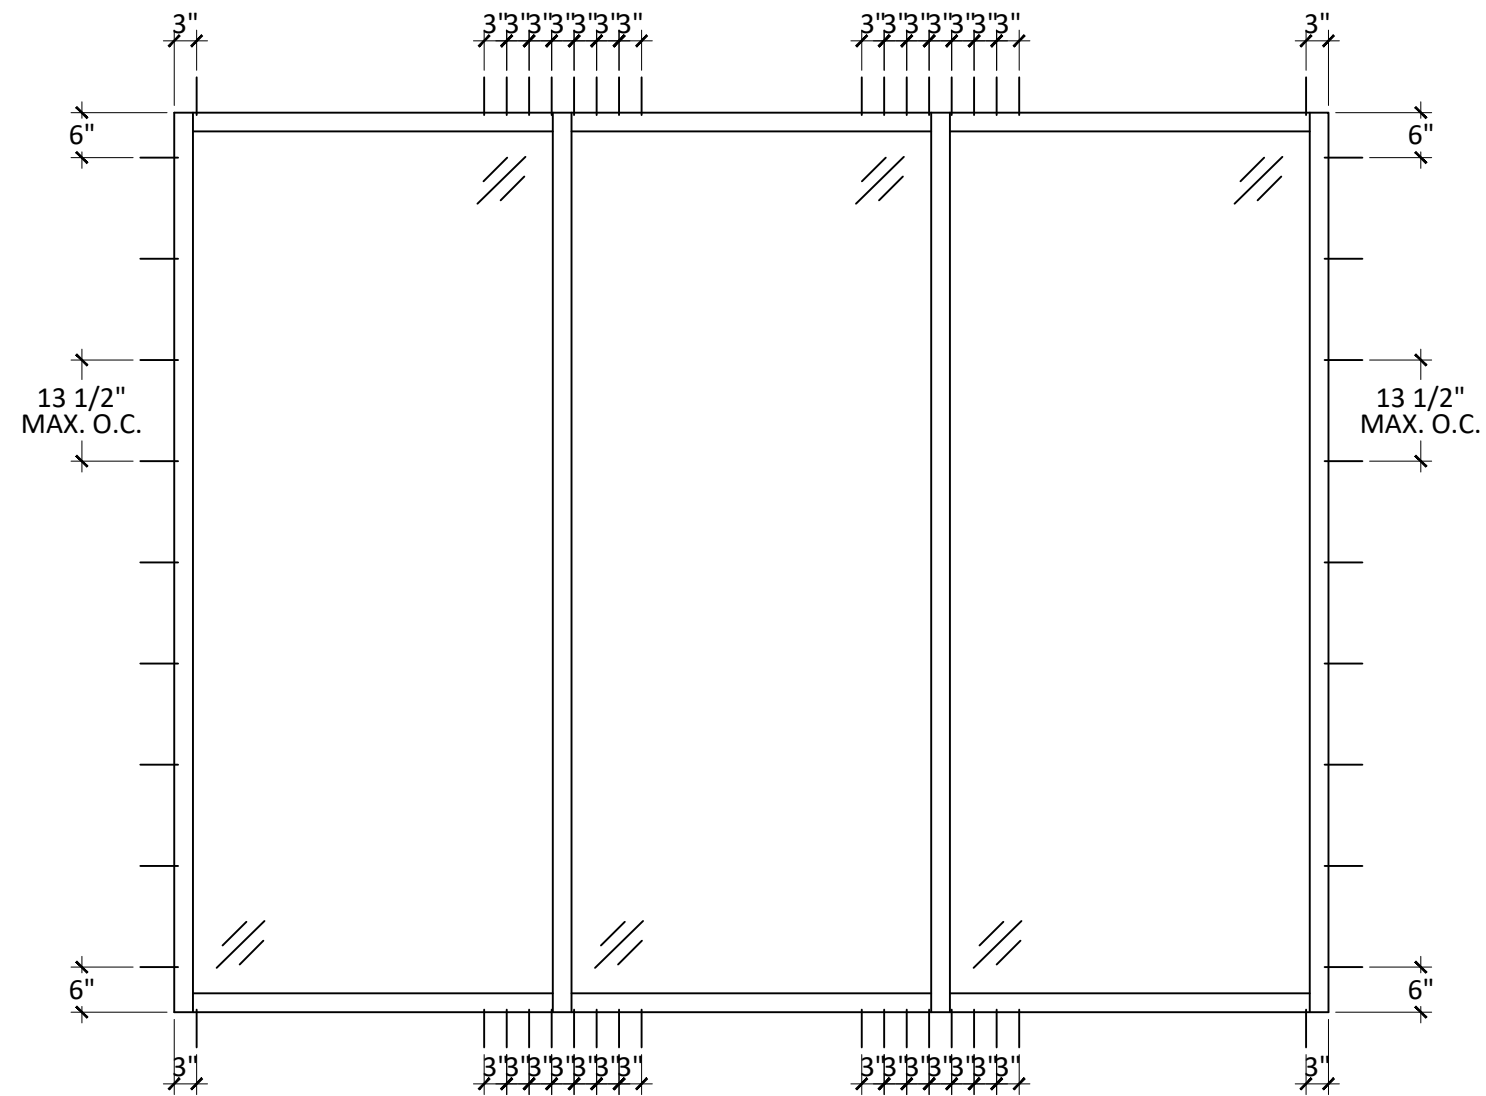

WINDOW WALL TYPICAL ANCHOR LAYOUT

EXTERIOR VIEW

REFER TO SHEET 1 FOR INSTALLATION
REQUIREMENT NOTES

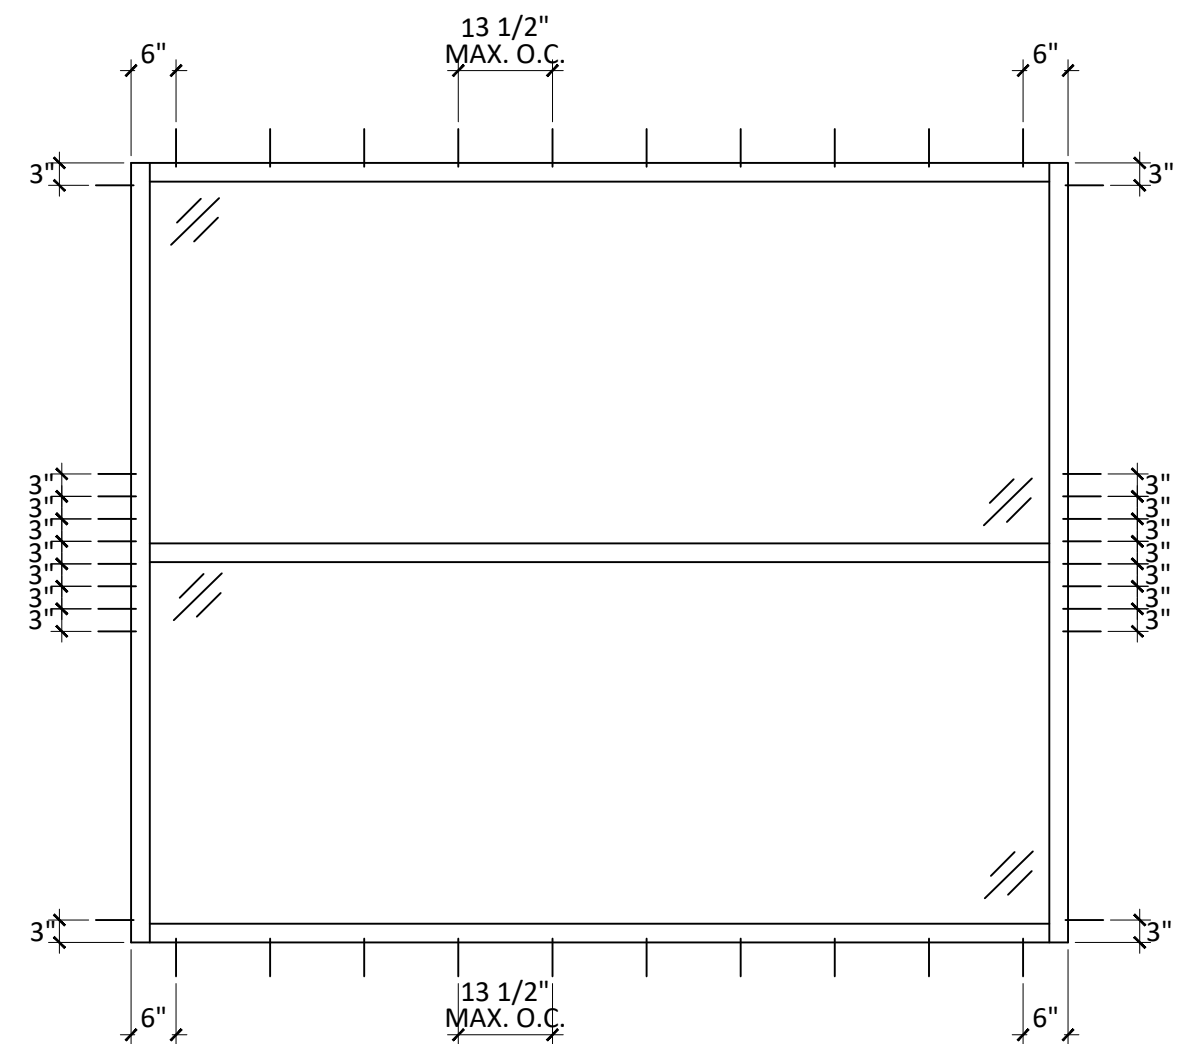

WINDOW WALL TYPICAL ANCHOR LAYOUT

EXTERIOR VIEW

REFER TO SHEET 1 FOR INSTALLATION
REQUIREMENT NOTES

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, FL 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

[illegible]

SLM ENGINEERS

REVIEWED FOR STRUCTURAL
COMPLIANCE ONLY BY:



SOMEL LORIGA
LICENSE
No. 77736
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 23314














SERIES:

3020 SERIES
L.M.I. & S.M.I.

Description:

W.W. SYSTEM

Drawn Date 10-10-2020	Scale AS NOTED
Project No. FLORIDA APPROVAL 2020	
Drawing Title ANCHOR LOCATIONS	
Sheet No. SHEET: 6 OF: 9	

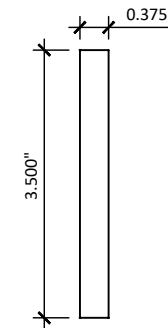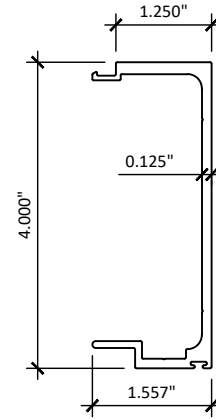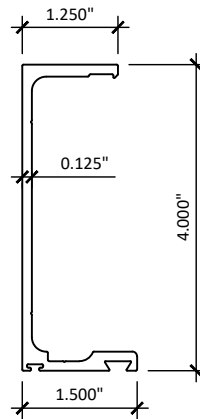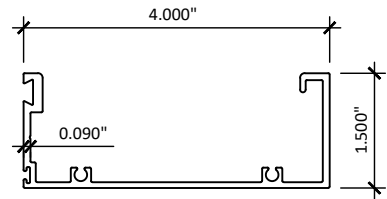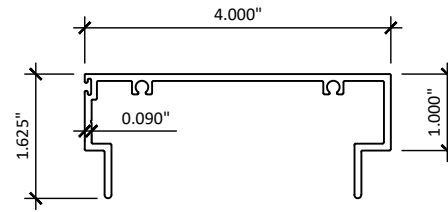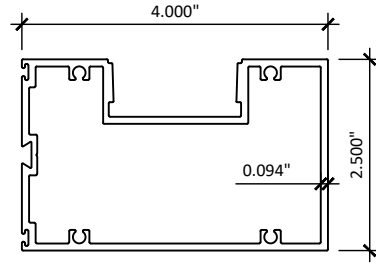

3020 WINDOW WALL	ITEM NUMBER	PART NUMBER	PART NAME	REMARKS	ALLOY & TEMPERED
	1	3020-01	FRAME HEAD/SILL/JAMB		6063-T6
	2	3020-02	FRAME COVER		6063-T6
	3	3020-03	INTERMEDIATE - MALE		6063-T6
	4	3020-04	INTERMEDIATE - FEMALE		6063-T6
	5	3020-05	MULLION - FEMALE		6063-T6
	6	3020-06	MULLION - MALE		6063-T6
	7	3020-07	STEEL REINFORCING		6063-T6
	8	3020-08	PRESSURE PLATE ADAPTER		6063-T6
	9	3020-09	MULLION PRESSURE PLATE		6063-T6
	10	3020-10	FRAME PRESSURE PLATE		6063-T6
	11	3020-11	PRESSURE PLATE COVER		6063-T6
	12	3020-12	SSG MONO. GLASS ADAPTER FRAME		6063-T6
	13	3020-13	SSG MONO. GLASS ADAPTER MULL		6063-T6
	14	CGS-01	GLASS SPACING	PROTOTYPE PLASTIC EXTRUSION	

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, FL 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

								FBC 2020 CODE CHANGE	Submittal/Revision Description
								10/10/20	Drawn By
								A	Rev. No.
									Sub. No.



SLM ENGINEERS

REVIEWED FOR STRUCTURAL
COMPLIANCE ONLY BY:



Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 23314

SERIES:

3020 SERIES
L.M.I. & S.M.I.

Description:

W.W. SYSTEM

Drawn Date
10-10-2020


Scale
AS NOTED

Project No.
FLORIDA APPROVAL 2020


Drawing Title
EXTRUSIONS &
BILL OF MATERIAL

Sheet No.
SHEET: 7 OF: 9


GLAZING DETAILS

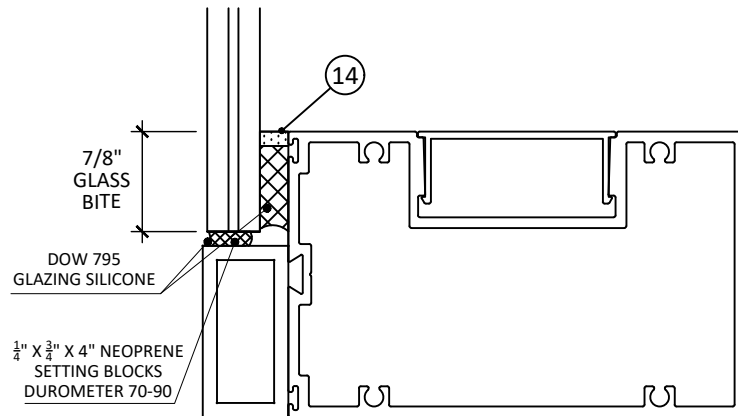


GL-1
GL-2
GL-5

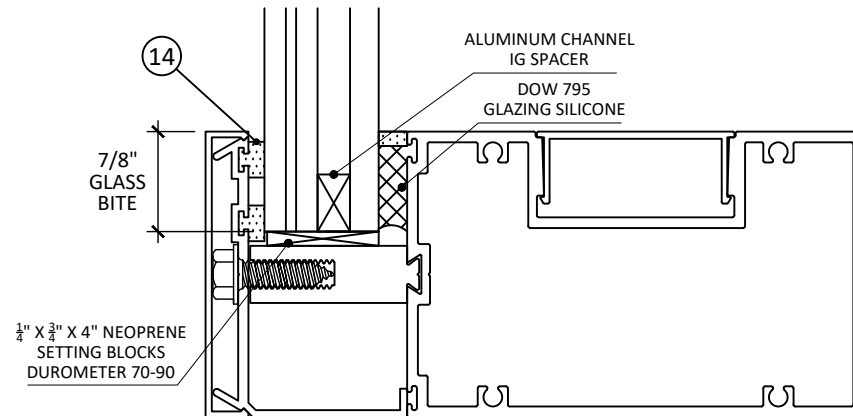


GL-3
GL-4

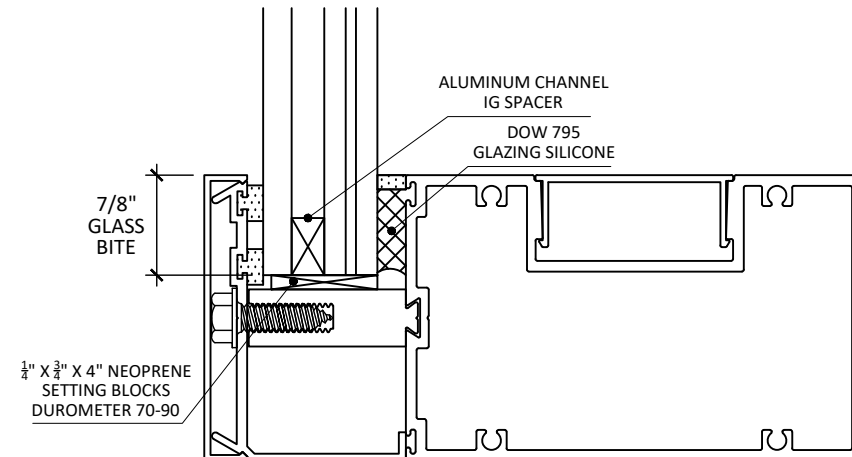

GL-3A
GL-4A

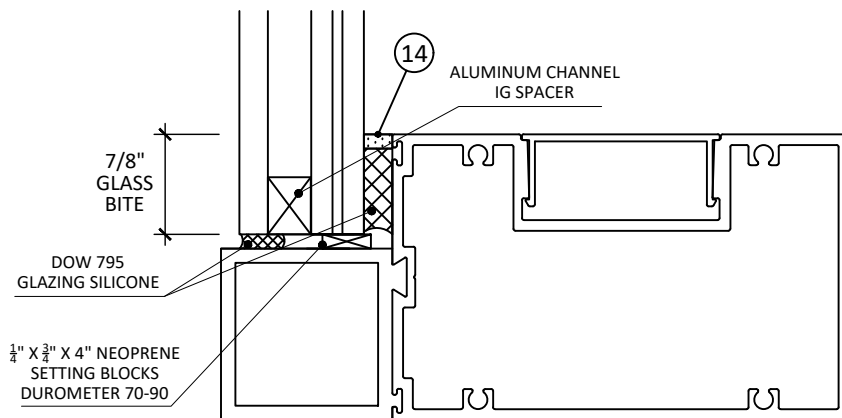

GL-1A
GL-2A

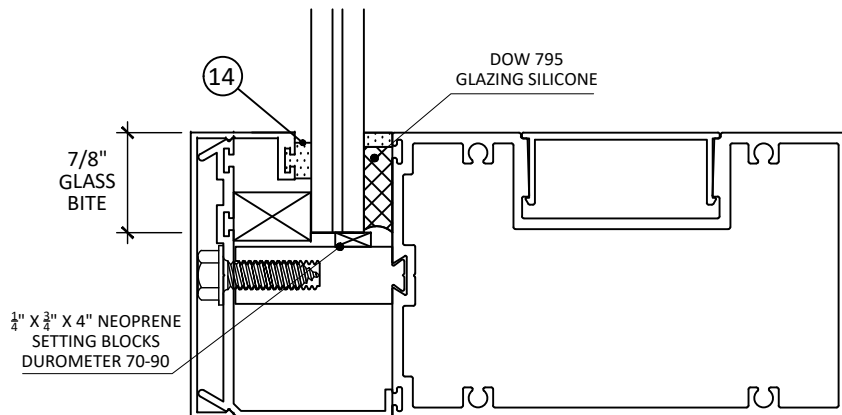

GL-1B
GL-2B

GLAZING SCHEDULE		
TYPE	IMPACT RATING	COMPOSITION
GL-1	LMI	7/16" MONO LAMI: 3/16" HEAT STRENGTHENED - 0.090" BUTACITE PVB - 3/16" HEAT STRENGTHENED
GL-1A	LMI	1" IG LAMI: 3/16" TEMPERED - AIR - 3/16" HEAT STRENGTHENED - 0.090" BUTACITE PVB - 3/16" HEAT STRENGTHENED (LAMI TO INTERIOR)
GL-1B	LMI	7/16" MONO LAMI: 3/16" HEAT STRENGTHENED - 0.090" BUTACITE PVB - 3/16" HEAT STRENGTHENED
GL-2	SMI	7/16" MONO LAMI: 3/16" HEAT STRENGTHENED - 0.060" BUTACITE PVB - 3/16" HEAT STRENGTHENED
GL-2A	SMI	1" IG LAMI: 3/16" TEMPERED - AIR - 3/16" HEAT STRENGTHENED - 0.060" BUTACITE PVB - 3/16" HEAT STRENGTHENED (LAMI TO INTERIOR)
GL-2B	SMI	7/16" MONO LAMI: 3/16" HEAT STRENGTHENED - 0.060" BUTACITE PVB - 3/16" HEAT STRENGTHENED
GL-3	LMI	1" IG LAMI: 3/16" HEAT STRENGTHENED - 0.090" BUTACITE PVB- 3/16" HEAT STRENGTHENED - AIR - 3/16" TEMPERED (LAMI TO EXTERIOR)
GL-3A	LMI	1" IG: 3/16" TEMPERED - AIR - 3/16" HEAT STRENGTHENED - 0.090" BUTACITE PVB - 3/16" HEAT STRENGTHENED (LAMI TO INTERIOR)
GL-4	SMI	1" IG LAMI: 3/16" HEAT STRENGTHENED - 0.060" BUTACITE PVB - 3/16" HEAT STRENGTHENED - AIR - 3/16" TEMPERED (LAMI TO EXTERIOR)
GL-4A	SMI	1" IG: 3/16" TEMPERED - AIR - 3/16" HEAT STRENGTHENED - 0.060" BUTACITE PVB - 3/16" HEAT STRENGTHENED (LAMI TO INTERIOR)
GL-5	LMI	9/16" MONO LAMI: 1/4" HEAT STRENGTHENED - 0.090" BUTACITE PVB - 1/4" HEAT STRENGTHENED

NOTE, GLAZING DETAILS SHOWN ARE QUALIFIED FOR USE ON THE SECTION DETAILS SHOWN ON SHEETS 4 AND 5, AT THE ALLOWABLE PRESSURES AND SPANS SPECIFIED IN THE DESIGN PRESSURE TABLE ON SHEET 1.

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, FL 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

Submittal/Revision Description

FBC 2020 CODE CHANGE

By _____


Date

No.

No.



REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:



Soumel Loriga, P.E.

PE Lic No.: 77736

Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 23314

SERIES:

3020 SERIES
L.M.I. & S.M.I.

Description:

W.W. SYSTEM

Drawn Date

10-10-2020

Scale

10/10/2020	AS NOTED
Project No.	
FLORIDA APPROVAL 2020	


Drawing Title

GLAZING DETAILS

Sheet No.


SHEET: 8 OF: 9

REINFORCING DETAILS

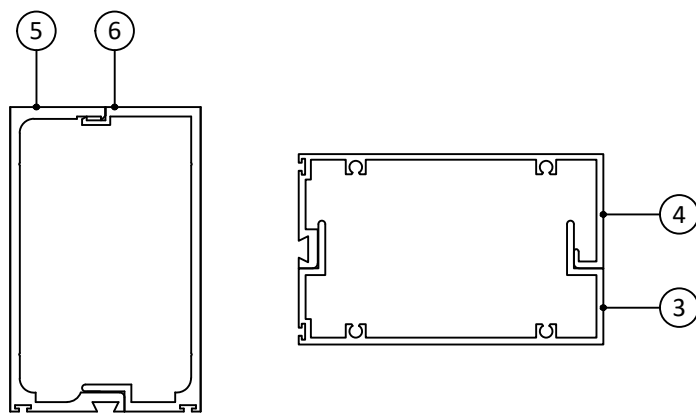

UNREINFORCED MULLIONS

UP TO 60 PSF & 96" SPAN
OR UP TO 90 PSF & 48" SPAN

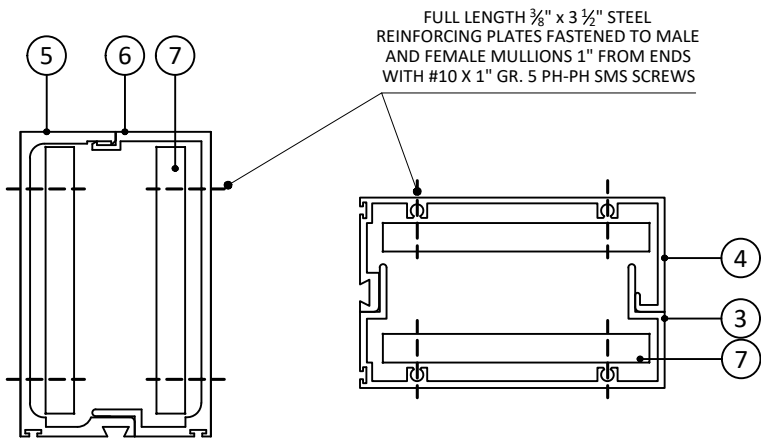

REINFORCED MULLIONS

UP TO 90 PSF & 120" SPAN

REINFORCING NOTES:

- REINFORCING (ITEM #7) IN MULLIONS NOT REQUIRED FOR SPANS UP TO 96" AT DP +/-60 PSF, OR FOR SPANS UP TO 48" AT 90 PSF.
- REINFORCING REQUIRED FOR SPANS OVER 96" AND/OR DP GREATER THAN +/- 60 PSF.
- SEE DESIGN PRESSURE TABLE, SHEET 1.

ASSEMBLY NOTES:

1. PRESSURE PLATES (ITEM 9 & 10) FASTENED 6" FROM CORNERS AND 12" O.C. USING #10 X 1" GR. 5 PH-PH SMS SCREWS
2. FRAME CORNER CONSTRUCTION USES TWO #10 X 1" GR. 5 PH-PH SMS SCREWS AT CORNERS OF EACH PANEL:
 - 2.3. THROUGH FRAME HEAD/SILL/JAMB PROFILE INTO FRAME HEAD/SILL/JAMB PROFILE AT OVERALL FRAME CORNERS
 - 2.4. THROUGH MALE AND FEMALE MULLIONS, INTO FRAME HEAD/SILL/JAMB PROFILE, ALONG FRAME PERIMETER
 - 2.5. THROUGH MALE AND FEMALE MULLIONS, INTO INTERMEDIATE MALE AND FEMALE COMPONENTS AT INTERMEDIATE MEMBER LOCATIONS
3. GLASS ADAPTERS (ITEMS 12 & 13) ATTACHED TO FRAME WITH SILICONE

Manufacturer:
CGS
CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, FL 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Rev. No.	Date	Drawn By	Submitter/Revision Description
A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS
REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

Soumel Loriga
LICENSE
No. 77736
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:
FL# 23314

SERIES:
**3020 SERIES
L.M.I. & S.M.I.**

Description:
W.W. SYSTEM

Drawn Date
10-10-2020

Scale
AS NOTED

Project No.
FLORIDA APPROVAL 2020

Drawing Title
**REINFORCING DETAILS
& ASSEMBLY NOTES**

Sheet No.
SHEET: 9 OF: 9