

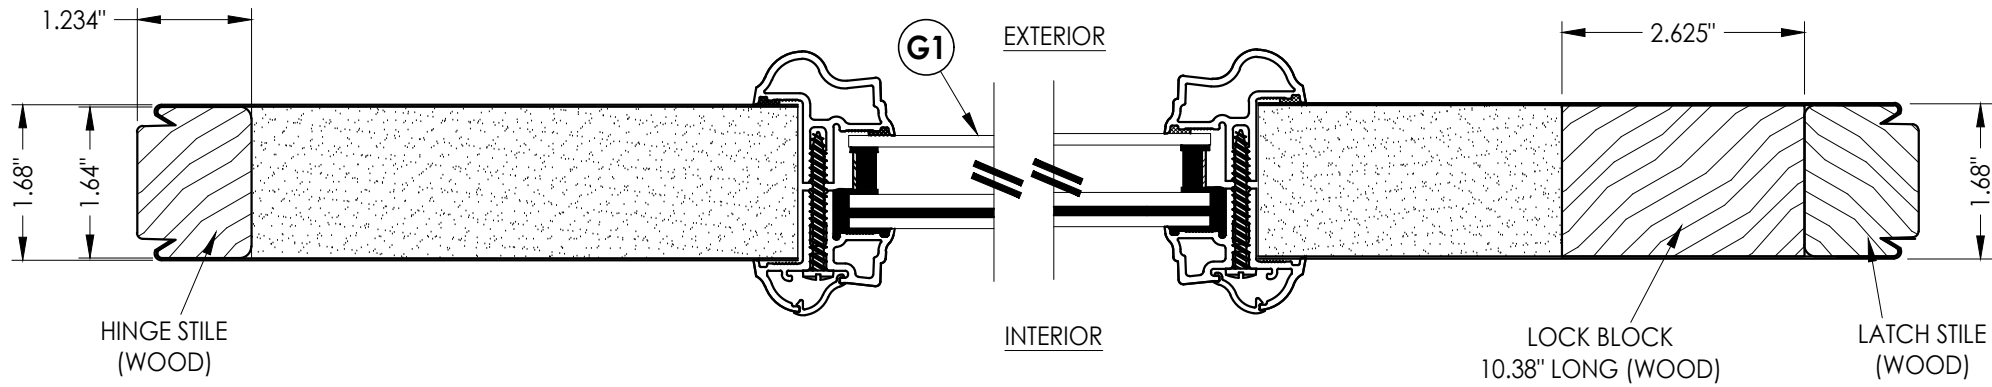


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.9-11.dwg

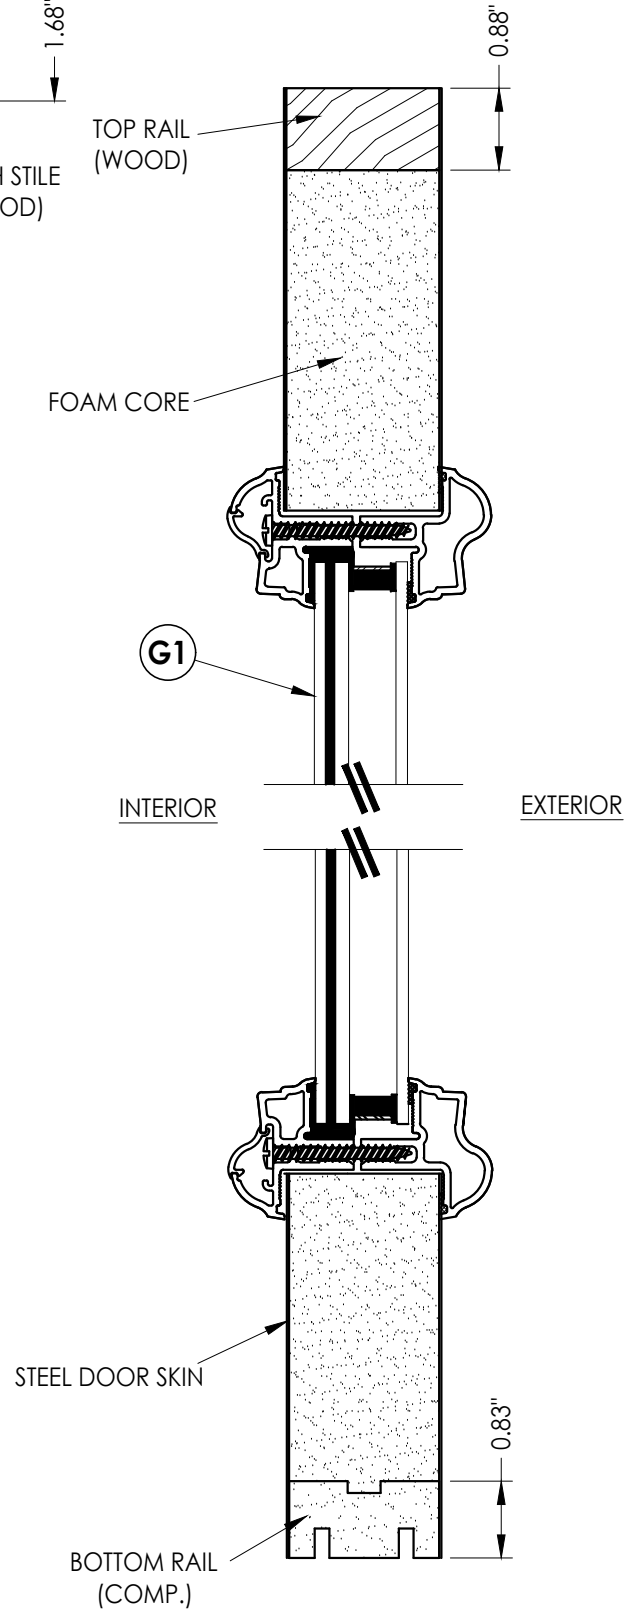

1
2 **HORIZONTAL CROSS SECTION**

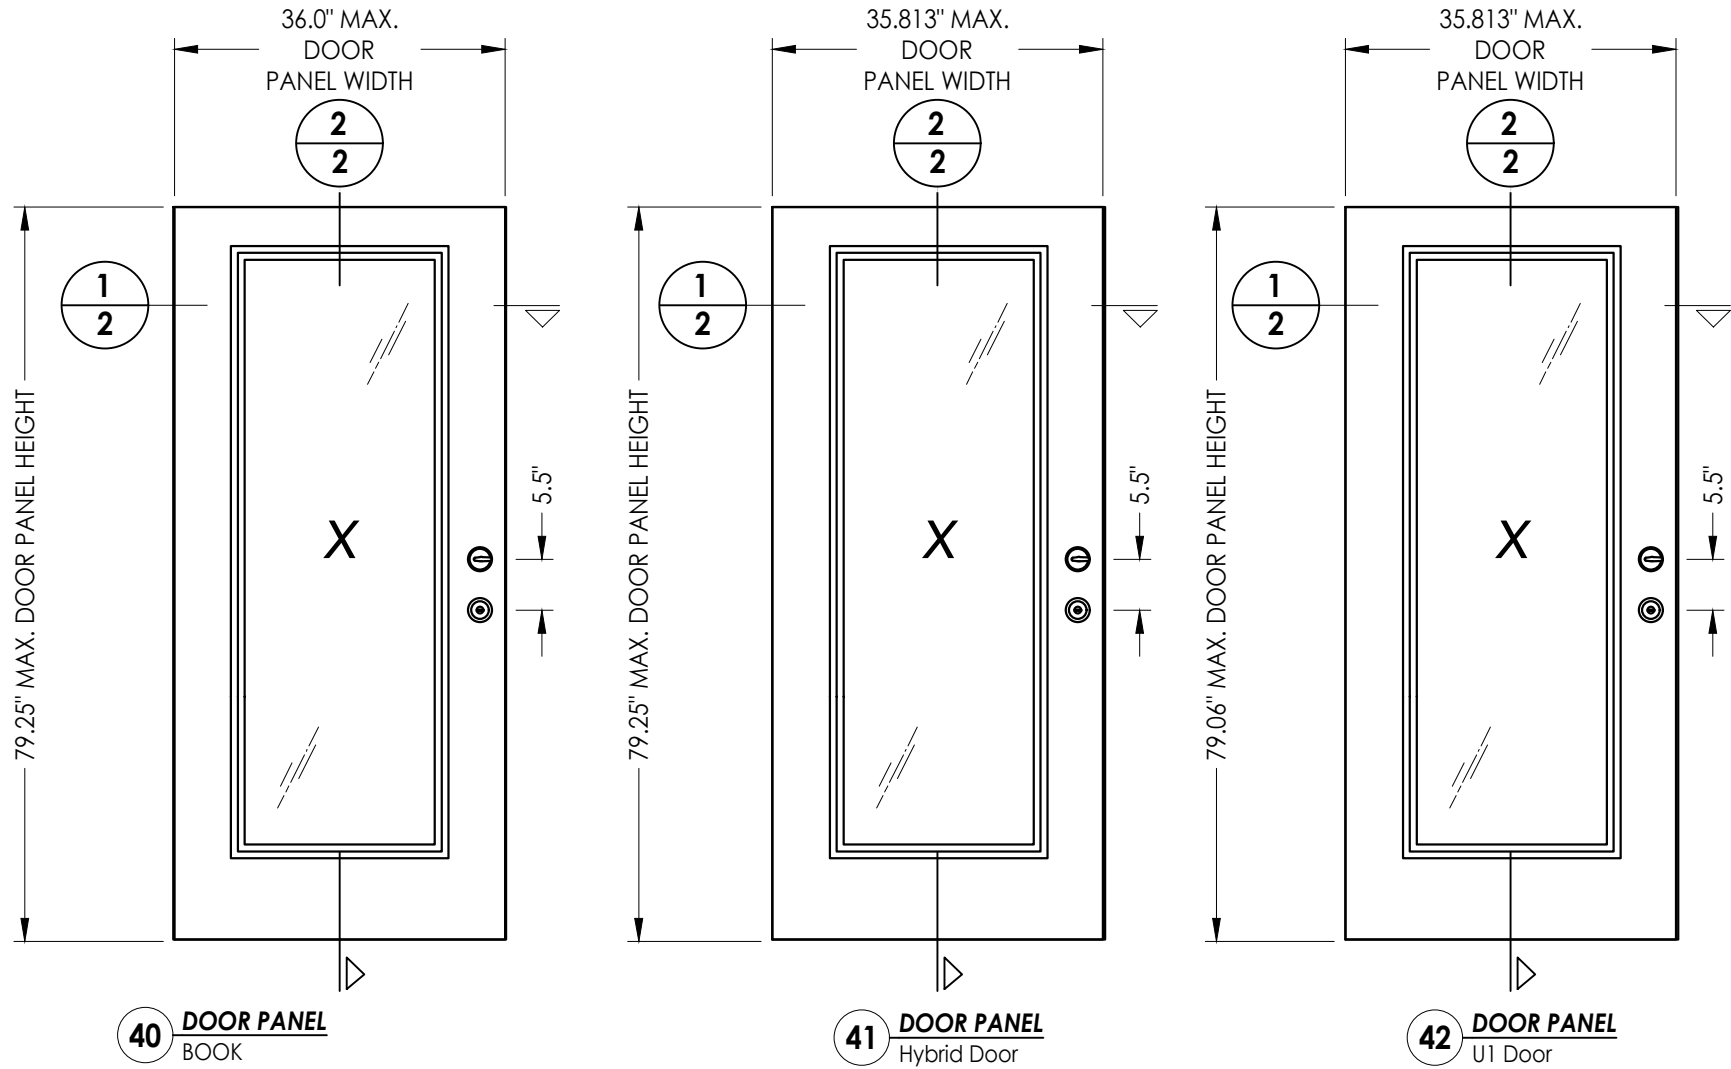

2
2 **VERTICAL CROSS SECTION**

"PROFILES" SERIES DOOR PANEL

STEEL DOOR SKIN: 24 GA. (0.022" MIN. THICKNESS, $F_y = 48,470$ PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
"PROFILES"
DOOR PANEL DETAILS


NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO
		BY

DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-23507.11
SHEET	2 OF 15

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.9-11.dwg

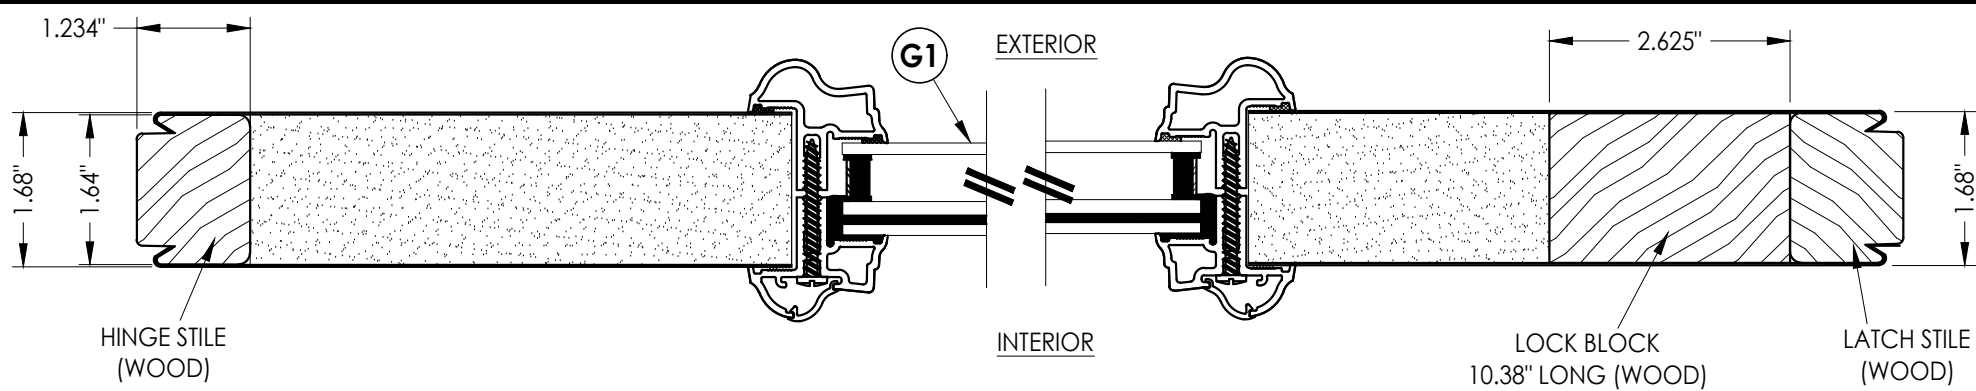

1
3 HORIZONTAL CROSS SECTION

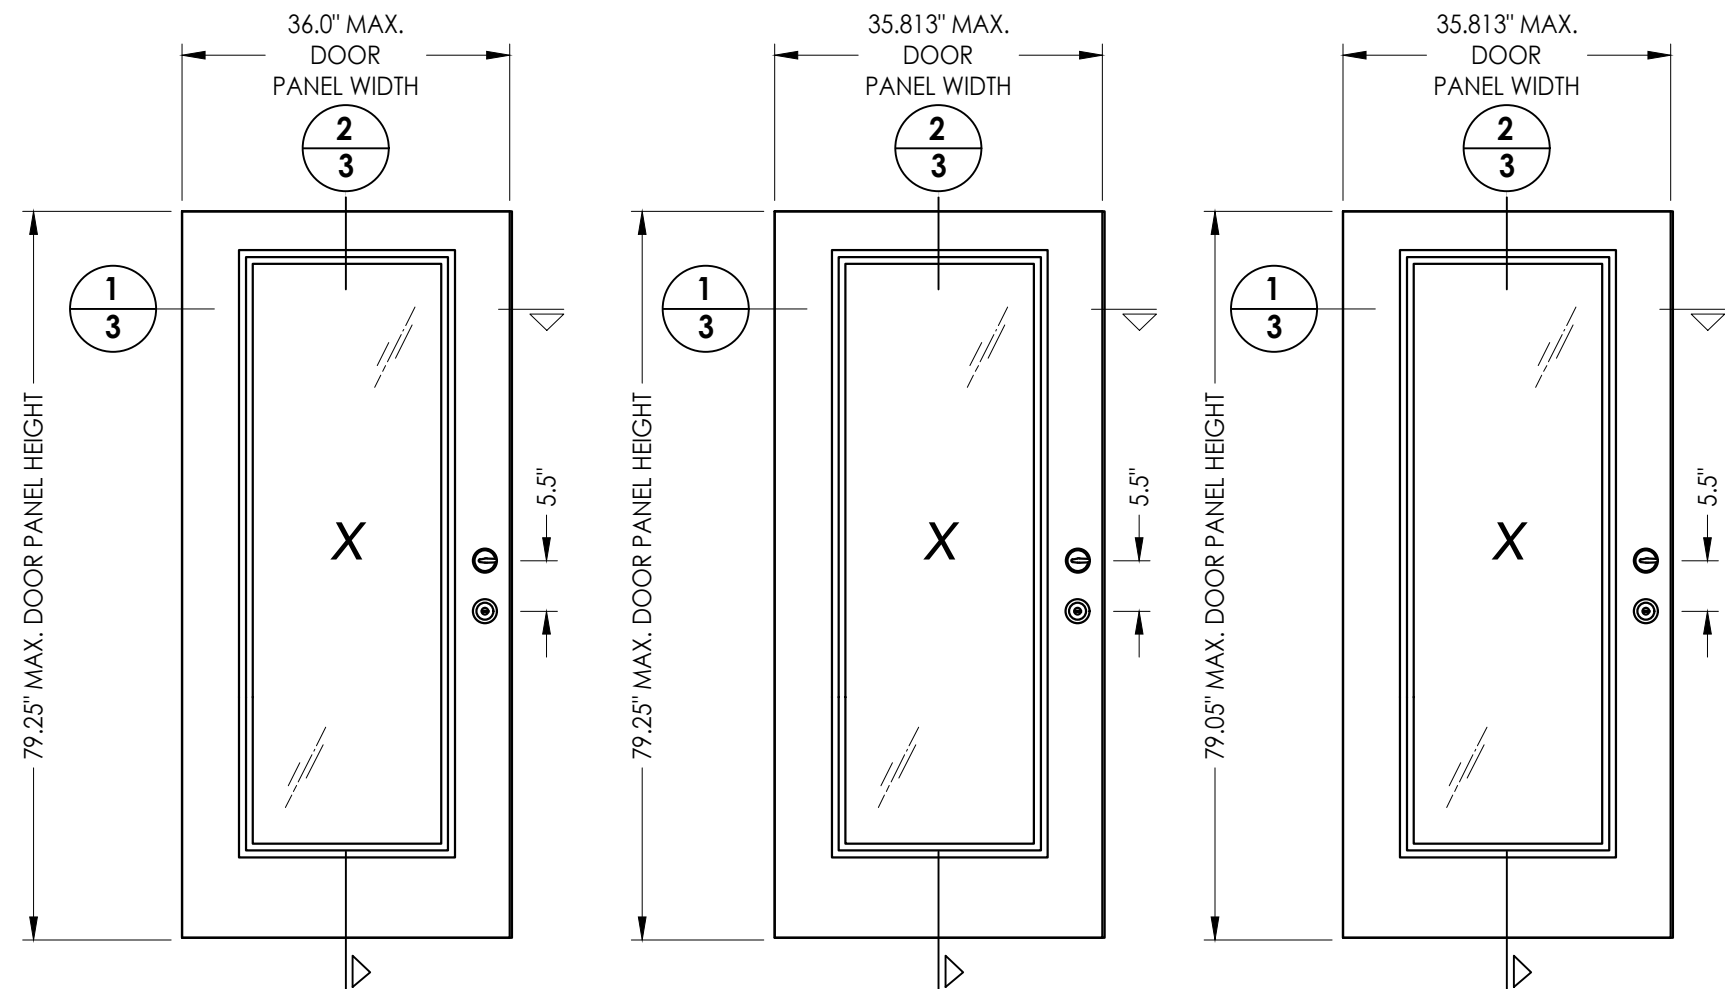

60 DOOR PANEL BOOK


61 DOOR PANEL Hybrid Door

62 DOOR PANEL U1 Door

"TRADITIONS" SERIES DOOR PANEL

STEEL DOOR SKIN: 25 GA. (0.018" MIN. THICKNESS, Fy = 27,830 PSI MIN.)

FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

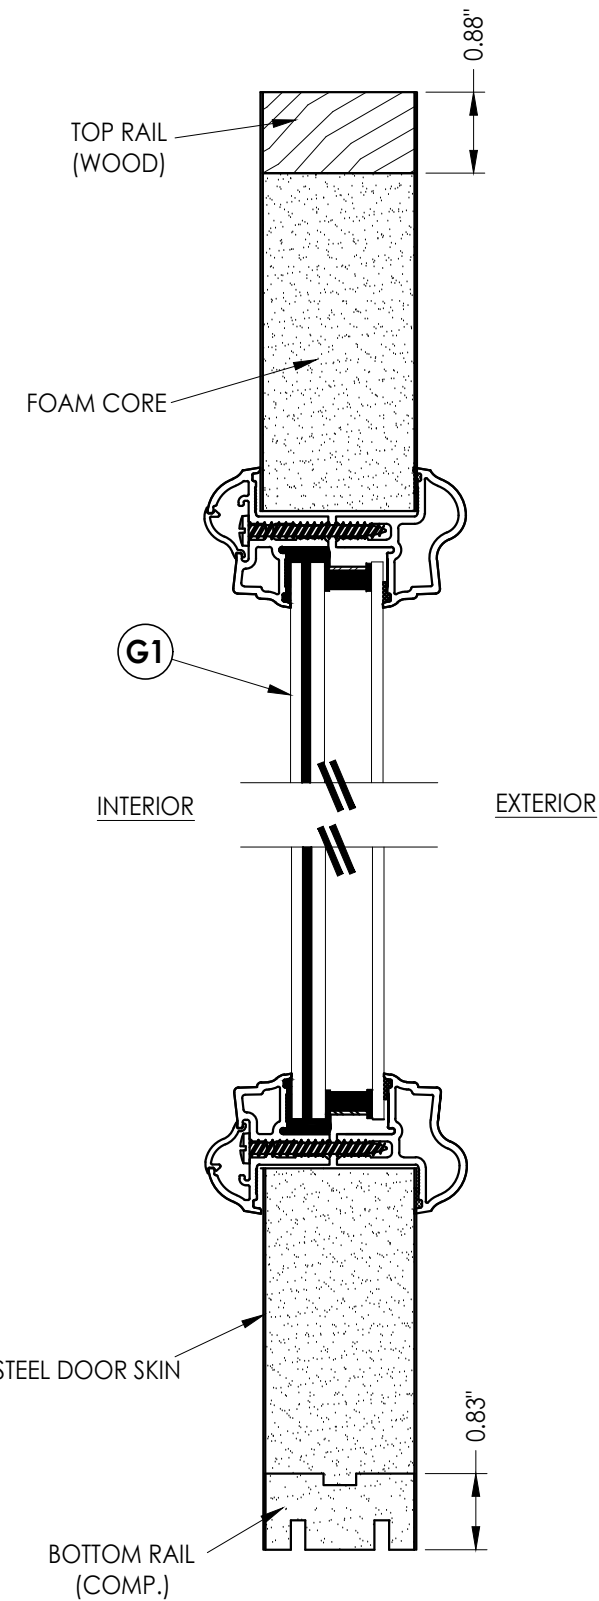

2
3 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	Therma-Tru STEEL DOOR
PART OR ASSEMBLY:	"TRADITIONS" DOOR PANEL DETAILS

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-23507.11
SHEET	3 OF 15




Technical drawing of a rectangular panel. The overall dimensions are 36.0" MAX. SIDELITE PANEL WIDTH and 79.25" MAX. SIDELITE PANEL HEIGHT. The drawing includes a central rectangular area with a double-line border and a large 'O' in the center. Two circular callouts are present: one labeled '1' and '4' on the left, and another labeled '2' and '4' at the top. The panel is shown with a top and bottom flange, indicated by dashed lines and arrows.

Diagram illustrating the cross-section of a door assembly, showing internal components and dimensions:

- TOP RAIL (COMP.)**: The top composite rail.
- FOAM CORE**: The insulating core material.
- G1**: A label for the central vertical component.
- INTERIOR** and **EXTERIOR**: Labels indicating the orientation of the door.
- STEEL DOOR SKIN**: The outer metal layer.
- BOTTOM RAIL (COMP.)**: The bottom composite rail.
- Dimensions**:
 - Top Rail height: 0.94"
 - Bottom Rail height: 0.55"

© 2008 R.W. BUILDING CONSULTANTS INC.

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.9-11.dwg

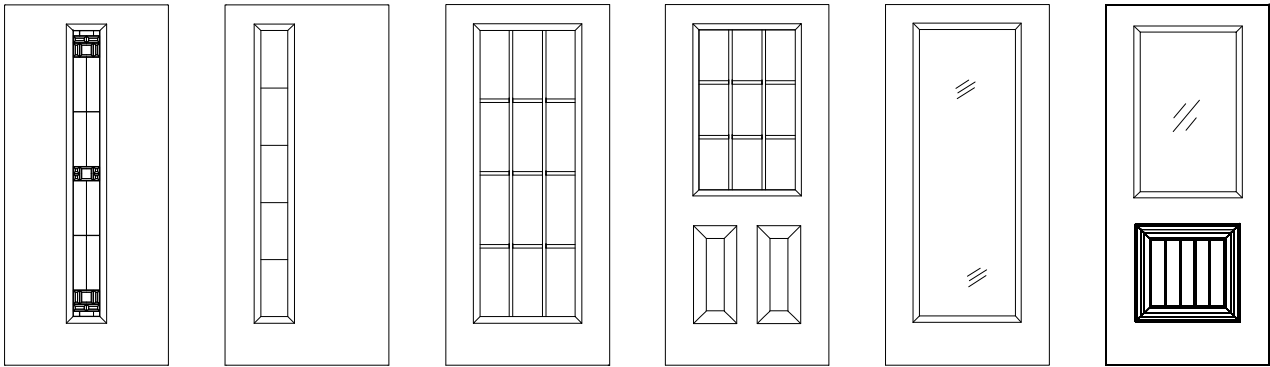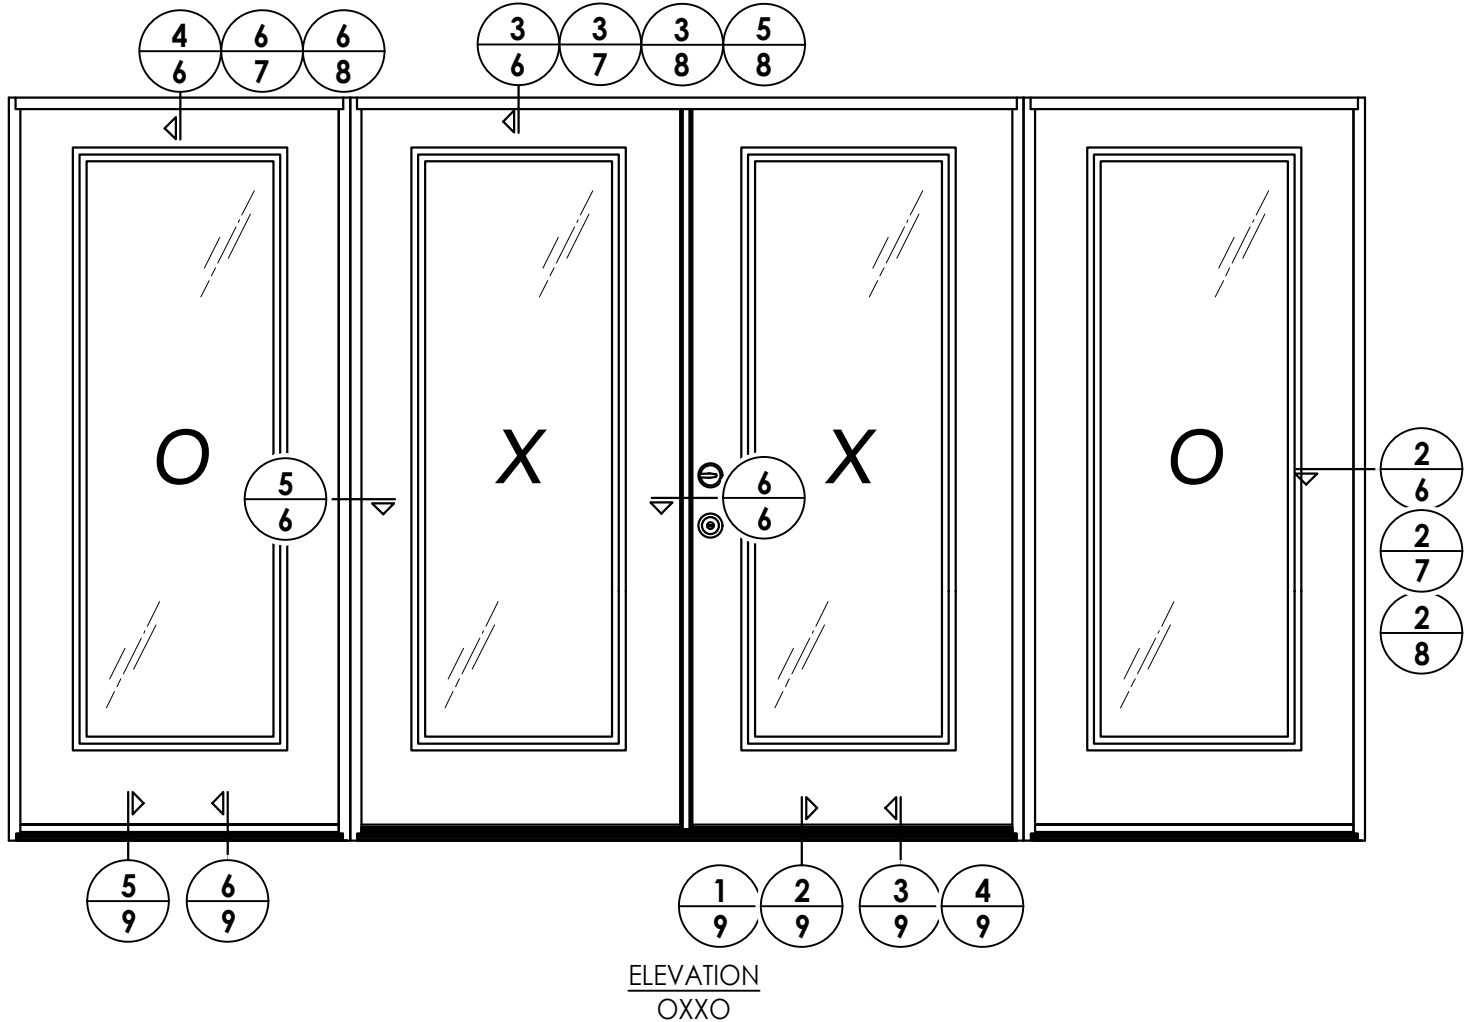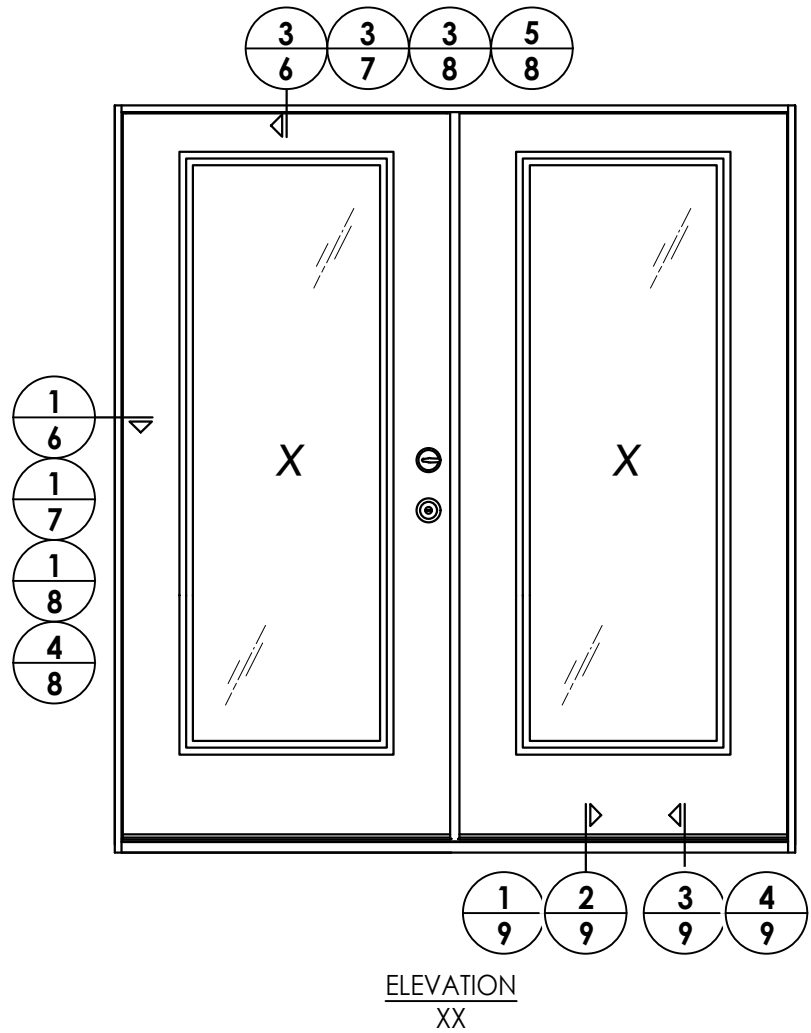

PROFILES/TRADITIONS Steel Door Panel Options
Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	Knob:	F51
	Deadbolt:	B60
KWIKSET	Knob:	SIGNATURE SERIES
	Deadbolt:	SIGNATURE SERIES (980)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
ELEVATIONS

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-23507.11

SHEET 5 OF 15

REVISIONS

NO.	DATE	BY
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO



BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595


Phone No.: 813.659.9197

FBPE Registry No. 9813

- Notes:
1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

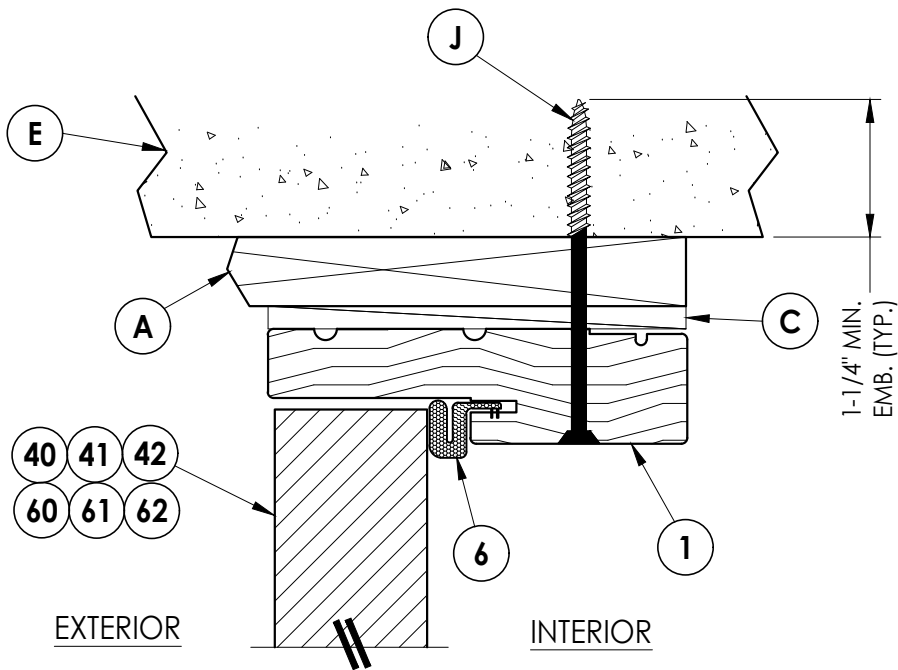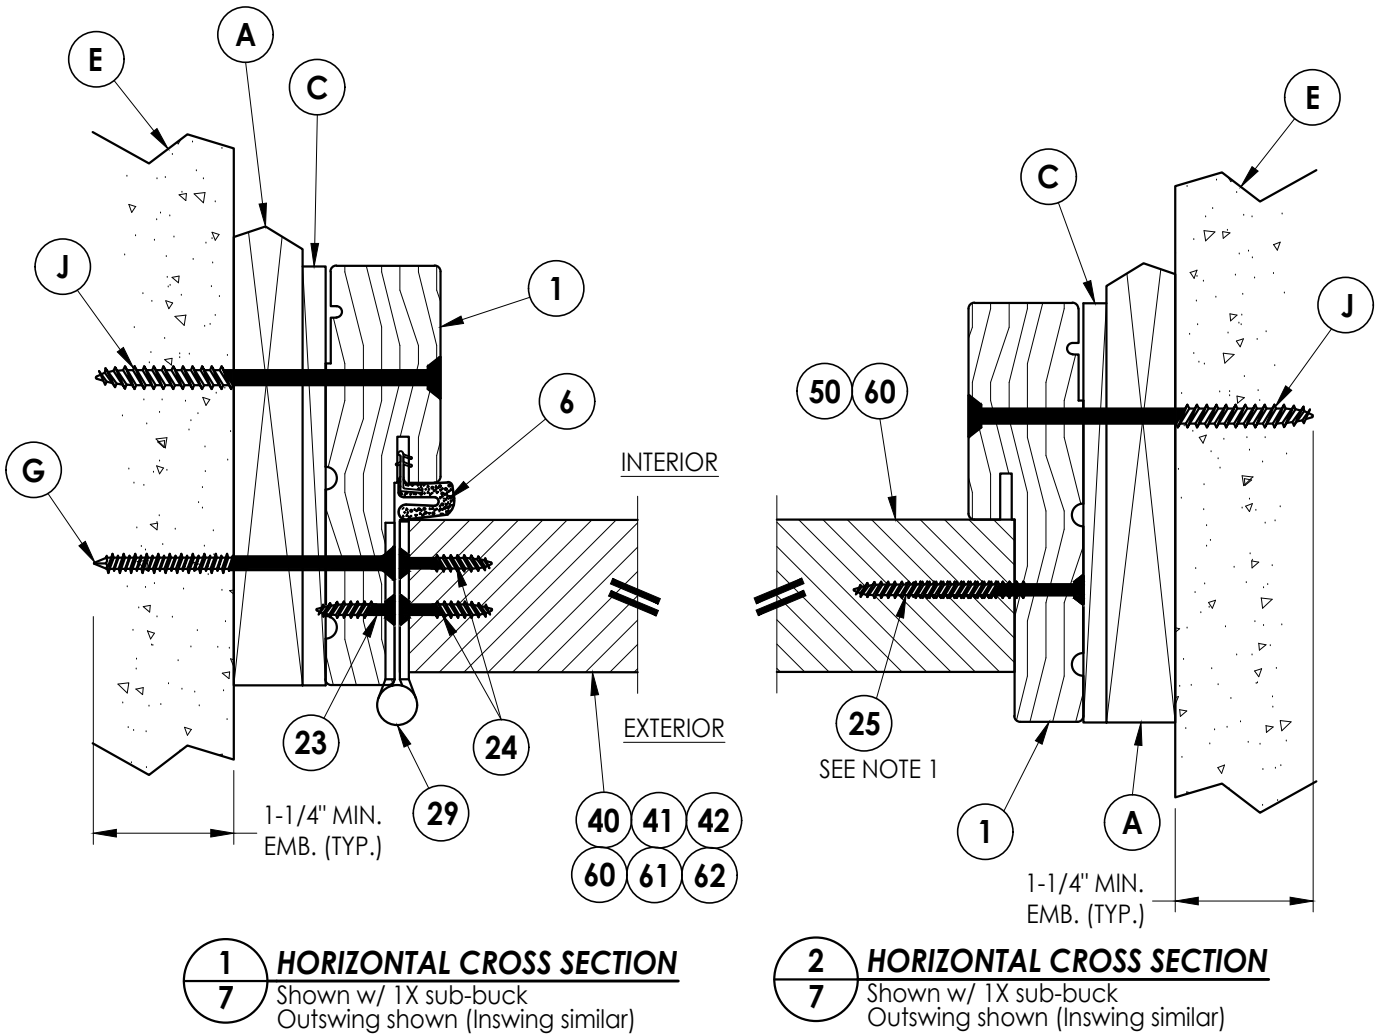


3 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

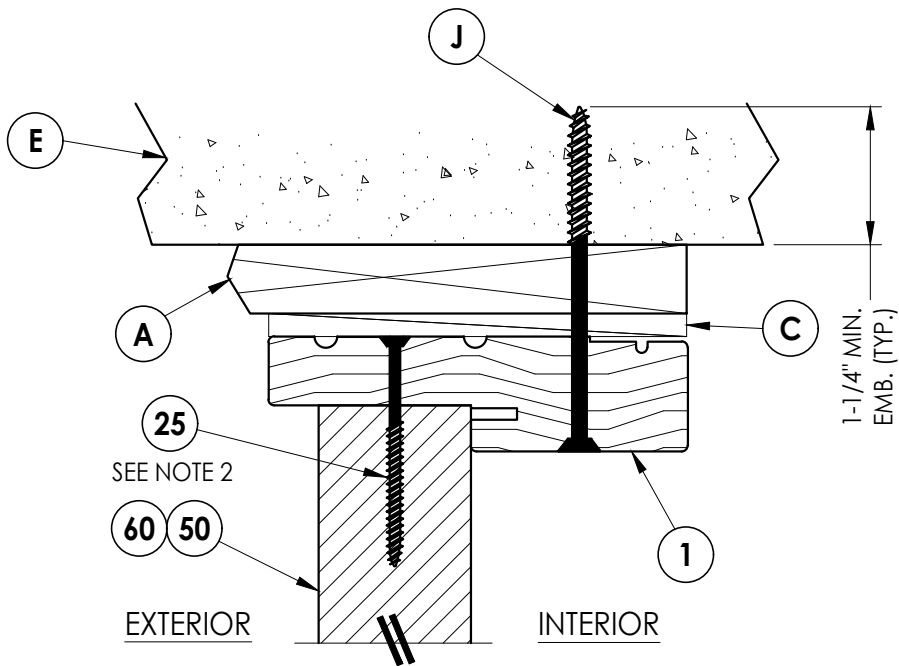


4 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
THERMA-TRU STEEL DOOR		R ^W	
PRODUCT:		PART OR ASSEMBLY:	
		HORIZONTAL & VERTICAL CROSS SECTIONS (1X BUCK)	
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO
NO.	DATE		BY
REVISIONS			
DATE: 10/12/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-23507.11			
SHEET 7 OF 15			


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.9-11.dwg

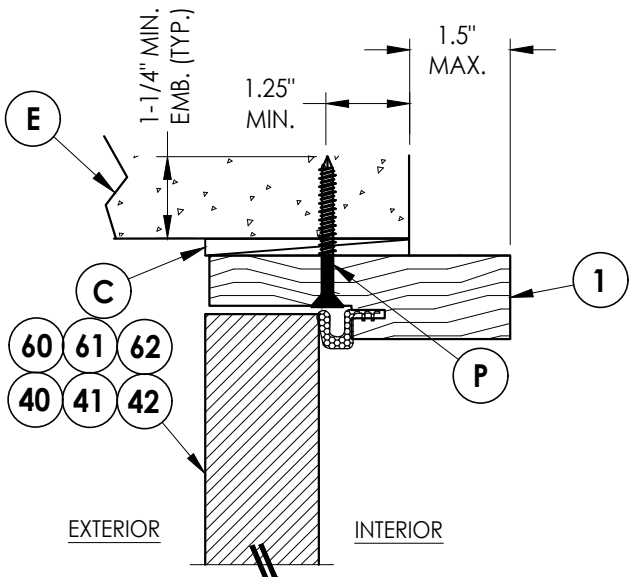

3
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

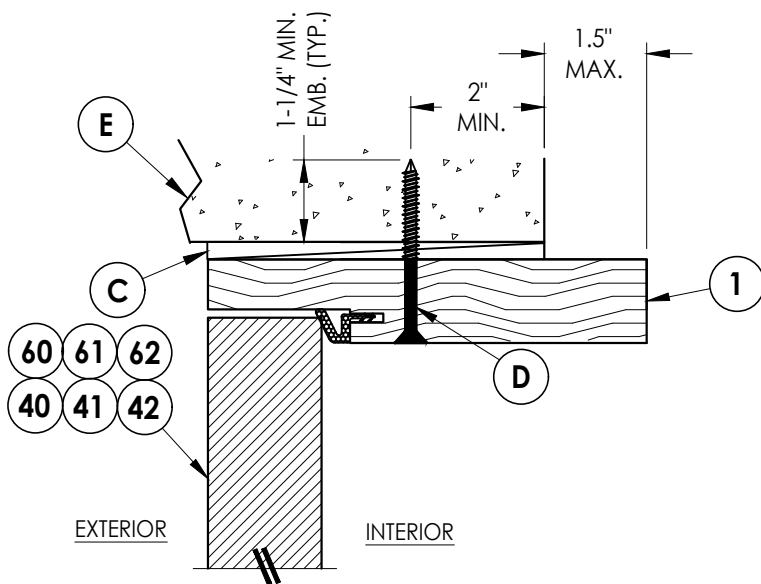


5
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

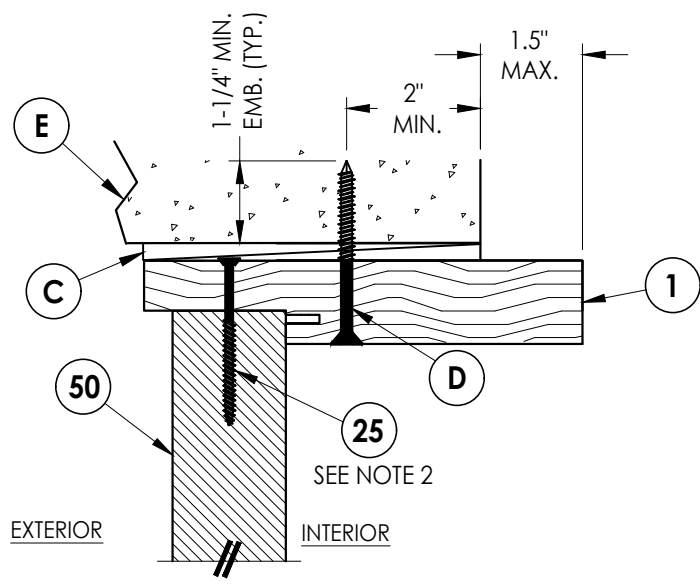


6
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb


- Notes:
1. Sidelite assembly screws located 7" from top and 14" from bottom & 2 more screws equally spaced between (4 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end (2 screws along head jamb).

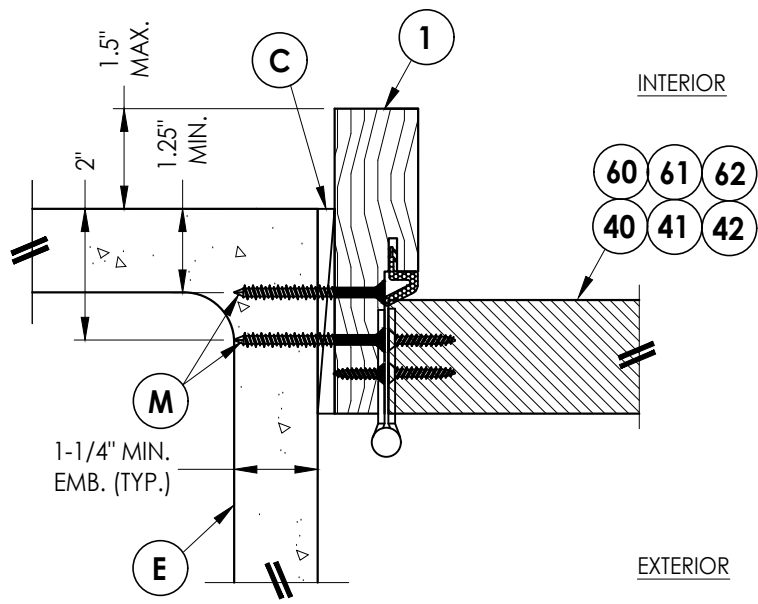

1
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

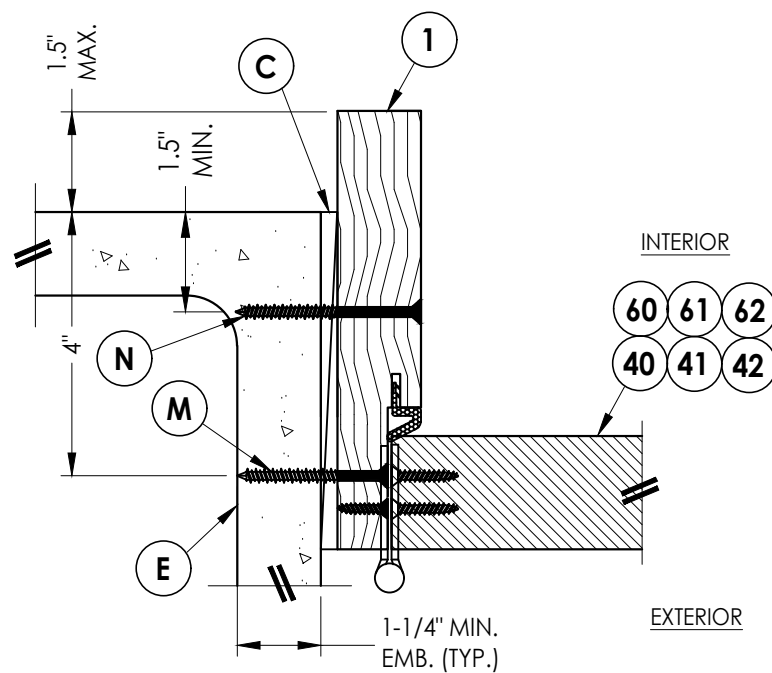

4
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

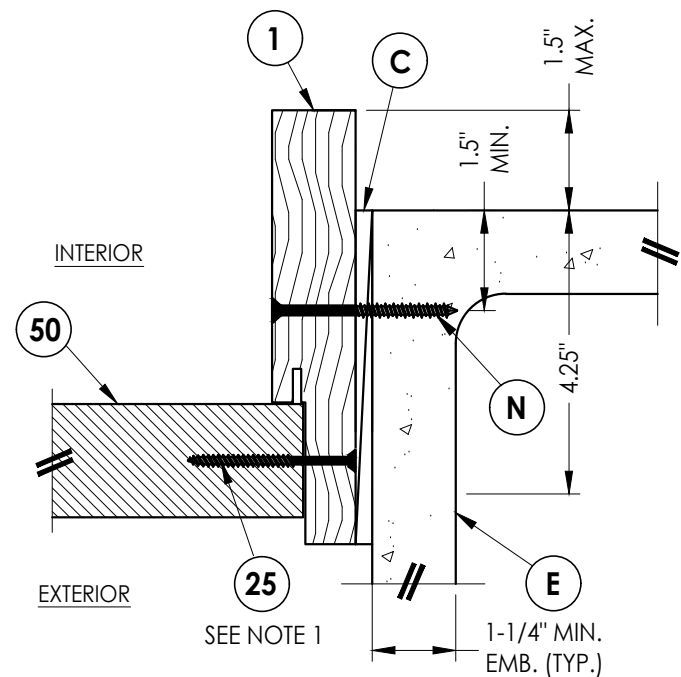

2
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813







RW

PRODUCT: THERMA-TRU STEEL DOOR
PART OR ASSEMBLY: HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)

NO.	DATE	BY	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-23507.11
SHEET 8 OF 15

- Notes:
- 1. Sill Item #'s 17, 18, 32, 34, 35, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pph screws at each end.
 - Sill Item #'s 16 & 33 are attached to jambs w/ (2) #8 X 2-1/2" pph screws at each end.
 - Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
 - 2. Sidelite assembly screws located 4" from each end (2 screws along sill).

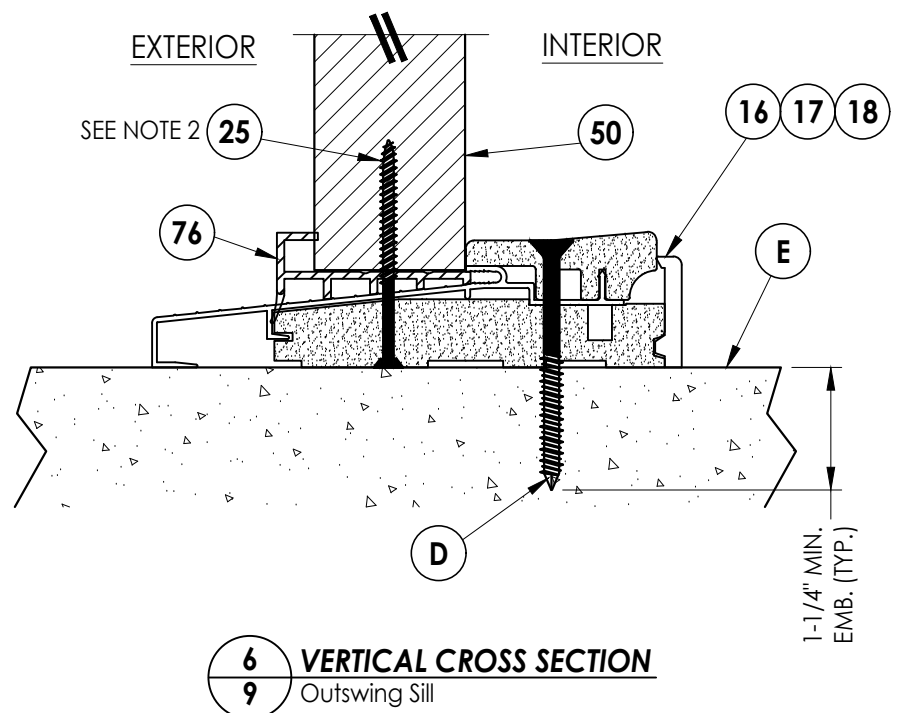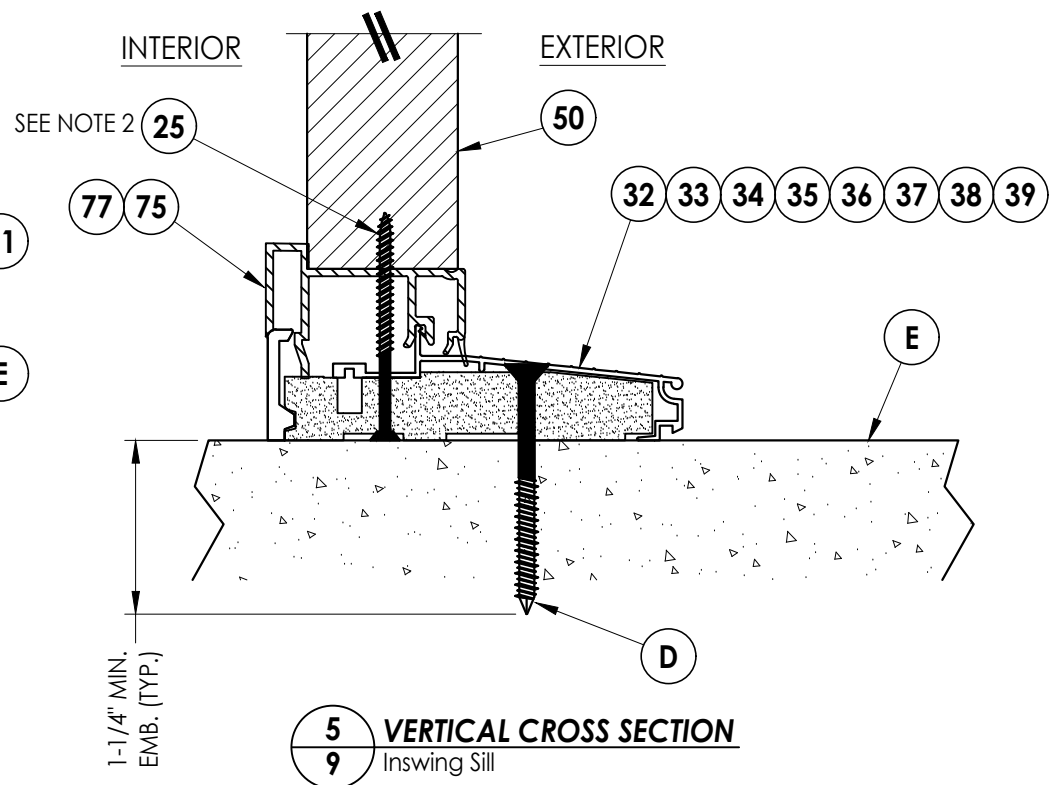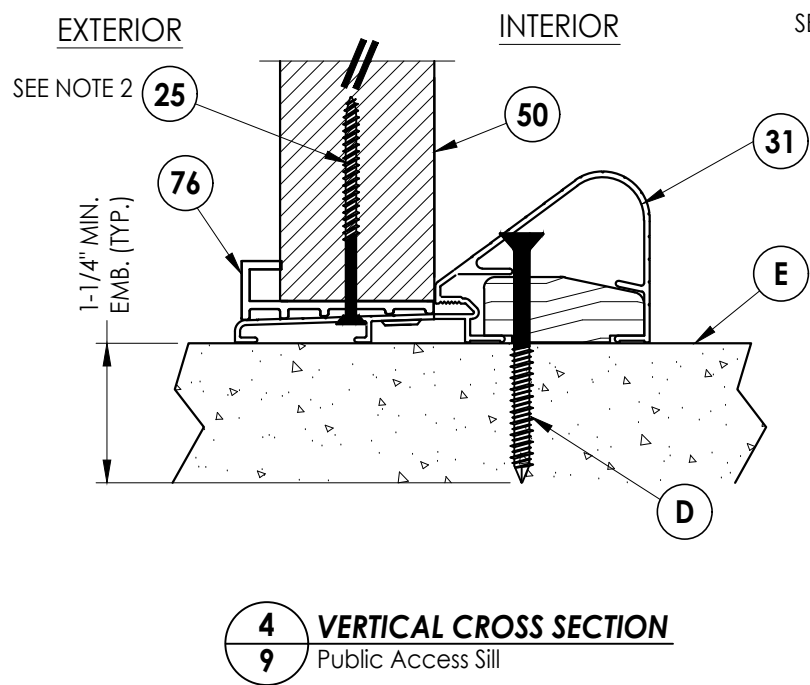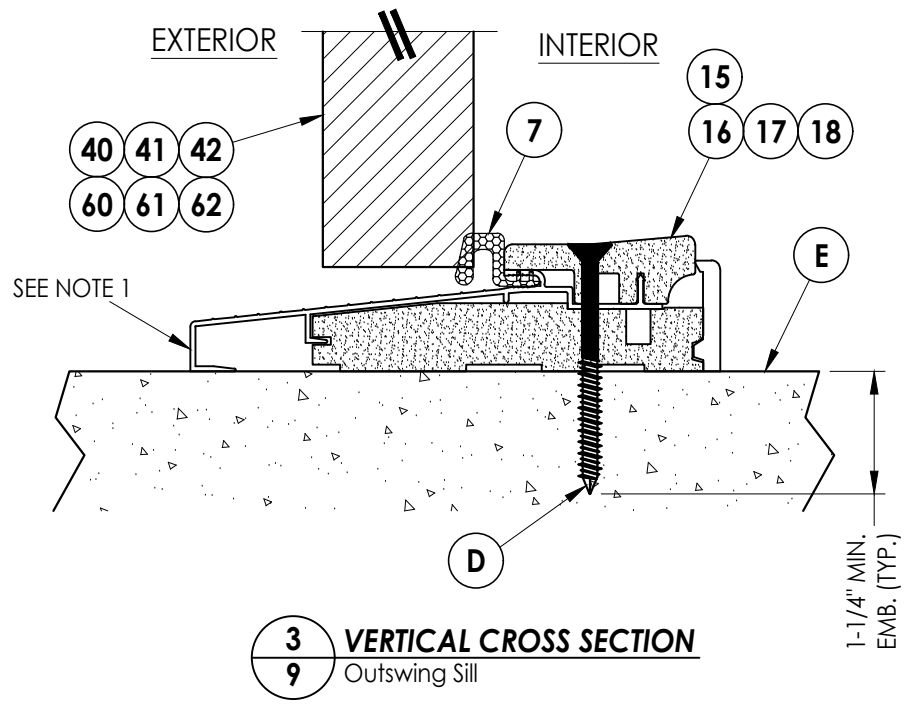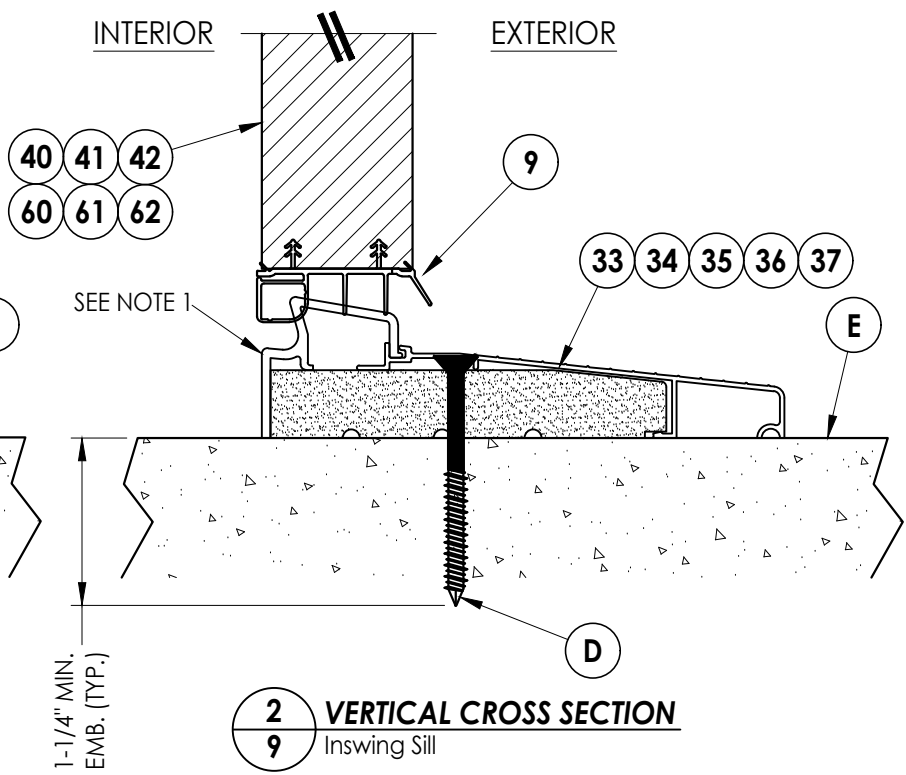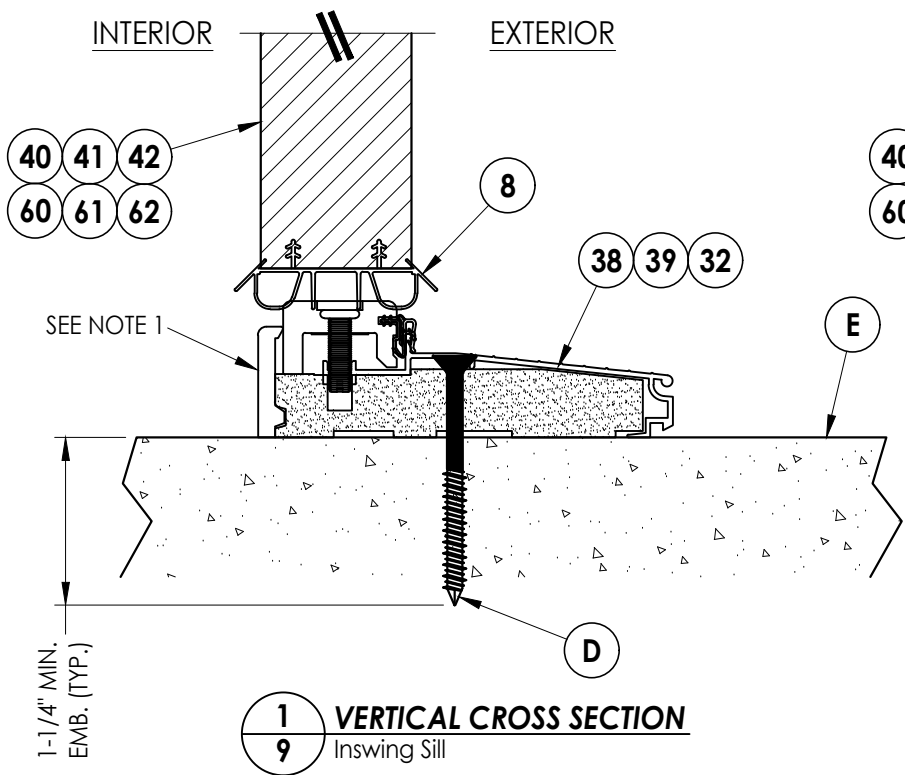

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-23507.11

SHEET 9 OF 15

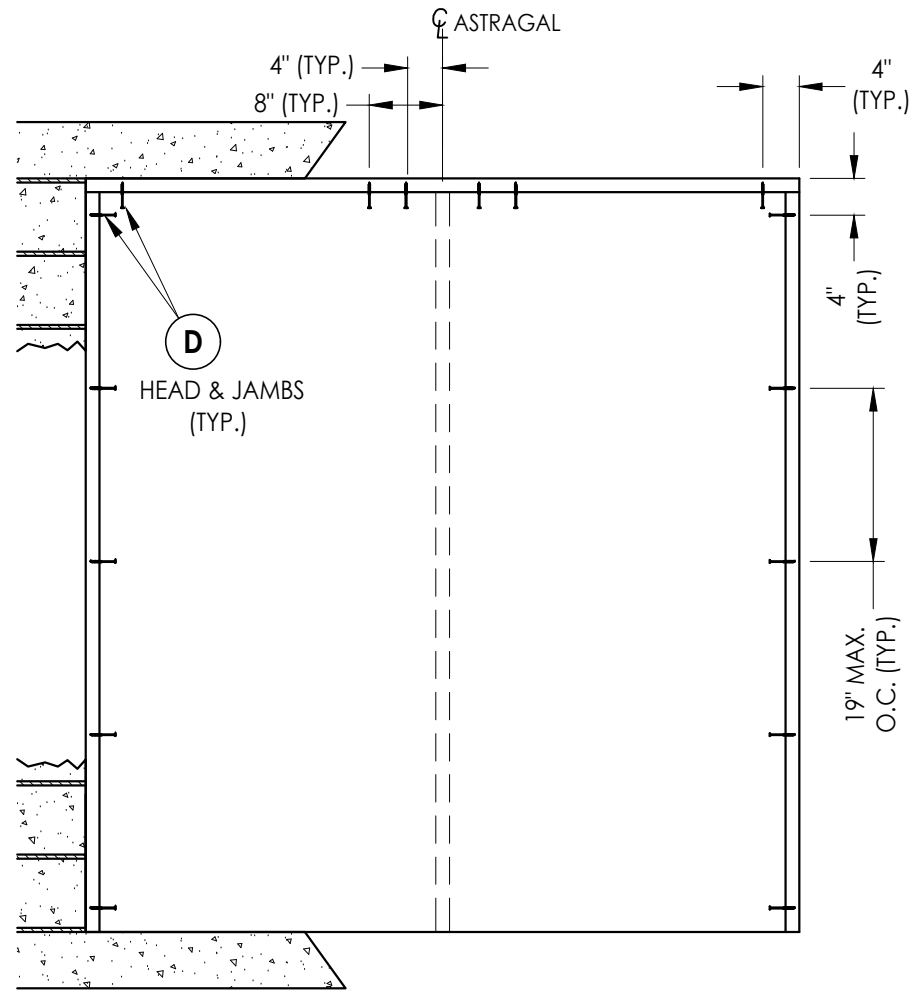

XX

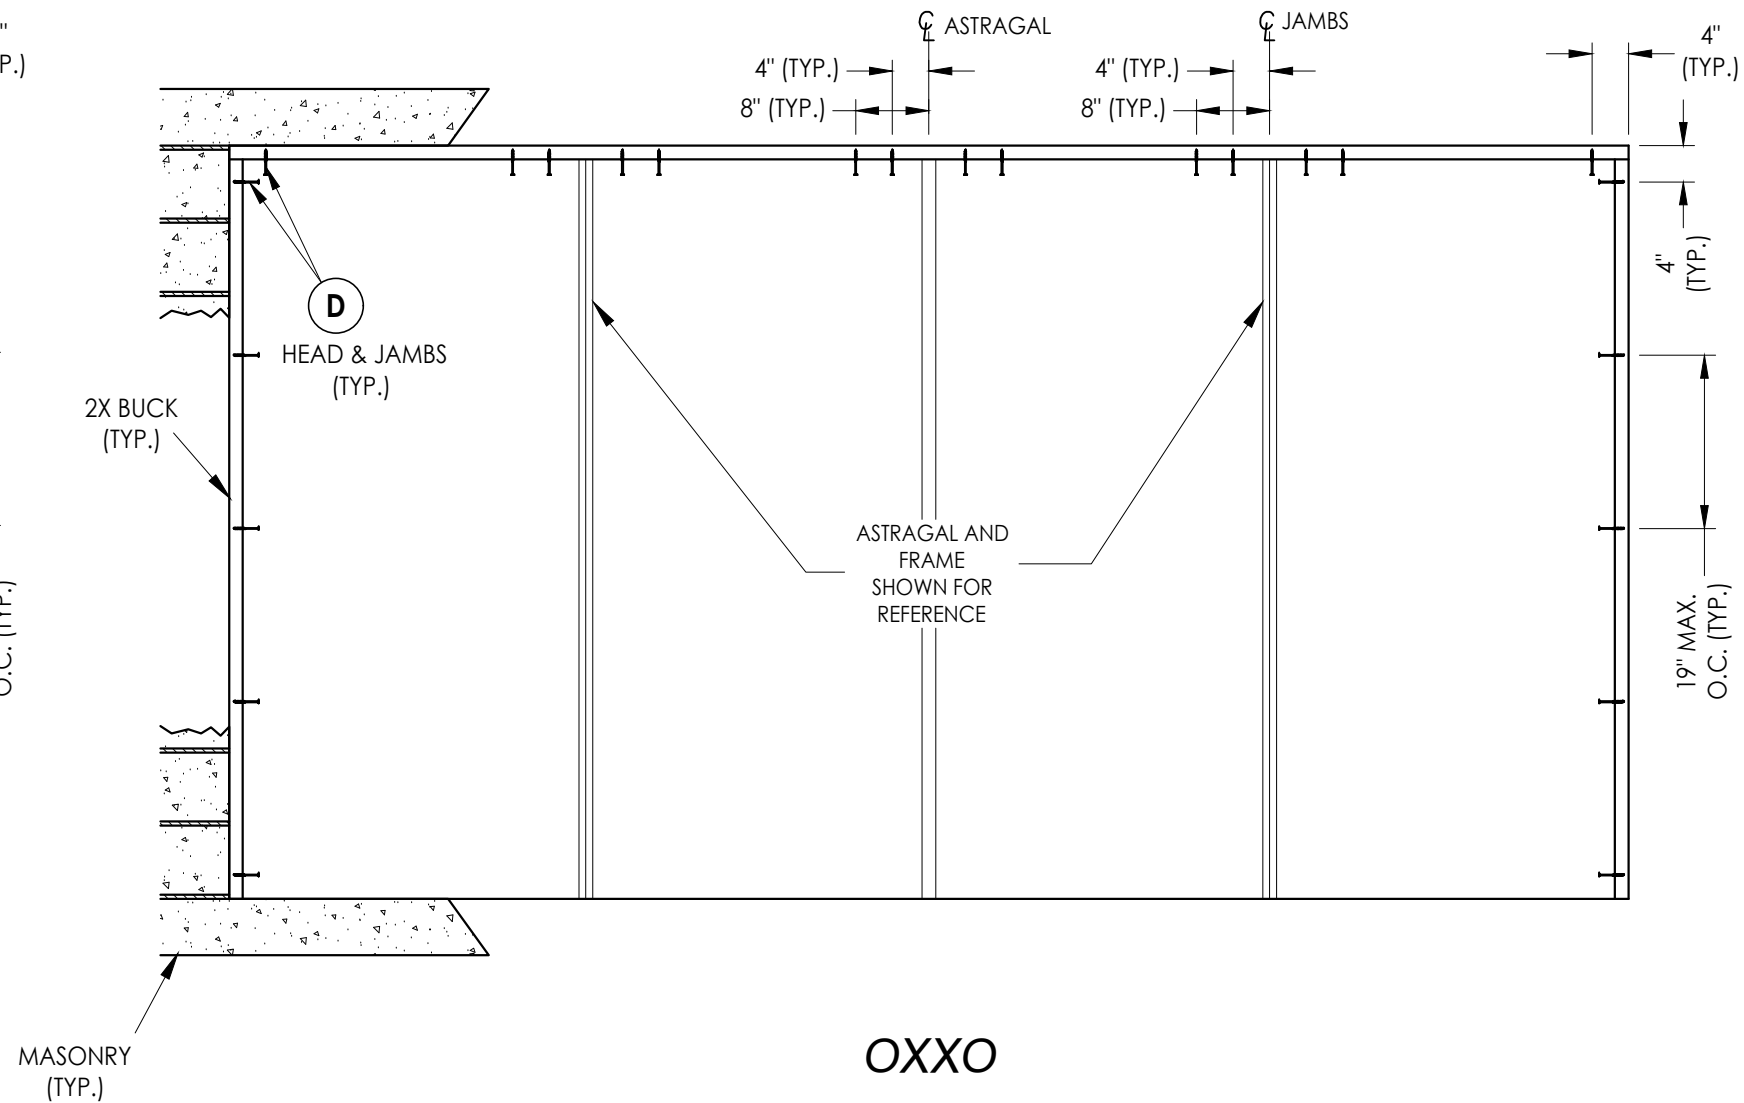

MASONRY
(TYP.)


2X BUCK ANCHORING

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^gW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507-9-11.dwg

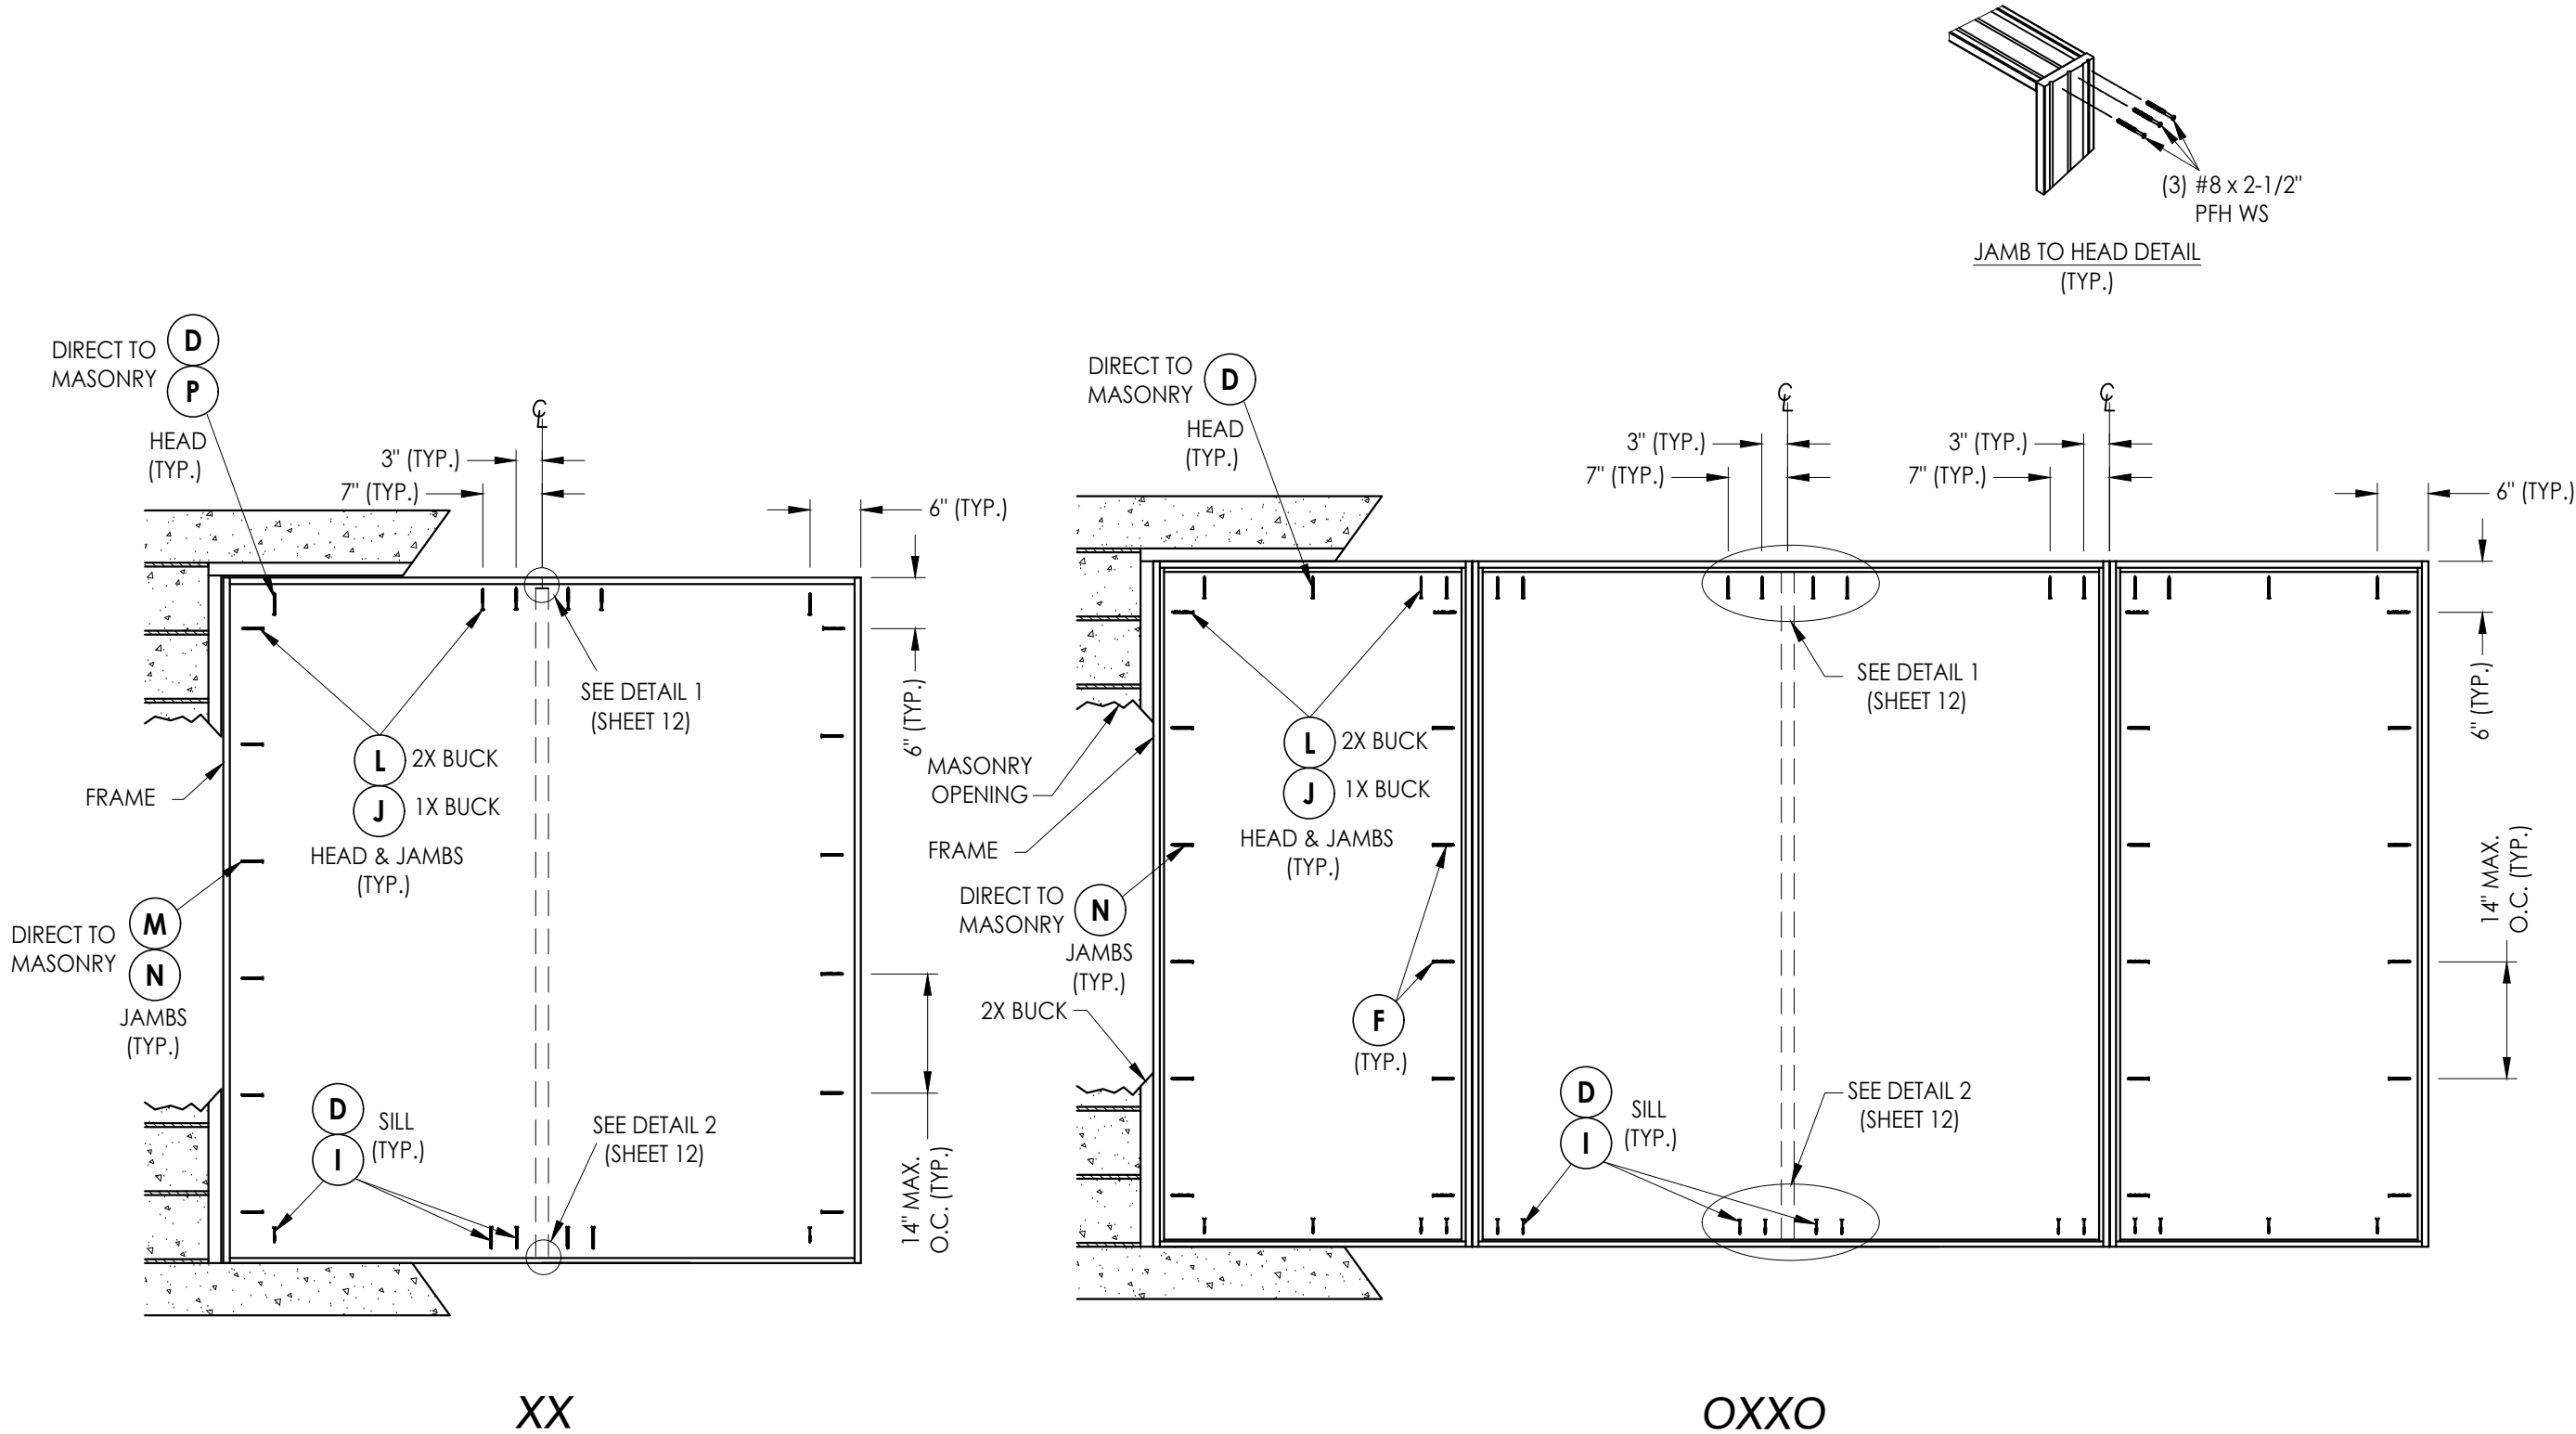


FRAME ANCHORING

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU STEEL DOOR		PART OR ASSEMBLY: FRAME ANCHORING	
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO
NO.	DATE		BY
REVISIONS			
DATE: 10/12/17			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-23507.11			
SHEET 11 OF 15			


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507-11.dwg

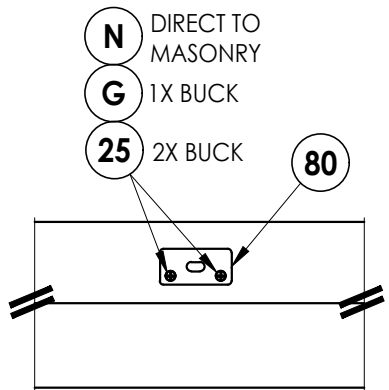


DETAIL 1
Coastal Astragal Strike Plate @ Head

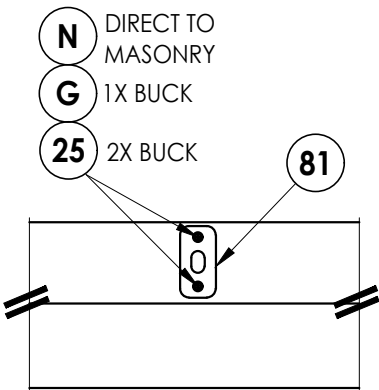


DETAIL 1
Standard Astragal Strike Plate @ Head

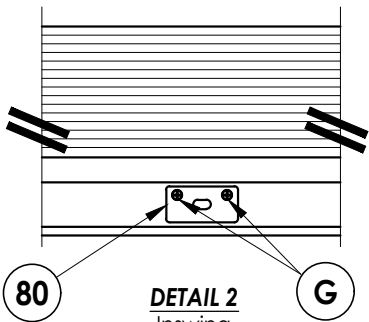


DETAIL 2
Inswing
Coastal Astragal Strike Plate @ Sill

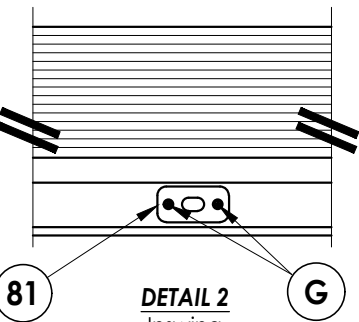


DETAIL 2
Inswing
Standard Astragal Strike Plate @ Sill

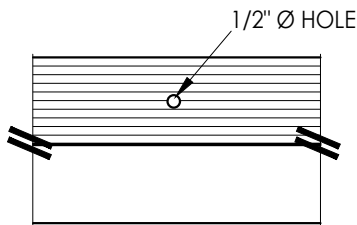


DETAIL 2
Outswing
Astragal Bolt Hole @ Sill

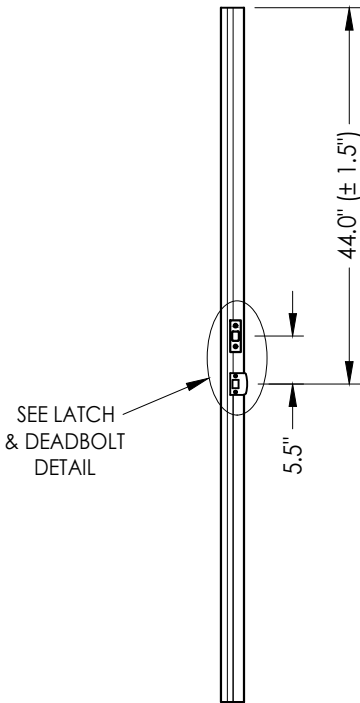


ASTRAGAL
Latch and Deadbolt

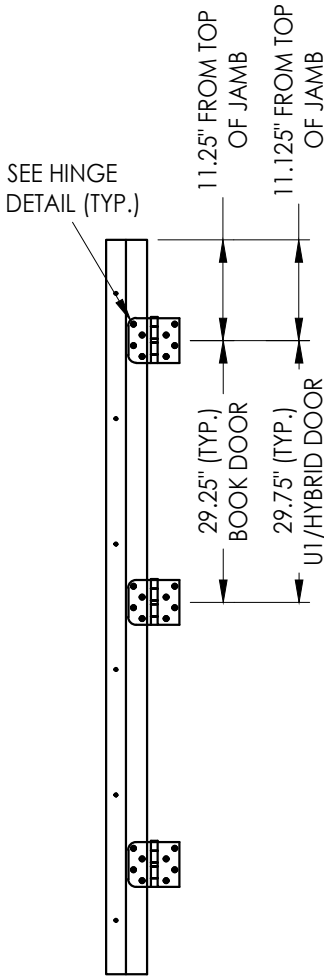

HINGE JAMB

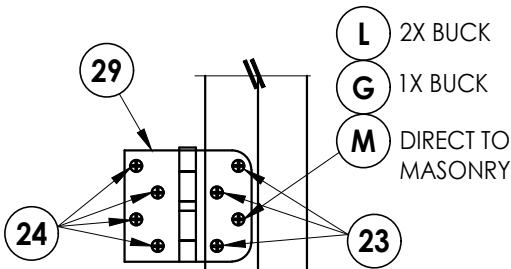

HINGE DETAIL

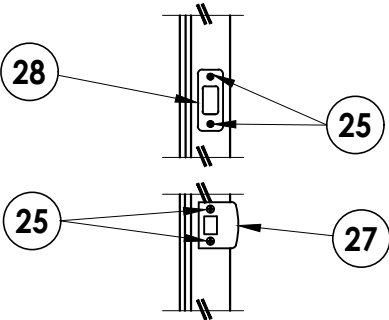

LATCH & DEADBOLT DETAIL
Schlage / Kwikset

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU STEEL DOOR
PART OR ASSEMBLY: HARDWARE DETAILS


NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-23507.11
SHEET 12 OF 15


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.9-11.dwg

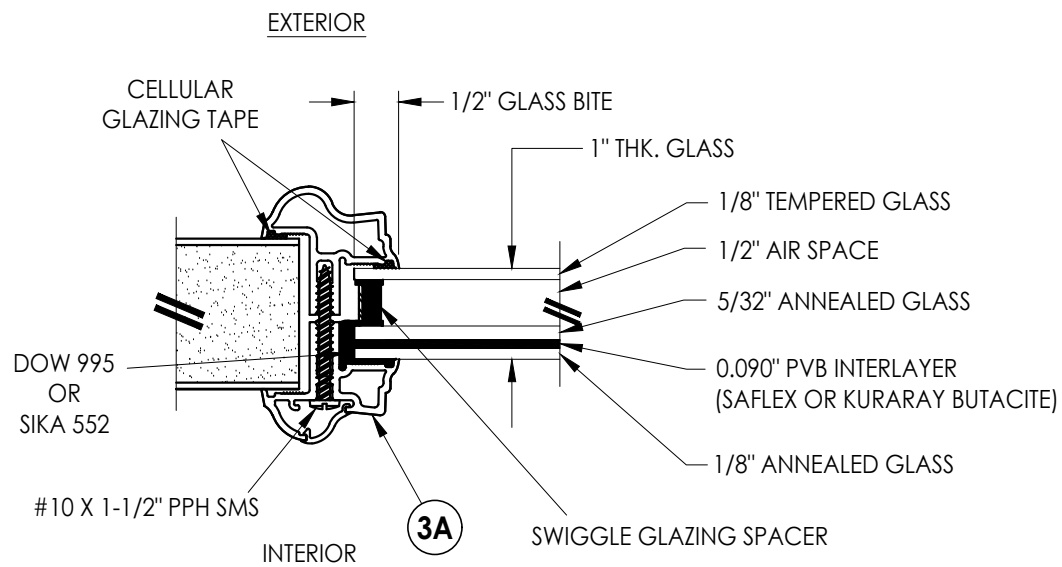


G1 GLAZING DETAIL
Aluminum Impact Lite Frame
Door Panels & Sidelites

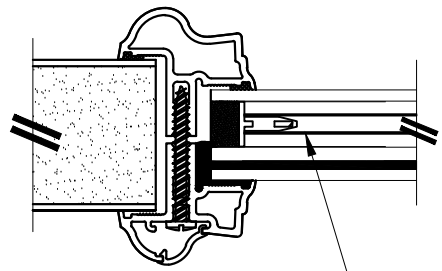


INTERNAL GRID (GBG)

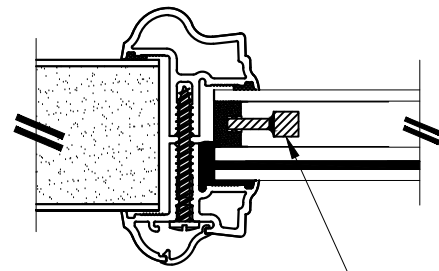

WROUGHT IRON INSERT

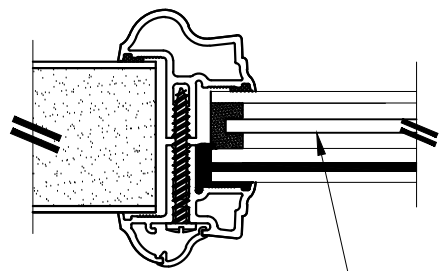


PRIVACY INSERT

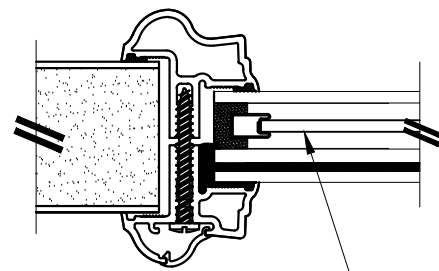


DECORATIVE INSERT

1" LAMINATED INSULATED IMPACT GLASS INSERT OPTIONS

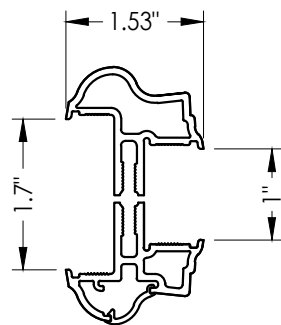

3A ALUMINUM FRAME
Aluminum Impact Lite Frame
Door Panels & Sidelites

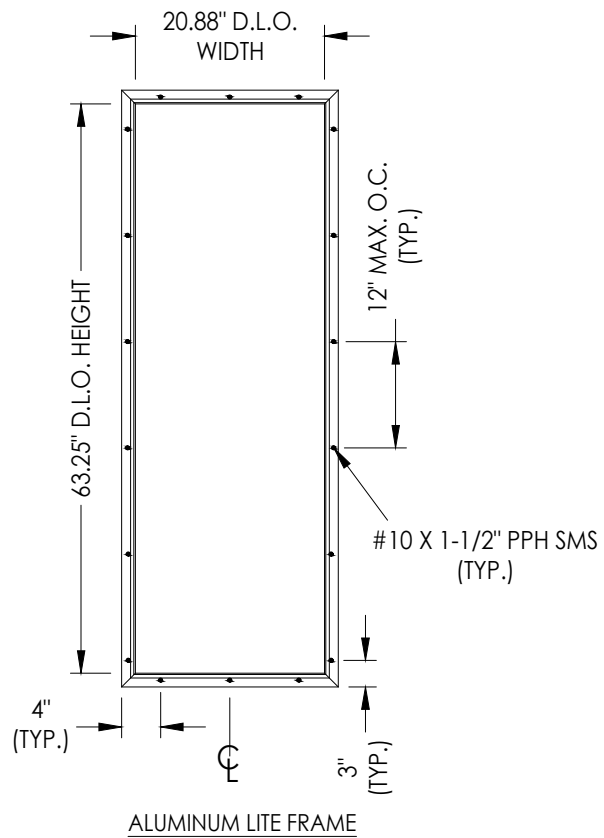

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	THERMA-TRU STEEL DOOR		
	PART OR ASSEMBLY:		
		GLAZING DETAILS	


		REVISIONS			
NO.	DATE	DESCRIPTION	BY	CHK.	DATE
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
1	7/15/20	UPDATE TO 7th ED (2020)	FBC	PO	

DATE:	10/12/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-23507.11
SHEET	13 OF 15


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.9-11.dwg

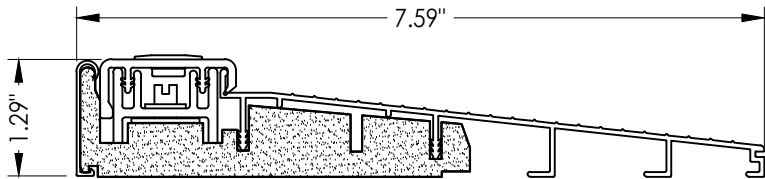


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

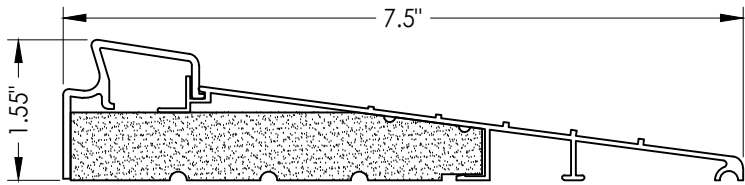


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

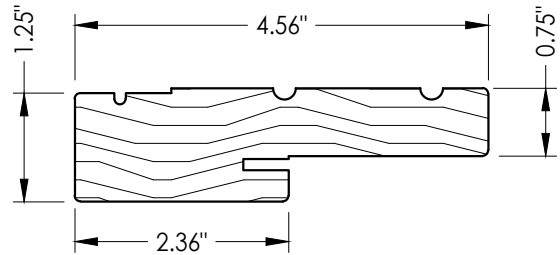


1 WOOD JAMB

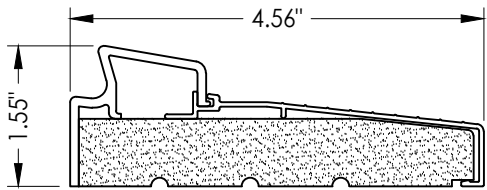


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

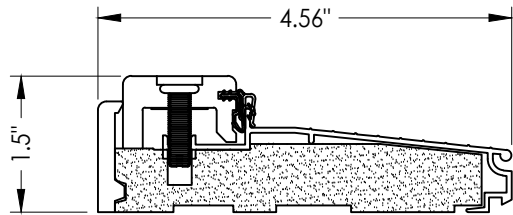


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

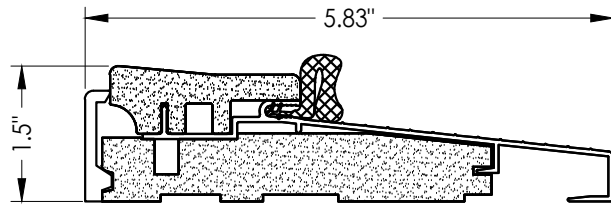


16 OUTSWING THRESHOLD
Composite Sill

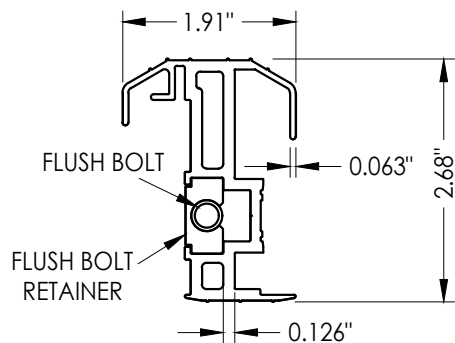


20 COASTAL ALUMINUM ASTRAGAL

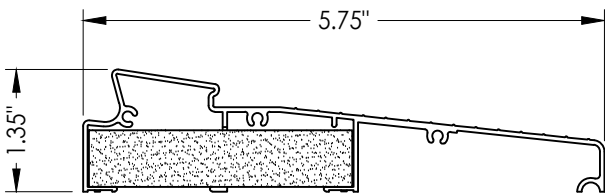


34 INSWING THRESHOLD
Inswing Moderate Climate Sill 1-3/8"

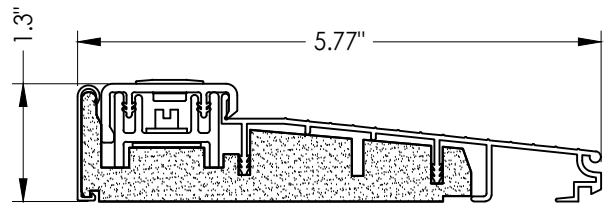


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

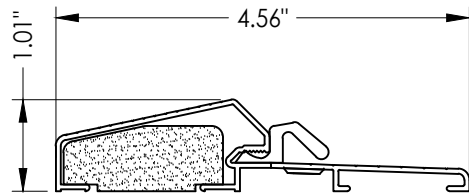


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

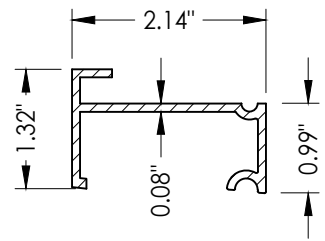


77 SIDELITE SPACER
Inswing Moderate Climate Threshold

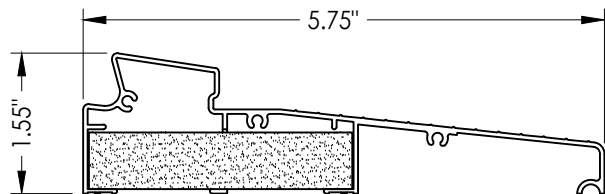


35 INSWING THRESHOLD
Inswing Moderate Climate Sill

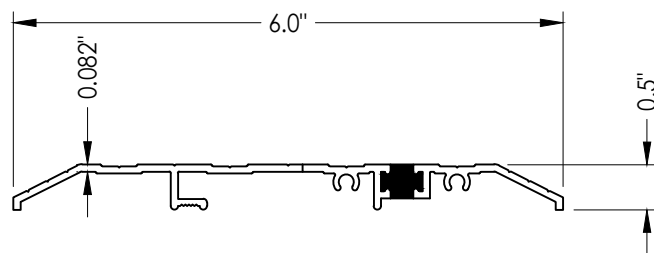


15 PUBLIC ACCESS THRESHOLD

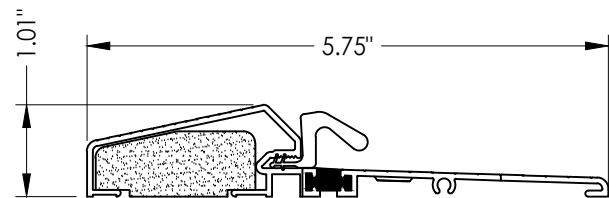


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)




76 SIDELITE SPACER
Outswing

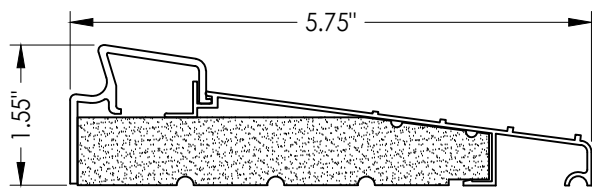


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

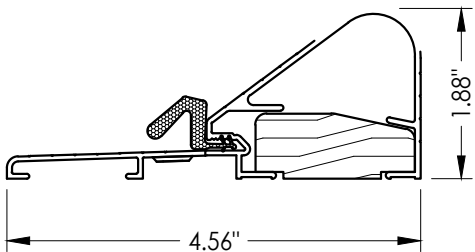


31 OUTSWING
Threshold coastal




8 SWEEP



9 SWEEP



10 SWEEP

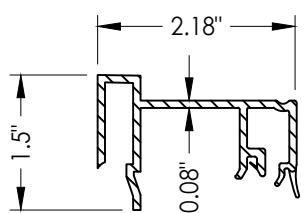

75 SIDELITE SPACER
Inswing

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO
NO.	DATE	BY

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-23507.11

SHEET 14 OF 15

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	29	4" X 4" HINGE	STEEL
F	#10 X 2" PFH WOOD SCREW	STEEL	31	OUTSWING THRESHOLD	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	34	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	35	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
P	1/4" X 2-3/4" PFH DeWALT CONCRETE SCREW	STEEL	38	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	39	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	40	DOOR PANEL (BOOK) - "PROFILES" SERIES	-
7	WEATHERSTRIP (LONG REACH)	FOAM	41	DOOR PANEL (HYBRID) - "PROFILES" SERIES	-
8	SWEEP	VINYL	42	DOOR PANEL (U1) - "PROFILES" SERIES	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	50	SIDELITE (FULL LITE)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	60	DOOR PANEL (BOOK) - "TRADITIONS" SERIES	-
11	#10 X 1-3/4" PFH WOOD SCREW	STEEL	61	DOOR PANEL (HYBRID) - "TRADITIONS" SERIES	-
15	PUBLIC ACCESS THRESHOLD	ALUM	62	DOOR PANEL (U1) - "TRADITIONS" SERIES	-
16	OUTSWING THRESHOLD	ALUM/COMP	75	SIDELITE SPACER (INSWING)	PVC
17	OUTSWING THRESHOLD	ALUM/COMP	76	SIDELITE SPACER (OUTSWING)	PVC
18	OUTSWING THRESHOLD	ALUM/COMP	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
19	STANDARD ALUMINUM ASTRAGAL	ALUM	80	COASTAL ASTRAGAL STRIKE PLATE	STEEL
20	COASTAL ALUMINUM ASTRAGAL	ALUM			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:
1. Concrete anchor locations at the corners may be adjusted.

CORROSION RESISTANCE - SALTWATER ENVIRONMENT
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

PRODUCT:		THERMA-TRU STEEL DOOR		R^gW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
DOCUMENTS PREPARED BY:		Lyndon F. Schmidt P.E. No. 43409			
PART OR ASSEMBLY:		BILL OF MATERIALS			
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
1	7/15/20	UPDATE TO 7th ED (2020)	FBC	PO	
NO.	DATE			BY	
					REVISIONS
DATE: 10/12/17					
SCALE: N.T.S.					
DWG. BY: JK					
CHK. BY: LFS					
DRAWING NO.: FL-23507.11					
SHEET 15 OF 15					