



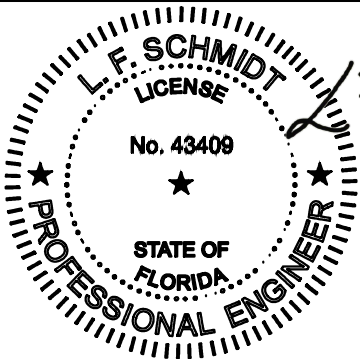

Digitally signed by
Lyndon F Schmidt
Date: 2026.08.07
16:22:56 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA




XX

WOOD EDGE
GLAZED STEEL DOUBLE DOOR
w/ or w/out SIDELITES
INSWING/OUTSWING
"IMPACT"

GENERAL NOTES

1. This product evaluation drawing has been developed in compliance with the 9th Edition (2026) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the FBC and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets the water infiltration requirements for the "HVHZ".
8. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.

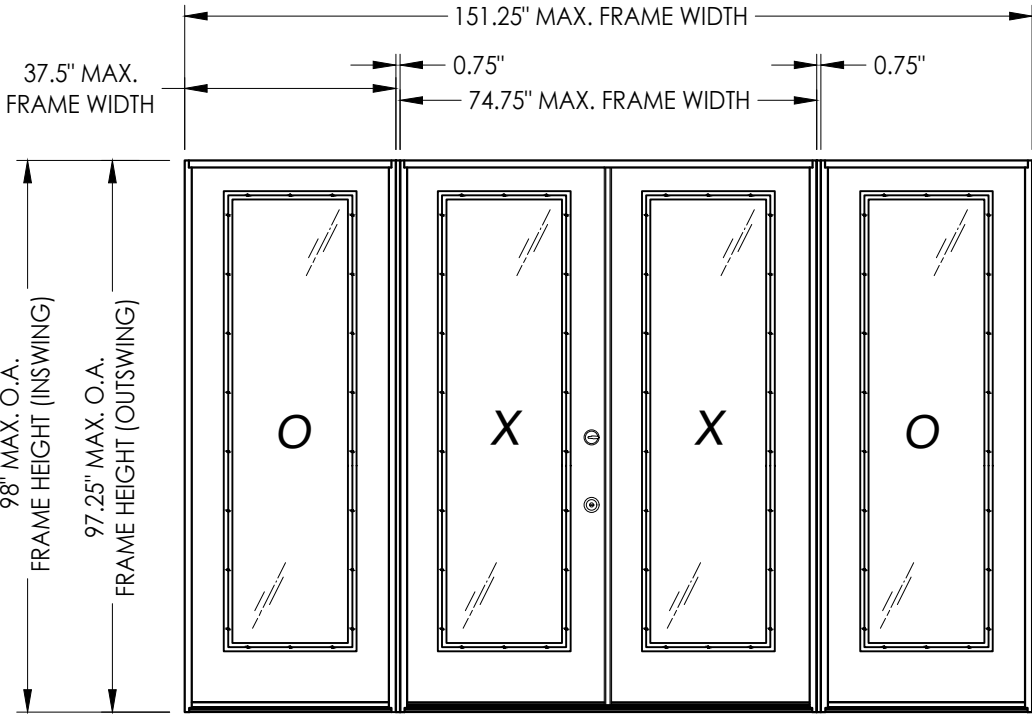

OXXO

TABLE OF CONTENTS			
SHEET#	DESCRIPTION	SHEET#	
1	Typical Elevations, Design Pressures & General Notes	8	Vertical Cross Sections (Thresholds)
2	Door Panel Details	9	Buck Anchoring
3	Sidelite Panel Details	10	Frame Anchoring
4	Elevations	11	Hardware Details
5	Horizontal & Vertical Cross Sections (2X Buck)	12	Glazing Details
6	Horizontal & Vertical Cross Sections (1X Buck)	13	Components
7	Horizontal & Vertical Cross Sections (Direct to Masonry)	14	Bill of Materials

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XX, OXXO	+47.0	-50.0	+47.0	-47.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

3

7/02/26

UPDATE TO 9TH ED. (2026)

FBC

LFS

2

8/17/23

UPDATE TO 8TH ED. (2023)

FBC

LFS

1

7/15/20

UPDATE TO 7th ED (2020)

FBC

PO

NO.

DATE

BY

REVISIONS

DATE: 8/02/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:
FL-23507.14


SHEET 1 OF 14

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

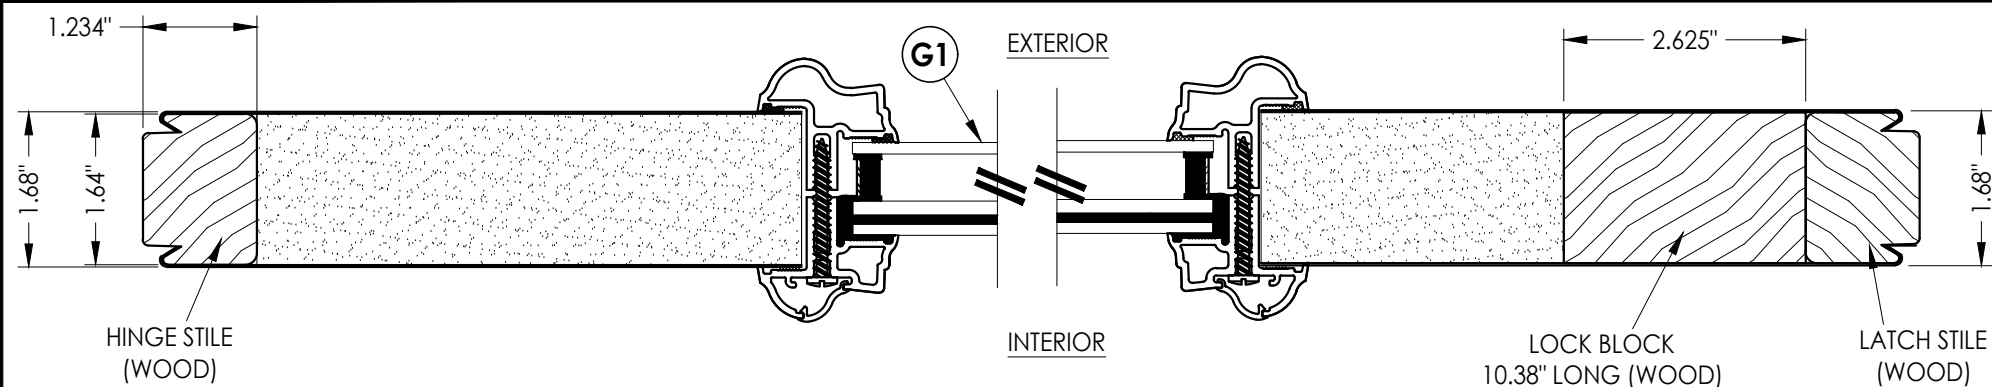


1
2 **HORIZONTAL CROSS SECTION**

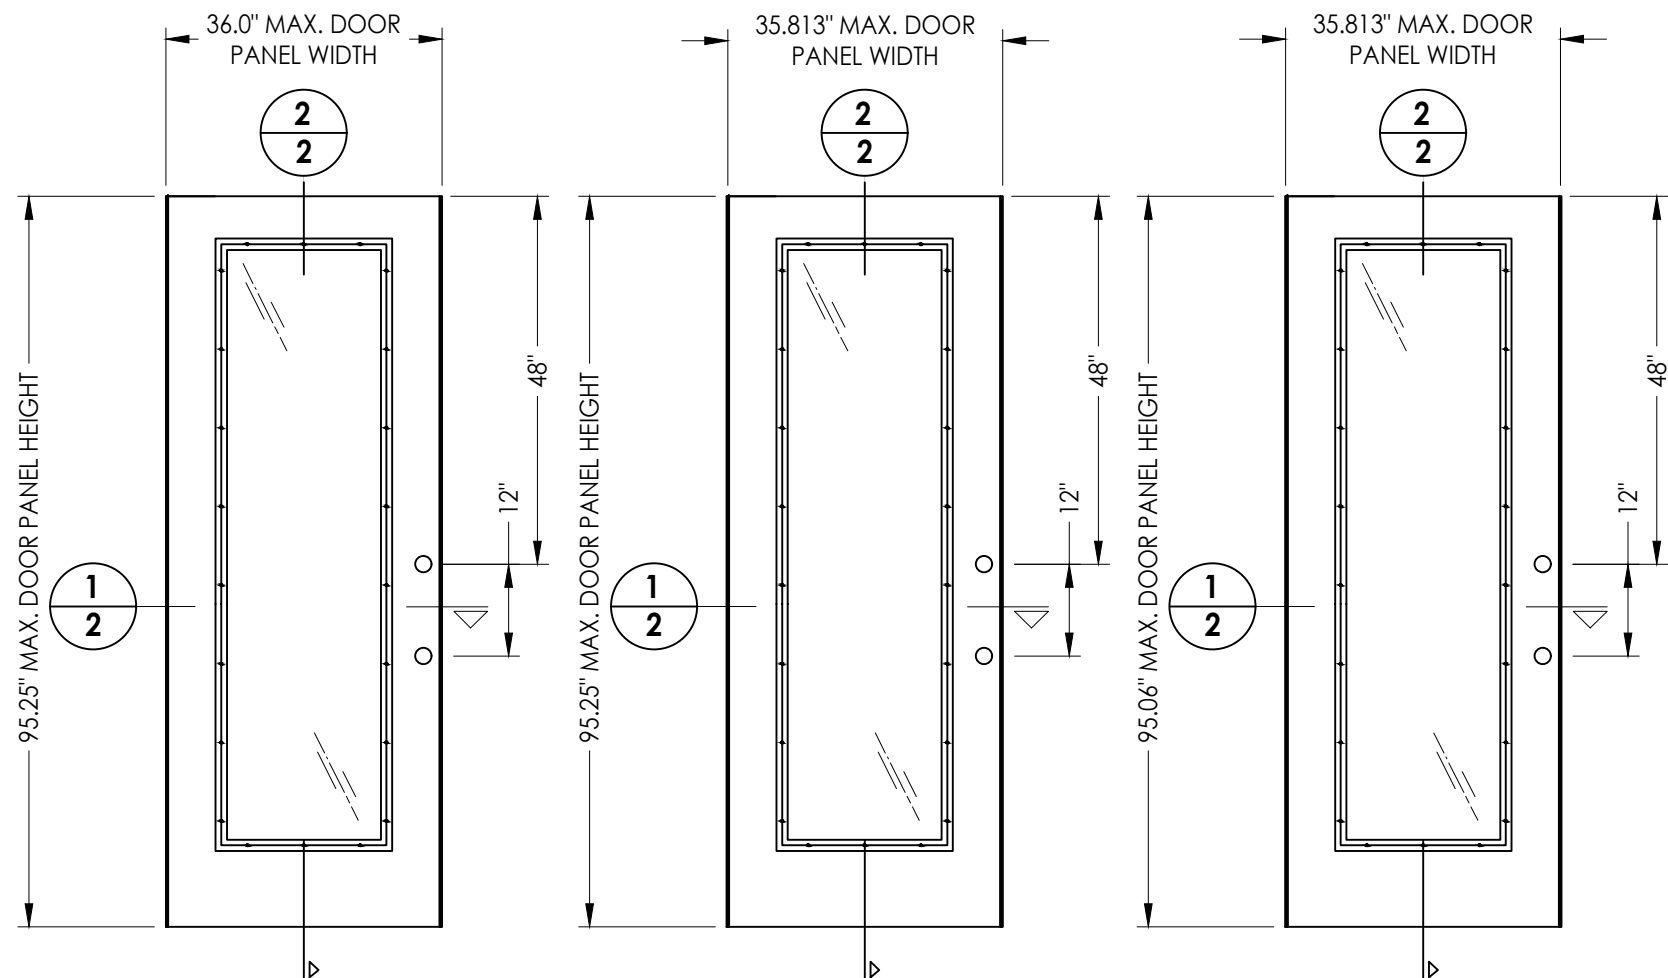

40 **DOOR PANEL**
BOOK

41 **DOOR PANEL**
Hybrid Door

42 **DOOR PANEL**
U1 Door

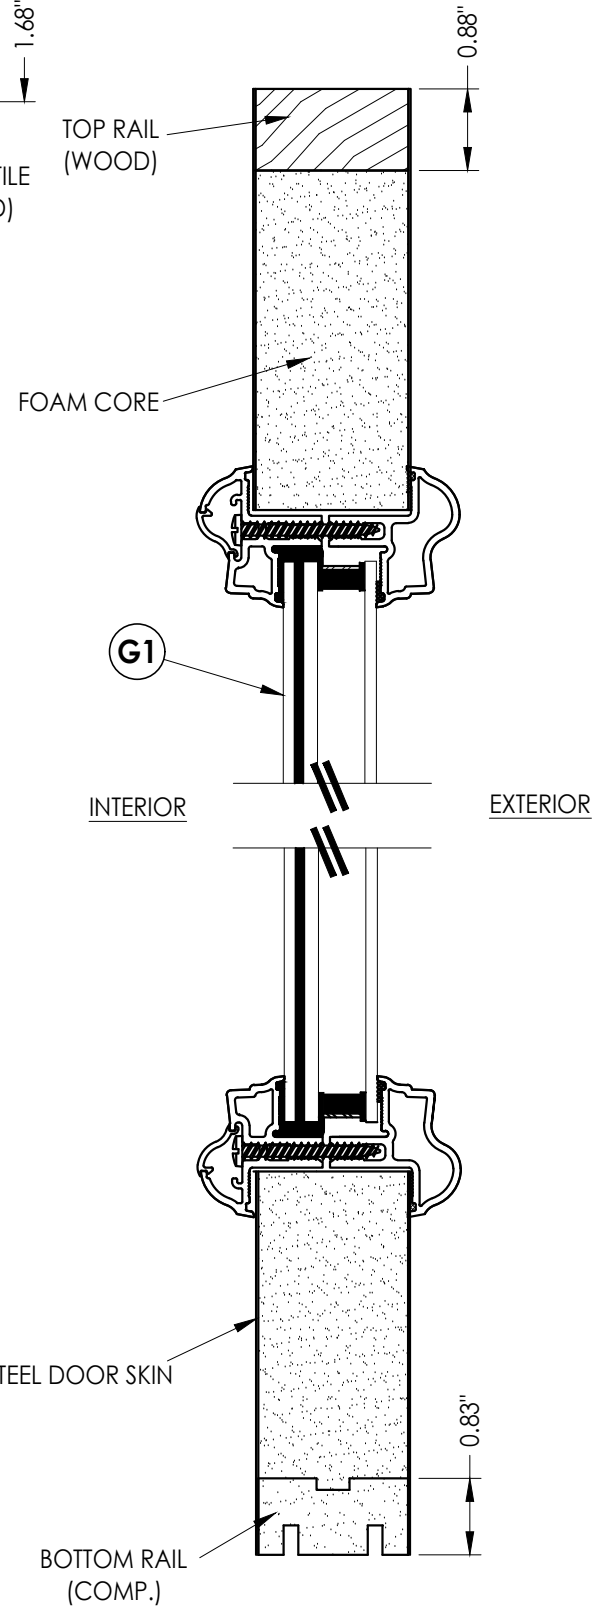

2
2 **VERTICAL CROSS SECTION**

"TRADITIONS" SERIES DOOR PANEL

STEEL DOOR SKIN: 24 GA. (0.022" MIN. THICKNESS, F_y = 48,470 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	THERMA-TRU STEEL DOOR	
	PART OR ASSEMBLY: "TRADITIONS" DOOR PANEL DETAILS	

NO.	DATE	REVISIONS			
		BY	PO	LFS	FBC
3	7/02/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
2	8/17/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
1	7/15/20	UPDATE TO 7th ED	(2020)	FBC	PO

DATE: 10/12/17

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-23507.14

SHEET 2 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

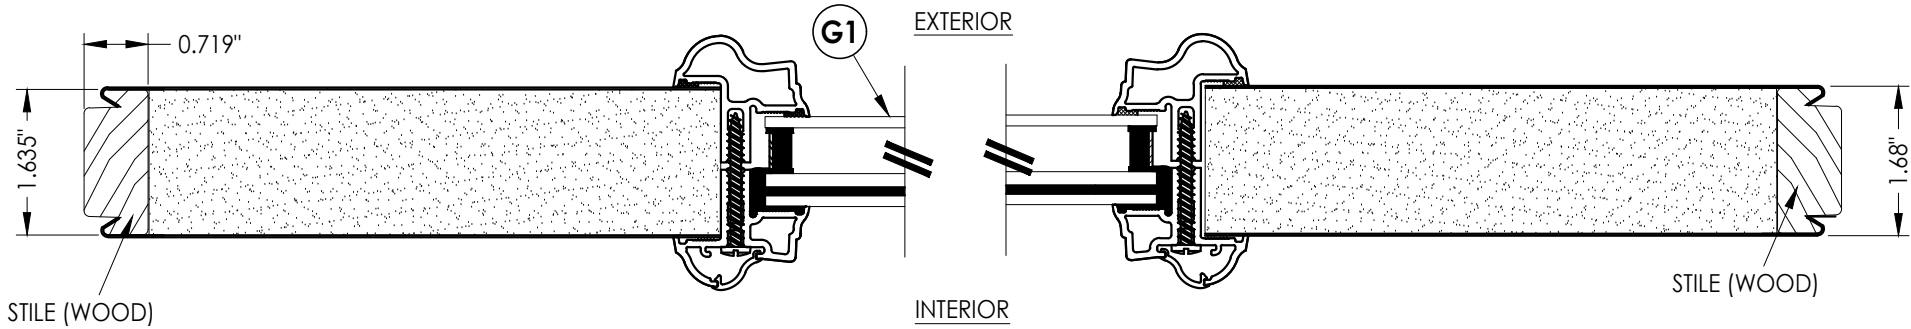


1
3 HORIZONTAL CROSS SECTION

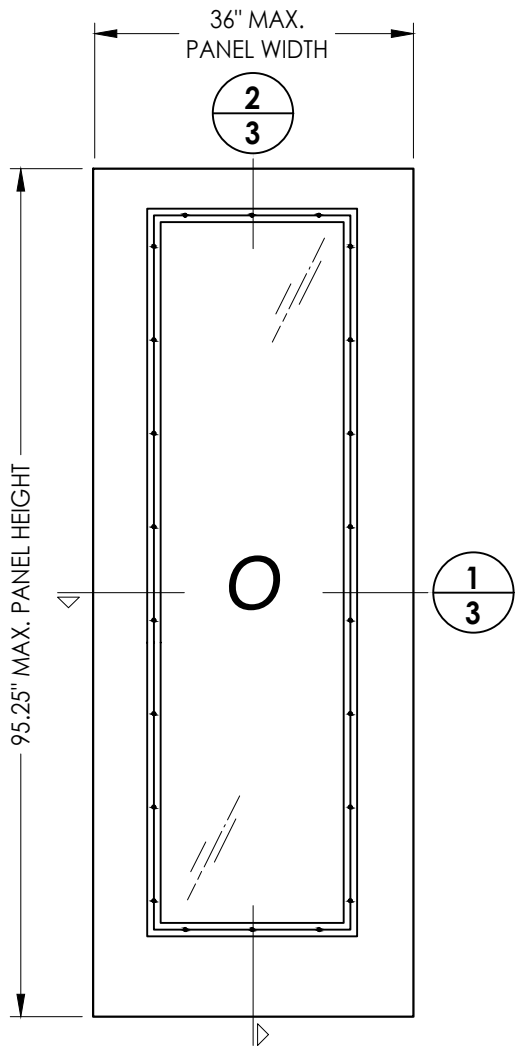

50 SIDELITE PANEL

SIDELITE PANEL

STEEL SKIN "TRADITIONS": 24 GA. (0.022" MIN. THICKNESS, Fy = 48,470 PSI MIN.)
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

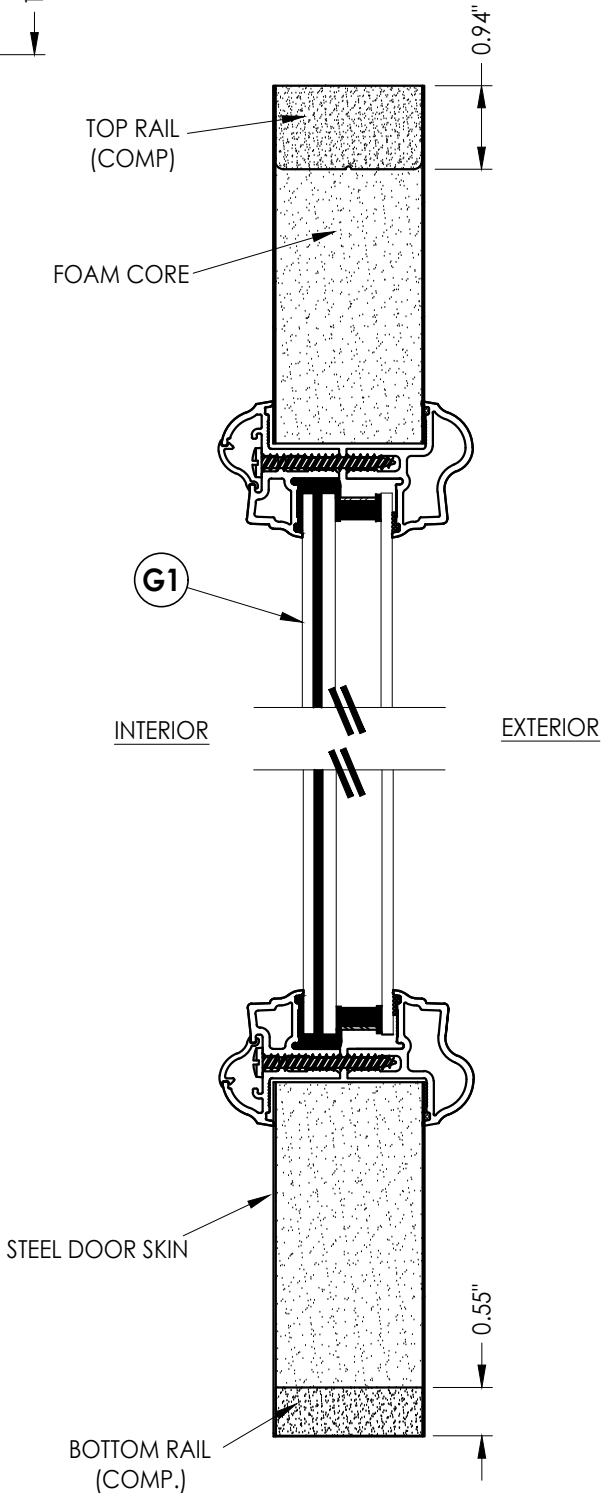

2
3 VERTICAL CROSS SECTION

REVISIONS			
NO.	DATE	PO	BY
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-23507.14




SHEET 3 OF 14

PRODUCT:	
THERMA-TRU STEEL DOOR	
PART OR ASSEMBLY:	
SIDELITE PANEL DETAILS	

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

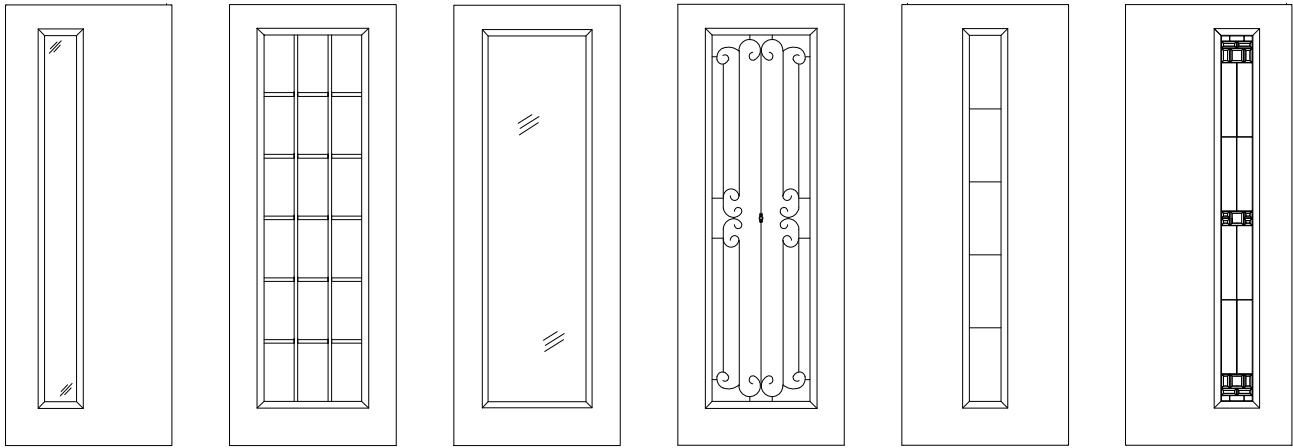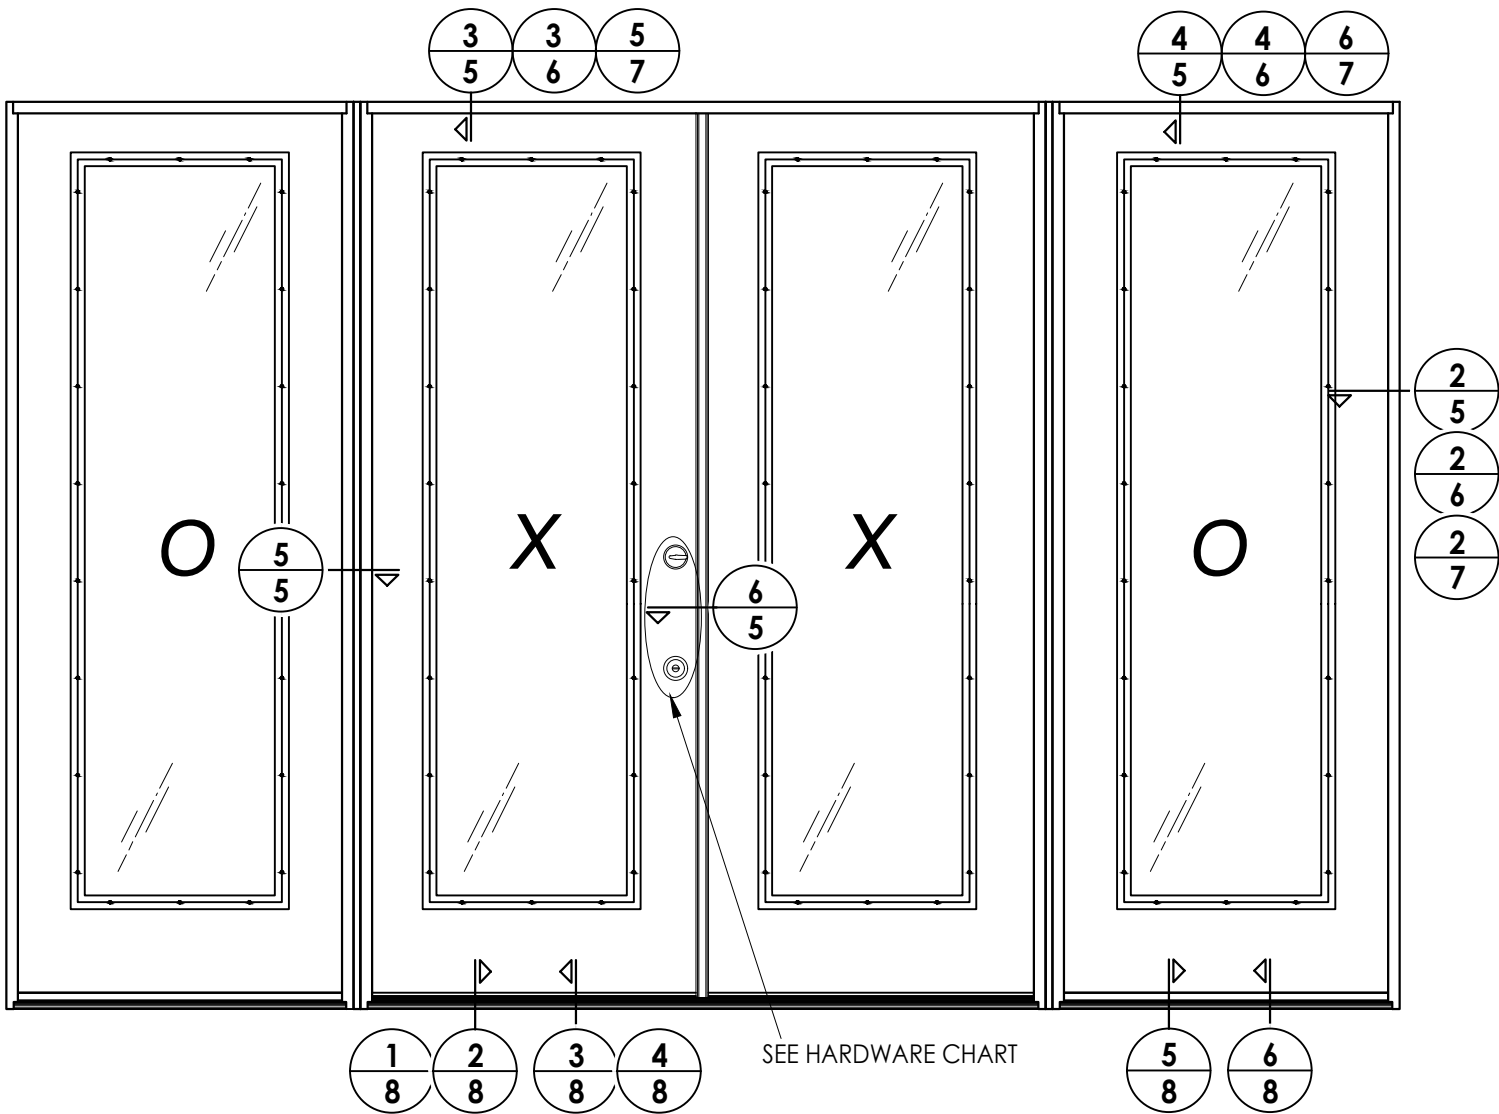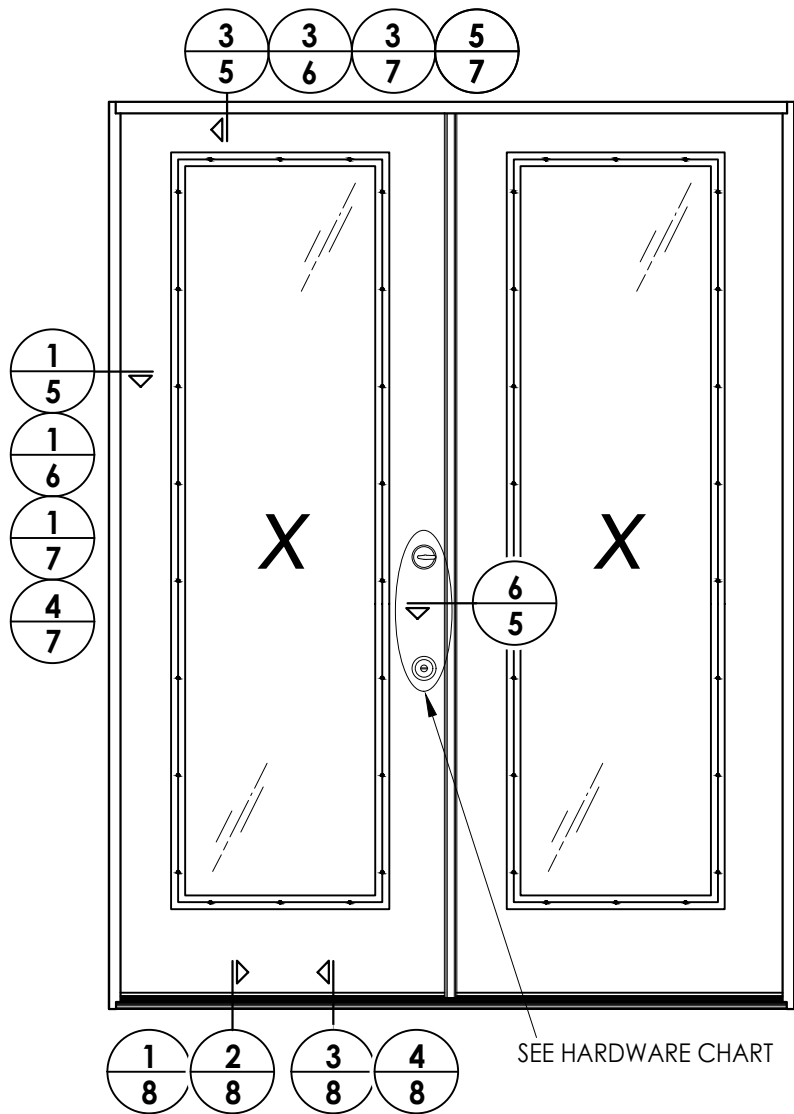


Traditions Door Panel Options

Panel options shown are for illustration and are representative only
(similar glazed panel configurations are allowed)


HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	Knob:	F51
	Deadbolt:	B60
KWIKSET	Knob:	SIGNATURE SERIES
	Deadbolt:	SIGNATURE SERIES (980)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813				
PRODUCT: THERMA-TRU STEEL DOOR		PART OR ASSEMBLY: ELEVATIONS				
		3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
		2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
		1	7/15/20	UPDATE TO 7th ED (2020)	FBC	PO
		NO.	DATE			BY
REVISIONS						
DATE: 10/12/17						
SCALE: N.T.S.						
DWG. BY: JK						
CHK. BY: LFS						
DRAWING NO.: FL-23507.14						
SHEET 4 OF 14						


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

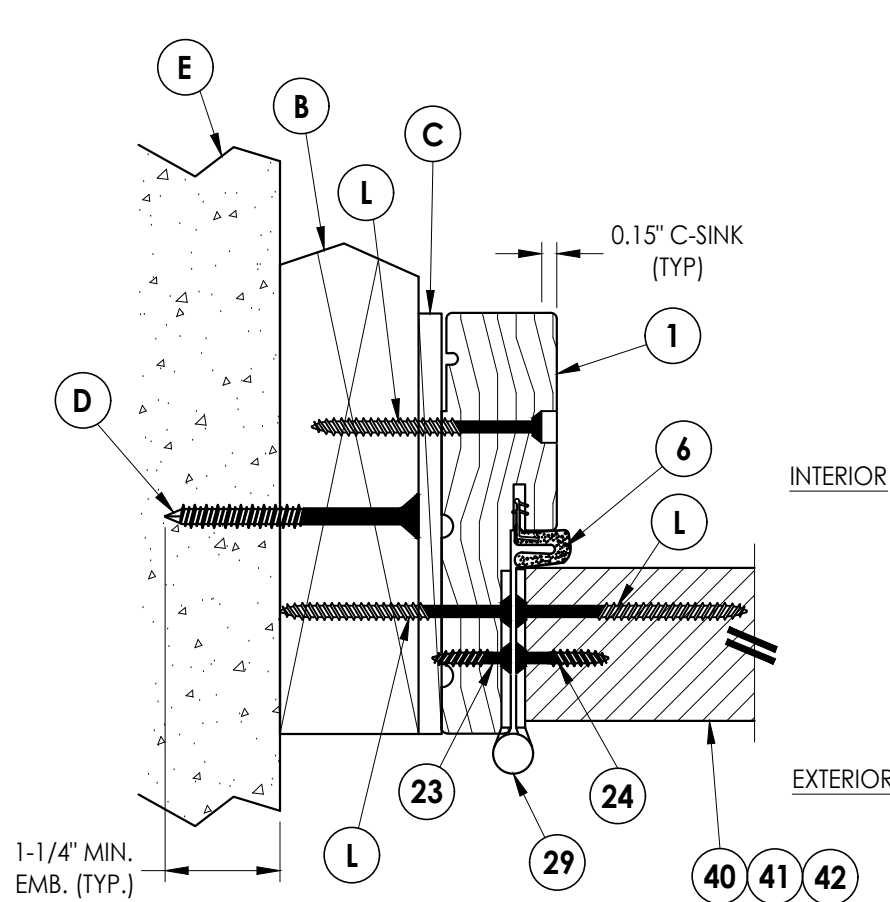


1 **HORIZONTAL CROSS SECTION**
5 Outswing shown (Inswing similar)

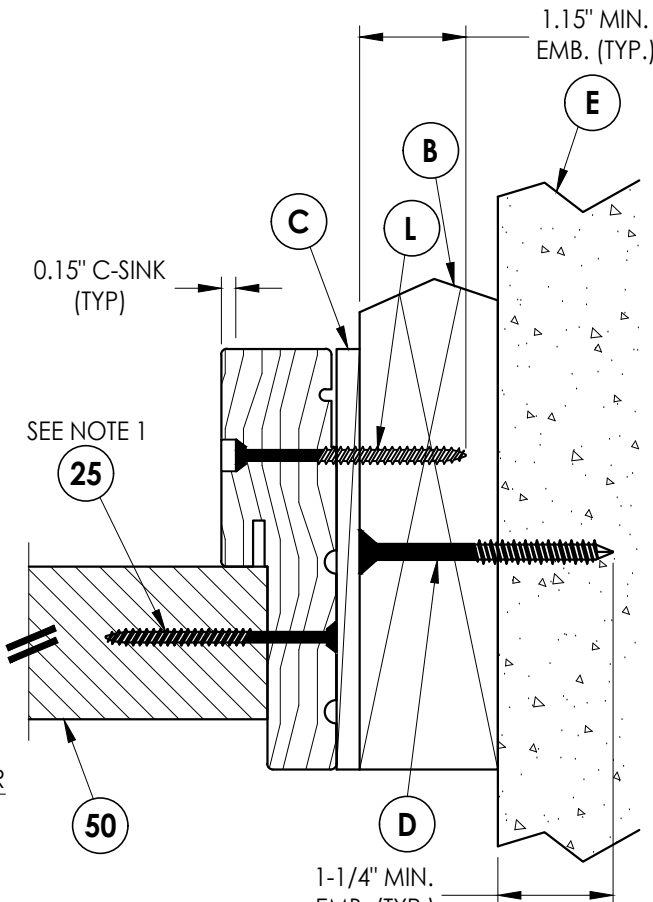


2 **HORIZONTAL CROSS SECTION**
5 Outswing shown (Inswing similar)

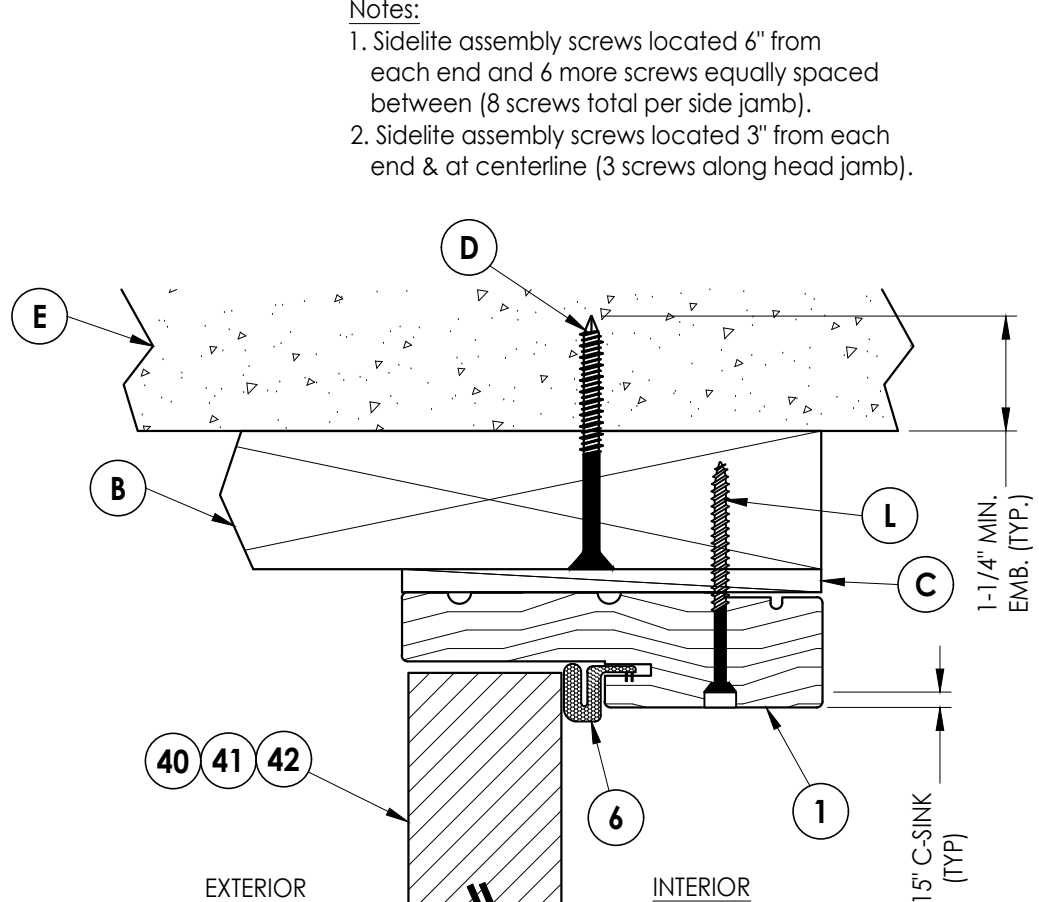


3 **VERTICAL CROSS SECTION**
5 Outswing shown (Inswing similar)

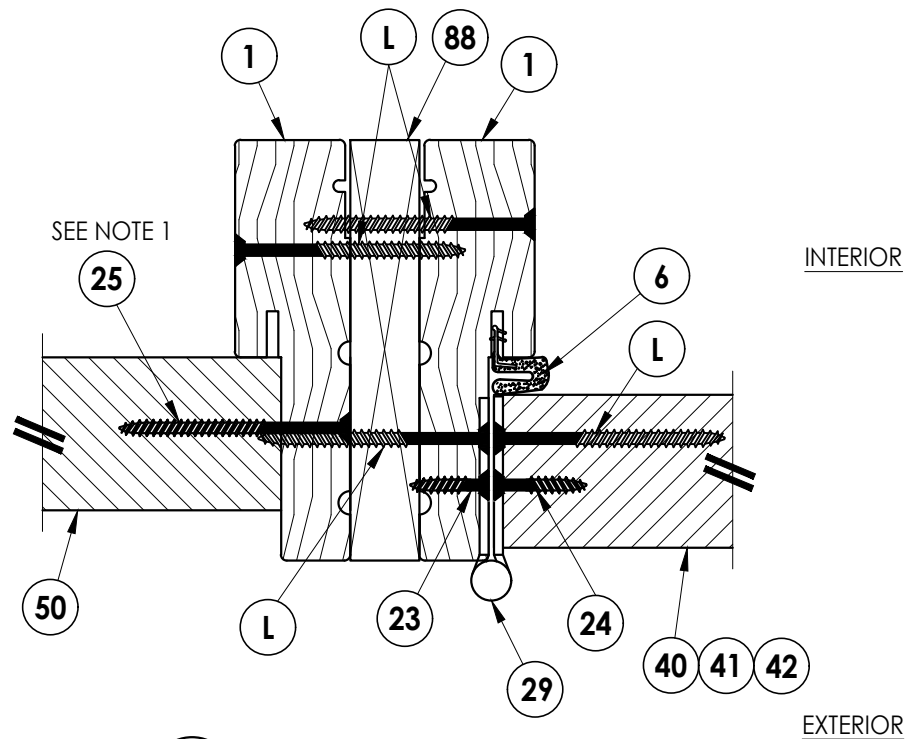

5 **HORIZONTAL CROSS SECTION**
5 Outswing shown (Inswing similar)

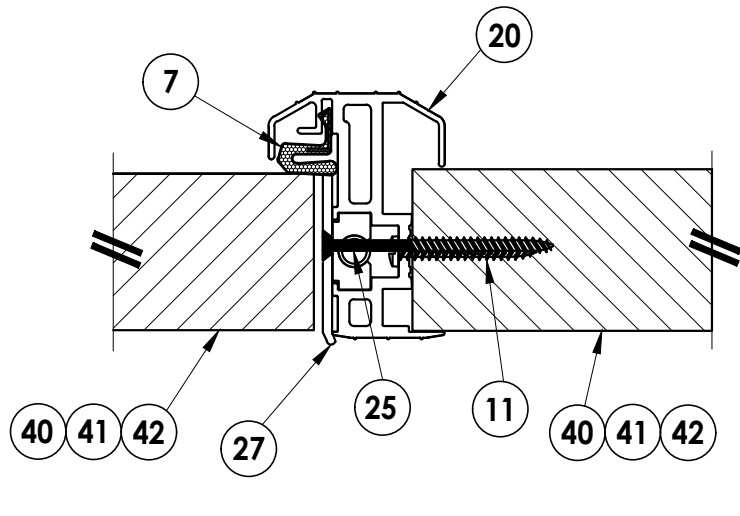

6 **HORIZONTAL CROSS SECTION**
5 Outswing shown (Inswing similar)

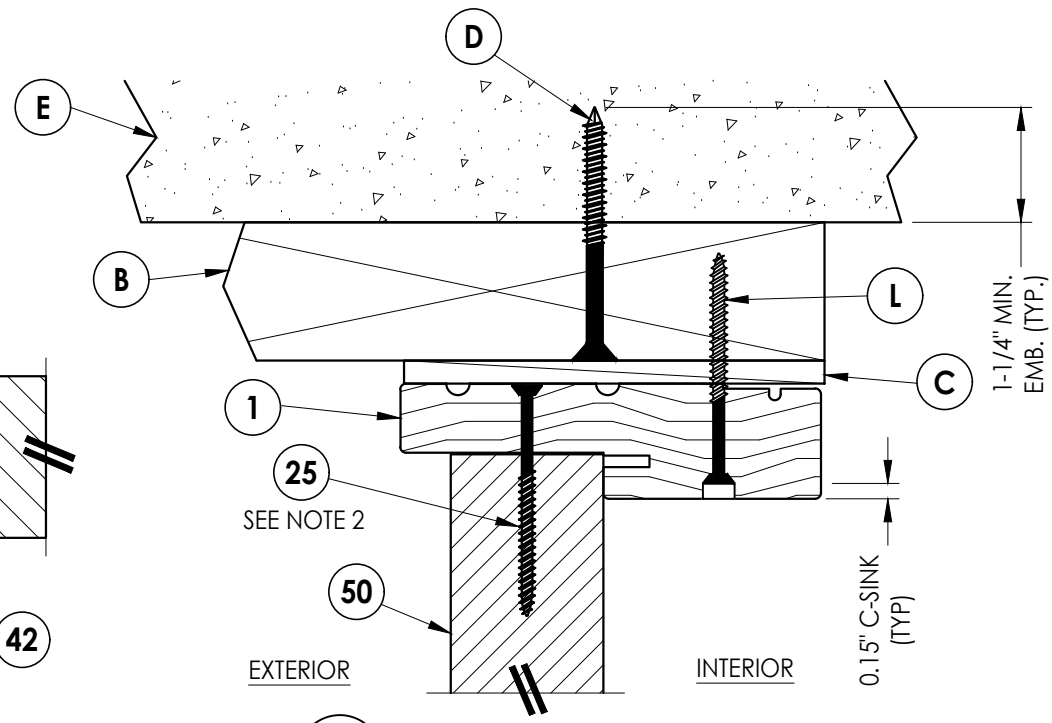

4 **VERTICAL CROSS SECTION**
5 Outswing shown (Inswing similar)

- Notes:
1. Sidelite assembly screws located 6" from each end and 6 more screws equally spaced between (8 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-23507.14

SHEET 5 OF 14


- Notes:
1. Sidelite assembly screws located 6" from each end and 6 more screws equally spaced between (8 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

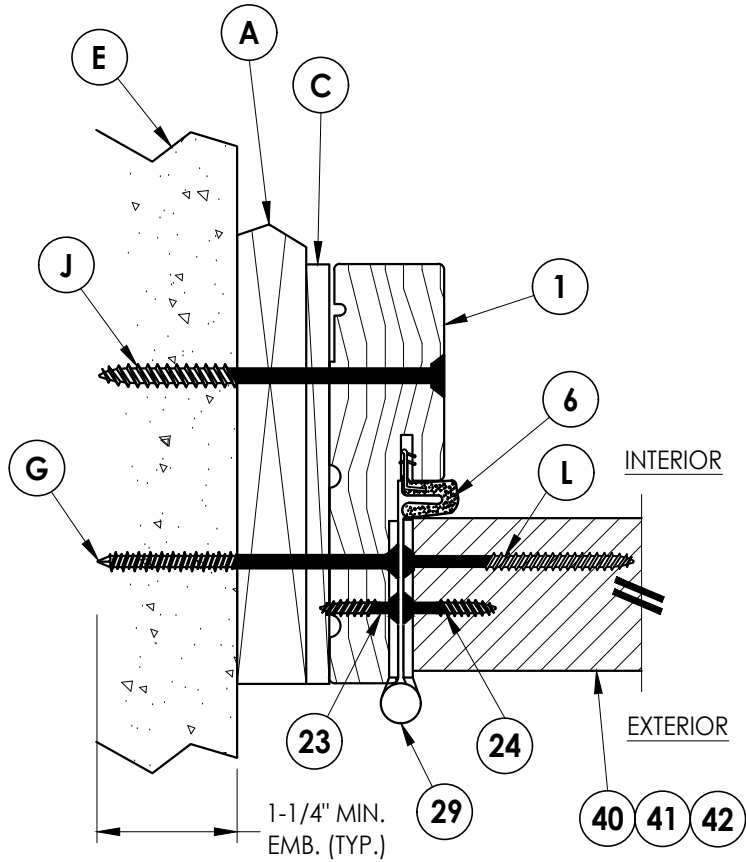


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

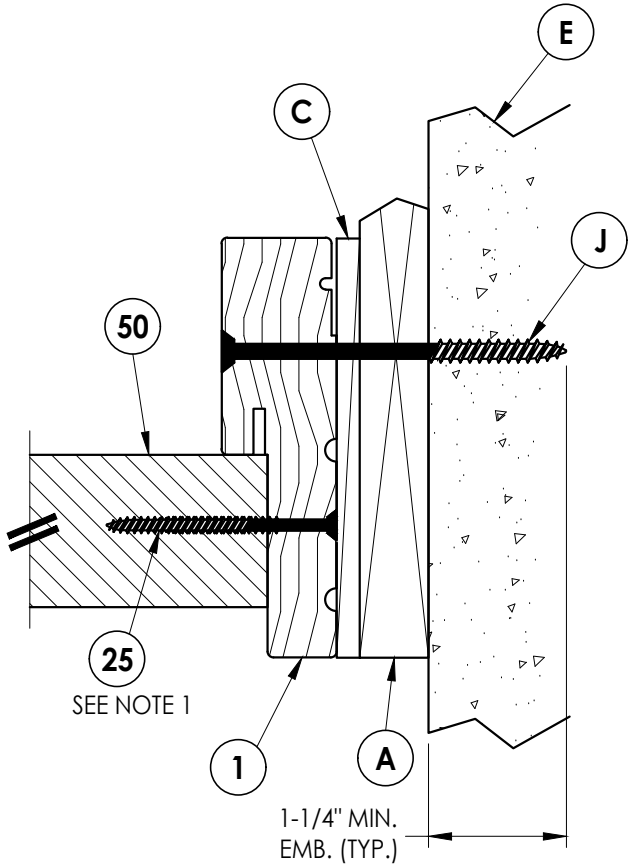

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

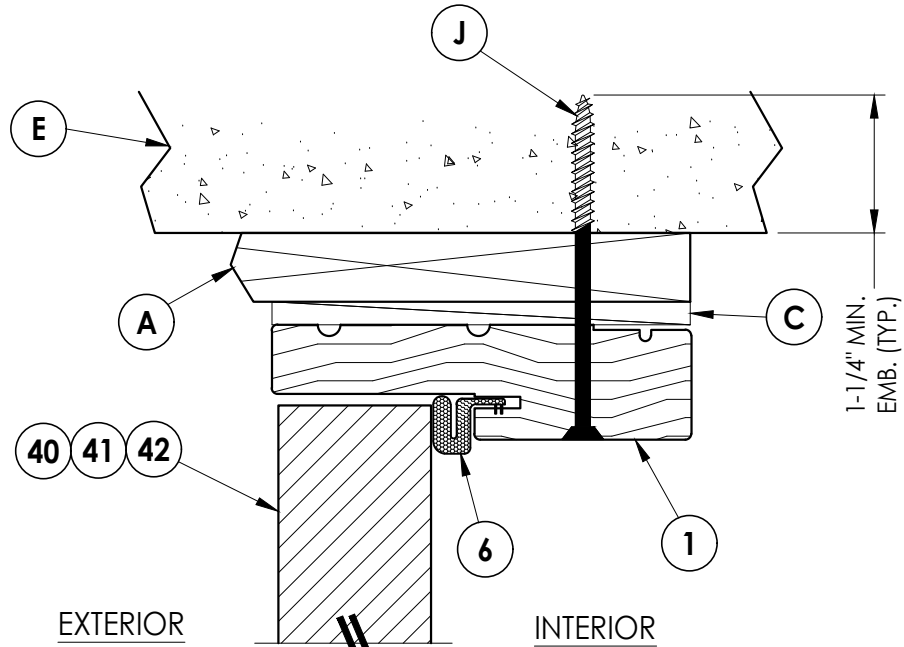

3
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

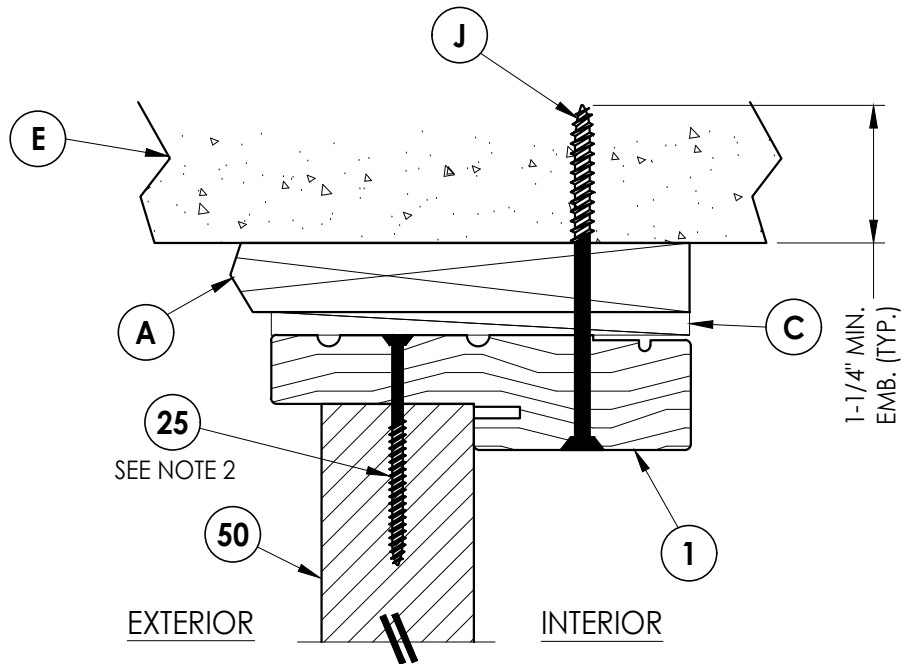

4
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)


NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.:
FL-23507.14
SHEET 6 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

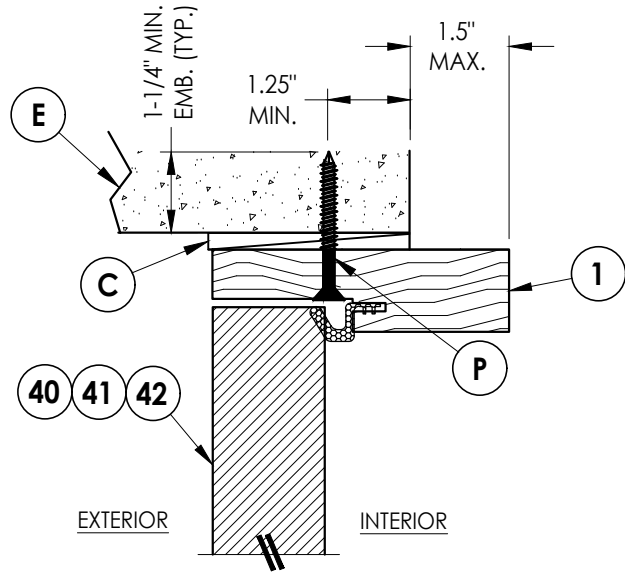

3
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

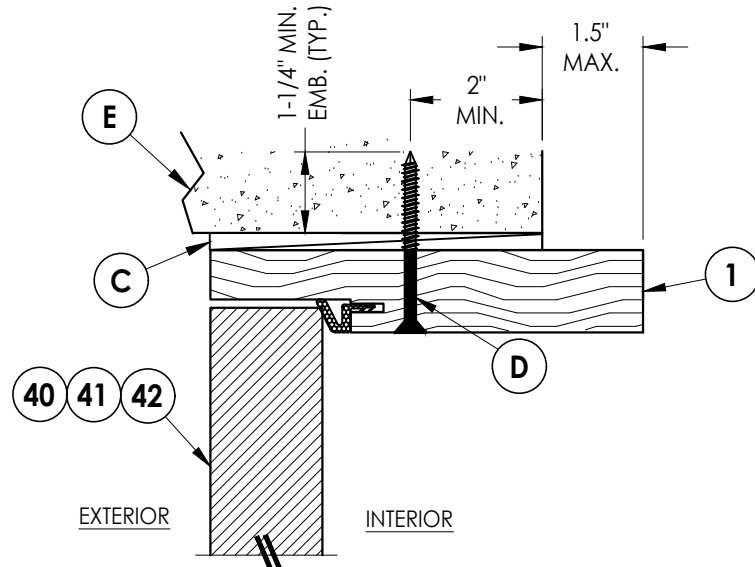


5
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

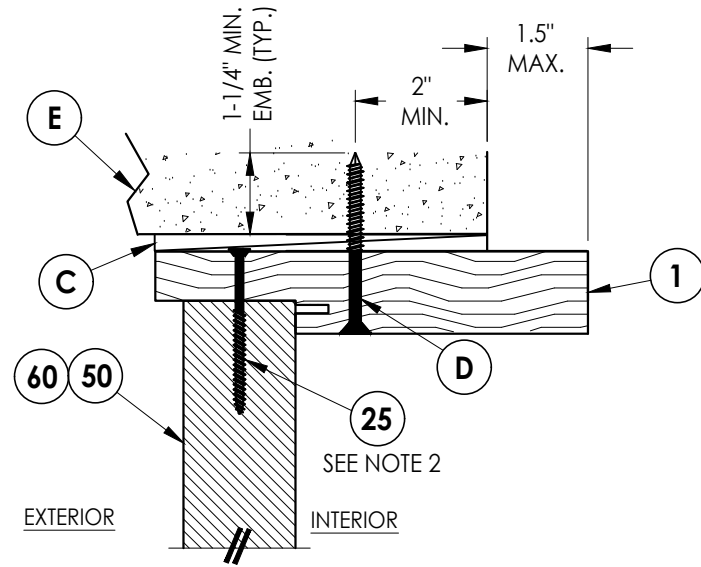


6
7 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Notes:


1. Sidelite assembly screws located 6" from each end plus 6 more equally spaced between (8 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

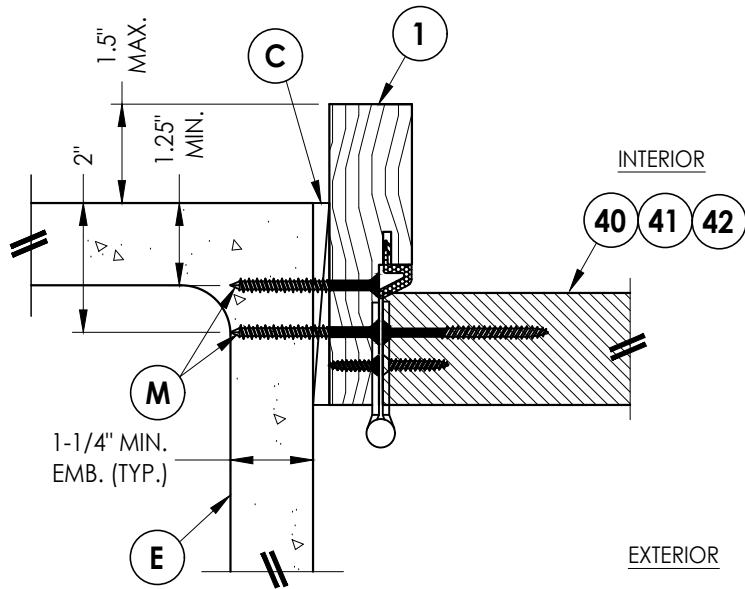

1
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Double Door Only (N/A w/ Sidelites)

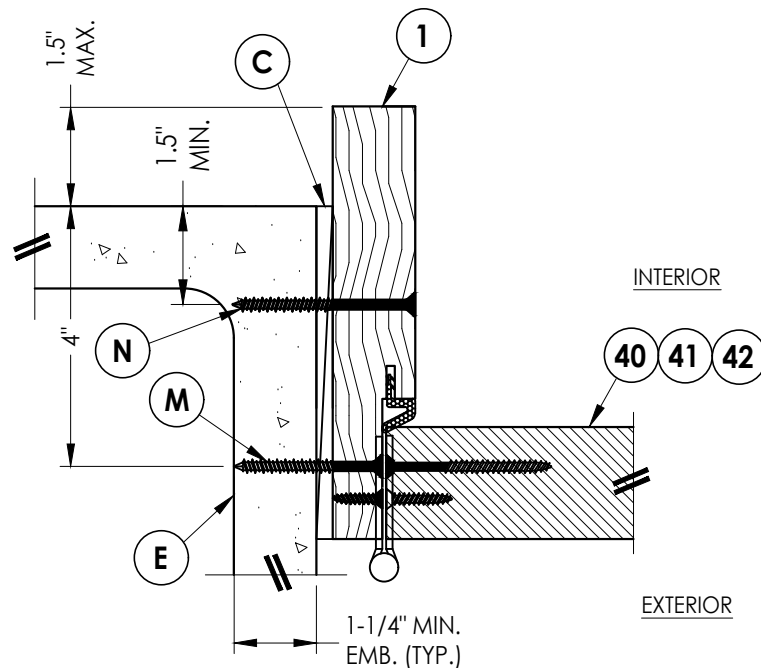

4
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

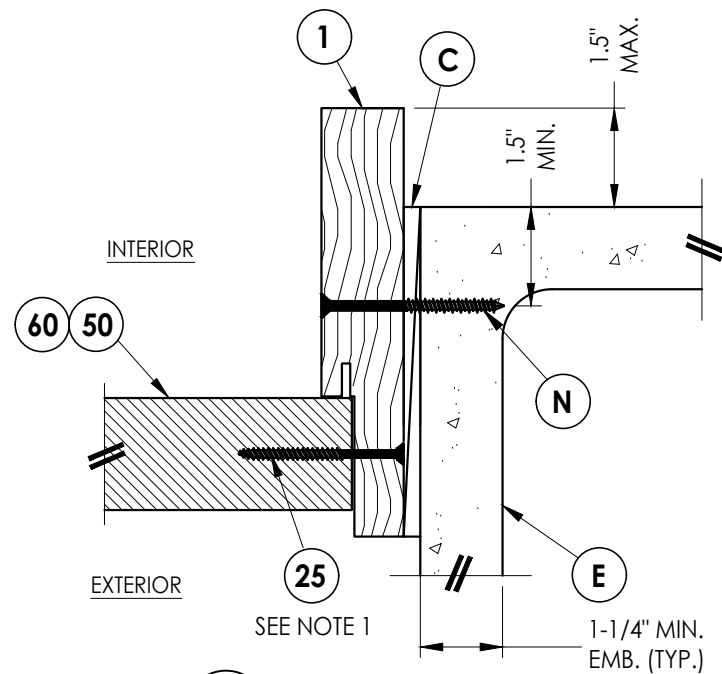

2
7 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

RW

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)







REVISIONS			
NO.	DATE	BY	
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020)	FBC PO

DATE: 8/02/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-23507.14
SHEET 7 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

Notes:

1. Sill Item #'s 17, 18, 32, 34, 35, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 16 & 33 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph screws at each end.
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along sill).

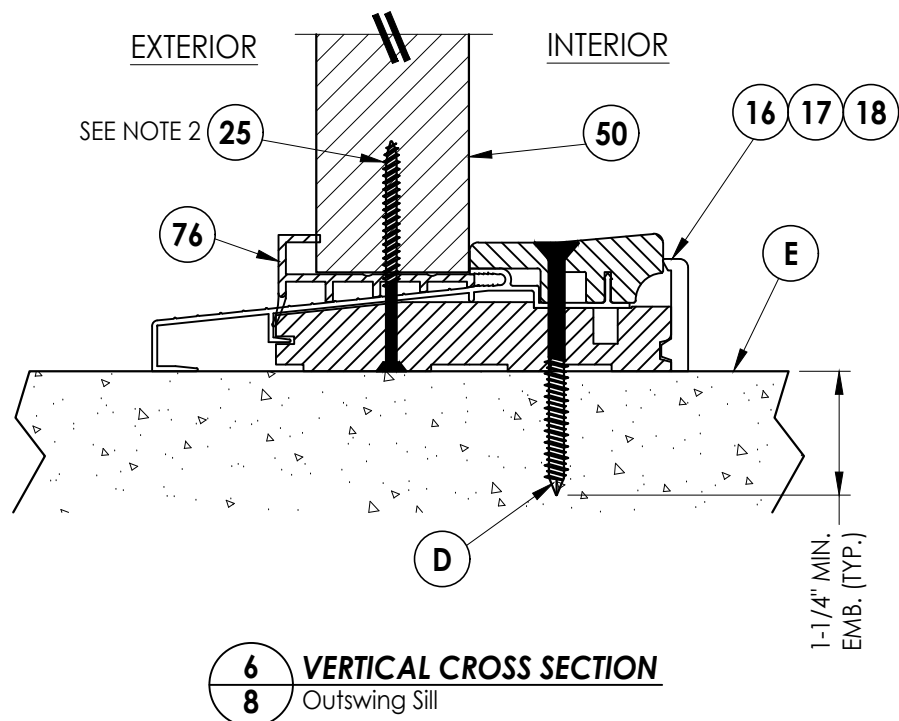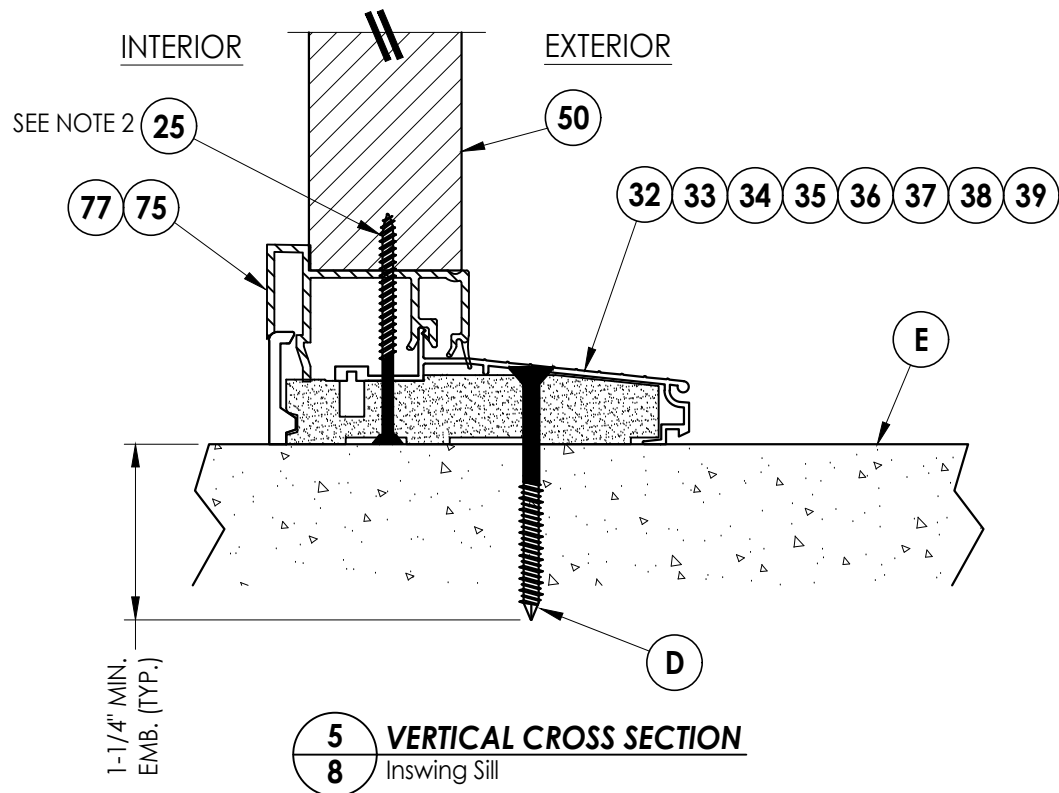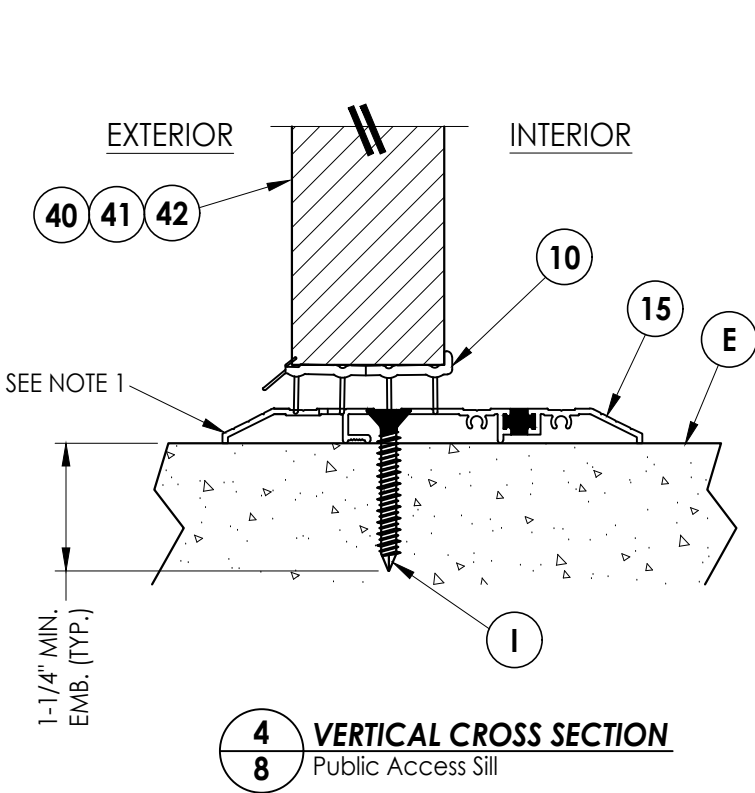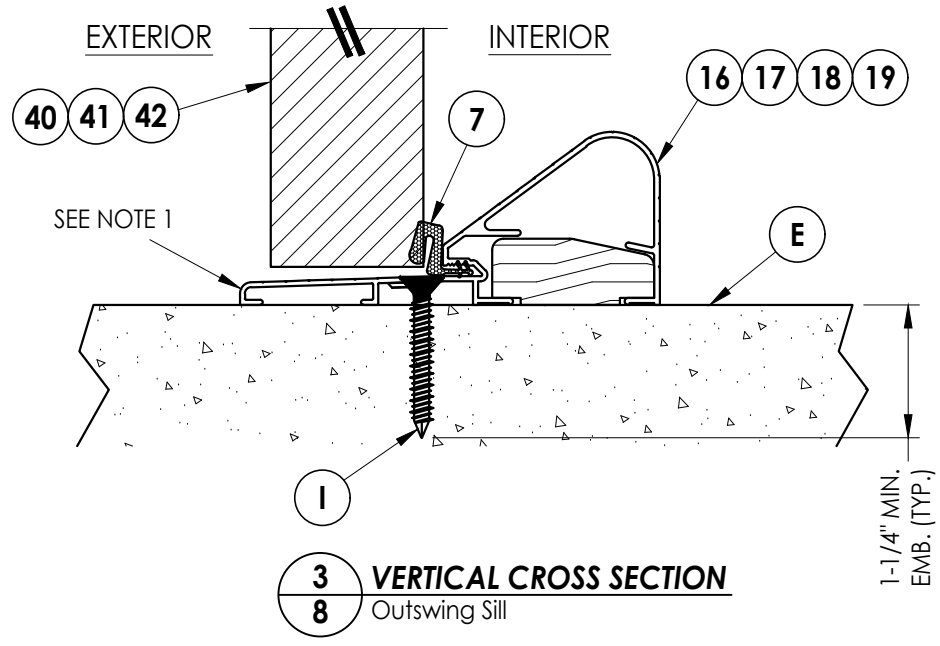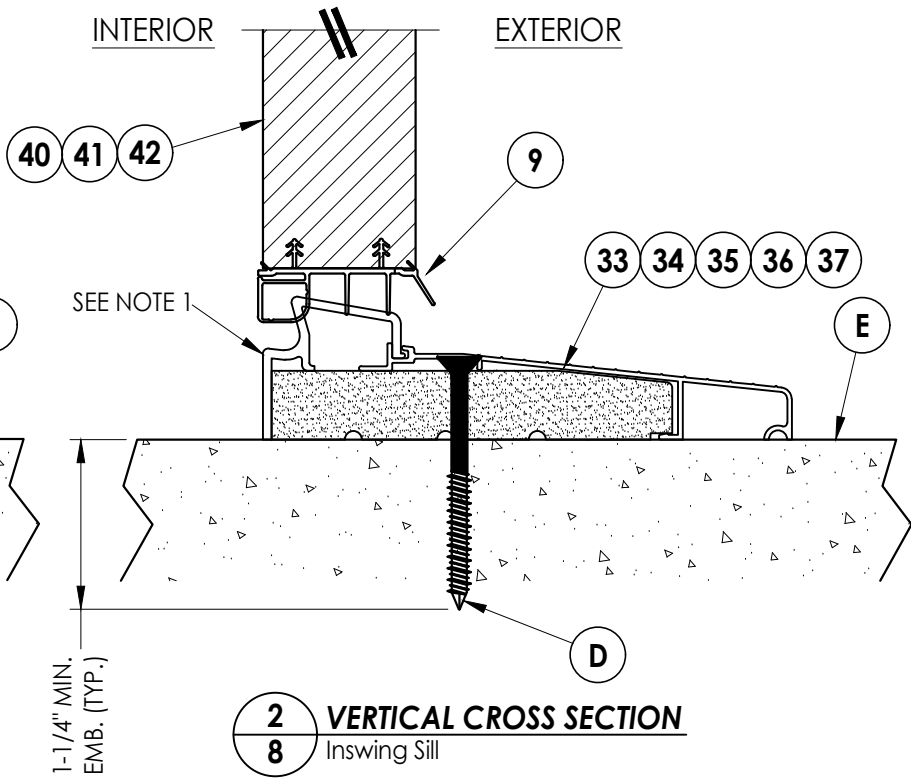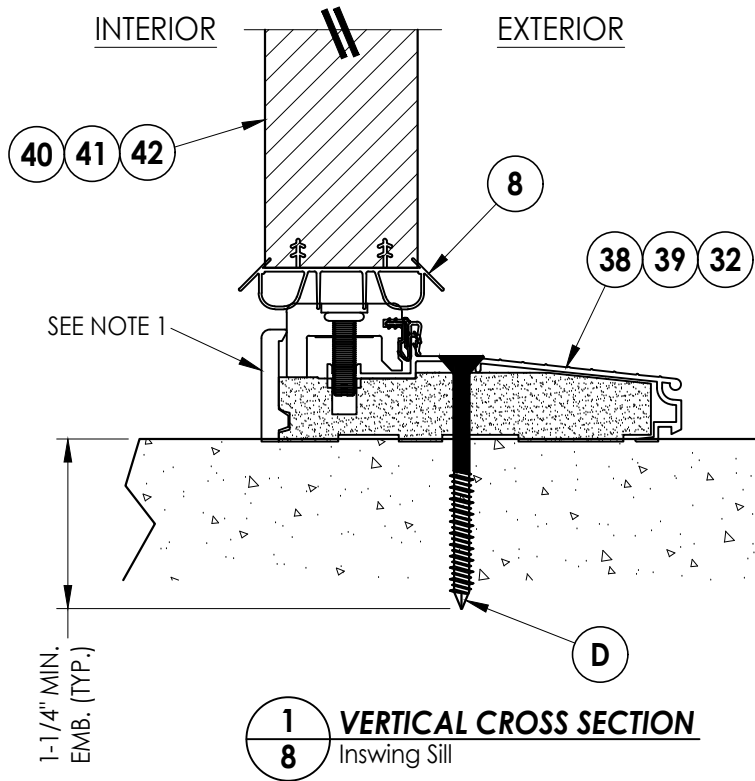

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17

SCALE: N.T.S.



DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-23507.14

SHEET 8 OF 14

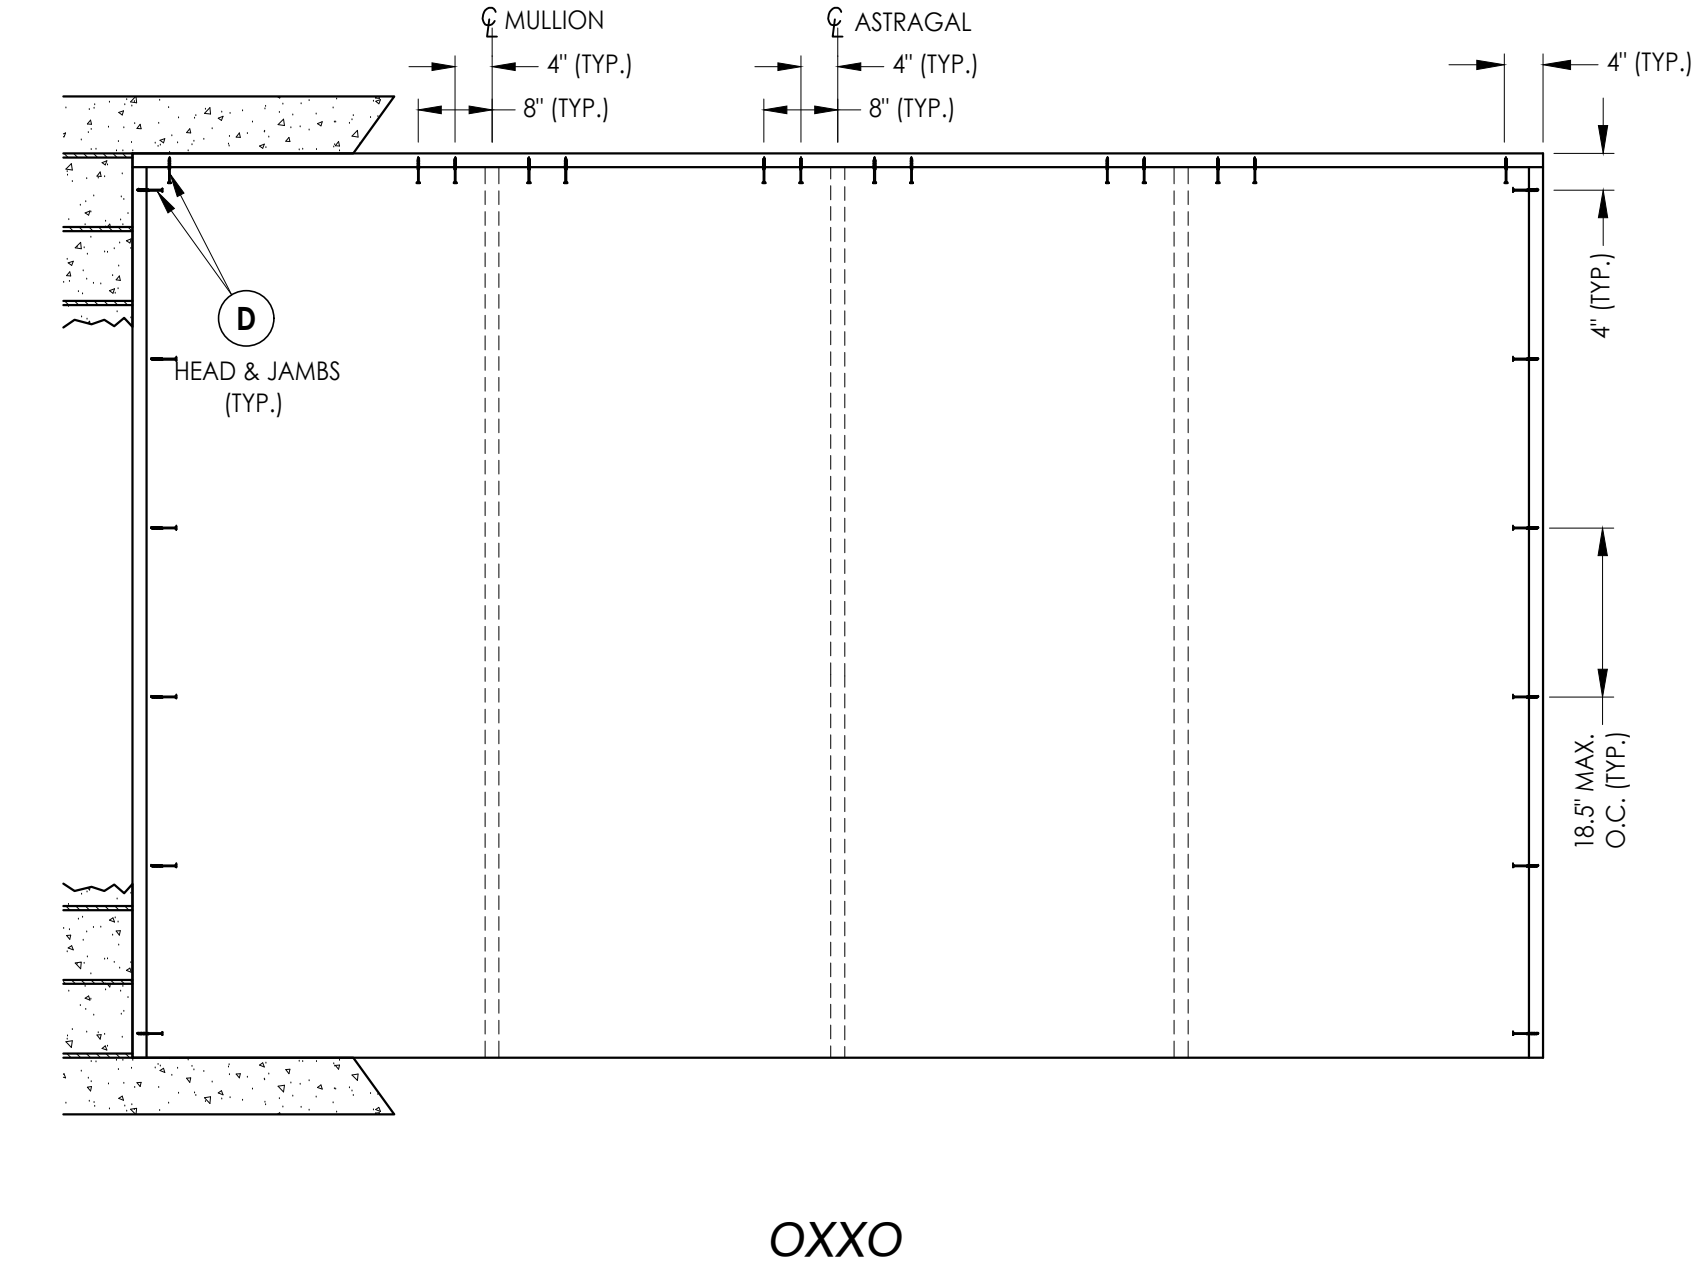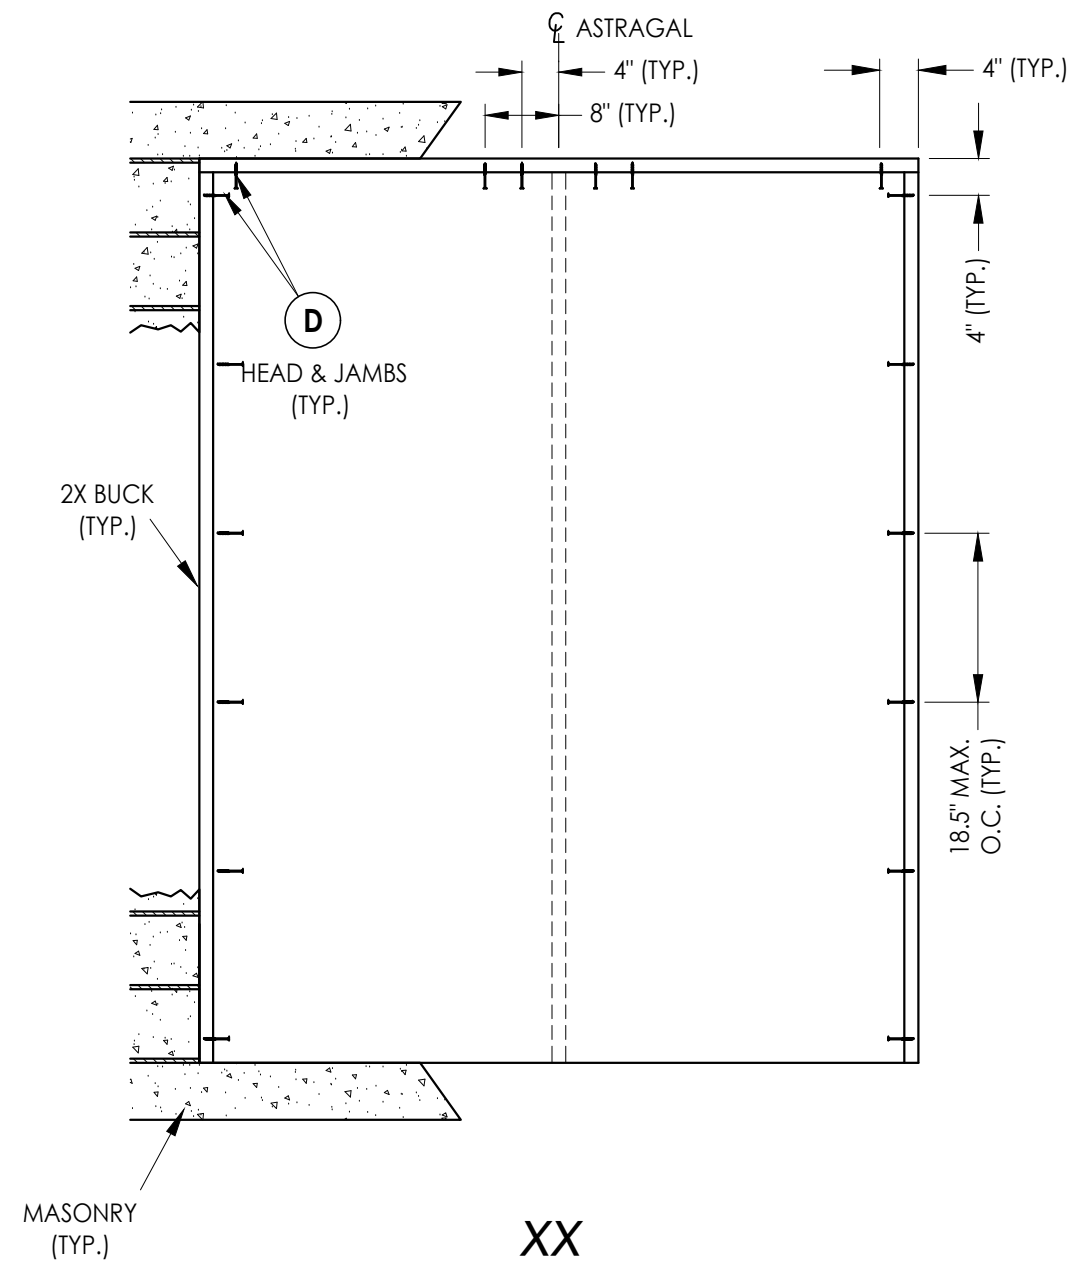

2X BUCK ANCHORING

[illegible]

DATE: 10/12/17

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-23507.14


SHEET 9 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

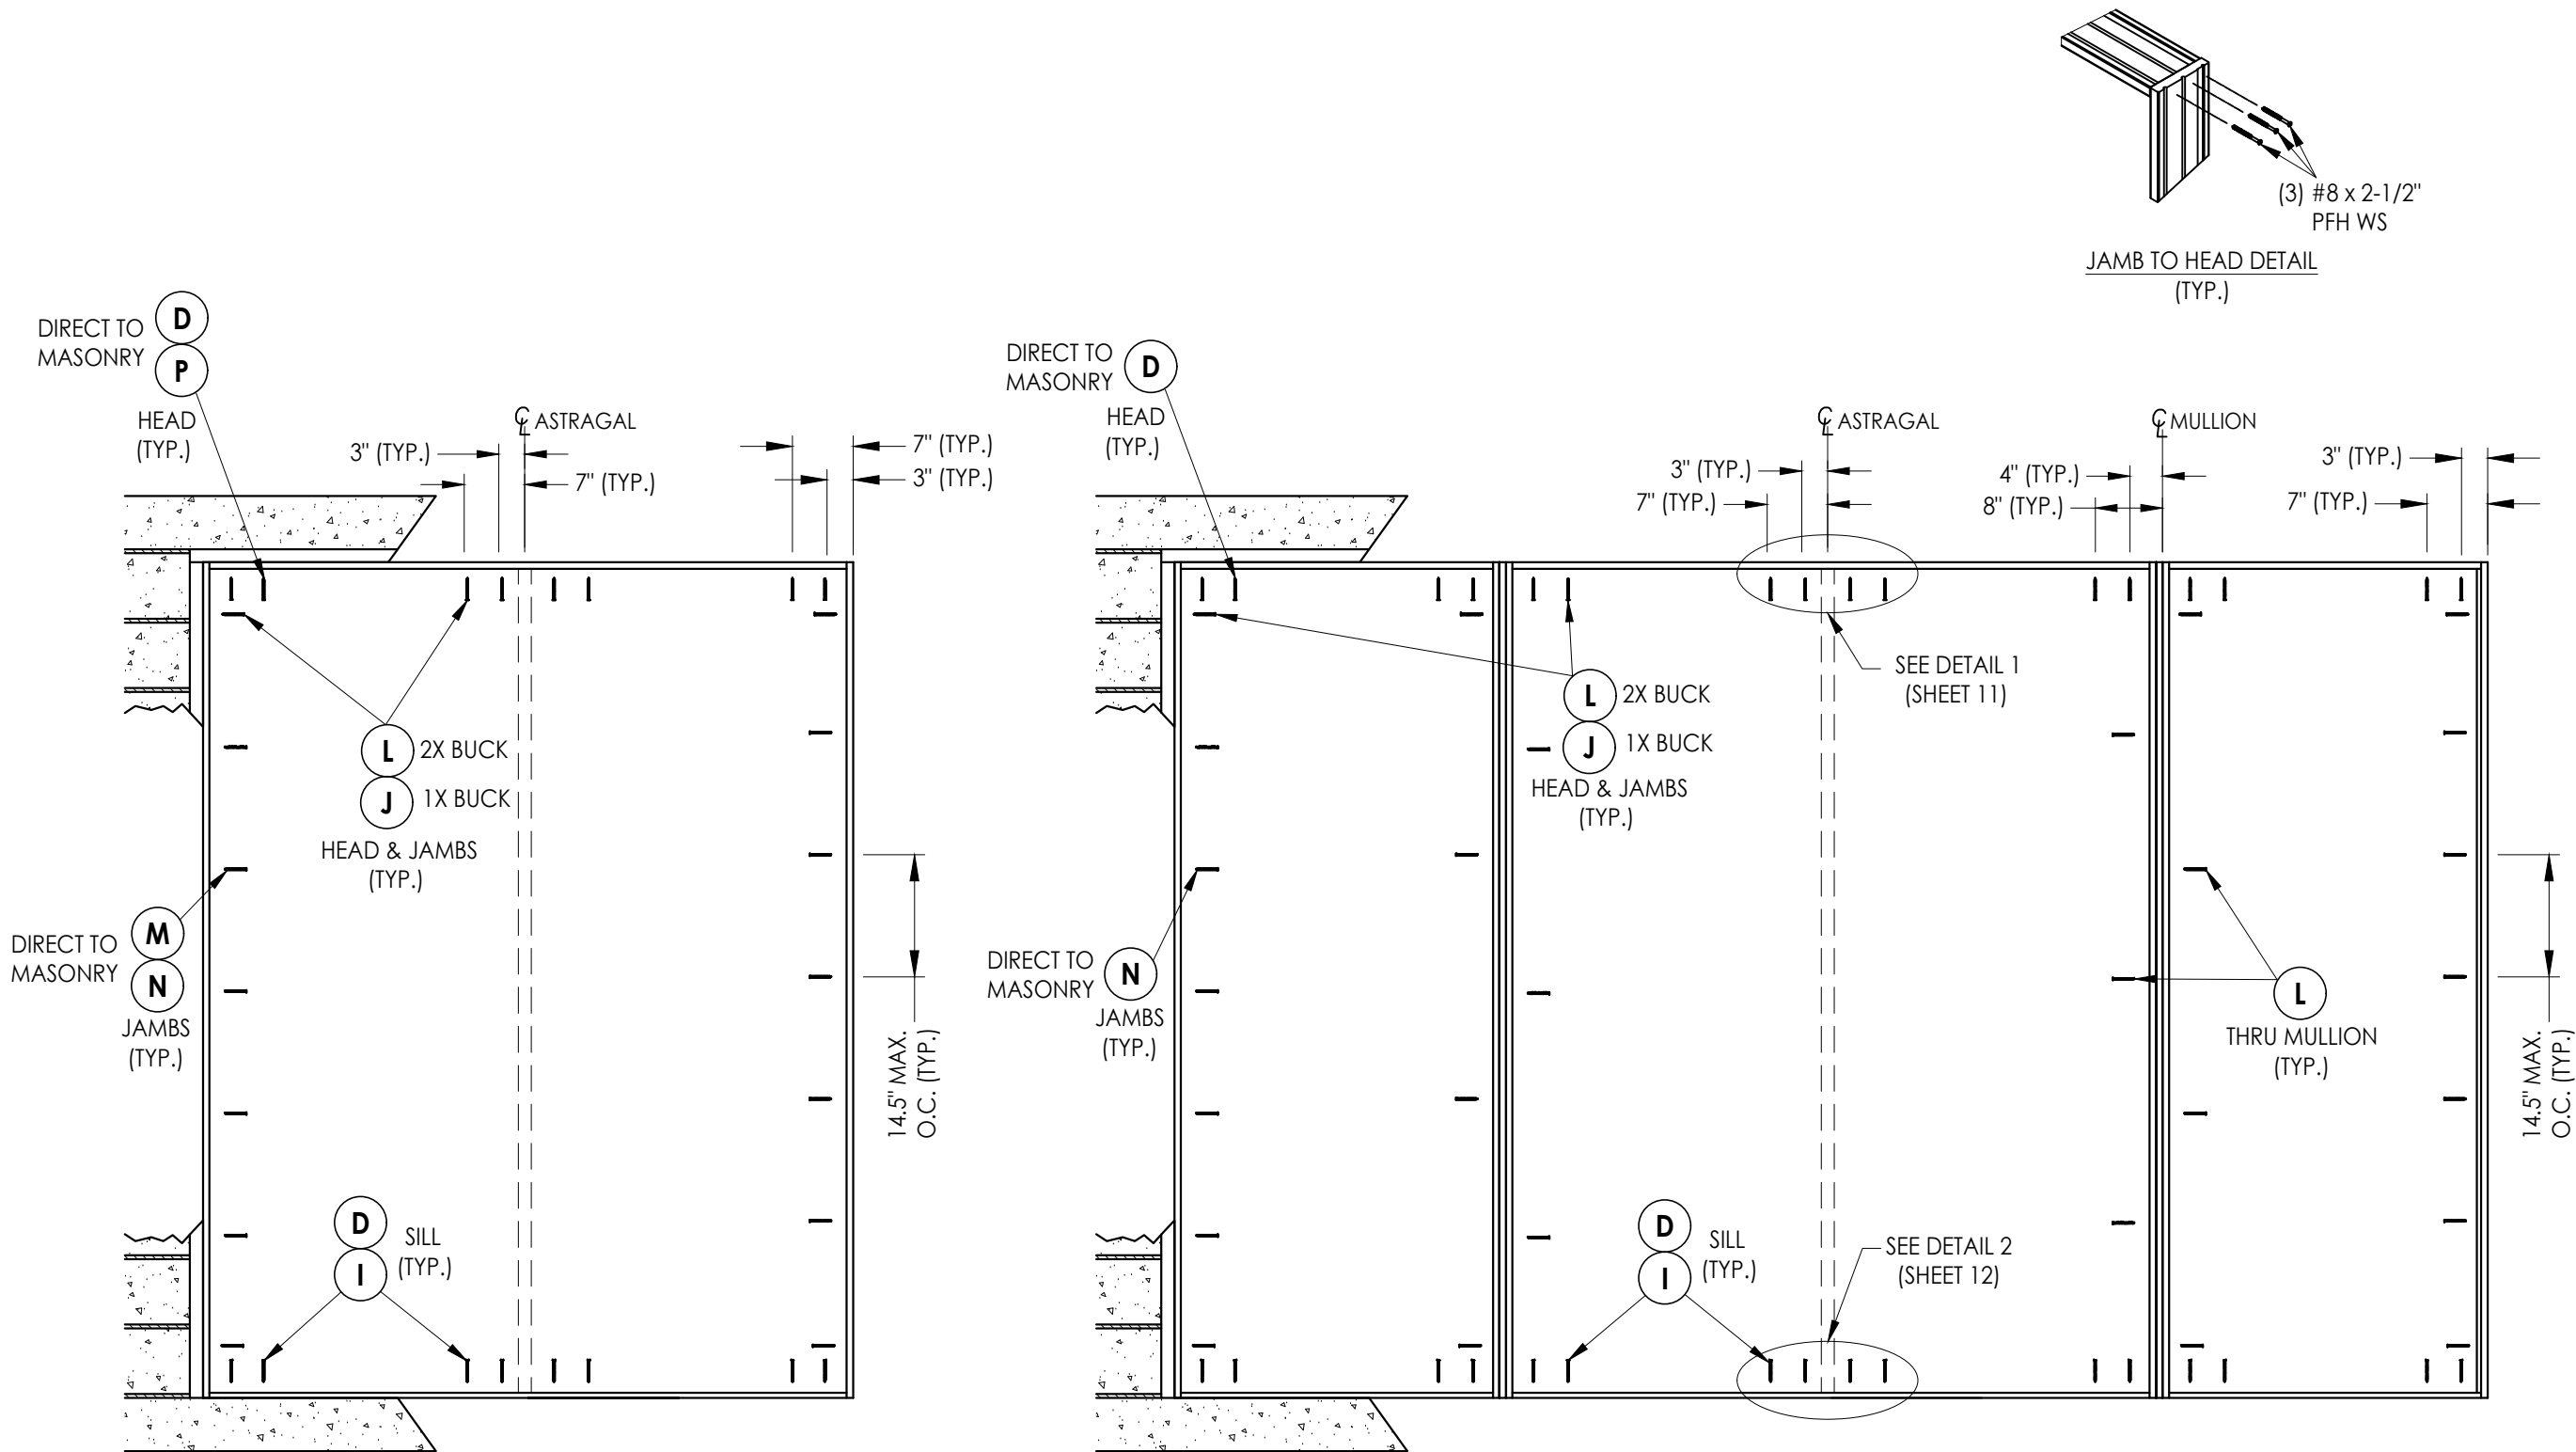

XX

OXXO

FRAME ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
FRAME ANCHORING

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17

SCALE: N.T.S.




DWG. BY: JK

CHK. BY: LFS




DRAWING NO.:

FL-23507.14

SHEET 10 OF 14

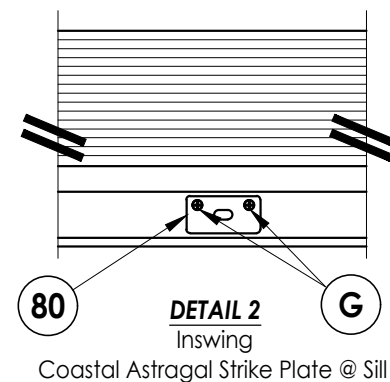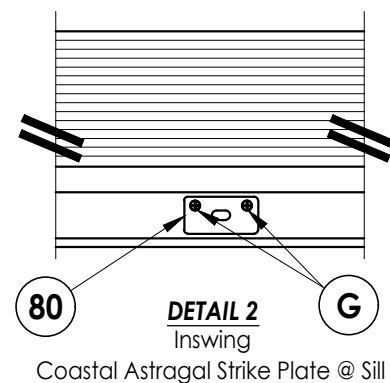

LATCH & DEADBOLT STRIKE DETAILS

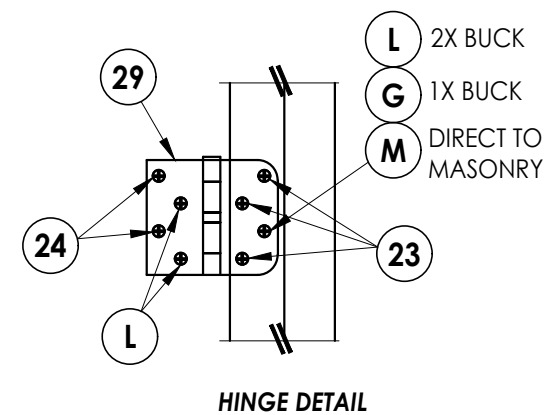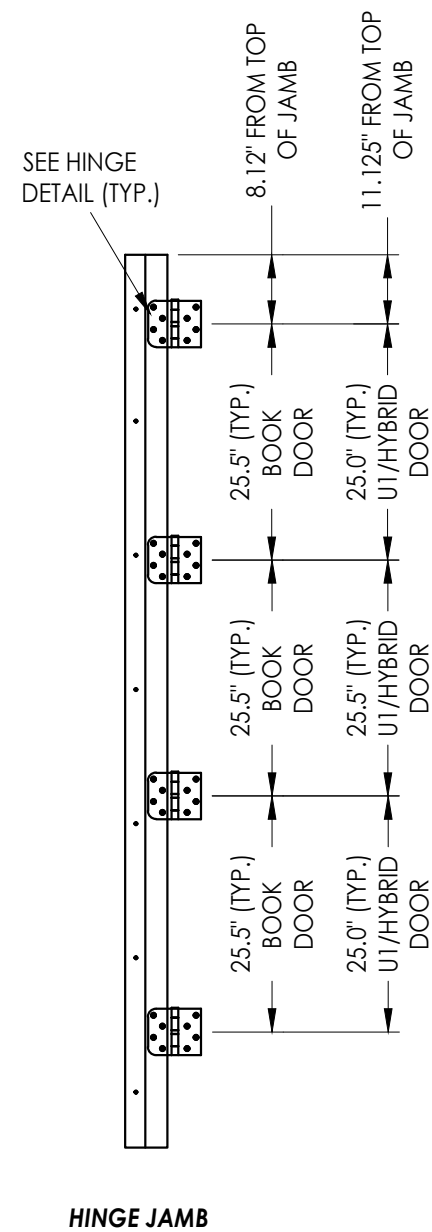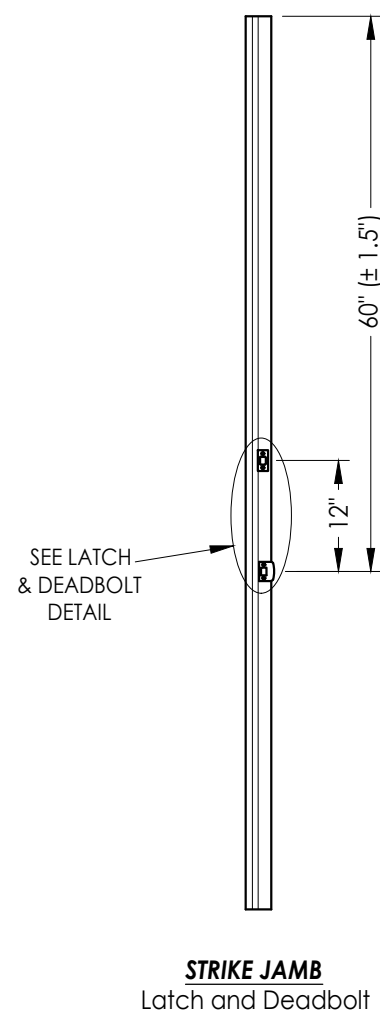
[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2017 R.W. BUILDING CONSULTANTS INC.


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23507 R3\FL-23507.12-14.dwg

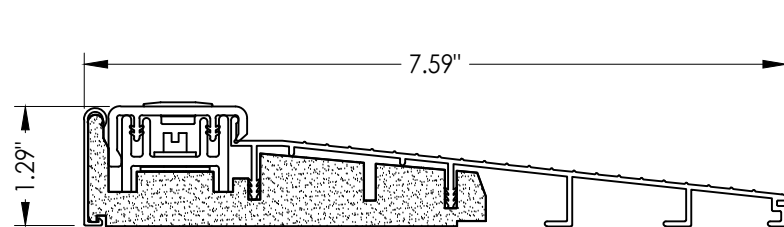


32 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill 7-1/2"

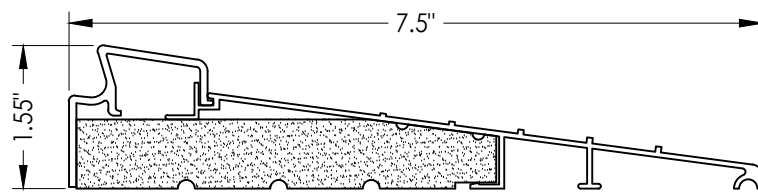


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

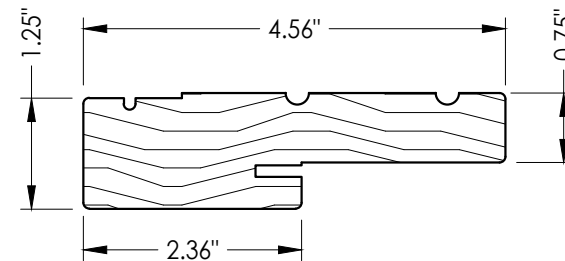


1 WOOD JAMB

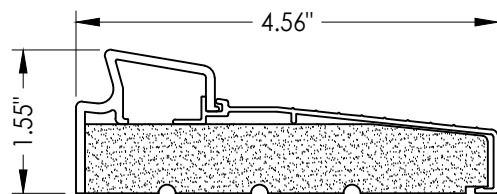


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

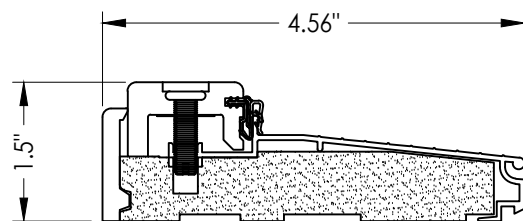


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

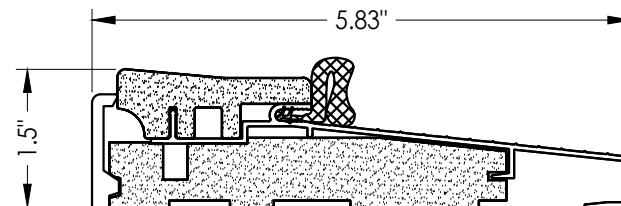


16 OUTSWING THRESHOLD
Composite Sill

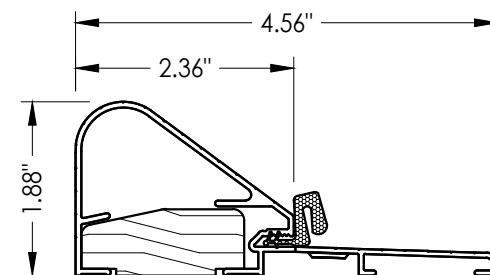


19 COASTAL OUTSWING THRESHOLD
Wood / Aluminum Sill

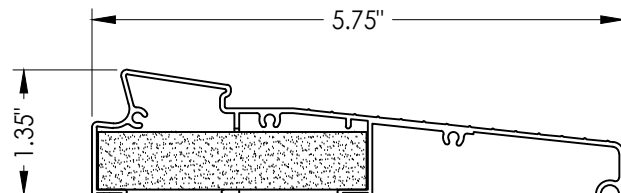


34 INSWING THRESHOLD
Inswing Moderate Climate Sill 1-3/8"

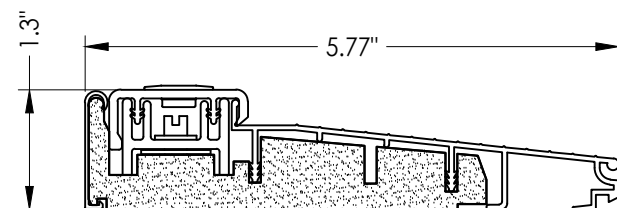


39 INSWING THRESHOLD
Inswing Basic Composite Adjustable Sill

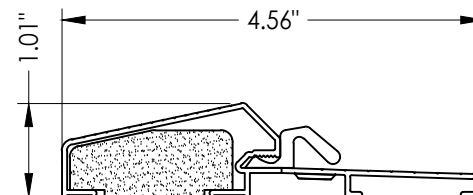


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

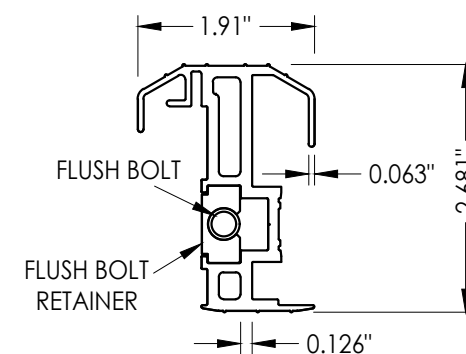


20 COASTAL ALUMINUM ASTRAGAL

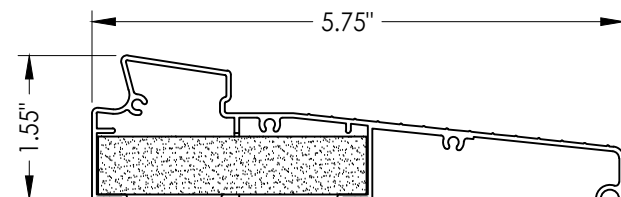


35 INSWING THRESHOLD
Inswing Moderate Climate Sill

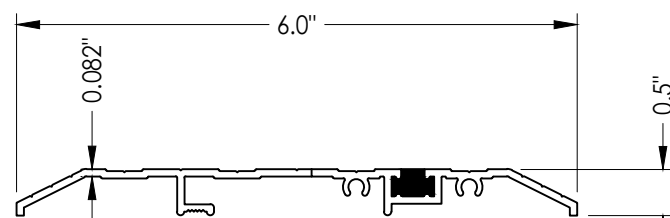


15 PUBLIC ACCESS THRESHOLD

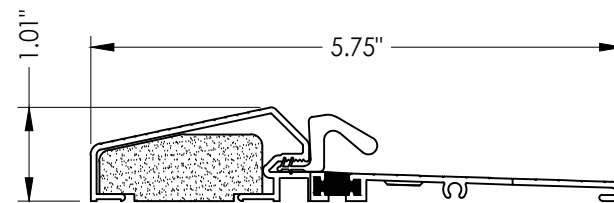


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

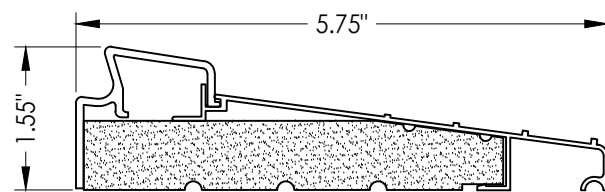


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill




8 SWEEP




9 SWEEP




10 SWEEP

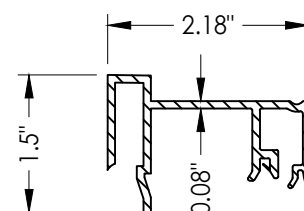

75 SIDELITE SPACER
Inswing



76 SIDELITE SPACER
Outswing

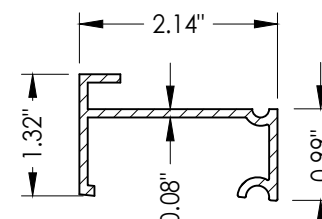

77 SIDELITE SPACER
Inswing
Moderate Climate Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
STEEL DOOR

PART OR ASSEMBLY:
COMPONENTS

NO.	DATE	REVISIONS
3	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/17/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/15/20	UPDATE TO 7th ED (2020) FBC PO

DATE: 10/12/17

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-23507.14

SHEET 13 OF 14

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	29	4" X 4" HINGE	STEEL
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	34	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	35	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	36	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
P	1/4" X 2-3/4" PFH DeWALT CONCRETE SCREW	STEEL	38	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	39	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	40	DOOR PANEL (BOOK)	-
7	WEATHERSTRIP (LONG REACH)	FOAM	41	DOOR PANEL (HYBRID)	-
8	SWEEP	VINYL	42	DOOR PANEL (U1)	-
9	SWEEP (USE W/ MODERATE CLIMATE THRESHOLD)	VINYL	50	SIDELITE (FULL LITE)	-
10	SWEEP (USE W/ PUBLIC ACCESS THRESHOLD)	VINYL	75	SIDELITE SPACER (INSWING)	PVC
11	#10 X 1-3/4" PFH WOOD SCREW	STEEL	76	SIDELITE SPACER (OUTSWING)	PVC
15	PUBLIC ACCESS THRESHOLD	ALUM	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	PVC
16	OUTSWING THRESHOLD	ALUM/COMP	80	ASTRAGAL STRIKE PLATE	STEEL
17	OUTSWING THRESHOLD	ALUM/COMP	88	2X MULLION (SG >= 0.55)	WOOD
18	OUTSWING THRESHOLD	ALUM/COMP			
19	COASTAL OUTSWING THRESHOLD	ALUM/WOOD			
20	COASTAL ALUMINUM ASTRAGAL	ALUM			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

PRODUCT:		THERMA-TRU STEEL DOOR		RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PART OR ASSEMBLY:		BILL OF MATERIALS			
3	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
2	8/17/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
1	7/15/20	UPDATE TO 7th ED (2020)	FBC	PO	
NO.	DATE				
REVISIONS					
DATE: 10/12/17					
SCALE: N.T.S.					
DWG. BY: JK					
CHK. BY: LFS					
DRAWING NO.: FL-23507.14					
SHEET 14 OF 14					