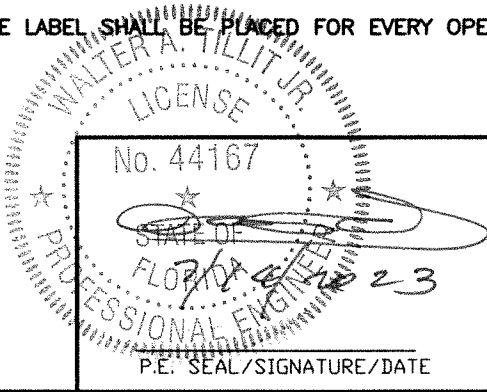



GENERAL NOTES:

- 1- ROLL-UP DOOR SHOWN ON THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) HAS BEEN VERIFIED FOR CODE COMPLIANCE IN ACCORDANCE WITH THE **2023 (8th EDITION)** OF THE FLORIDA BUILDING CODE.
- DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTIONS **1620** (HVHZ) AND **1609** (NHVHZ) OF THE ABOVE MENTIONED CODE, FOR A WIND SPEED AS REQUIRED BY THE JURISDICTION WHERE THIS PRODUCT WILL BE INSTALLED AND FOR A DIRECTIONALITY FACTOR $K_d=0.85$, USING **ASCE 7-22** AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON NOTE 1.
- IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER **ASCE 7-22** SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/ MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON NOTE 1.
- ROLL-UP DOOR'S ADEQUACY FOR IMPACT AND FATIGUE RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTIONS 1626 (HVHZ) AND 1609.1.2 (NHVHZ) OF THE ABOVE MENTIONED CODE AS PER BLACK WATER TESTING, INC. REPORT # BT-ROD-18-001, PER TAS-201, TAS-202 & TAS-203 PROTOCOLS.
- MAX. A.S.D. DESIGN PRESSURE RATING: +70.0, -70.0 PSF FOR SLAT ①
- 2-SLAT AND ROLLED FORMED GUIDE TO BE A.S.T.M. A-653 GR 40 STRUCTURAL QUALITY STEEL WITH MIN. $F_y = 44.7$ ksi. AND G-90 GALVANIZING PER A.S.T.M. A-653, OR A.I.S.I. 304 SERIES STAINLESS STEEL MANUFACTURED WITH A MINIMUM YIELD STRENGTH OF $F_y = 44.7$ ksi.
- 3- ALL STEEL ANGLES TO BE A.S.T.M. A-36 DESIGNATION, SHOP PRIMED AGAINST CORROSION PRIOR TO INSTALLATION. PAINT TO CONFORM TO FEDERAL SPECIFICATIONS CORRESPONDING TO RED OXIDE PAINT OR EQUAL.
- 4- WINDLOCKS TO BE "MALLEABLE IRON" $F_y = 42$ ksi OR A.I.S.I. DESIGNATION STEEL W/ $F_y = 40$ ksi., CHROME OR NICKEL PLATED.
- 5- ALL ASSEMBLY BOLTS TO BE S.A.E. GRADE 2 CADMIUM PLATED OR GALVANIZED STEEL.
- 6- STEEL WINDBARS TO BE A.S.T.M. A-36 DESIGNATION, SHOP PRIMED PRIOR TO INSTALLATION. PAINT TO CONFORM TO FEDERAL SPECIFICATIONS CORRESPONDING TO RED OXIDE PAINT OR EQUAL.
- 7- HOOD TO BE 24 GA. A.S.T.M. A-653 DESIGNATION G-90 FINISH TYPE COATING.
- 8- ALL RIVETS TO BE A.I.S.I. C1006 SPHERODIZED ANNEALED ALUMINUM LOW CARBON COLD HEADING QUALITY STEEL, ZINC PLATED, W/ 55.0 ksi. MINIMUM TENSILE STRENGTH, AS MANUFACTURED BY UNIVERSAL RIVET, INC.
- 9- CONCRETE ANCHORS TO BE AS PER MANUFACTURERS INDICATED ON SHEET 6, AND SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER. STEEL FASTENERS TO BE AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS AND SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.
- 10- ALL WELDING TO CONFORM TO AMERICAN WELDING SOCIETY'S AWS D1.1 REGULATIONS. USE A.W.S A5.1 OR A5.5 E60XX ELECTRODES MIN. 3/16" FILLET SIZE.
- 11- INSULATION MATERIAL SHALL BE EPS-EXPANDED POLYSTYRENE INSULATION, MANUFACTURED **BY DYPLAST PRODUCTS LLC. W/ MIAMI DADE COUNTY APPROVAL.**
- 12- THIS DOOR MAY BE INSTALLED WITH SLATS CONCAVE SIDE FACING OUTSIDE OR INSIDE OF BUILDING.
- 13- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THAT THE EXISTING STRUCTURE IS DESIGNED TO SUPPORT V_x AND V_y FORCES AT BOTH JAMBS. SEE SCHEDULE ON SHEET 6, FOR V_x & V_y VALUES.
- 14- ROLL-UP MECHANISM NOT PART OF THIS APPROVAL.
- 15- (A) THIS P.E.D. PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.
(B) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS P.E.D. PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.
(C) THIS P.E.D. WILL BE CONSIDERED INVALID IF MODIFIED.
(D) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER, SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
(E) ORIGINAL P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.
- 16- DOOR MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION **AT DOOR. ONE LABEL SHALL BE PLACED FOR EVERY OPENING. LABELING TO COMPLY WITH SECTION 1709.5.2.1.1** OF THE FLORIDA BUILDING CODE.


THIS DRAWING SHALL ONLY BE USED TO
OBTAIN PERMITS IN THE STATE OF FLORIDA

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

	©2023 TILTECO, INC.	16'-0" WIDE, 24 GAGE SLAT ROLL-UP DOOR	Y.M. DRAWN BY:																		
	 TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr., P.E. FLORIDA Lic. # 44167	XOEZ IMPORT & EXPORT, INC. dba.RollingDoors.com 7214 NW 78th TERRACE MEDLEY, FL 33166 PHONE: (305)885-7590 EMAIL: info@rollingdoors.com	7/14/2023 DATE:																		
	<table><tr><th>REV. NO</th><th>DESCRIPTION</th><th>DATE</th><th>REV. No</th><th>DESCRIPTION</th><th>DATE</th></tr><tr><td>1</td><td>OLD 20-283</td><td>7/14/23</td><td>3</td><td>-</td><td>-</td></tr><tr><td>2</td><td>-</td><td>-</td><td>4</td><td>-</td><td>-</td></tr></table>	REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	1	OLD 20-283	7/14/23	3	-	-	2	-	-	4	-	-		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE																
1	OLD 20-283	7/14/23	3	-	-																
2	-	-	4	-	-																

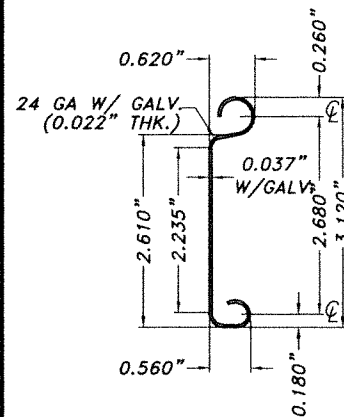


PLAIN

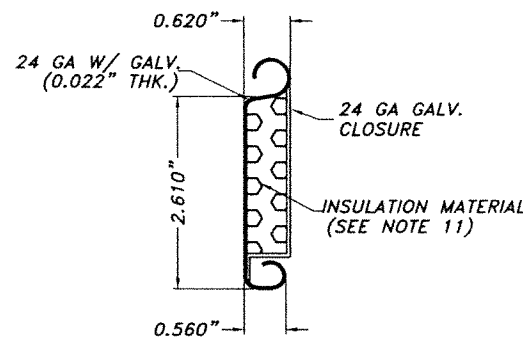


INSULATED

1 FLAT SOLID SLAT
SCALE : N.T.S

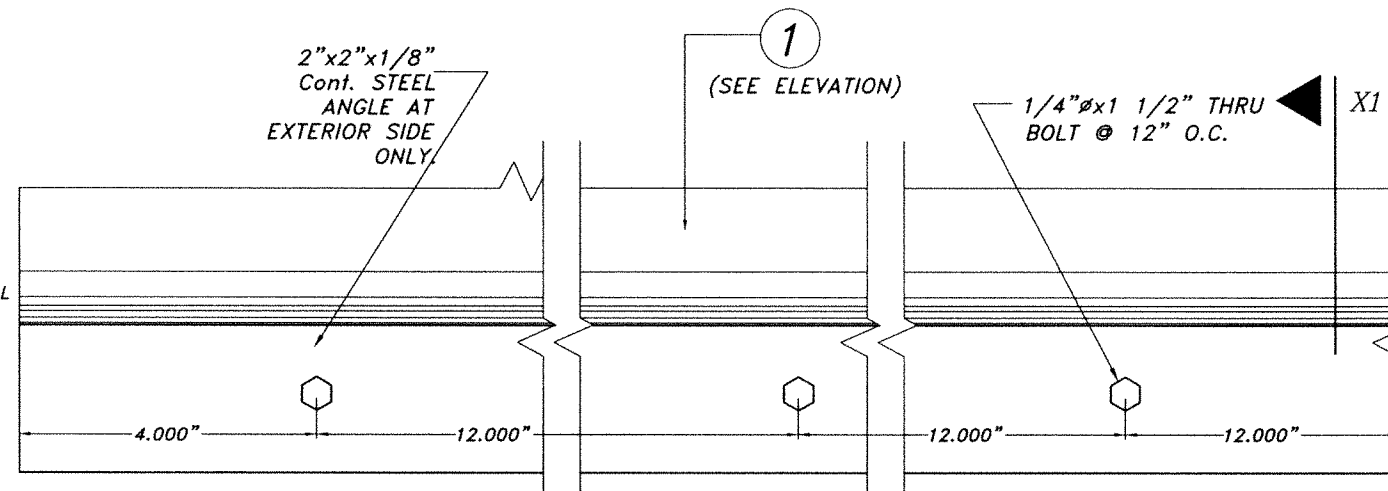


ELEVATION


2 BOTTOM BAR
SCALE : N.T.S

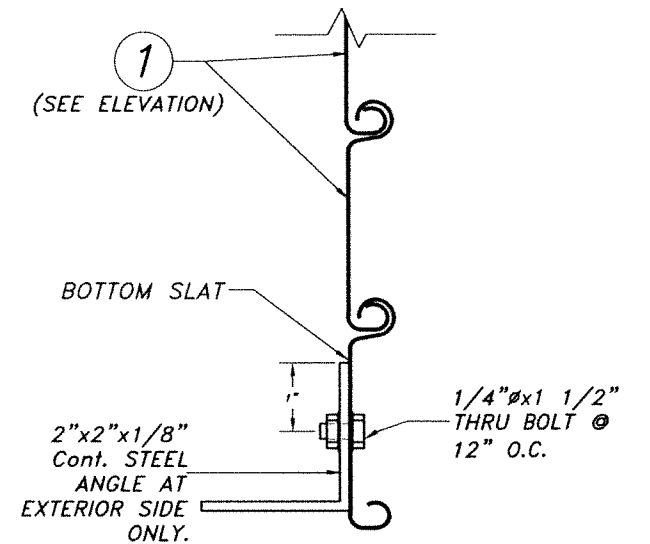


SECTION X1

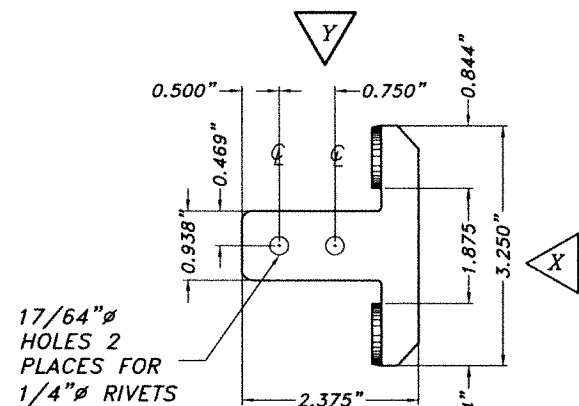

TYPICAL ELEVATION

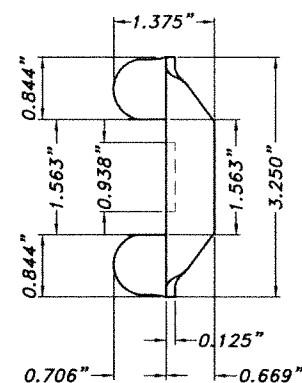


VIEW X

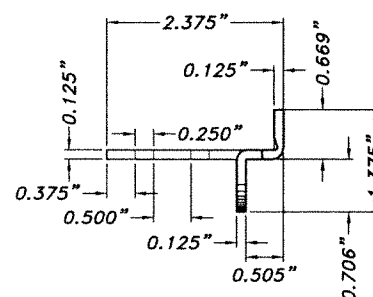


VIEW Y

3 TYPICAL WINDLOCK W - 1 DETAIL
SCALE : N.T.S

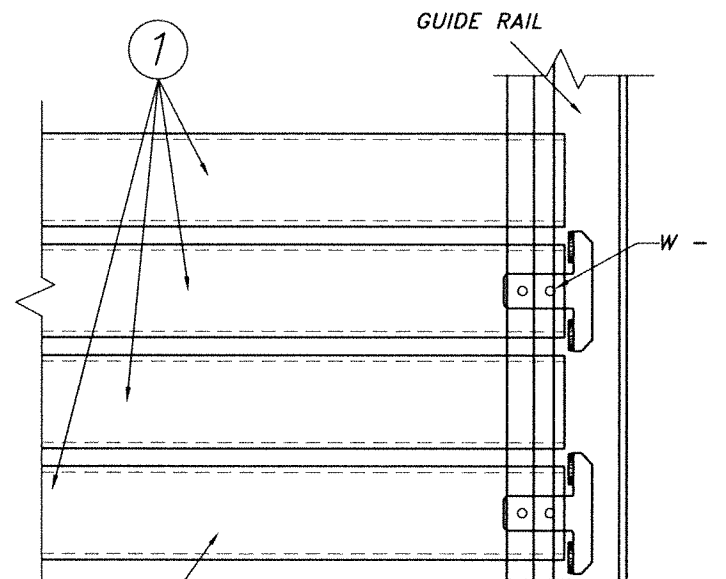


BOTTOM SLAT

DETAIL 1 (elevation)
SCALE : N.T.S

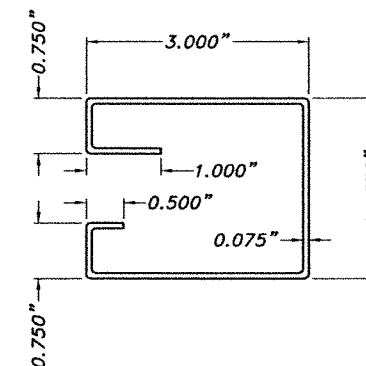

4 ROLLFORMED GUIDE
SCALE : N.T.S

COMPONENTS

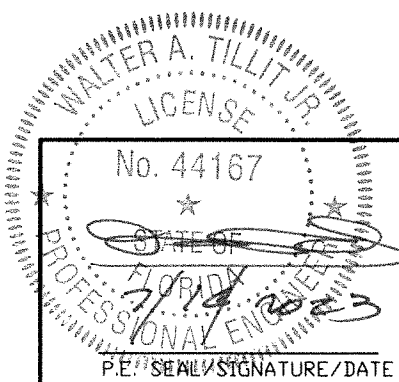


FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. # 44167




16'-0" WIDE, 24 GAGE SLAT ROLL-UP DOOR
XOEZ IMPORT & EXPORT, INC.
dba.RollingDoors.com
7214 NW 78th TERRACE
MEDLEY, FL 33166
PHONE: (305)885-7590 EMAIL: info@rollingdoors.com

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-283	7/14/23	3	-	-
2	-	-	4	-	-

Y.M.
DRAWN BY:
7/14/2023
DATE:
23-105
DRAWING No.
SHEET 2 OF 6

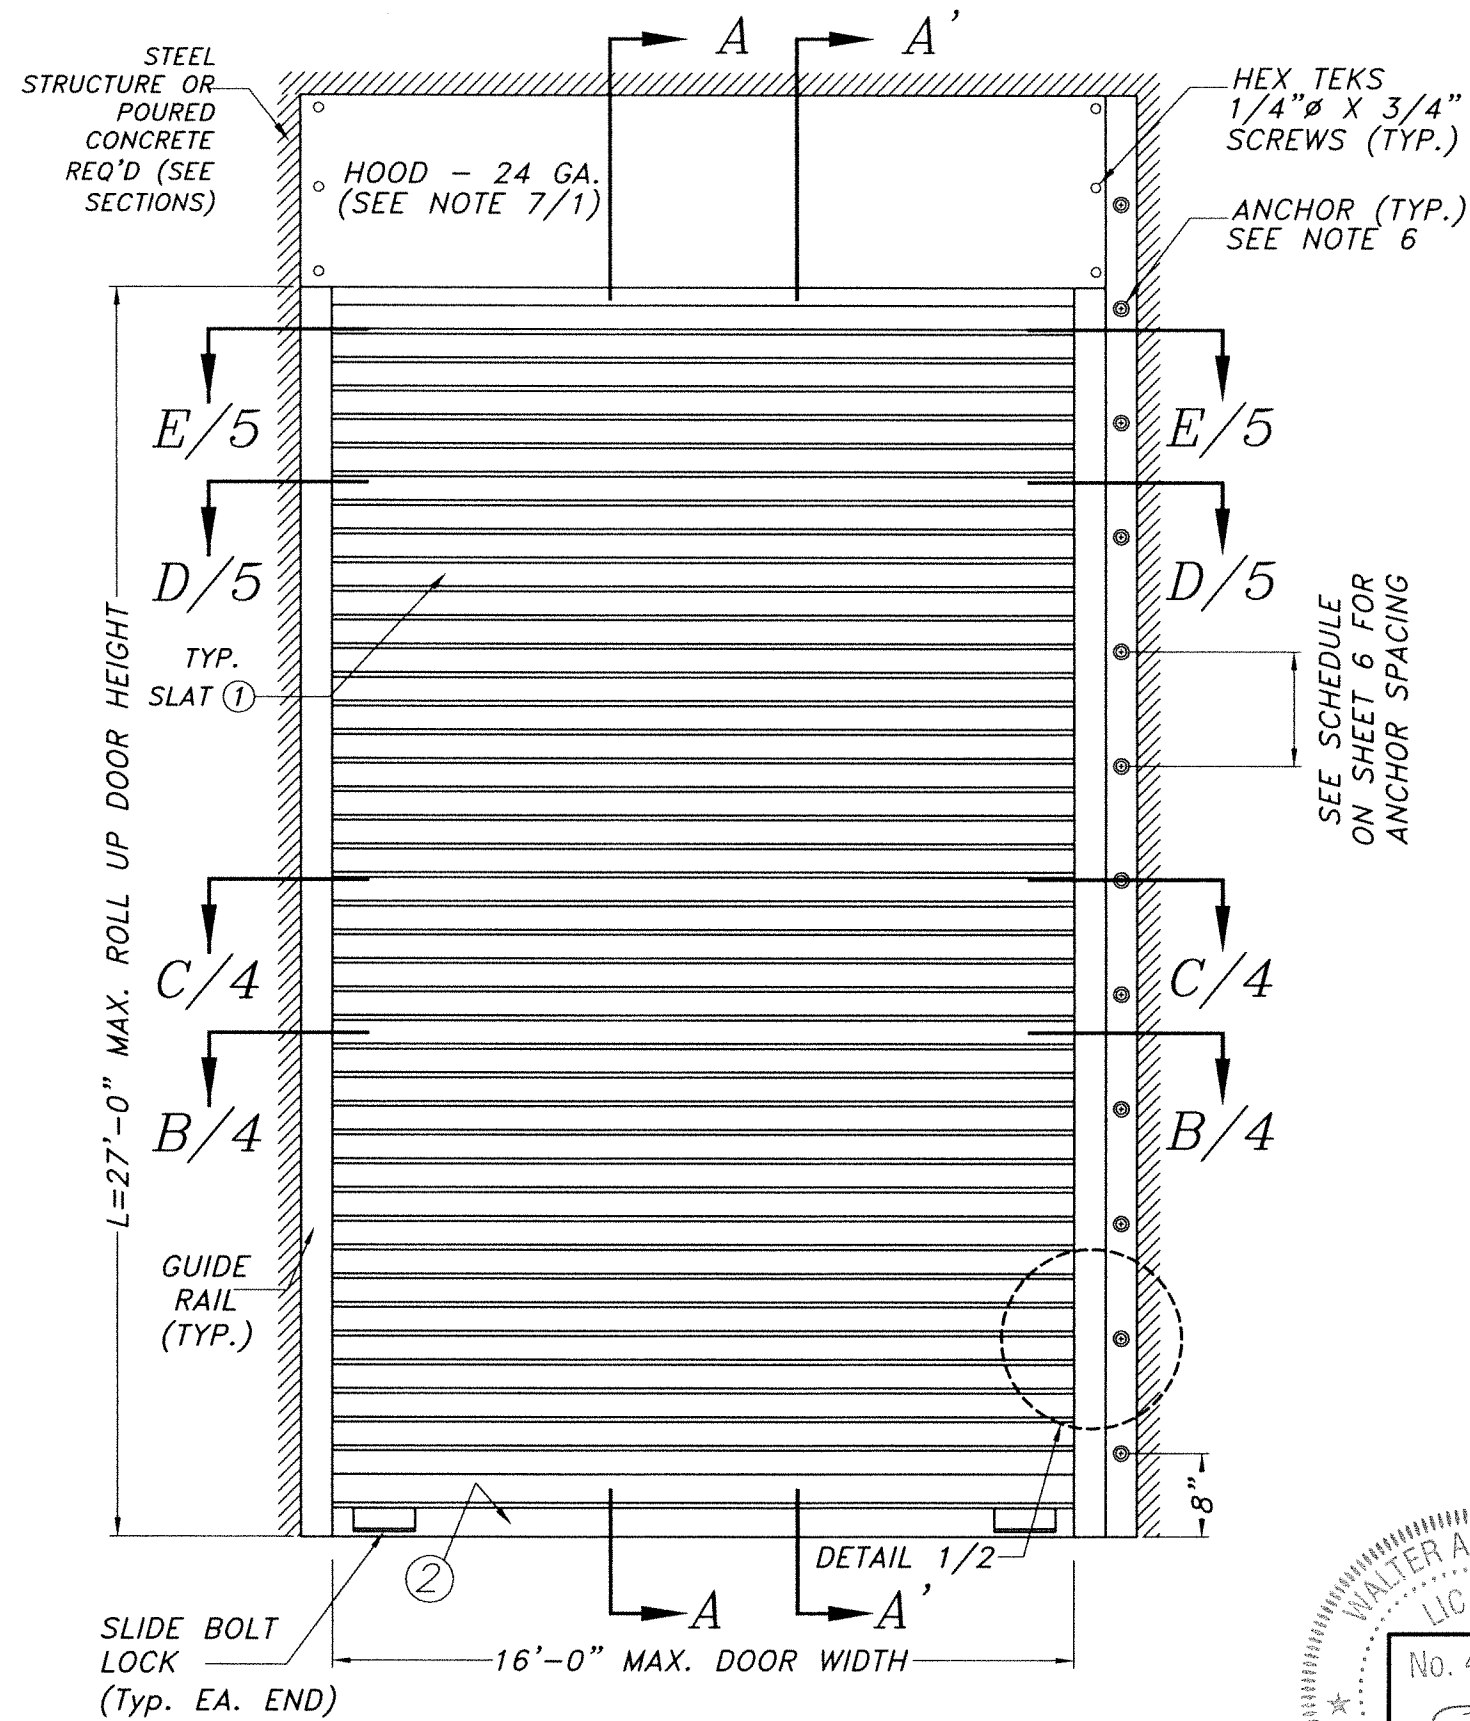

TYPICAL DOOR ELEVATION
N. T. S.

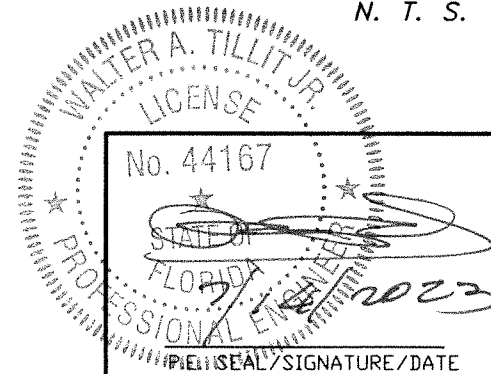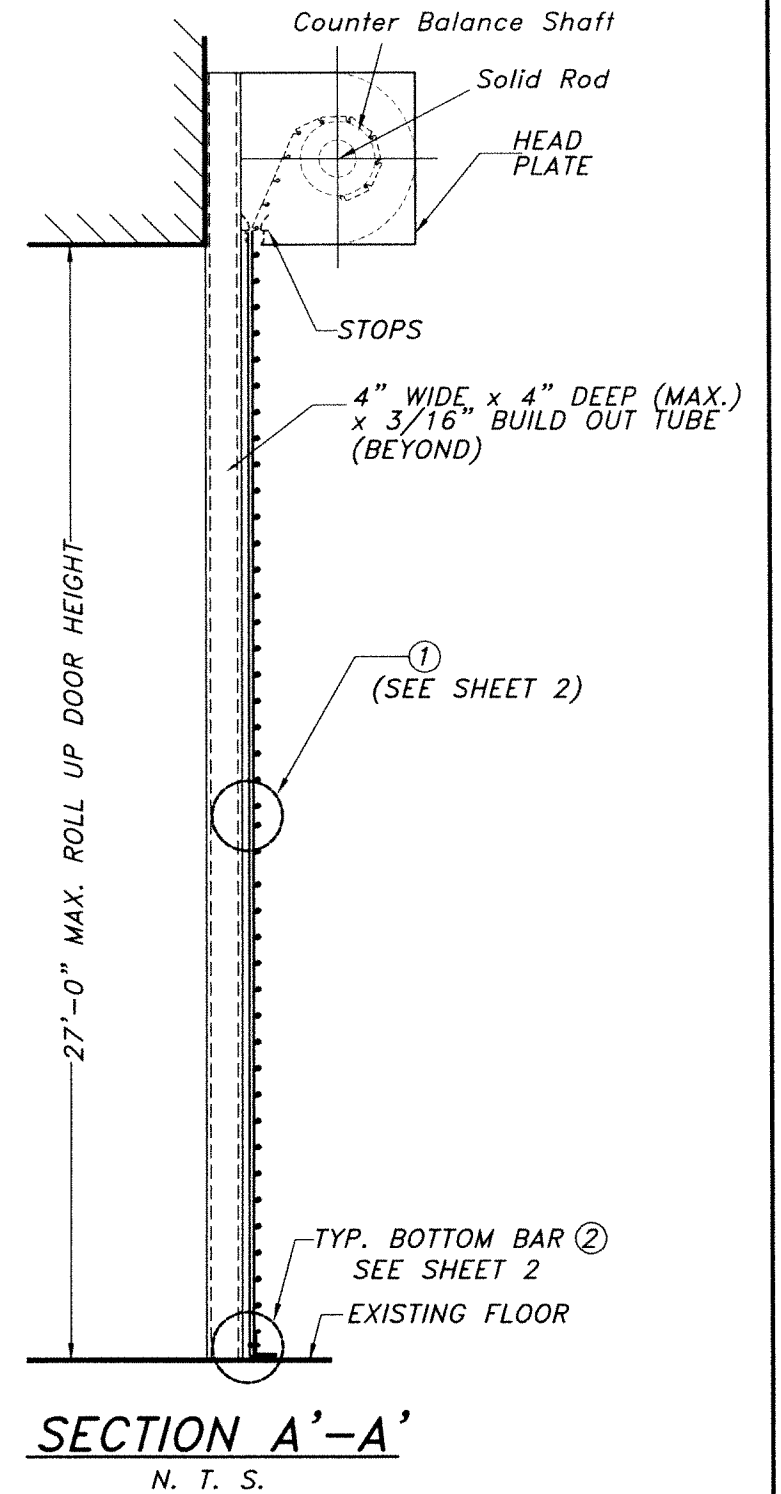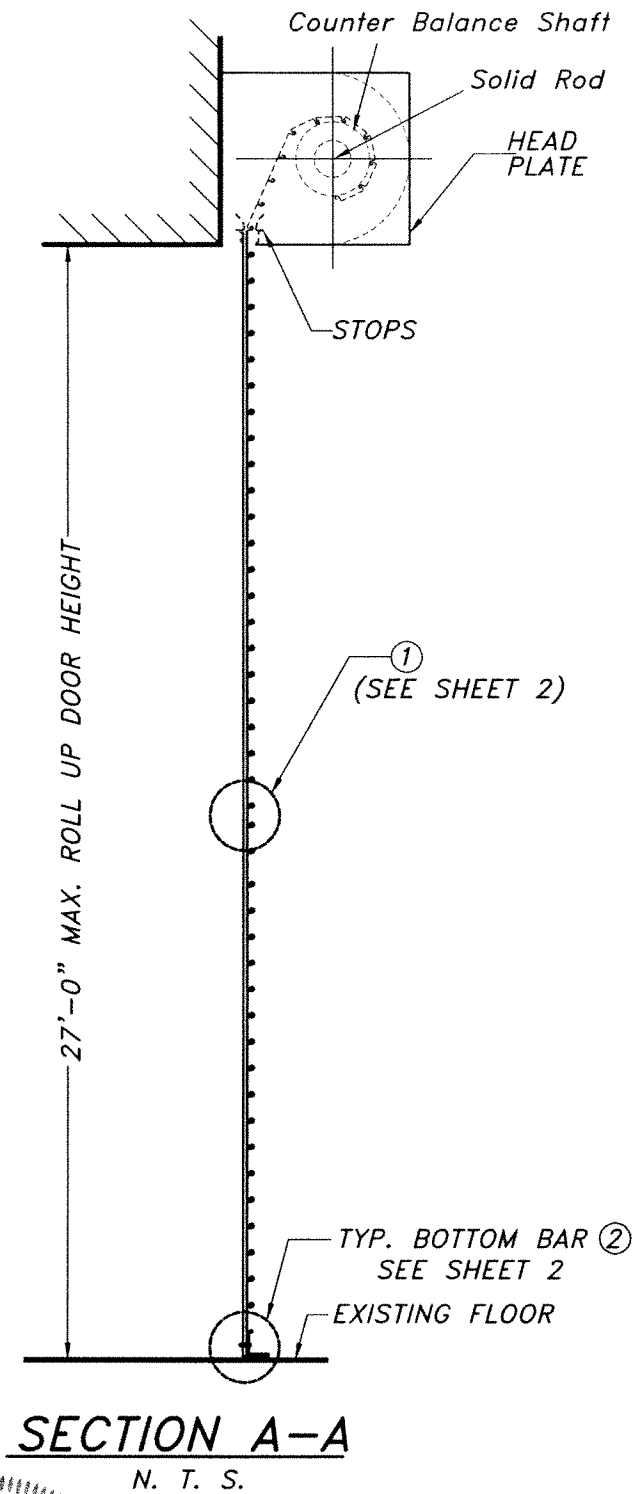

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.



TILLIT TESTING & ENGINEERING COMPANY
8355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone: (305)871-1530 - Fax: (305)871-1531
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. # 44167

16'-0" WIDE, 24 GAGE SLAT ROLL-UP DOOR

XOEZ IMPORT & EXPORT, INC.
dba.RollingDoors.com
7214 NW 78th TERRACE
MEDLEY, FL 33166
PHONE: (305)885-7590 EMAIL: Info@rollingdoors.com

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-283	7/14/23	3	-	-
2	-	-	4	-	-

Y.M.
DRAWN BY:
7/14/2023
DATE:
23-105
DRAWING No.
SHEET 3 OF 6

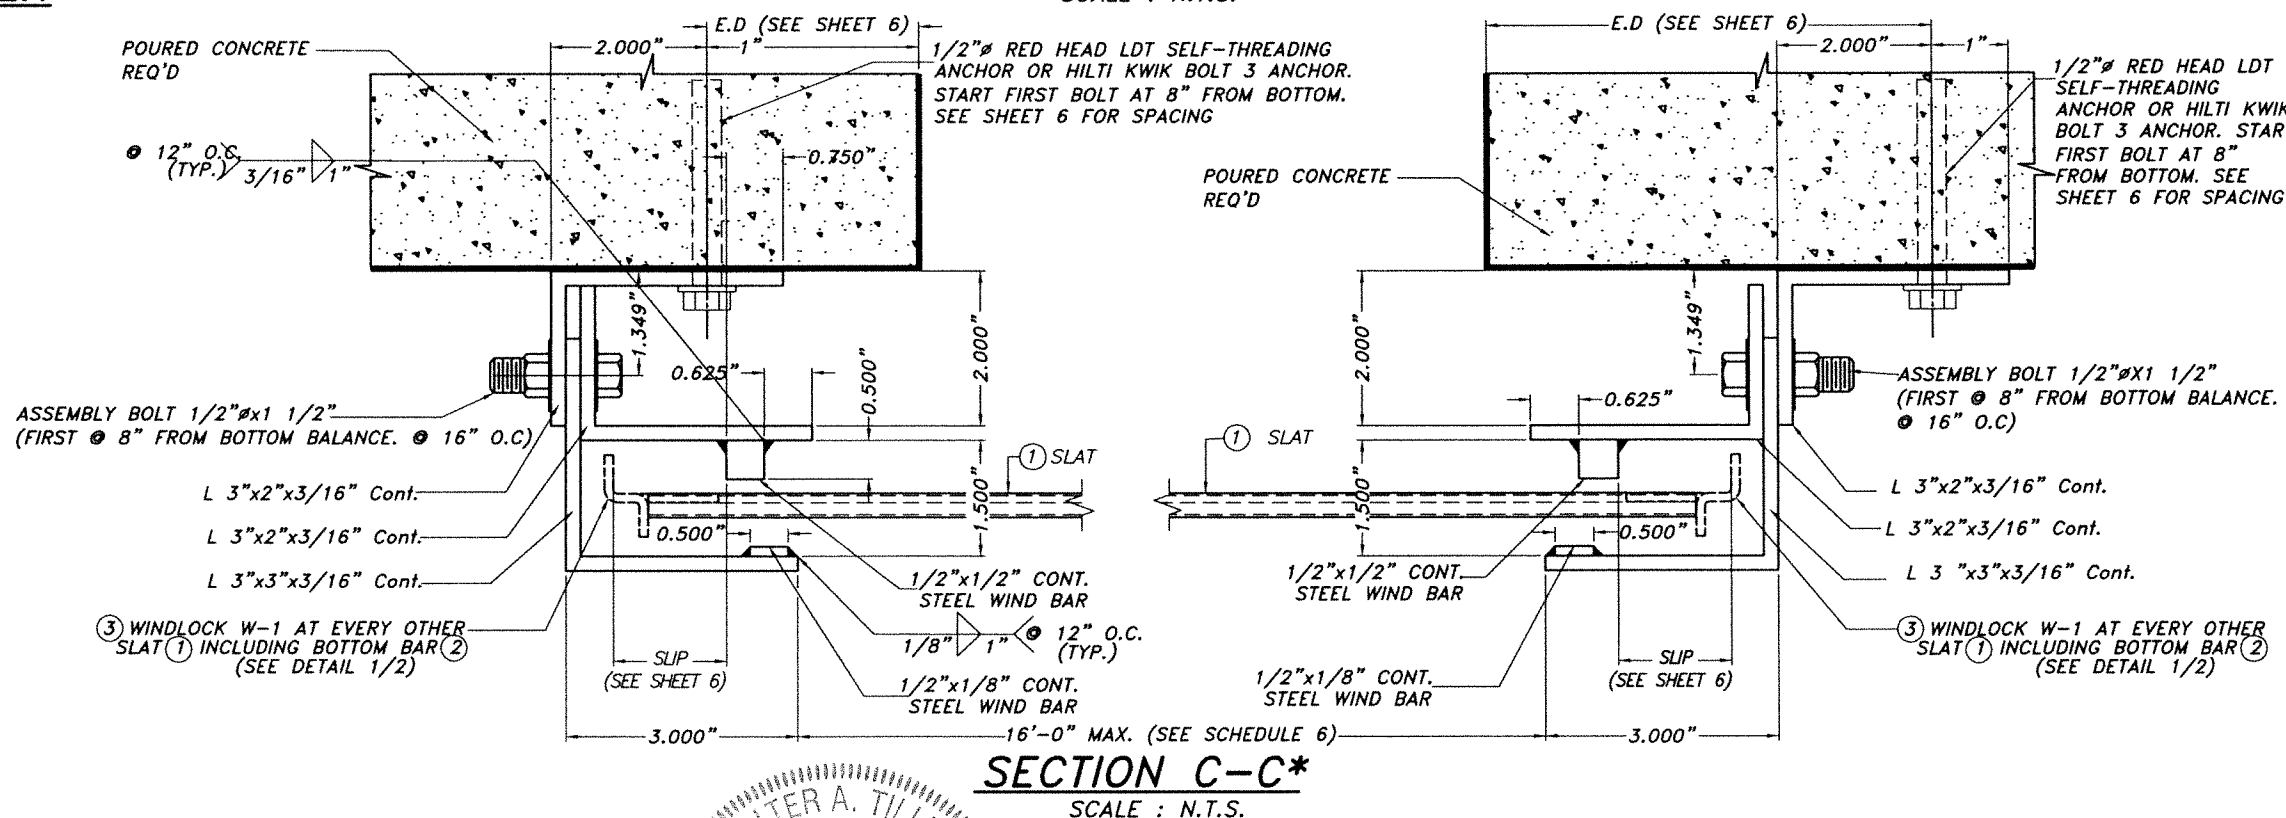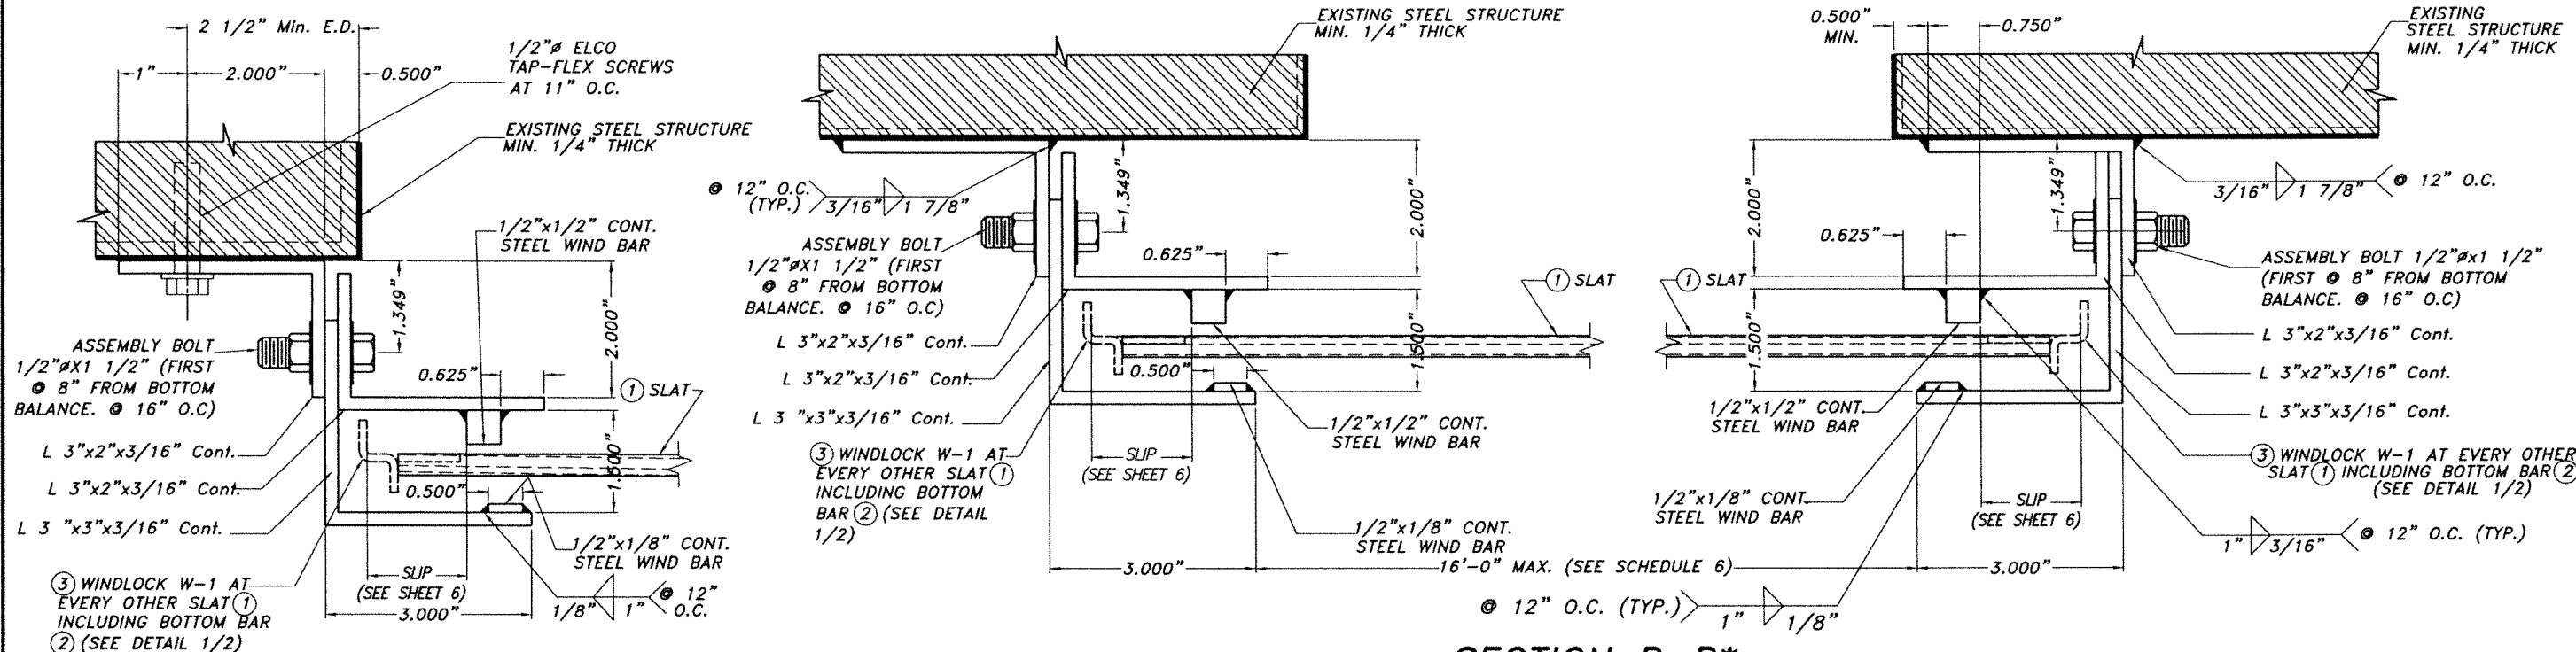

* GUIDES AT EACH JAMB MAY BE COMBINED AS NEEDED TO SUIT ANY INSTALLATION

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

WALTER A. TILLIT JR.
LICENSED PROFESSIONAL ENGINEER
No. 44167
STATE OF FLORIDA
P.E. SEAL/SIGNATURE/DATE






©2023 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 • Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

16'-0" WIDE, 24 GAGE SLAT ROLL-UP DOOR

XOEZ IMPORT & EXPORT, INC.
dba. RollingDoors.com
7214 NW 78th TERRACE
MEDLEY, FL 33166
PHONE: (305)885-7590 EMAIL: info@rollingdoors.com

REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 20-283	7/14/23	3	-	-
2	-	-	4	-	-

Y.M.
DRAWN BY:
7/14/2023
DATE:
23-105
DRAWING No.
SHEET 4 OF 6

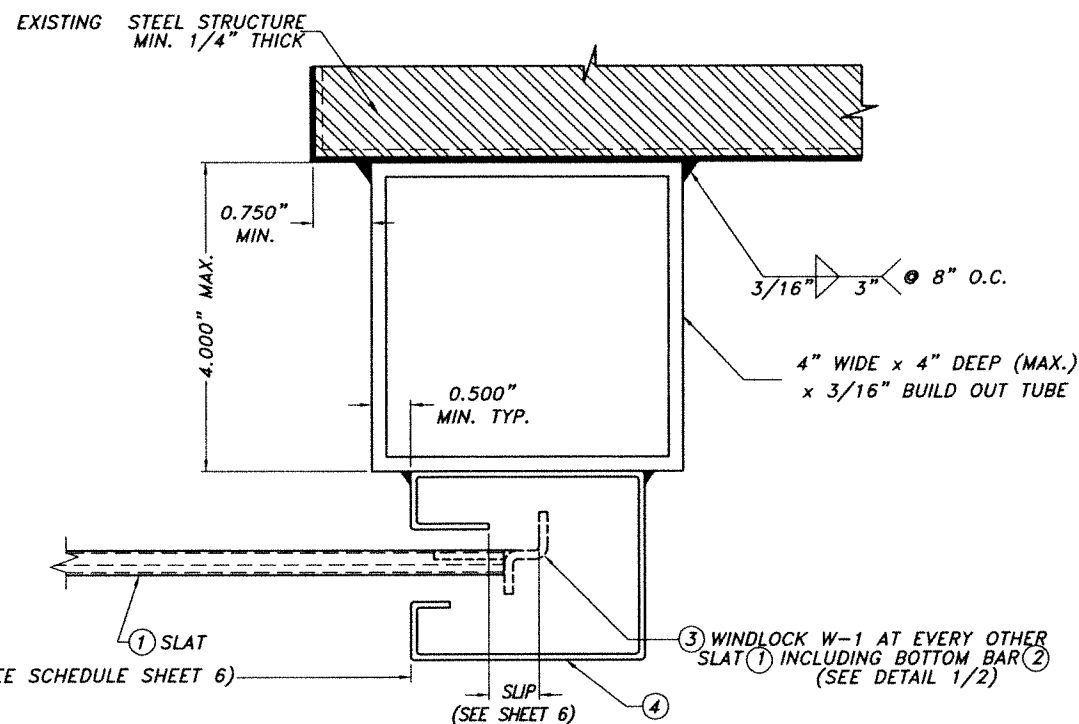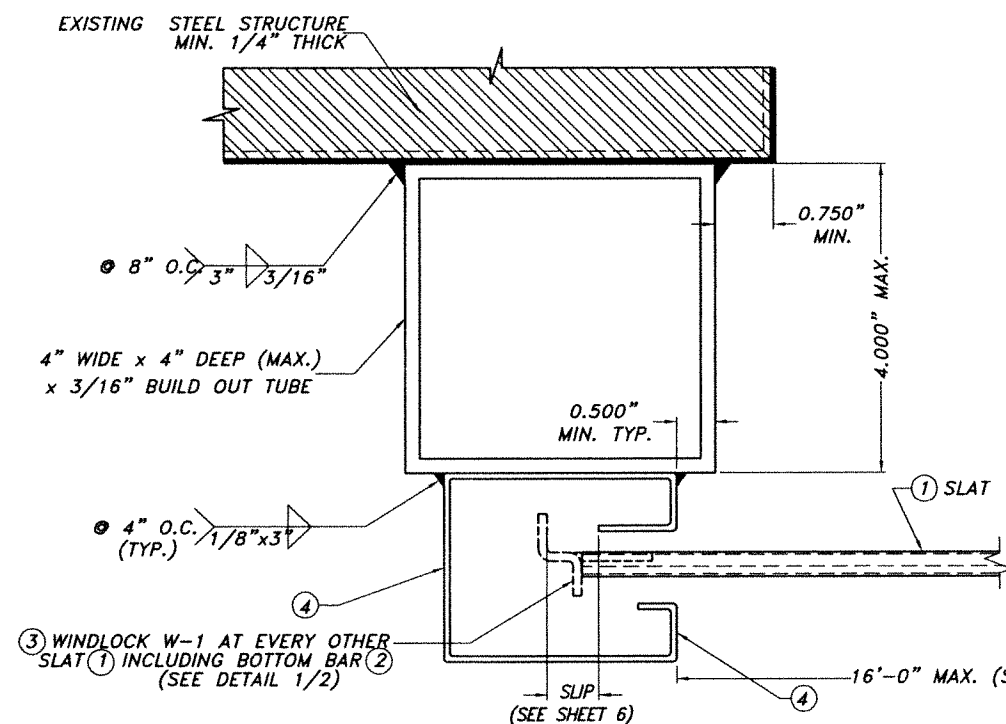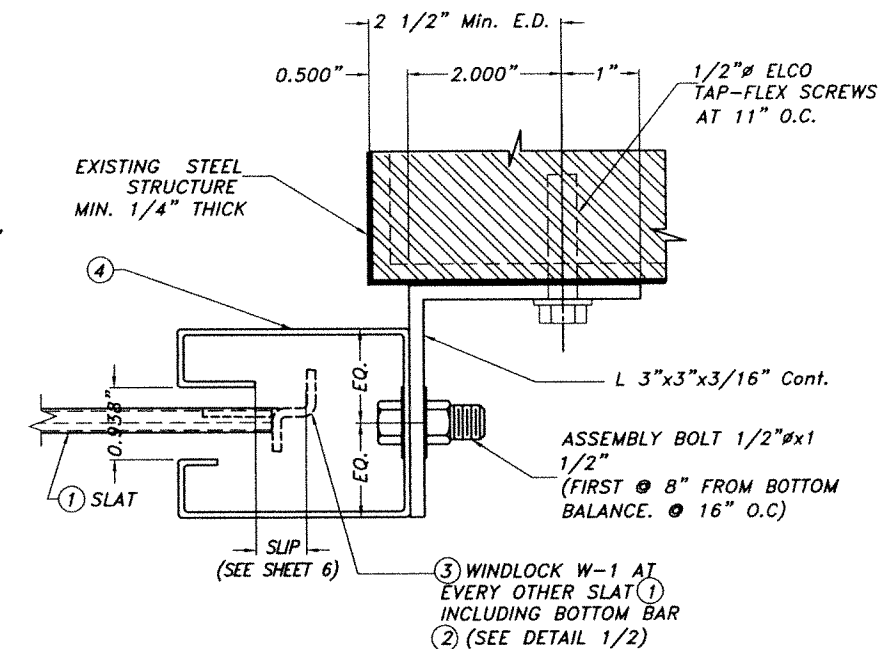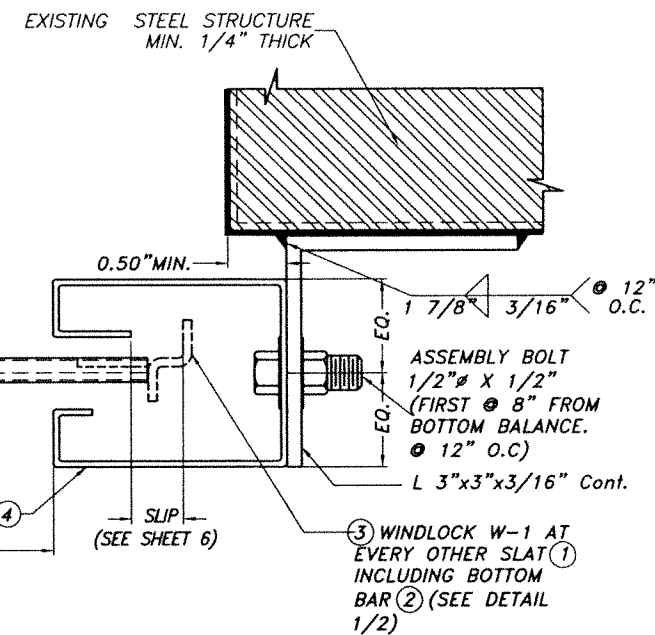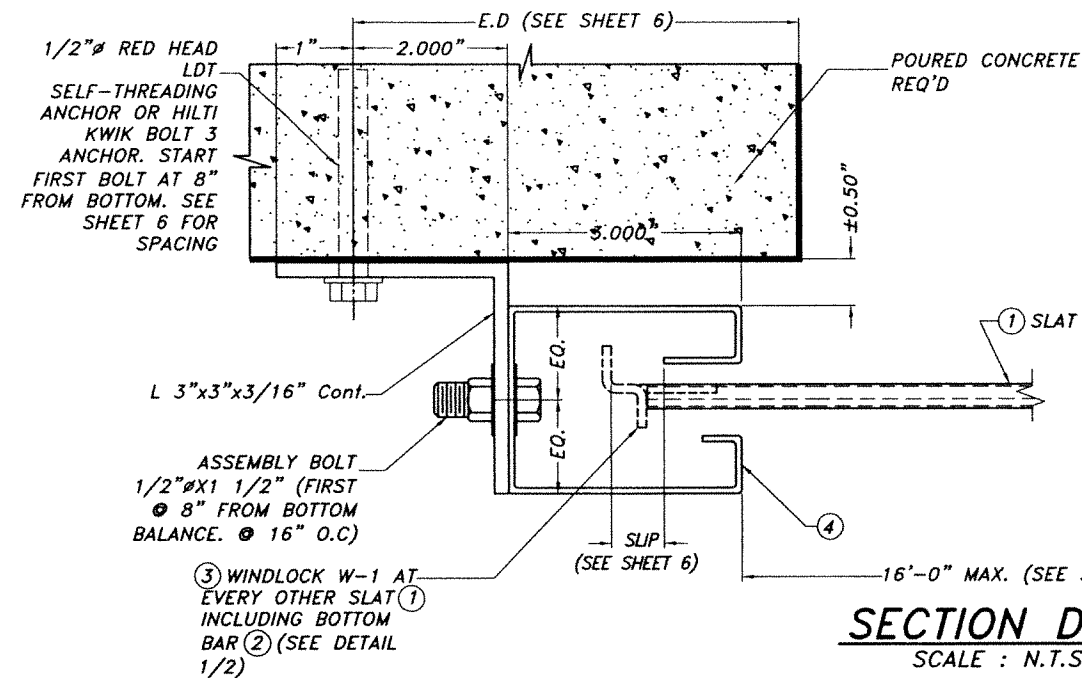

* GUIDES AT EACH JAMB MAY BE COMBINED AS NEEDED TO SUIT ANY INSTALLATION

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

16'-0" WIDE, 24 GAGE SLAT ROLL-UP DOOR

Y.M. DRAWN BY:
7/14/2023 DATE:
23-105 DRAWING No.
SHEET 5 OF 6

XOEZ IMPORT & EXPORT, INC.
dba.RollingDoors.com
7214 NW 78th TERRACE
MEDLEY, FL 33166
PHONE: (305)885-7590 EMAIL: info@rollingdoors.com

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-283	7/14/23	3	-	-
2	-	-	4	-	-


MAX. PRESSURE RATINGS, V_x & V_y REACTIONS
& ANCHOR SPACING SCHEDULE

MAXIMUM A.S.D. DESIGN PRESSURE RATING (PSF)	DOOR WIDTH (Ft.)	SLIP (In)	V _x (Lb/Ft)	V _y (Lb/Ft)	MAX. ANCHOR SPACING					
					ANCHOR TYPE					
					TYPE 1		TYPE 1A			TYPE 2
					f'c=3Ksi	f'c=4Ksi	f'c=3Ksi	f'c=4Ksi	f'c=6Ksi	1/4" STEEL
+47.0, -47.0	10'-0"	1/4"	776	250	10 1/2"	11"	11"	11"	11"	11"
	12'-0"	3/8"	994	300	8 1/2"	9"	11"	11"	11"	11"
	14'-0"	1/2"	1187	350	—	8"	10"	11"	11"	11"
	16'-0"	5/8"	1364	400	—	—	8"	10"	11"	9 1/2"
+55.0, -55.0	10'-0"	1/4"	966	275	8 1/2"	9 1/2"	11"	11"	11"	11"
	12'-0"	3/8"	1198	330	—	8"	10"	11"	11"	11"
	14'-0"	1/2"	1409	385	—	—	8"	9 1/2"	11"	9 1/2"
	16'-0"	5/8"	1605	440	—	—	6 1/2"	8"	10"	8"
+60.0, -60.0	10'-0"	1/4"	1084	300	8"	8 1/2"	11"	11"	11"	11"
	12'-0"	3/8"	1324	360	—	—	9"	10"	11"	10"
	14'-0"	1/2"	1546	420	—	—	7"	8 1/2"	10 1/2"	8 1/2"
	16'-0"	5/8"	1754	480	—	—	6"	7"	9 1/2"	7 1/2"
+70.0, -70.0	10'-0"	1/4"	1314	350	—	—	9"	10"	11"	10"
	12'-0"	3/8"	1572	420	—	—	7"	8"	10 1/2"	8 1/2"
	14'-0"	1/2"	1816	490	—	—	5 1/2"	7"	9"	7 1/2"
	16'-0"	5/8"	2049	560	—	—	4 1/2"	5 1/2"	8"	6 1/2"


ANCHOR LEGEND

CHARACTERISTICS	ANCHOR TYPE		
	TYPE 1	TYPE 1A	TYPE 2
	LDI SELF THREADING	KWIK BOLT 3 EXPANSION	TAP-FLEX FULL THREAD SCREW
DIAMETER Ø	1/2"	1/2"	1/2"
MIN. EMBEDMENT IN CONCRETE	3 1/2" *	3 1/2" *	FULL ENGAGEMENT IN 1/4" STRUCTURE
MATERIAL	ZINC PLATED GRADE 5 F _y =92 Ksi F _u =120Ksi	AISI 304 SERIES S.S	GRADE 5, SILVER STALGARD SUB COATING
MANUFACTURER	RED HEAD	HILTI INC.	ELCO CONSTRUCTION PRODUCTS
MIN. E.D	5" *	6" *	2" *
MIN. SPACING	AS PER SCHEDULE	AS PER SCHEDULE	AS PER SCHEDULE


* BEYOND ANY WALL FINISH

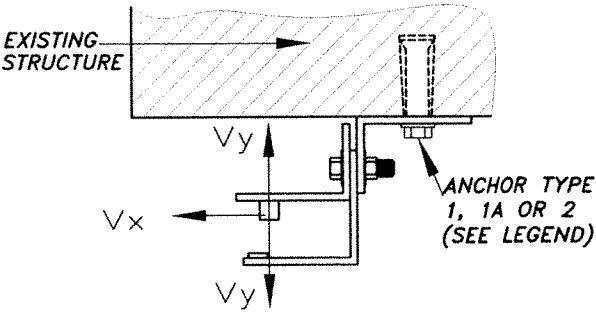

LOAD DIAGRAM: "Z" GUIDE

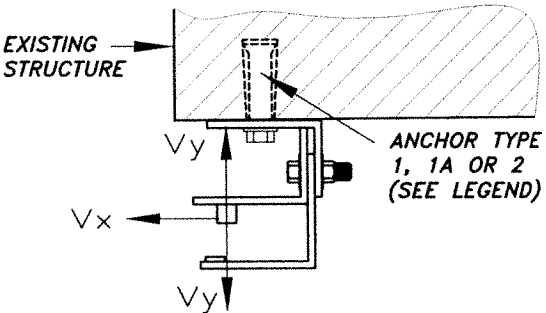

LOAD DIAGRAM: "E" GUIDE

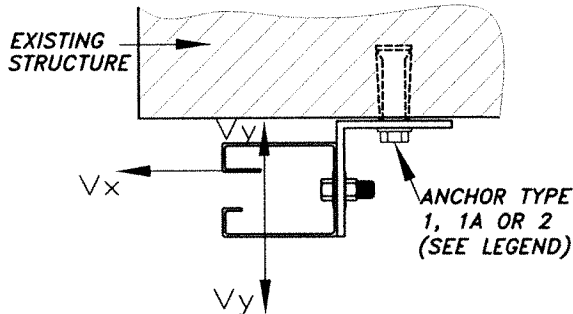

LOAD DIAGRAM: "ROLLED FORMED GUIDE"

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH & NON HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 • Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

16'-0" WIDE, 24 GAGE SLAT ROLL-UP DOOR
XOEZ IMPORT & EXPORT, INC.
dba.RollingDoors.com
7214 NW 78th TERRACE
MEDLEY, FL 33166
PHONE: (305)885-7590 EMAIL: info@rollingdoors.com
REV. NO. DESCRIPTION DATE REV. No. DESCRIPTION DATE
1 OLD 20-283 7/14/23 3 - -
2 - - 4 - -

Y.M.
DRAWN BY:
7/14/2023
DATE:
23-105
DRAWING No.
SHEET 6 OF 6