




G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23956 R3\FL-23956.1-3.dwg

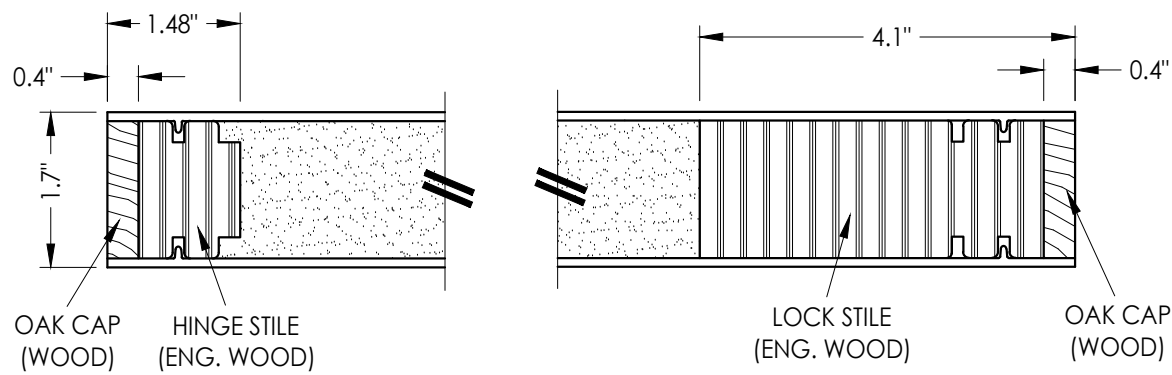


1
2 HORIZONTAL CROSS SECTION

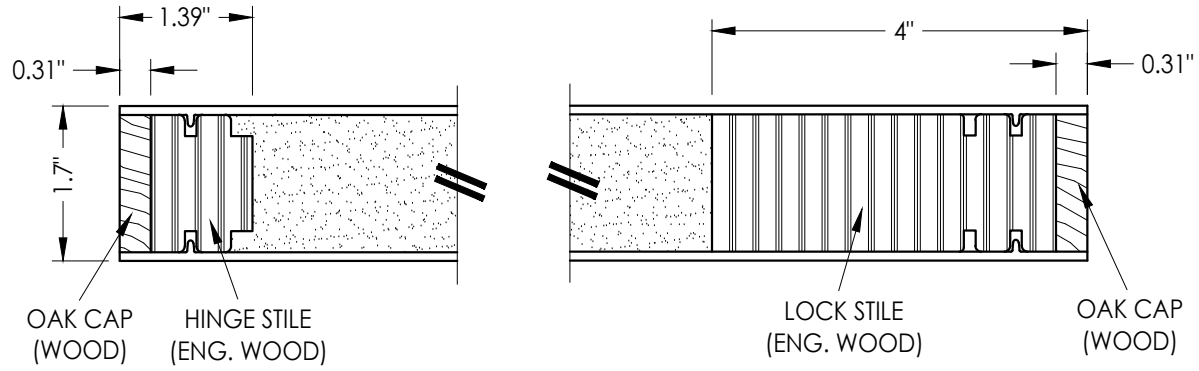


2
2 HORIZONTAL CROSS SECTION

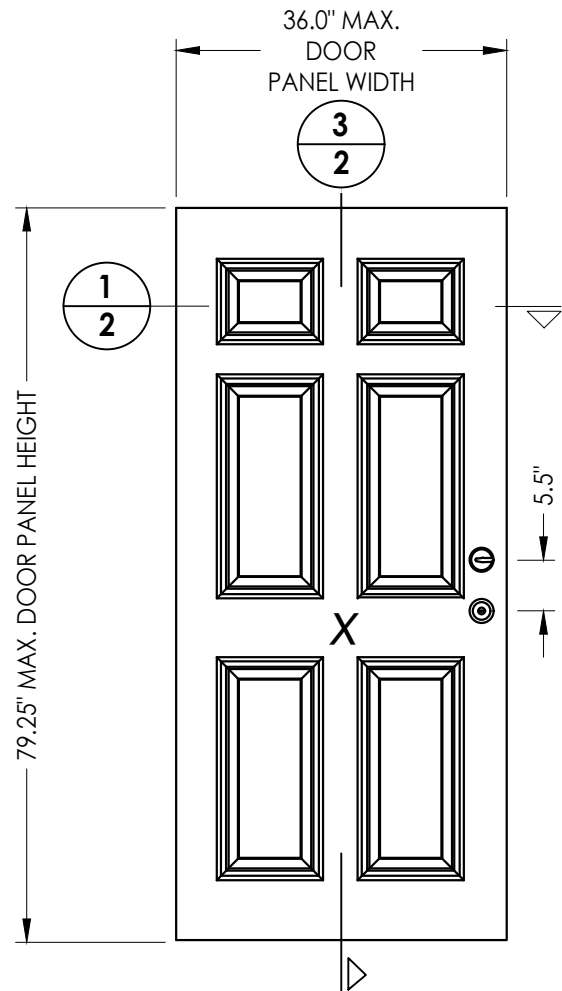


40 DOOR PANEL
BOOK

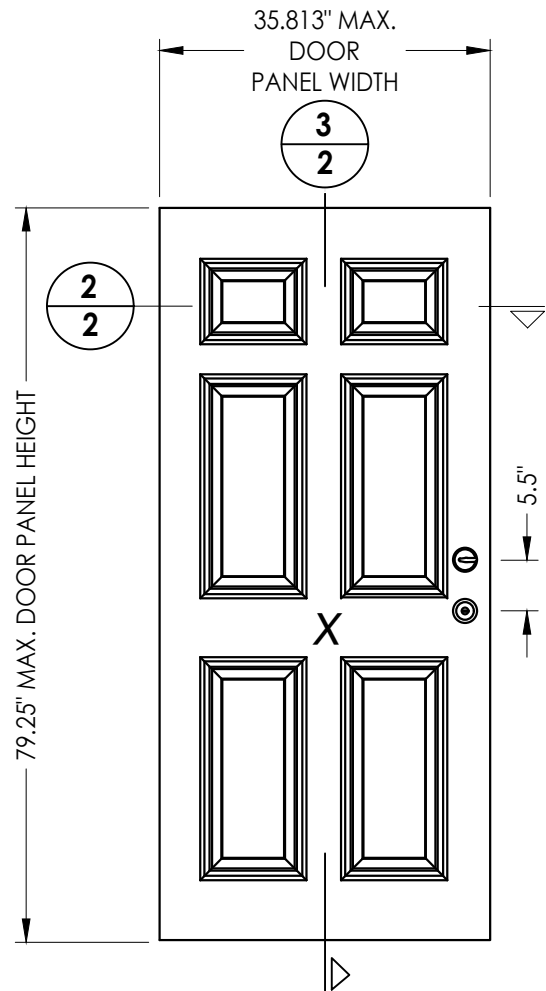


41 DOOR PANEL
Hybrid Door

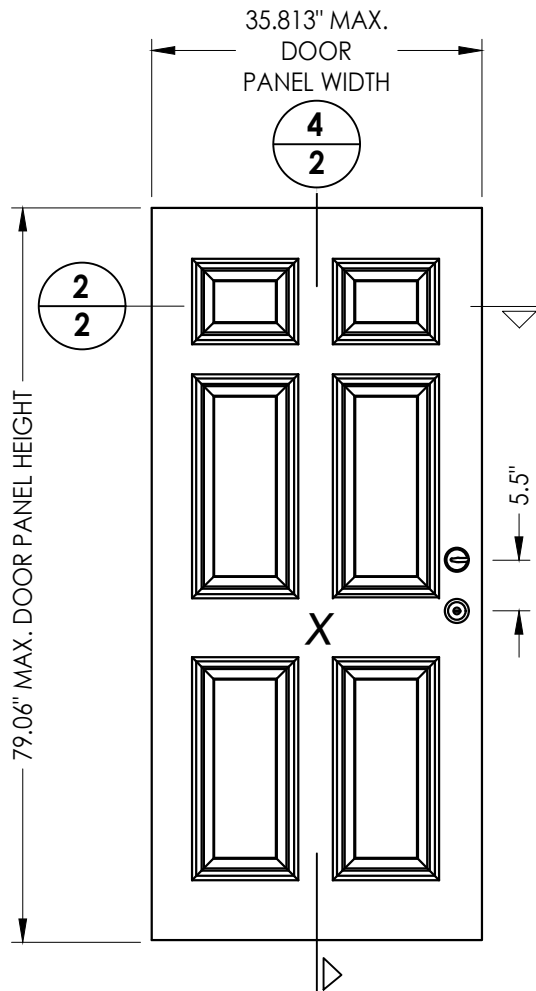

42 DOOR PANEL
U1 Door

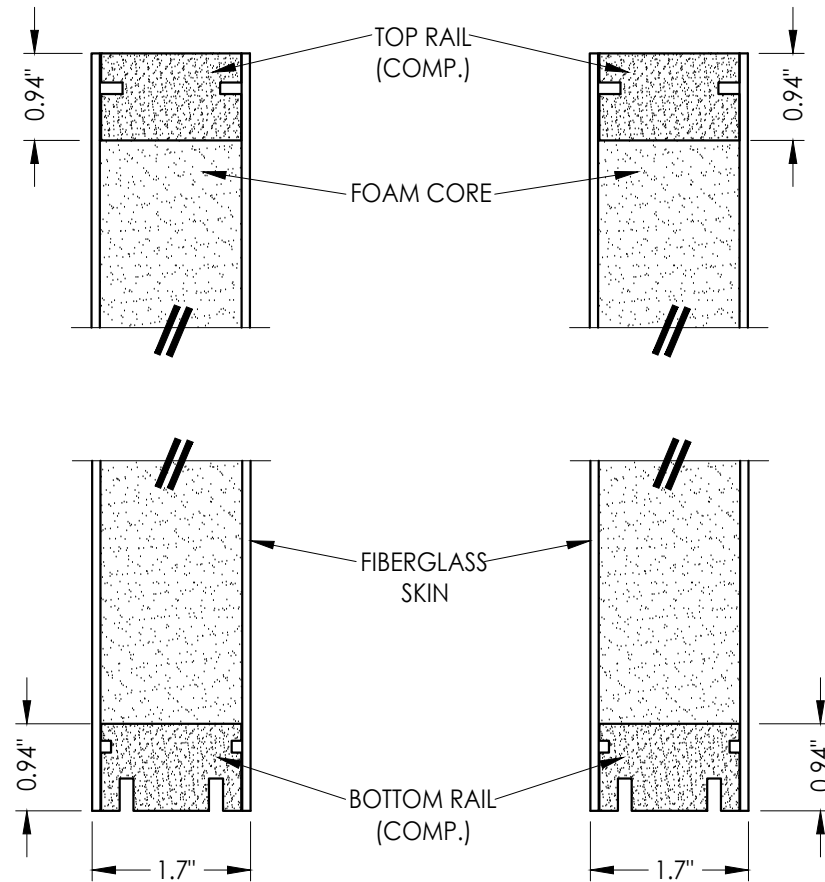

3
2 VERTICAL CROSS SECTION

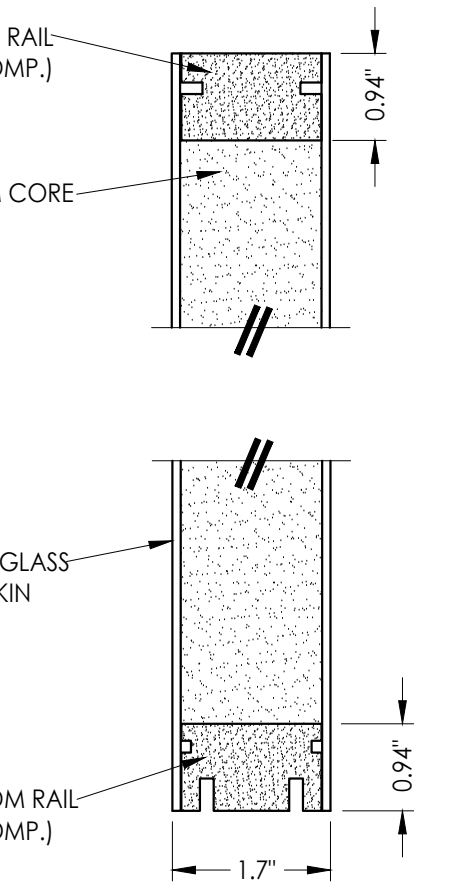

4
2 VERTICAL CROSS SECTION

"Classic-Craft" SERIES DOOR PANEL
FIBERGLASS DOOR SKIN: 0.095" MIN. THK.
FOAM CORE: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	BY	REVISIONS
3	7/01/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/08/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/23/20	UPDATE TO 7TH ED (2020)	FBC LFS

DATE: 4/13/20


SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.: FL-23956.1

SHEET 2 OF 10

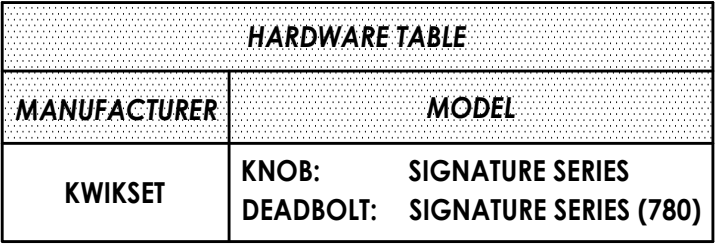

HARDWARE TABLE		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (780)



Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197
EBDE Boats: No. 0813

FBI Registry No. 3013


PRODUCT:

THERMA-TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:

ELEVATIONS


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23956 R3\FL-23956.1-3.dwg

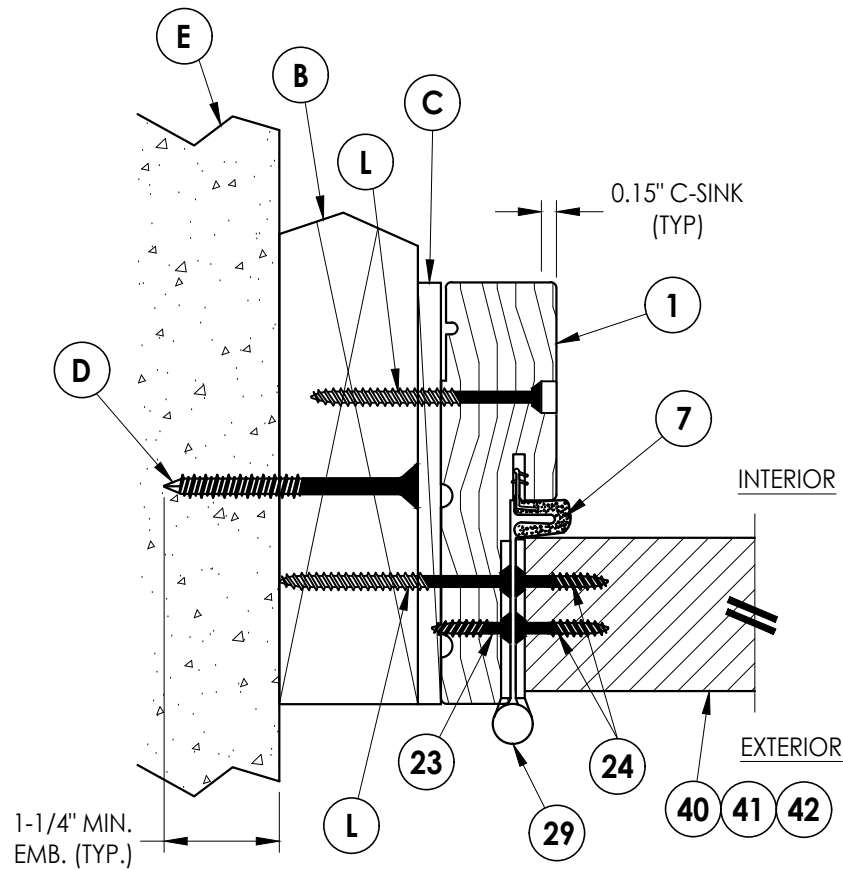

2 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

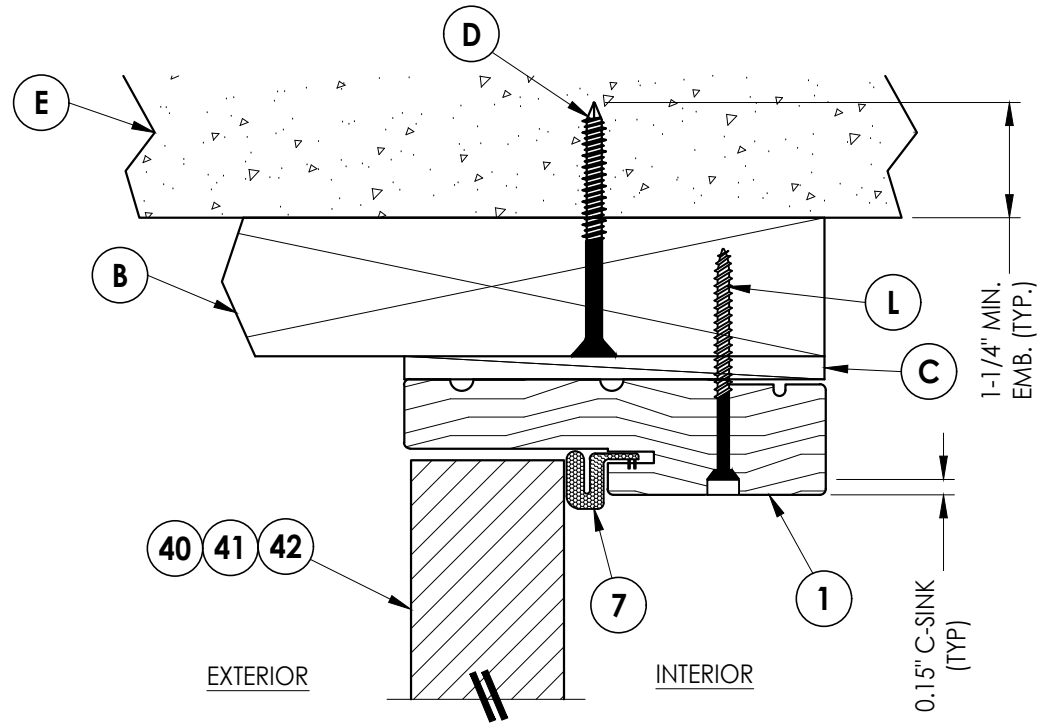

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

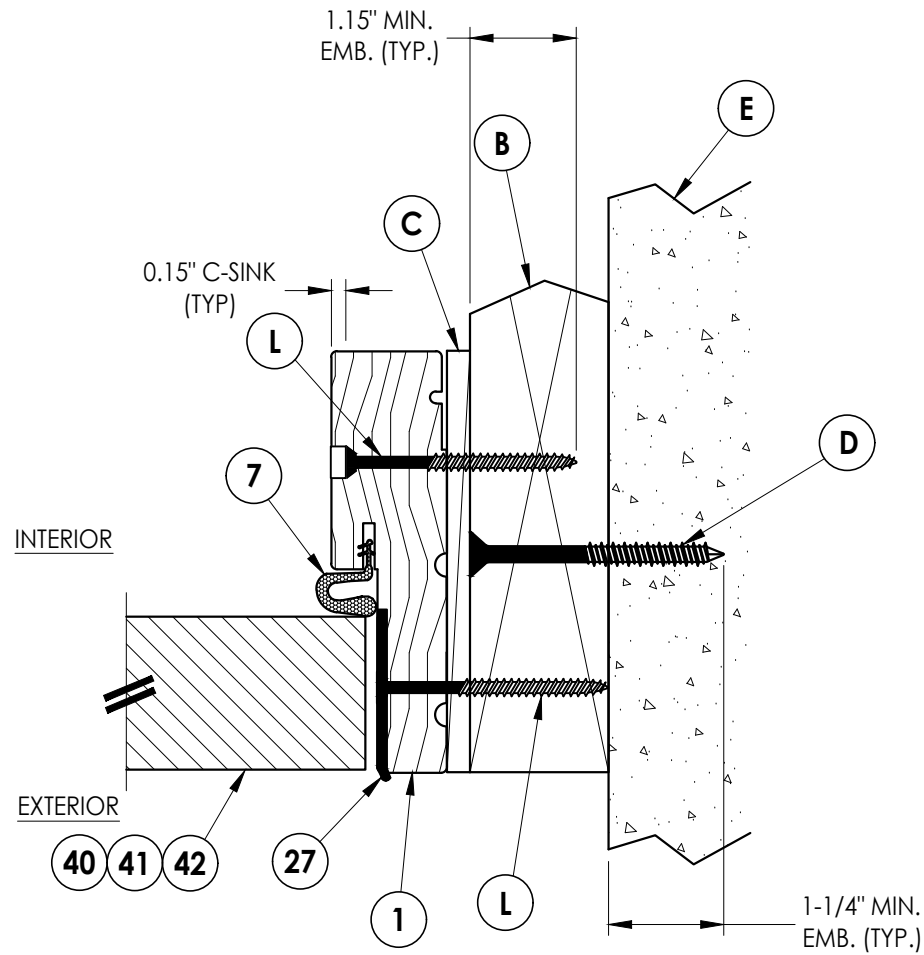

3 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

REVISIONS		NO.	DATE	BY
3	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
2	8/08/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
1	7/23/20	UPDATE TO 7TH ED (2020)	FBC	LFS

DATE: 4/13/20

SCALE: N.T.S.

DWG. BY: RW


CHK. BY: LFS

DRAWING NO.:


FL-23956.1

SHEET 4 OF 10


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23956 R3\FL-23956.1-3.dwg

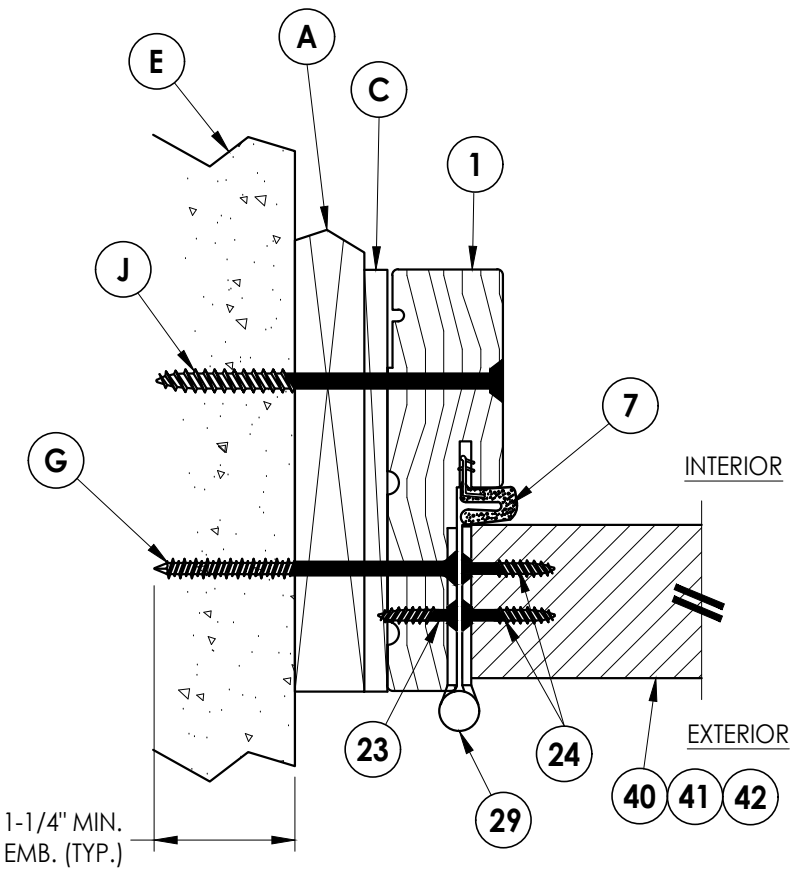

2 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

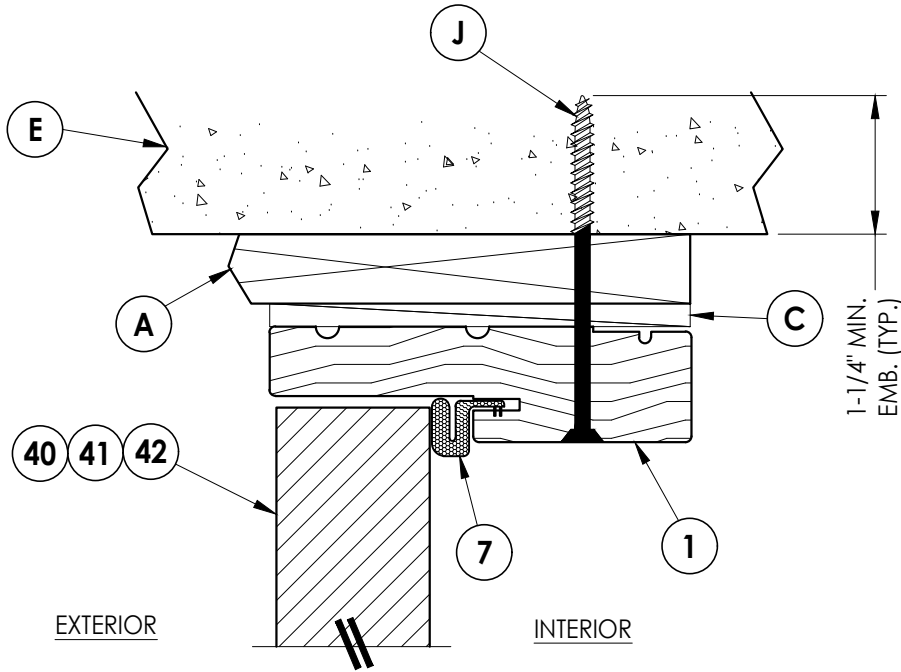

1 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

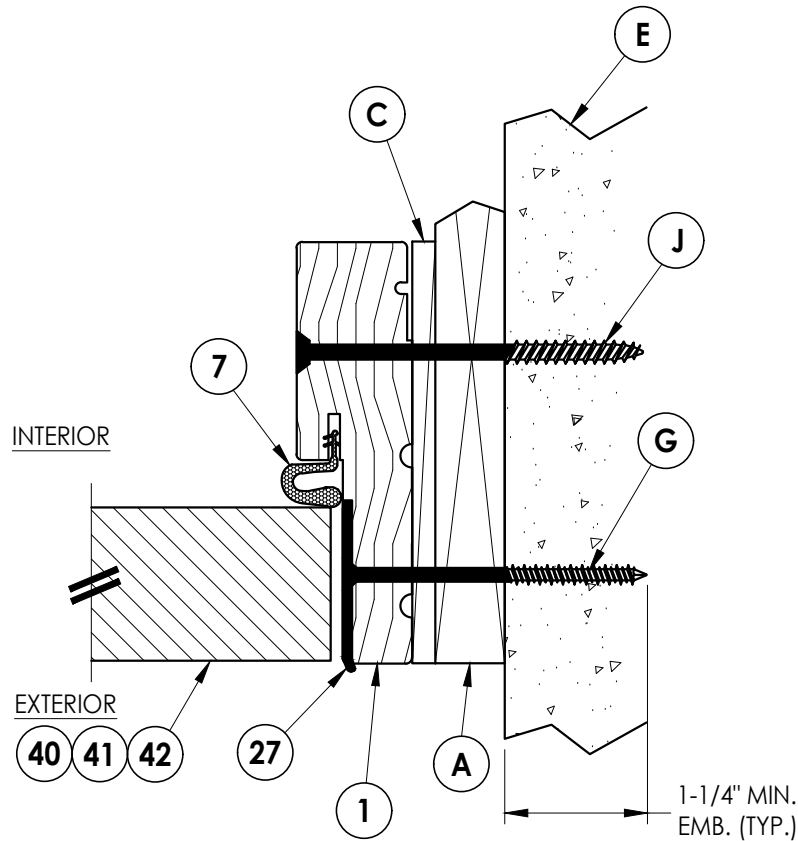

3 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

REVISIONS			
NO.	DATE	BY	
3	7/01/26	UPDATE TO 9TH ED. (2026)	FBC LFS
2	8/08/23	UPDATE TO 8TH ED. (2023)	FBC LFS
1	7/23/20	UPDATE TO 7TH ED (2020)	FBC LFS

DATE: 4/13/20

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:

FL-23956.1


SHEET 5 OF 10

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813




DATE: 4/13/20		PRODUCT: THERMA-TRU FIBERGLASS DOOR	
SCALE: N.T.S.		PART OR ASSEMBLY: HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)	
DWG. BY: RW			
CHK. BY: LFS			
DRAWING NO.: FL-23956.1			
SHEET 6 OF 10			


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Notes:
1. Sill Item #'s 13, 16, 17, 19, 20, 43, 44, 45, 46, 47 & 48 are attached to jambs
w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item # 14 is attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item # 18 is attached to jambs utilizing (4) #10 X 1-1/2" pph screws at each end.

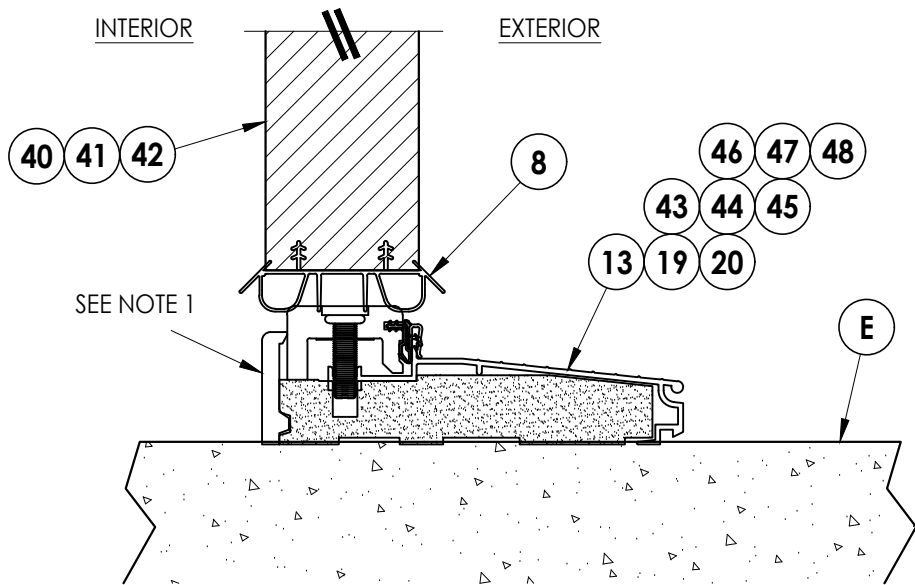


1
7 VERTICAL CROSS SECTION
Inswing Sill

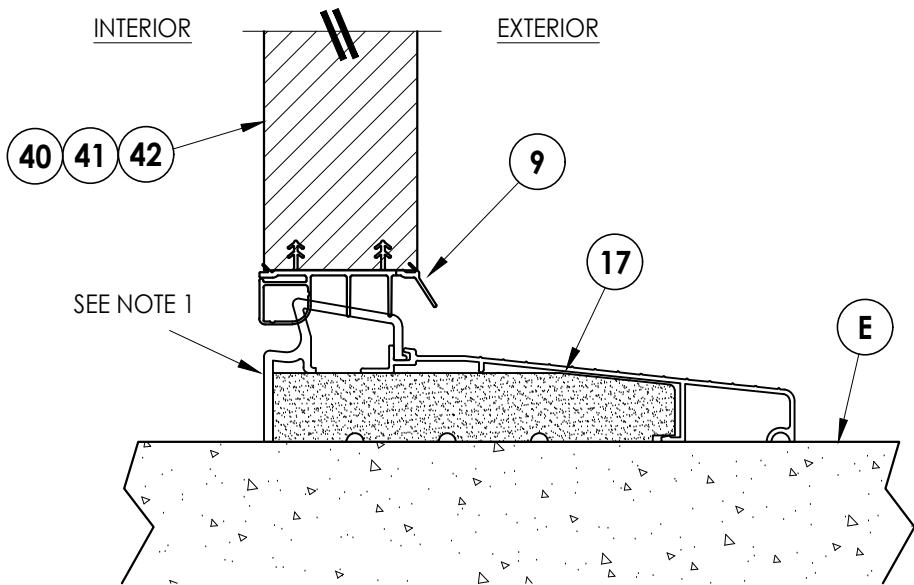

2
7 VERTICAL CROSS SECTION
Inswing Sill

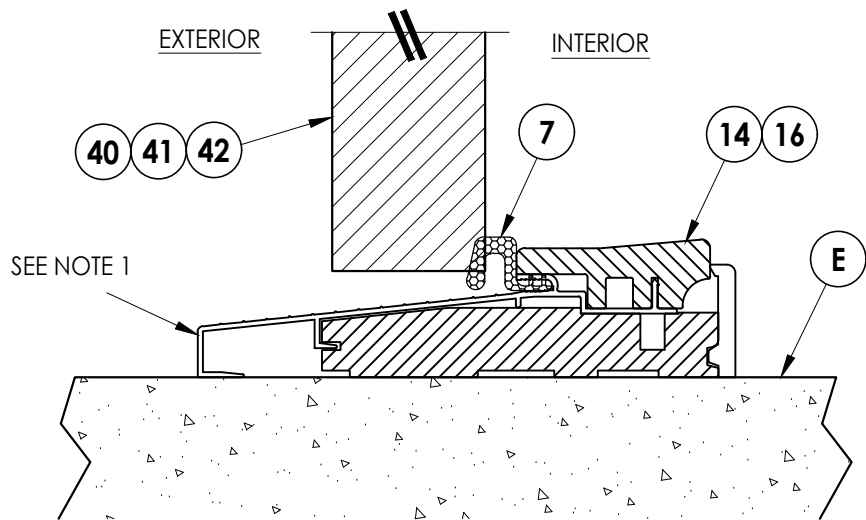

3
7 VERTICAL CROSS SECTION
Outswing Sill

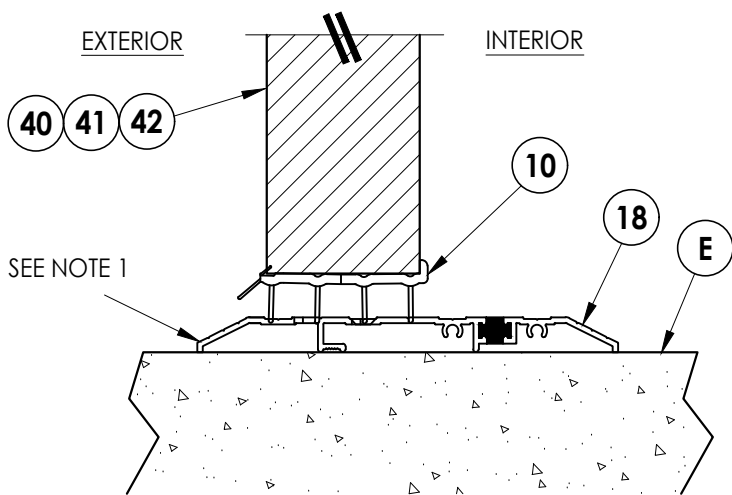

4
7 VERTICAL CROSS SECTION
Public Access Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS		
		BY	DATE	DESCRIPTION
3	7/01/26	LFS		UPDATE TO 9TH ED. (2026) FBC
2	8/08/23	LFS		UPDATE TO 8TH ED. (2023) FBC
1	7/23/20	LFS		UPDATE TO 7TH ED (2020) FBC

DATE: 4/13/20

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:

FL-23956.1

SHEET 7 OF 10


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23956 R3\FL-23956.1-3.dwg




© 2020 R.W. BUILDING CONSULTANTS INC.

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-23956 R3\FL-23956.1-3.dwg

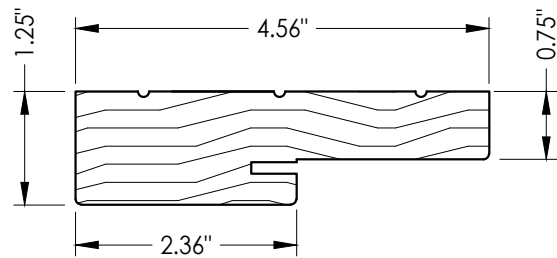


1 WOOD JAMB

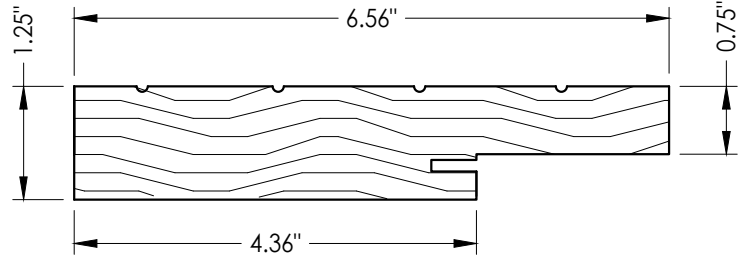


2 WOOD JAMB




8 SWEEP




9 SWEEP




10 SWEEP

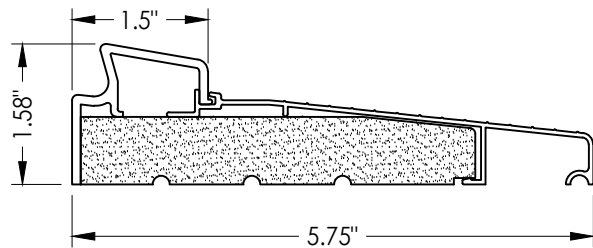


17 INSWING THRESHOLD
Basic Fixed

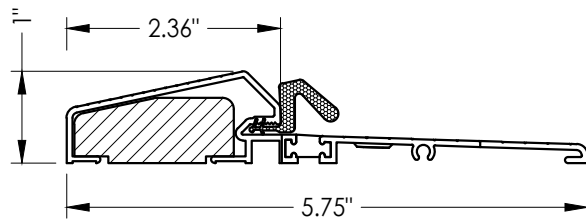


14 OUTSWING THRESHOLD

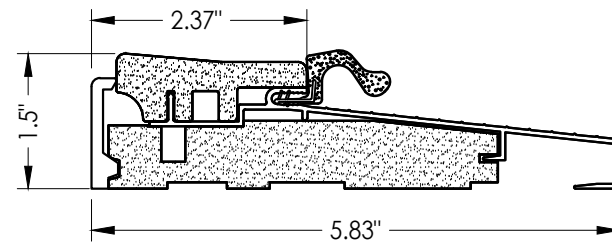


16 OUTSWING THRESHOLD

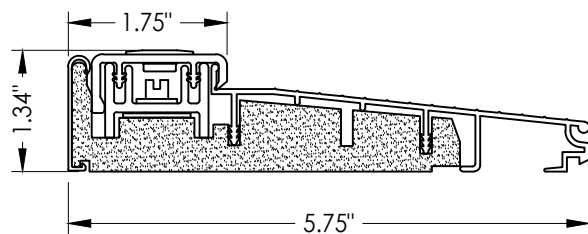


13 INSWING THRESHOLD
Adjustable

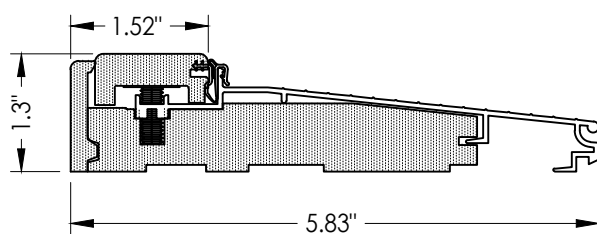


19 INSWING THRESHOLD
Adjustable

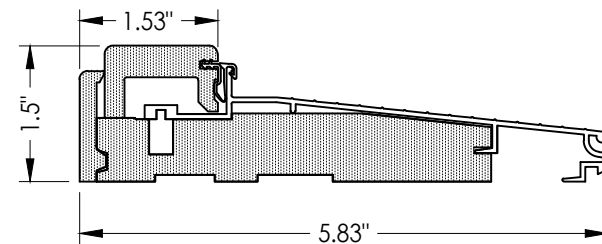


20 INSWING THRESHOLD
Adjustable

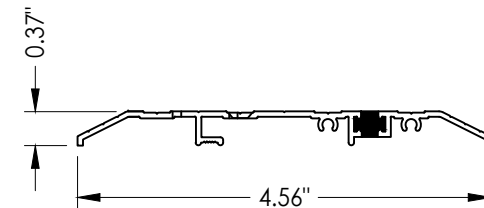


18 PUBLIC ACCESS THRESHOLD

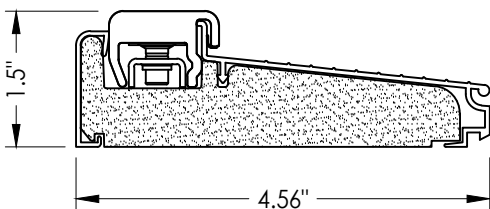


43 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

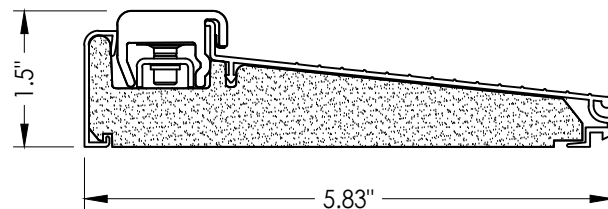


44 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

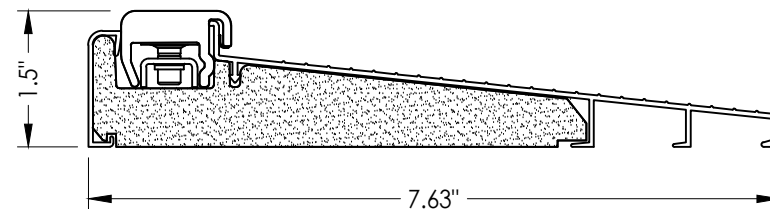


45 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

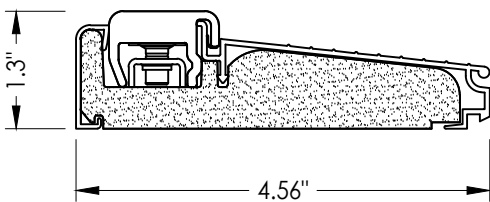

46 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

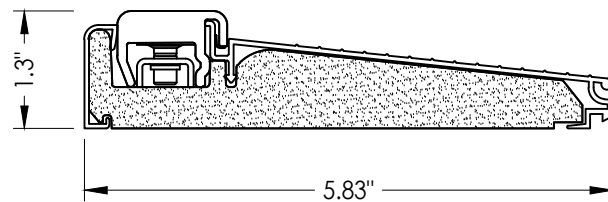

47 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

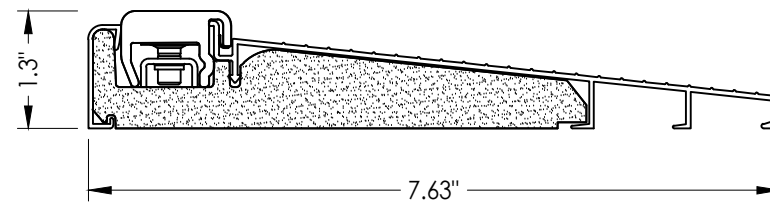

48 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
3	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
2	8/08/23	UPDATE TO 8TH ED. (2023) FBC LFS
1	7/23/20	UPDATE TO 7TH ED. (2020) FBC LFS

DATE: 4/13/20

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.: FL-23956.1

SHEET 9 OF 10

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
P	1/4" X 2-3/4" PFH DeWALT CONCRETE SCREW	STEEL
1	JAMB (FINGER JOINT PINE)	WOOD
2	JAMB (FINGER JOINT PINE)	WOOD
7	WEATHERSTRIP	FOAM
8	SWEEP	VINYL
9	SWEEP	VINYL
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL
13	INSWING THRESHOLD	ALUM/COMP
14	OUTSWING THRESHOLD	ALUM/COMP
16	OUTSWING THRESHOLD	ALUM/COMP
17	INSWING THRESHOLD	ALUM/COMP
18	PUBLIC ACCESS THRESHOLD	ALUM
19	INSWING THRESHOLD	ALUM/COMP
20	INSWING THRESHOLD	ALUM/COMP
23	#10 X 3/4" PFH WOOD SCREW	STEEL
24	#10 X 1" PFH WOOD SCREW	STEEL
25	#8 X 2-1/2" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE	STEEL
29	4" X 4" HINGE	STEEL
40	DOOR PANEL (BOOK DOOR)	-
41	DOOR PANEL (HYBRID DOOR)	-
42	DOOR PANEL (U1 DOOR)	-
43	INSWING THRESHOLD	ALUM/COMP
44	INSWING THRESHOLD	ALUM/COMP
45	INSWING THRESHOLD	ALUM/COMP
46	INSWING THRESHOLD	ALUM/COMP
47	INSWING THRESHOLD	ALUM/COMP
48	INSWING THRESHOLD	ALUM/COMP

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRAON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]