

6/14/2022 2:48 PM

s:\projects\andersen windows\fbc-22-0301 - fbc submittal - fl24174.2 & fl24174.3\dwgs\awd311.dwg

ANDERSEN CORPORATION

A-SERIES FIXED SPECIALTY PG UPGRADE SASH SET WINDOW (NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.


GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INTERNATIONAL BUILDING CODE & INTERNATIONAL RESIDENTIAL CODE, **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PONDEROSA PINE & LVL
- WINDOW CLADDING MATERIAL: ALUMINUM 6063-T5 & 6063-T4
- IN ACCORDANCE WITH THE FBC, DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS PER CH 20.
- IN ACCORDANCE WITH THE FBC, WOOD COMPONENTS SHALL HAVE BEEN PRESERVATIVE TREATED OR SHALL BE OF A DURABLE SPECIES AS PER CH 23.
- LVL WINDOW FRAME MATERIAL COMPLIES WITH APPLICABLE STANDARDS SET FORTH IN THE FBC.
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 5 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	GLAZING DETAIL, ANCHOR DETAILS, & QUALIFIED CONFIGURATIONS

DESIGN PRESSURE RATING			
OVERALL SIZE		DESIGN PRESSURE	MISSILE IMPACT RATING
WIDTH	HEIGHT		
75"	125"	+/- 70 PSF	NON-IMPACT

NOTE:
UNIT HEIGHT & WIDTH ARE INTERCHANGEABLE.
SEE BELOW FOR DETAILS.

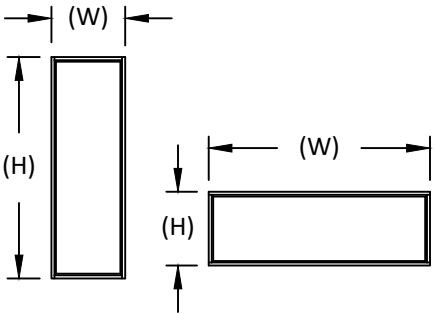

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096

PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
A-SERIES FIXED
SPECIALTY PG UPGRADE
SASH SET WINDOW
(NON-HVHZ)(NON-IMPACT)
INSTALLATION & GENERAL NOTES


PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 47-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2022.06.14 12:34:40 -04'00'

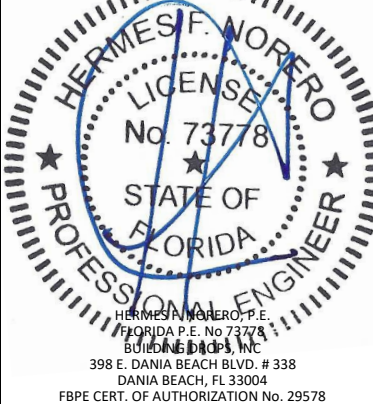

FL #:

FL24174

DATE: 06.13.22

DWG. BY: SH

CHK. BY: HFN

SCALE: NTS

DWG. #: AWD311


SHEET:

1

OF 5

6/14/2022 2:48 PM


s:\projects\andersen windows\lbc-22-0301 - fbc submittal - fl24174.2 & fl24174.3.dwg

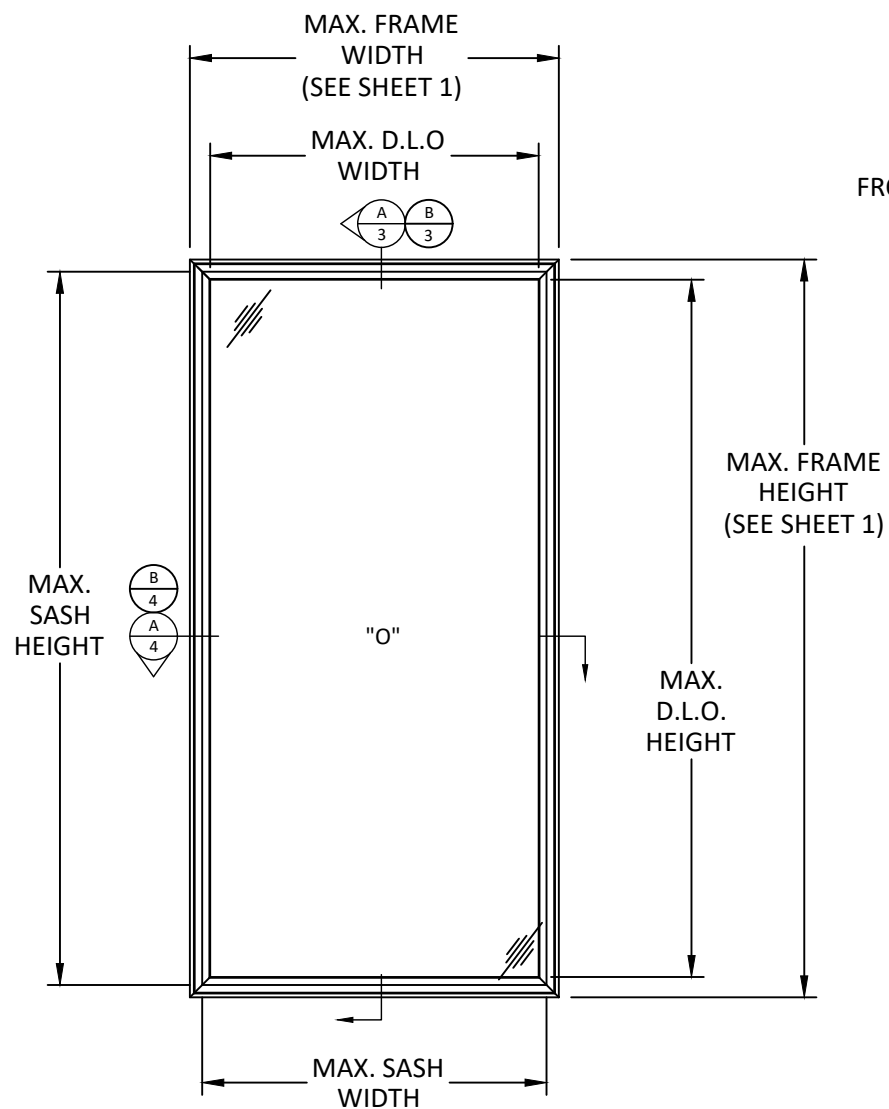

TYPICAL ELEVATION


SASH HEIGHT = FRAME HEIGHT - 2.5"
SASH WIDTH = FRAME WIDTH - 2.5"

D.L.O. HEIGHT = FRAME HEIGHT - 6.5"
D.L.O. WIDTH = FRAME WIDTH - 6.5"

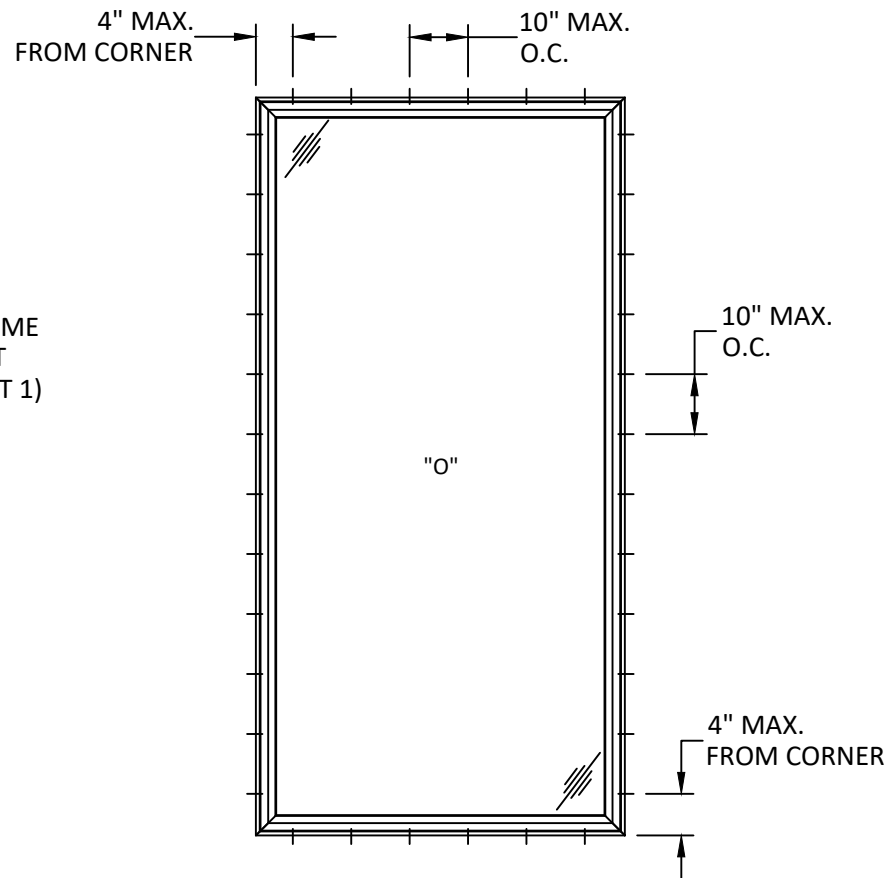


ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

NOTE:
INSTALLATION CLIP AND NAIL FIN
MUST BE USED WITH ONE
ANOTHER.

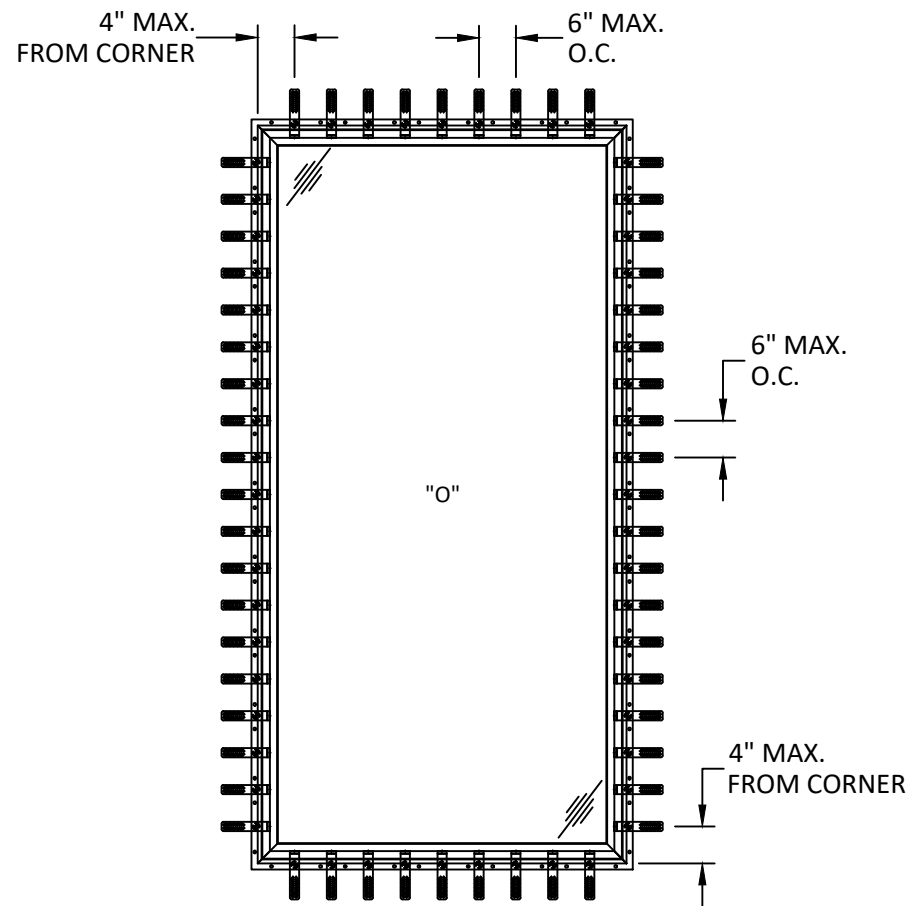

ANCHOR LAYOUT
INSTALLATION CLIPS
AND NAIL FIN

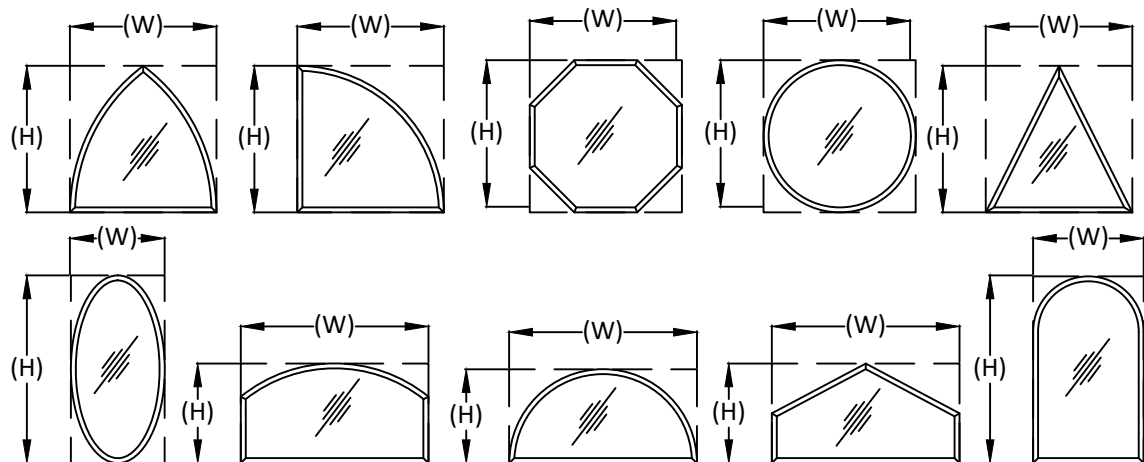

UNITS OF ANY SHAPE ARE ALLOWED PROVIDED CONSTRUCTION, GLAZING, & ANCHORAGE ARE PER DETAILS SHOWN HEREIN. ALL SHAPED UNITS SHALL FIT WITHIN THE RECTANGULAR AREAS AS SHOWN AND VERIFIED BY OBTAINING THE ALLOWABLE PERFORMANCE RATING ON SHEET 1.

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN. EMBEDMENT	MIN. EDGE DISTANCE	SPACING
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW PAN HEAD	1.50"	0.75"	4" FROM CORNERS 4" ON CENTER
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#8 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"	
THROUGH INSTALLATION CLIP	WOOD: MIN. SG = 0.55	#10 PAN HEAD WOOD SCREW	1.50"	0.75"	SEE ELEVATION ABOVE
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#10 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"	
THROUGH FRAME	WOOD: MIN. SG = 0.55	#12 WOOD SCREW PAN HEAD	1.50"	0.75"	SEE ELEVATION ABOVE
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#12 TEK SCREW	3 THREADS MIN. PENETRATION BEYOND METAL	0.50"	
	CONCRETE: MIN. COMPRESSIVE STRENGTH 3000 PSI	3/16" ITW TAPCON	1.25"	2.50"	
	CMU: CONFORMING TO ASTM C-90. MIN. COMPRESSIVE STRENGTH 2000 PSI				



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES FIXED
SPECIALTY PG UPGRADE
SASH SET WINDOW
(NON-HVHZ)(NON-IMPACT)
ELEVATION, ANCHOR LAYOUTS, &
QUALIFIED SHAPES

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT



FL #:
FL24174

DATE: **06.13.22**


DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **AWD311**


SHEET:
2
OF 5

6/14/2022 2:48 PM
s:\projects\andersen windows\lbc-22-0301 - fbc submittal - fl24174.2 & fl24174.3.dwg
s:\projects\andersen windows\lbc-22-0301 - fbc submittal - fl24174.2 & fl24174.3.dwg

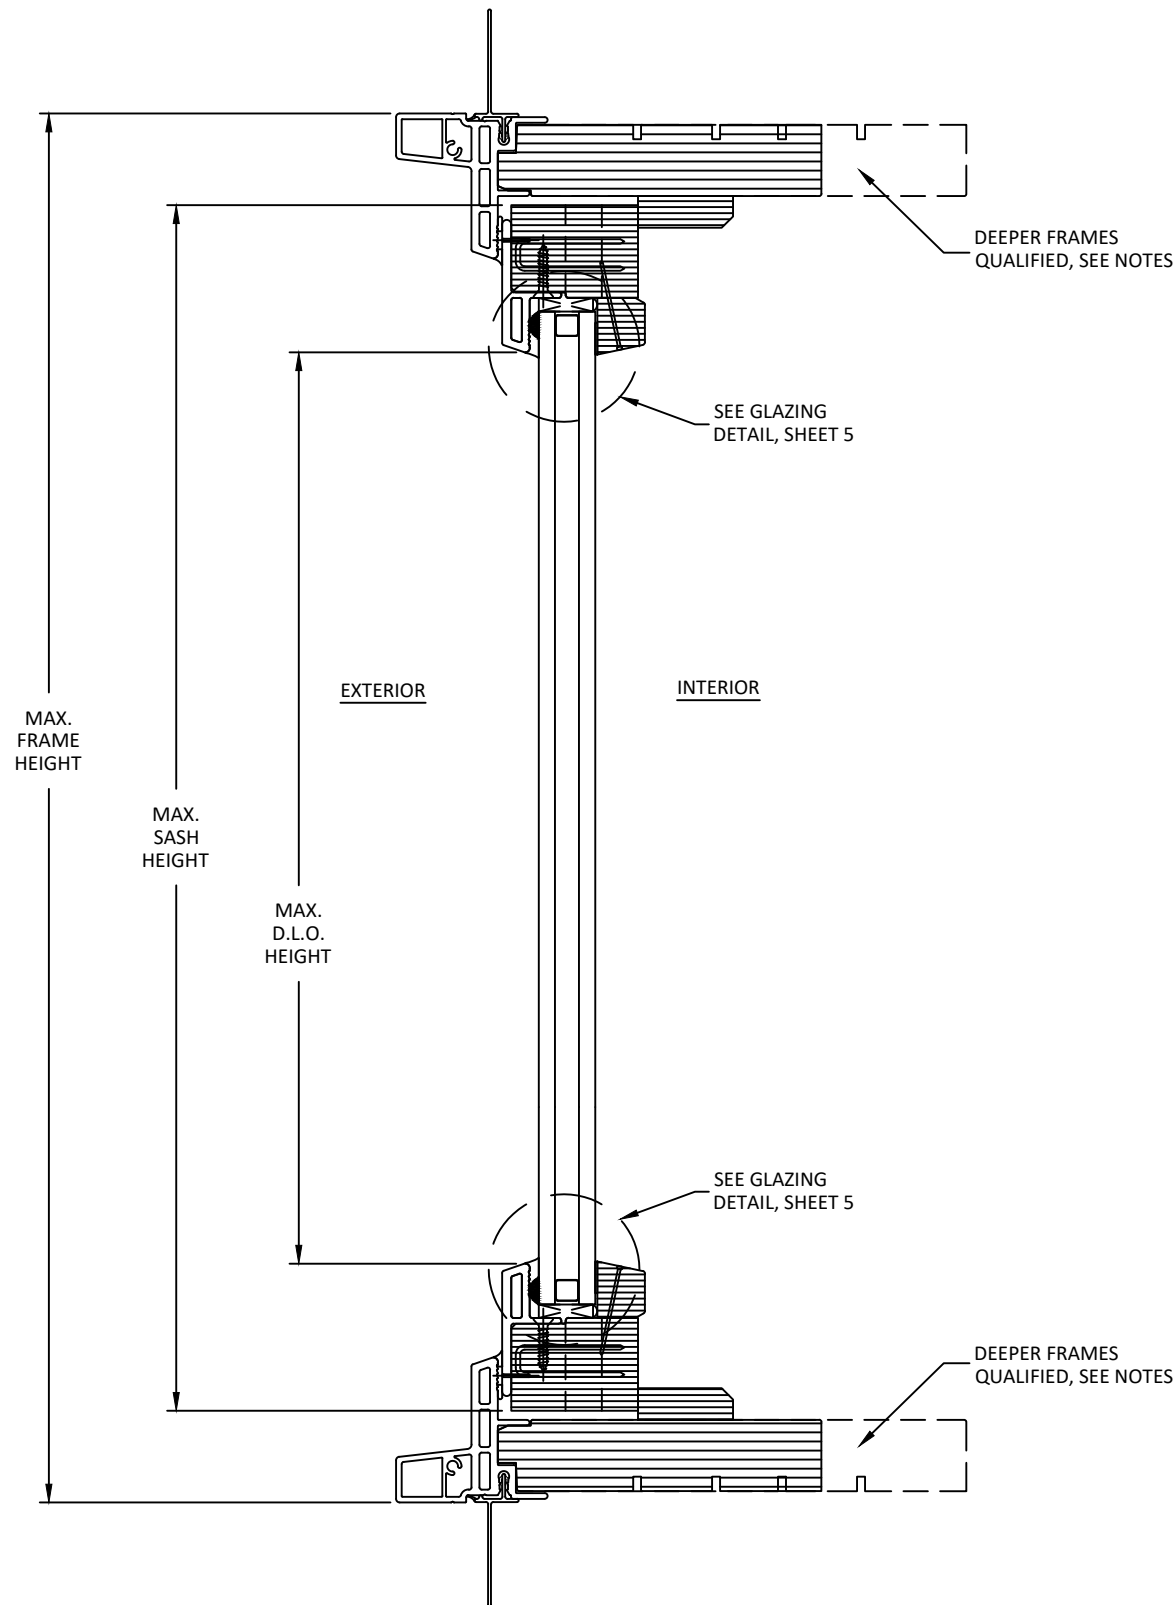

A
3 **VERTICAL SECTION**
CURVED FRAME

- NOTE:
1. DEEPER FRAME TYPES ARE QUALIFIED BY MINIMUM DEPTH TESTED (HATCHED PROFILES).
 2. WALL CONDITIONS MUST ACCOMMODATE FRAME DEPTH AND PROVIDE SUPPORT ALONG ENTIRE FRAME.

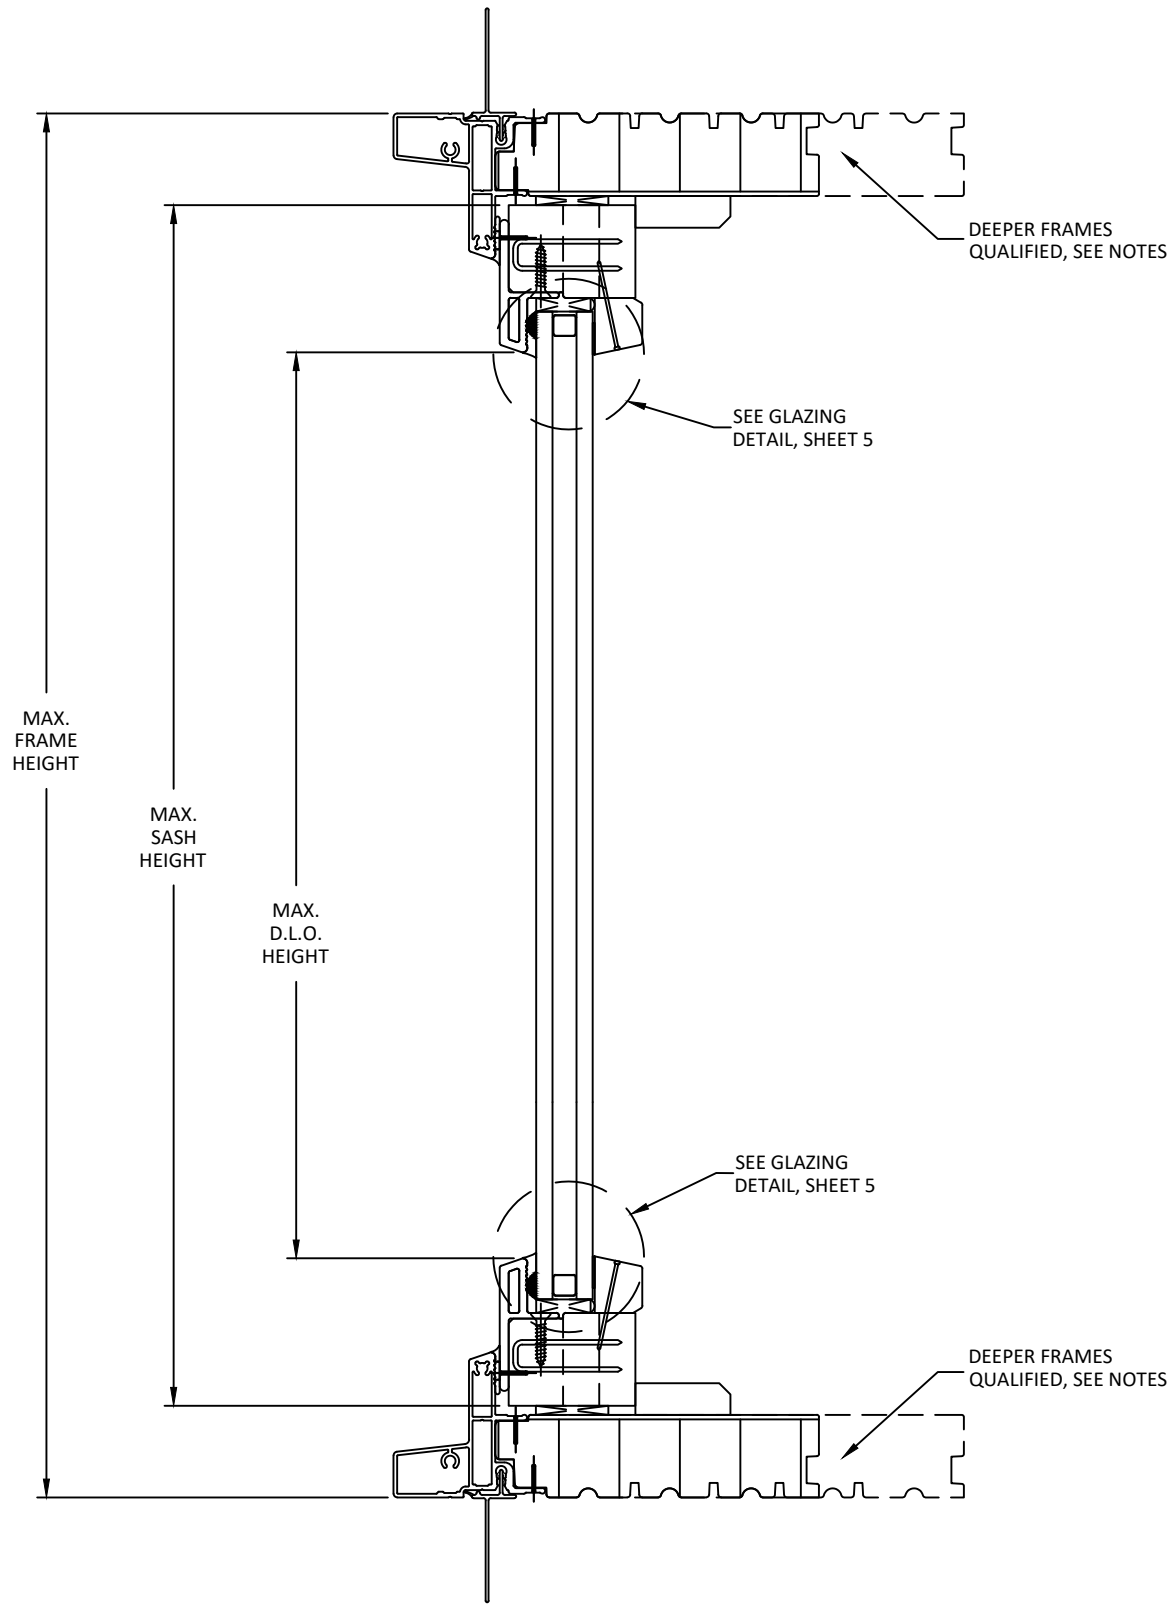

B
3 **VERTICAL SECTION**
LINEAL FRAME



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: **A-SERIES FIXED
SPECIALTY PG UPGRADE
SASH SET WINDOW
(NON-HVHZ)(NON-IMPACT)
VERTICAL SECTIONS**

PREPARED BY: **BUILDING DROPS, INC.**
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

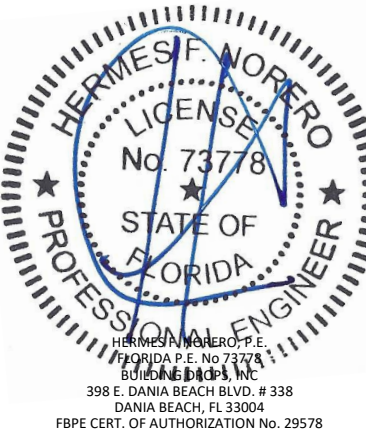

FL #: **FL24174**

DATE: **06.13.22**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **AWD311**

SHEET:

3


OF 5

s:\projects\andersen windows\fbc-22-0301 - fbc submittal - f24174.2 & f24174.3.dwg
6/14/2022 2:48 PM

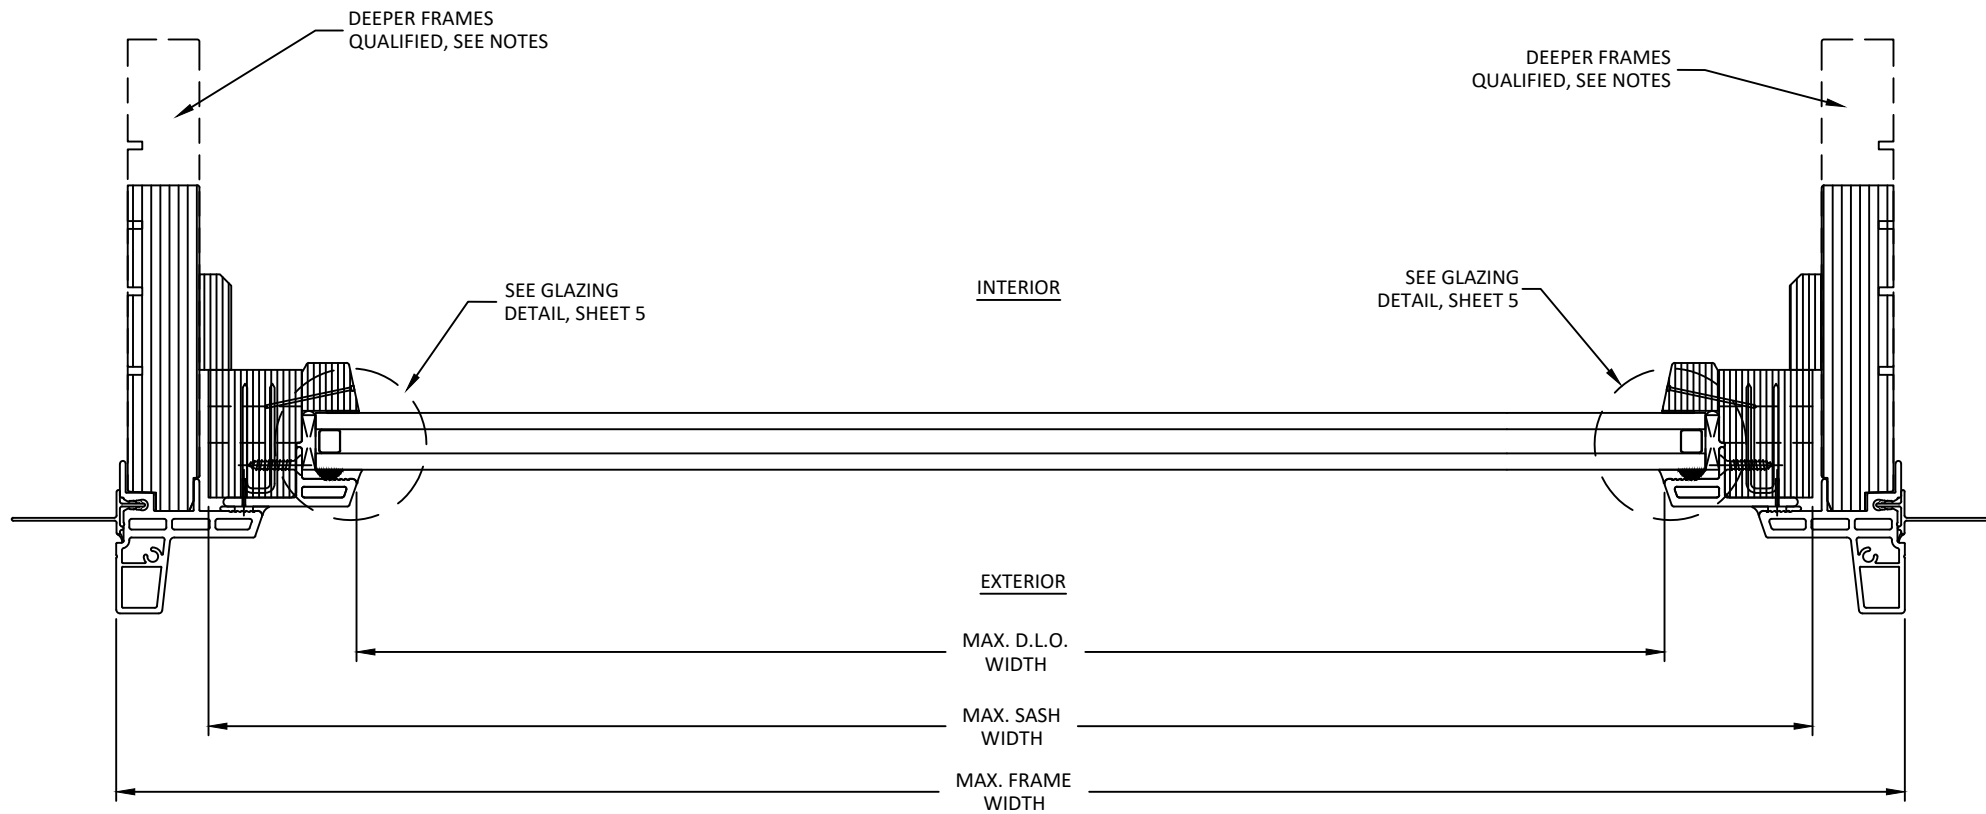

A
4 **HORIZONTAL SECTION**
CURVED FRAME

NOTE:
1. DEEPER FRAME TYPES ARE QUALIFIED BY MINIMUM DEPTH TESTED (HATCHED PROFILES).
2. WALL CONDITIONS MUST ACCOMMODATE FRAME DEPTH AND PROVIDE SUPPORT ALONG ENTIRE FRAME.

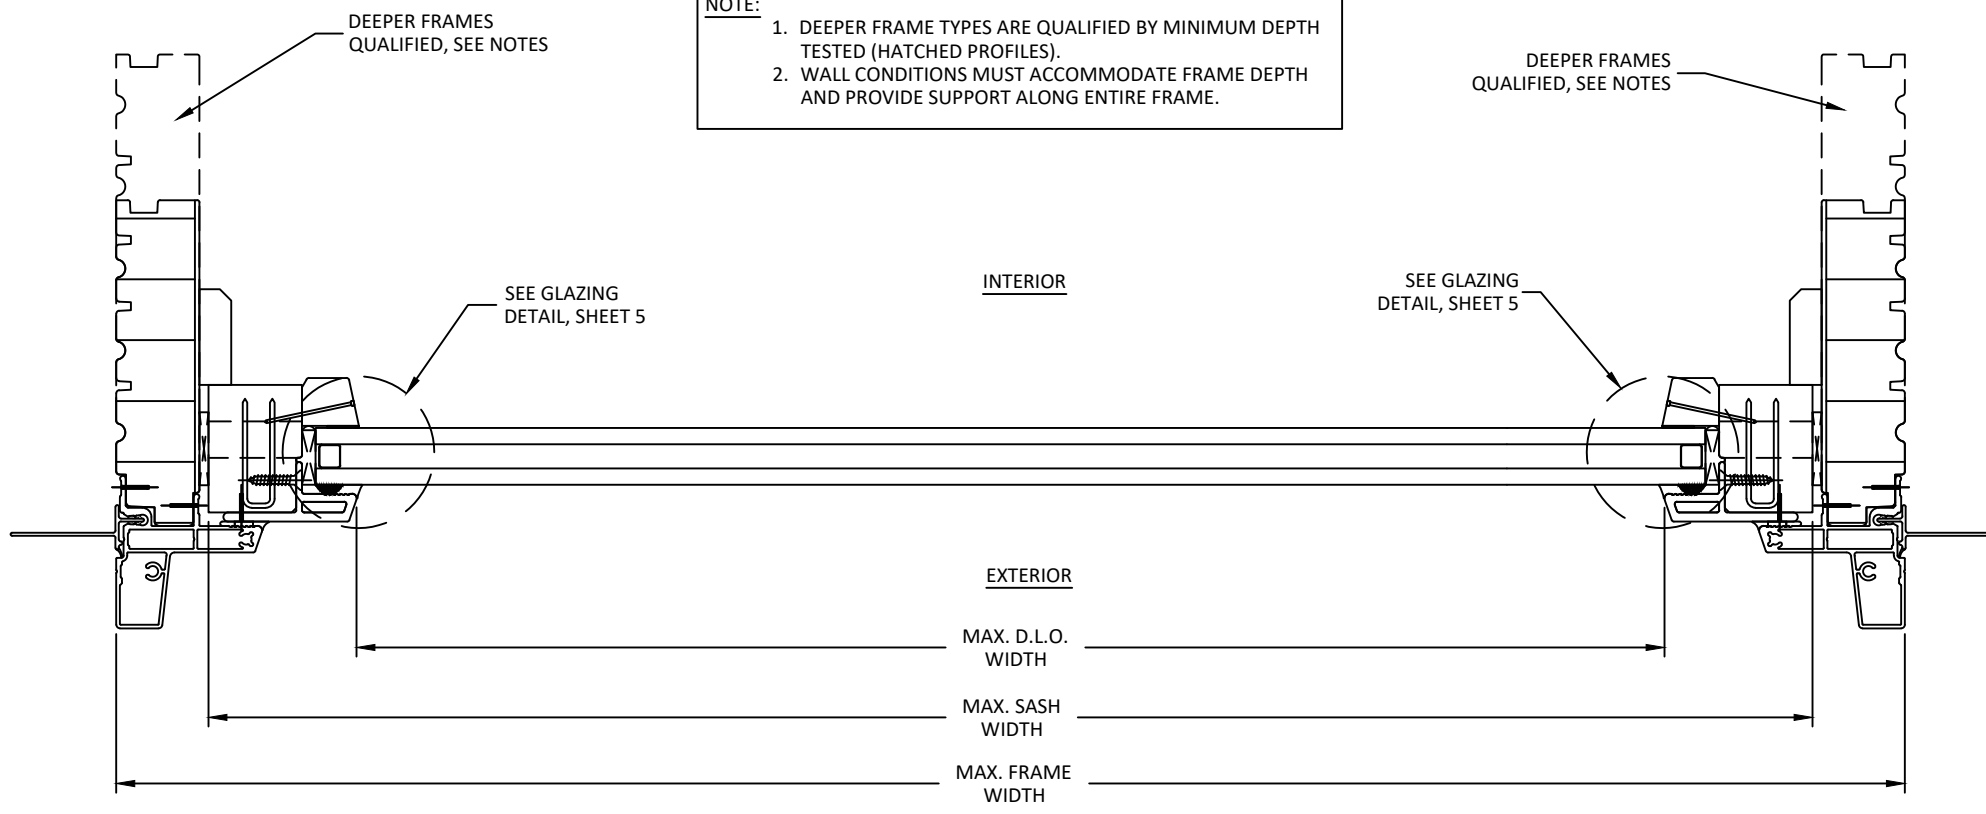

B
4 **HORIZONTAL SECTION**
LINEAL FRAME



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: **A-SERIES FIXED
SPECIALTY PG UPGRADE
SASH SET WINDOW
(NON-HVHZ)(NON-IMPACT)
HORIZONTAL SECTIONS**

PREPARED BY: **BUILDING DROPS, INC.**
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

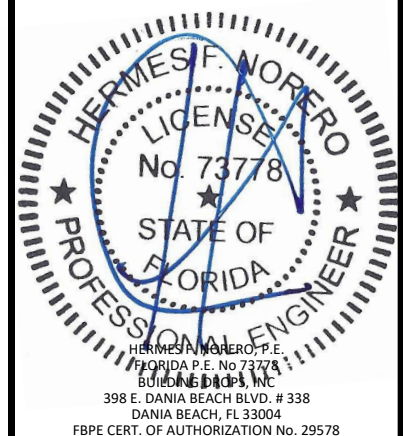

FL #:	FL24174
DATE:	06.13.22
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AWD311
SHEET:	4


6/14/2022 2:48 PM
s:\projects\andersen windows\fbc-22-0301 - fbc submittal - 024174.2 & 024174.3.dwg
s:\projects\andersen windows\fbc-22-0301 - fbc submittal - 024174.2 & 024174.3.dwg

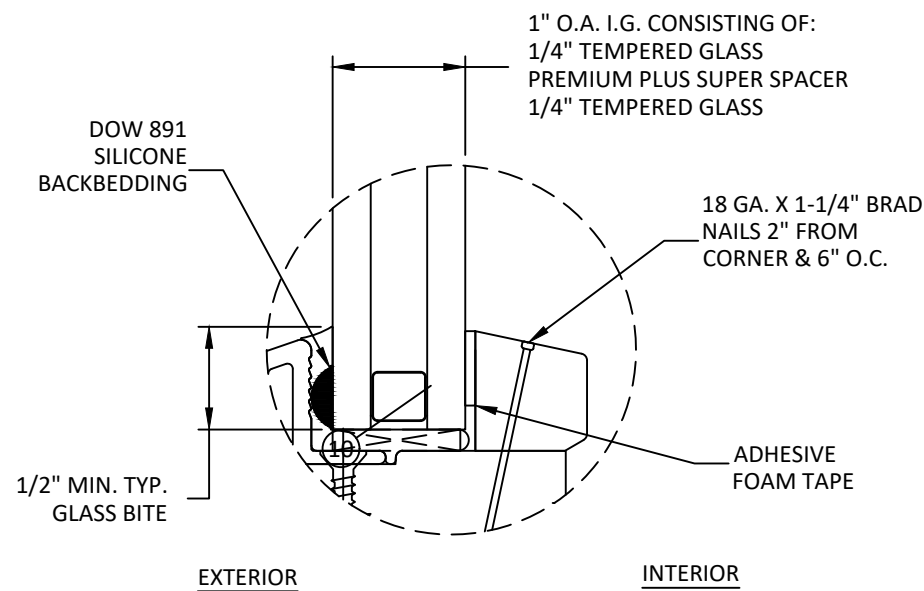

GLAZING DETAIL


GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
3. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX. VALUES SHOWN HEREIN.

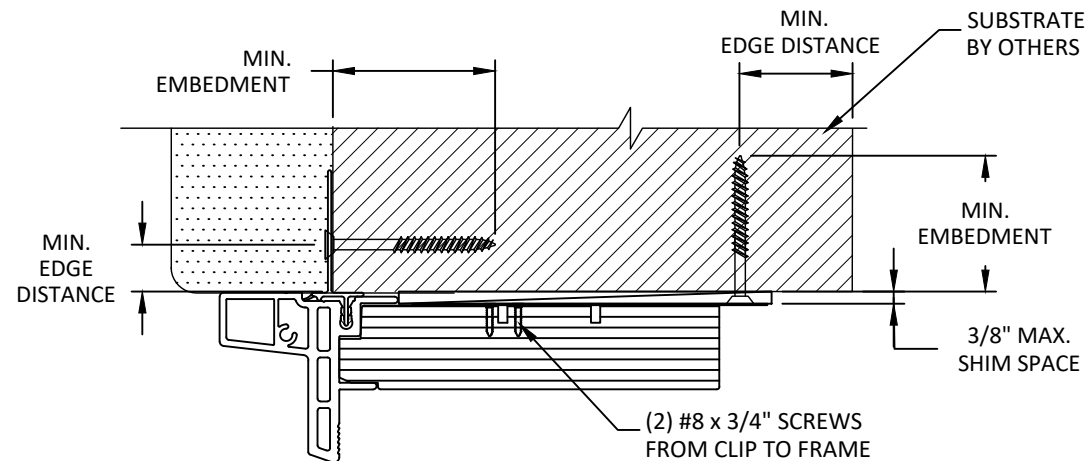

A/5 VERTICAL SECTION
THROUGH INSTALLATION CLIP & NAIL FIN
HEAD/JAMB/SILL

DETAIL A/5 SHOWS CURVED FRAME, LINEAL FRAME ALSO APPROVED FOR CLIP AND NAIL FIN INSTALLATION.

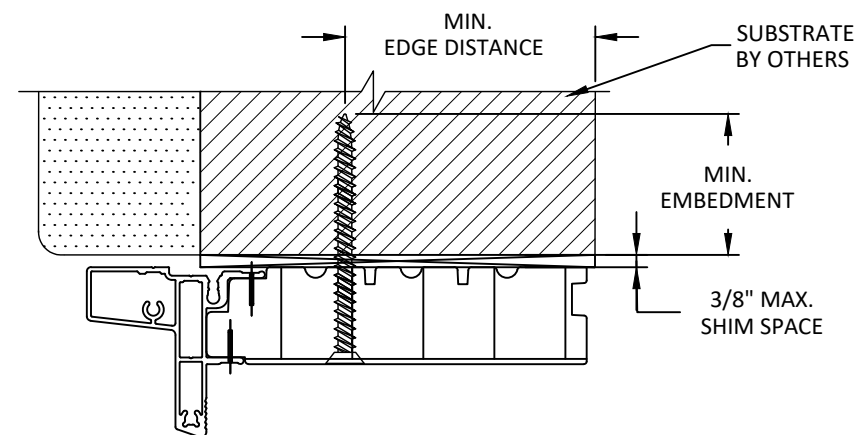

B/5 VERTICAL SECTION
THROUGH FRAME
HEAD/JAMB/SILL

DETAIL B/5 SHOWS LINEAL FRAME, CURVED FRAME ALSO APPROVED FOR THROUGH FRAME INSTALLATION.



ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: **A-SERIES FIXED
SPECIALTY PG UPGRADE
SASH SET WINDOW
(NON-HVHZ)(NON-IMPACT)
GLAZING DETAIL, ANCHOR DETAILS,
& QUALIFIED CONFIGURATIONS**

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

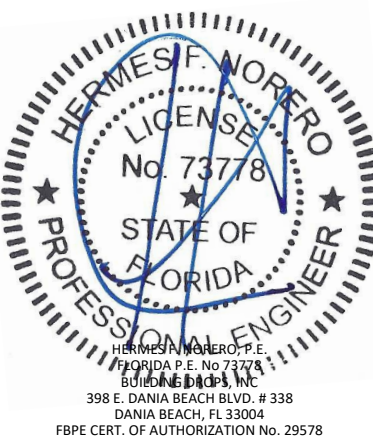

FL #:	FL24174
DATE:	06.13.22
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AWD311
SHEET:	5