



# Metal Roof Certification & Listing Program

## Certification Report



11030-001-KCI

145 Limekiln Road, Suite 100B  
New Cumberland, PA 17070  
[www.keystonecerts.com](http://www.keystonecerts.com)

Issue Date: 9/01/2017  
Revision Date: 1/11/2021  
Expiration Date: 10/12/2025

### Construction Specifications Institute (CSI) Category:

**Division:** 07 00 00 – Thermal & Moisture Protection

**Section:** 07 41 13 – Metal roof and wall panels

### 1. Program Licensee:



1st Coast Metal Roofing Supply  
186 SR 207  
East Palatka, FL 32131  
386-325-0242  
<http://www.1stcoastmrs.com/>

### 2. Certified Roof Covering:

1<sup>st</sup> Coast Metal Roofing Supply's Model 5V Crimp Panel non-structural through-fastened minimum 26 gauge metal roof and wall panels installed over nominal 7/16" OSB sheathing roof deck for use in new construction, re-roofing and re-covering applications.

### 3. Scope of Certification:

This Certification Report provides technical data substantiating that the use of the certified roof covering and the evaluated roof systems are in compliance with the following:

- 2020 Florida Building Code - Building, 7th Edition, Section 1504.3.2.
- Florida Product Approval Rule 61G20-3.

Properties Evaluated:

- Wind Uplift Resistance

**This Certification Report was used to qualify Florida Product Approval FL 24397-R6.**

### 4. Evaluated Roof System Description:

- 4.1. **Roof Covering:** 5V Crimp Panel metal roof and wall covering panels are cold roll-formed from minimum 26 gauge ASTM A792 Grade 50 steel sheet. The panels are aluminum-zinc alloy coated per ASTM A792 (AZ50), and shall be installed in accordance with the manufacturer's instructions and this Certification Report.
- 4.2. **Roof Deck:** 5V Crimp metal roof and wall panels are certified for use over solid or closely-spaced, nominal 7/16" OSB sheathing complying with 2020 Florida Building Code - Building, 7th Edition, Section 2303.1.8 with a minimum slope of 25% (3:12).
- 4.3. **Anchorage:** 5V Crimp Panel metal roof and wall panels shall be through-fastened to the roof deck using #9-15 x 1-1/2" Woodbinder ST-XL hex-head wood screws with EPDM-sealing washer or equivalent, as specified in Table 1, applied in the patterns described in Appendix 1.
- 4.4. **Underlayment:** 5V Crimp Panel metal roof and wall panels in new construction applications shall be installed over underlayment meeting the applicable material type and attachment details specified in 2020 Florida Building Code - Building, 7th Edition Table 1507.1.1.1., the manufacturer's installation instructions and this Certification Report.



# Metal Roof Certification & Listing Program

## Certification Report

### 11030-001-KCI



## 5. Installation

5V Crimp Panel metal roof and wall panels in new construction applications shall be installed in accordance with the 2020 Florida Building Code - Building, 7th Edition, Section 1507.4, the manufacturer’s published installation instructions and this Certification Report.

5V Crimp Panel metal roof and wall panels in re-roofing and re-covering applications may be installed over a single layer of existing shingles and shall be installed in accordance with the 2020 Florida Building Code Code - Building, 7th Edition, Sections 1507.4 & 1511, the manufacturer’s published installation instructions and this Certification Report.

The manufacturer’s installation instructions shall be made available at the time of installation. If there are differences between this report and the manufacturer’s installation instructions, this report shall take precedence.

## 6. Product Performance

The performance of the 5V Crimp Panel non-structural through-fastened metal roof and wall panels described in this Certification Report has been determined in accordance with:

- UL 580-06, *Tests for Uplift Resistance of Roof Assemblies.*
- UL 1897-04, *Uplift Tests for Roof Covering Systems.*

As tested & reported by the following independent accredited laboratory:

Laboratory	Report Ref.
Force Engineering & Testing	99-0284T-15A & B

**Note:** The UL 1897-04 standard is equivalent to the UL 1897-2012 standard.

## 6.1. Wind Resistance

The allowable design uplift pressures for 5V Crimp Panel anchored as described in Appendix 1, when tested in accordance with the referenced standards with an applied safety factor of 2.0 are found in Table 1.

**Table 1**

Description	Anchor Pattern	Anchor Man’f & Model	Max Design Uplift Pressure
Over 7/16” OSB Sheathing	<b>A</b> (16” O.C.)	Woodbinder ST-XL	<b>-52.5 psf</b>
Over 7/16” OSB Sheathing	<b>B</b> (24” O.C.)	Woodbinder ST-XL	<b>-63.5 psf</b>

## 7. Conditions of Use

5V Crimp Panel non-structural through-fastened metal roof and wall panels must be insulated against other materials or metals including concrete, lead, copper and treated lumber that contains corrosive materials.

## 8. Limitations of Use

5V Crimp Panel non-structural through-fastened metal roof and wall panels are not qualified for use in the High Velocity Hurricane Zone (HVHZ).

Fire classification, shear diaphragm design, roof deck design & attachment to supporting members are not within the scope of this Certification Report.

Roof support framing shall comply with 2020 Florida Building Code - Building, 7th Edition, Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.



# Metal Roof Certification & Listing Program

## Certification Report

### 11030-001-KCI



#### 9. Licensed Manufacturing Facilities

This Certification Report is applicable only to 5V Crimp Panel non-structural through-fastened metal roof and wall panels manufactured at the following locations:

1st Coast Metal Roofing Supply  
186 State Rd 207  
East Palatka, Florida 32131

Each licensed facility is subject to periodic inspection by Keystone Certifications to verify conformance with Keystone Roof Covering Certification & Listing Program requirements.

#### 10. Identification

5V Crimp Panel non-structural through-fastened metal roof and wall panels represented by this report shall be identified with Keystone Roof Covering Certification & Listing Program certification labeling illustrated below, to be applied to individual panels, packaging, invoicing or bills of lading:




Aaron M. Shultz  
Validation Manager


## Appendix 1

Note: In all cases (new construction and re-roofing), the anchors shall fully penetrate the OSB roof deck.

### Anchor Pattern A

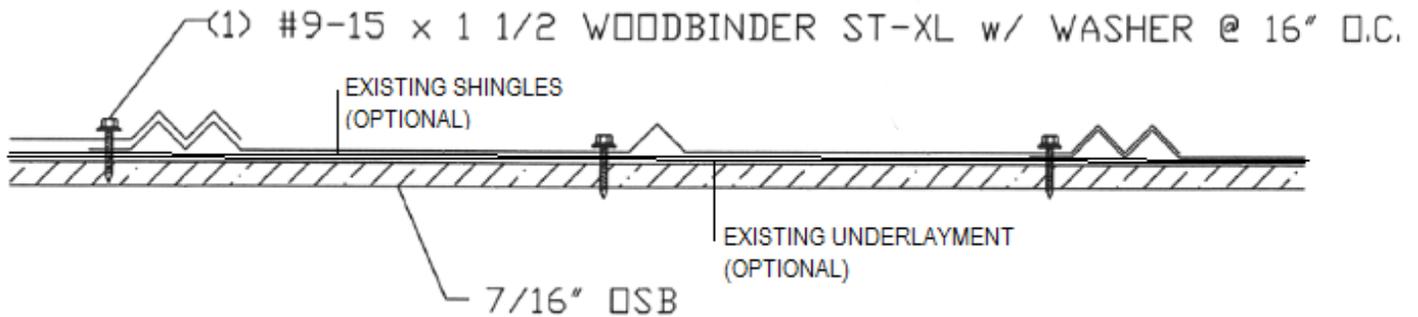

### Anchor Pattern B

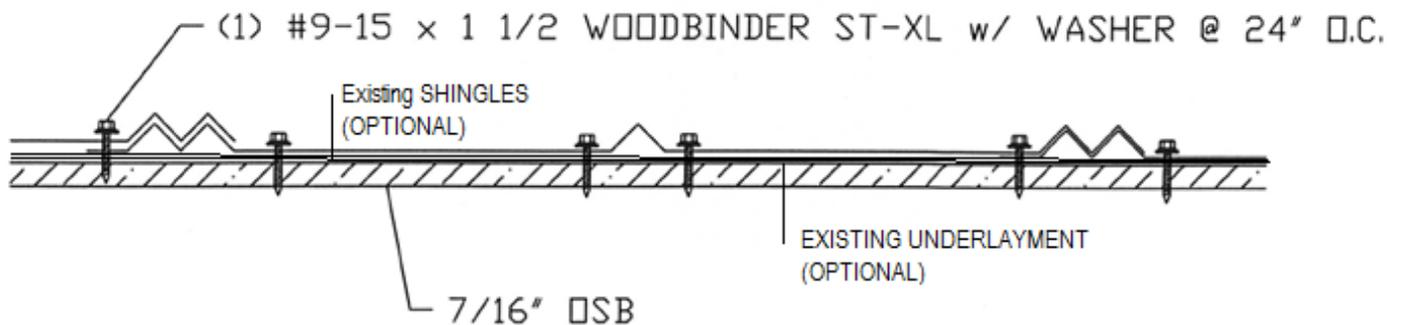



Metal Roof Certification & Listing Program  
**Certification Report**  
 11030-001-KCI



145 Limekiln Road, Suite 100B  
 New Cumberland, PA 17070  
[www.keystonecerts.com](http://www.keystonecerts.com)

Issue Date: 9/01/2017  
 Revision Date: 1/11/2021  
 Expiration Date: 10/12/2025

**Certificate Revisions**

Rev #	Date	Description
0	9/1/2017	Initial issuance.
1	9/6/2017	Revised 2017 FBC Particleboard Section reference to 2301.1.8.
2	1/8/2018	Added reference to associated Florida Product Approval No FL24397.
3	1/23/2018	Added hyperlink to FL24397
4	6/25/2018	Removed ref's to measurements for mat'l thickness and yield strength, relying on applicable Gauge and steel Grade.
5	3/12/2019	Updated Model name to include metal roof <i>"and wall panels"</i>
6	10/7/2019	Updated ANSI Logo to proper requirements. Revised anchorage illustrations for clarity, added reference to optional re-roofing / re-covering installation over "one layer of existing shingles".
7	10/12/2020	Updated to 2020 FBC 7 <sup>th</sup> Edition.
8	1/11/2021	Corrected Model name. Updated FPA link.