

OPAQUE FIBERGLASS

SINGLE DOOR


INSWING / OUTSWING

"IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 3 as defined in ASTM E 1996.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Horizontal & vertical cross sections (2X buck)
4	Horizontal & vertical cross sections (1X buck)
5	Horizontal & vertical cross sections (Direct to Masonry)
6	Vertical cross sections
7	Buck & frame anchoring
8	Components
9	Bill of materials

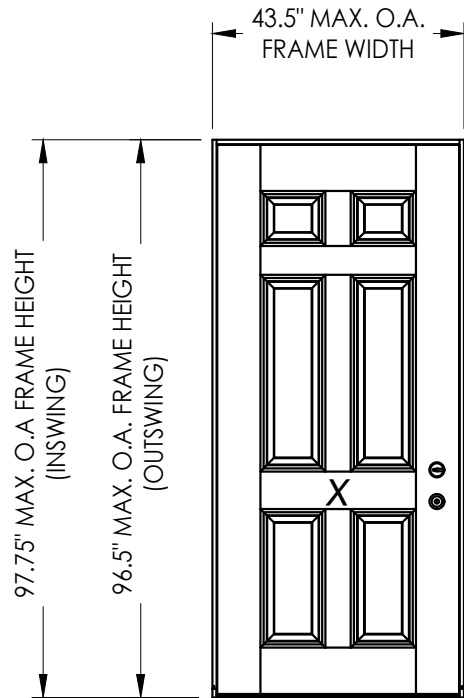

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	+65.0	-70.0	+65.0	-65.0

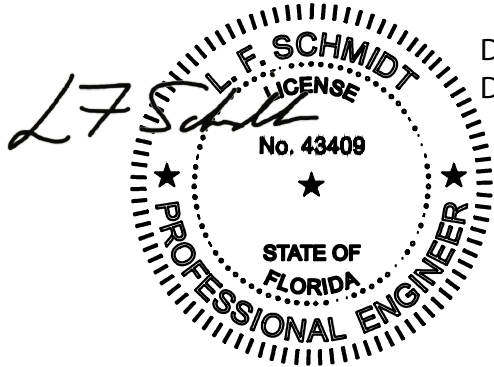

Digitally signed by Lyndon F Schmidt
Date: 2026.07.26 10:46:40 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: TRINITY GLASS INT'L

Part or Assembly:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

REVISIONS

DATE: 8/13/21

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.: FL-25575.19

SHEET 1 OF 9


Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

2 7/01/26 UPDATE TO 9TH ED. (2026) FBC LFS


1 8/01/23 UPDATE TO 8TH ED. (2023) FBC LFS

NO. DATE BY

G:\2023 FBC Drawings 7-20-26\Trinity Glass International\FL-25575 R6\FL-25575.19.dwg

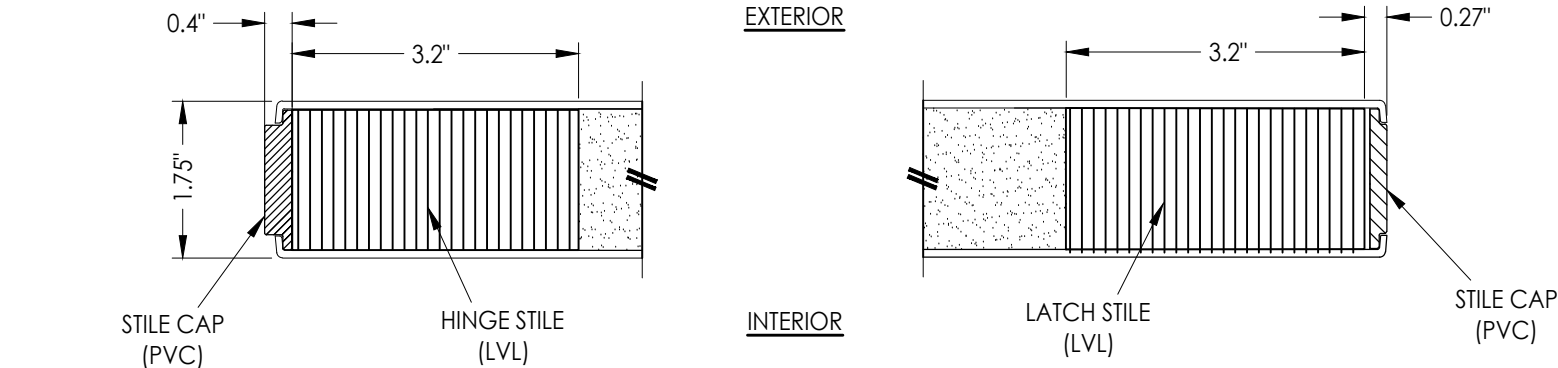


1
2 HORIZONTAL CROSS SECTION

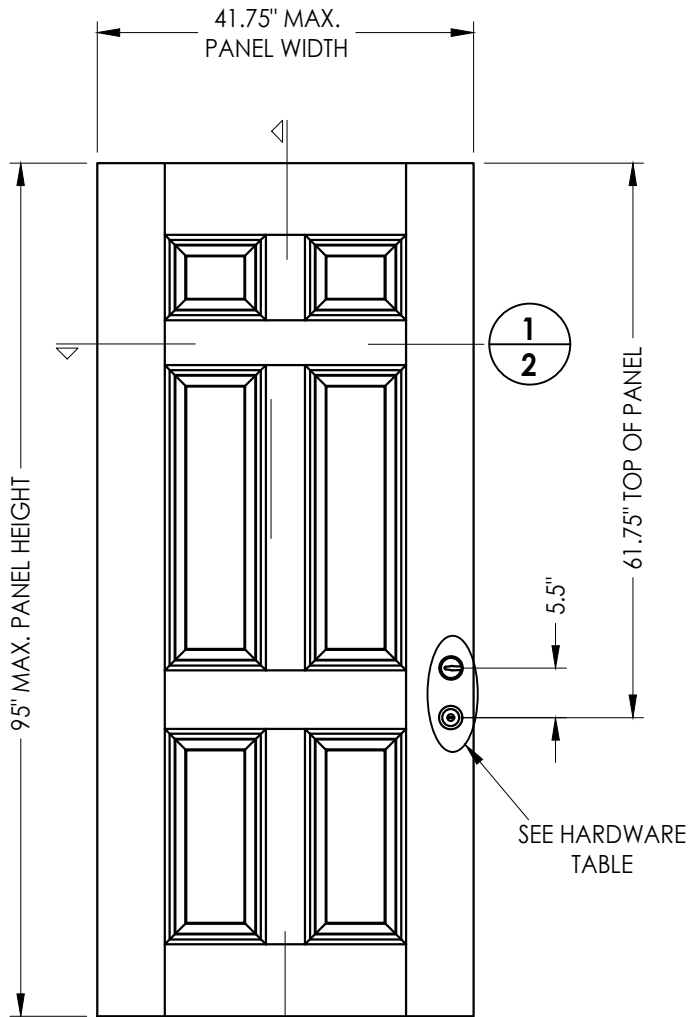


2
2 OPAQUE DOOR PANEL
Fiberglass

DOOR SKIN: 0.070" MIN. THK. FIBERGLASS
CORE MATERIAL: POLYURETHANE FOAM

HARDWARE CHART		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)
SCHLAGE	KNOB:	F SERIES
	DEADBOLT:	B60 SERIES

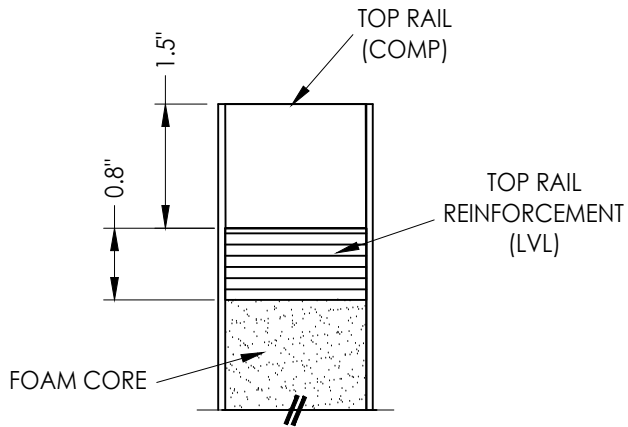

EXTERIOR INTERIOR

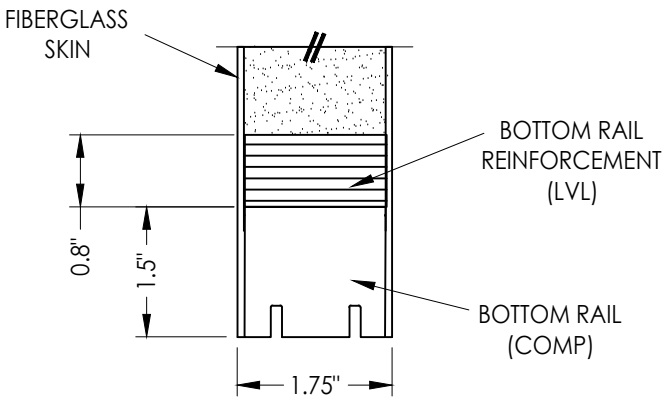

2
2 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TRINITY GLASS INT'L

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
2	7/01/26	UPDATE TO 9TH ED. (2026) FBC
1	8/01/23	UPDATE TO 8TH ED. (2023) FBC

DATE: 8/13/21

SCALE: N.T.S.



DWG. BY: RW

CHK. BY: LFS


DRAWING NO.:

FL-25575.19

SHEET 2 OF 9

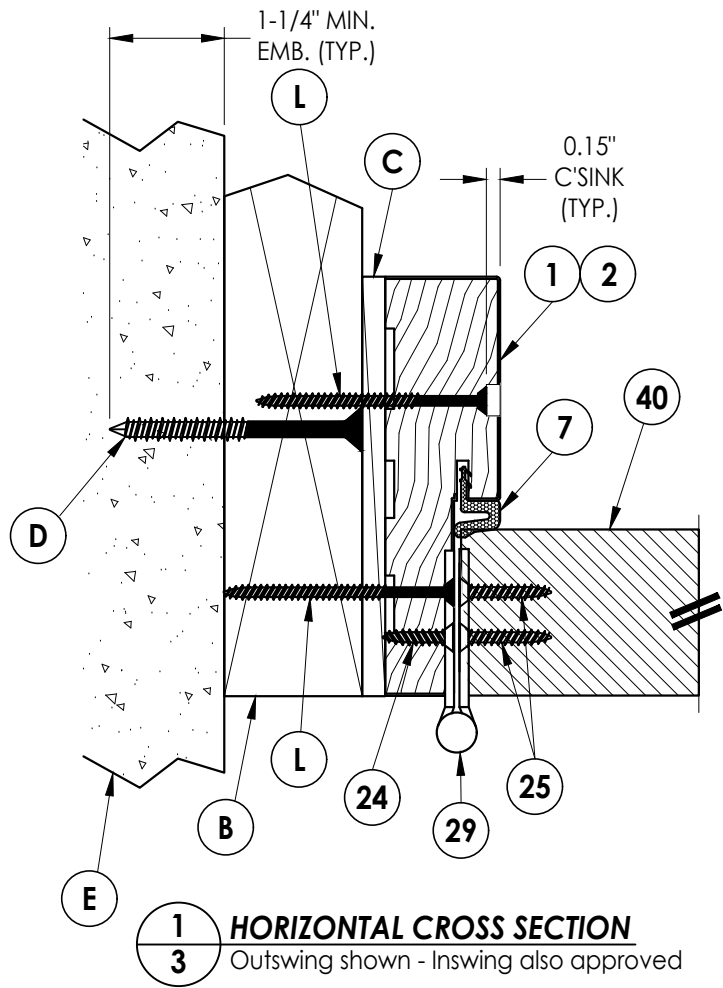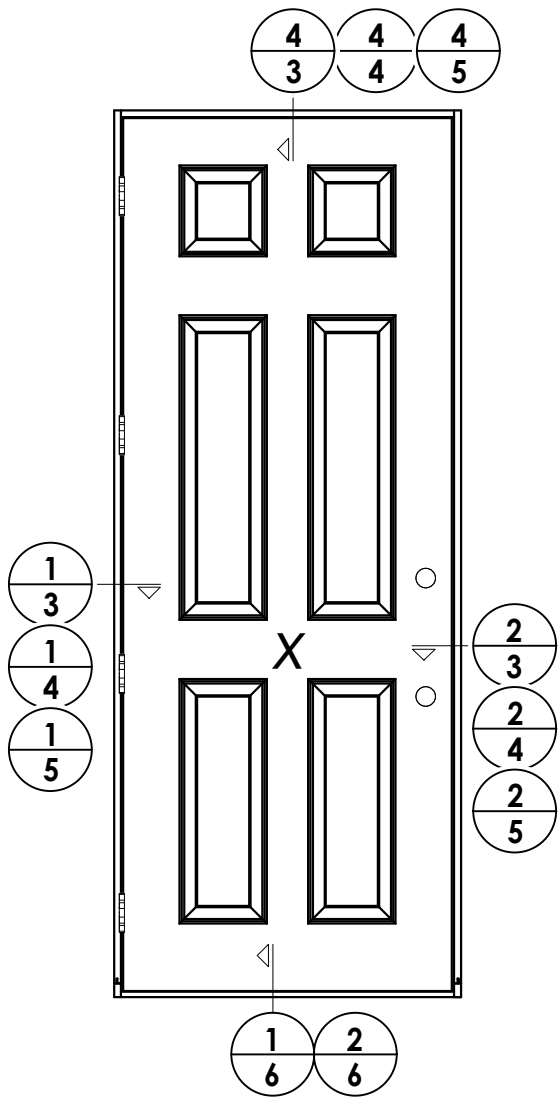


3 **VERTICAL CROSS SECTION**
Outswing shown - Inswing also approved

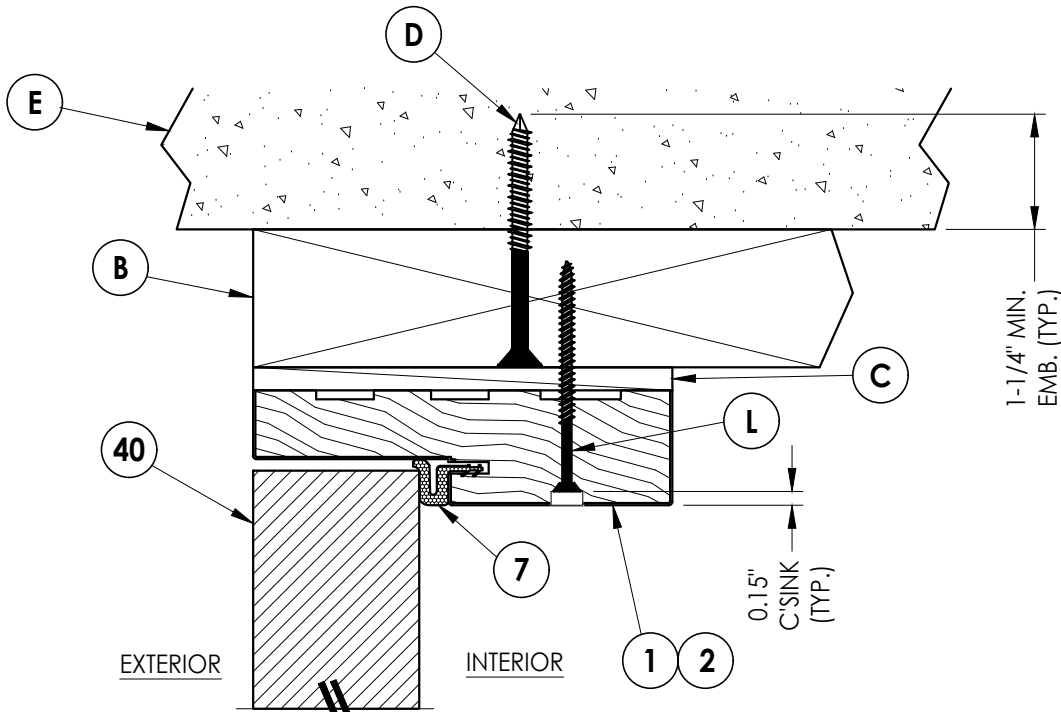

INTERIOR

EXTERIOR

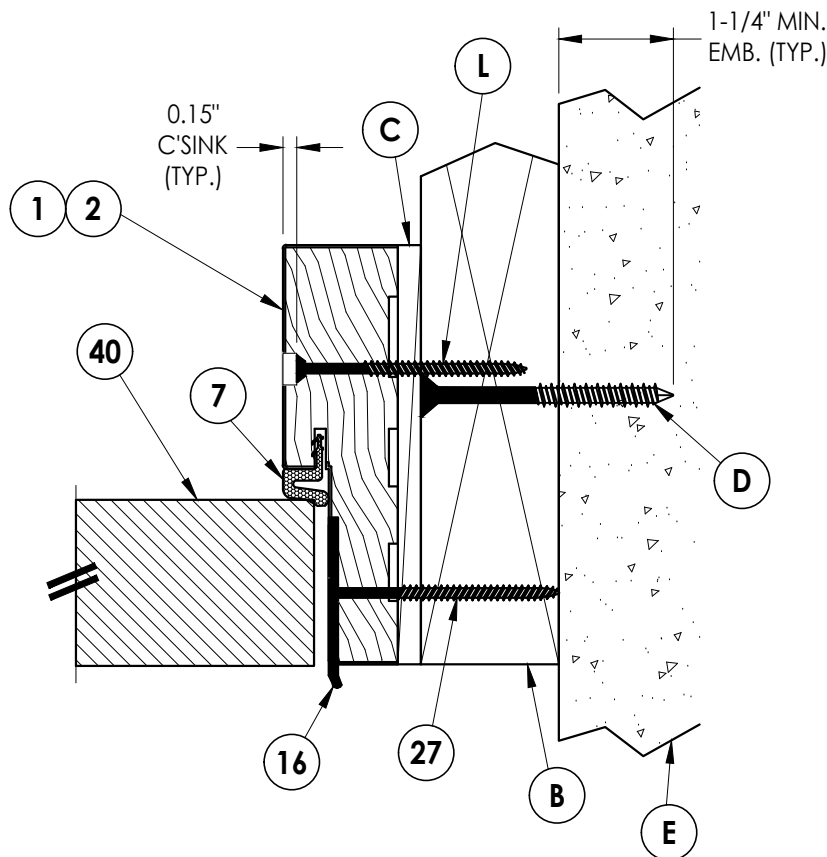

2 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

PRODUCT:		TRINITY GLASS INT'L	
PART OR ASSEMBLY:		HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	
REVISIONS			
NO.	DATE		BY
2	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS
1	8/01/23	UPDATE TO 8TH ED. (2023) FBC	LFS

DATE: 8/13/21

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS


DRAWING NO.:

FL-25575.19


SHEET 3 OF 9

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

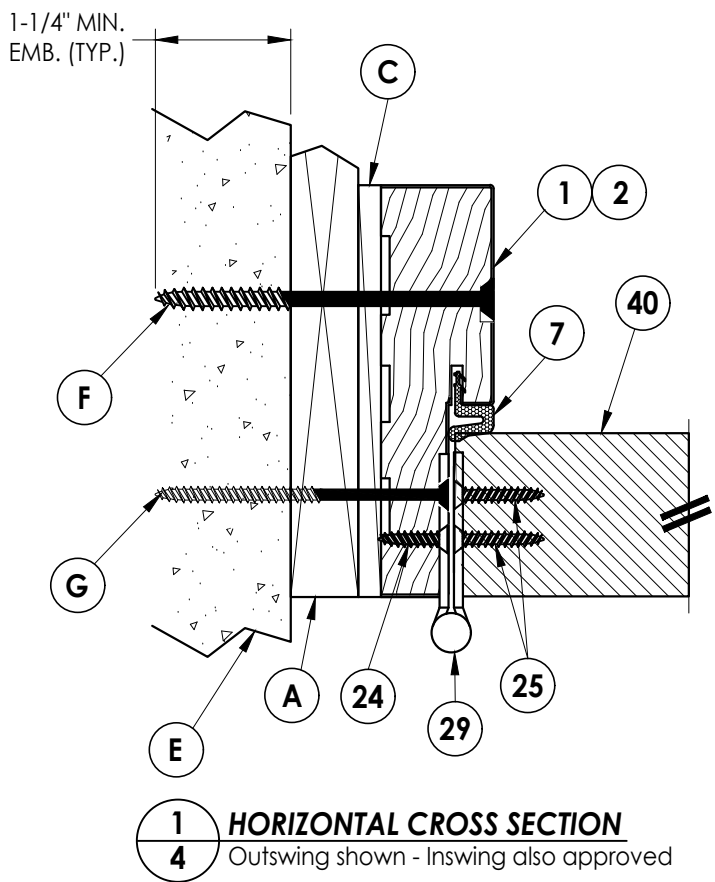

1 **HORIZONTAL CROSS SECTION**
4 Outswing shown - Inswing also approved

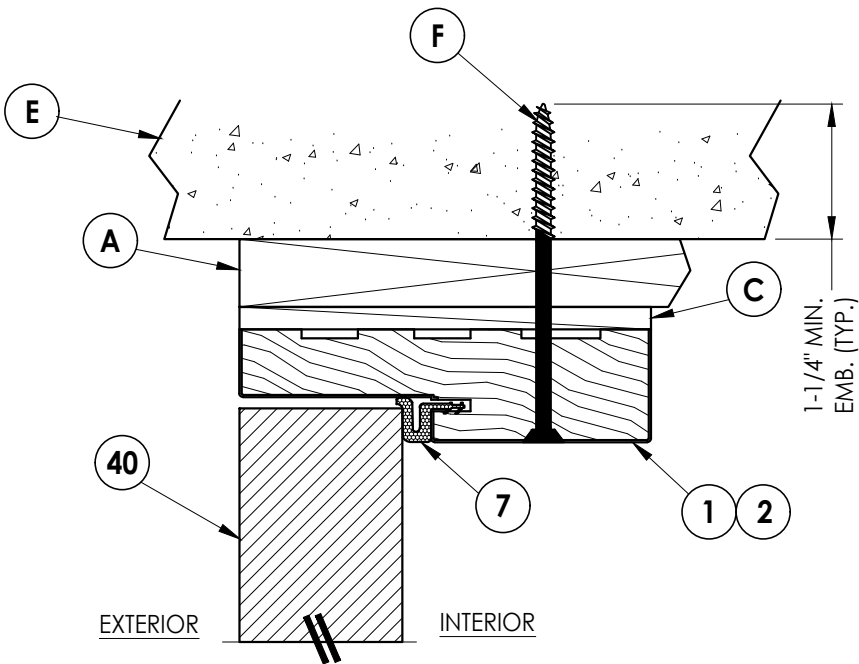

3 VERTICAL CROSS SECTION
4 Outswing shown - Inswing also approved

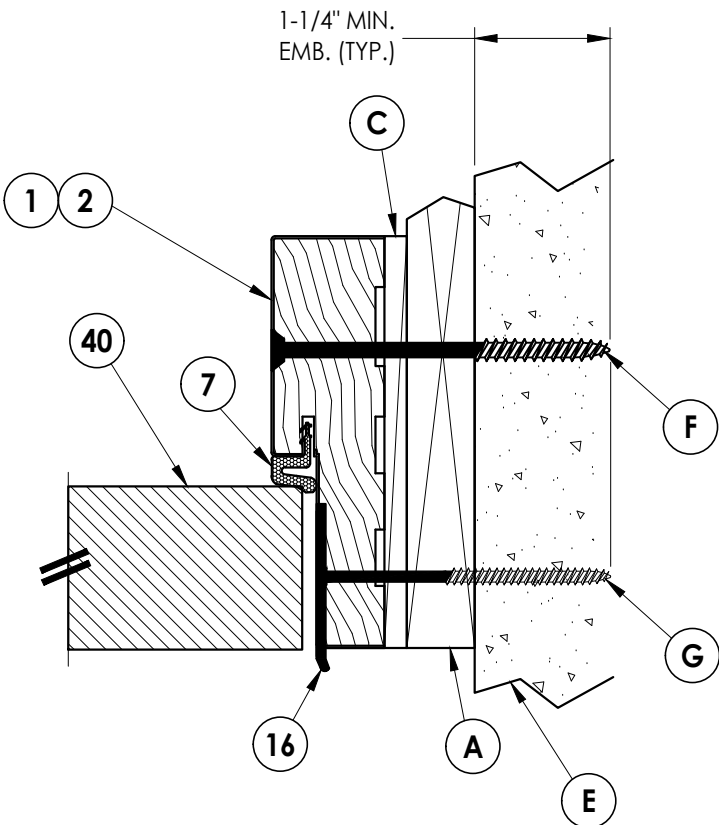


2 **HORIZONTAL CROSS SECTION**
4 Outswing shown - Inswing also approved

[illegible]


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC Drawings 7-20-26\Trinity Glass International\FL-25575 R6\FL-25575.19.dwg

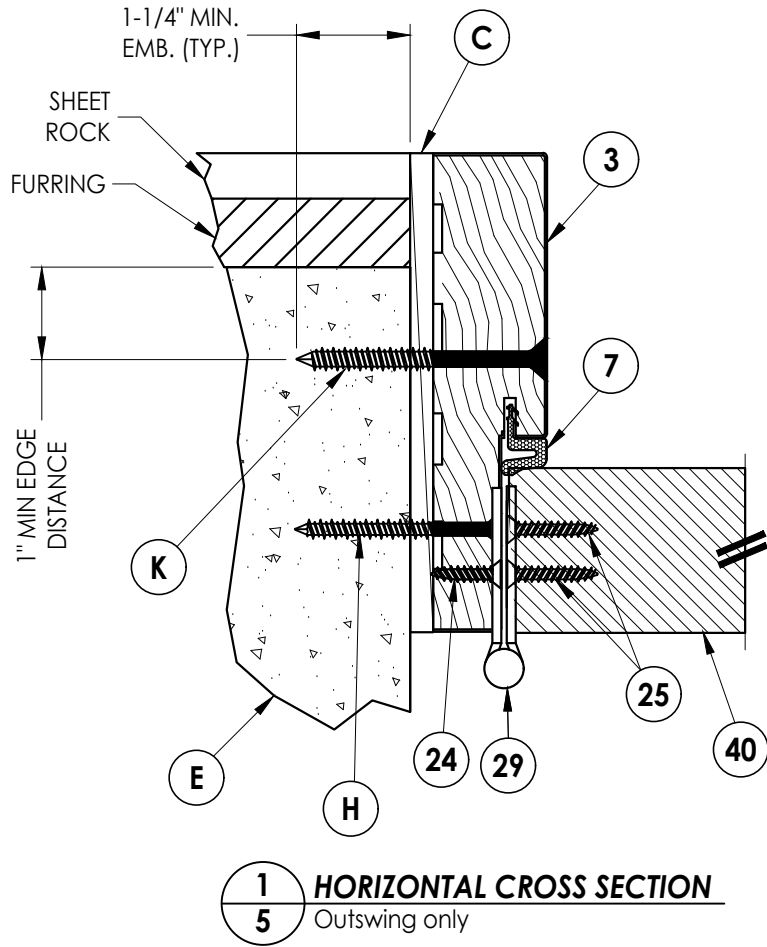

1
5 **HORIZONTAL CROSS SECTION**
Outswing only

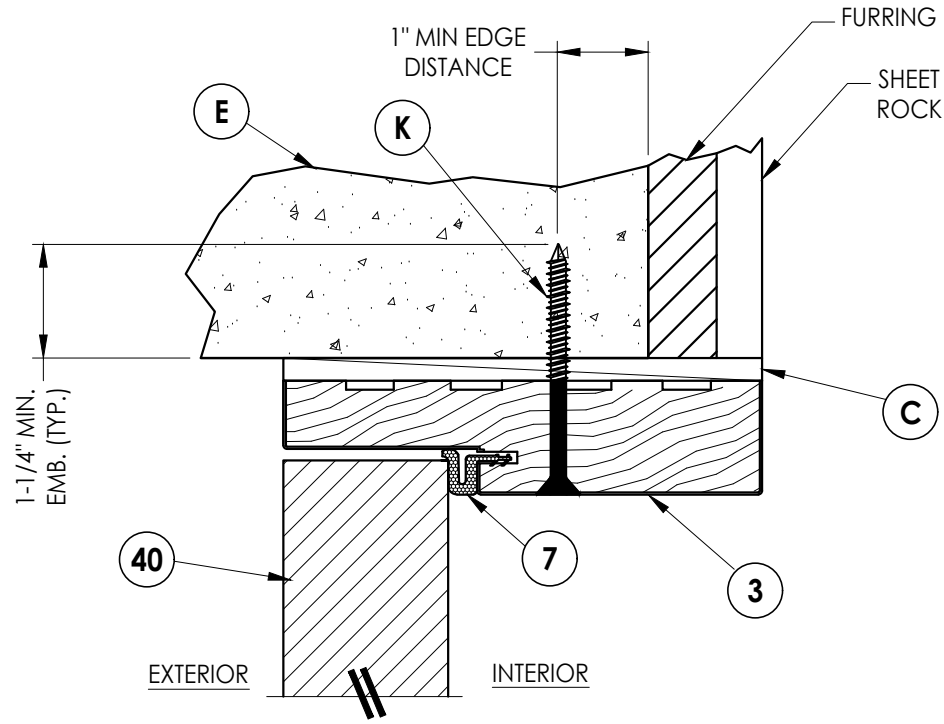

3
5 **VERTICAL CROSS SECTION**
Outswing only

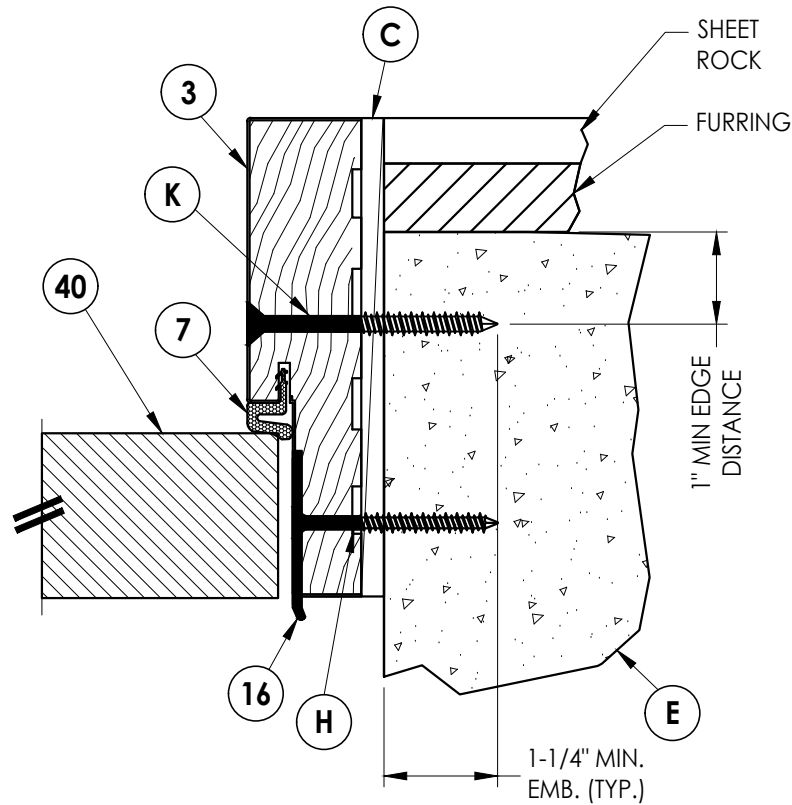

2
5 **HORIZONTAL CROSS SECTION**
Outswing only

DATE: 8/13/21
SCALE: N.T.S.
DWG. BY: RW
CHK. BY: LFS
DRAWING NO.: FL-25575.19
SHEET 5 OF 9


PRODUCT: TRINITY GLASS INT'L
PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
2	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
1	8/01/23	UPDATE TO 8TH ED. (2023) FBC LFS
		BY


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC Drawings 7-20-26\Trinity Glass International\FL-25575 R6\FL-25575.19.dwg

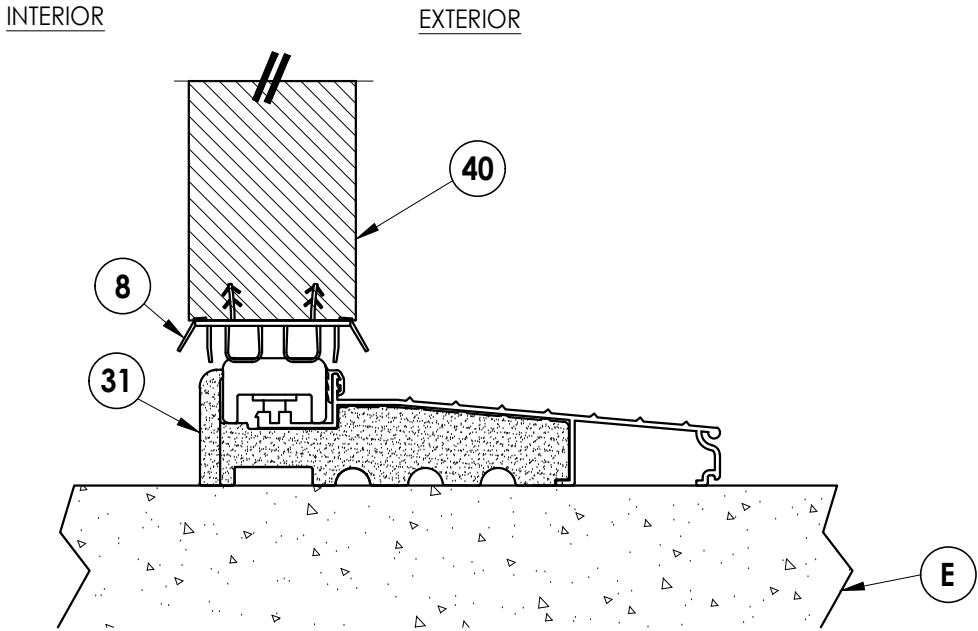


1 **VERTICAL CROSS SECTION**
6 Inswing sill

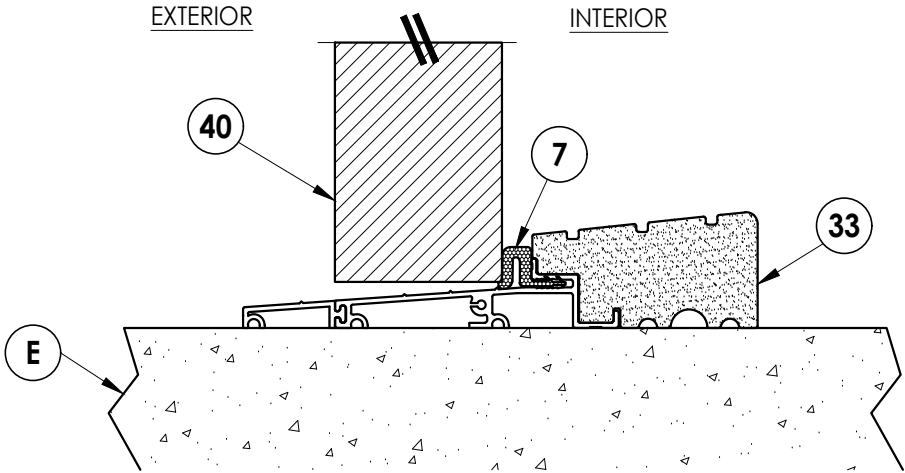


2 **VERTICAL CROSS SECTION**
6 Outswing sill


PRODUCT:				TRINITY GLASS INT'L				Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PART OR ASSEMBLY:				VERTICAL CROSS SECTIONS				RW							

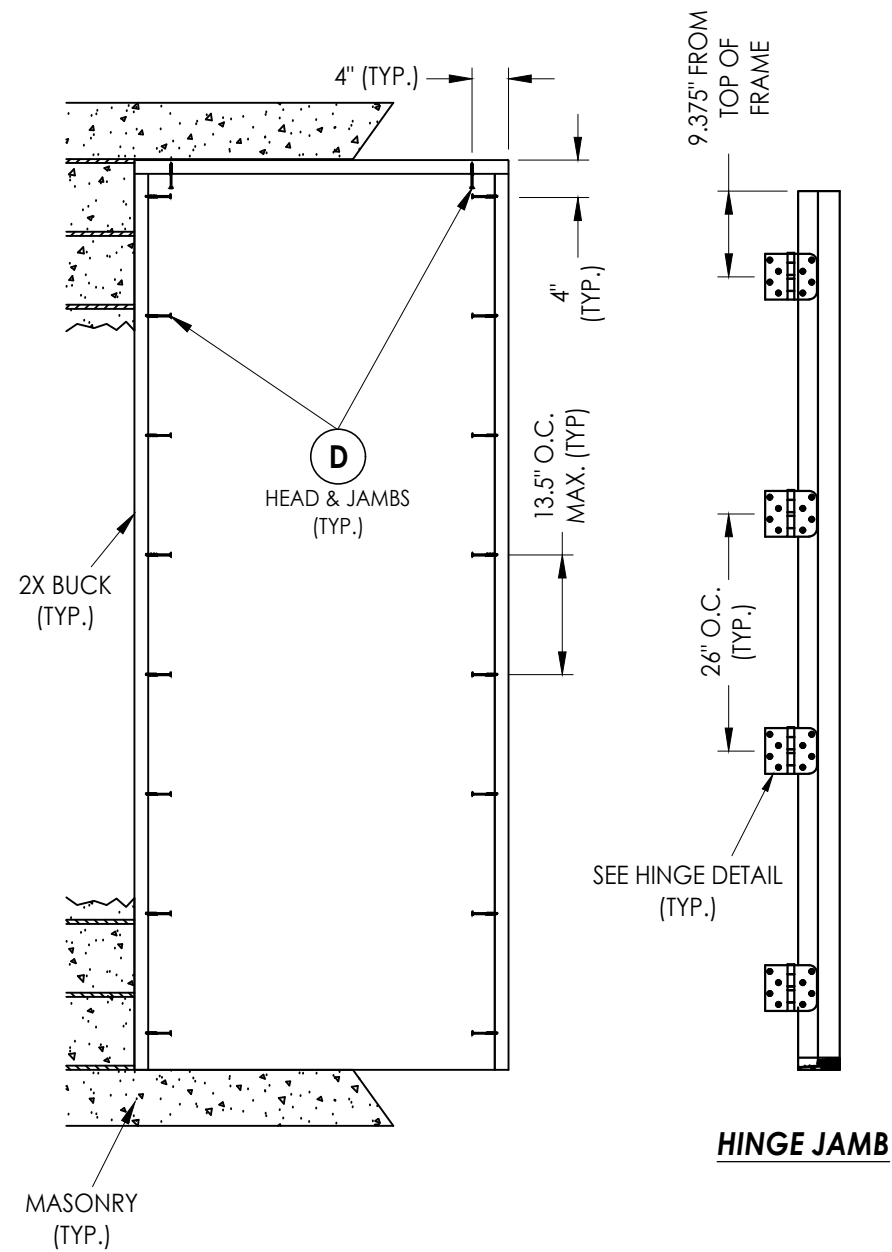


2X BUCK ANCHORING

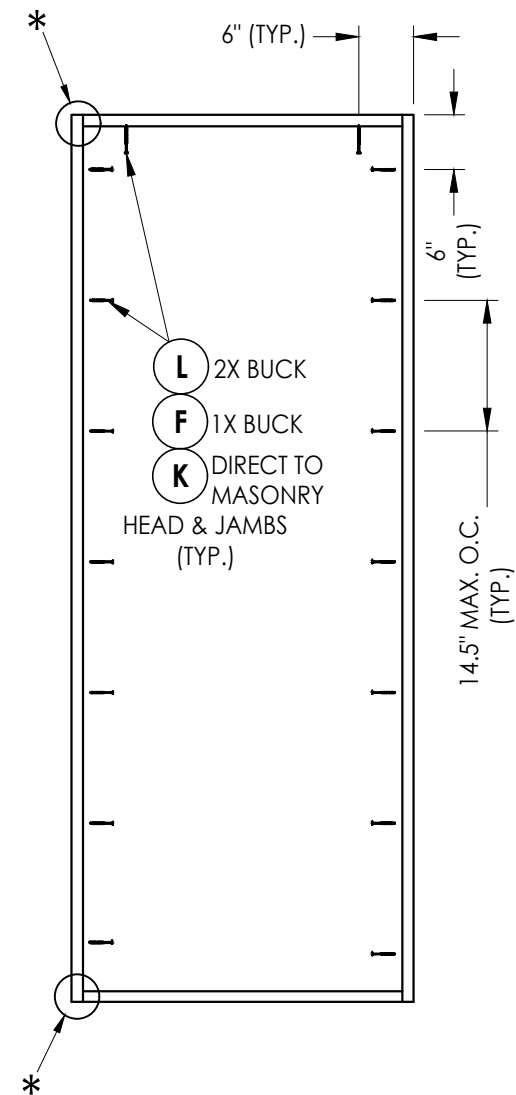

FRAME ANCHORING

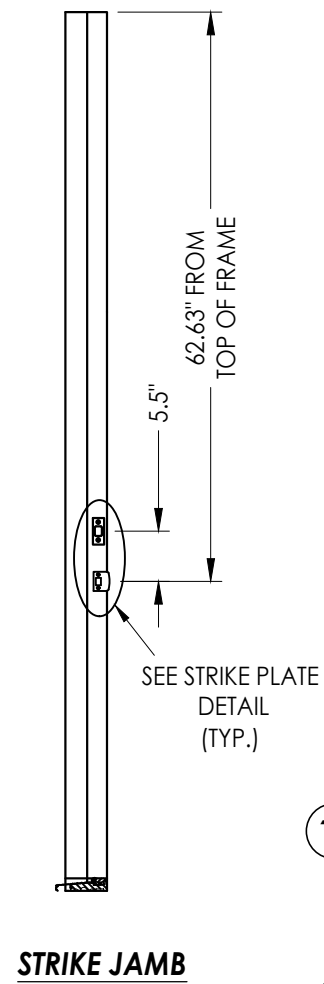

STRIKE JAMB

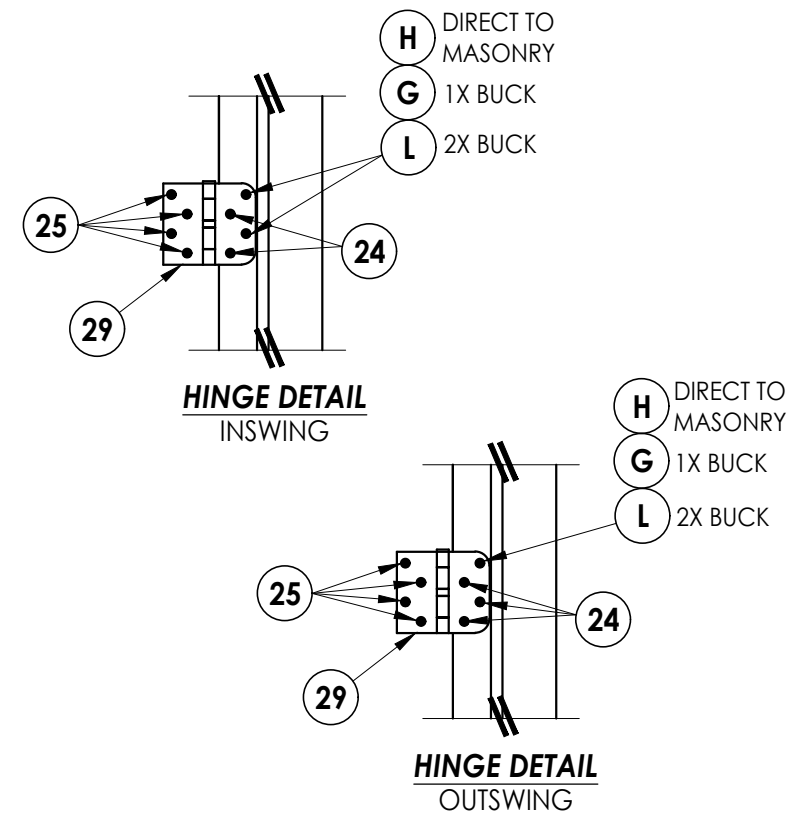


HINGE DETAIL

INSWING

HINGE DETAIL

OUTSWING

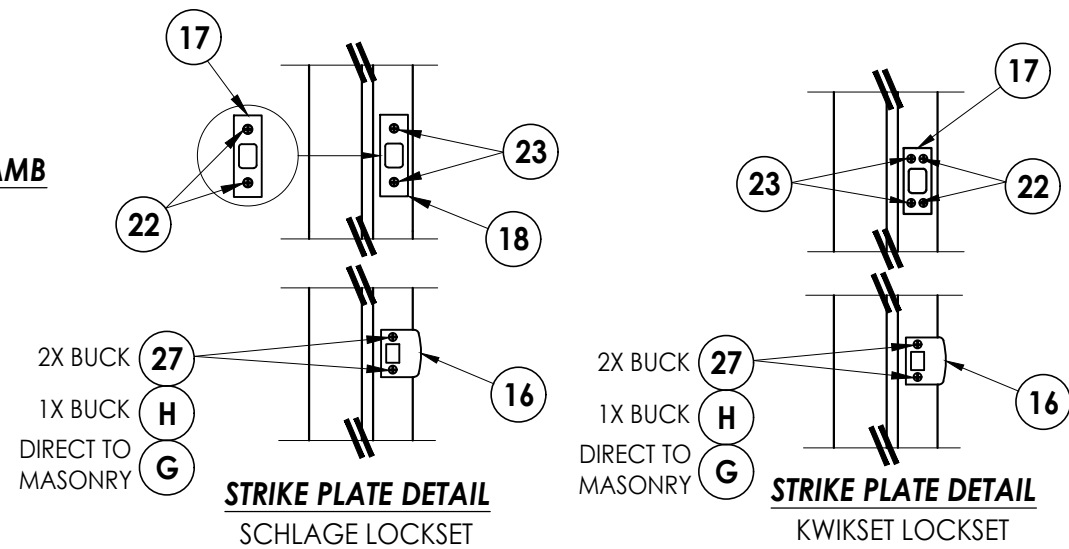

STRIKE PLATE DETAIL

SCHLAGE LOCKSET

STRIKE PLATE DETAIL

KWIKSET LOCKSET


*NOTE: FRAME CORNERS ATTACHED w/ #8 X 2" COURSE THREAD DRYWALL SCREWS: (3) @ HEAD, (3) @ INSWING SILL & (2) @ OUTSWING SILL (TYP.).

[illegible]


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC Drawings 7-20-26\Trinity Glass International\FL-25575 R6\FL-25575.19.dwg

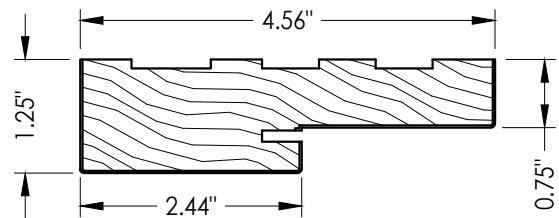


1 HEAD & JAMBS
FINGER JOINT PINE

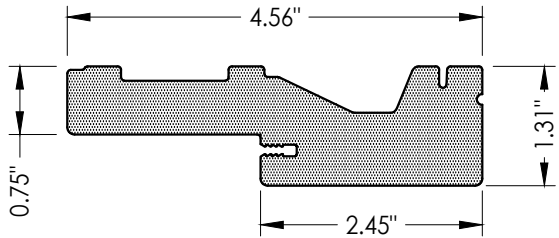


2 HEAD & JAMBS
PVC

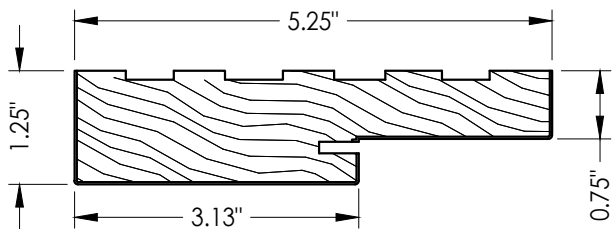


3 HEAD & JAMBS
FINGER JOINT PINE

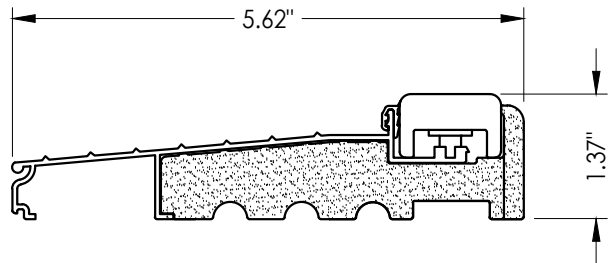


31 INSWING THRESHOLD

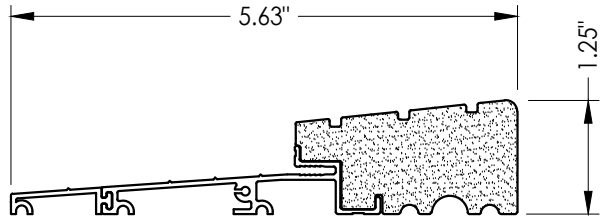





33 OUTSWING THRESHOLD
w/ sill extension



SILLKEY (LEFT)



SILLKEY (RIGHT)

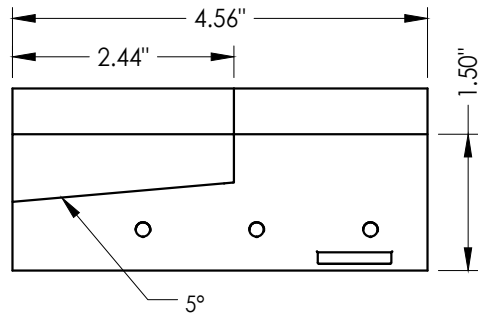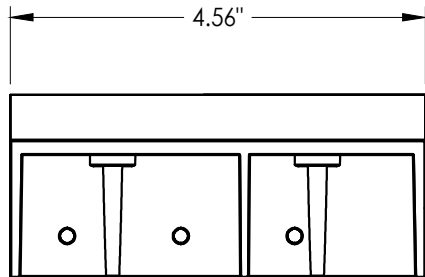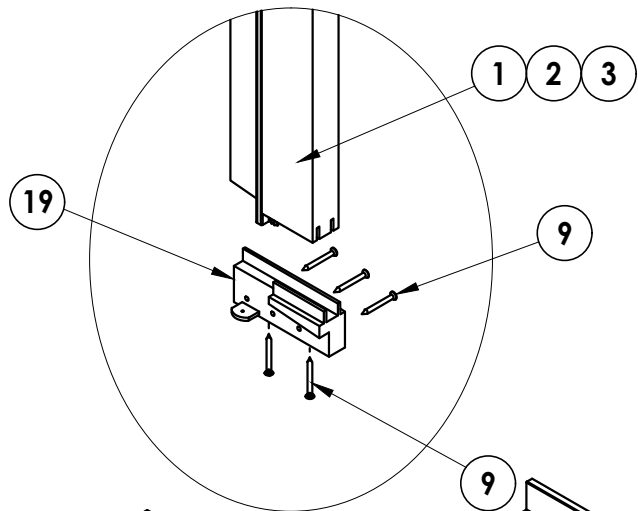

19 SILLKEY DETAILS
Optional

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
TRINITY GLASS INT'L

PART OR ASSEMBLY:
COMPONENTS

NO.	DATE	REVISIONS
2	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
1	8/01/23	UPDATE TO 8TH ED. (2023) FBC LFS

DATE: 8/13/21

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:
FL-25575.19

SHEET 8 OF 9

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
H	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
K	1/4" X 2-3/4" PFH DeWALT CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WS (1.15" MIN. EMBEDMENT)	STEEL
1	HEAD & JAMB (FINGER JOINT PINE: SG >= 0.42)	WOOD
2	HEAD & JAMB	PVC
3	HEAD & JAMB (5.25") (FINGER JOINT PINE: SG >= 0.42)	WOOD
7	WEATHERSTRIP	FOAM
8	DOOR BOTTOM SWEEP	PVC
16	LATCH STRIKE PLATE	STEEL
17	DEADBOLT STRIKE PLATE	STEEL
18	DEADBOLT SUB-STRIKE PLATE	STEEL
19	SILLKEY	ABS
22	#8 X 1/2" PFH WOOD SCREW	STEEL
23	#12 X 2-1/2" PFH WOOD SCREW	STEEL
24	#9 X 3/4" PFH WS	STEEL
25	#9 X 1" PFH WS	STEEL
27	#8 X 2-1/2" PFH WOOD SCREW	STEEL
29	4" X 4" HINGE	STEEL
31	INSWING THRESHOLD ALUMINUM w/ COMPOSITE SUBSTRATE	ALUM/ COMP
33	OUTSWING HIGH - DAM THRESHOLD ALUMINUM w/ COMPOSITE SUBSTRATE	ALUM/ COMP
40	DOOR PANEL	-

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRAON®+	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]