



GENERAL NOTES


1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Vertical & horizontal cross sections
3	Buck & frame anchoring
4	Bill of materials, components & glazing details


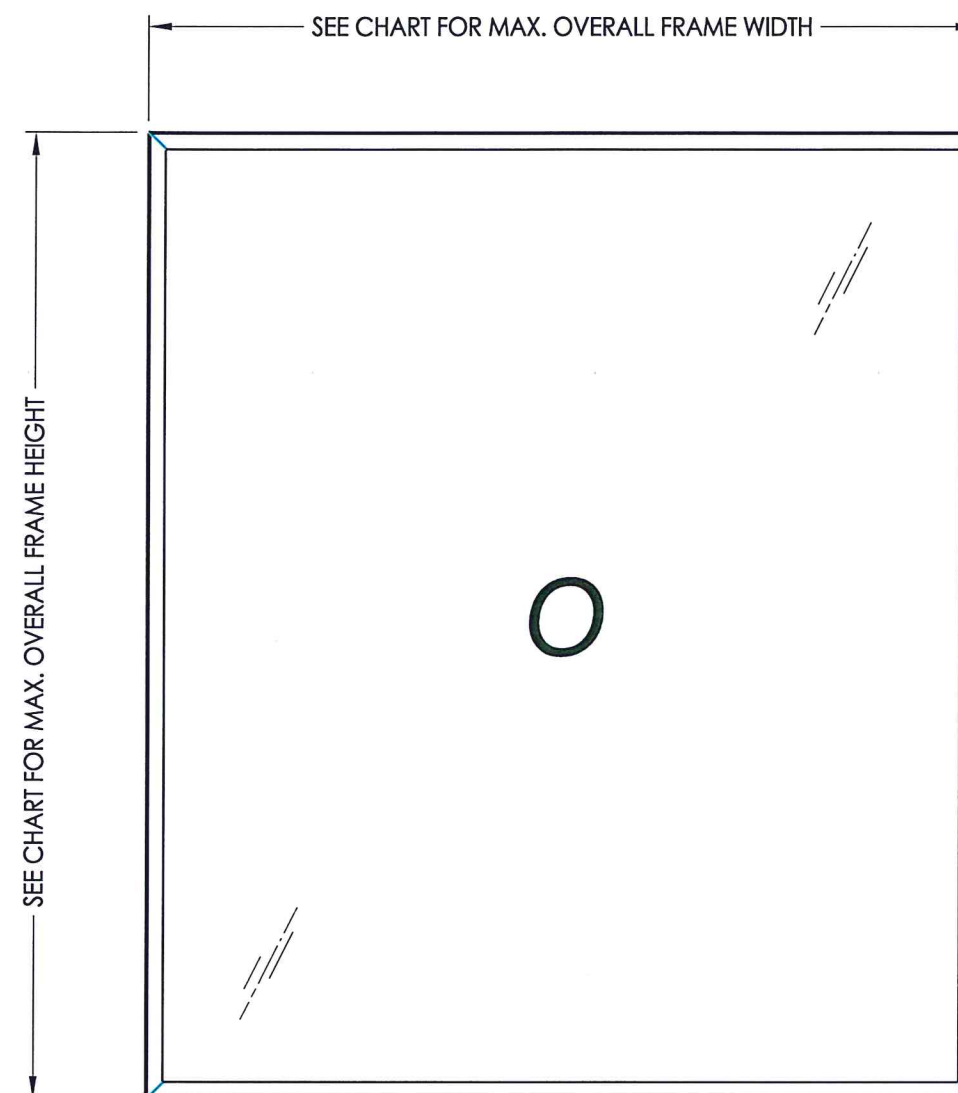


MAX. OVERALL FRAME DIMENSION	MAX DAY LITE DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POS.	NEG.
59.06" X 59.06"	56.06" x 56.06"	G1	+40.0	-40.0
59.19" X 63.25"	56.19" x 60.25"	G2	+50.0	-50.0
72.0" X 84.19"	69.0" x 81.19"	G3	+60.0	-65.0

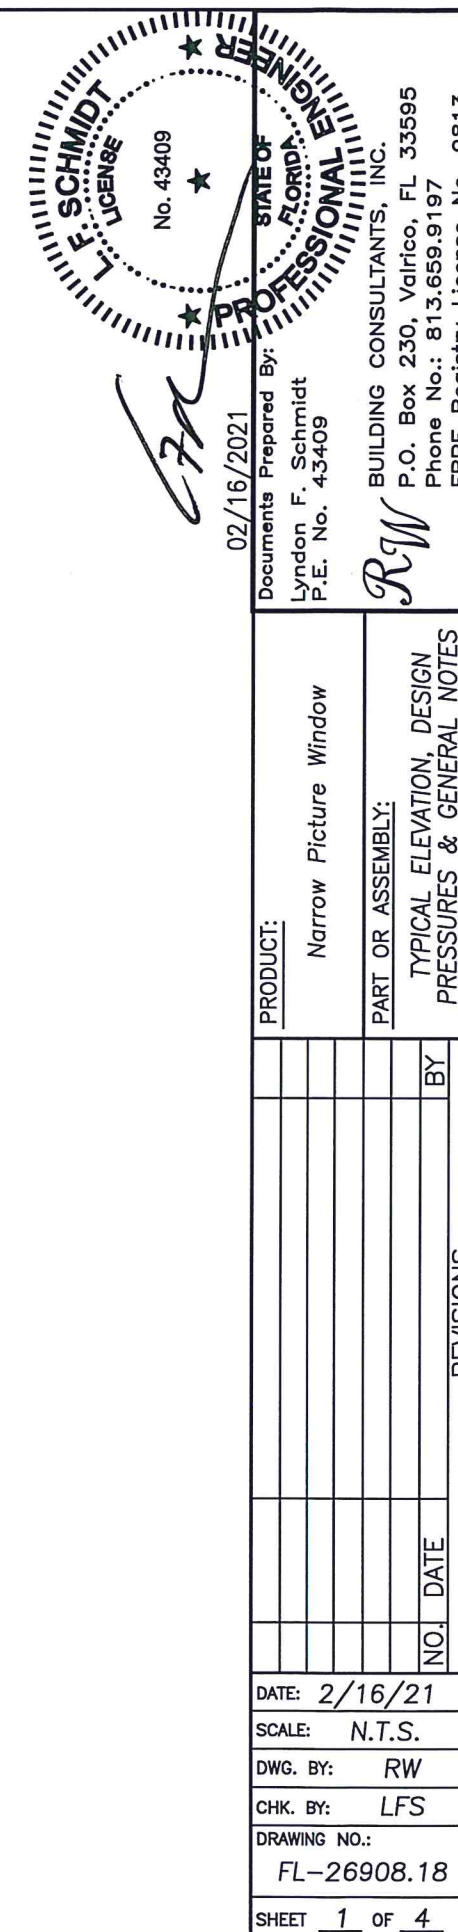

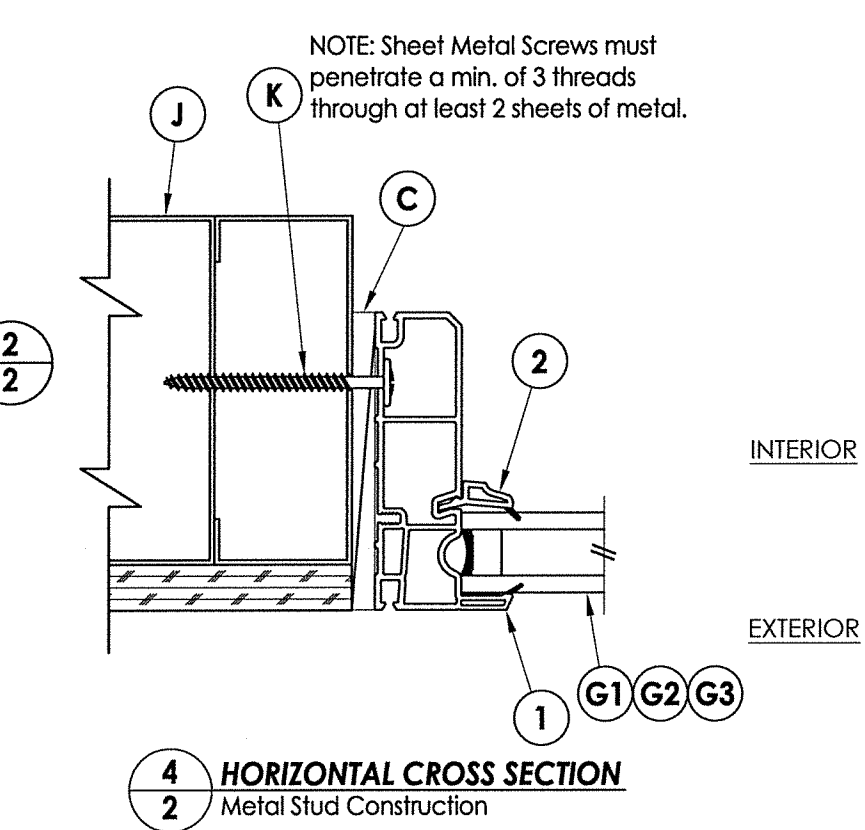

NOTE: Sheet Metal Screws must penetrate a min. of 3 threads through at least 2 sheets of metal.

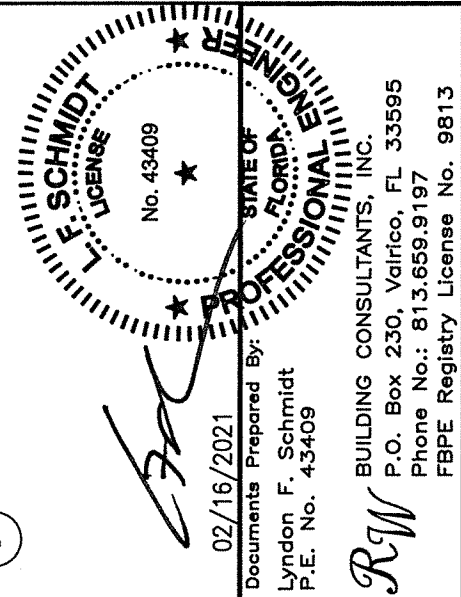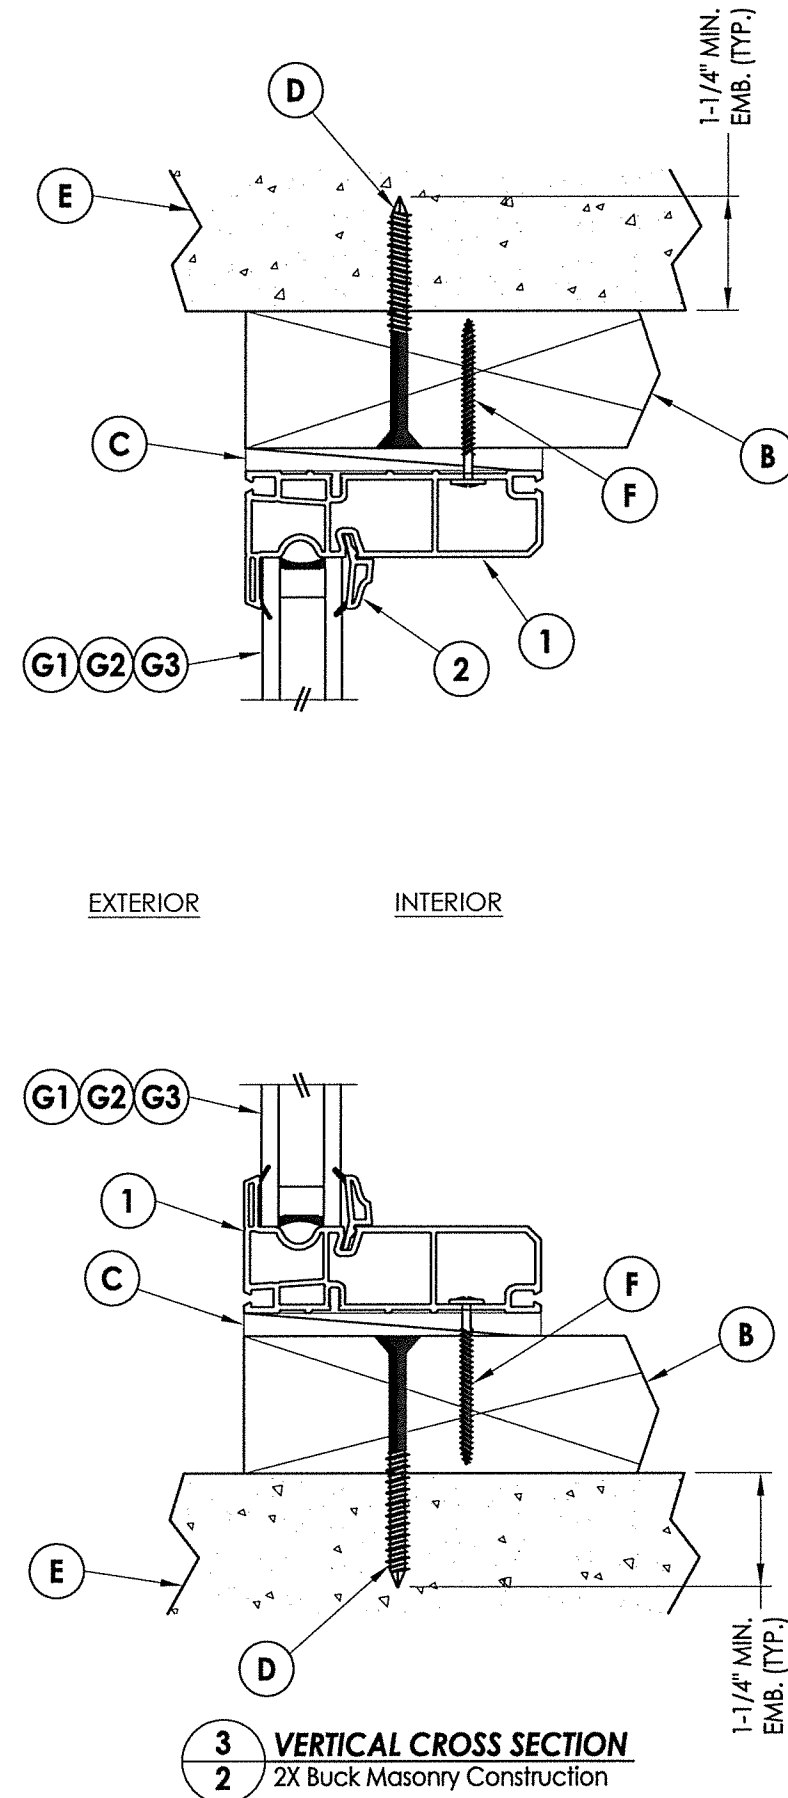

<u>PRODUCT:</u>	Narrow Picture Window	<u>PART OR ASSEMBLY:</u>	VERTICAL & HORIZONTAL CROSS SECTIONS
DATE:	2/16/21		
SCALE:	N.T.S.		
DWG. BY:	RW		
CHK. BY:	LFS		
DRAWING NO.:	FL-26908.18		
SHEET	2	OF	4

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

DATE: 2/16/21

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:

FL-26908.18


SHEET 3 OF 4

© 2021 R.W. BUILDING CONSULTANTS INC.


Z:\Clients\Sunrise Windows\A - Florida Product Approvals\FL-26908 - Fixed Window\C - Drawings\FL 26908 (2020)\FL-26908.18.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 X 1-3/4" MODIFIED TRUSS HEAD (7/16"Ø HEAD) SMS (1-3/8" MIN. EMBEDMENT)	STEEL
G	1/4" X 3-1/4" HWH DeWALT OR ITW CONCRETE SCREW	STEEL
J	STEEL STUD Min. Thk .033" (ASTM A653 GRADE 33 Fy=33 ksi min., Fu=45 ksi min.)	STEEL
K	#10 PPH SELF-DRILLING SMS	STEEL
1	EXTRUDED VINYL FRAME *	RIGID PVC
2	EXTRUDED VINYL GLAZING BEAD *	RIGID PVC


* THE APPROVED WHITE RIGID PVC EXTERIOR EXTRUSIONS FOR WINDOWS ARE TO BE PRODUCED BY EXTRUDERS LICENSEES IN "AAMA CERTIFICATION PROGRAMS FOR RIGID PVC EXTRUSIONS".

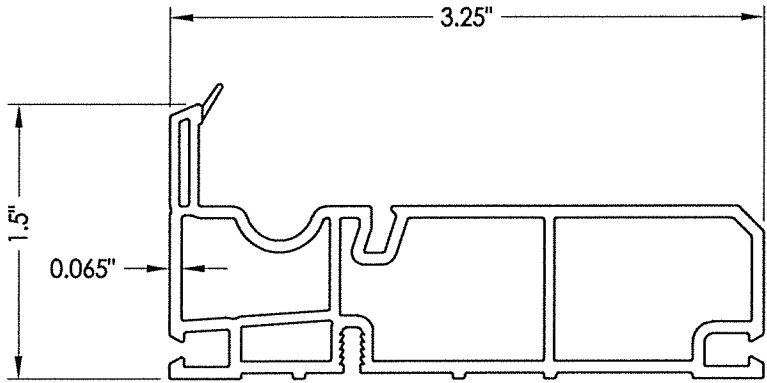


1 FRAME




2 GLAZING BEAD

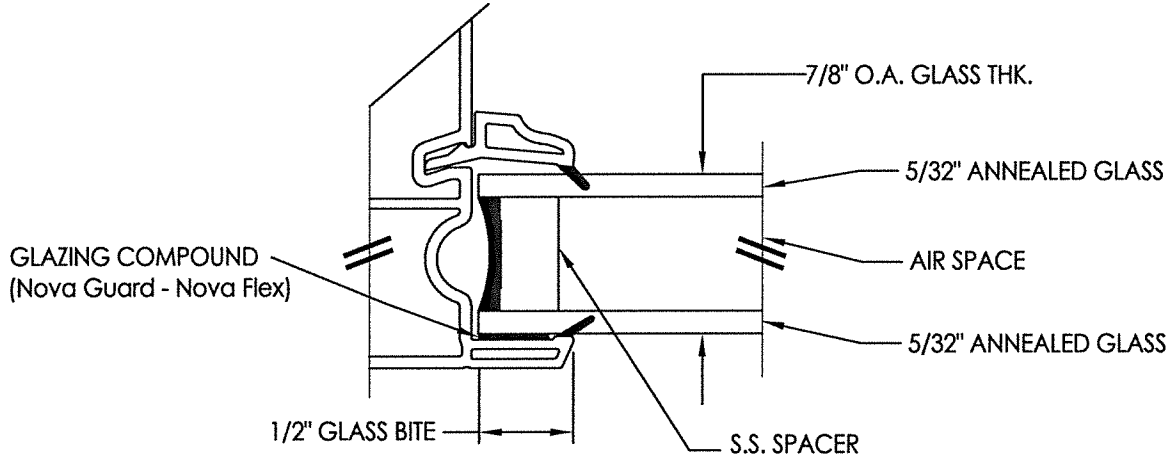


G2 GLAZING DETAIL

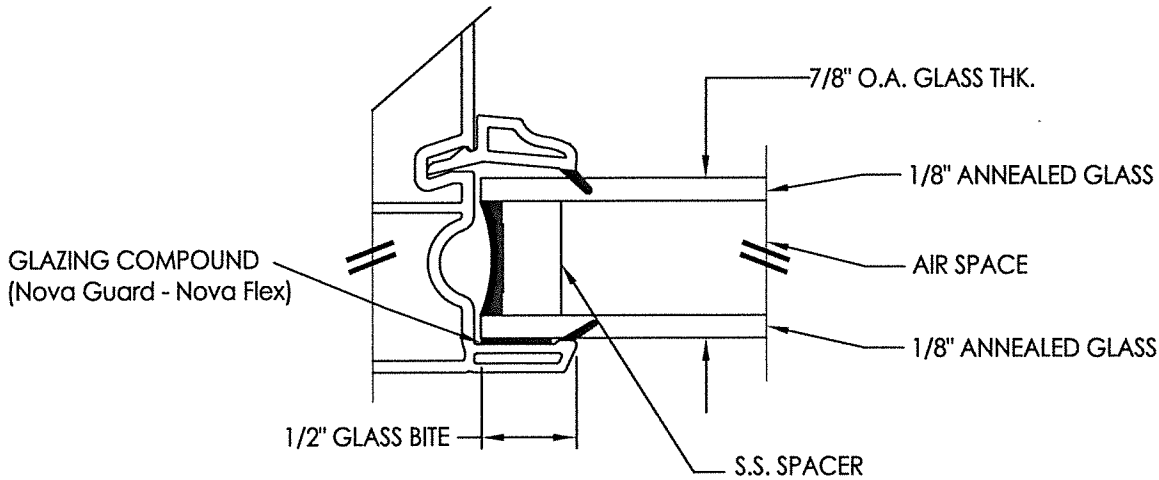

G1 GLAZING DETAIL

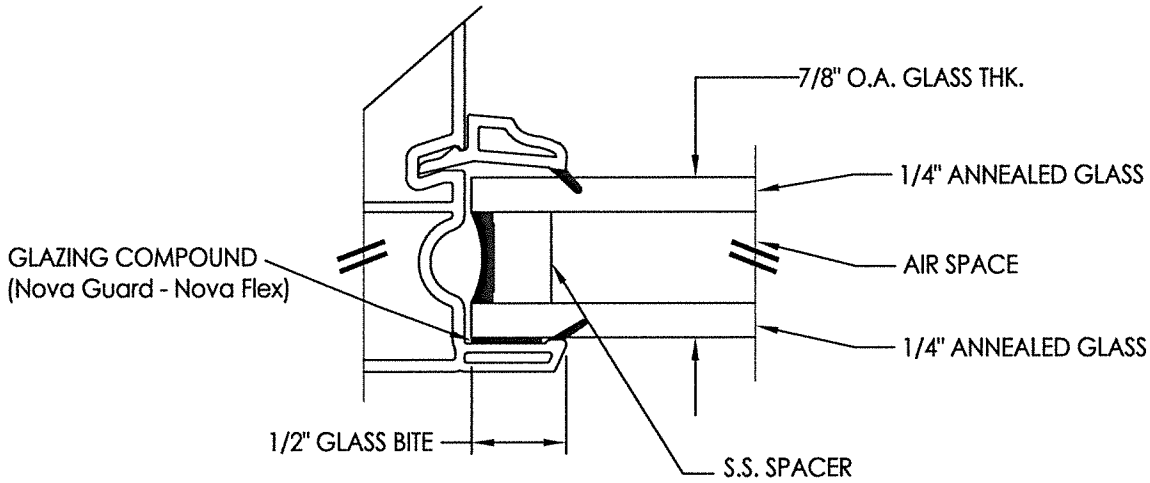

G3 GLAZING DETAIL

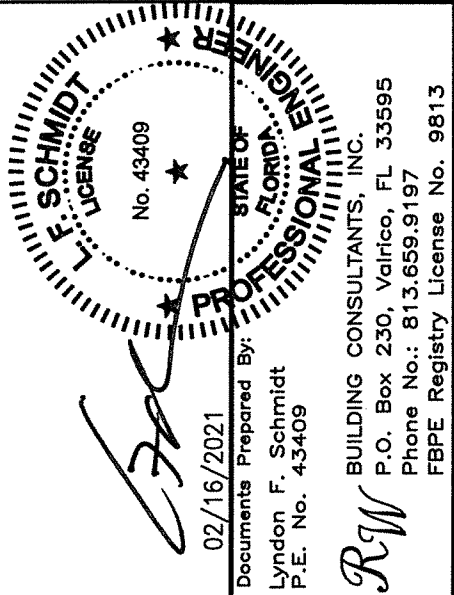

<u>PRODUCT:</u>		Narrow Picture Window	
<u>PART OR ASSEMBLY:</u>		BILL OF MATERIALS, COMPONENTS AND GLAZING DETAILS	